


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:27:31  
Page:6/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

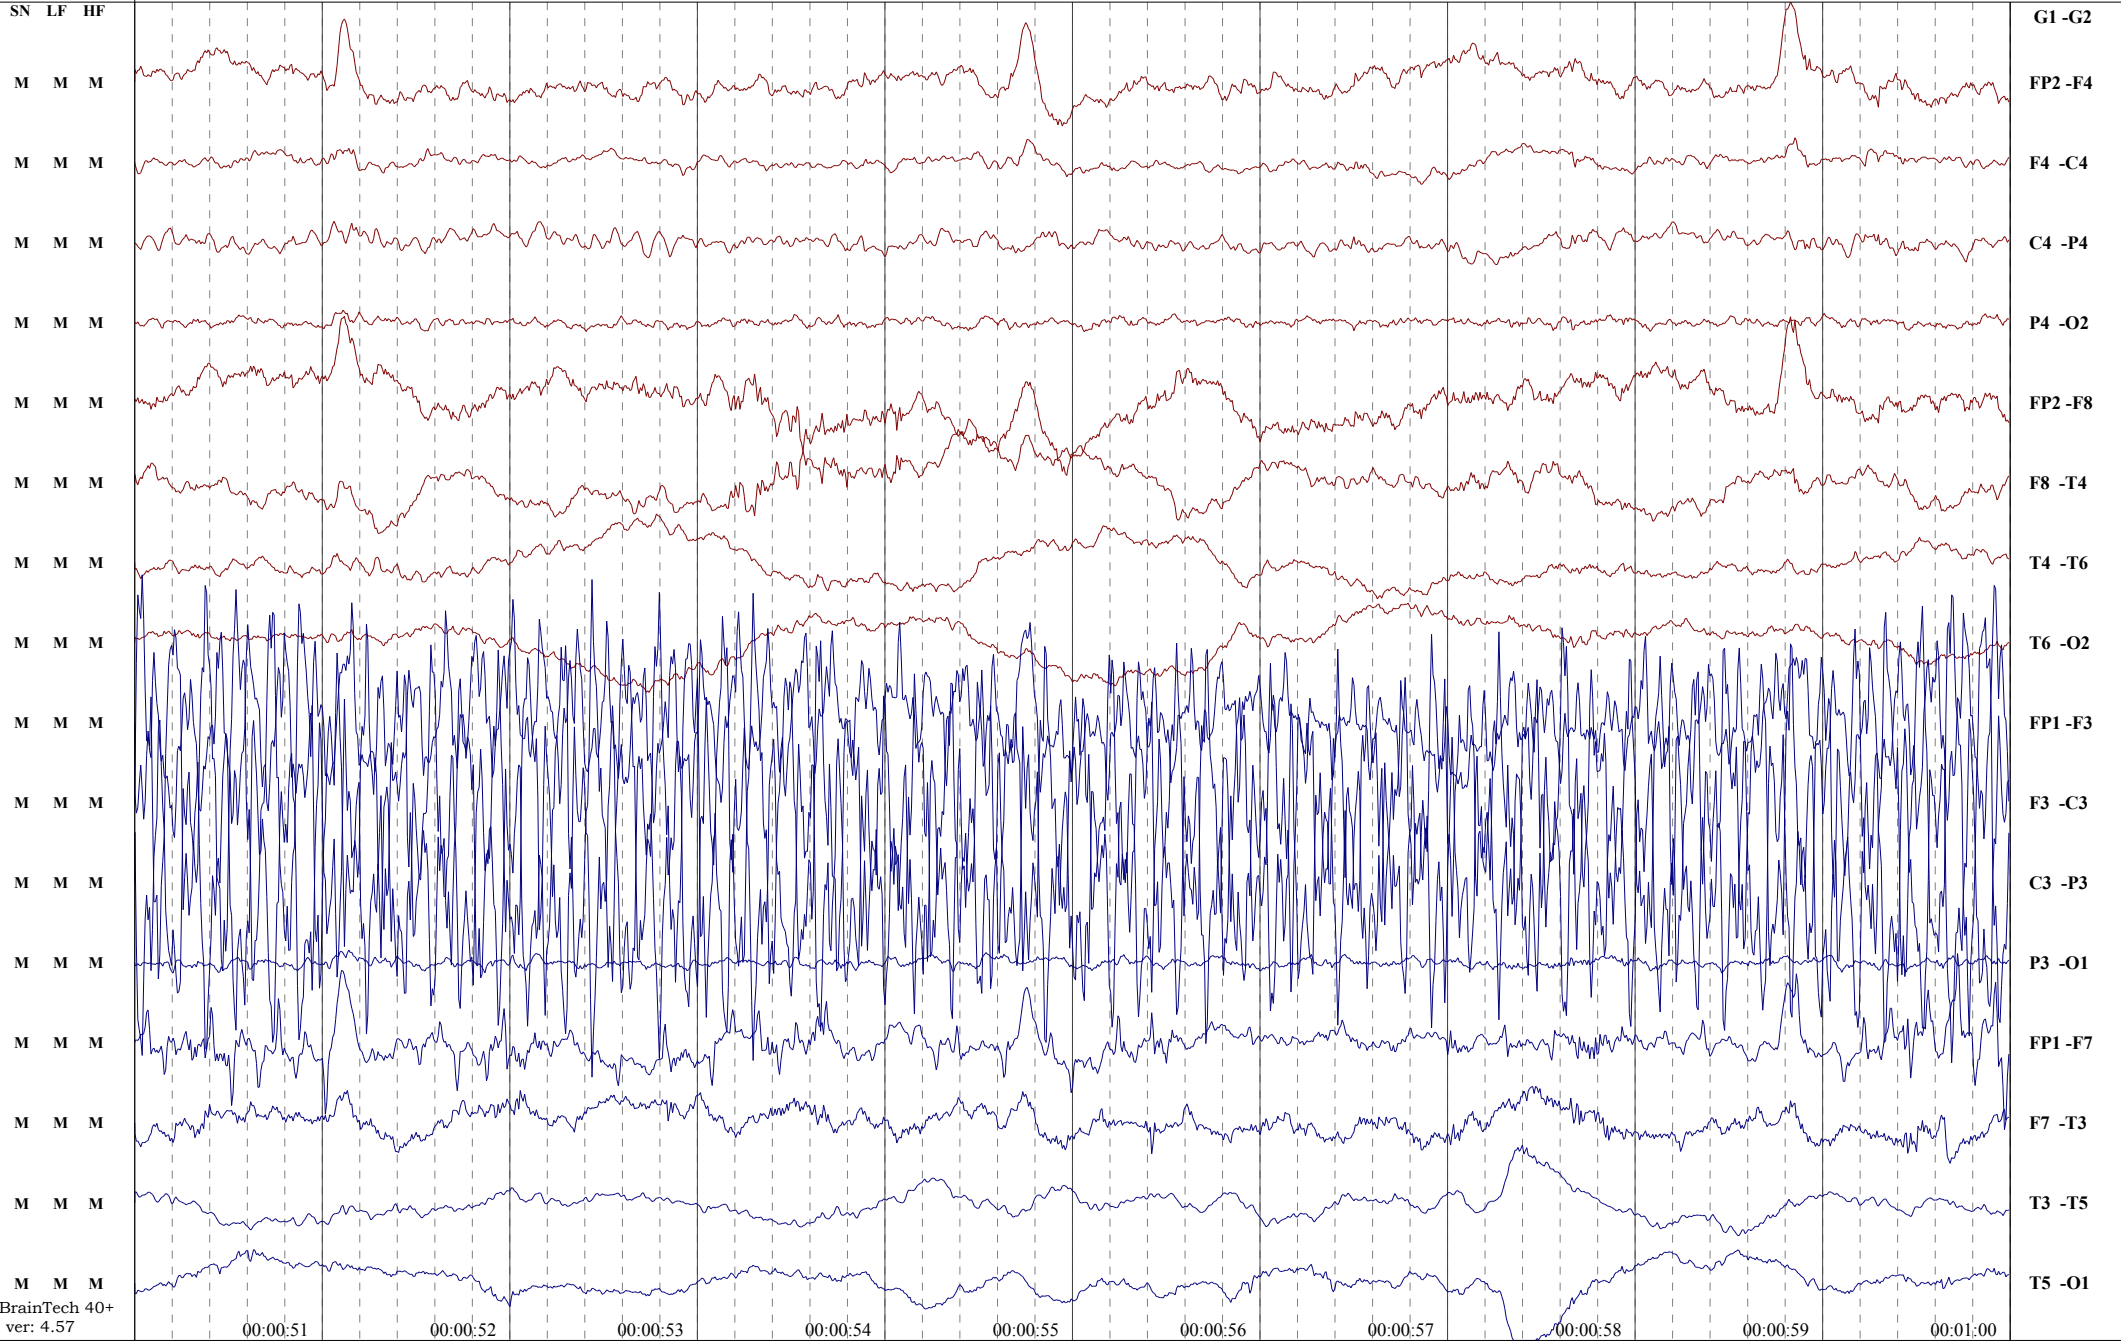


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:27:41  
Page:7/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

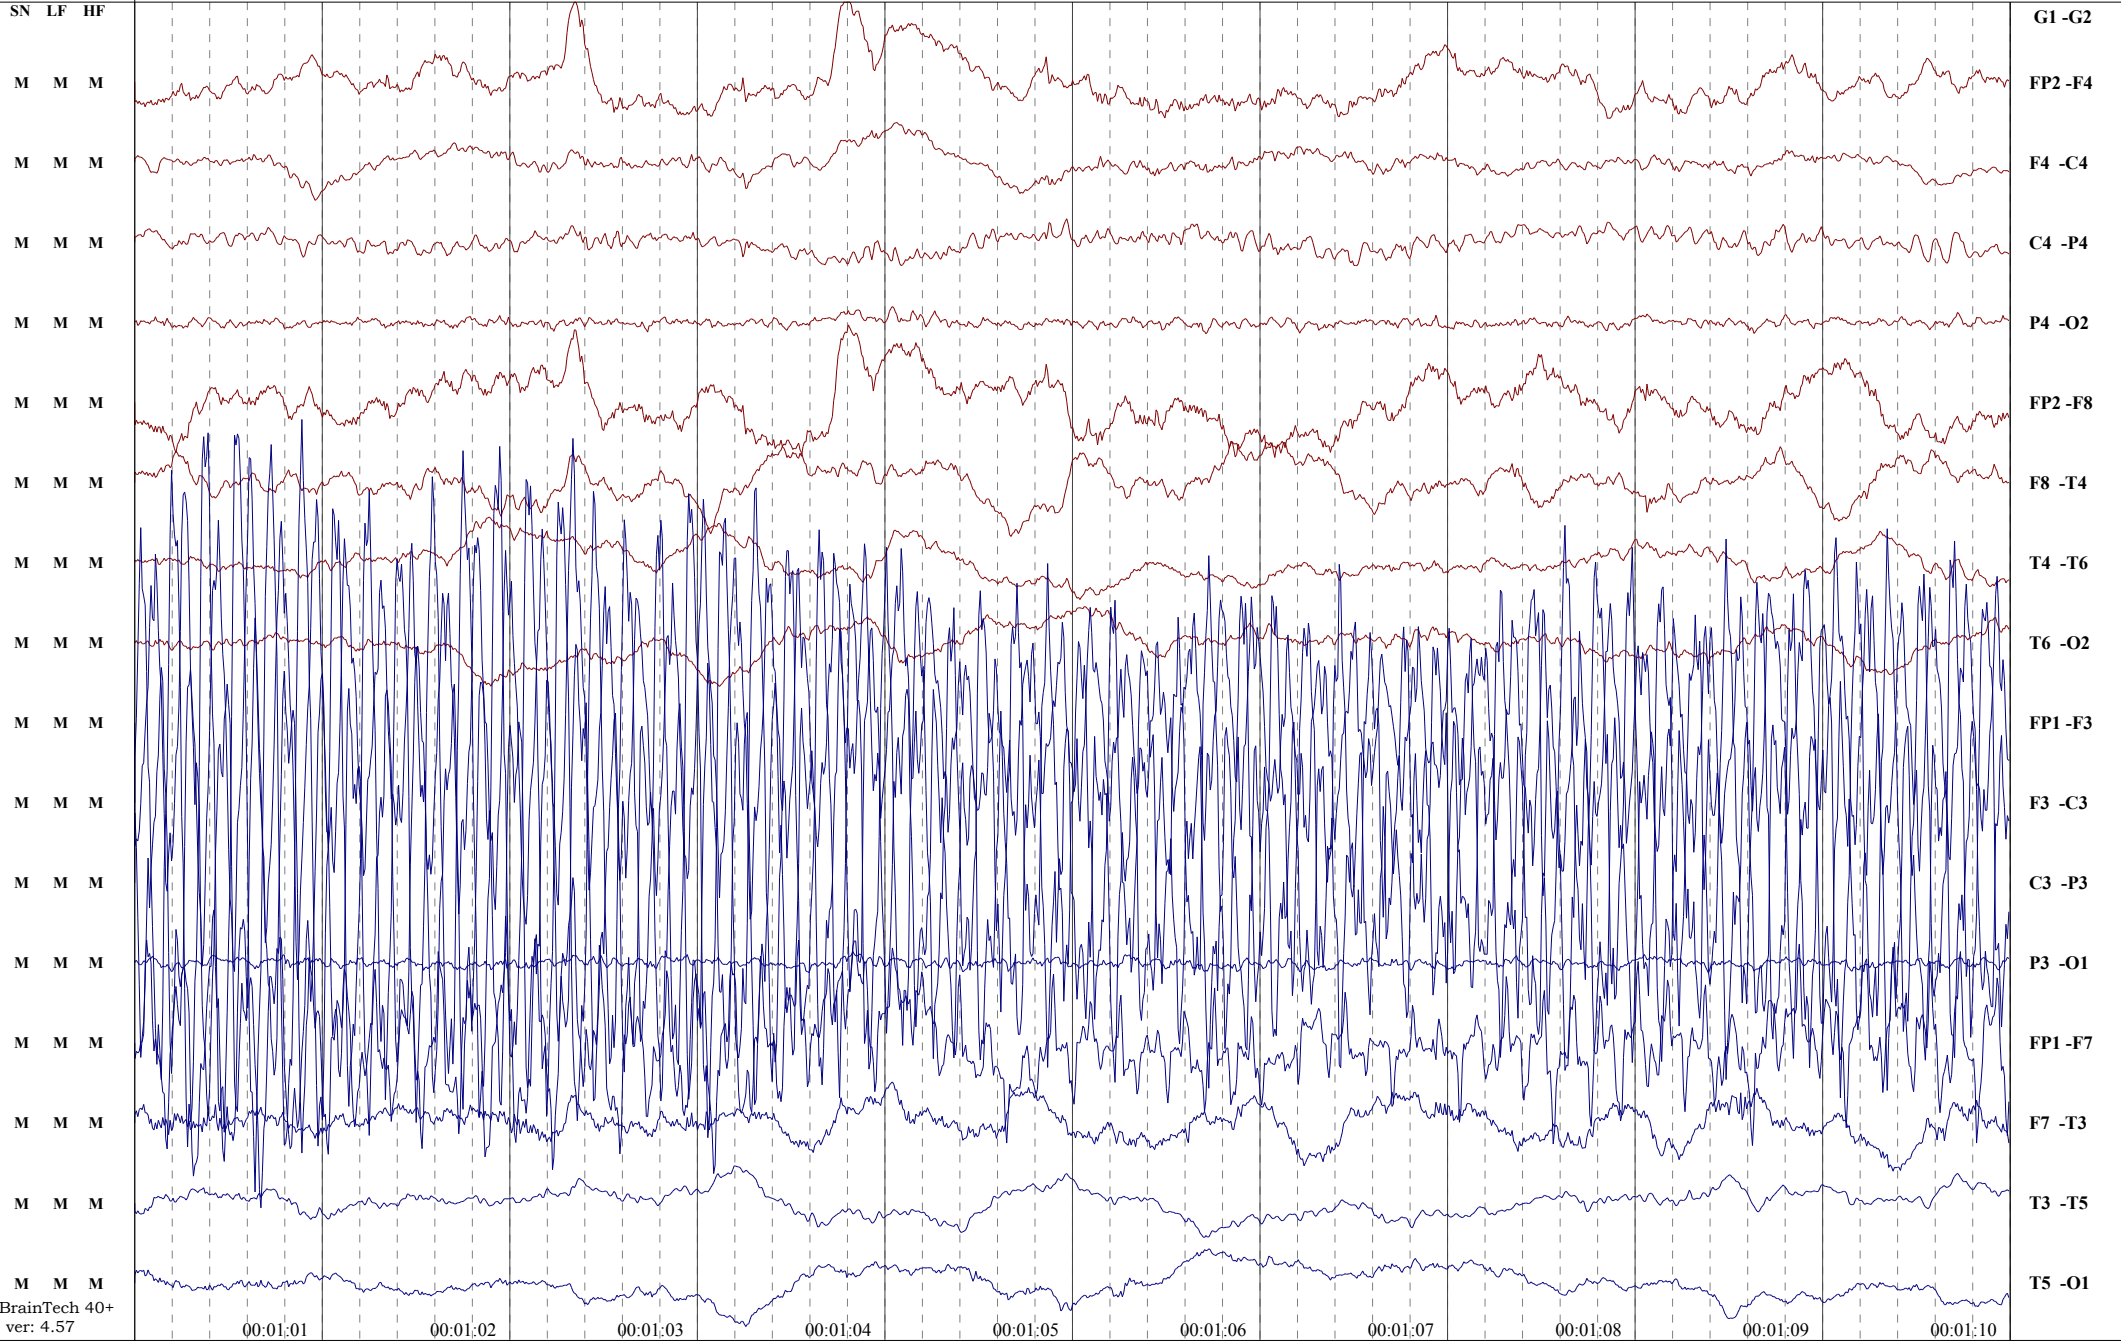




76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:27:51  
Page:8/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

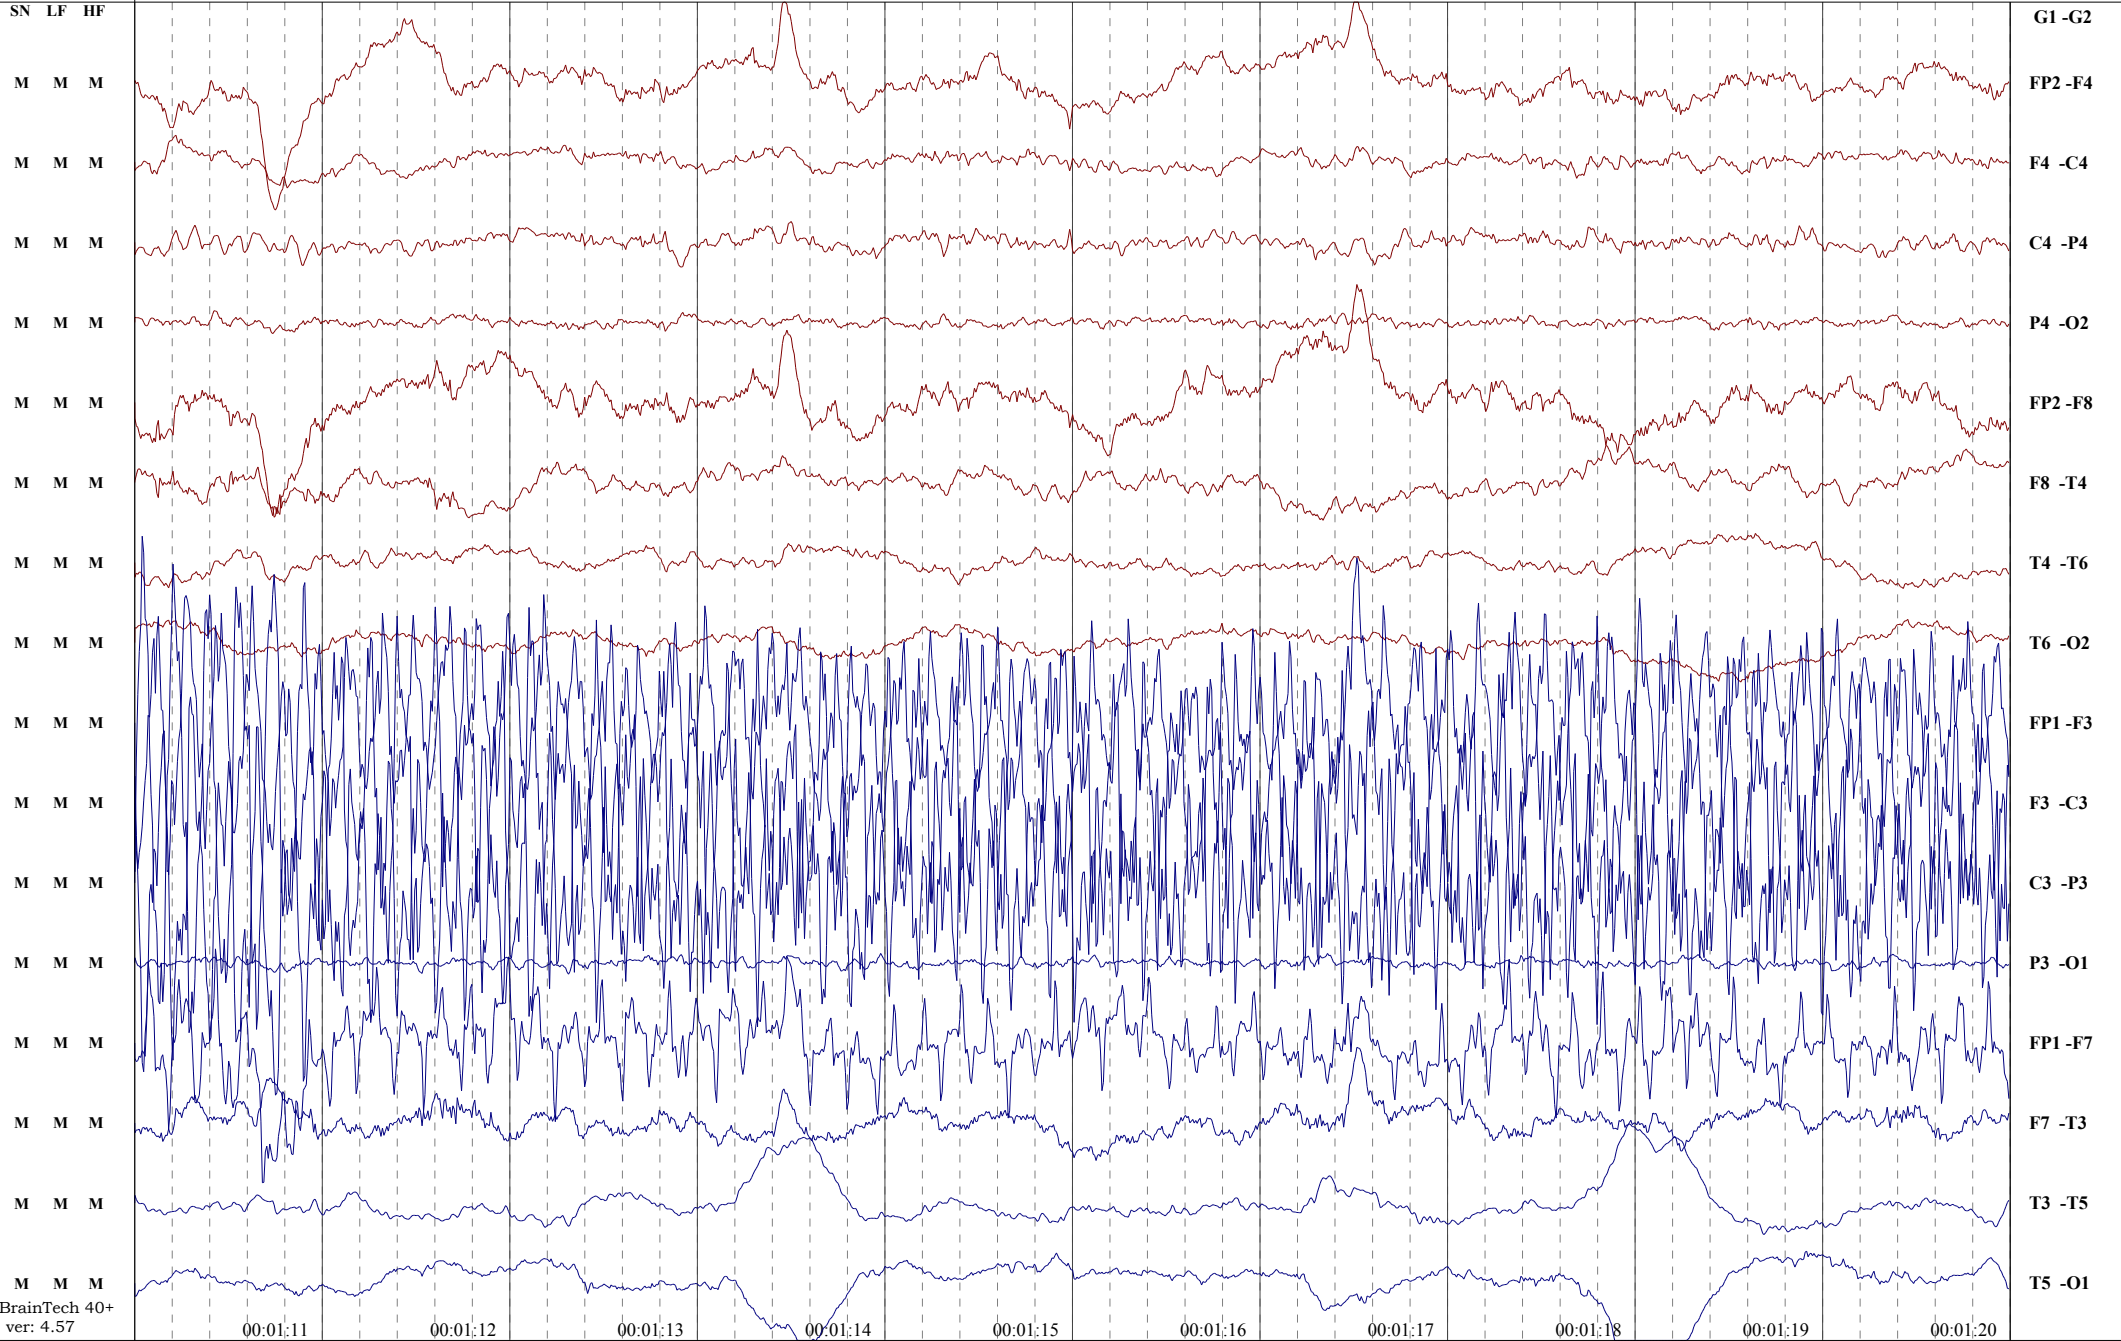

Clarity

PRATHAM HOSPITAL


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:28:01  
Page:9/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

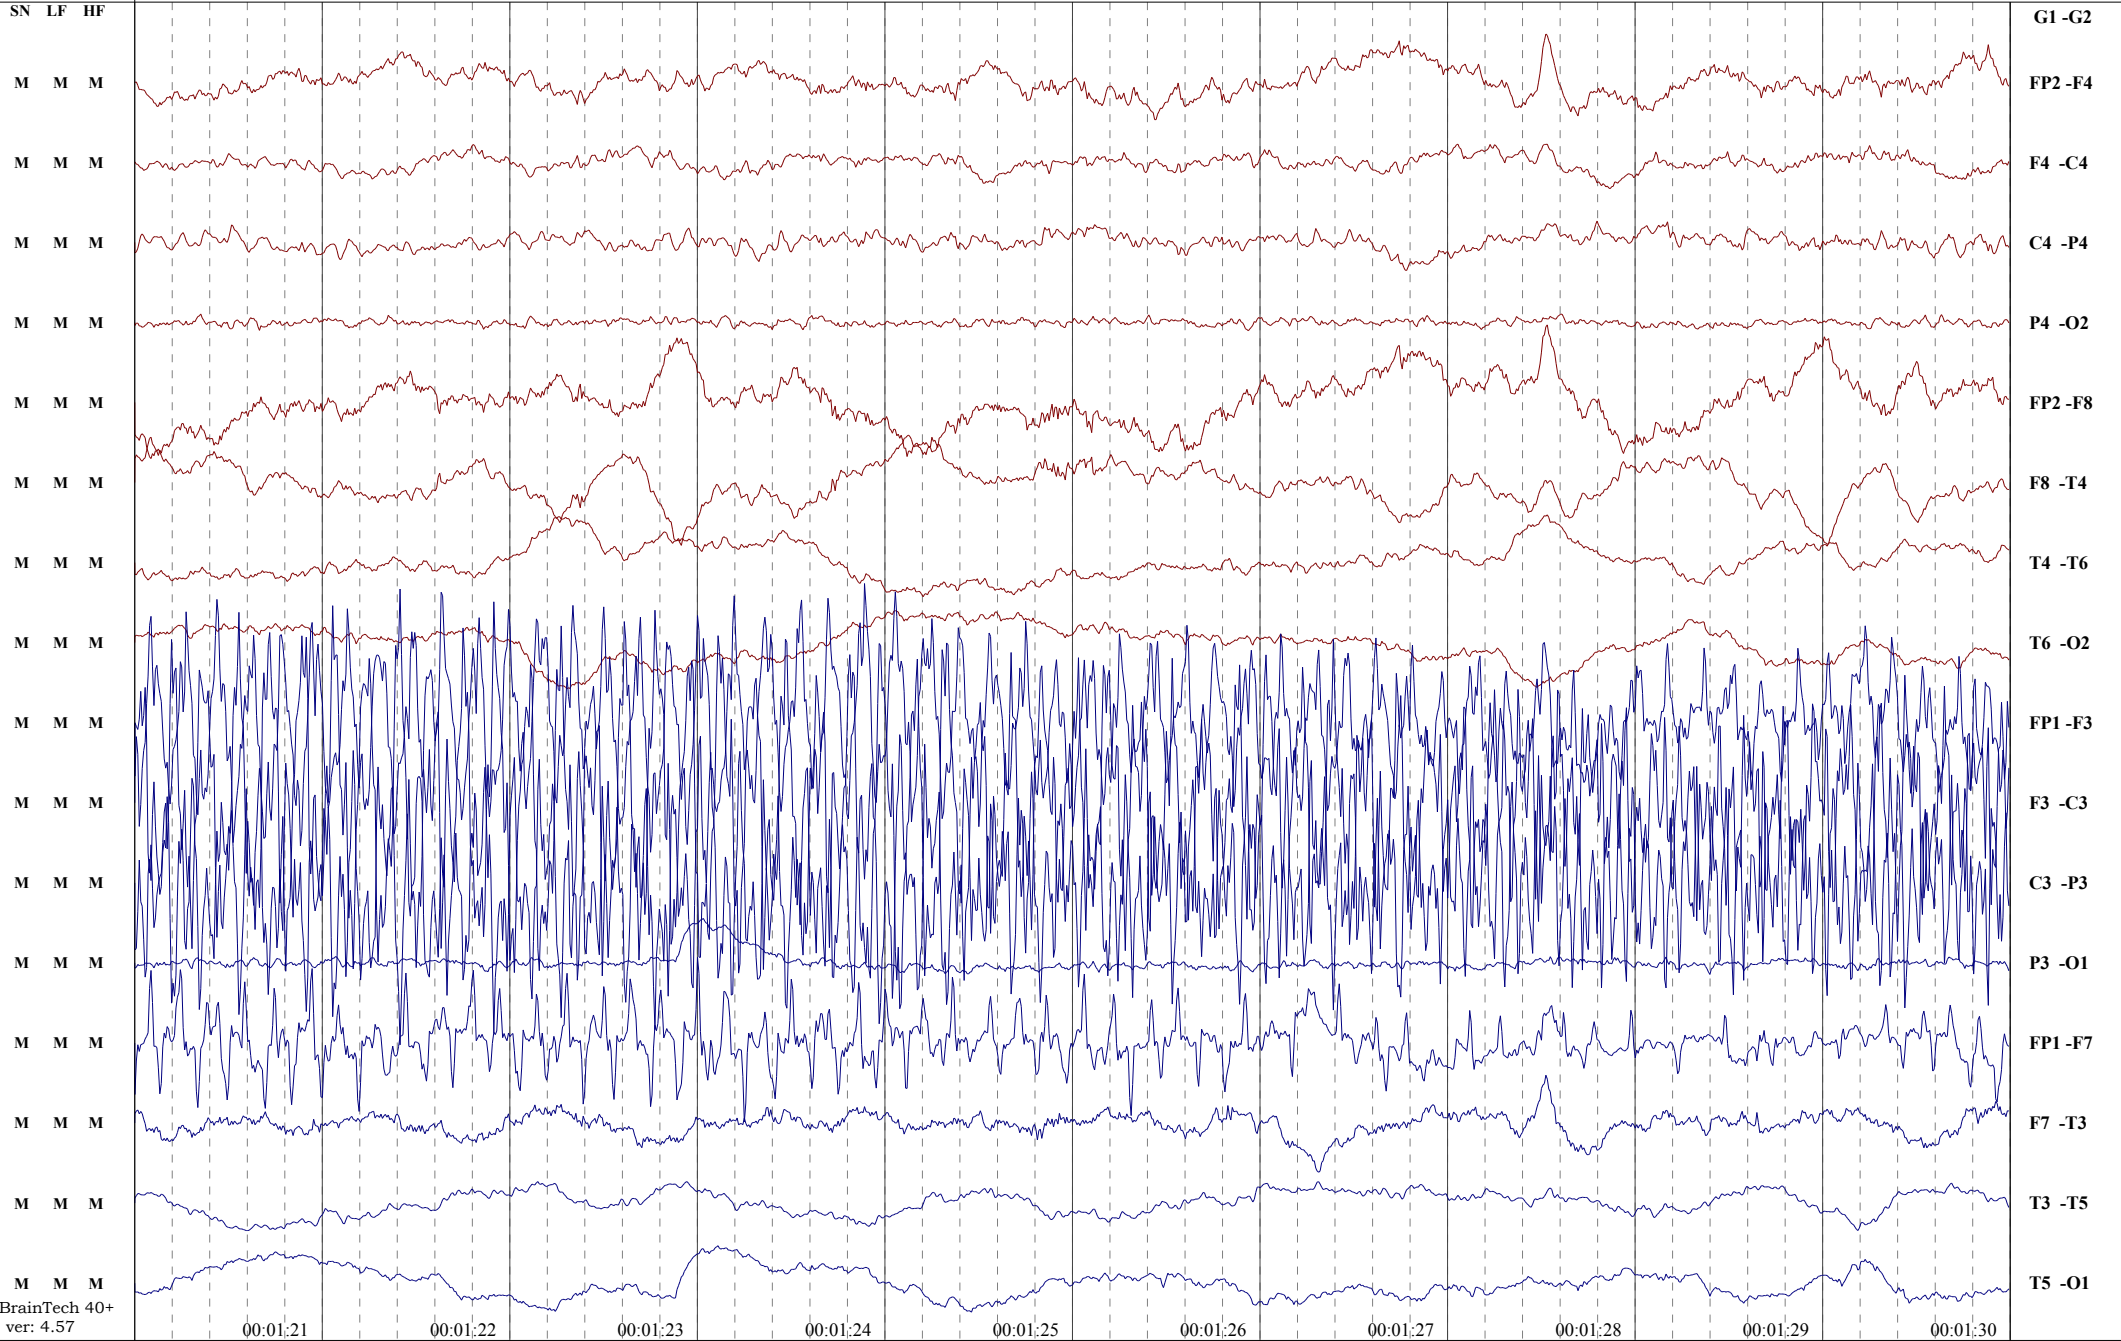


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL


Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz


Time: 16:28:11  
Page:10/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

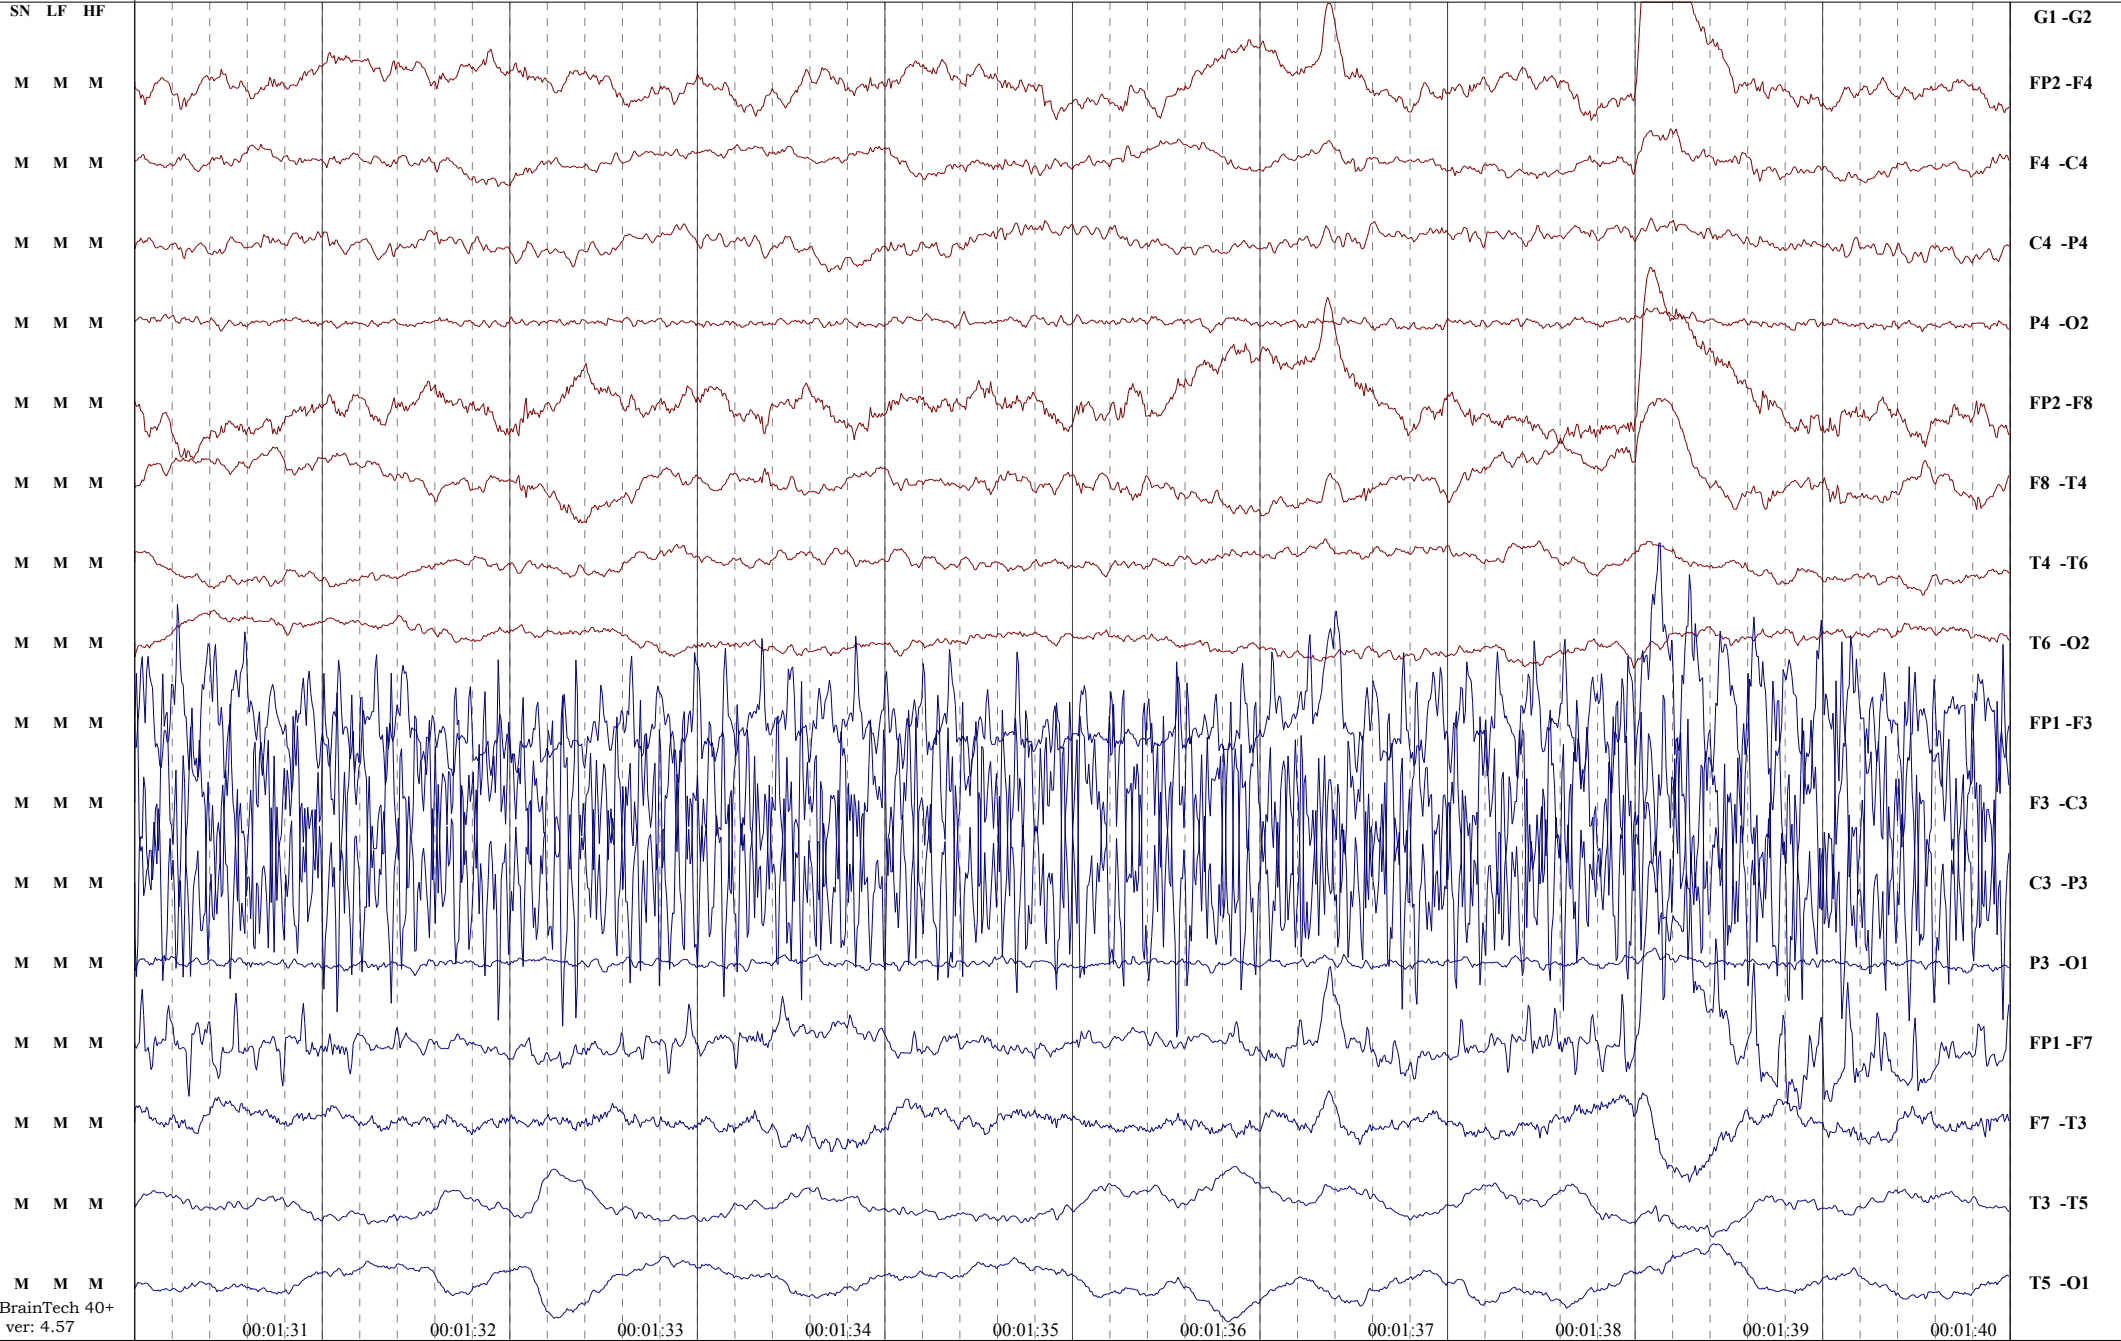



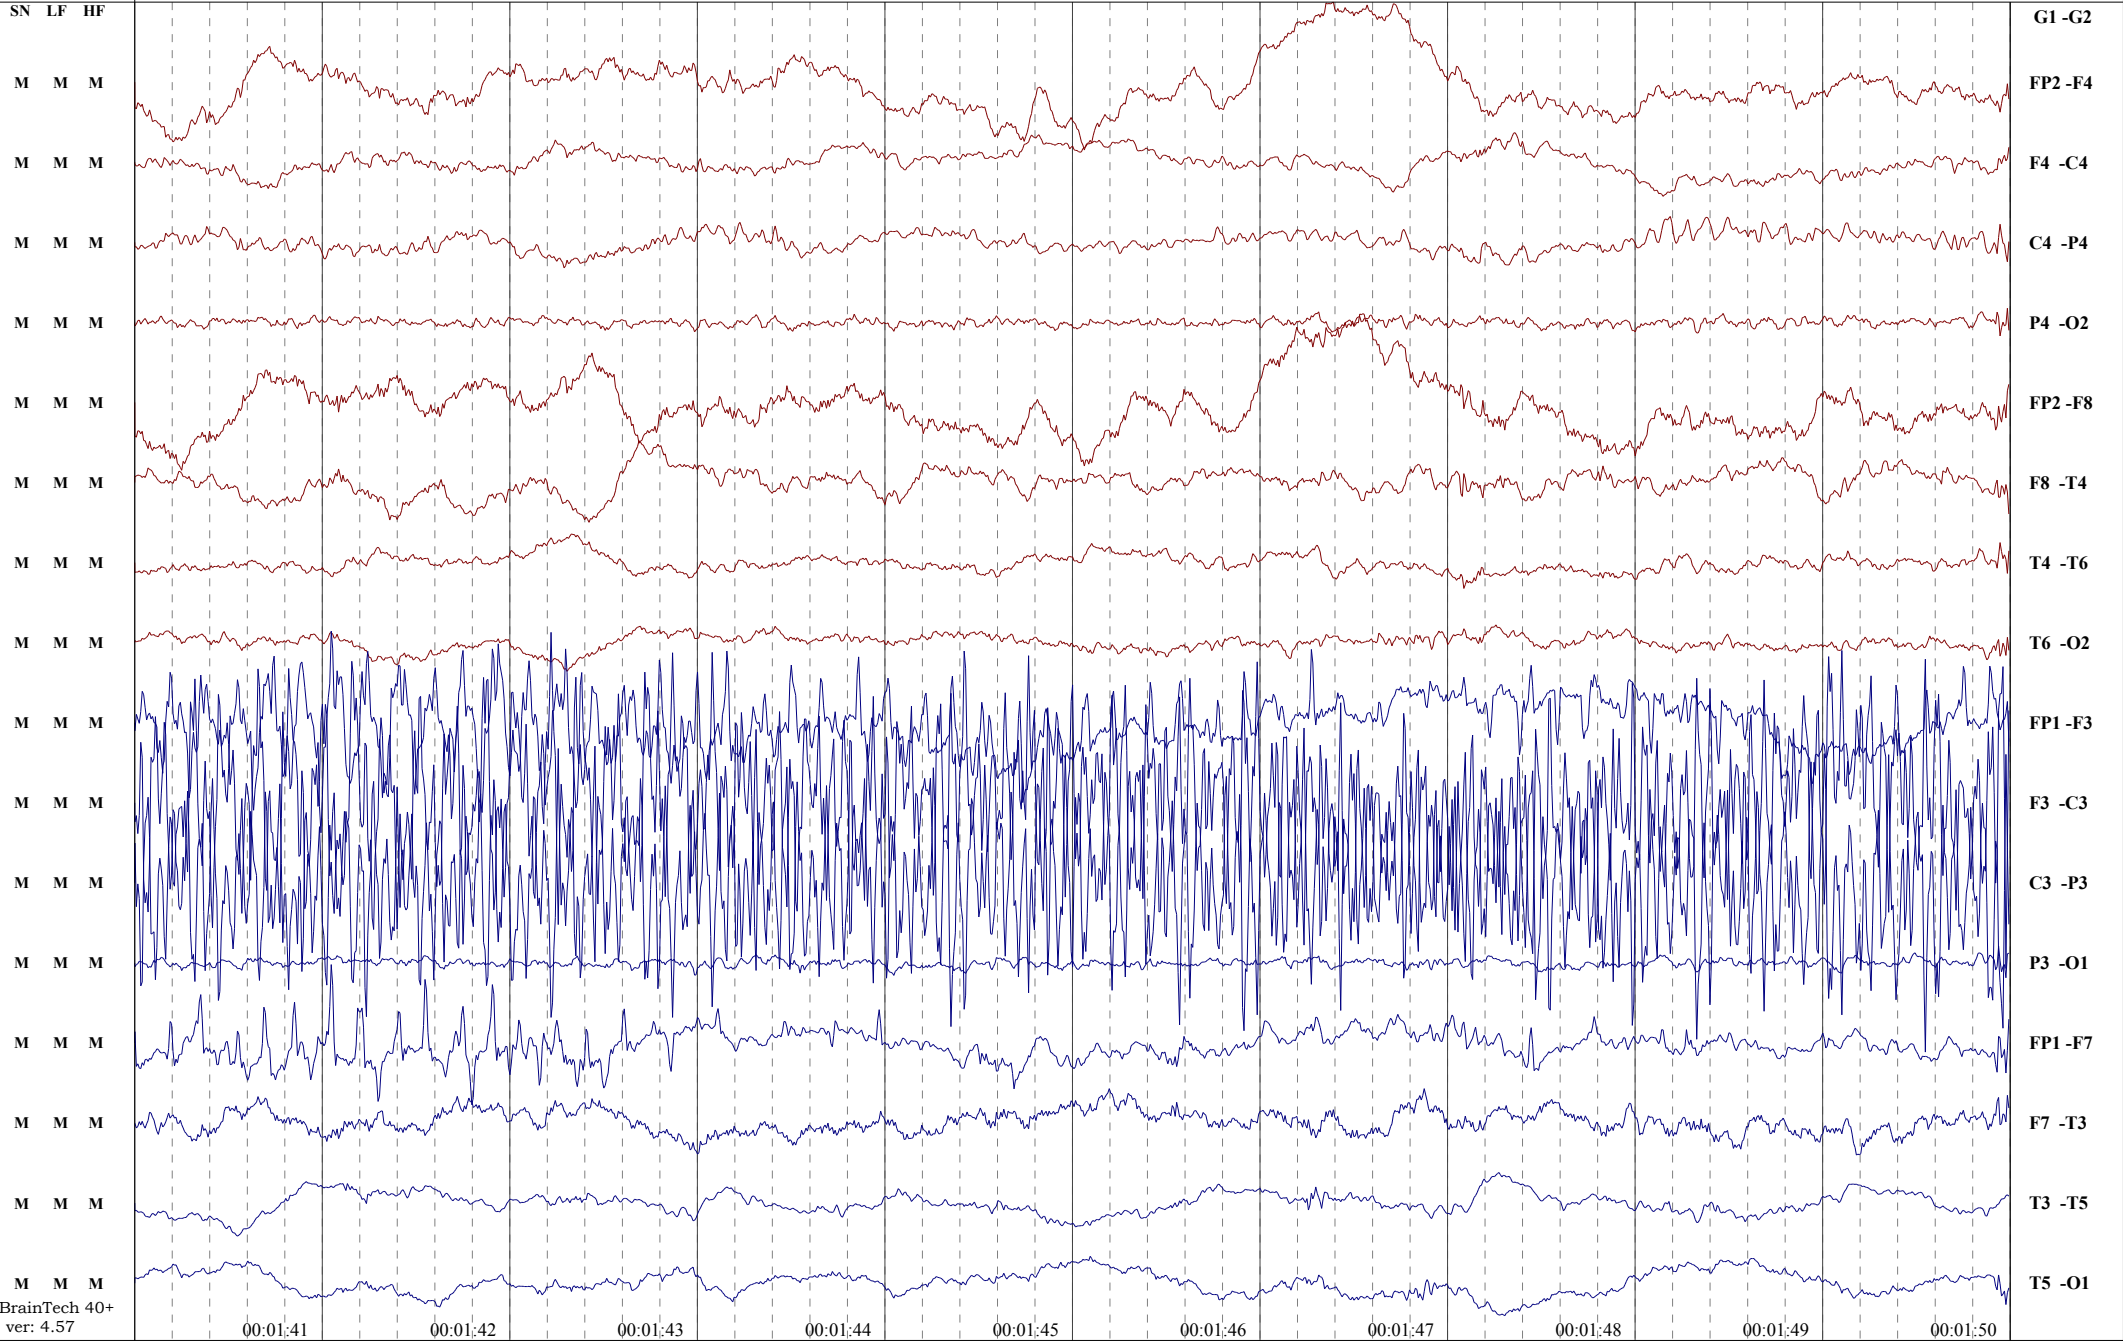

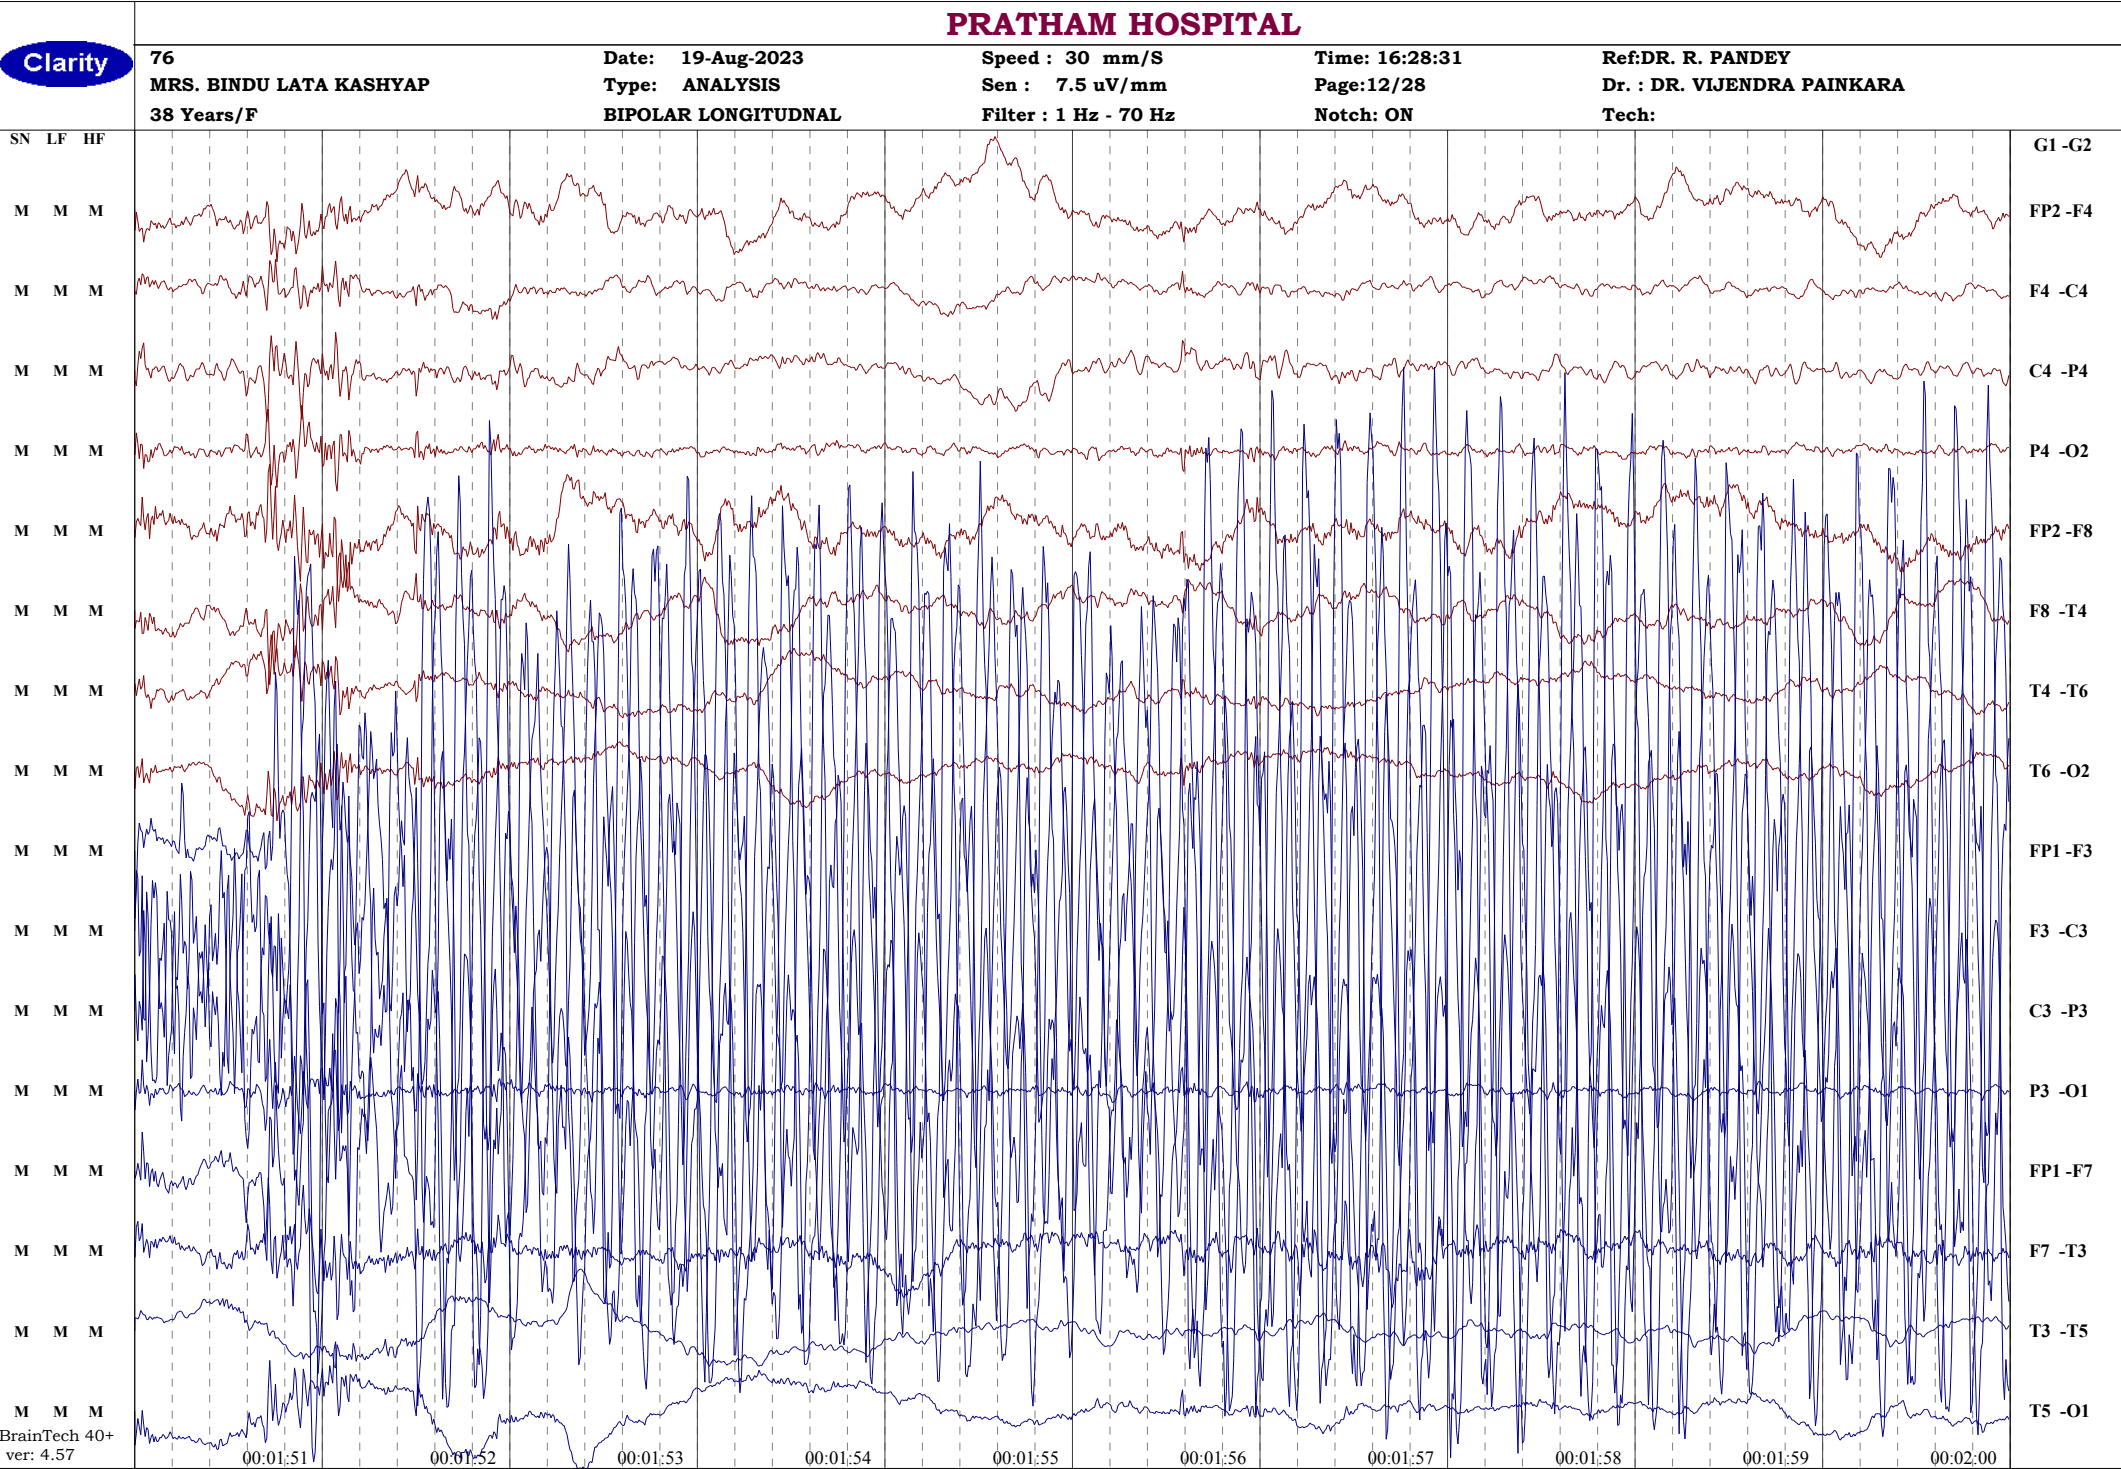




76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:28:41  
Page:13/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

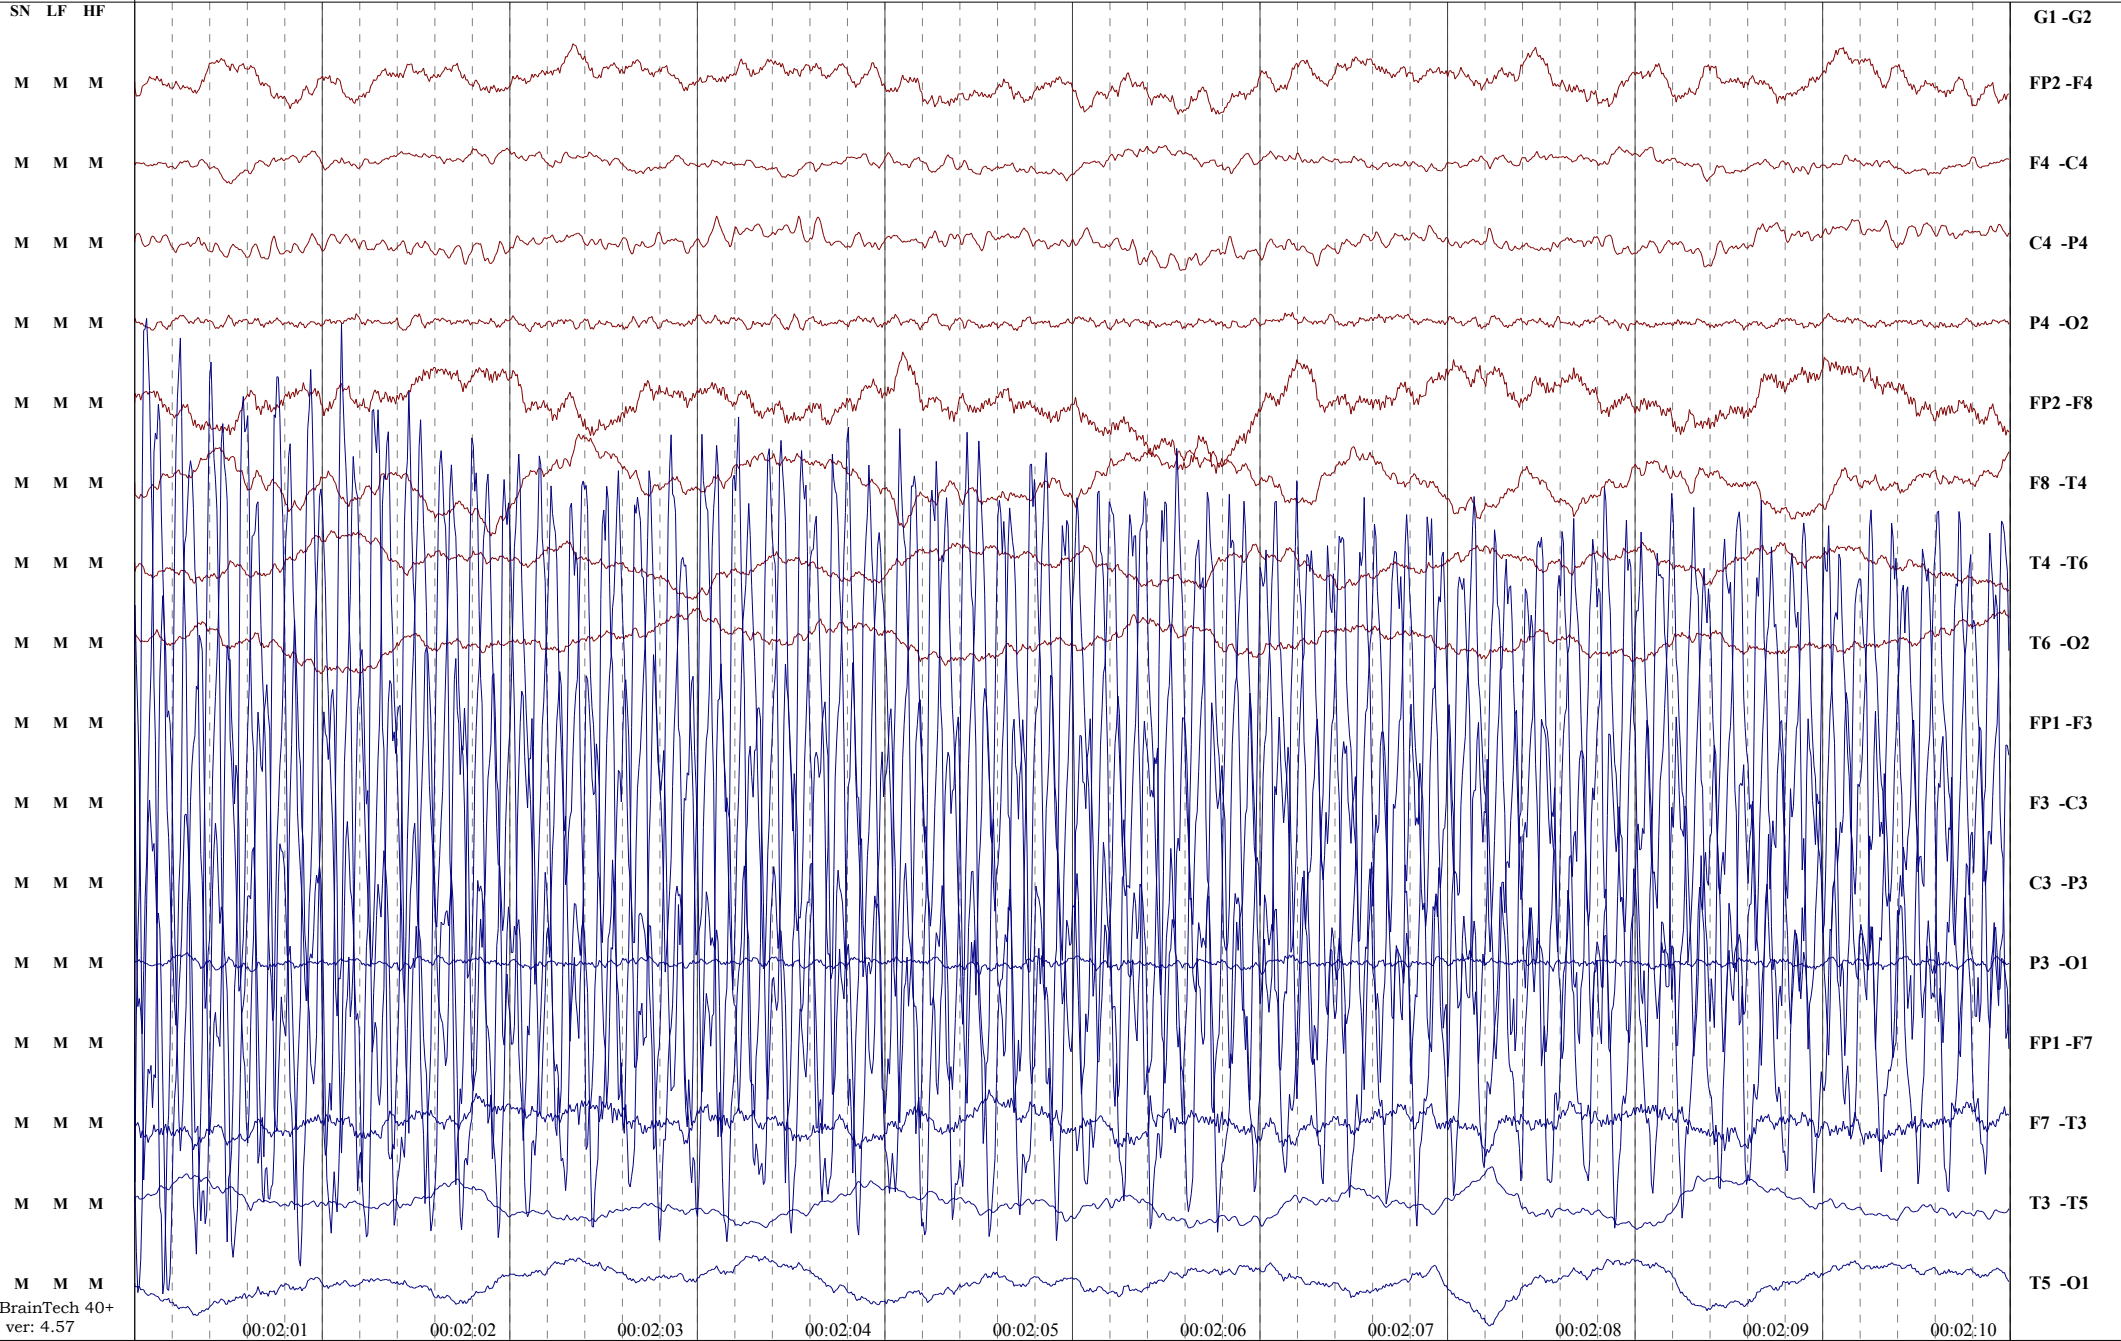


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:28:51  
Page:14/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

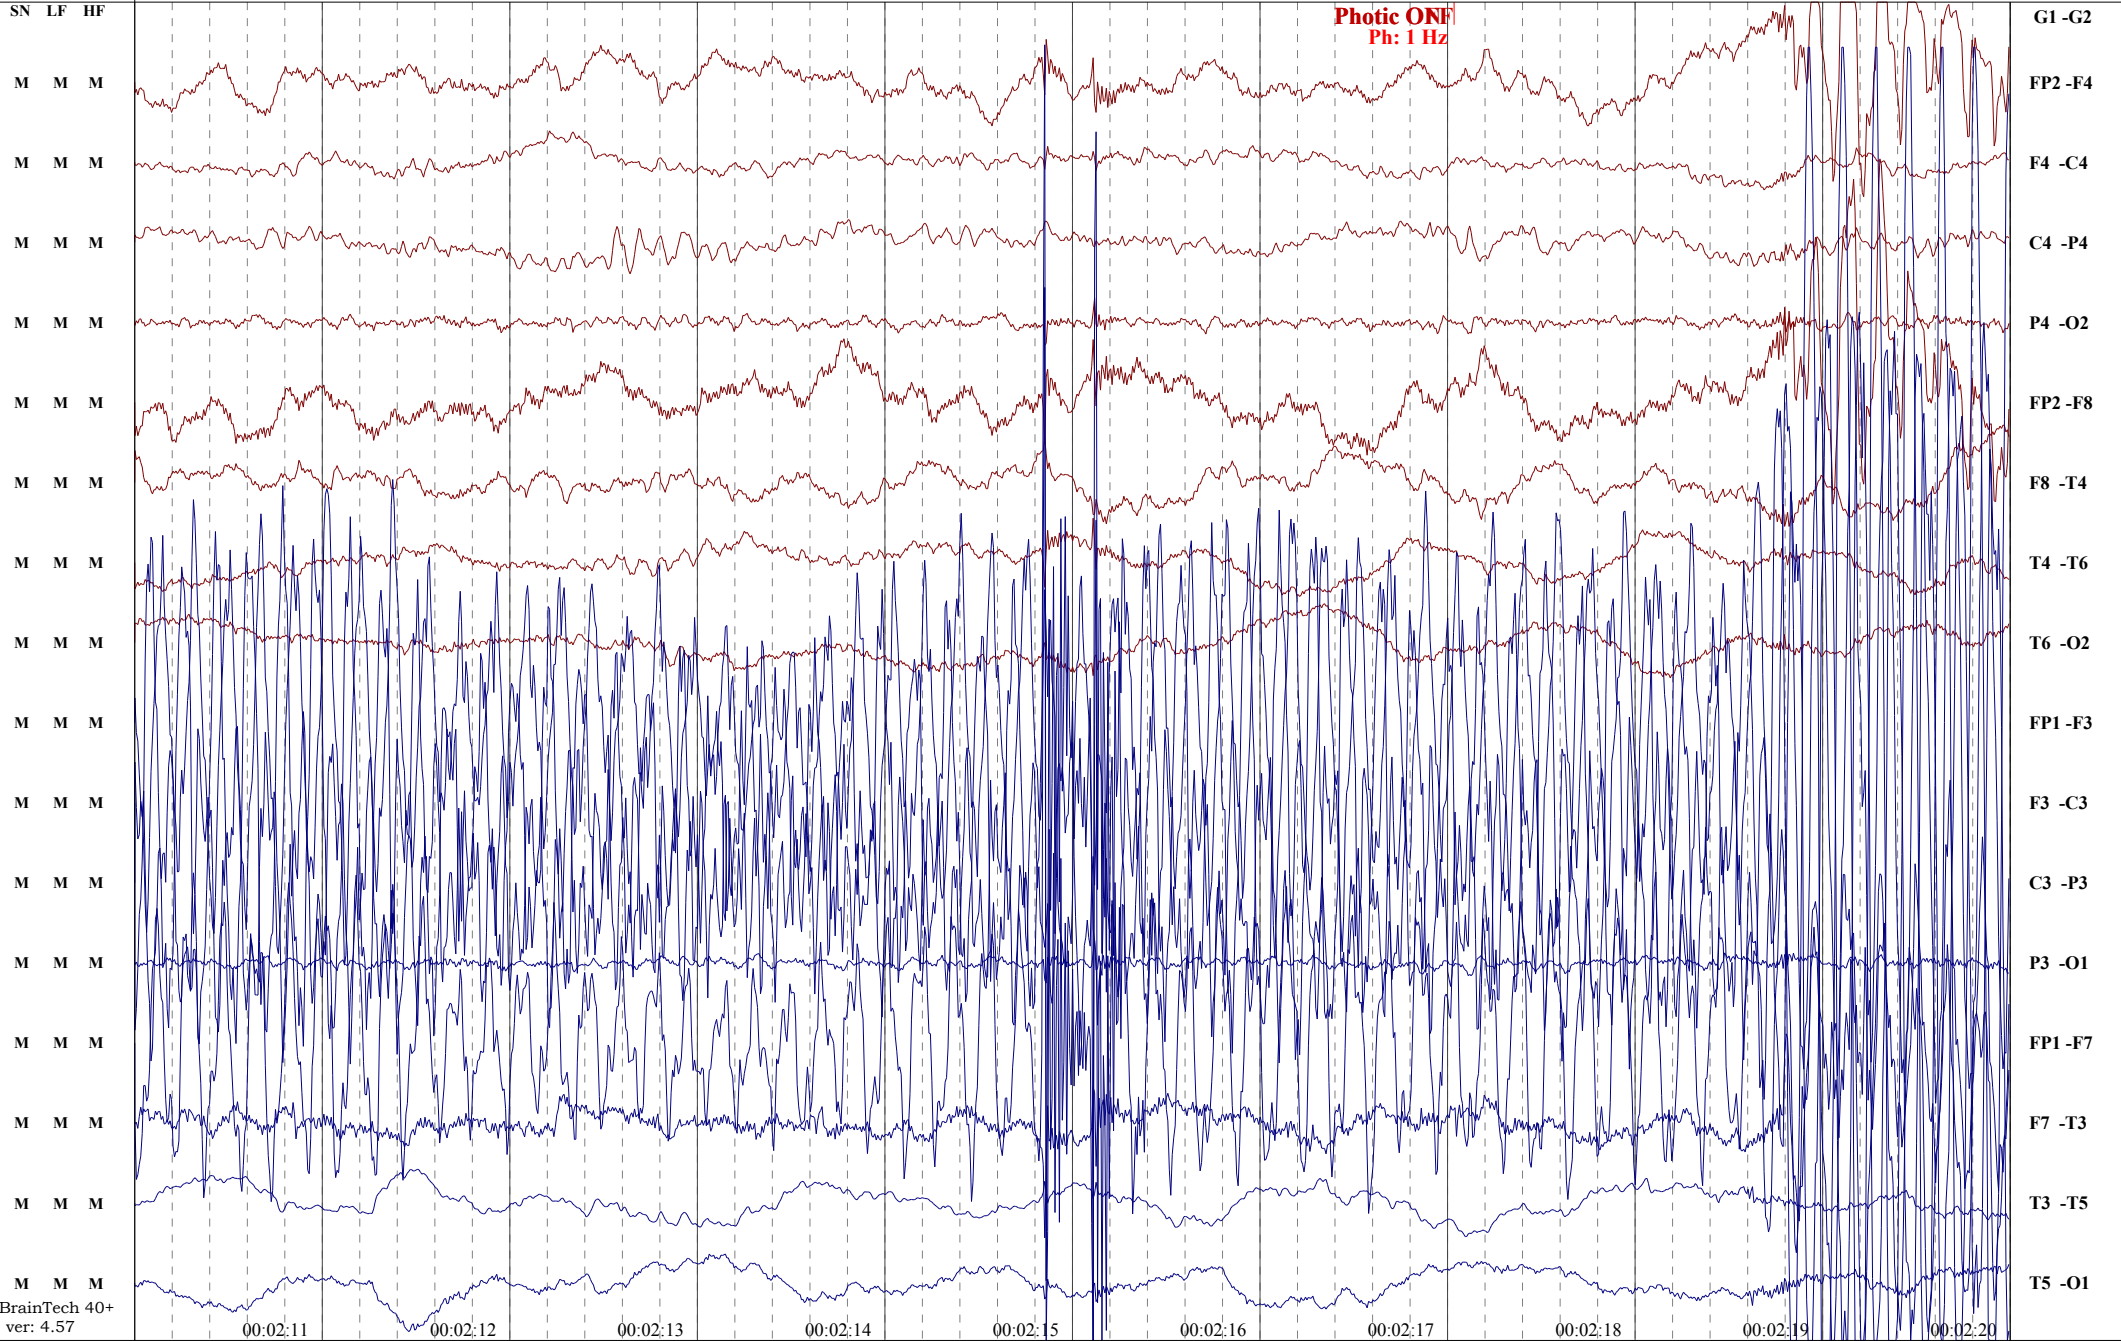


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:29:01  
Page:15/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

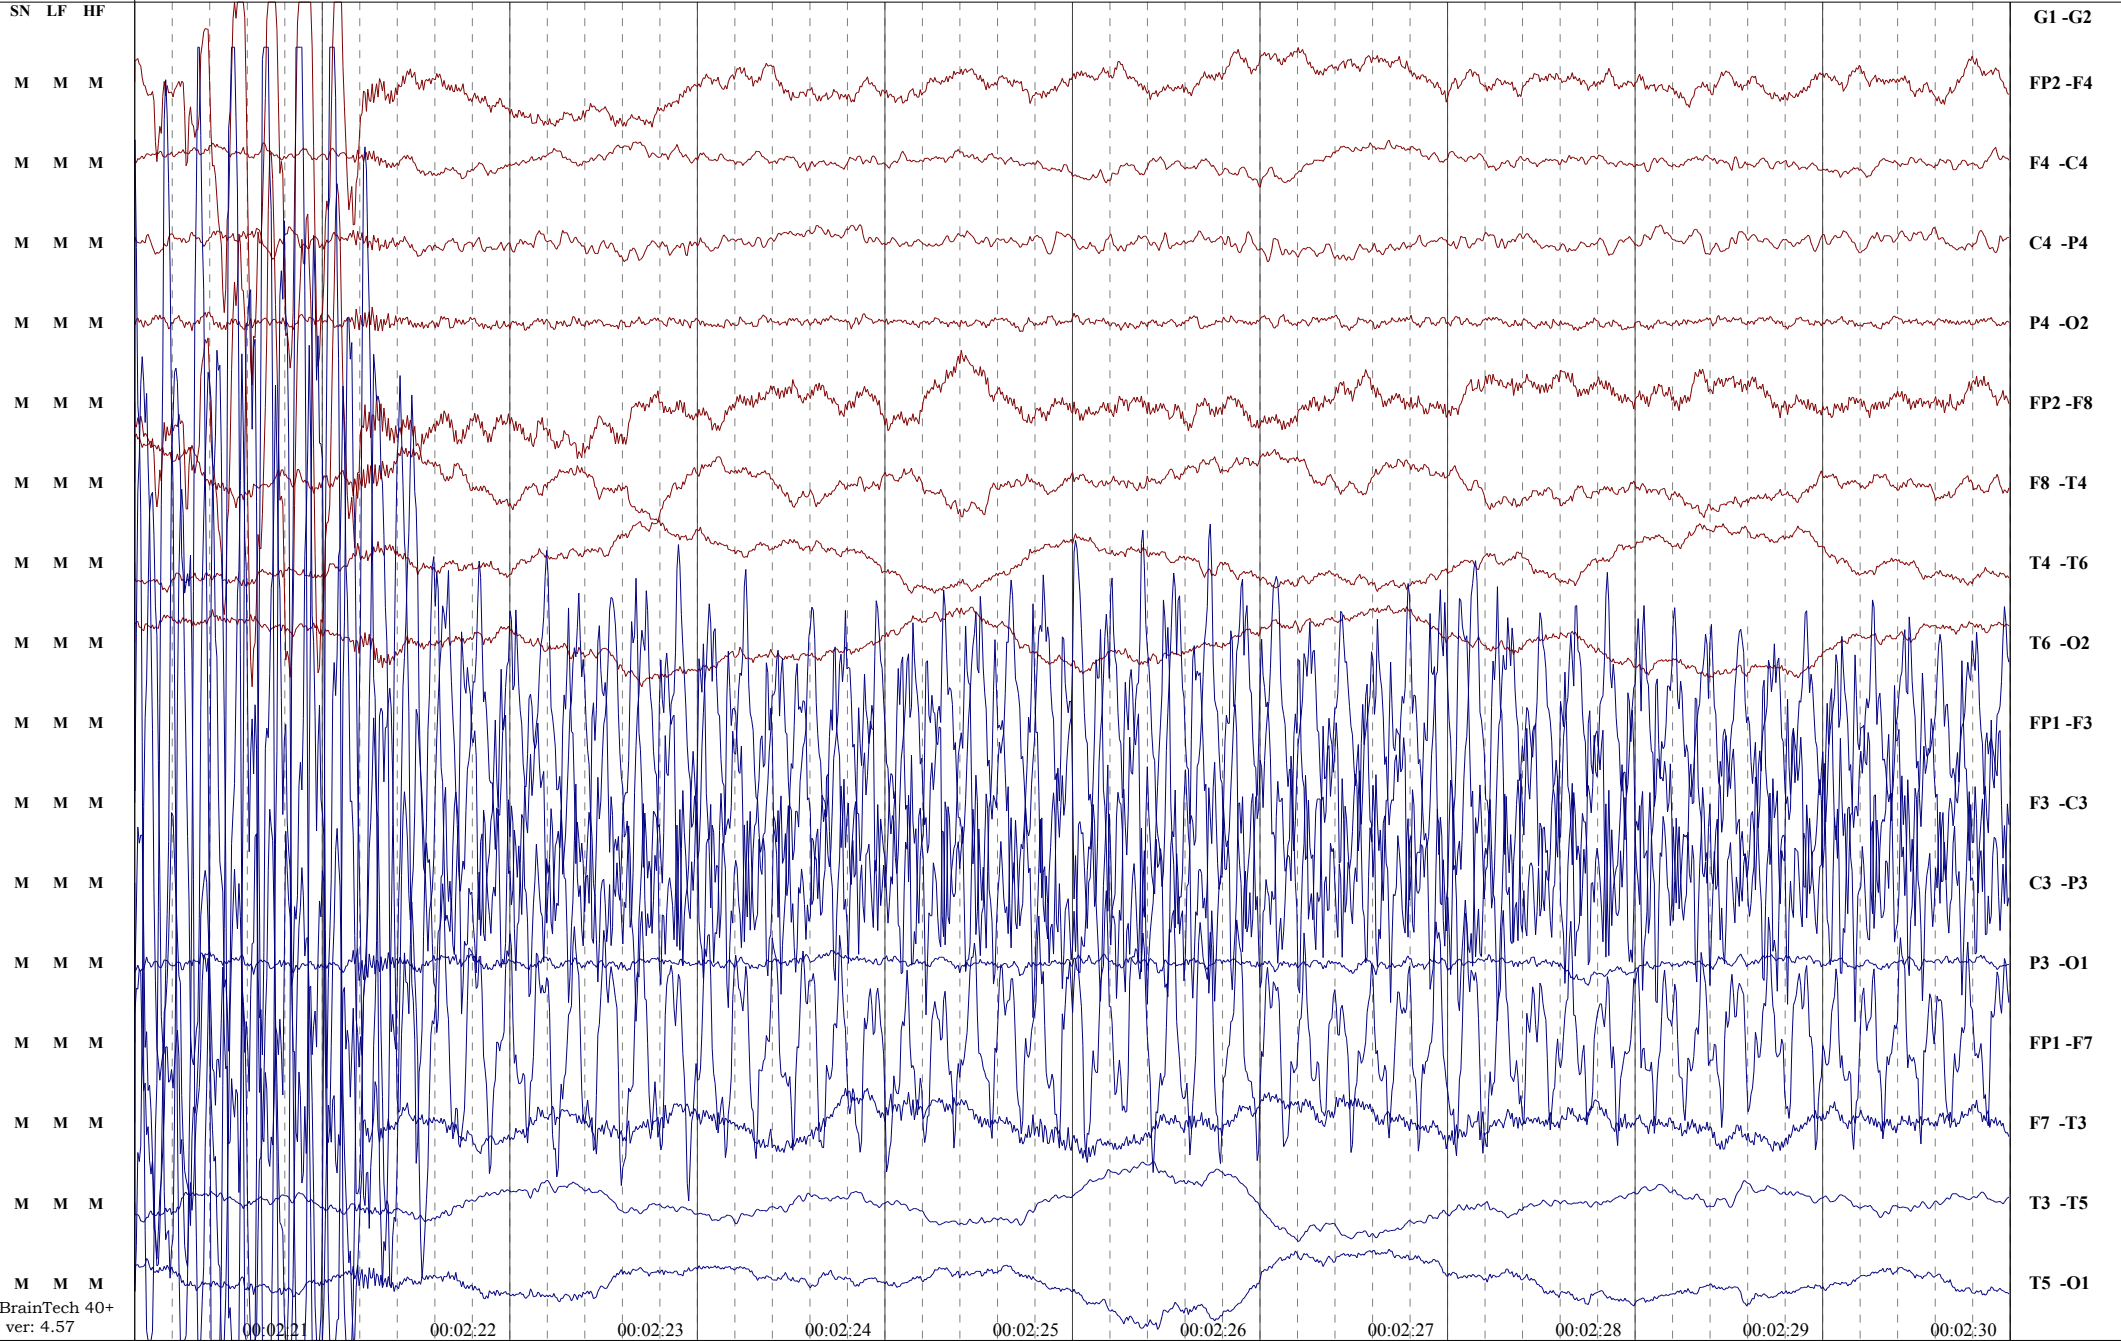




76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:29:11  
Page:16/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

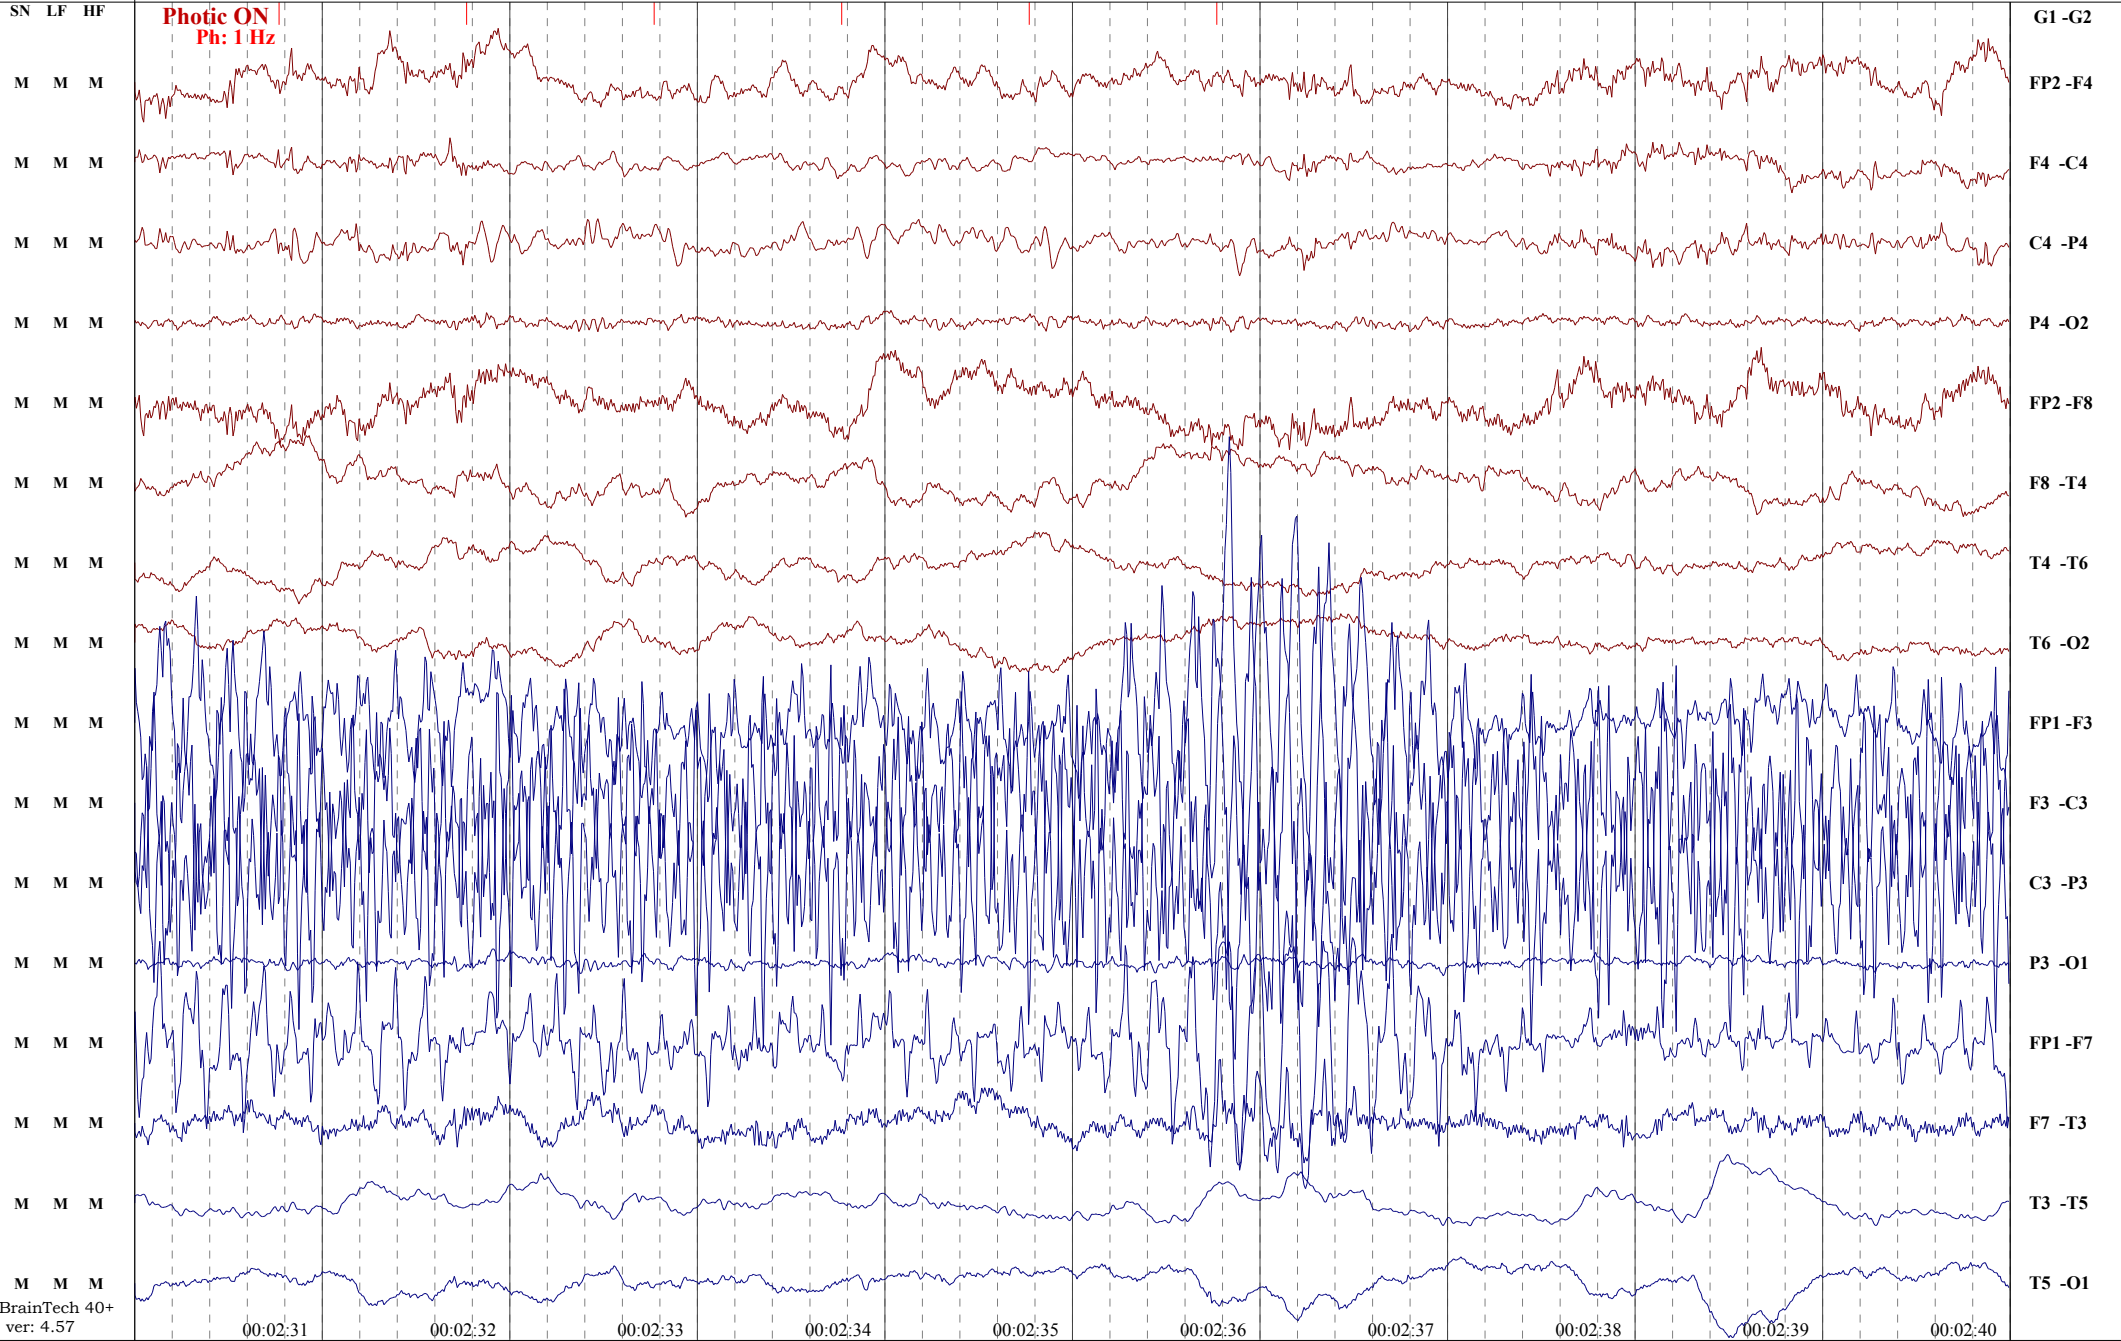


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:29:21  
Page:17/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

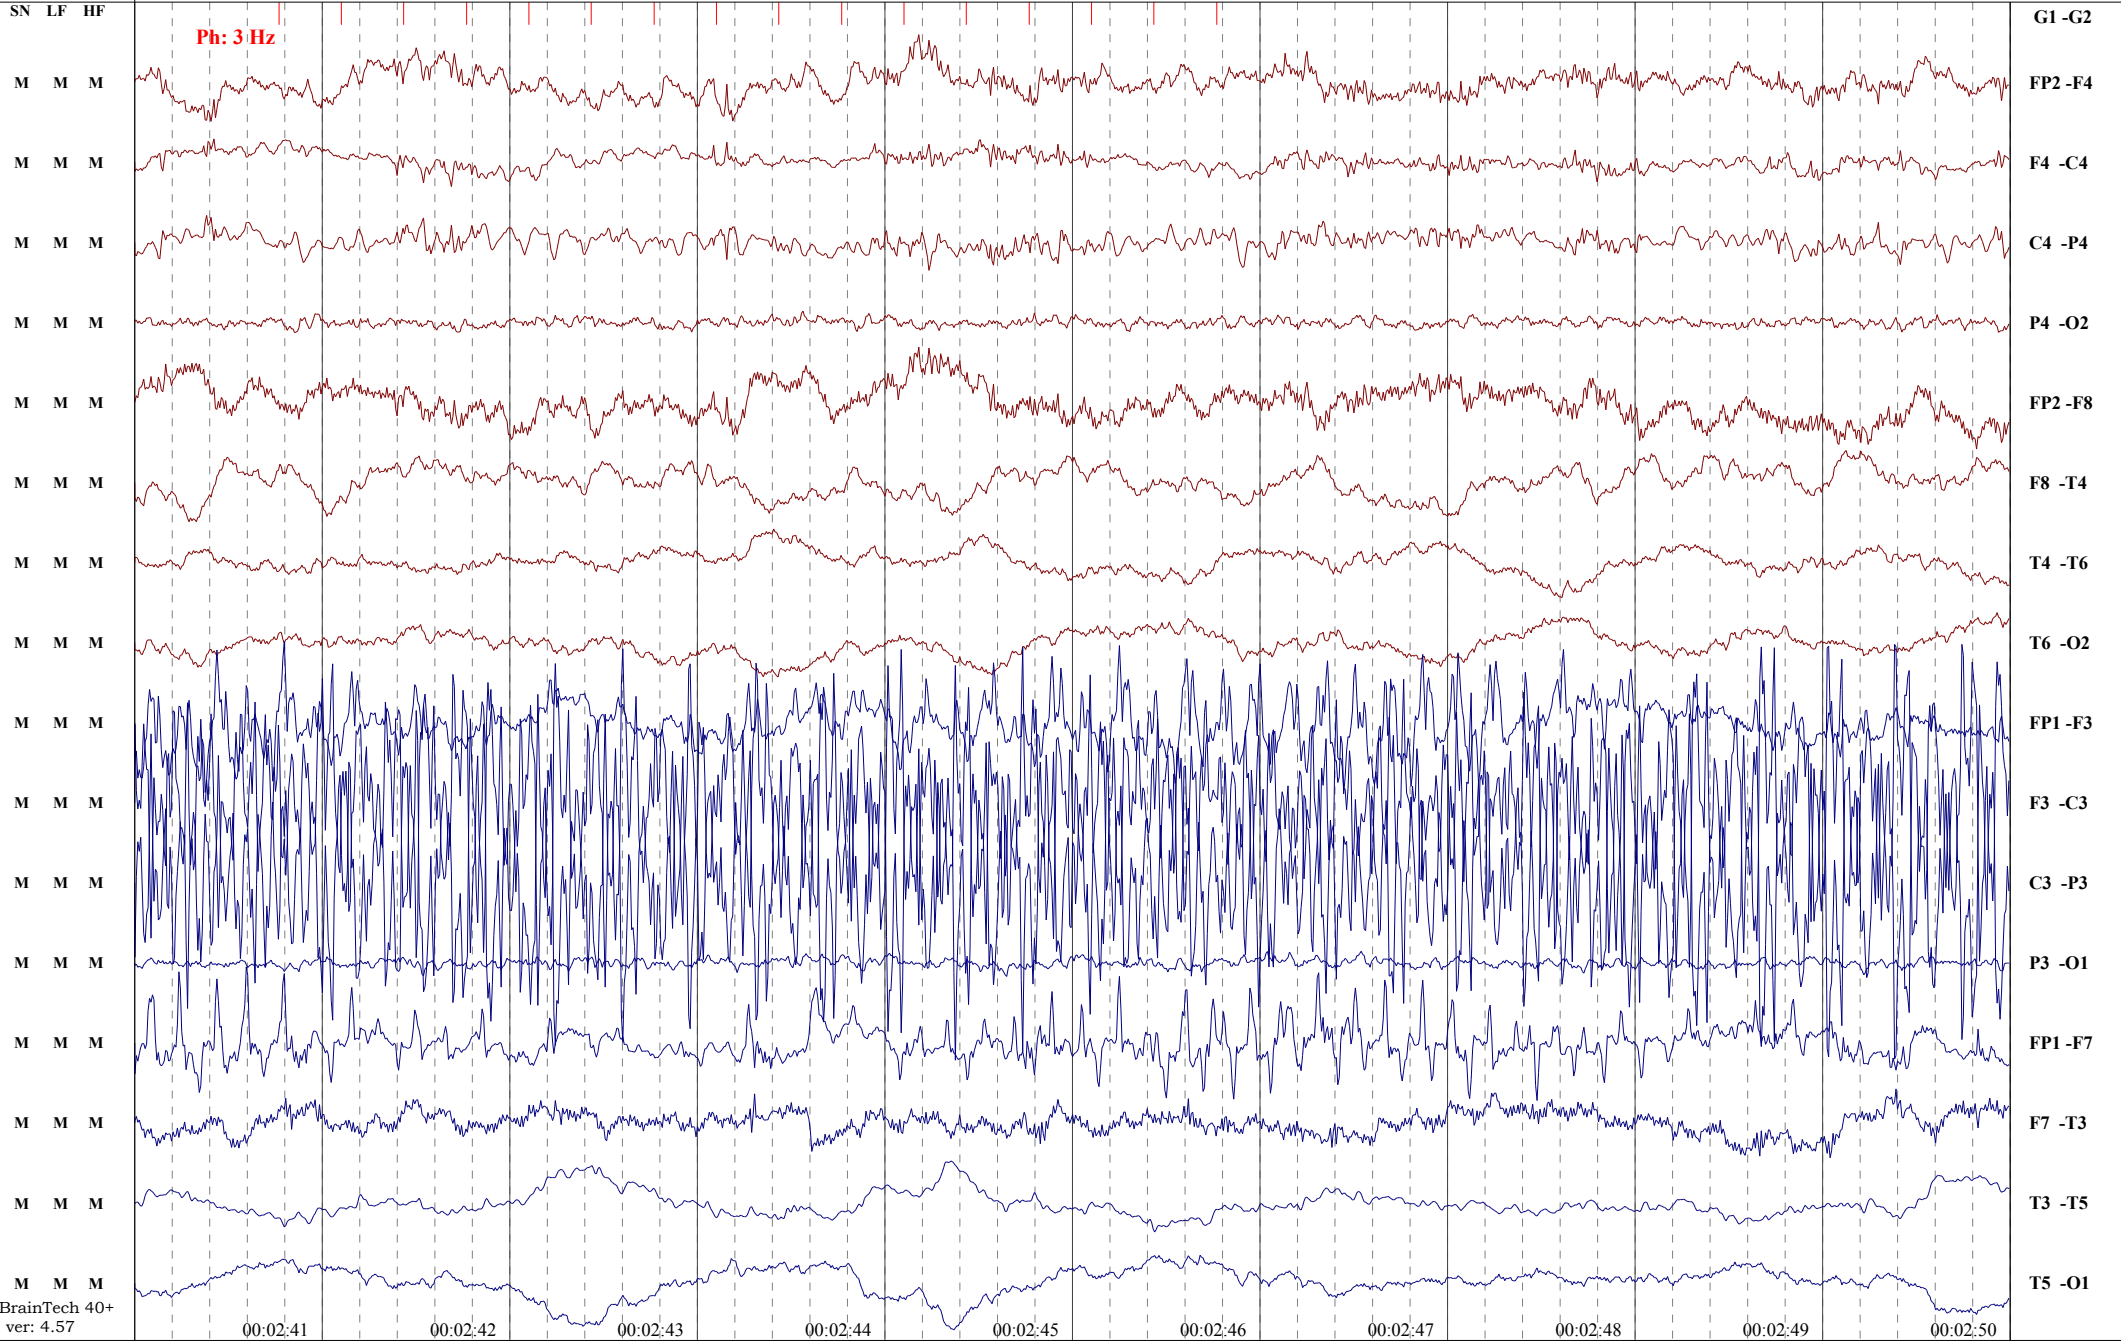


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL


Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:29:31  
Page:18/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

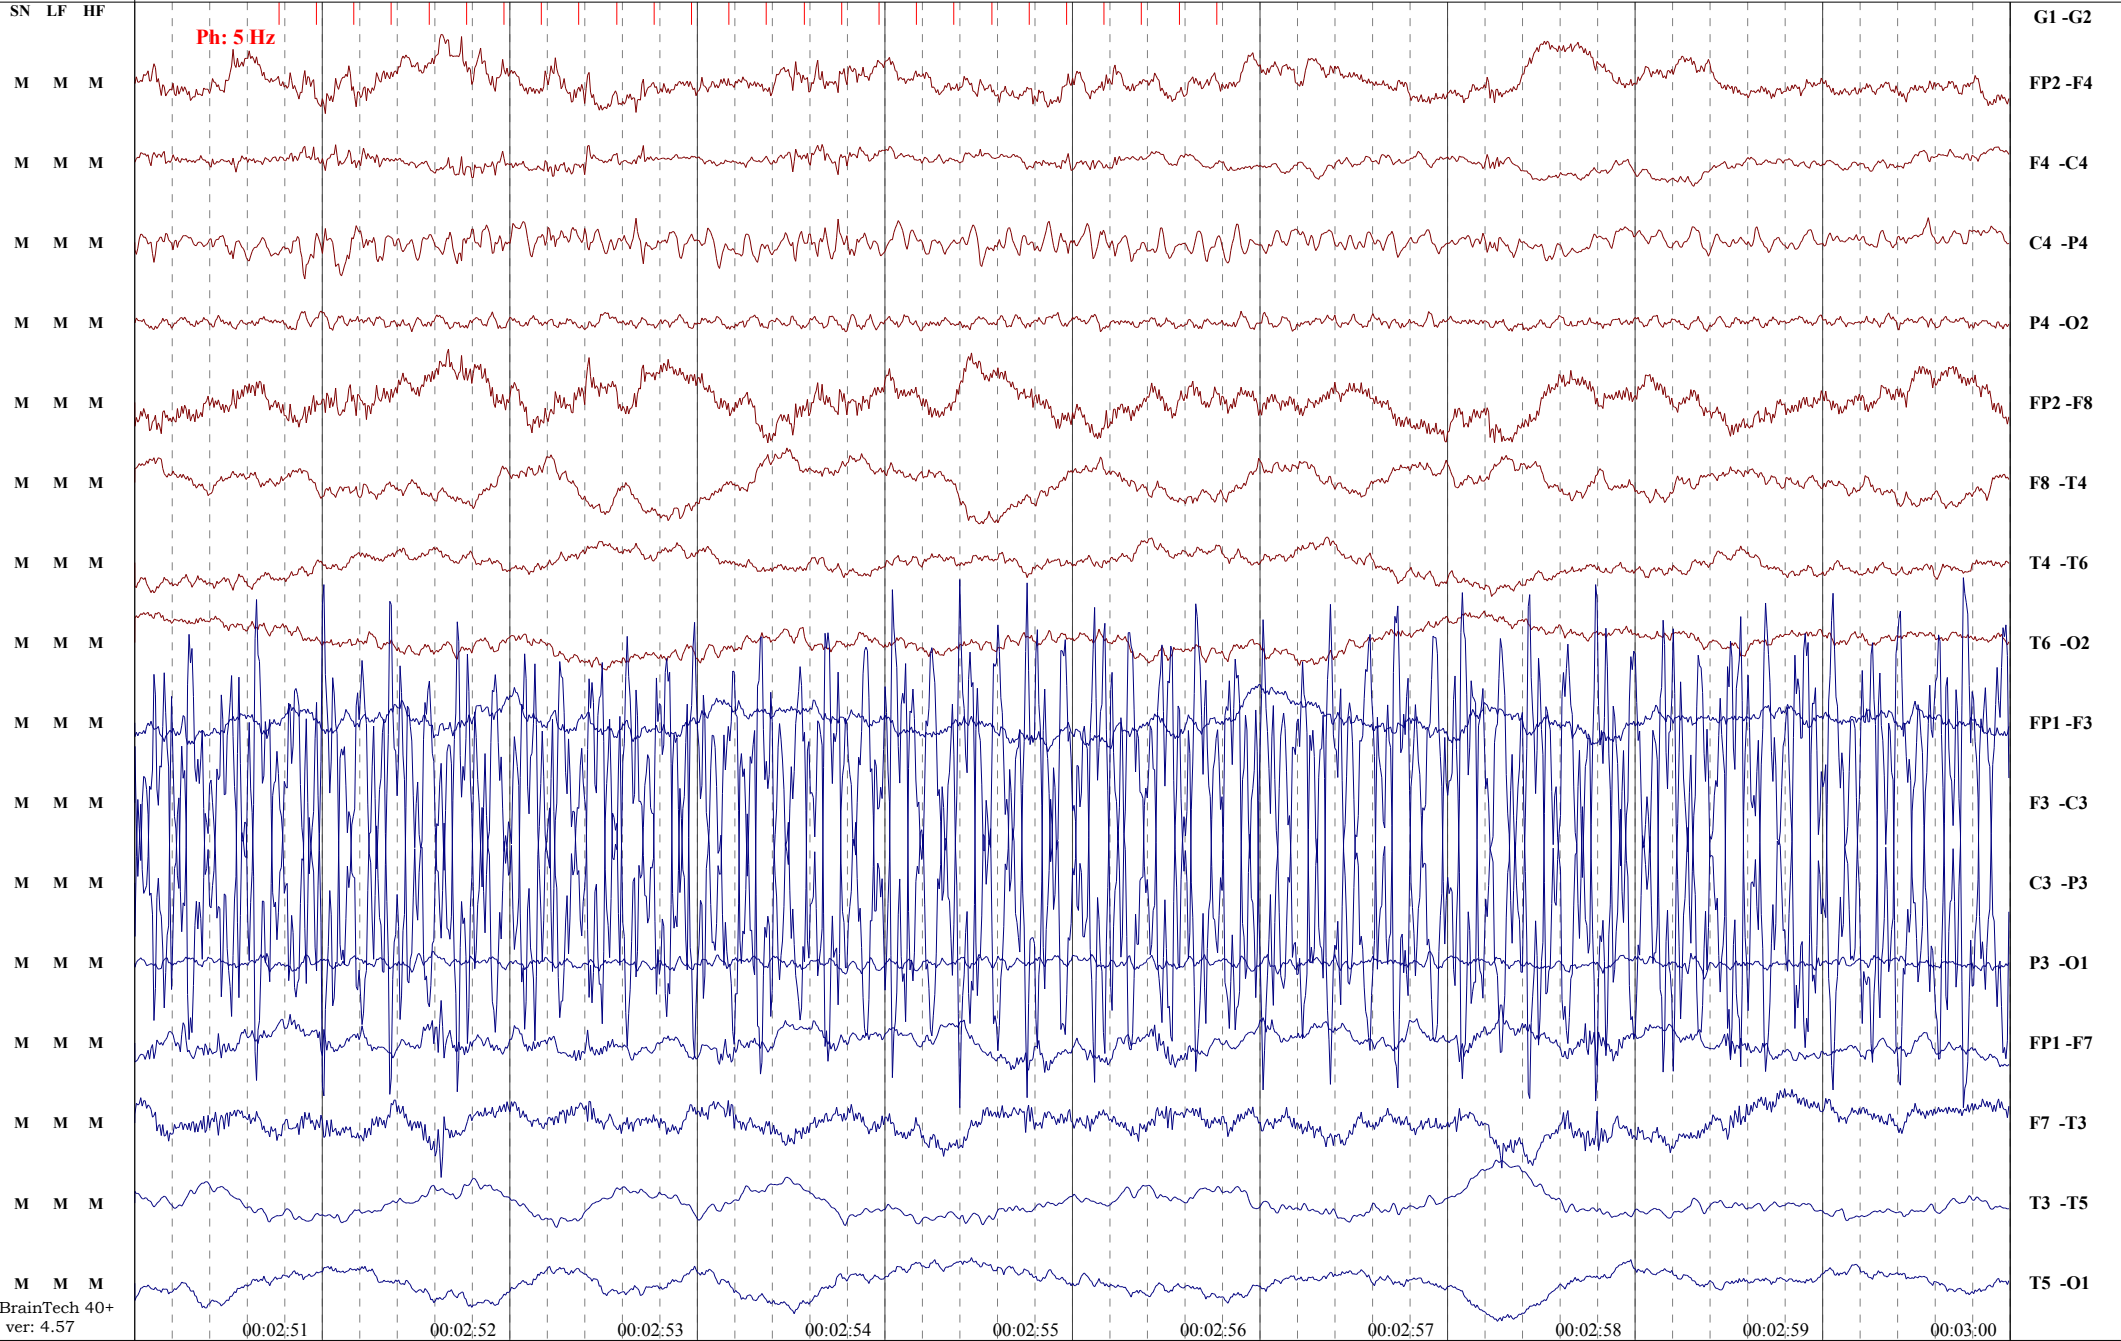



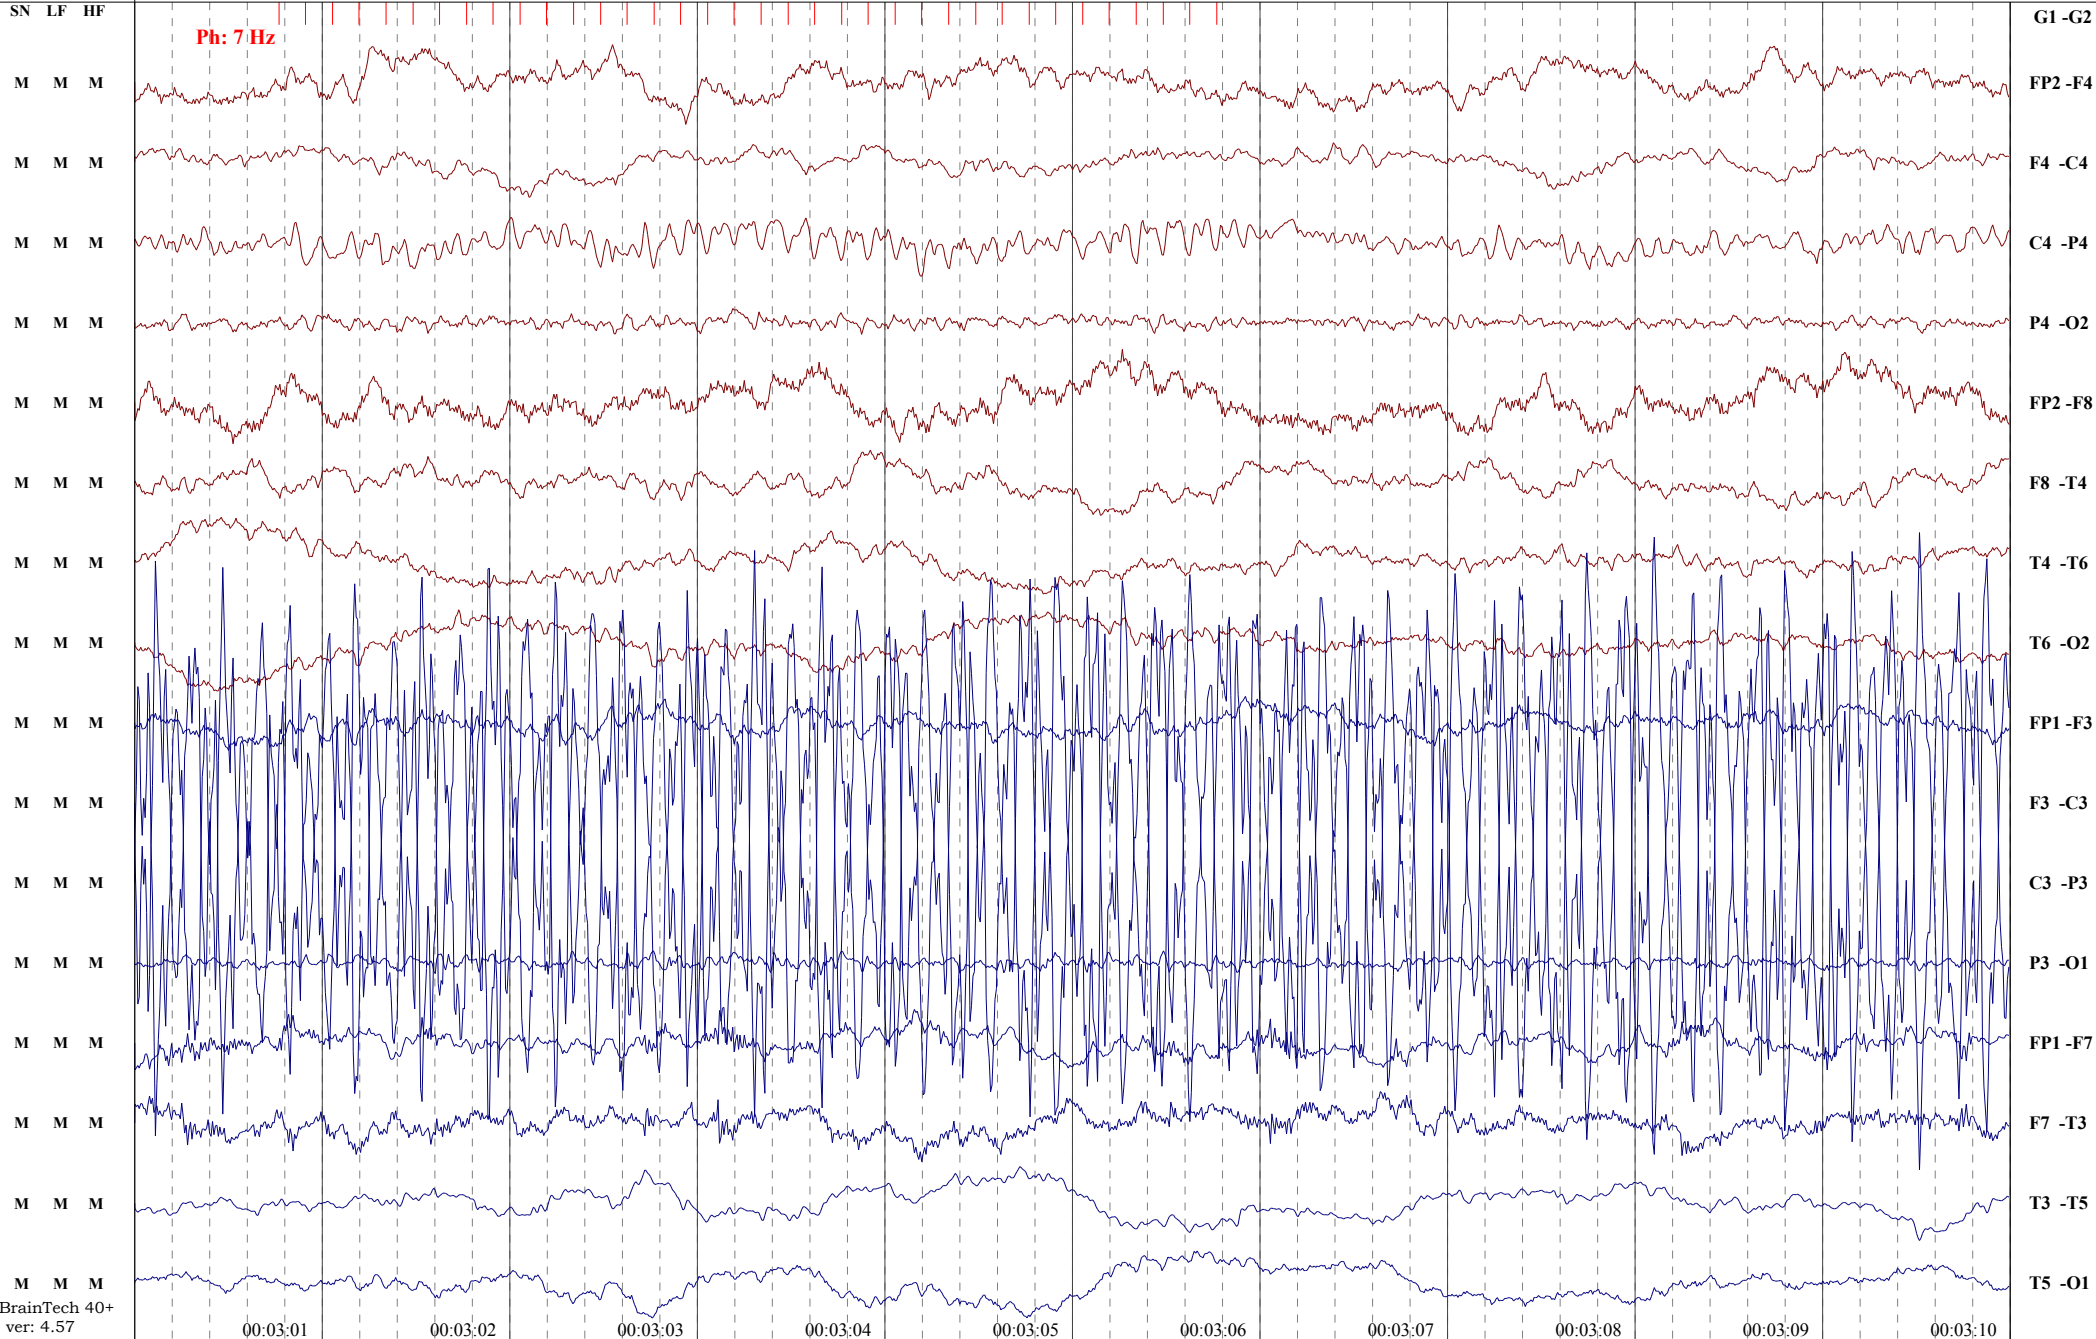


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:29:51  
Page:20/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

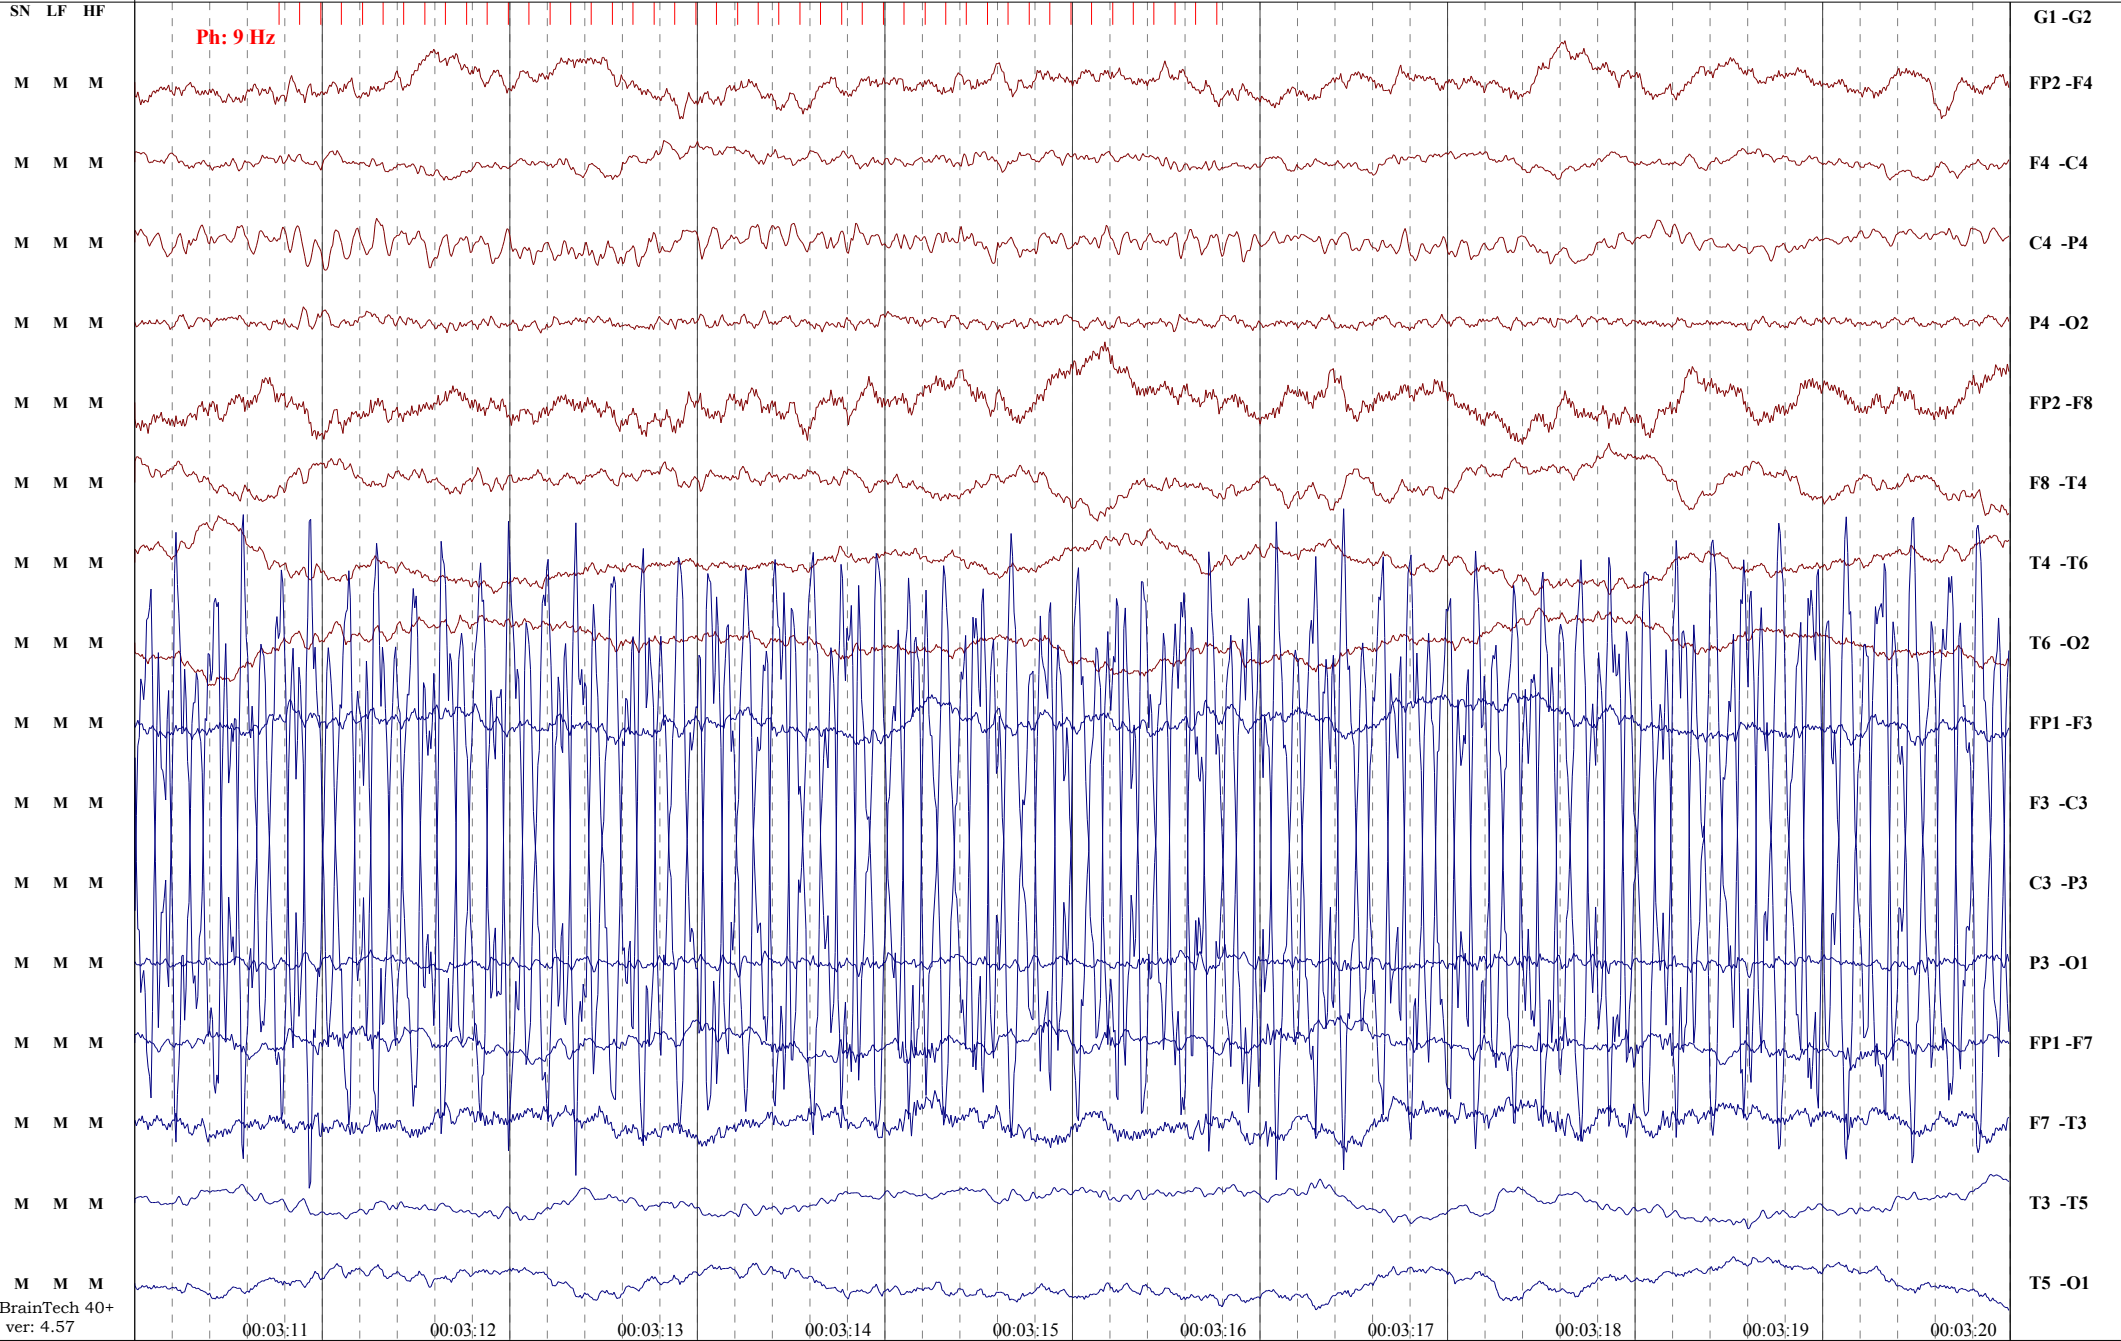


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:30:01  
Page:21/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

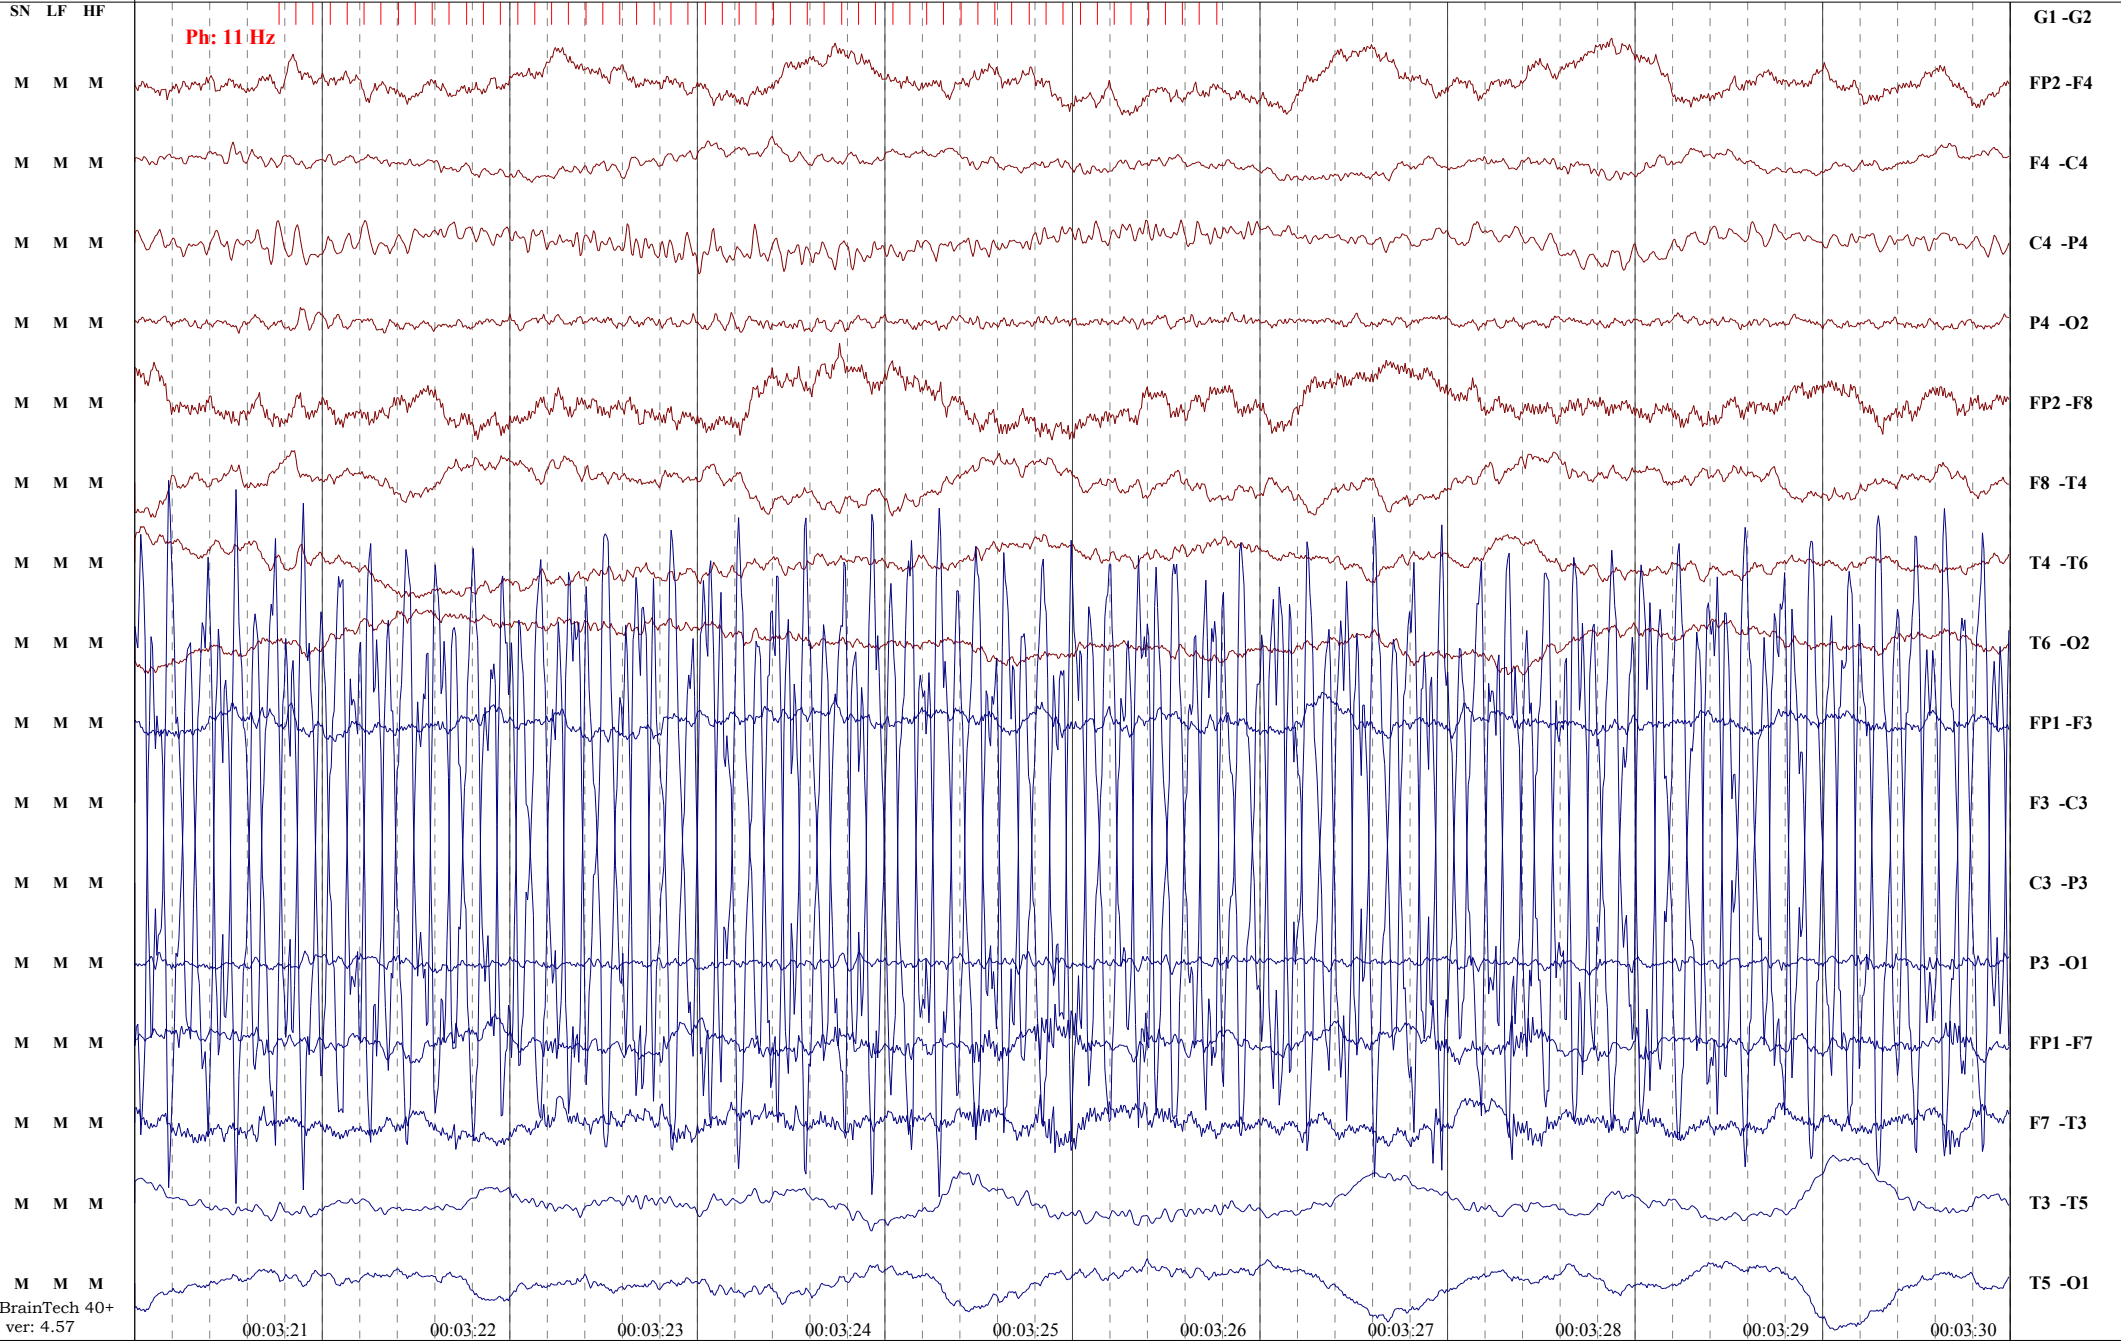




76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:30:11  
Page:22/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

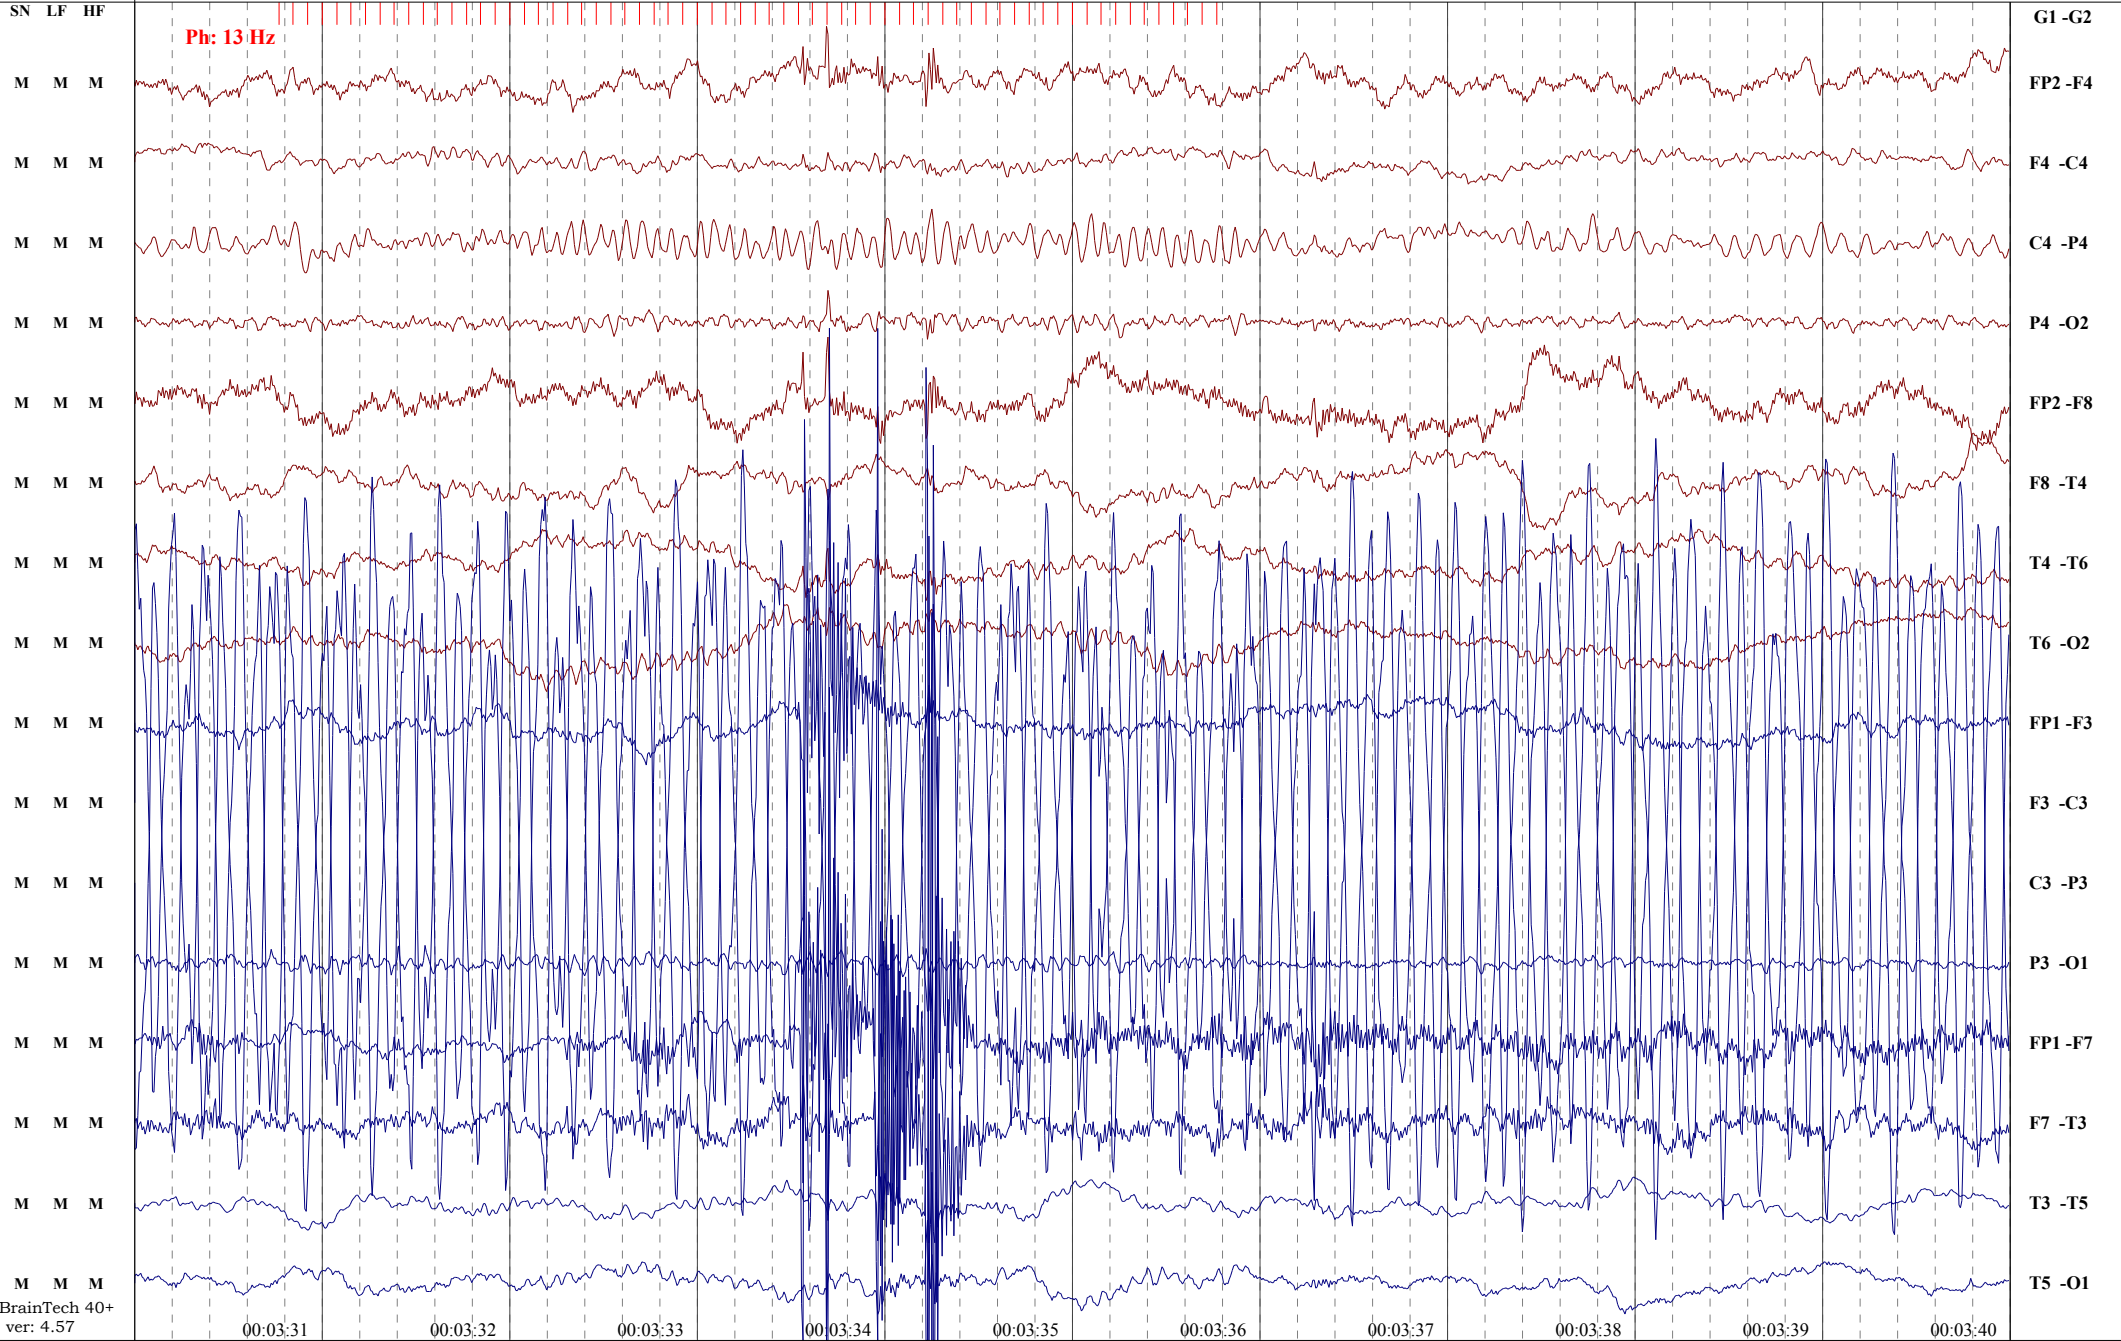


76  
MRS. BINDU LATA KASHYAP  
38 Years/F


Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:30:21  
Page:23/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

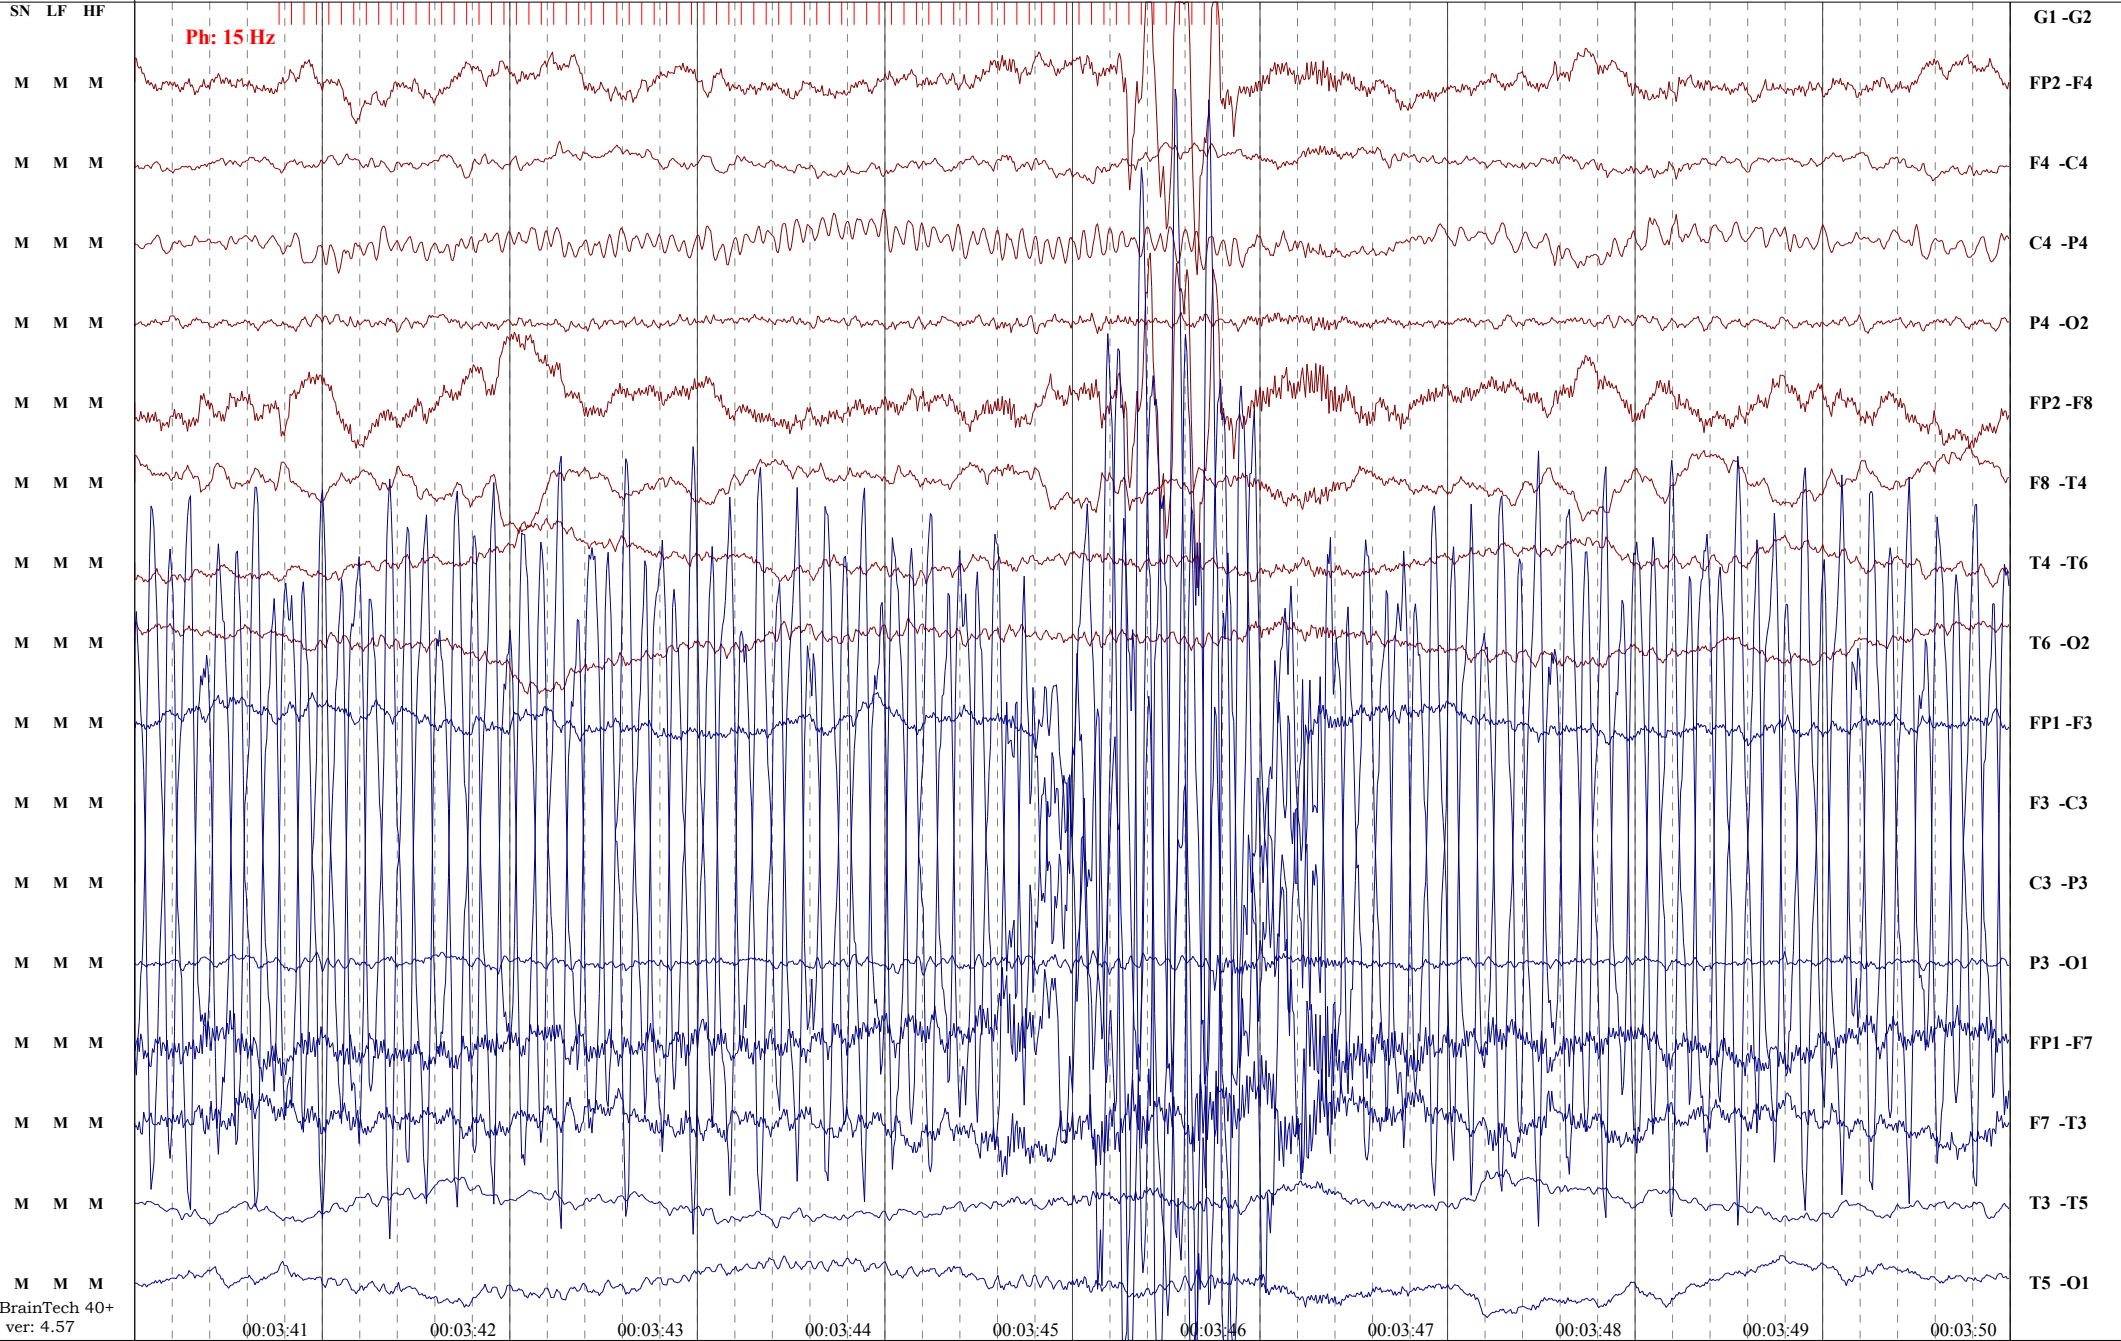

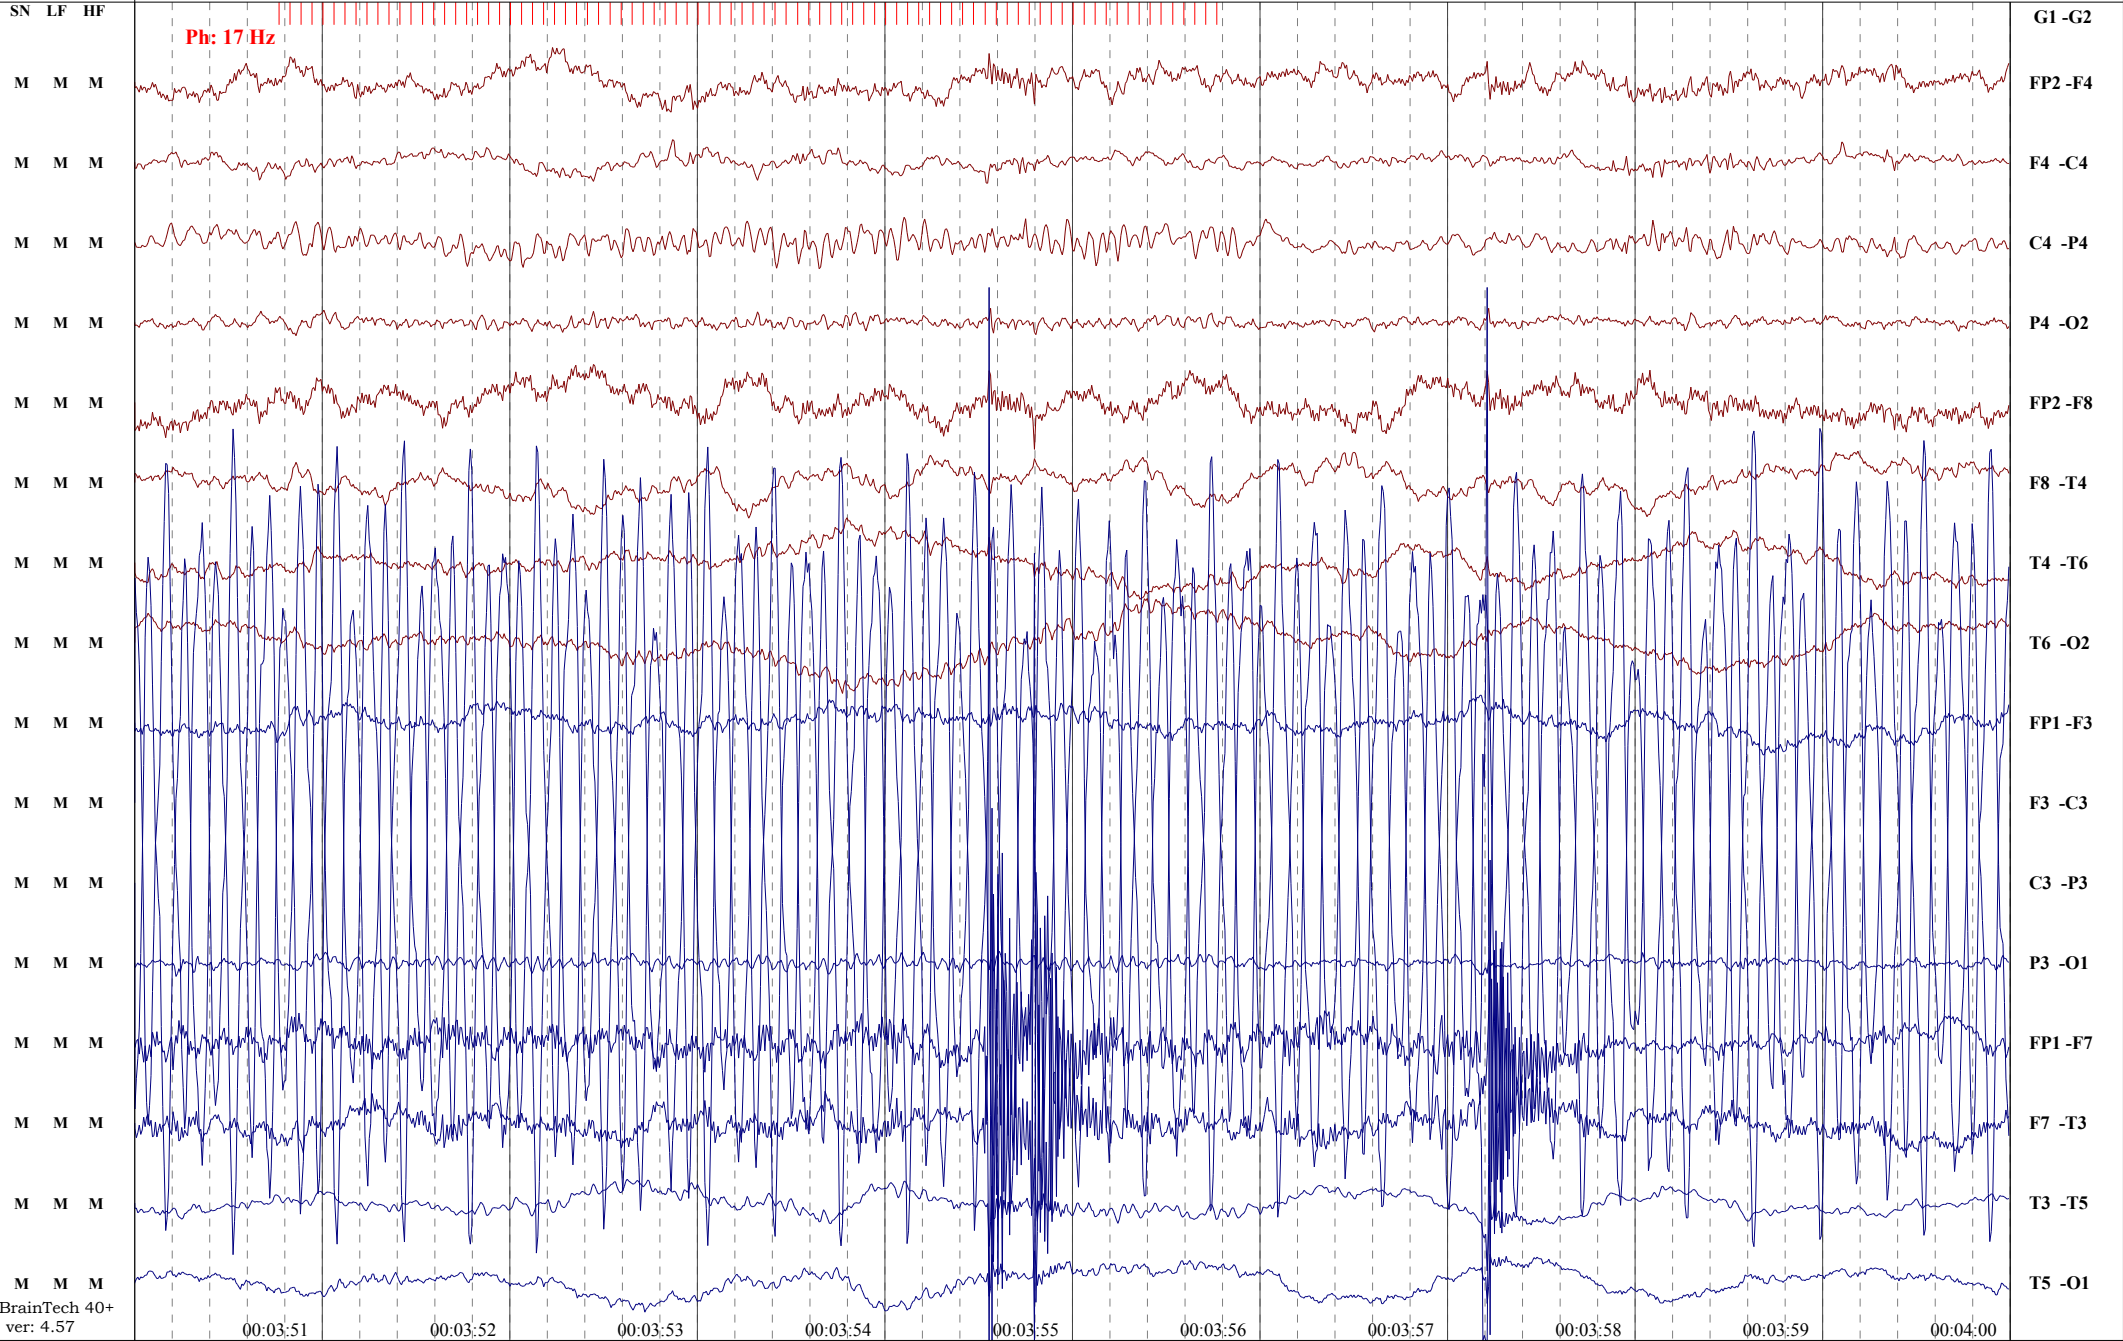




76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:30:41  
Page:25/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

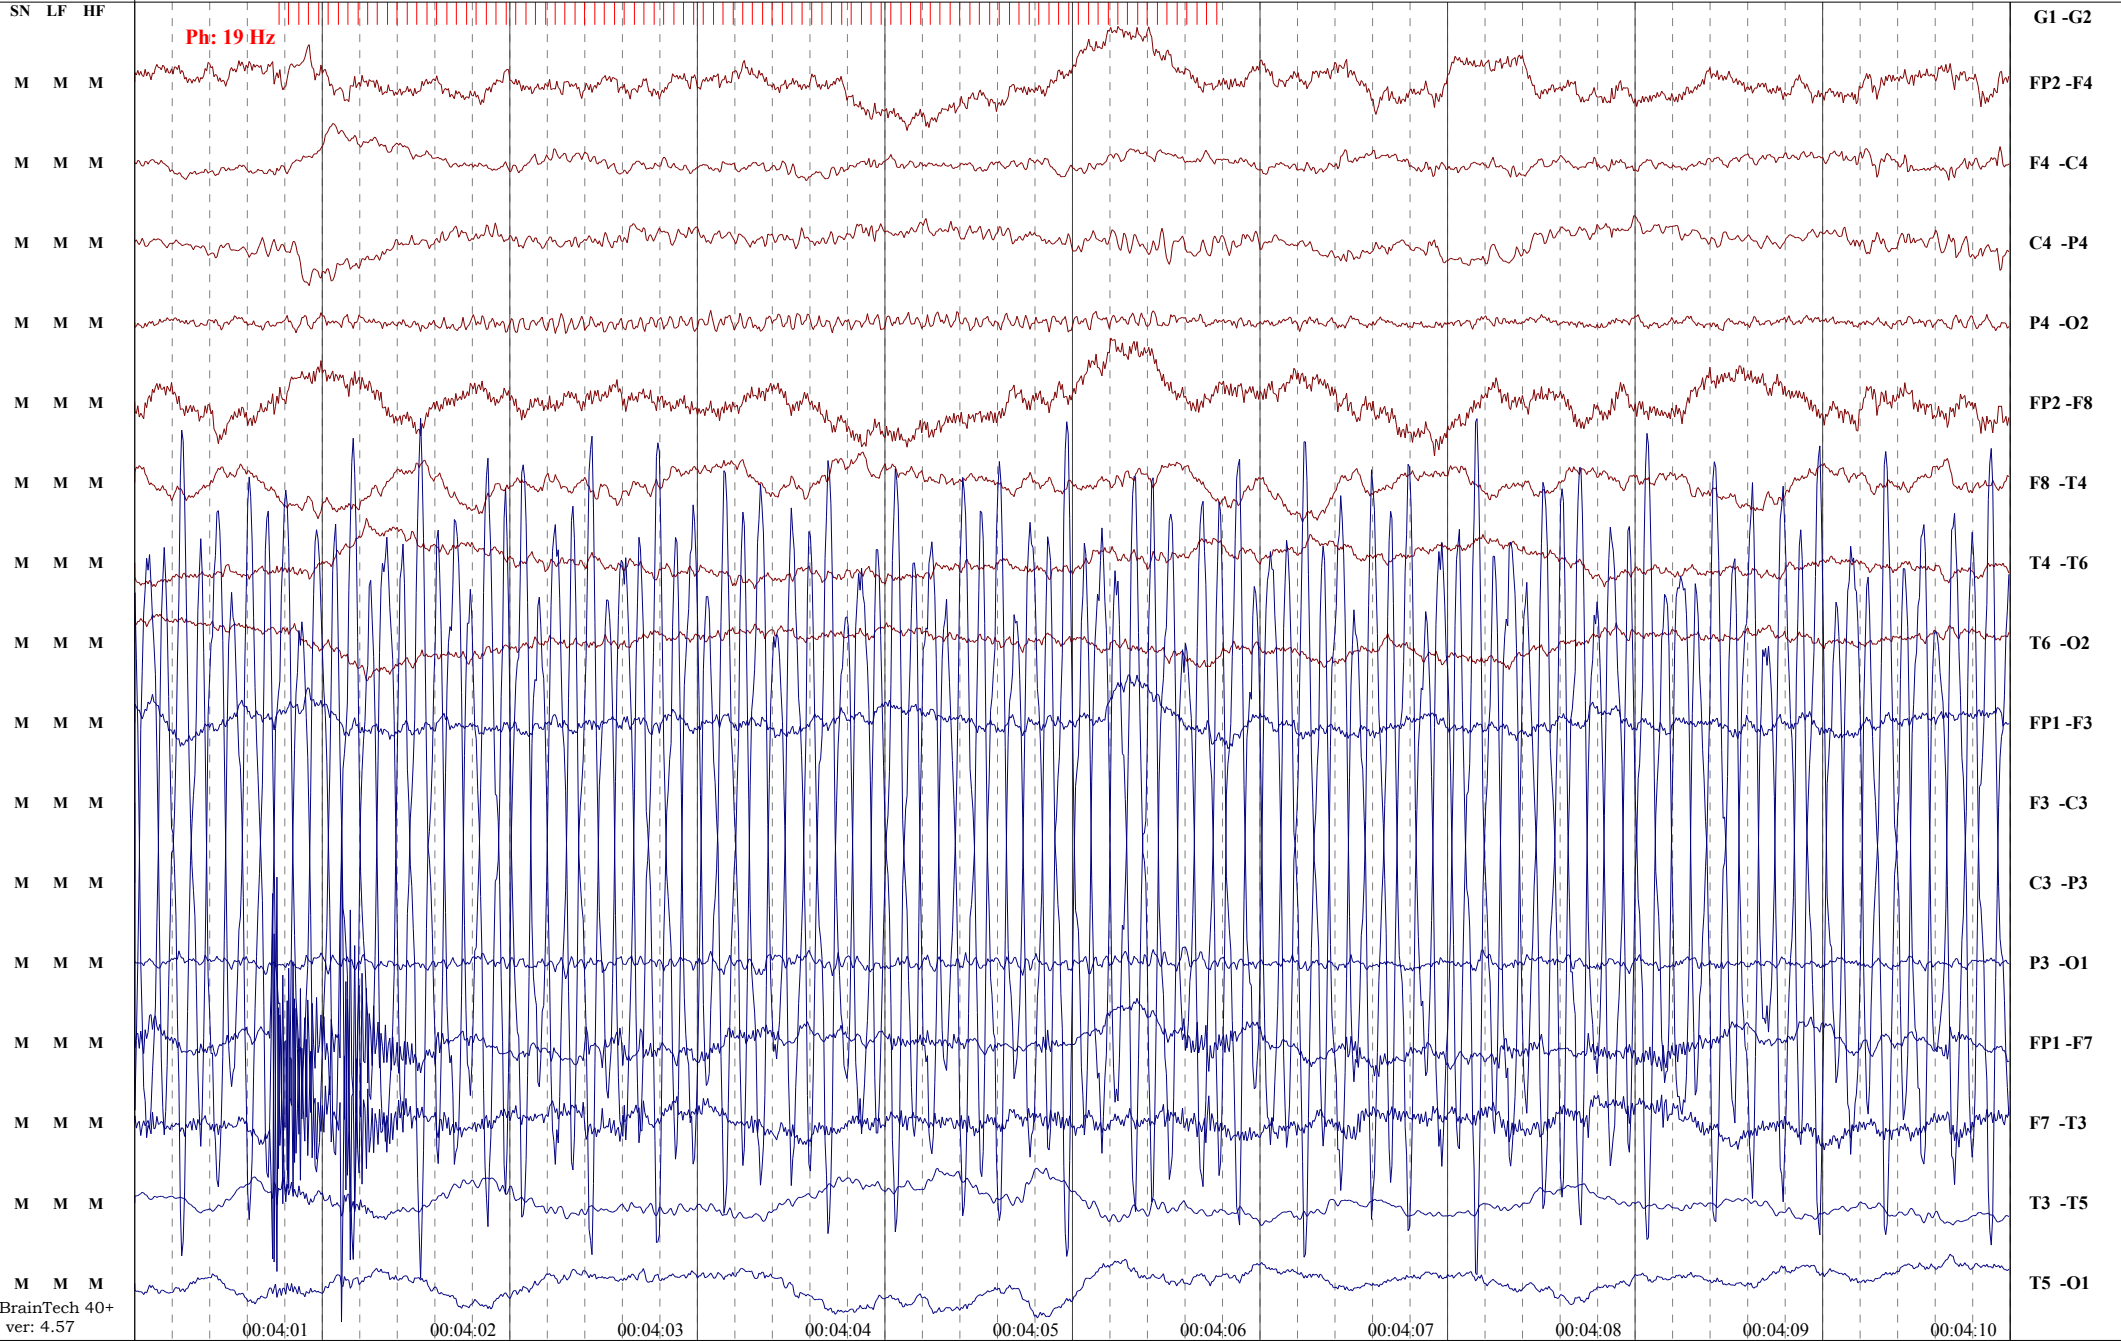


76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:30:51  
Page:26/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

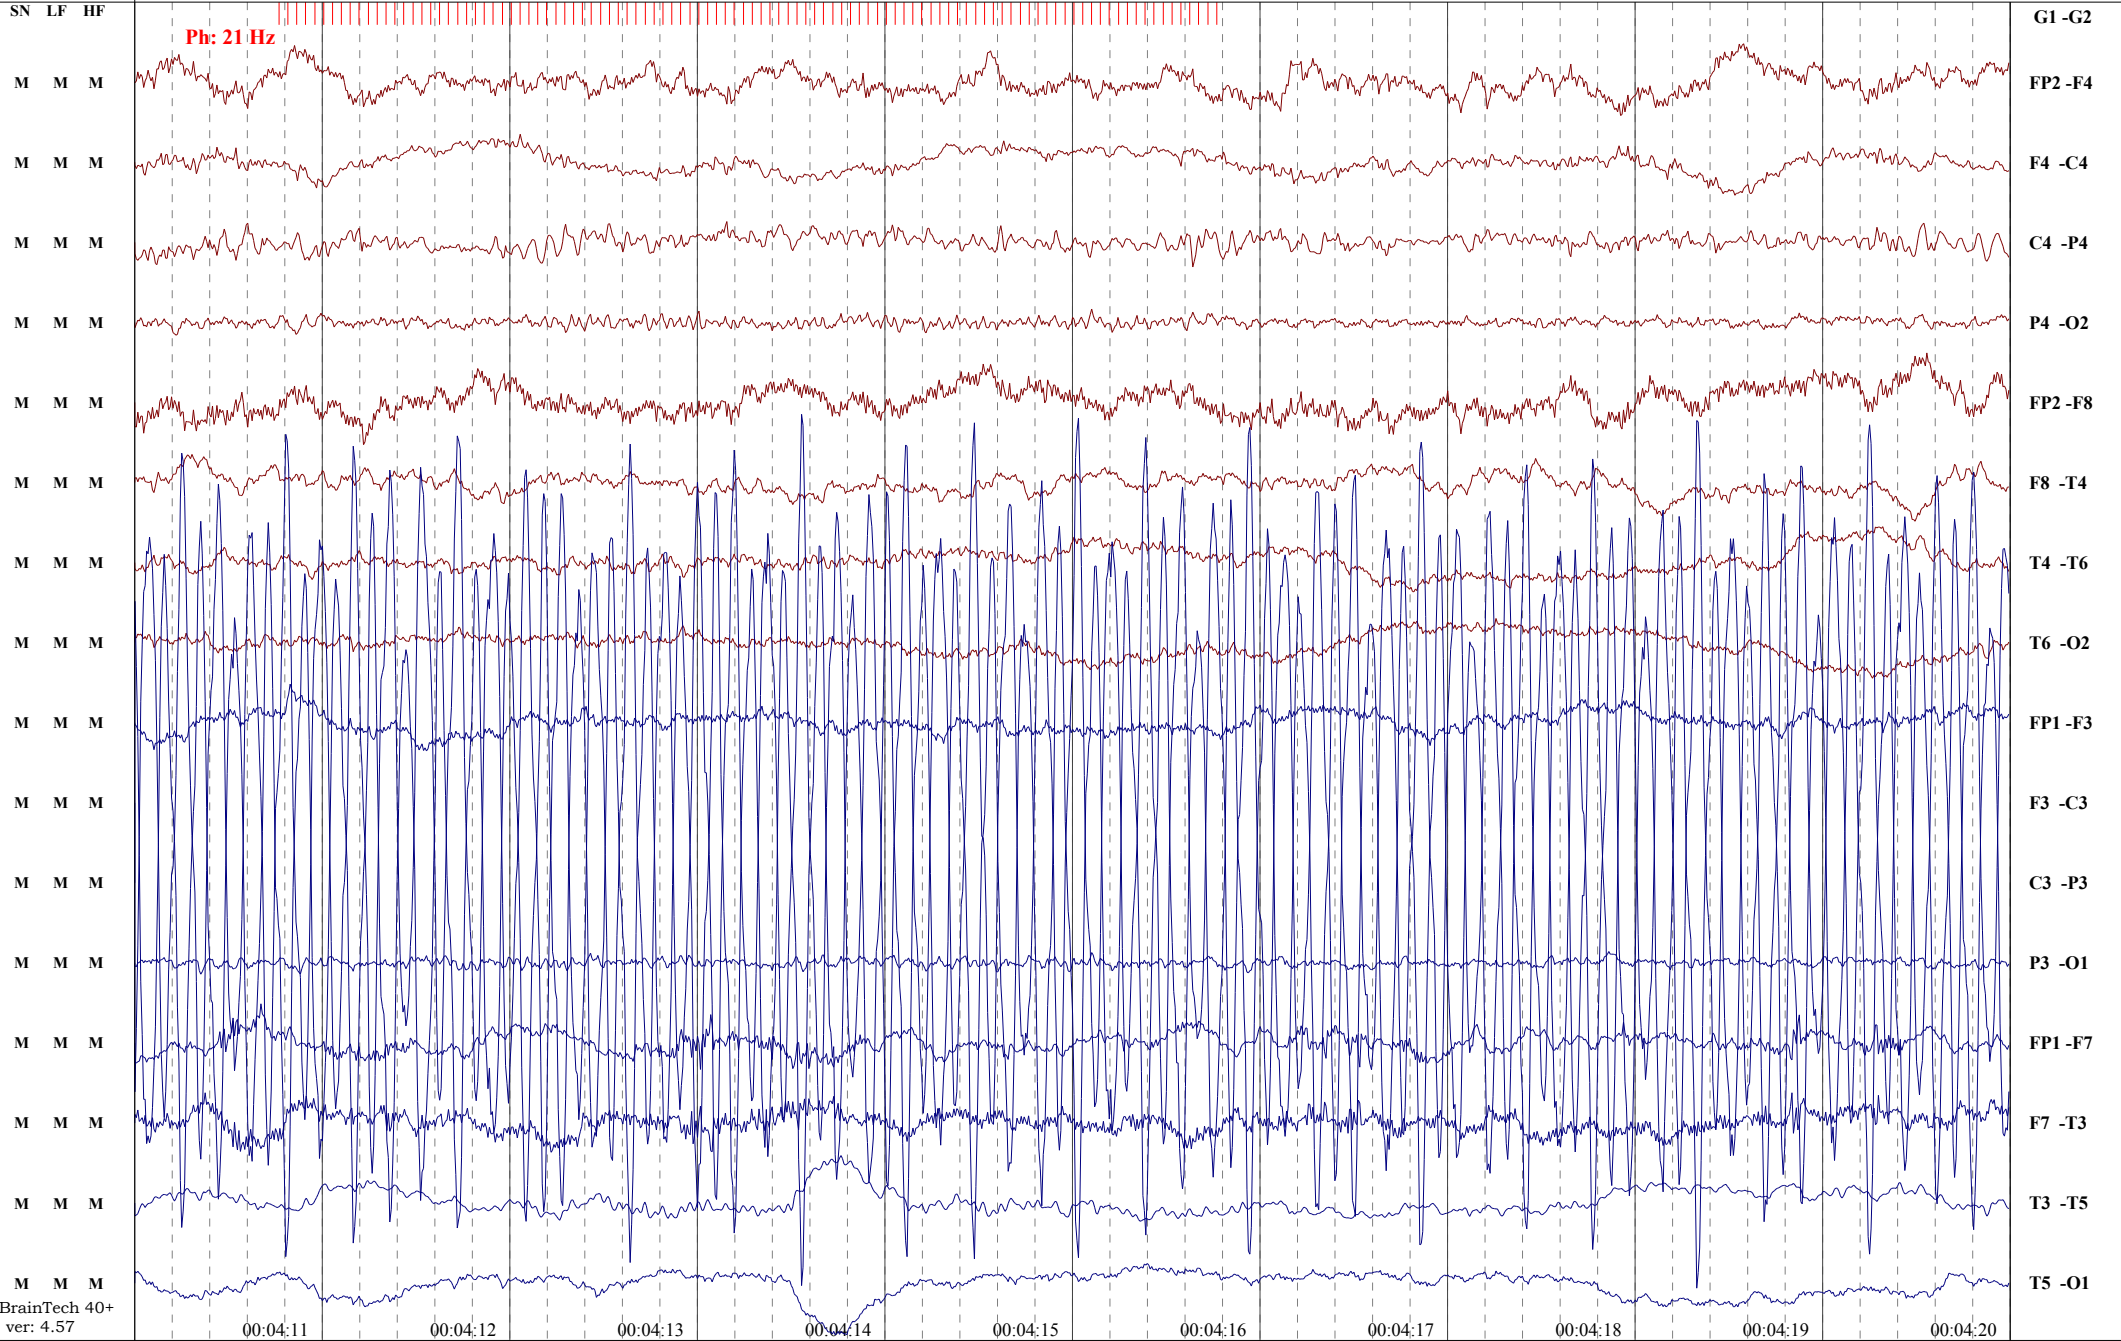

76  
MRS. BINDU LATA KASHYAP  
38 Years/F

Date: 19-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 16:31:01  
Page:27/28  
Notch: ON

Ref:DR. R. PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

