


45  
MRS. HEENA SAHU  
28 Years/F

Date: 05-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 20:04:16  
Page:6/27  
Notch: ON

Ref:DR. RAJNISH PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

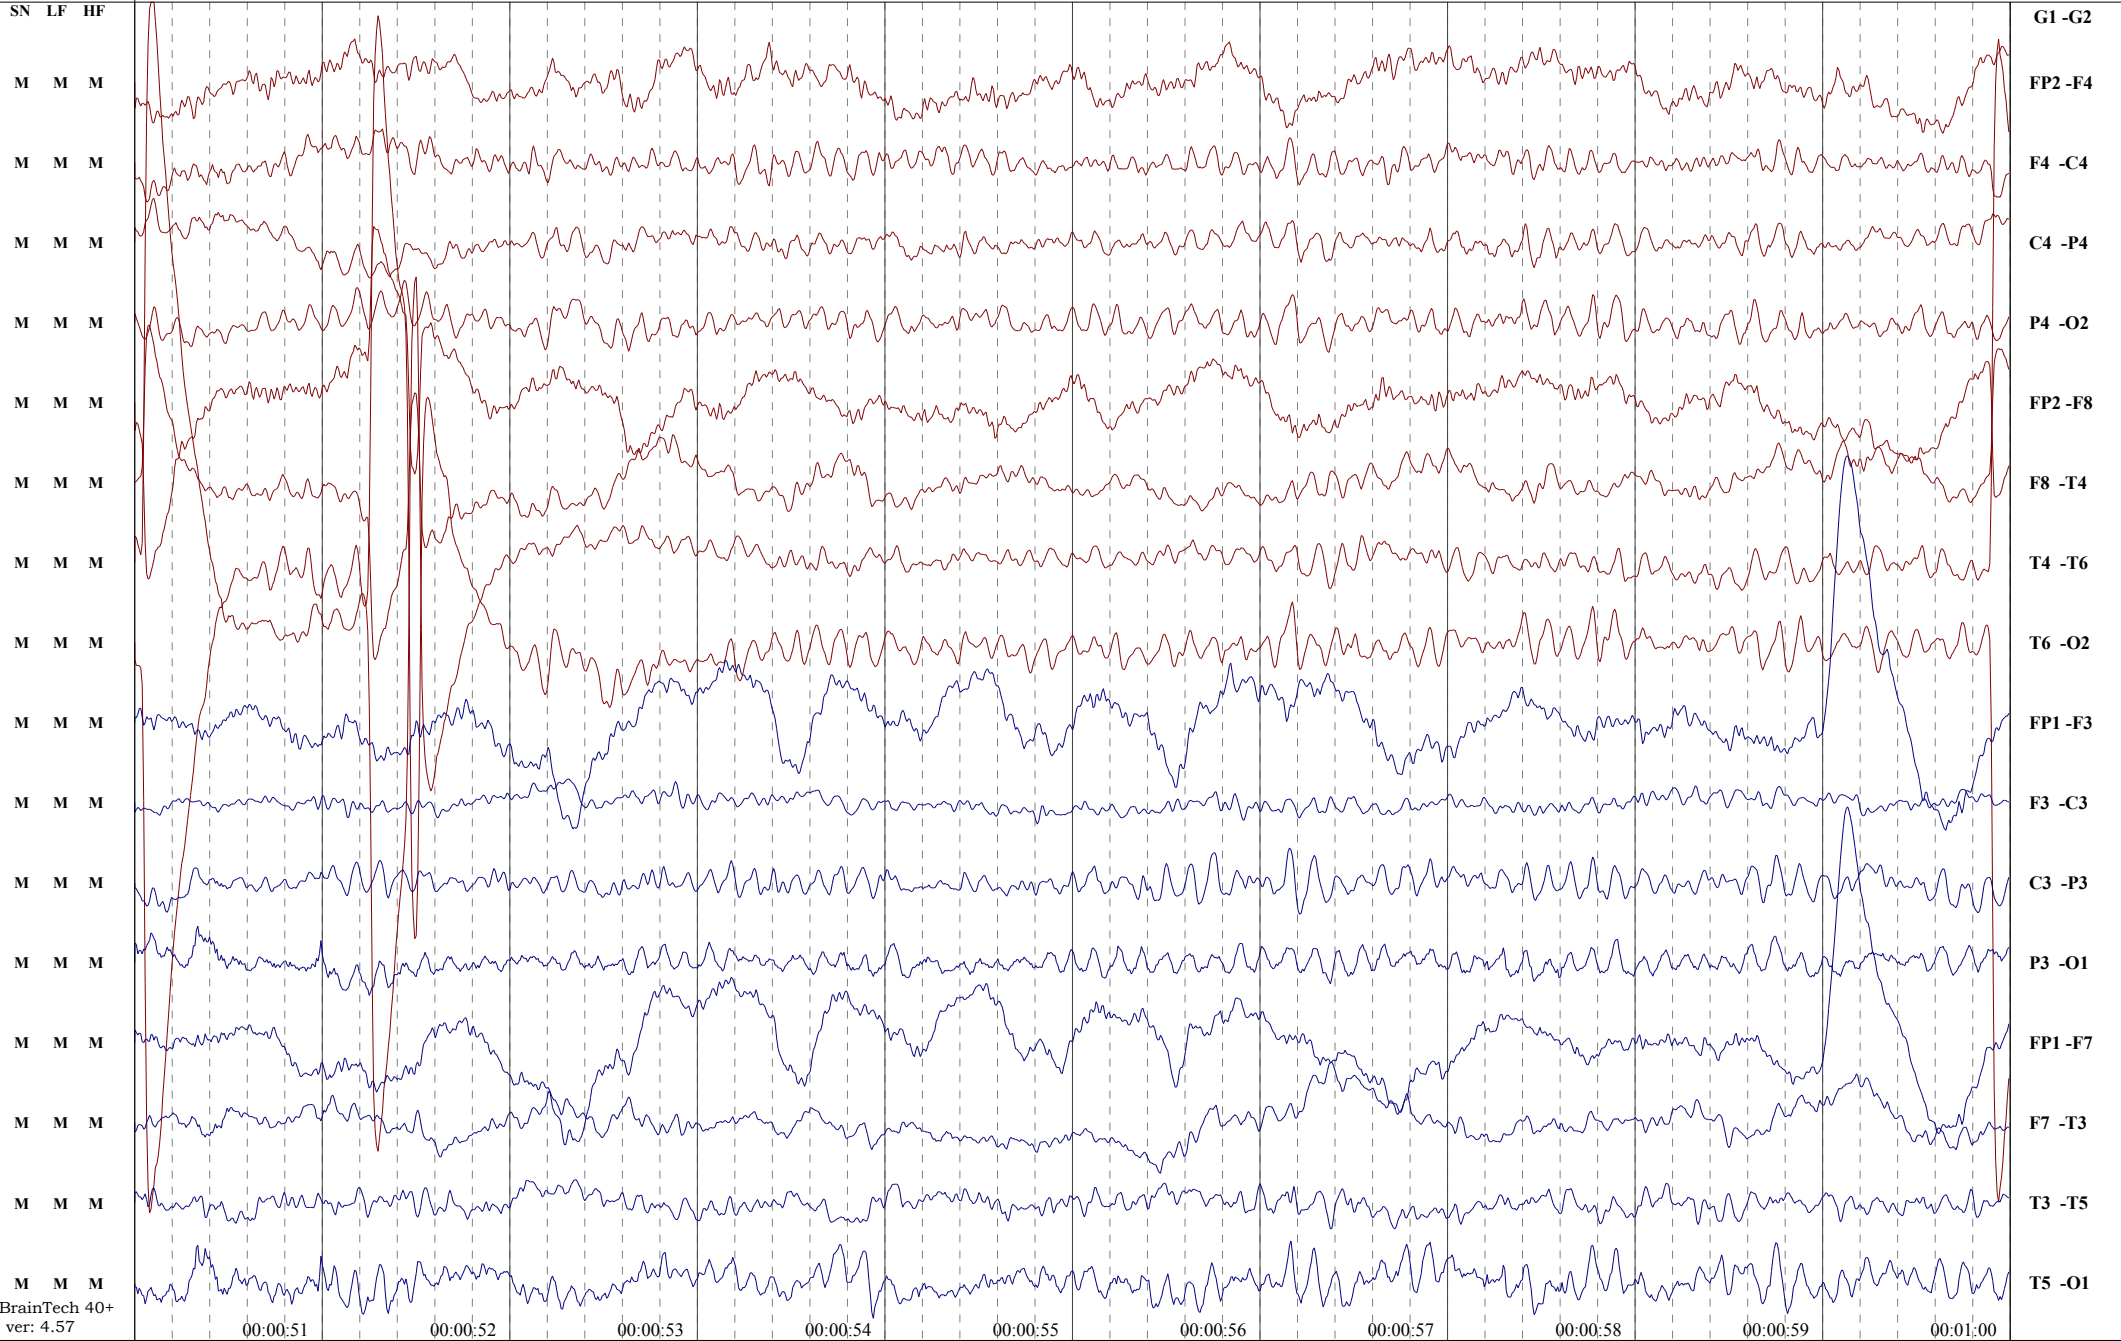


45  
MRS. HEENA SAHU  
28 Years/F

Date: 05-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 20:04:46  
Page:9/27  
Notch: ON

Ref:DR. RAJNISH PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

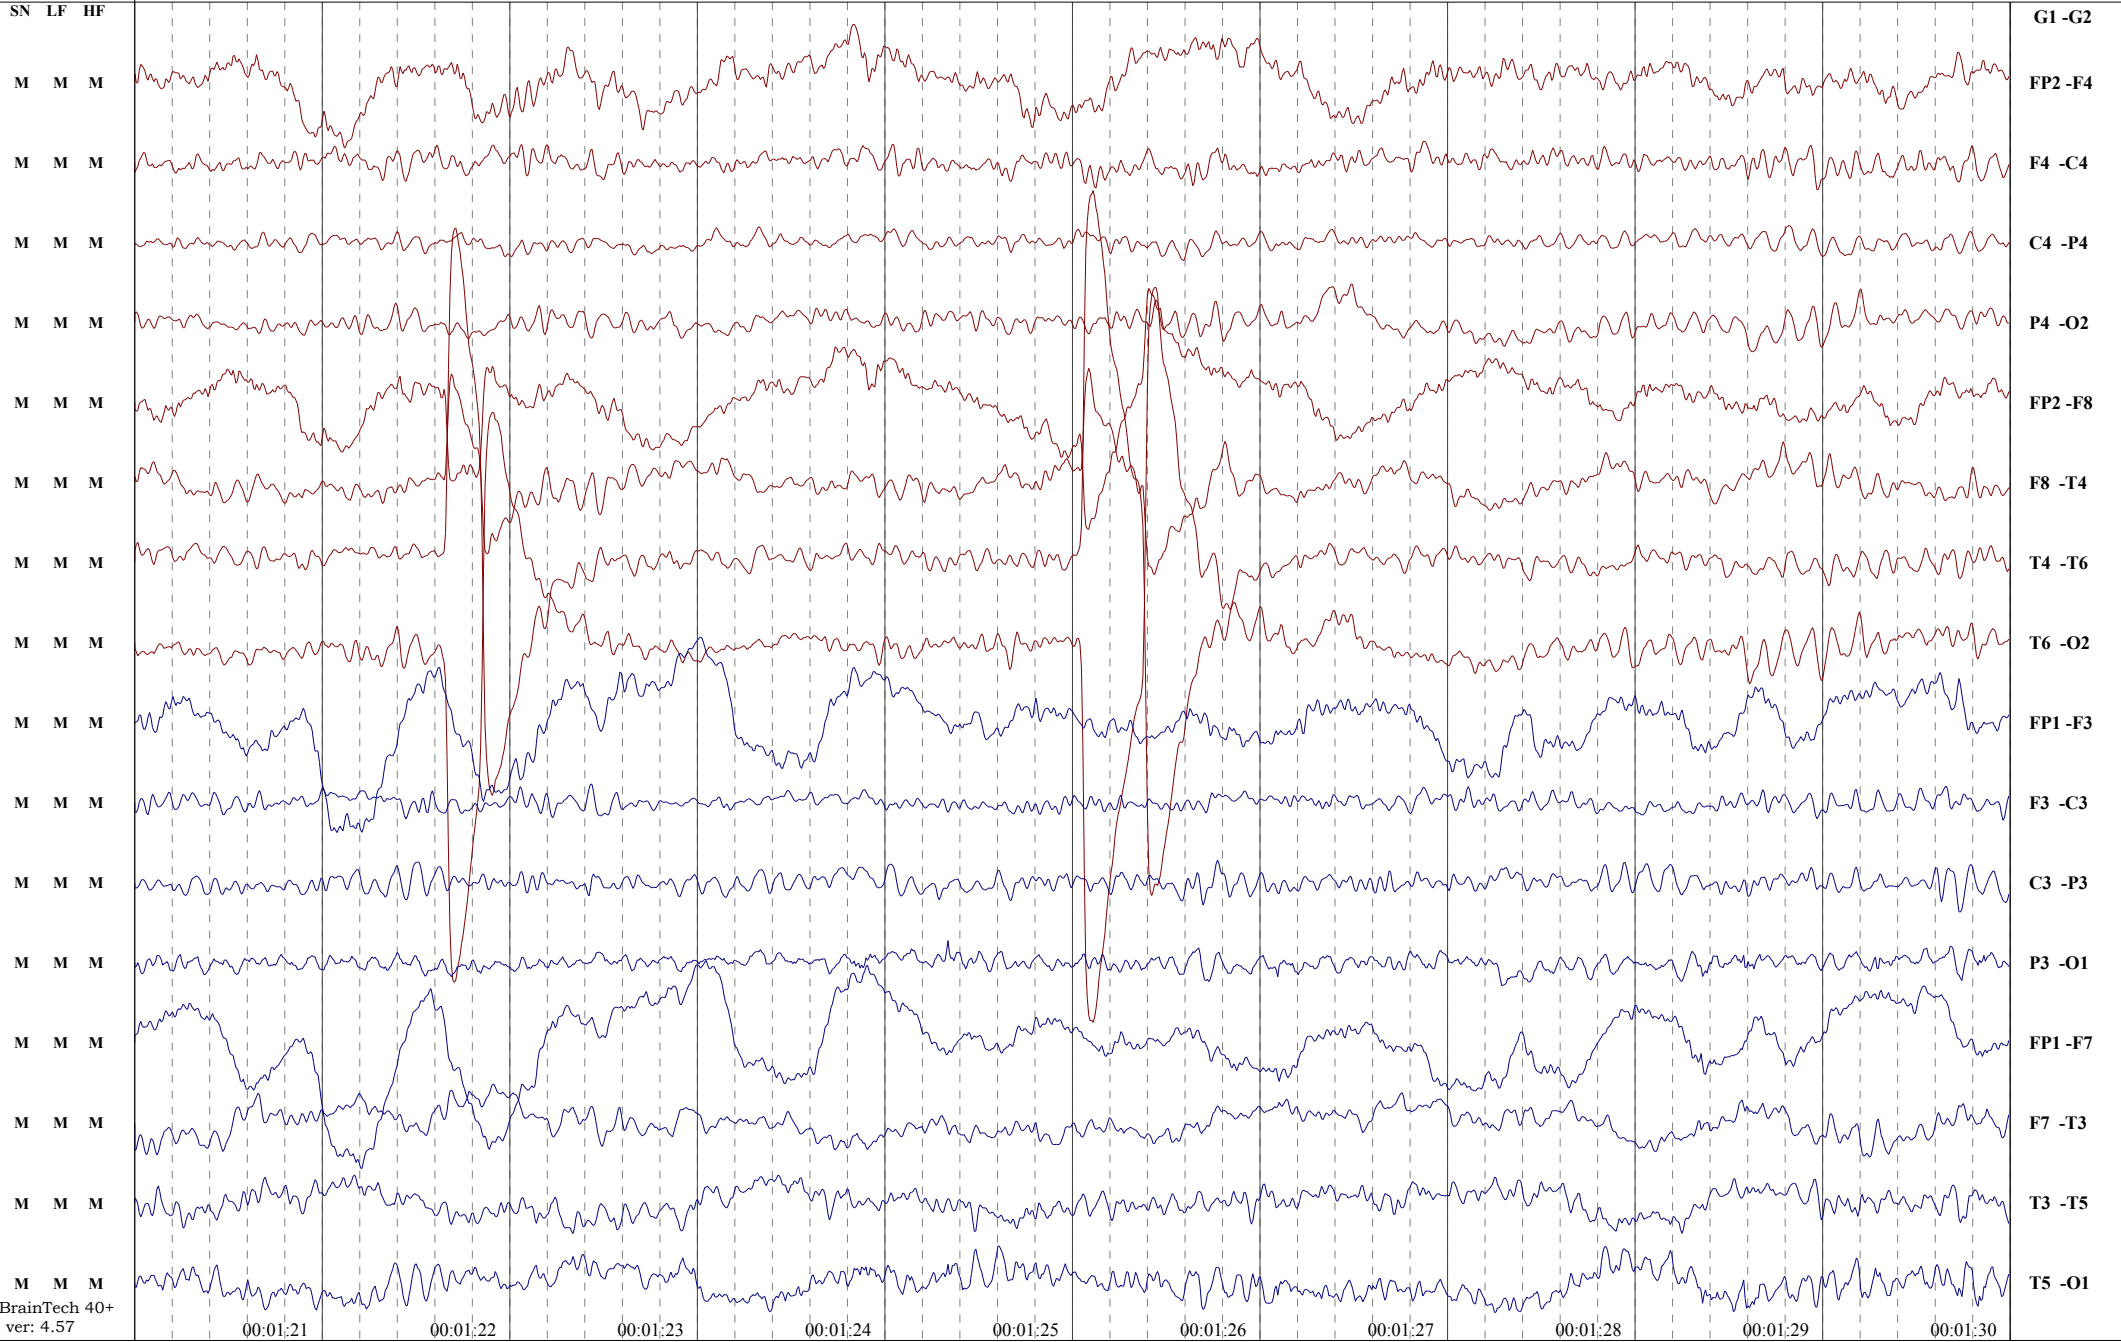

45  
MRS. HEENA SAHU  
28 Years/F

Date: 05-Aug-2023  
Type: ANALYSIS  
BIPOLAR LONGITUDNAL

Speed : 30 mm/S  
Sen : 7.5 uV/mm  
Filter : 1 Hz - 70 Hz

Time: 20:06:46  
Page:21/27  
Notch: ON

Ref:DR. RAJNISH PANDEY  
Dr. : DR. VIJENDRA PAINKARA  
Tech:

