


105
MRS. KAMLA BAI DEWANGAN
74 Years/F


Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:44:26
Page:1/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

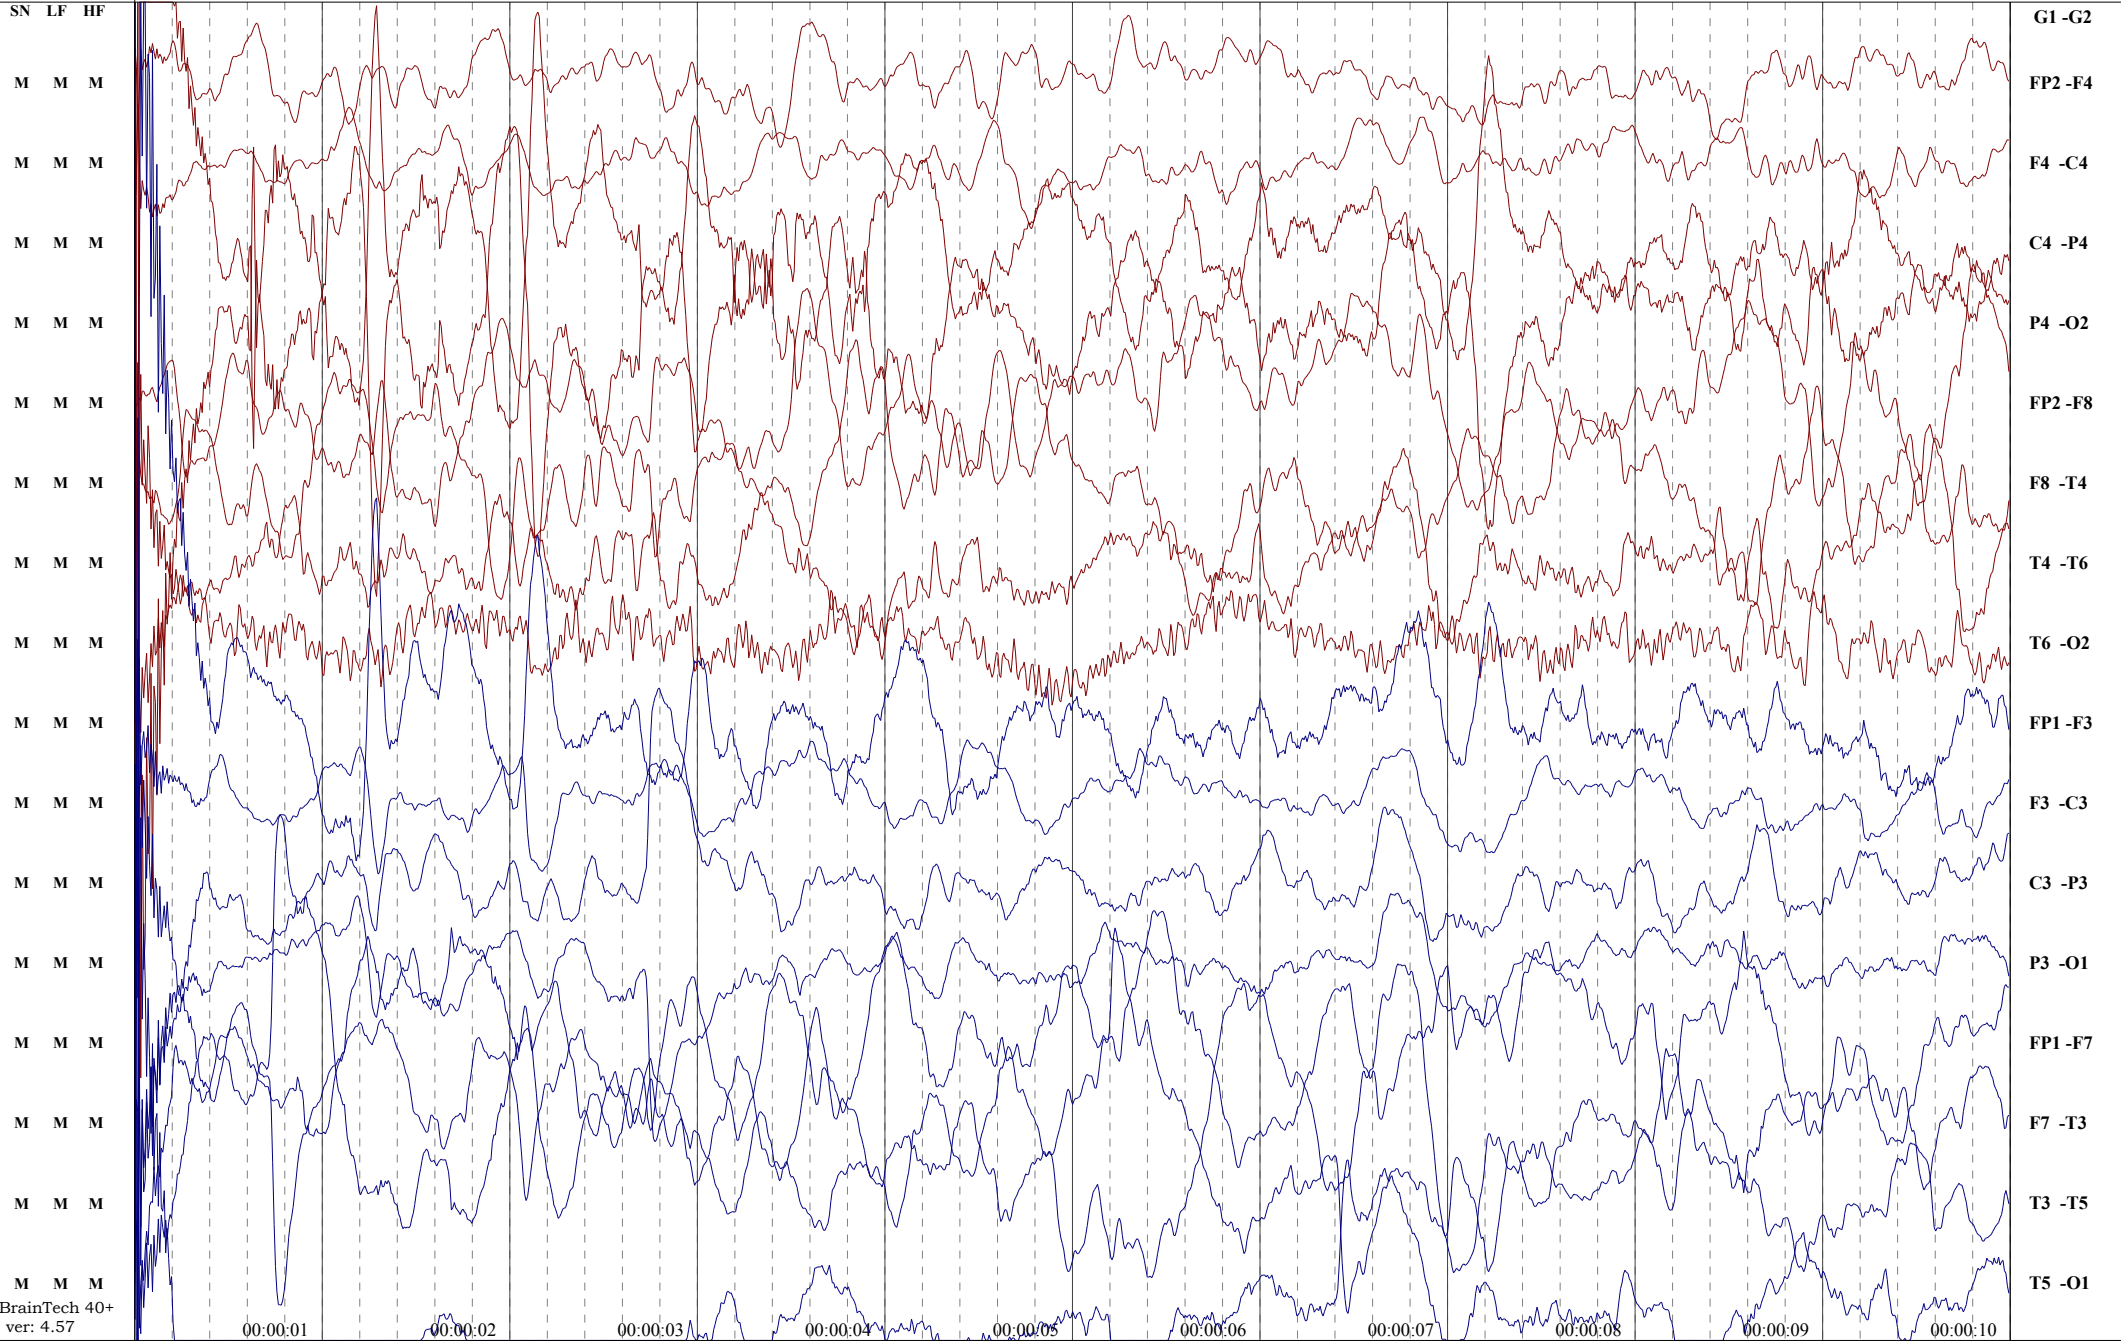

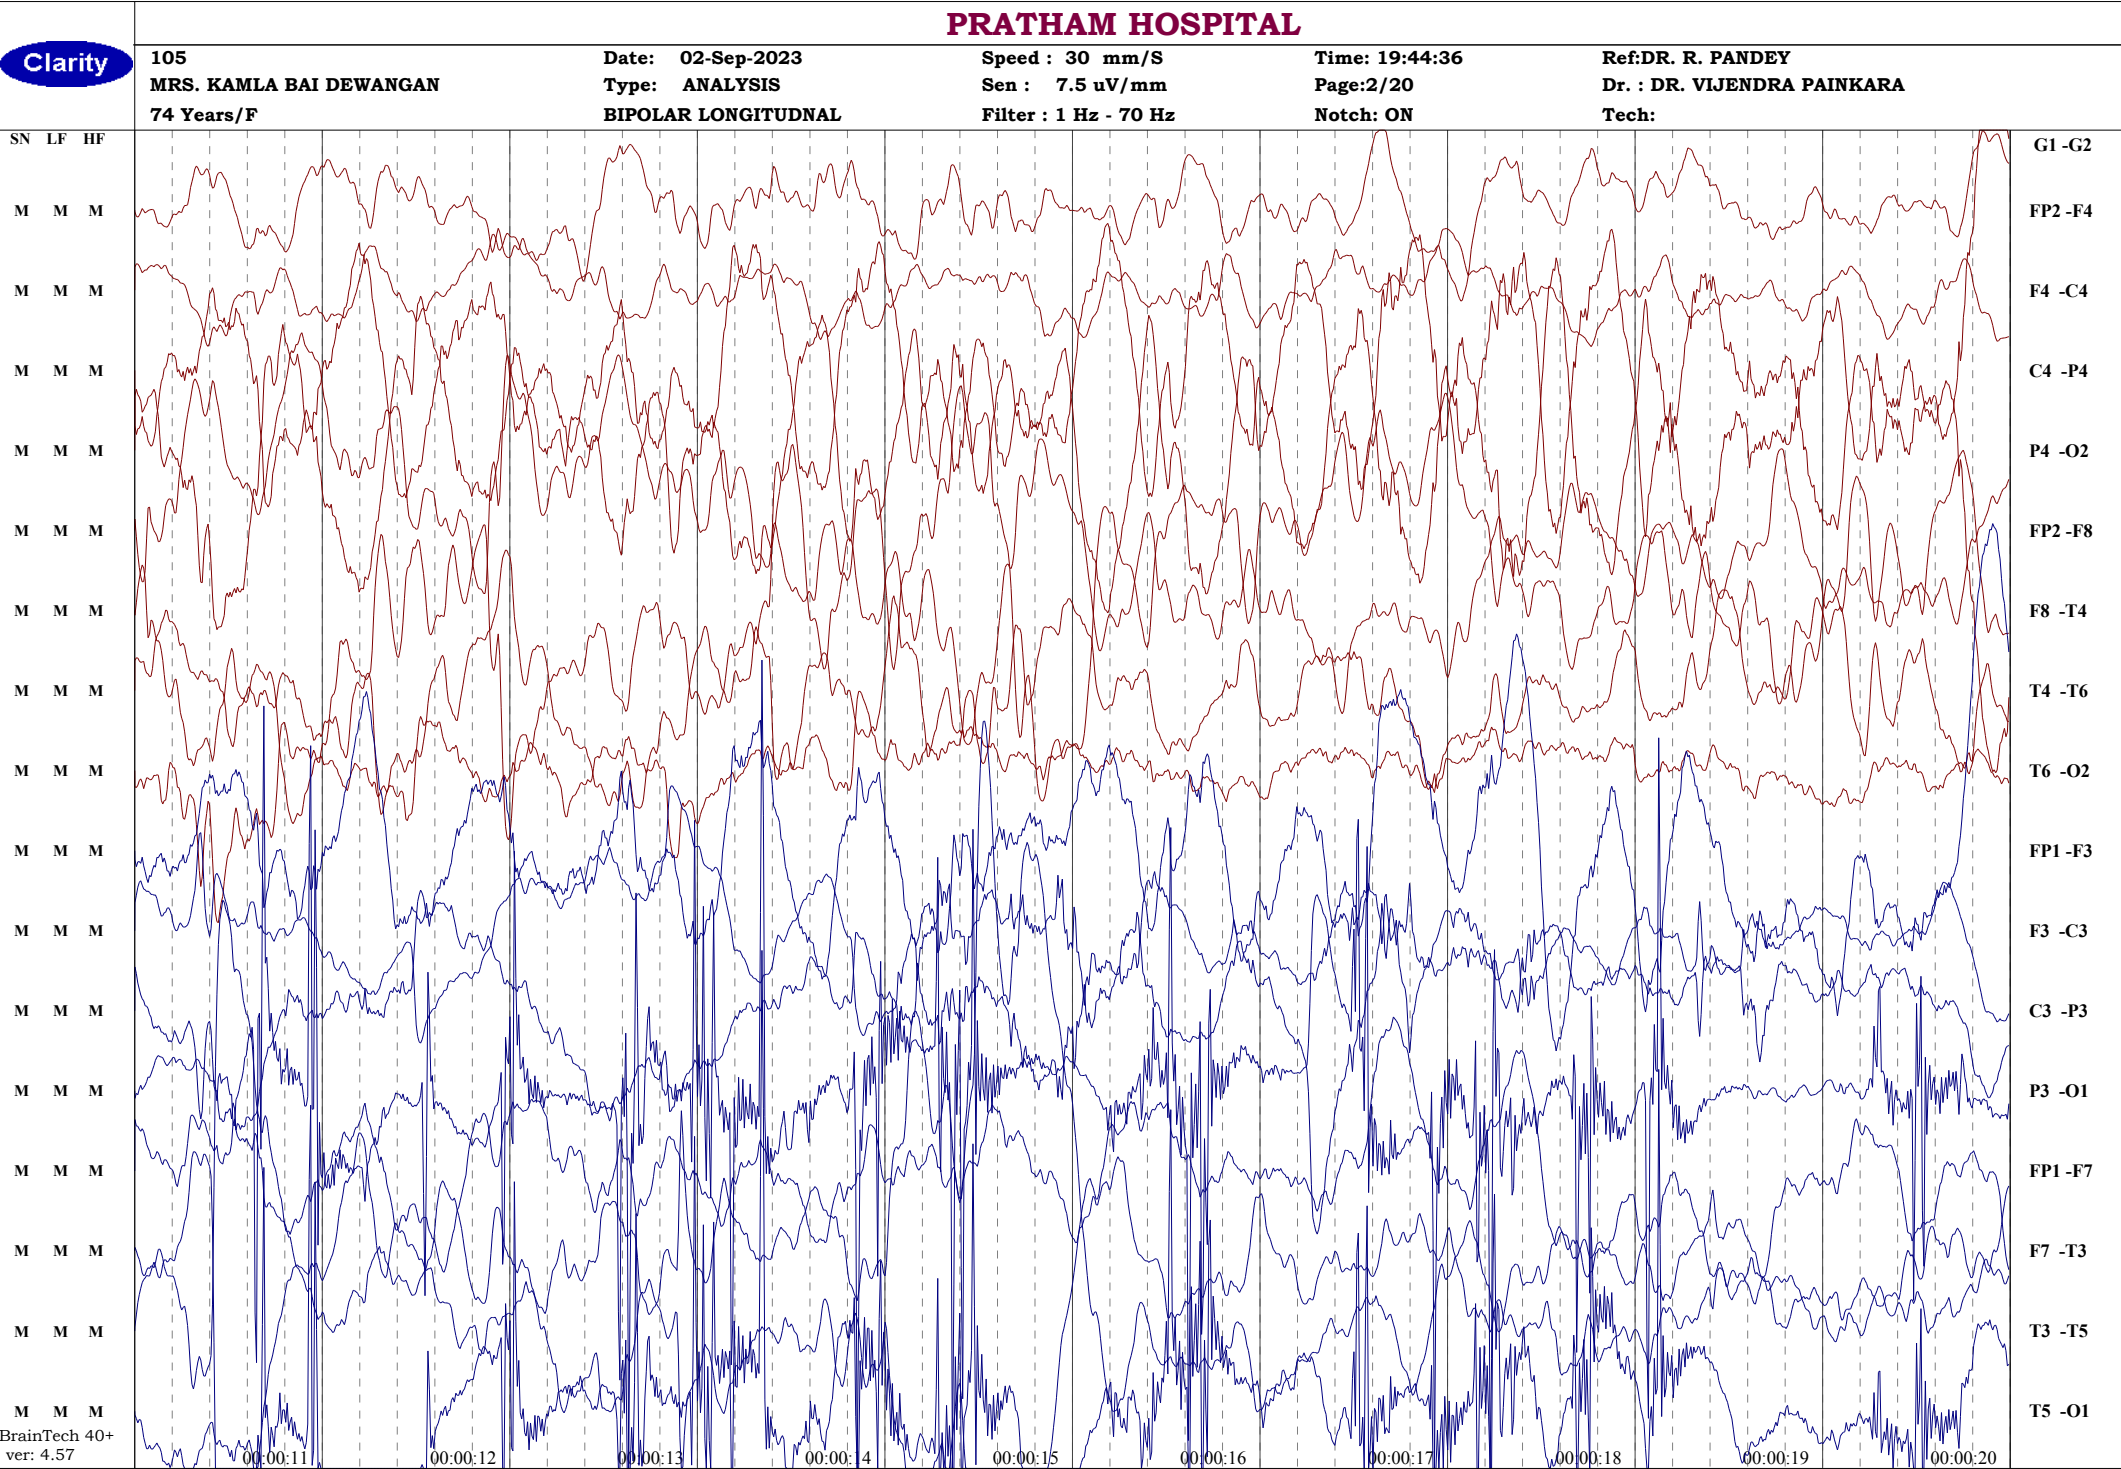


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:45:16
Page:6/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

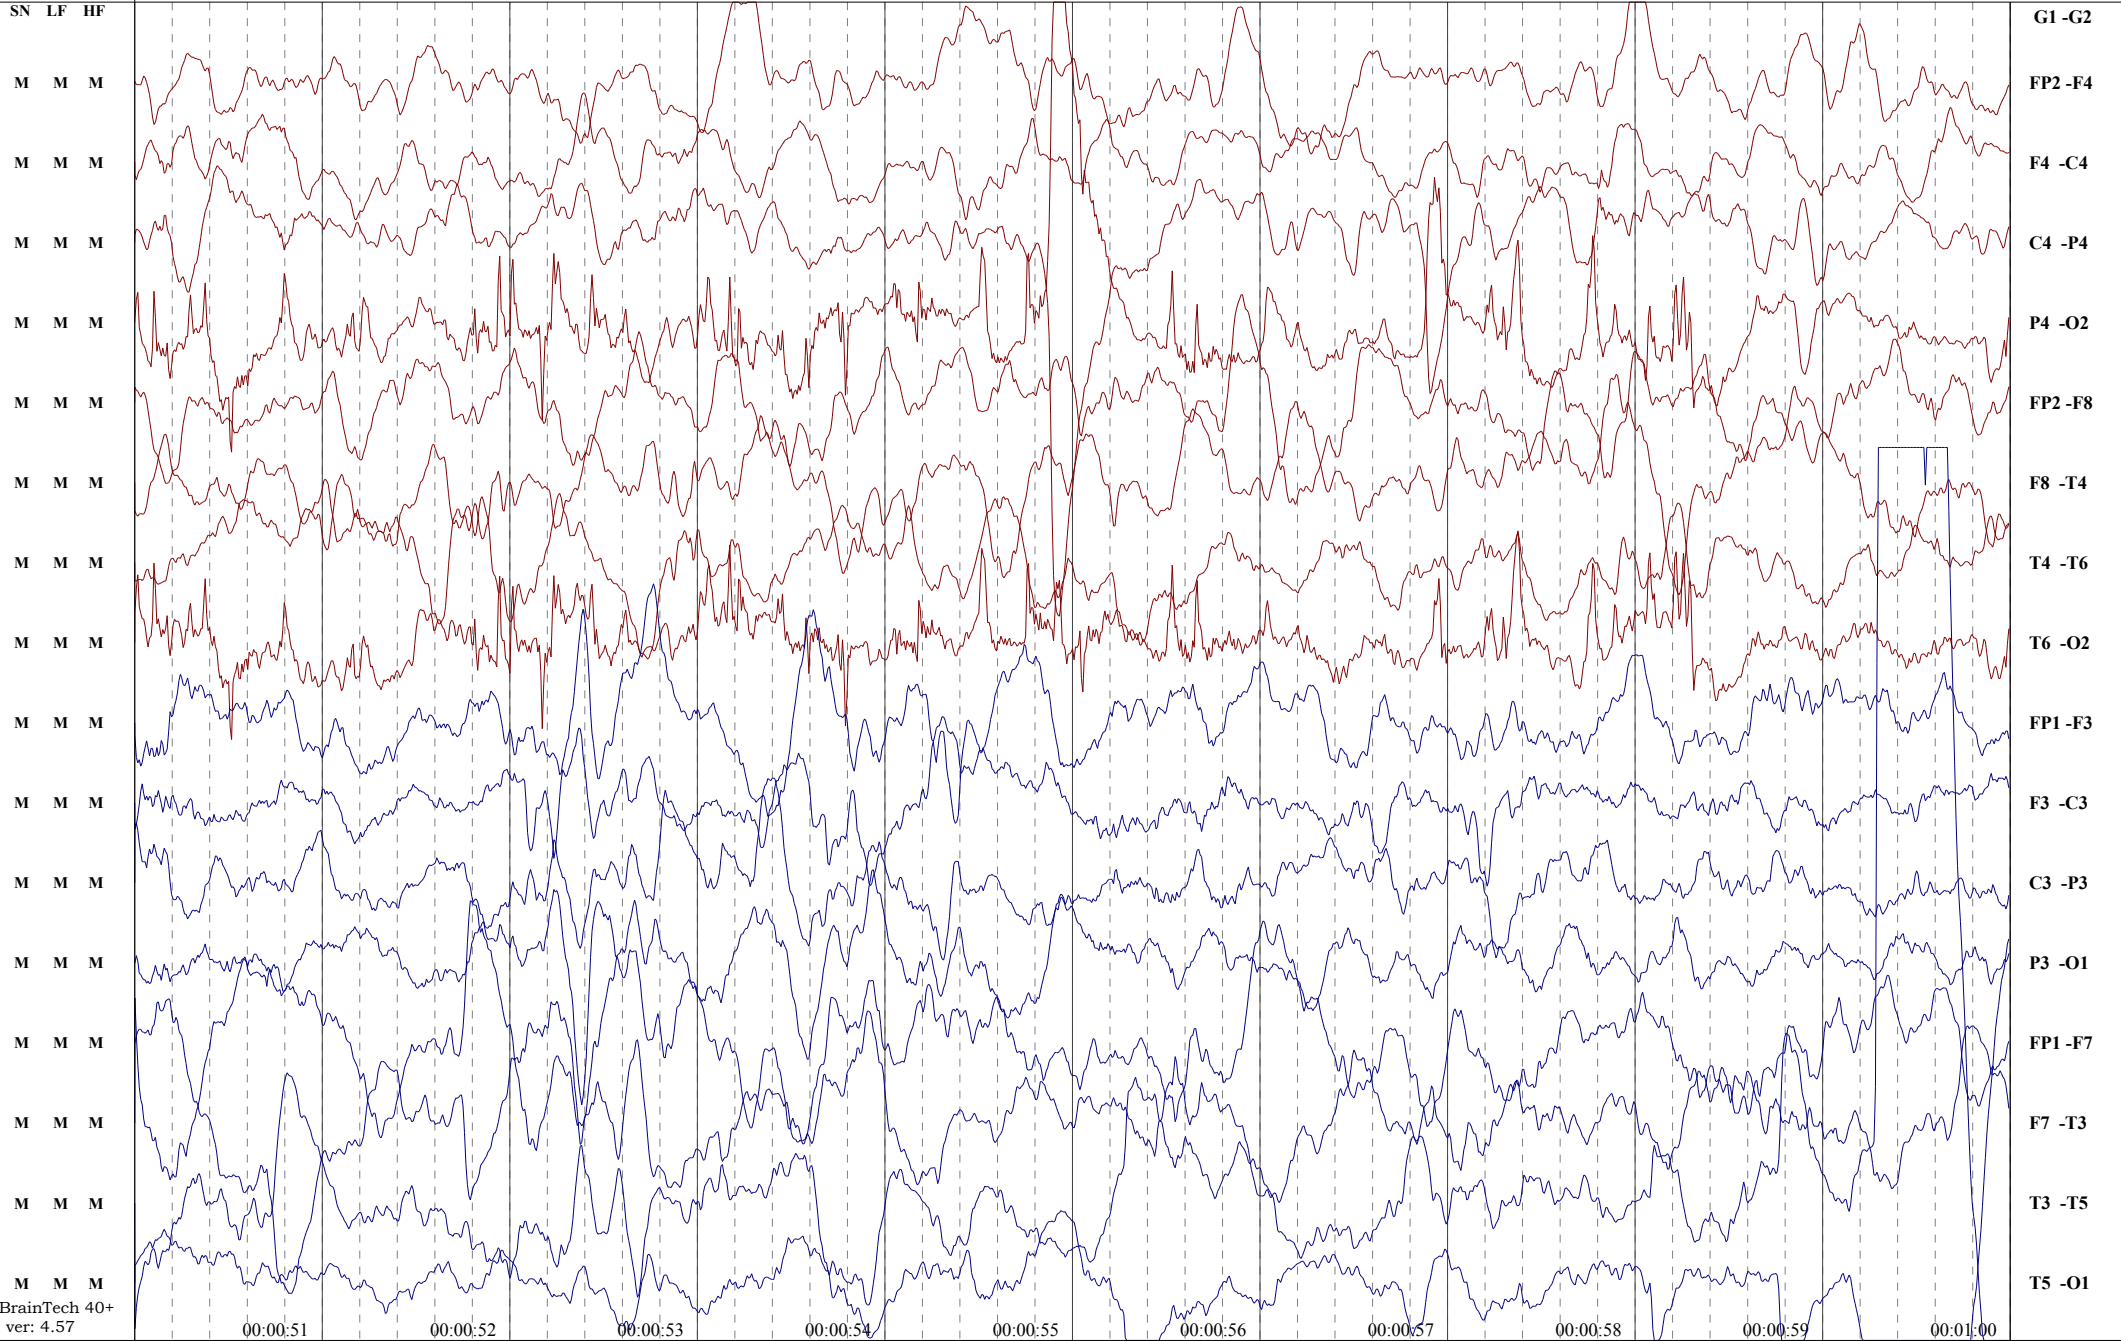


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDINAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:45:26
Page:7/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

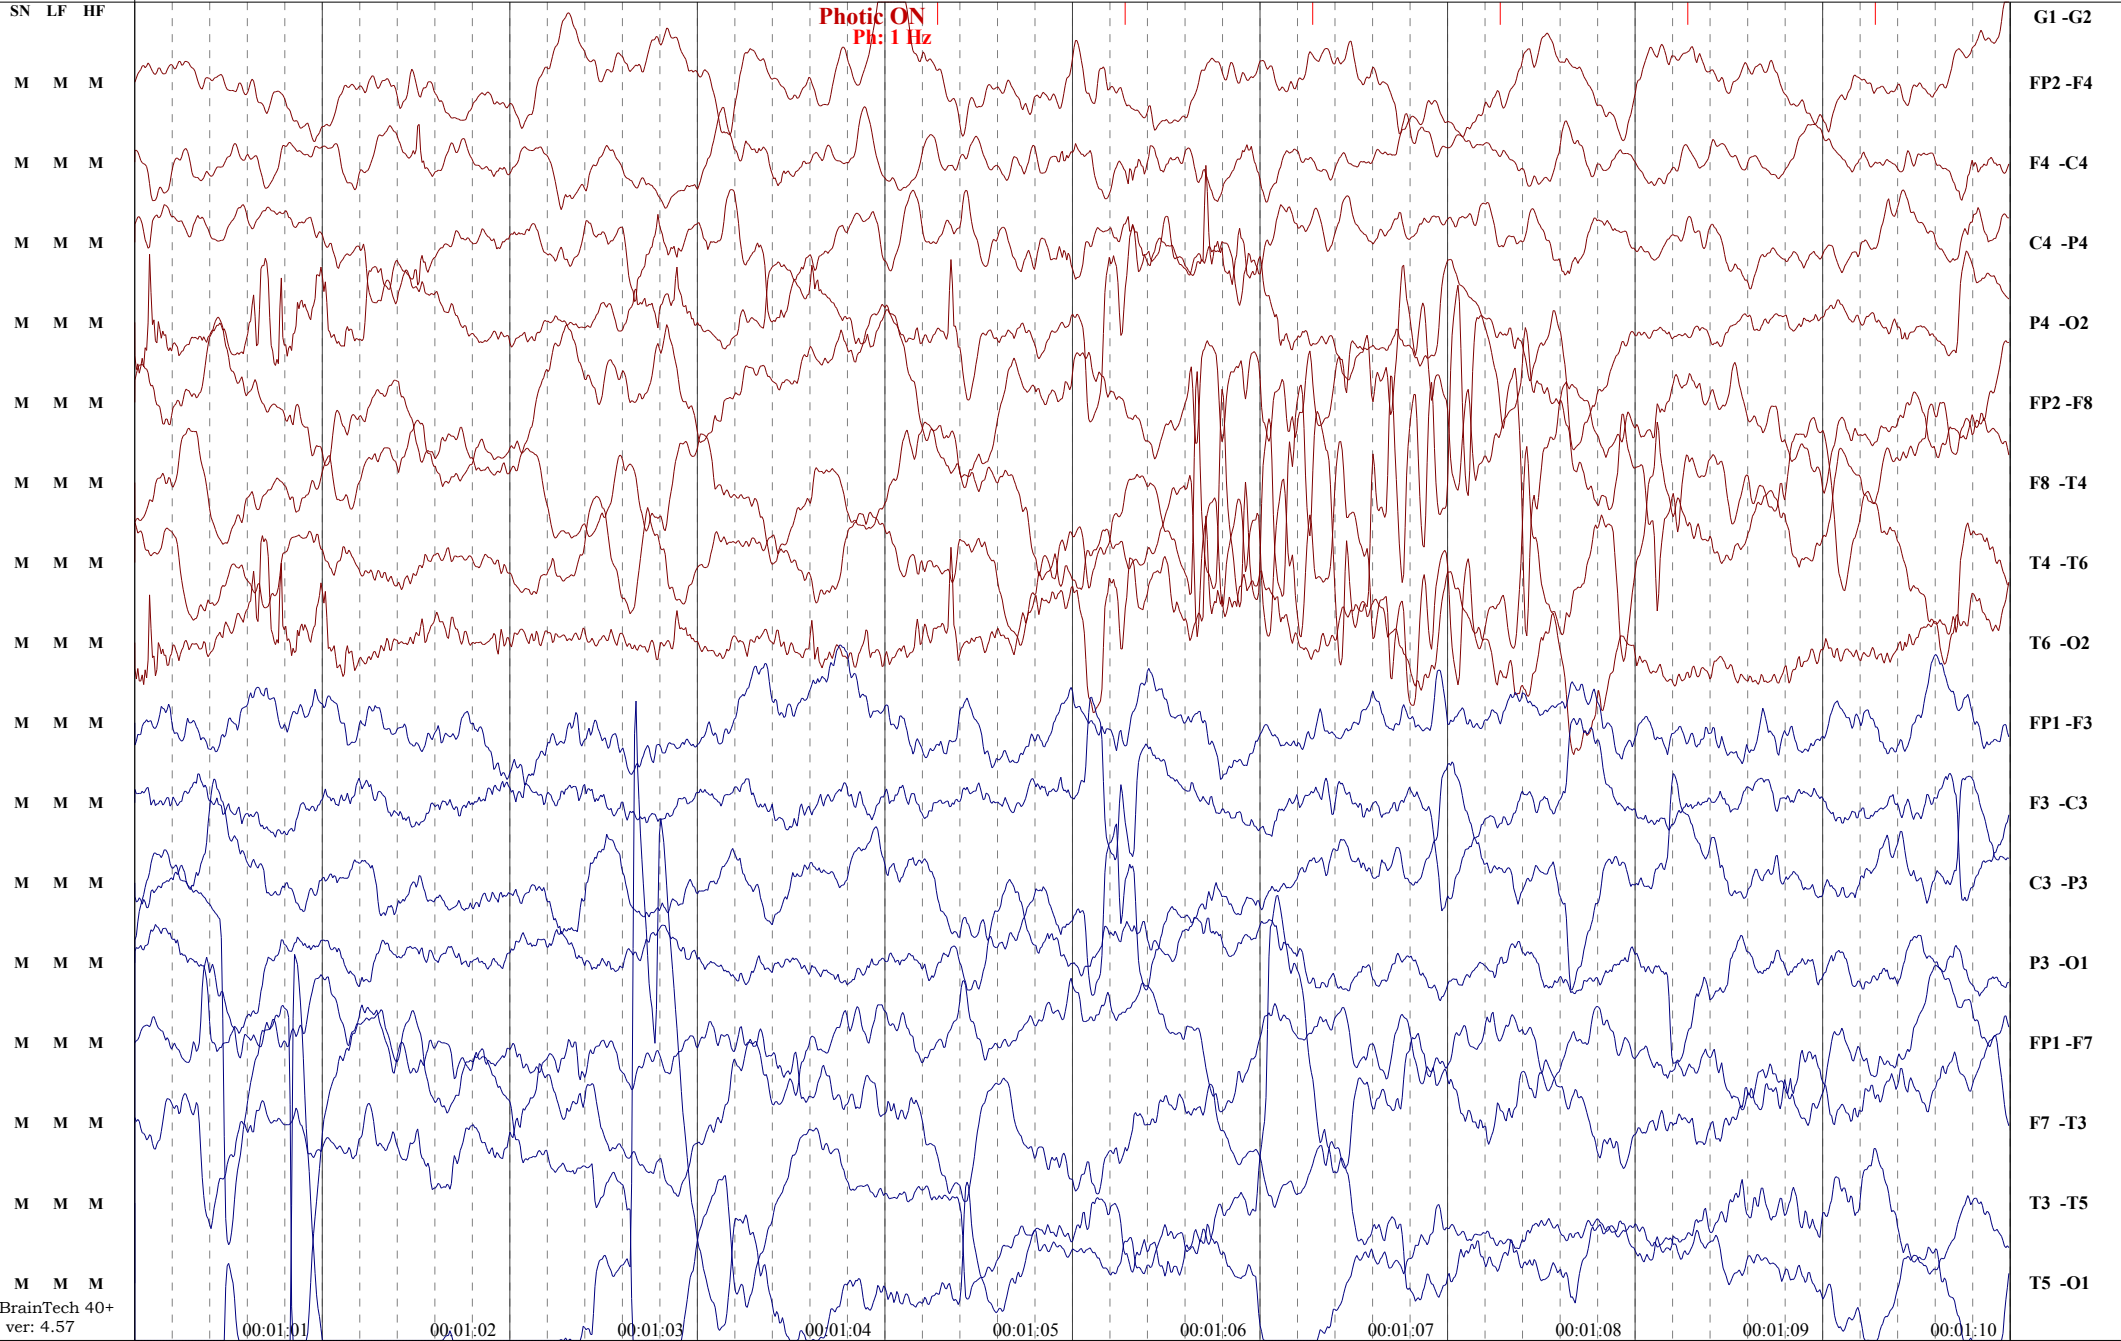


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:45:36
Page:8/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

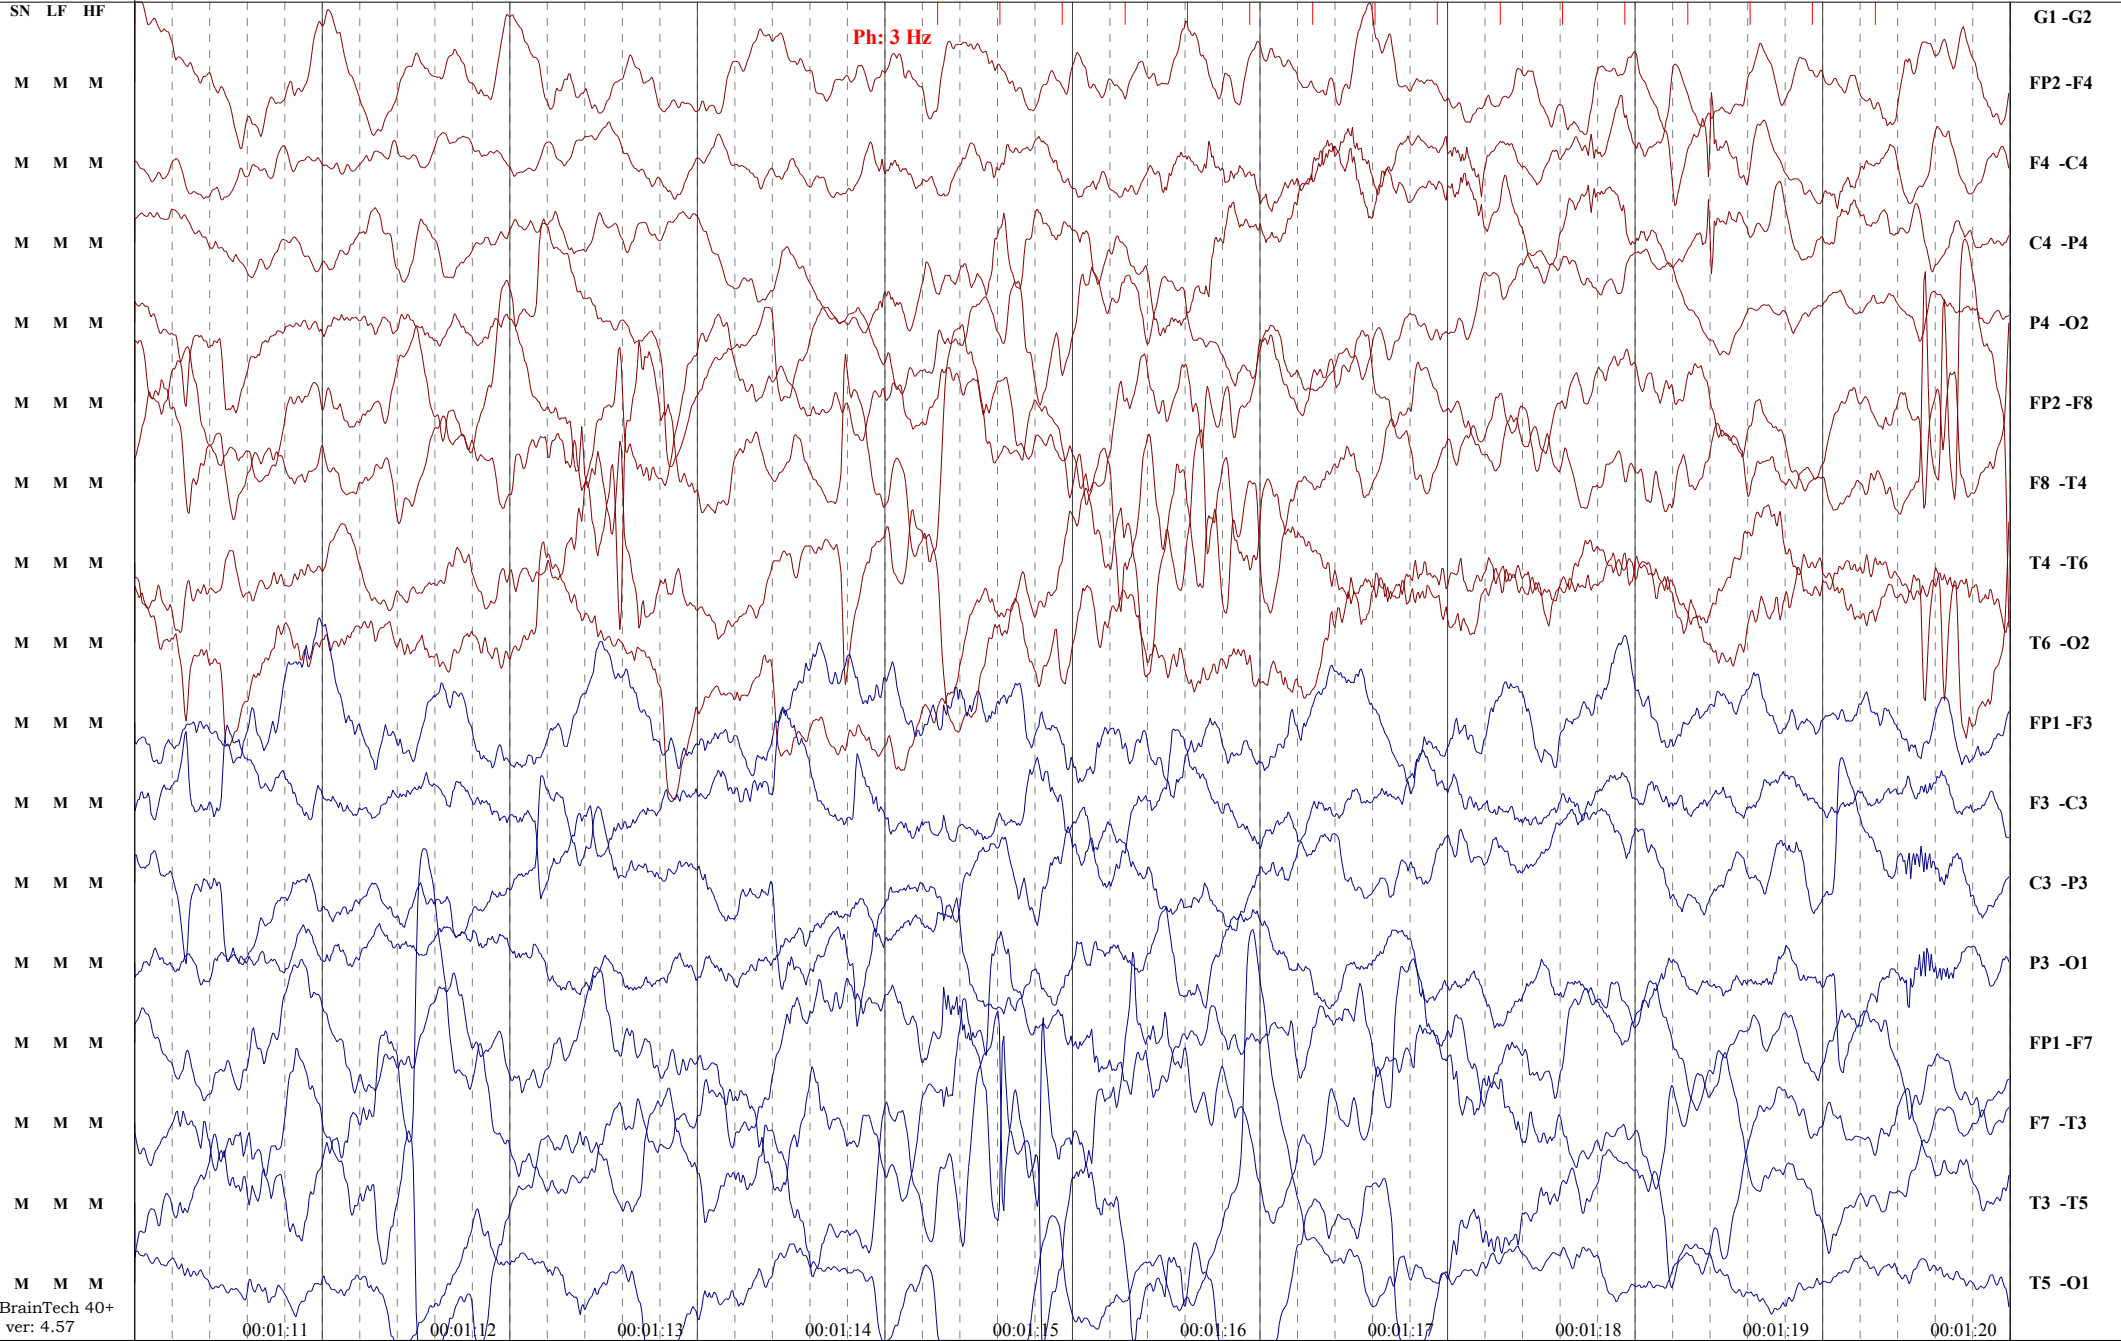

Clarity

PRATHAM HOSPITAL


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:45:56
Page:10/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

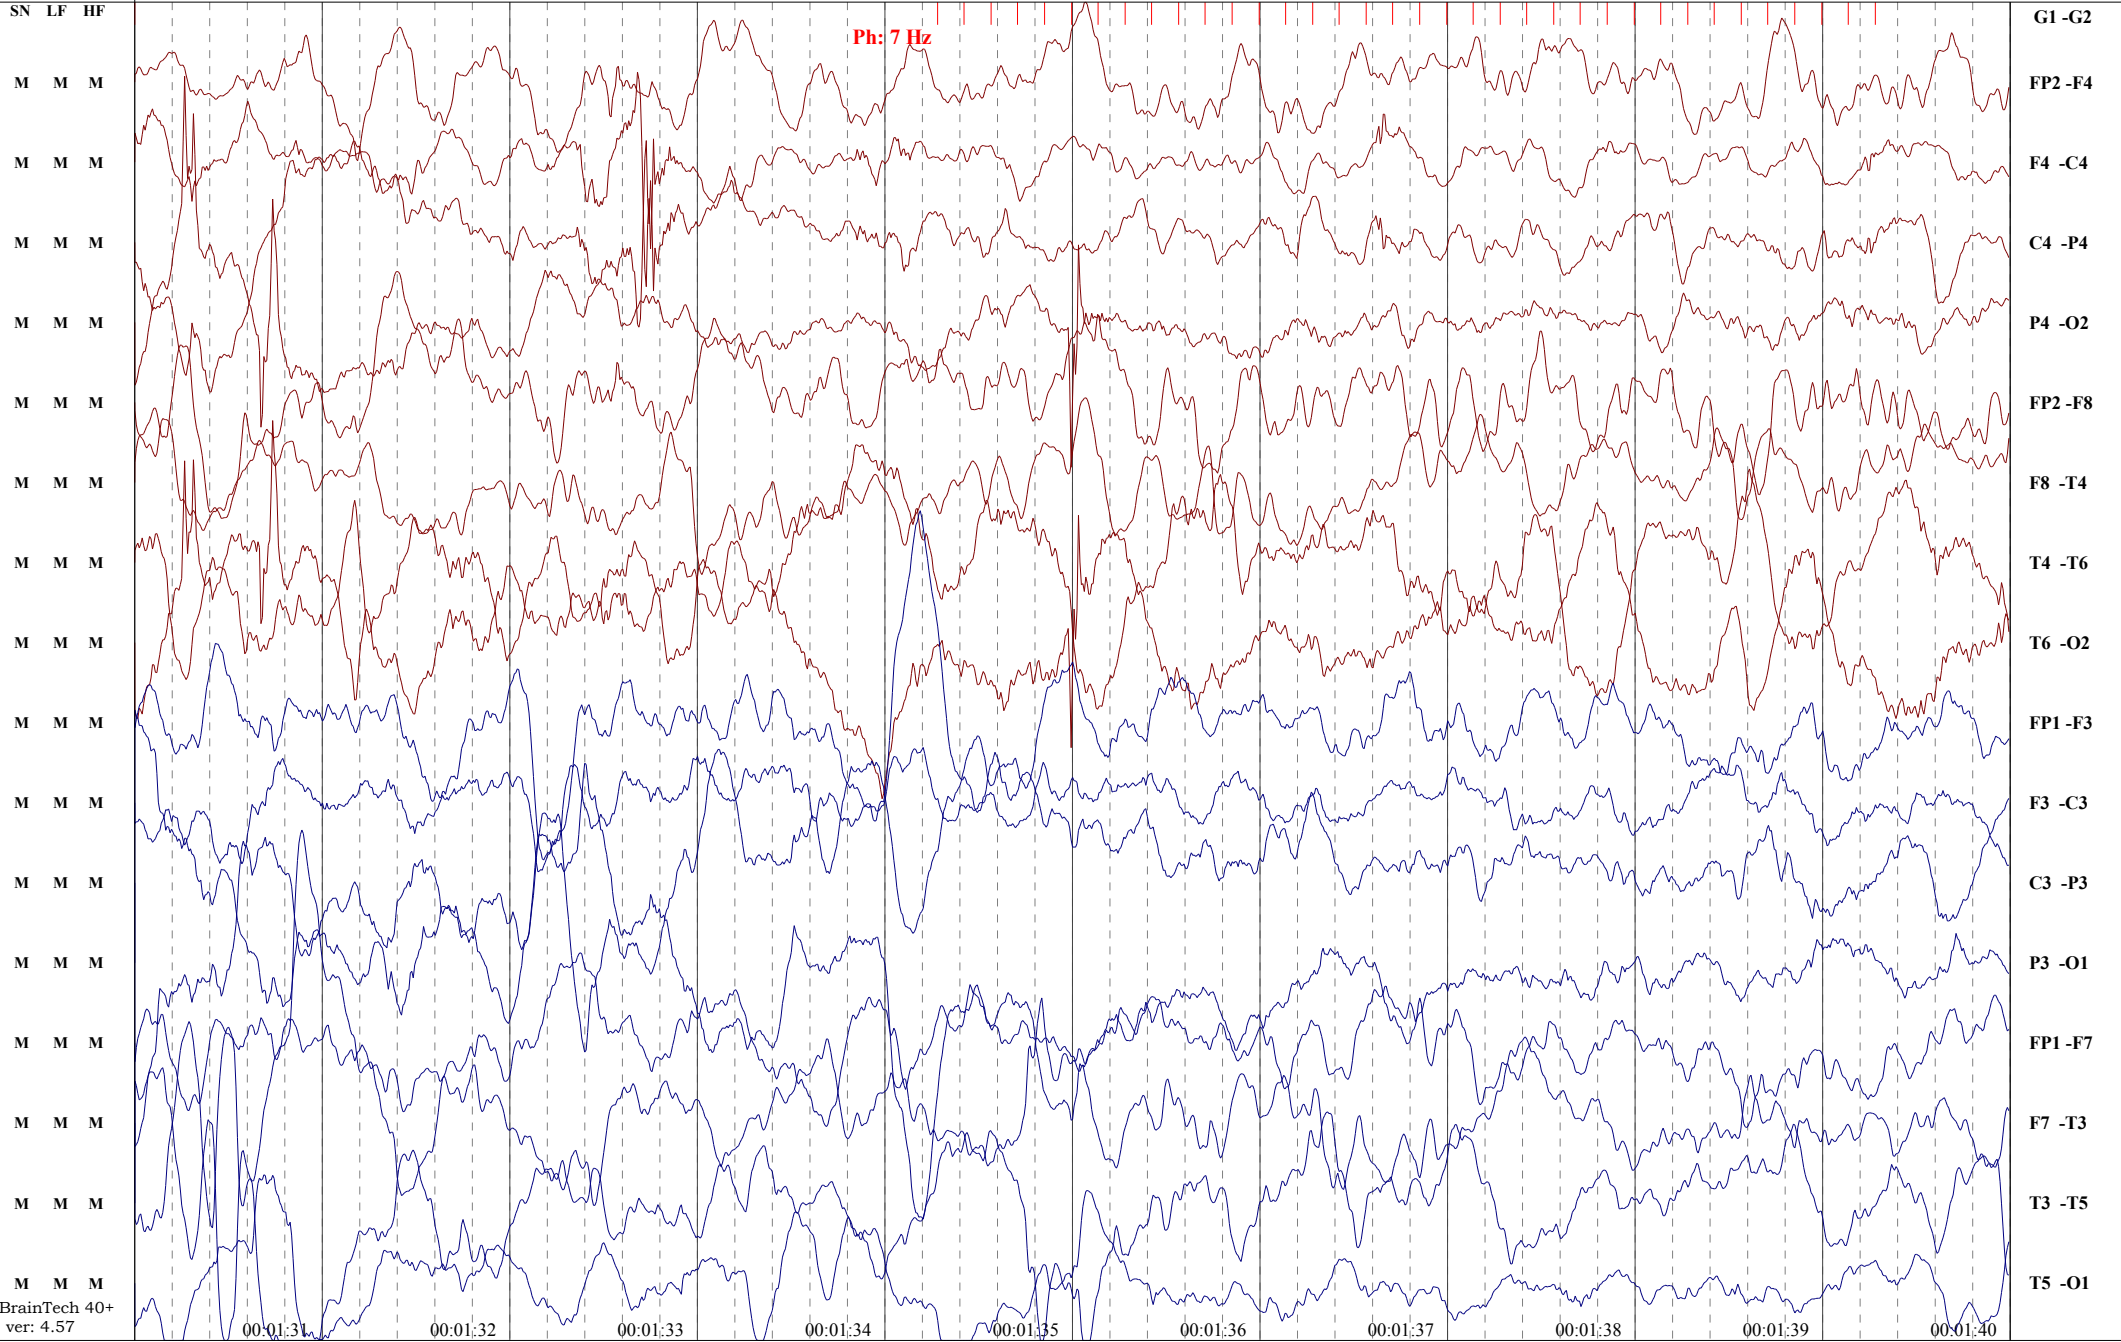

<div>Clarity</div>				<div>PRATHAM HOSPITAL</div>															
105				Date: 02-Sep-2023				Speed : 30 mm/S				Time: 19:46:06				Ref:DR. R. PANDEY			
MRS. KAMLA BAI DEWANGAN				Type: ANALYSIS				Sen : 7.5 uV/mm				Page:11/20				Dr. : DR. VIJENDRA PAINKARA			
74 Years/F				BIPOLAR LONGITUDNAL				Filter : 1 Hz - 70 Hz				Notch: ON				Tech:			
SN	LF	HF																	G1 -G2
M	M	M																	FP2 -F4
M	M	M																	F4 -C4
M	M	M																	C4 -P4
M	M	M																	P4 -O2
M	M	M																	FP2 -F8
M	M	M																	F8 -T4
M	M	M																	T4 -T6
M	M	M																	T6 -O2
M	M	M																	FP1 -F3
M	M	M																	F3 -C3
M	M	M																	C3 -P3
M	M	M																	P3 -O1
M	M	M																	FP1 -F7
M	M	M																	F7 -T3
M	M	M																	T3 -T5
M	M	M																	T5 -O1
BrainTech 40+ ver: 4.57																			


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:46:16
Page:12/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

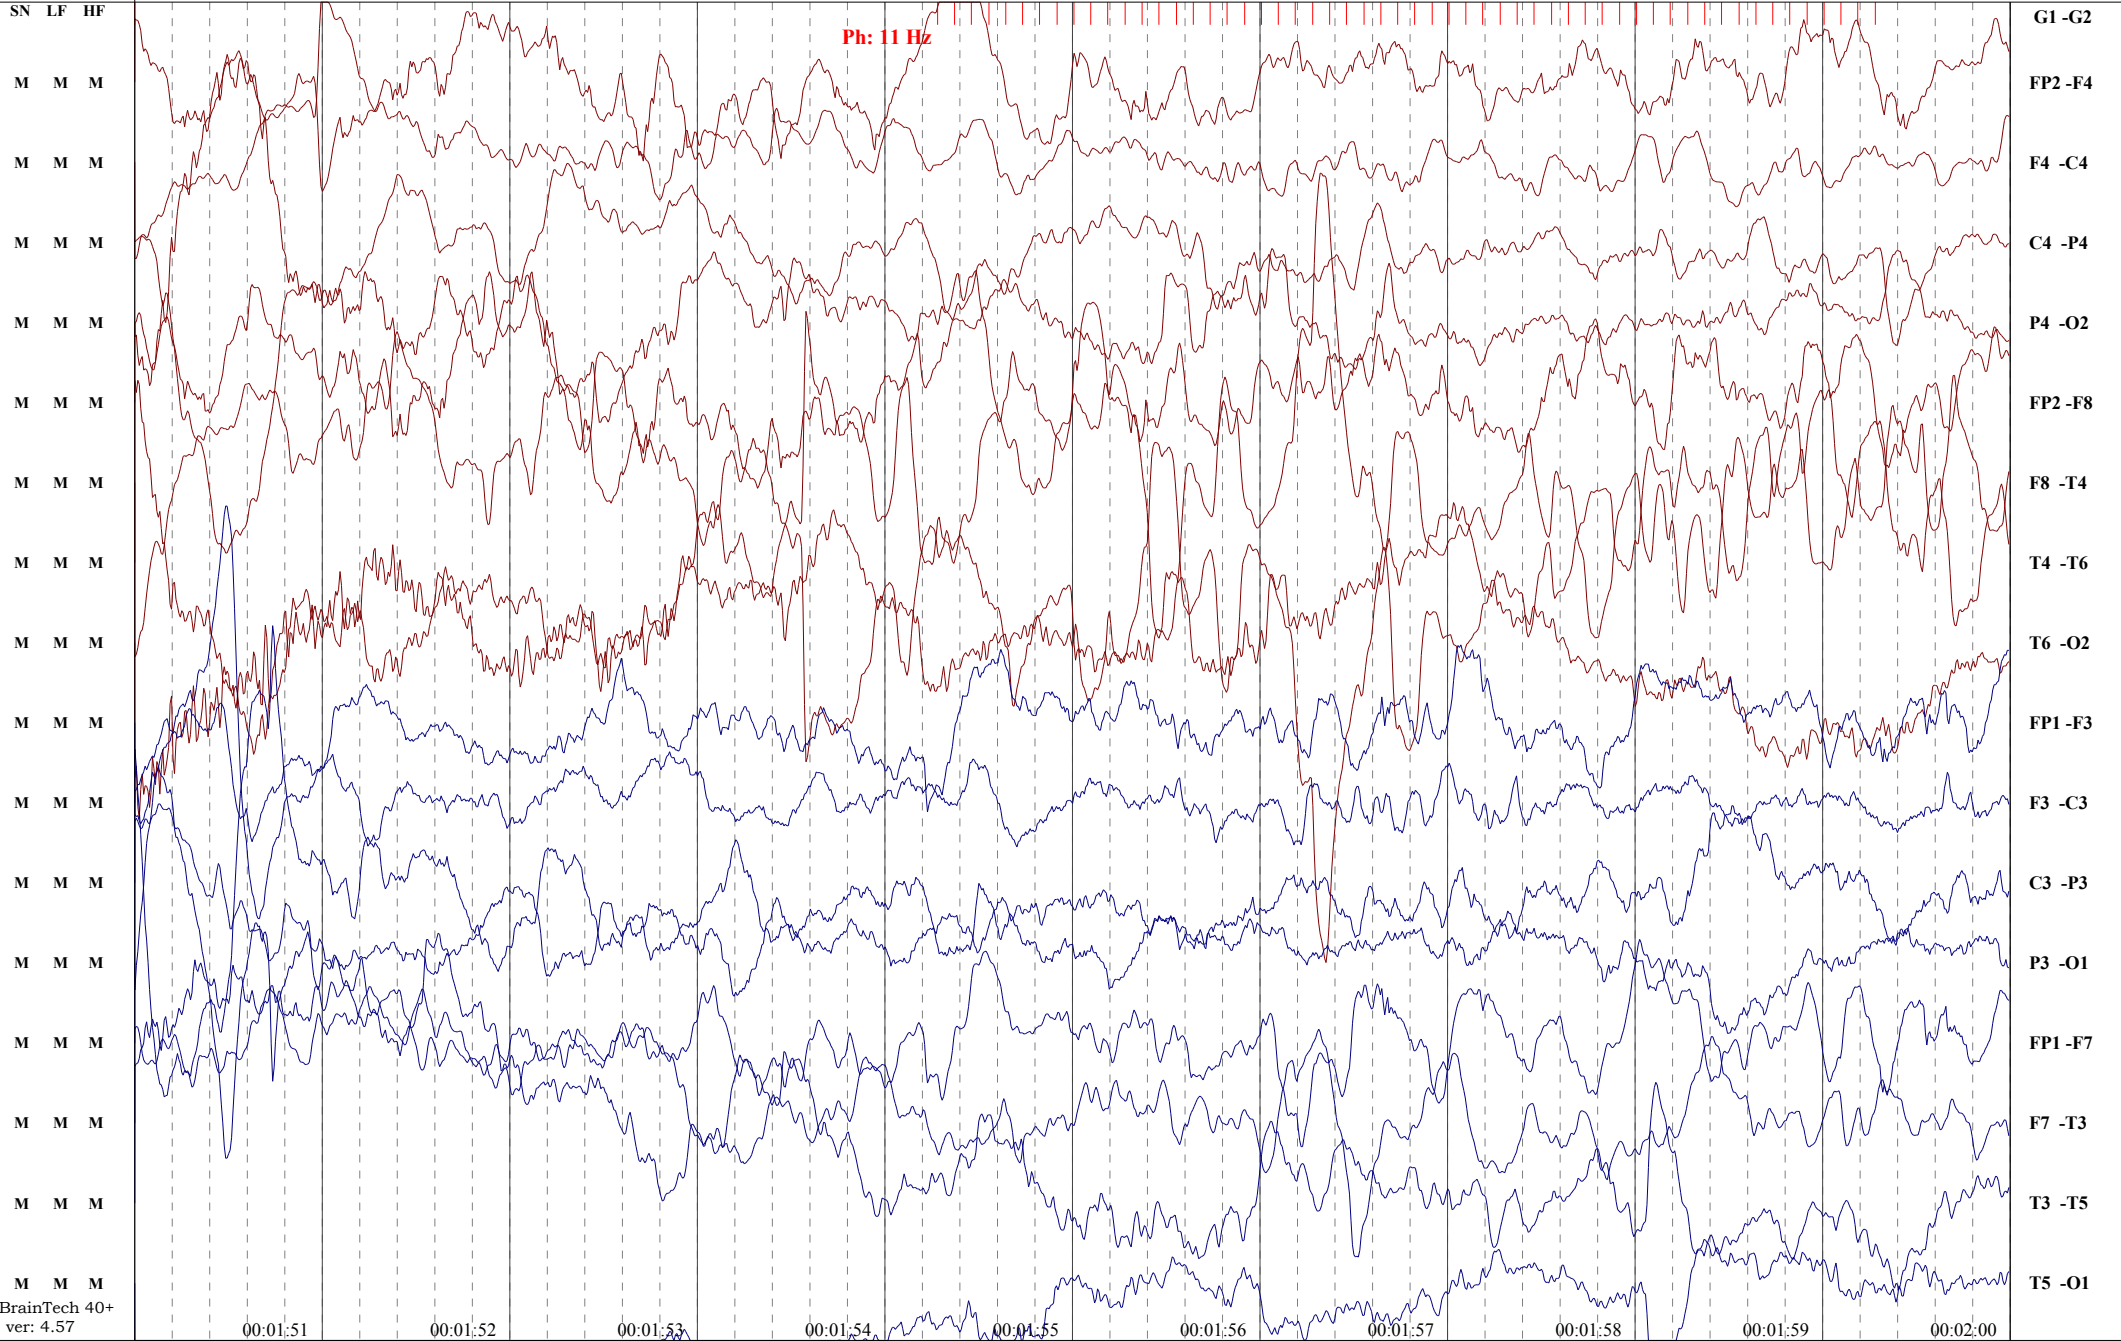


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:46:26
Page:13/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

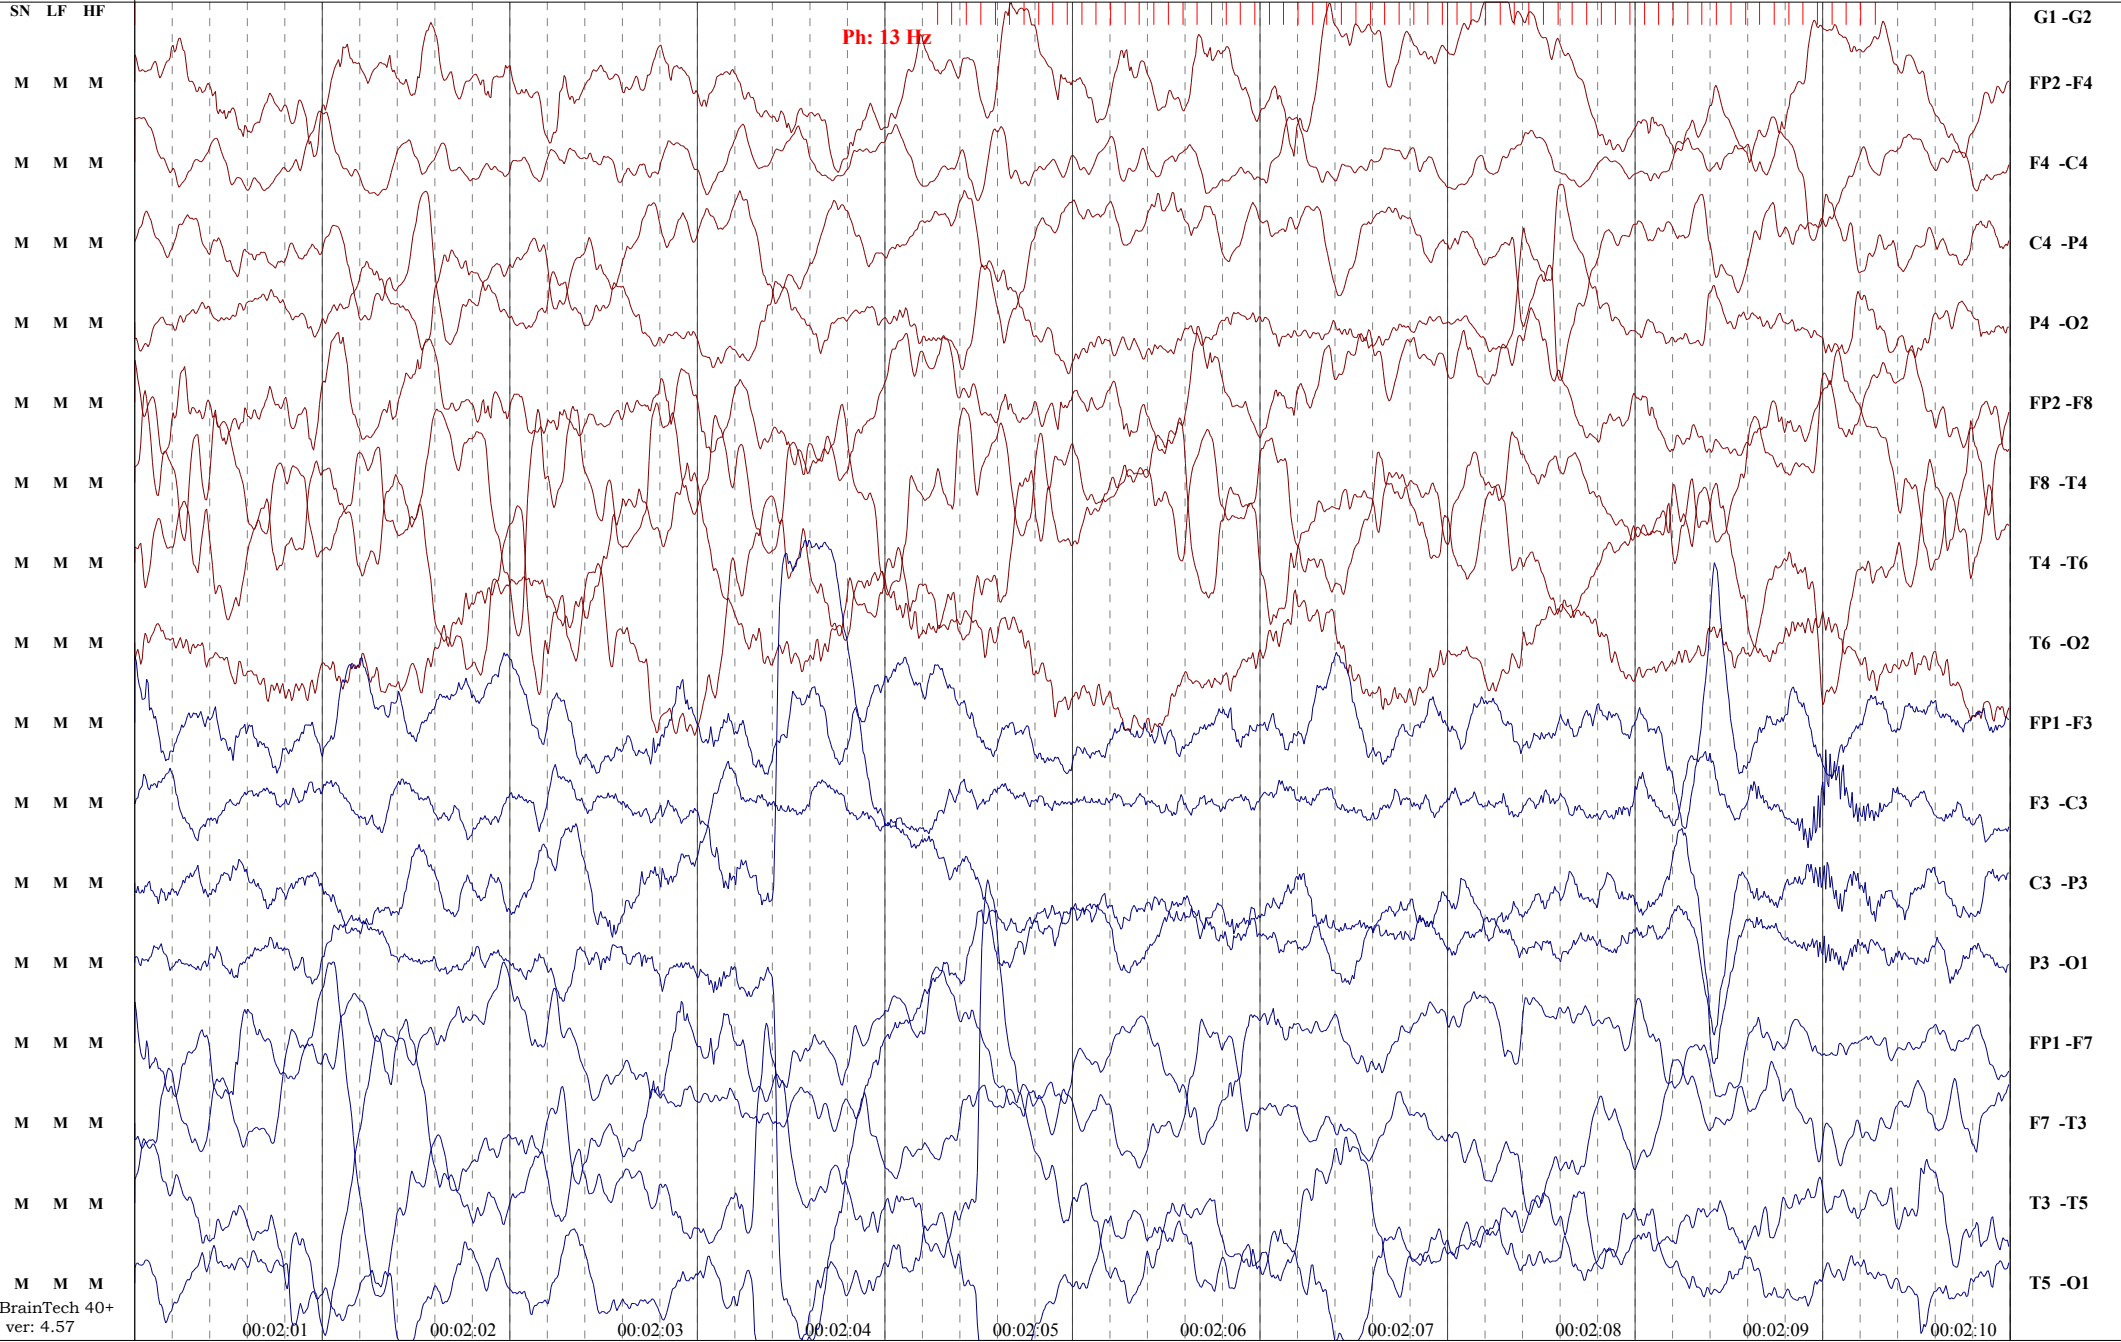


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:46:36
Page:14/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

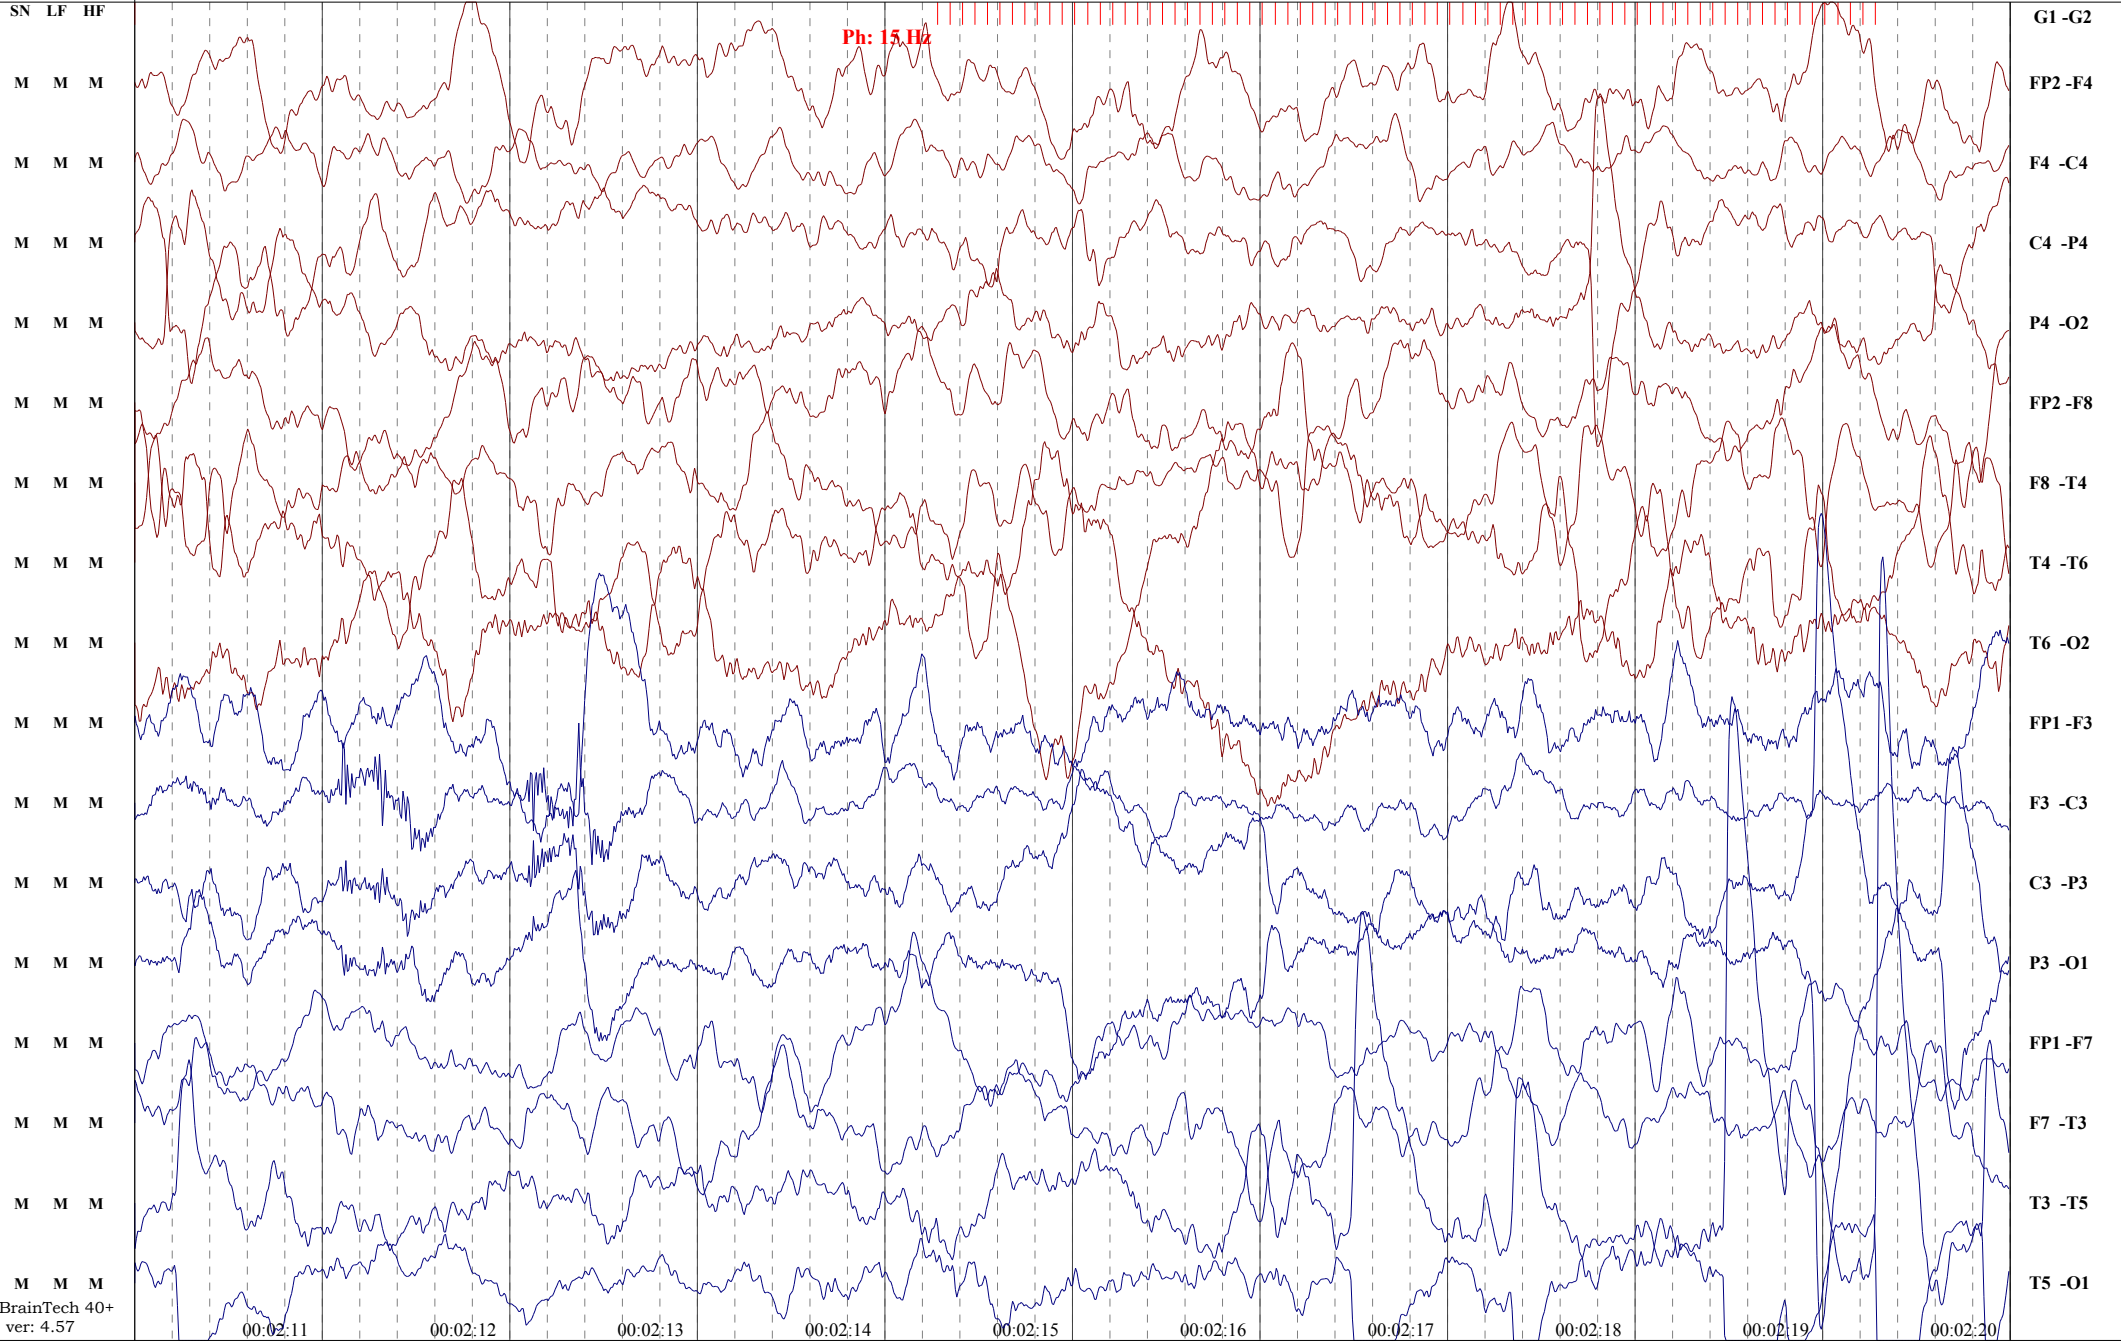


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:46:46
Page:15/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

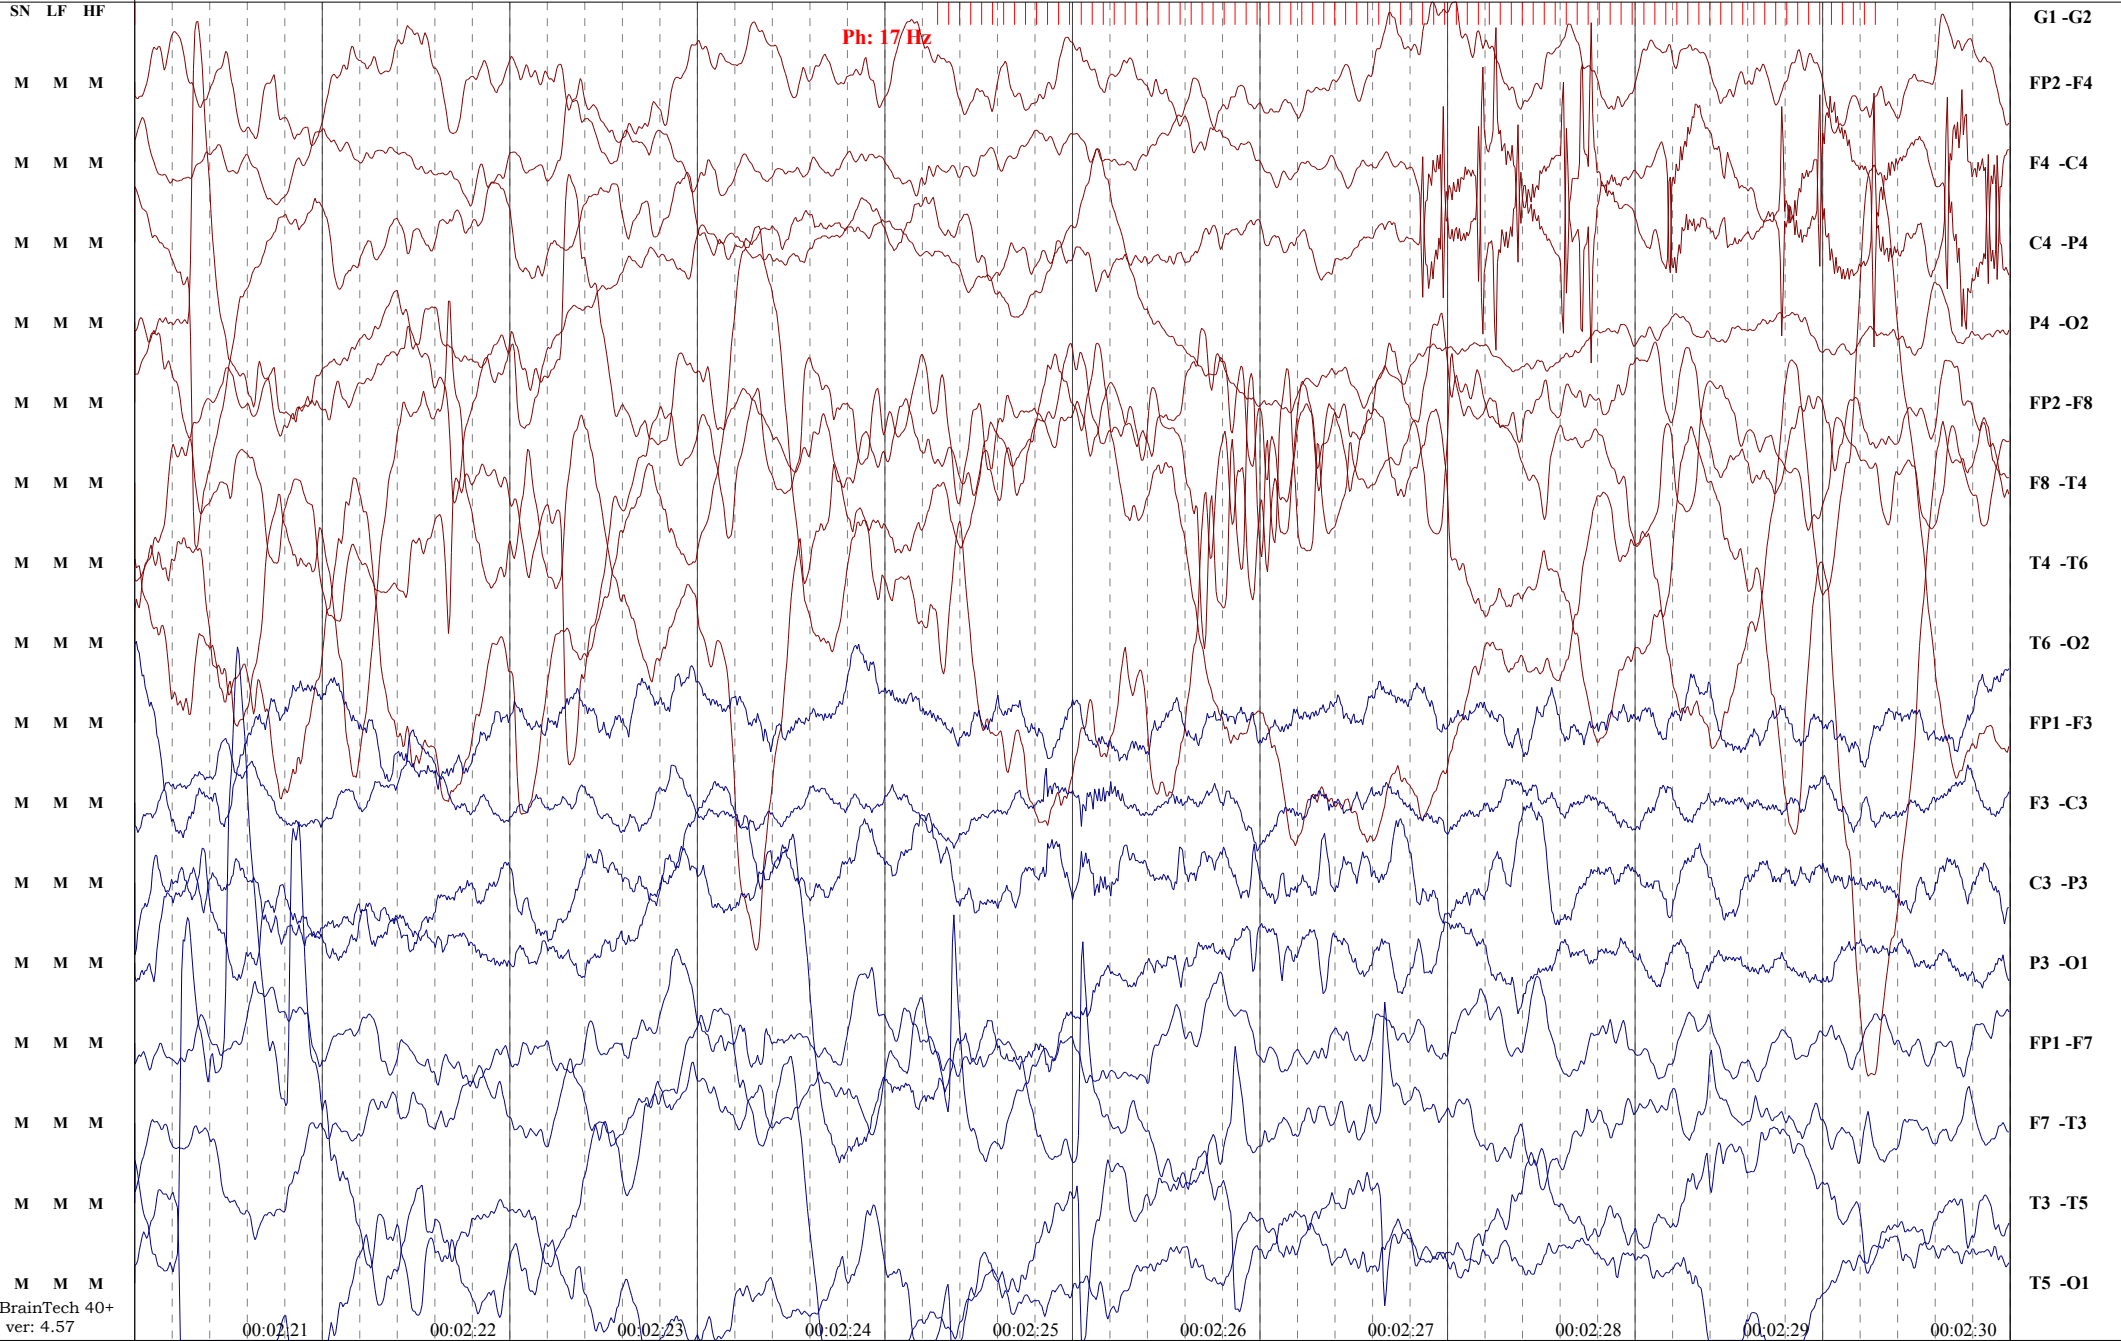


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:46:56
Page:16/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

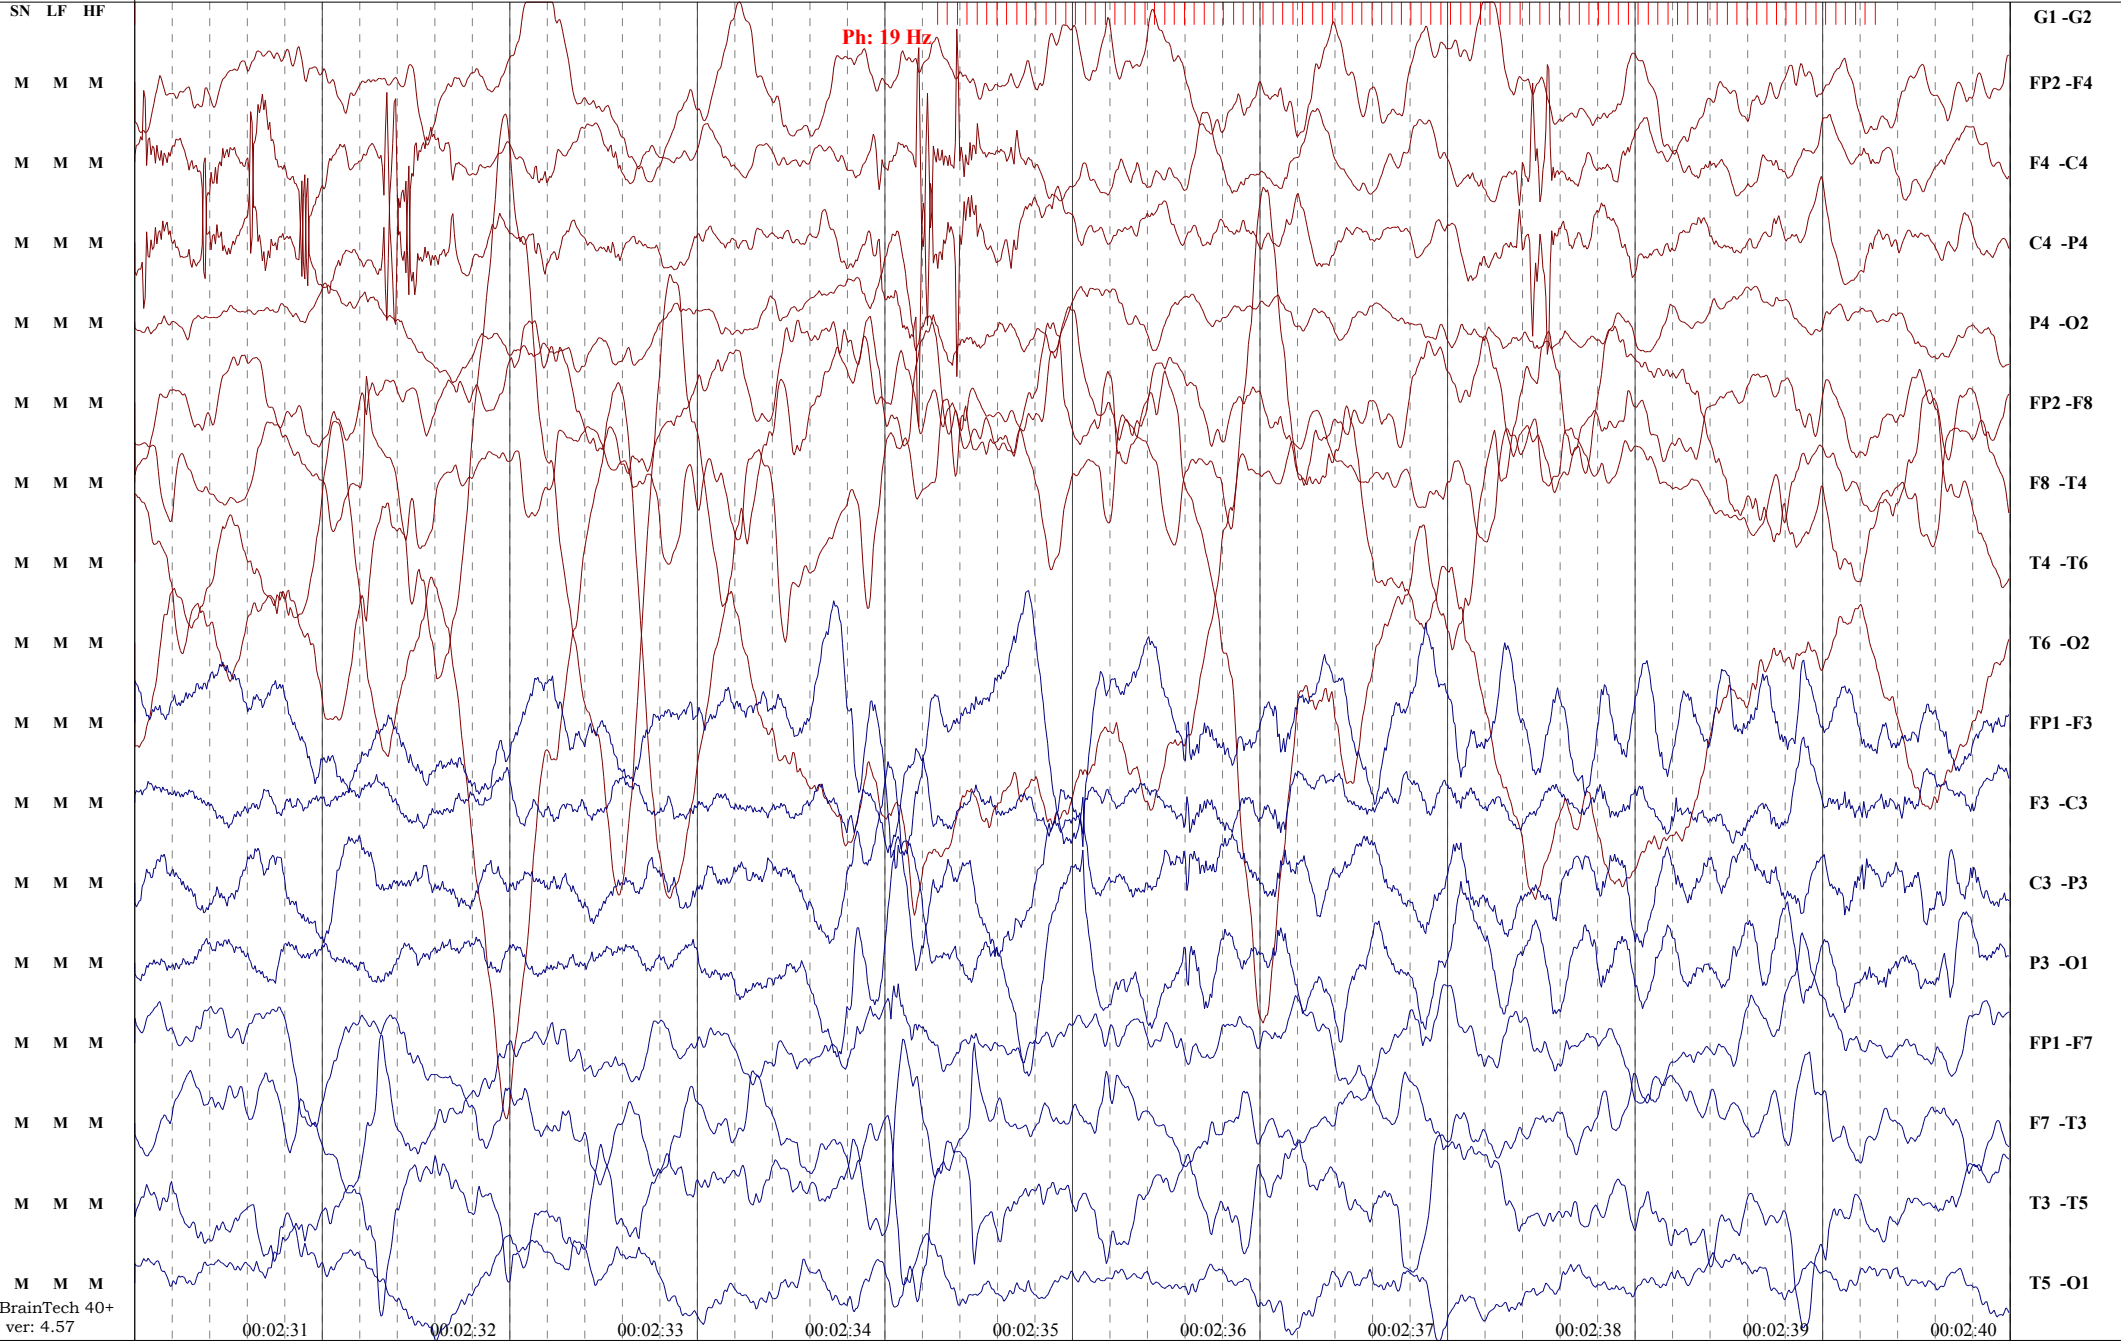


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:47:06
Page:17/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

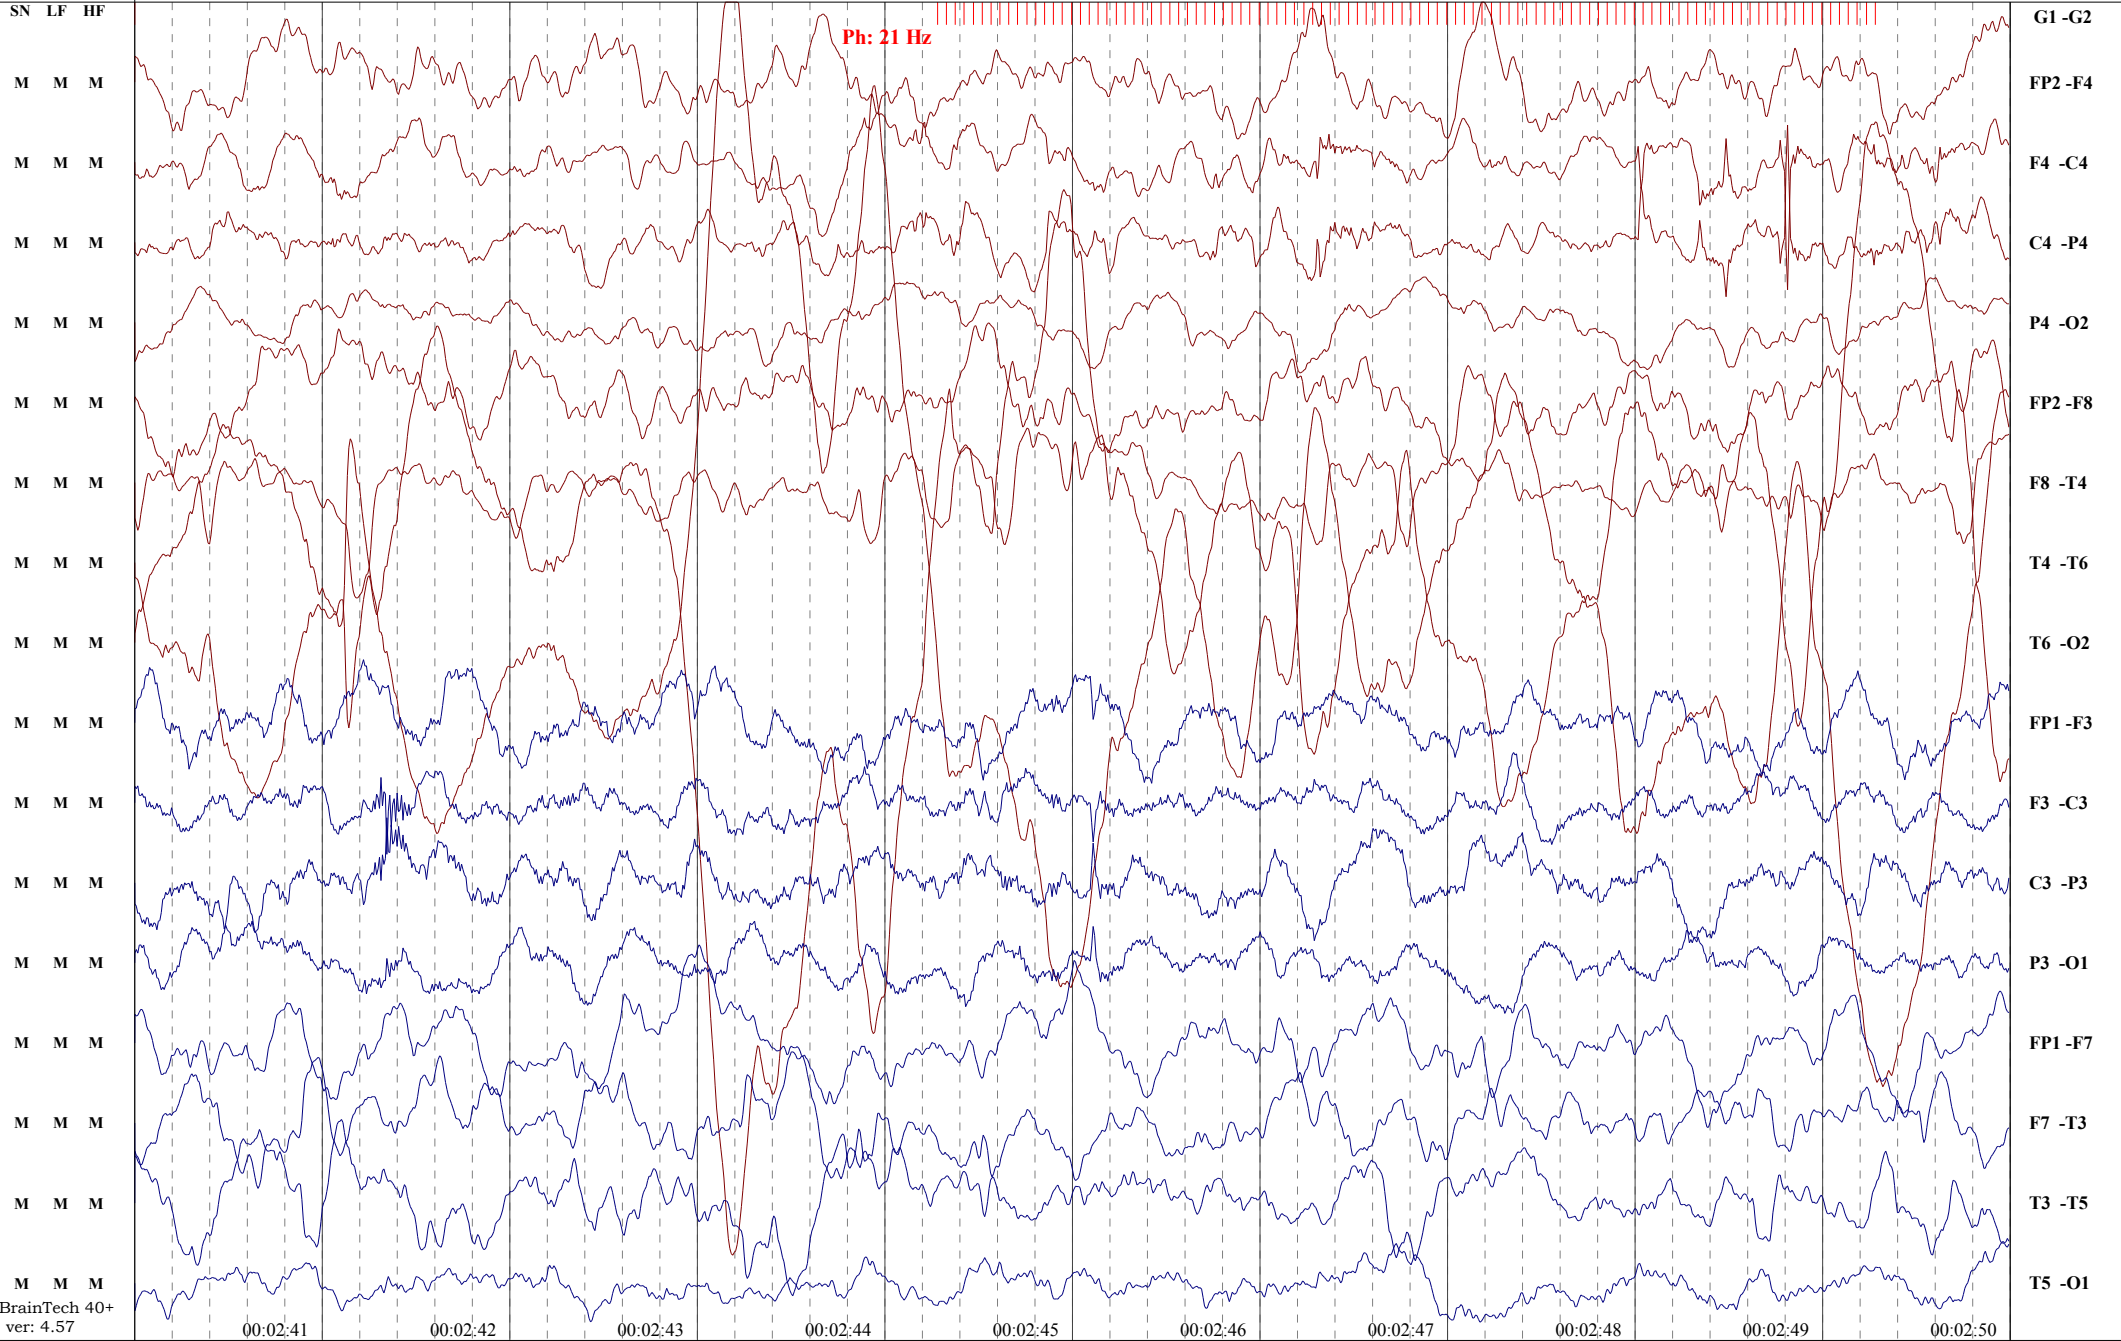

Clarity

PRATHAM HOSPITAL

105
MRS. KAMLA BAI DEWANGAN
74 Years/F


Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:47:16
Page:18/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

Photic OFF

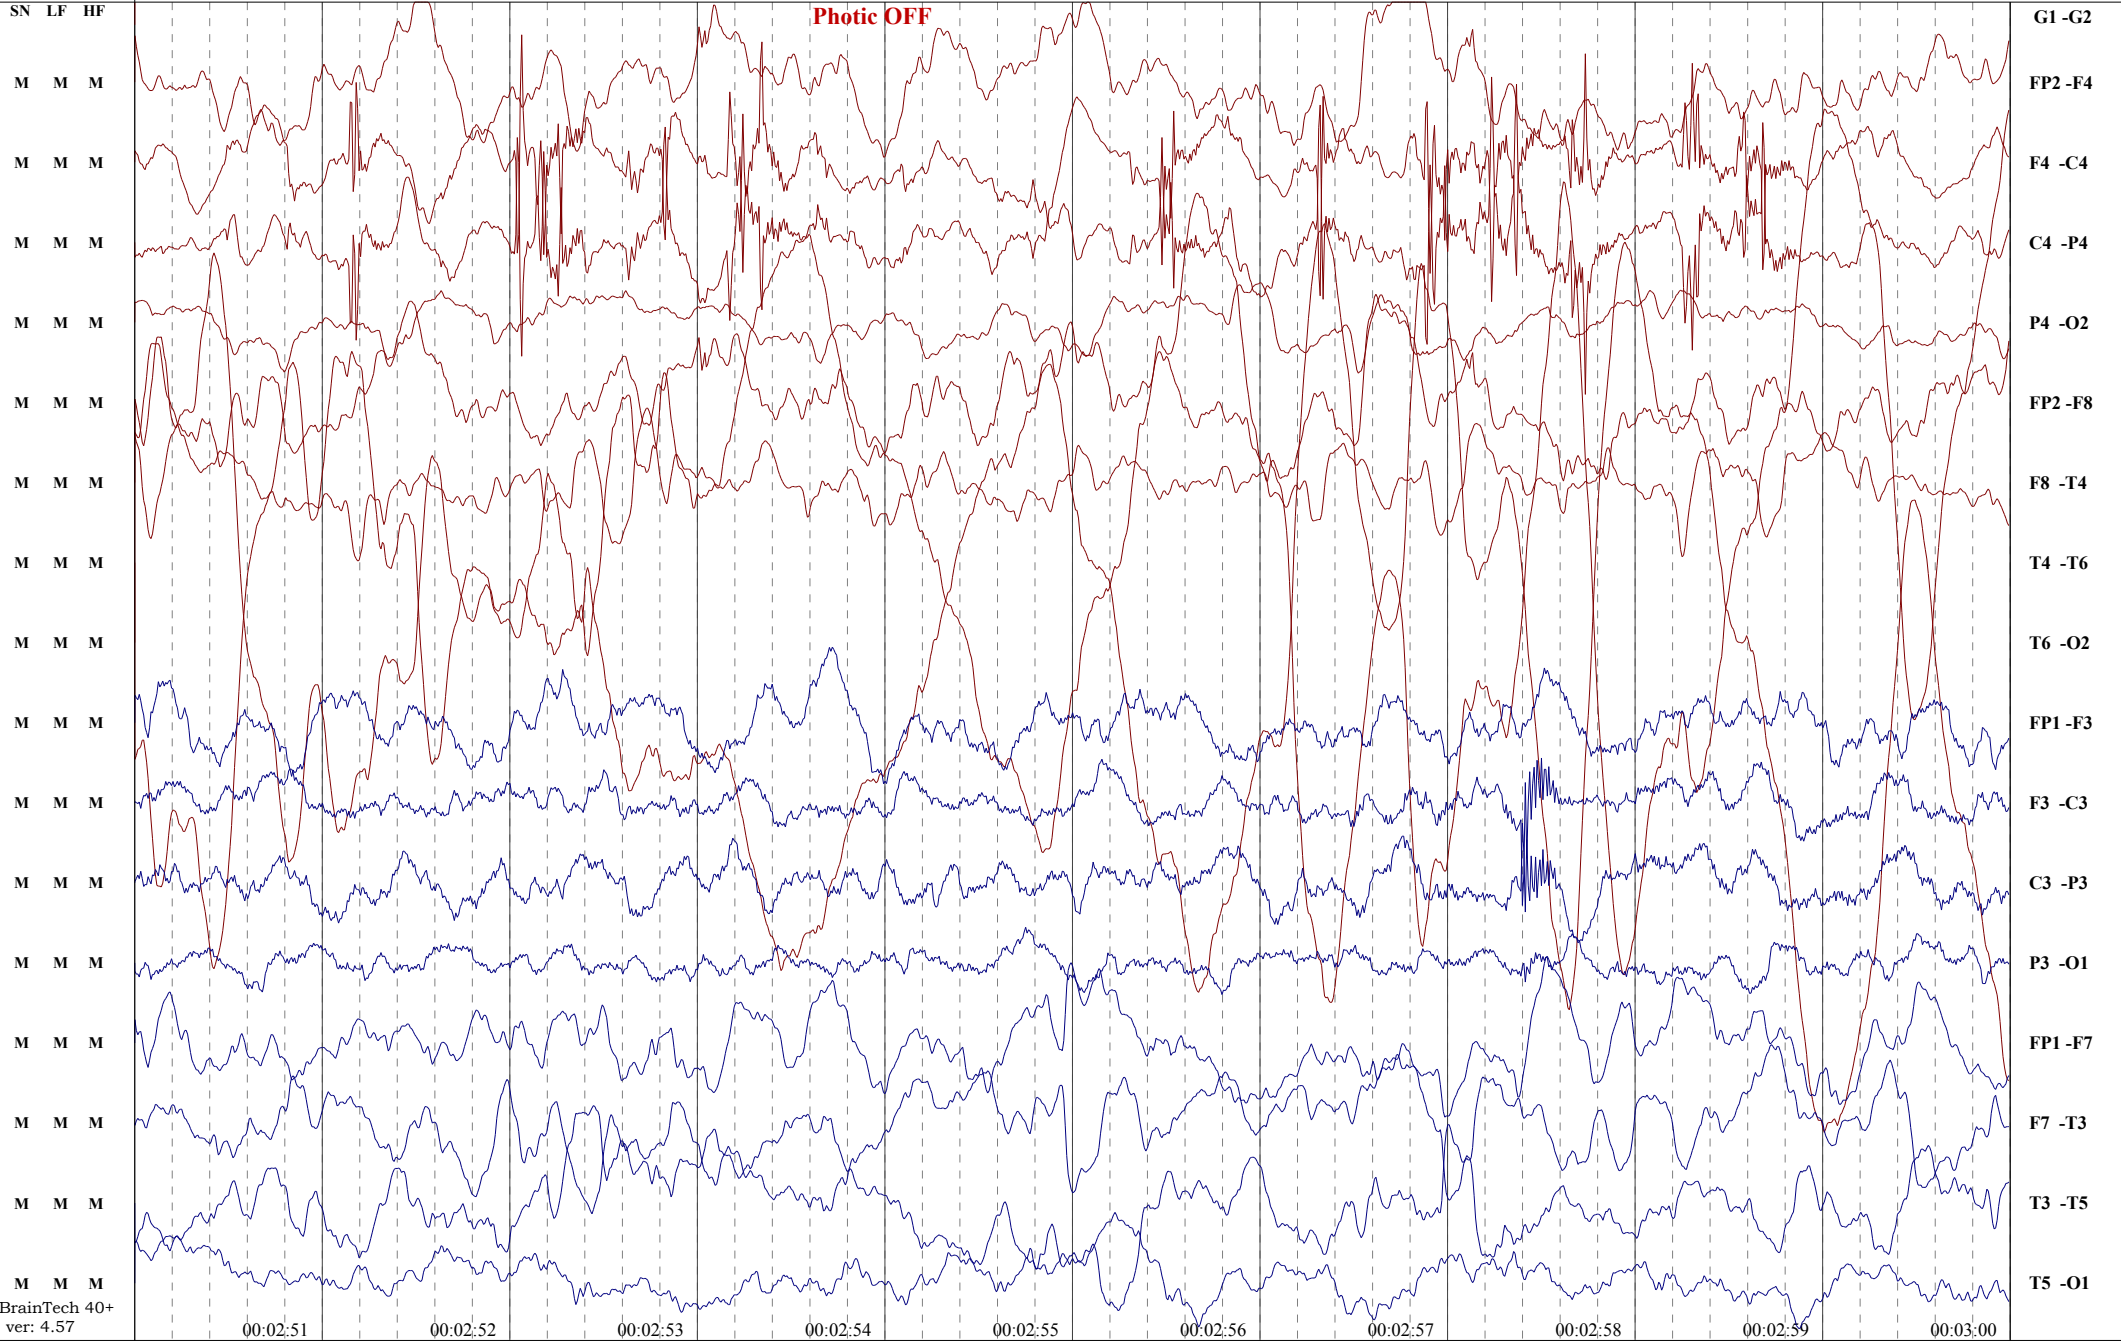


105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:47:26
Page:19/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

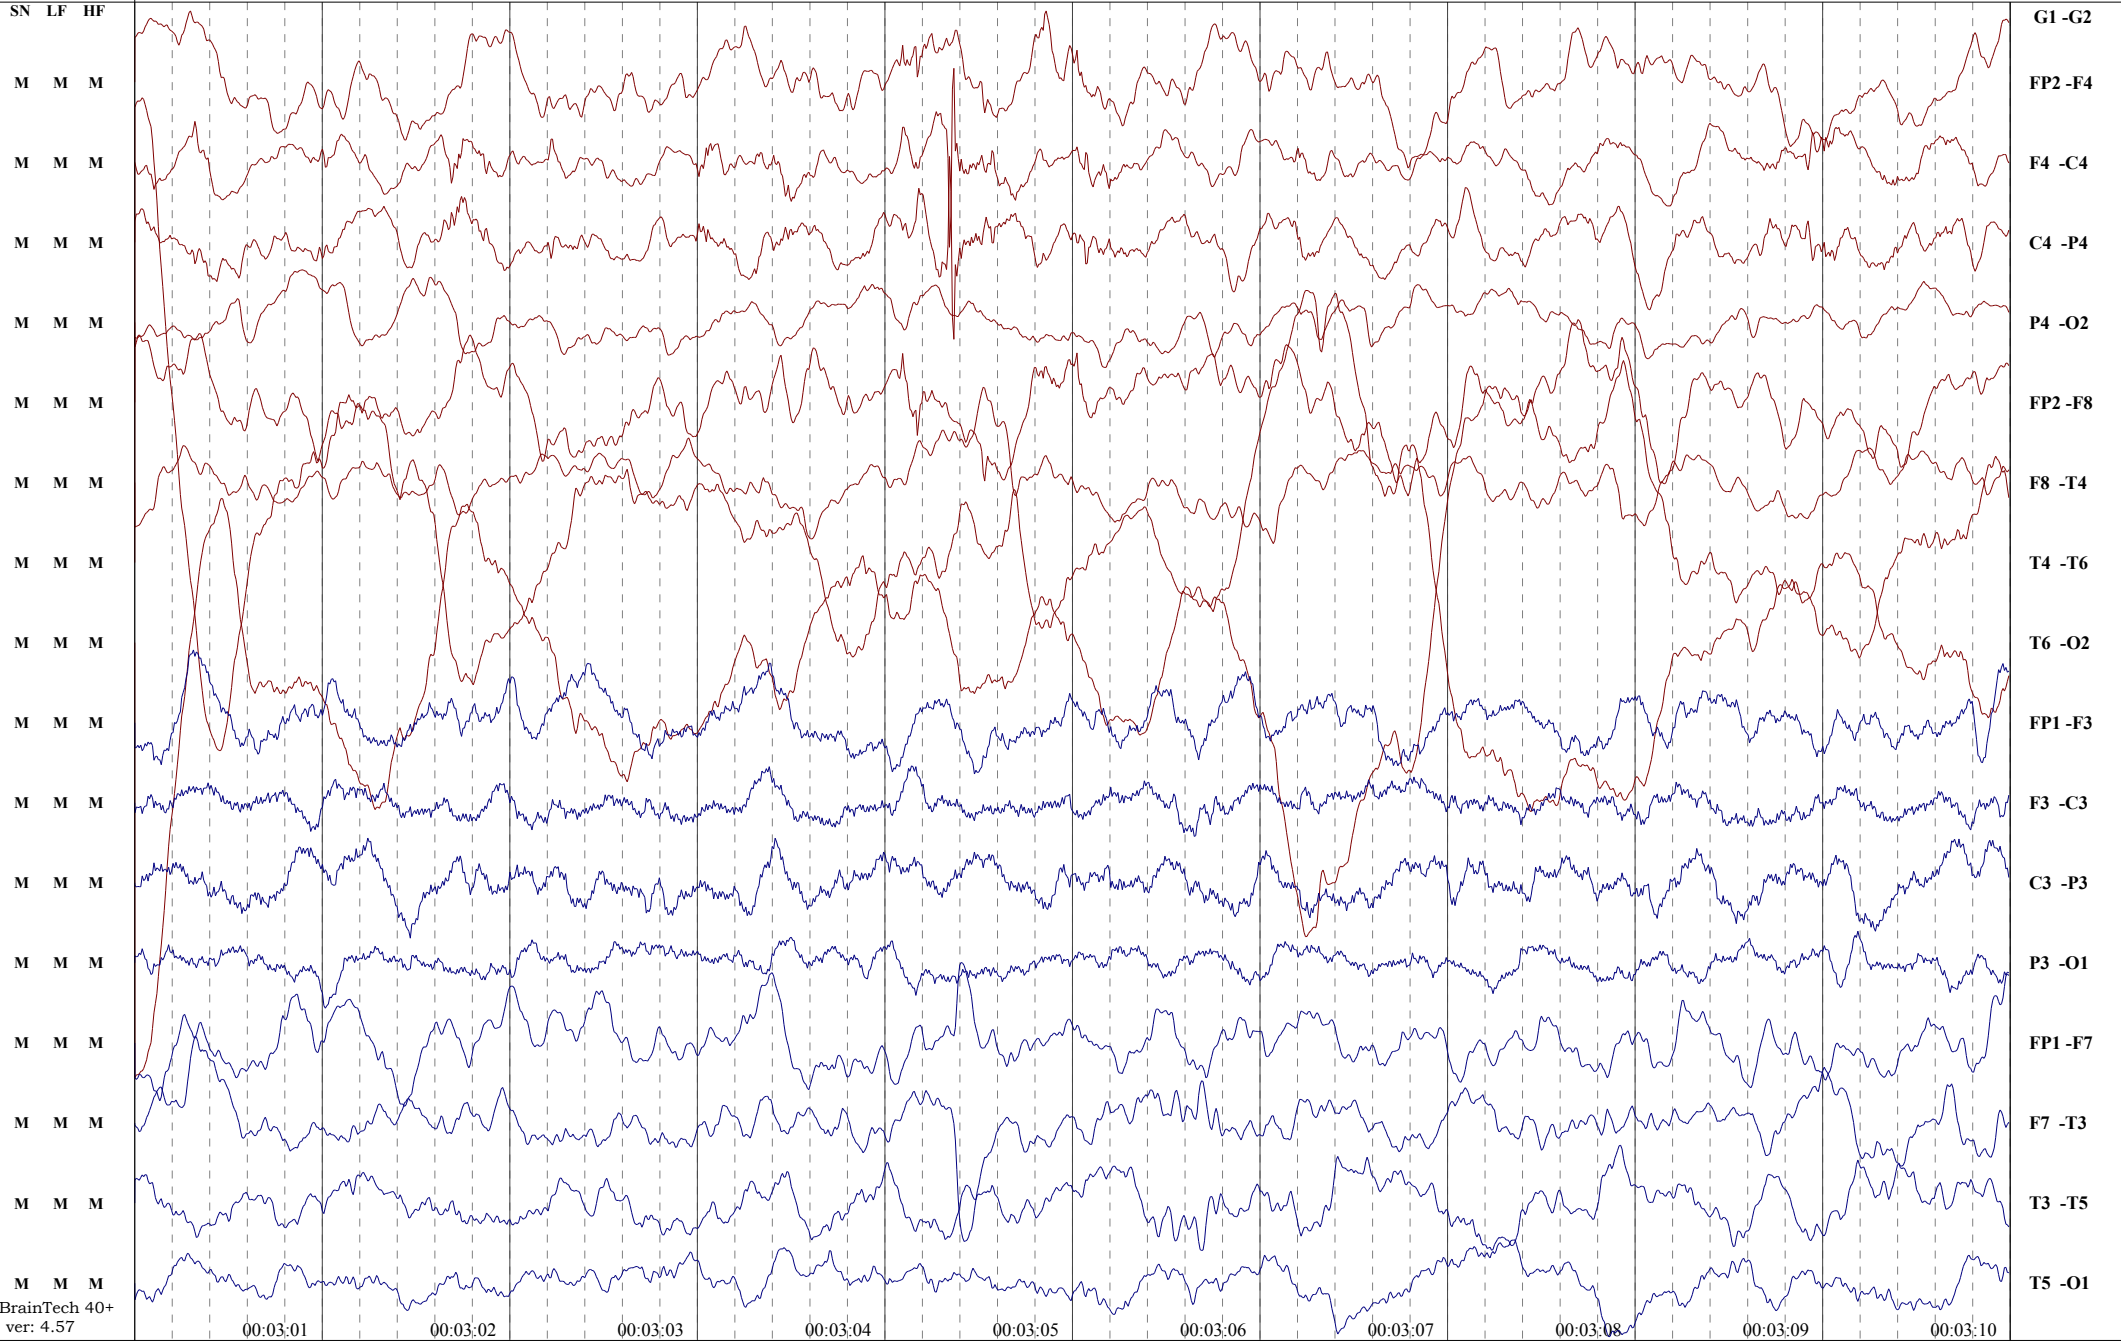

Clarity

PRATHAM HOSPITAL

105
MRS. KAMLA BAI DEWANGAN
74 Years/F

Date: 02-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:47:30
Page:20/20
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

