


35
MR. CHATLAL RATHORE
52 Years/M


Date: 31-Jul-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 15:55:43
Page:3/38
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

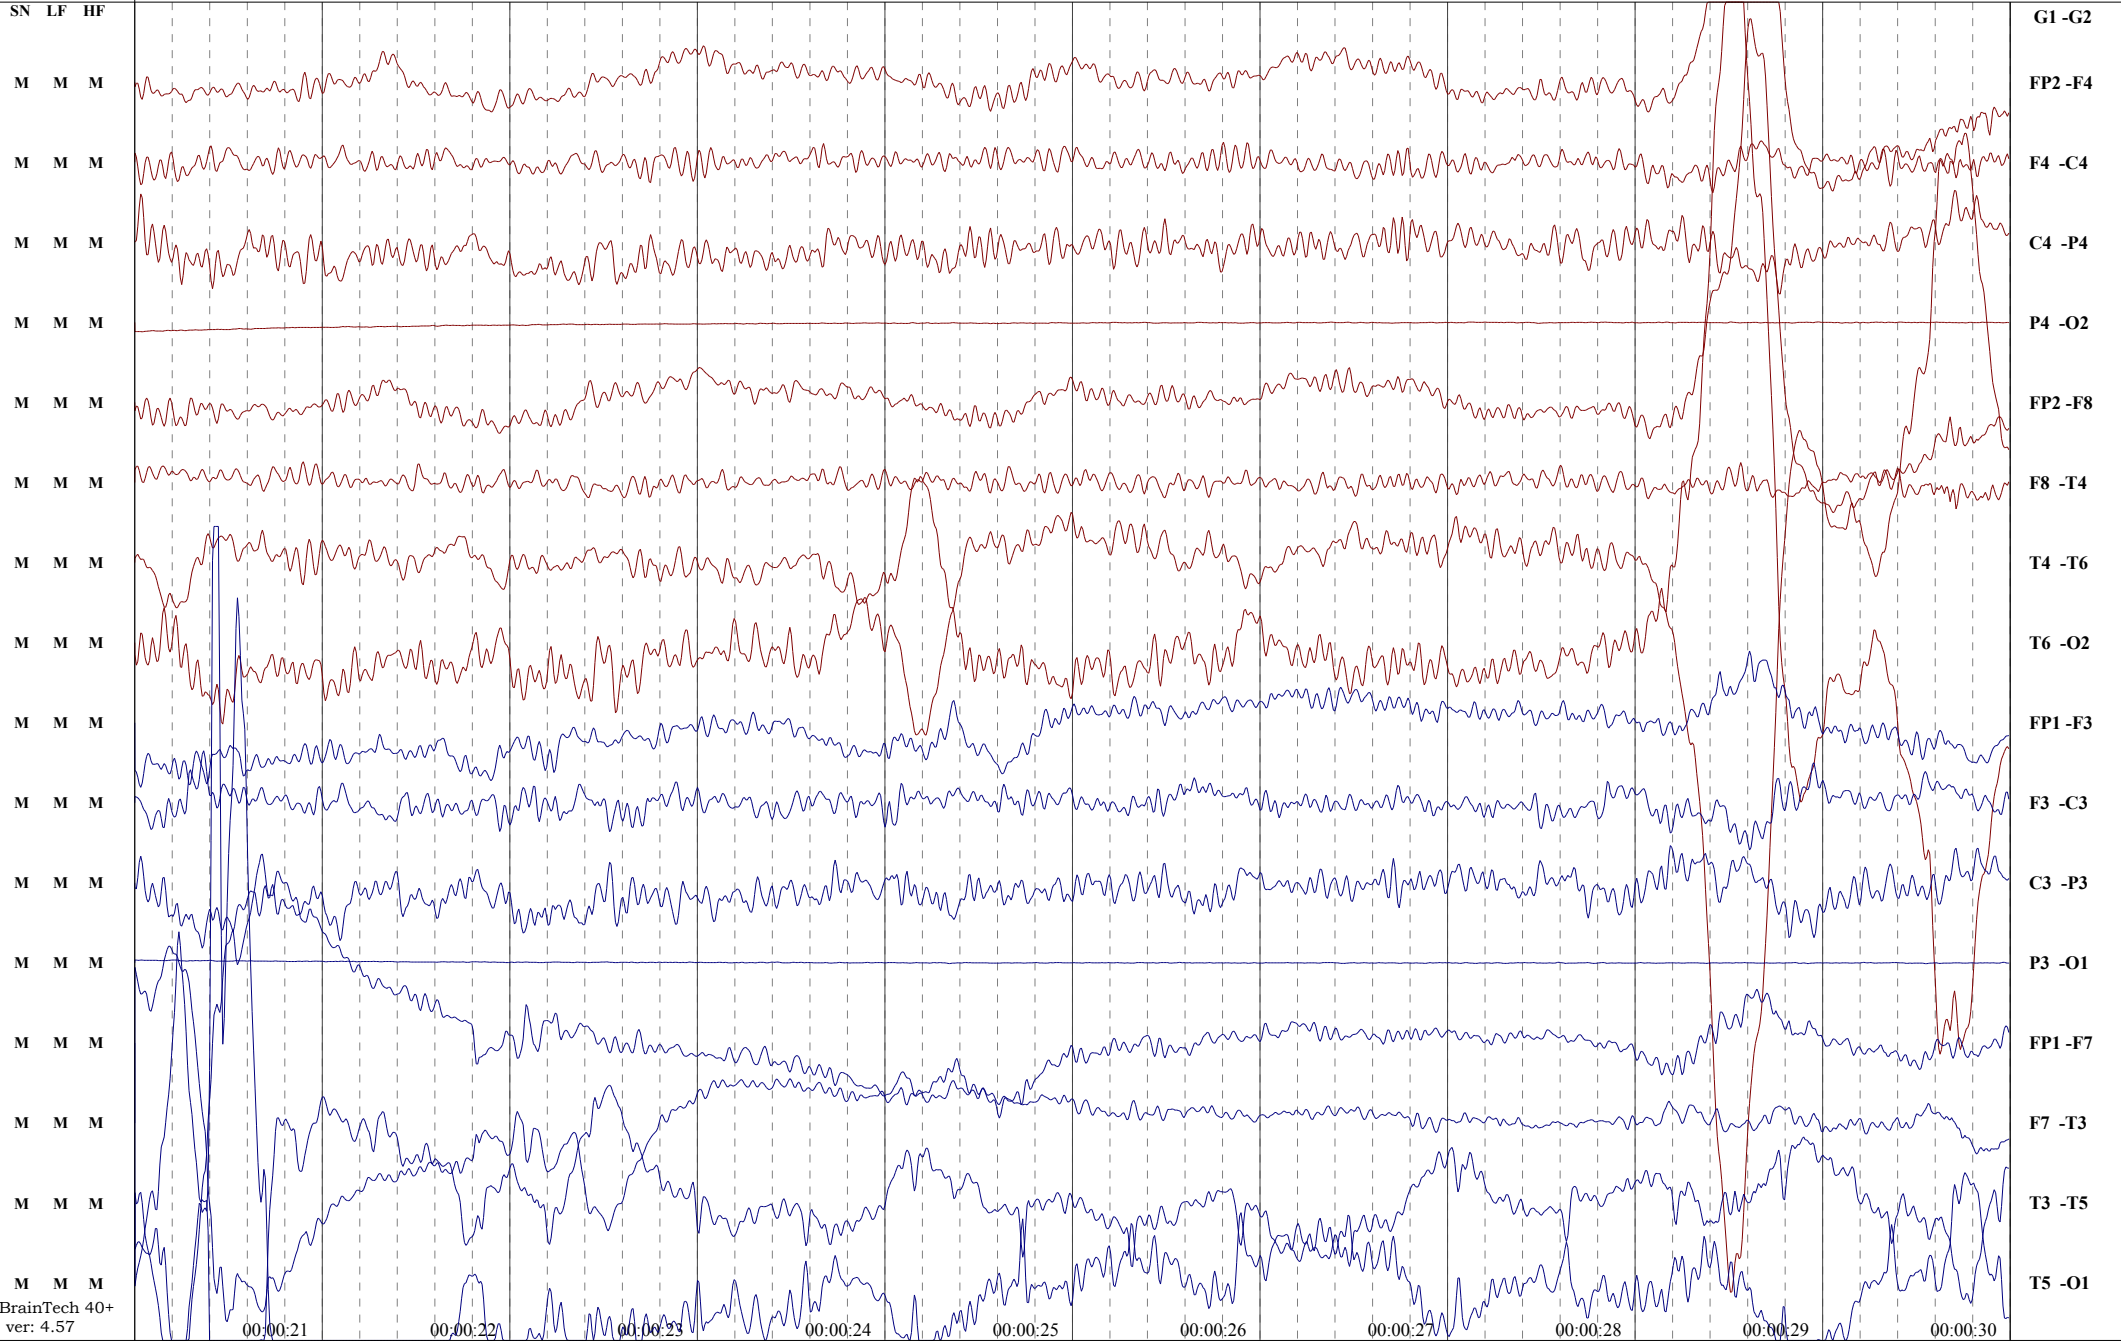

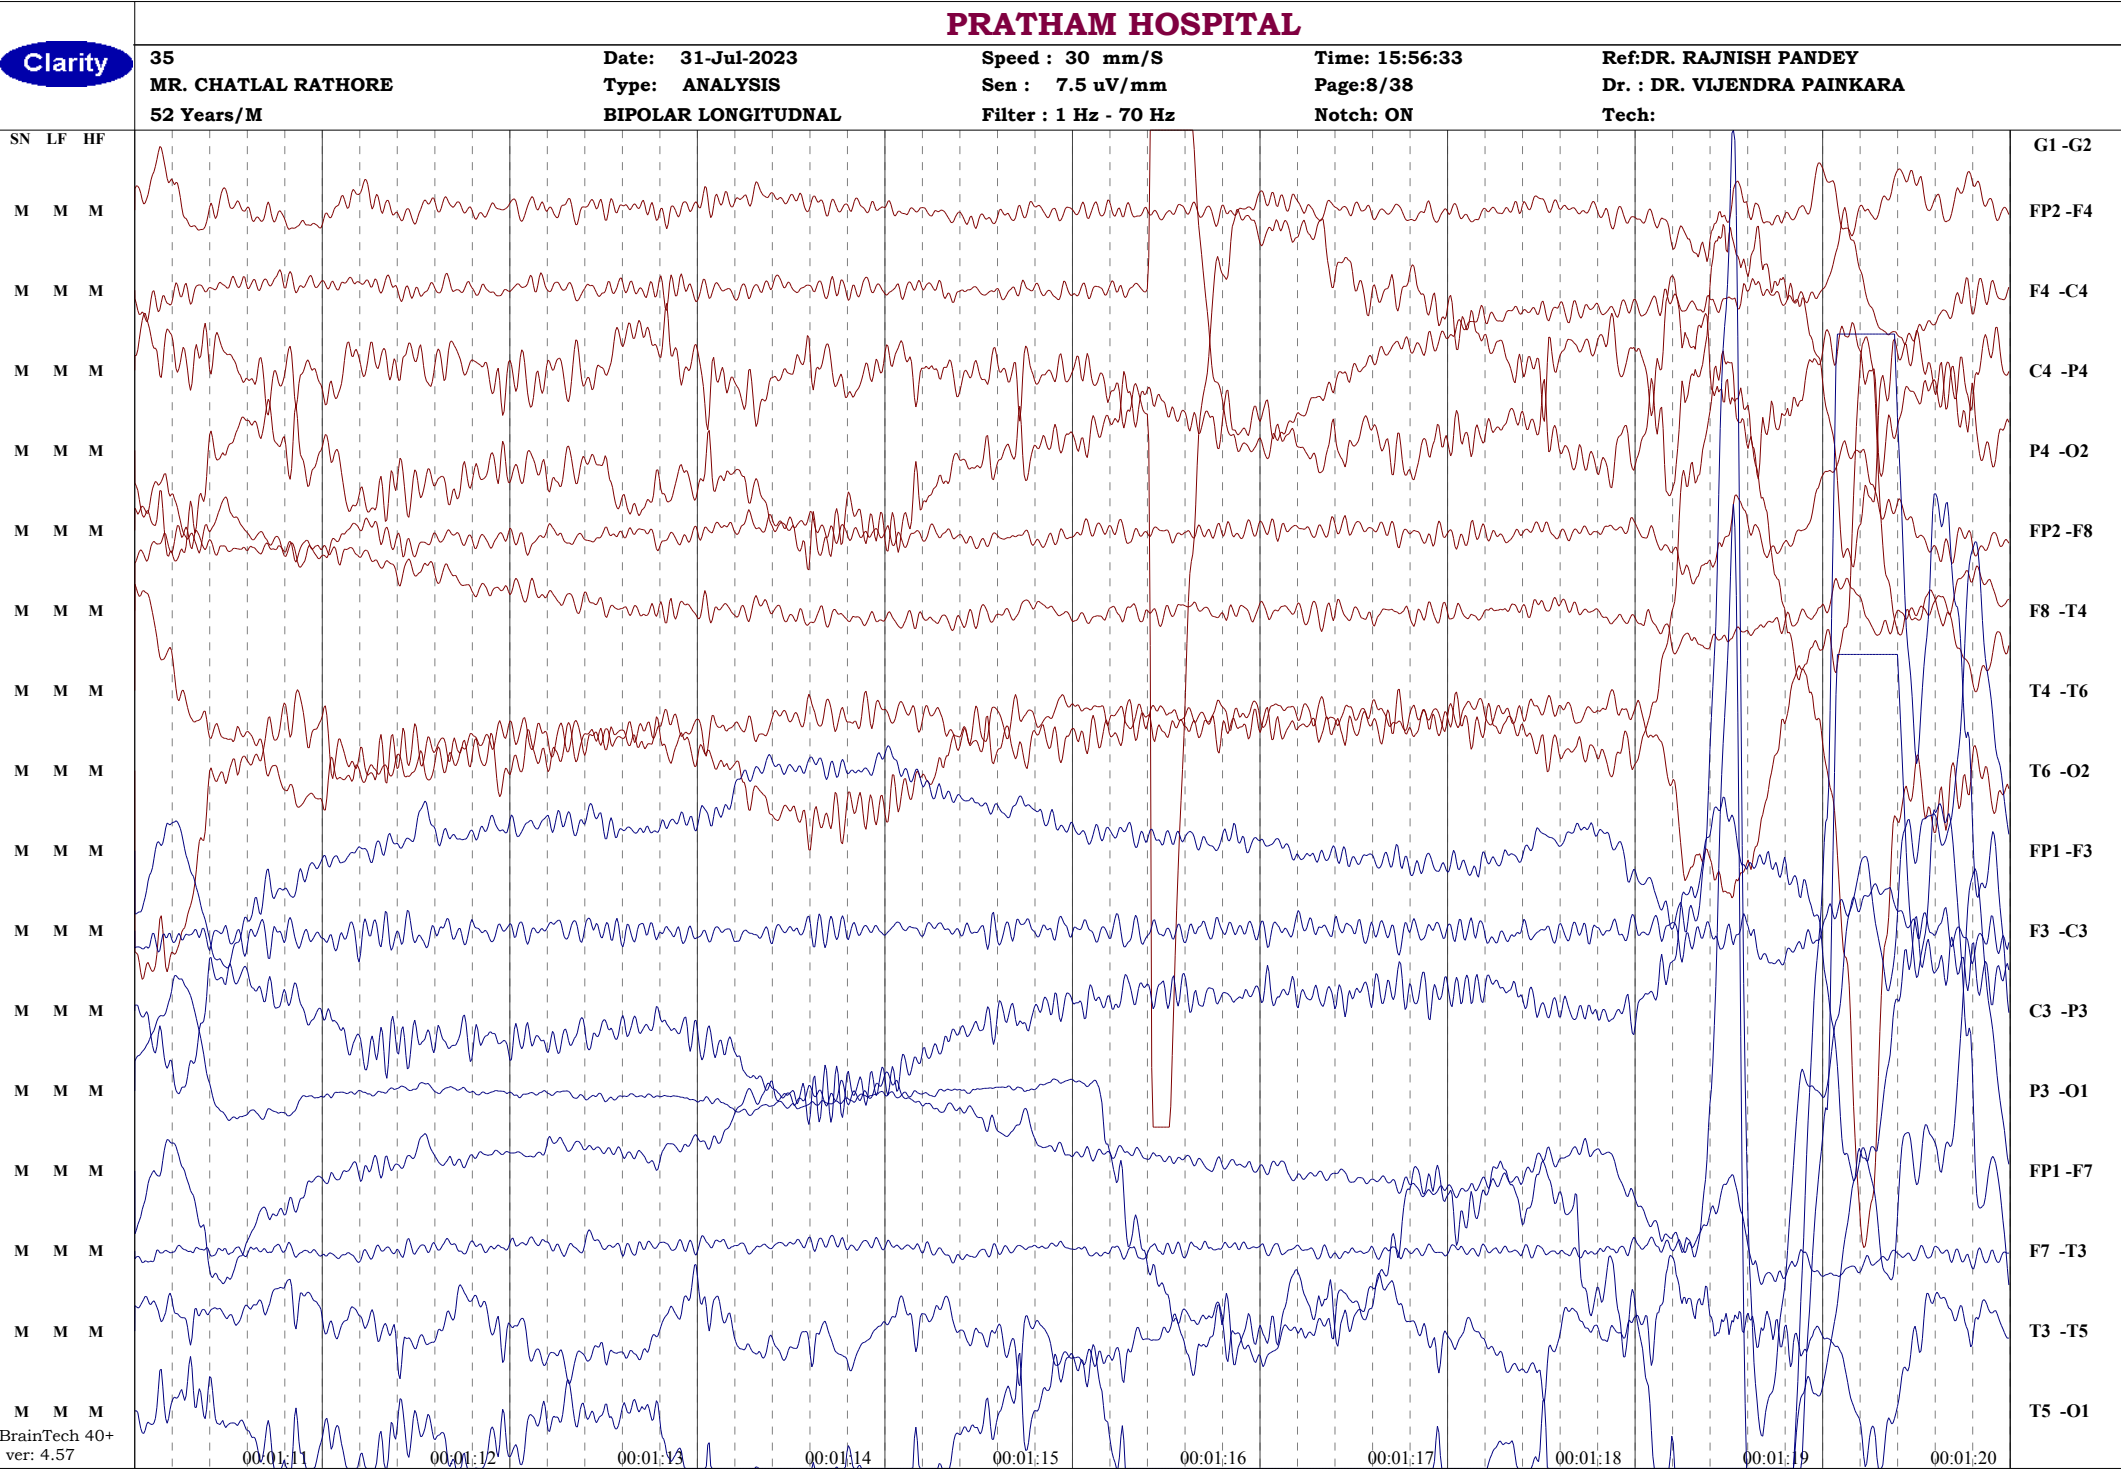


35
MR. CHATLAL RATHORE
52 Years/M

Date: 31-Jul-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 15:56:53
Page:10/38
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

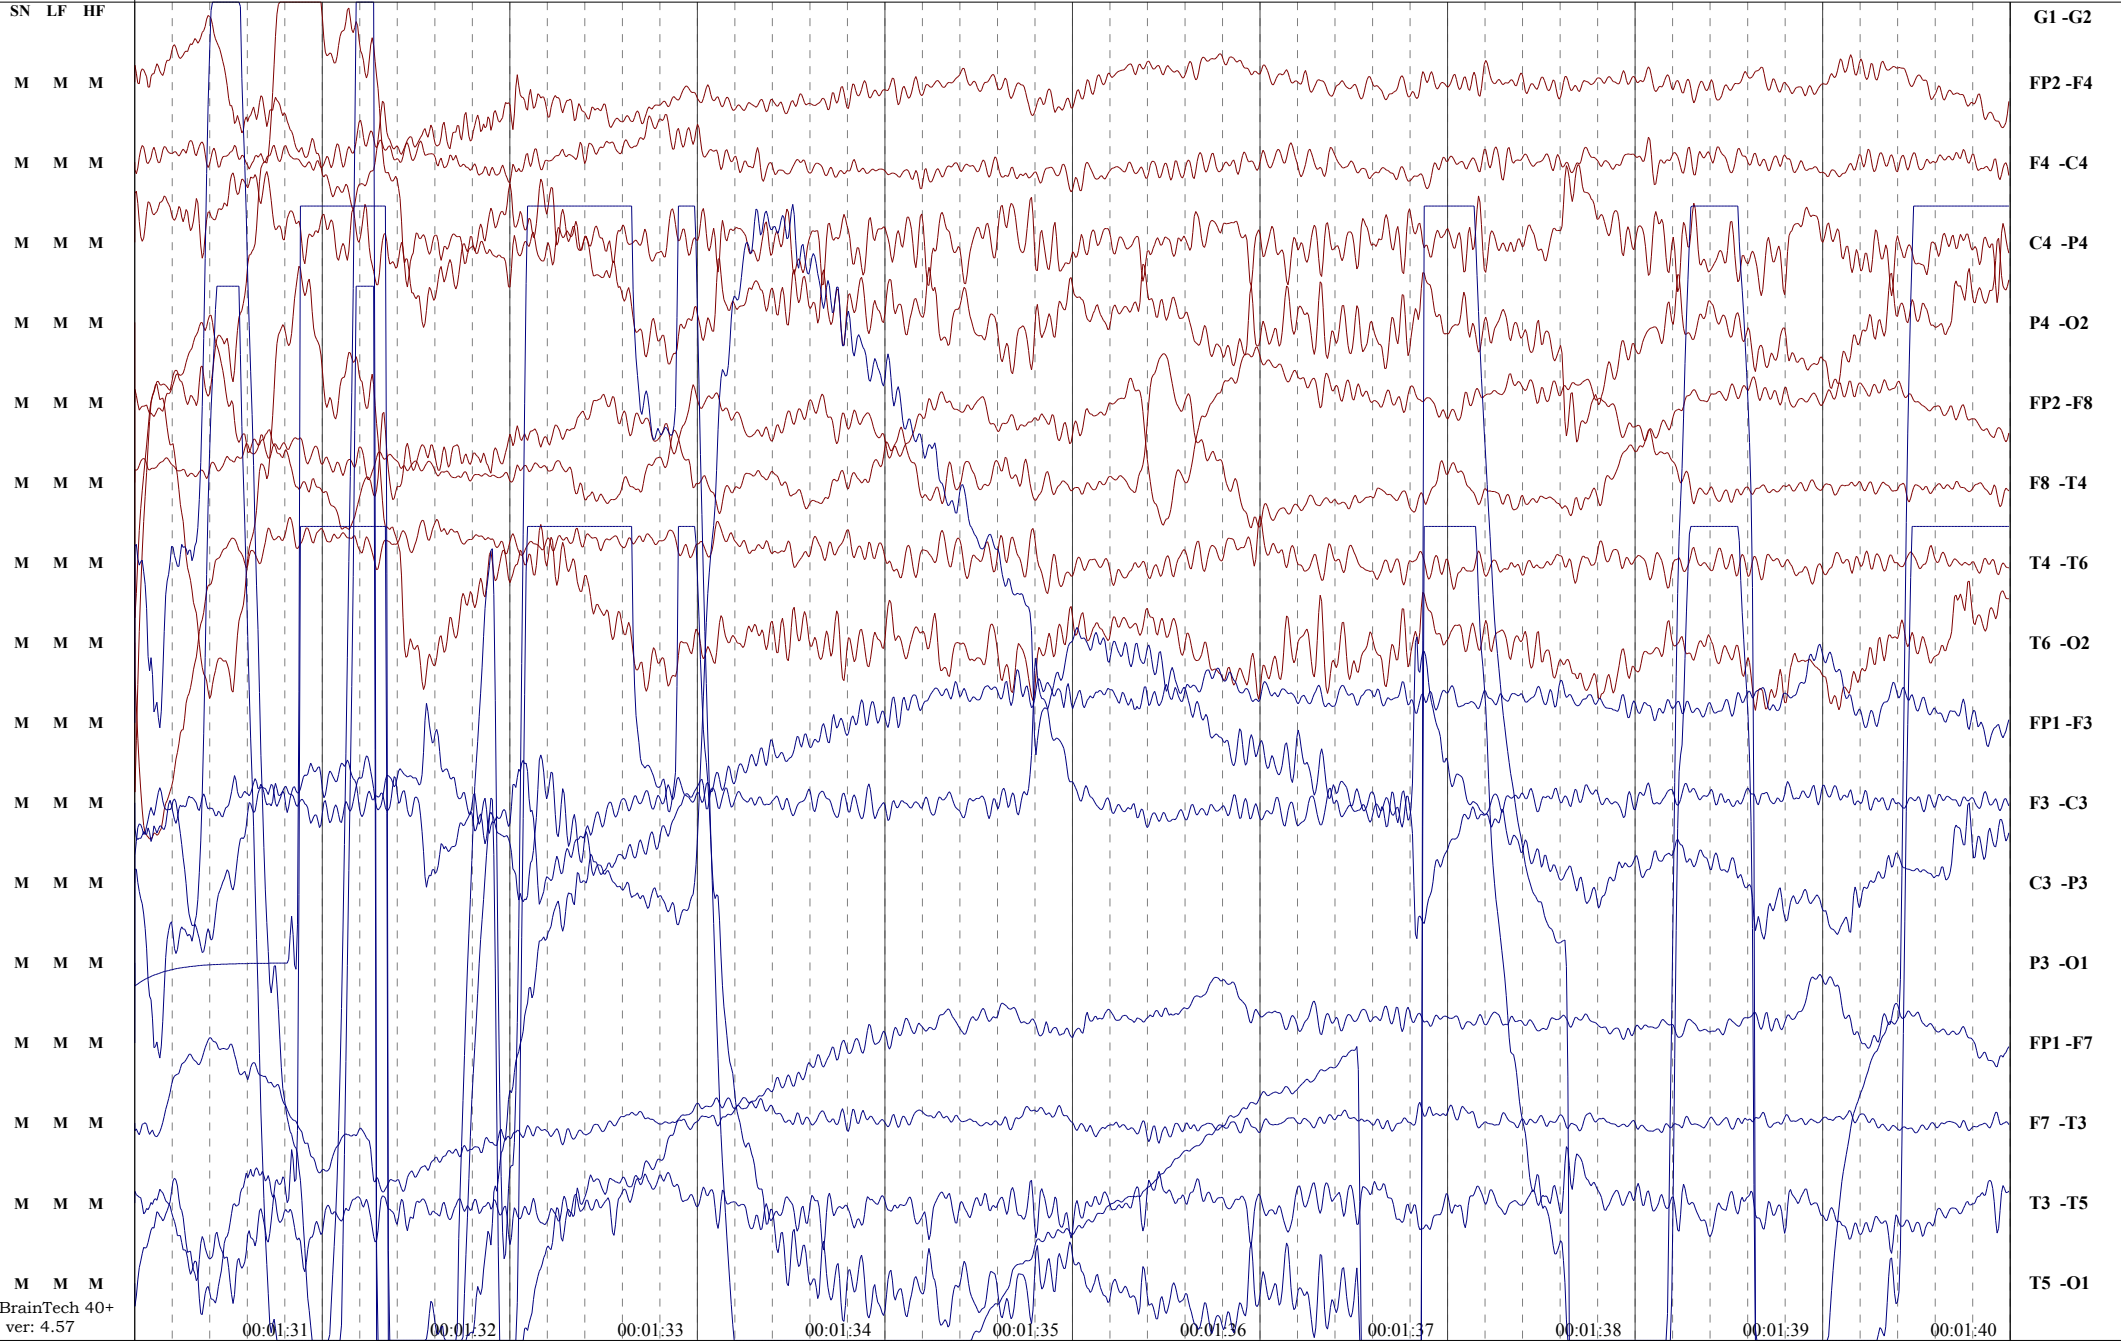

<div>Clarity</div>			<div>PRATHAM HOSPITAL</div>																	
35			Date: 31-Jul-2023					Speed : 30 mm/S					Time: 15:57:23			Ref:DR. RAJNISH PANDEY				
MR. CHATLAL RATHORE			Type: ANALYSIS					Sen : 7.5 uV/mm					Page:13/38			Dr. : DR. VIJENDRA PAINKARA				
52 Years/M			BIPOLAR LONGITUDNAL					Filter : 1 Hz - 70 Hz					Notch: ON			Tech:				
SN	LF	HF																		G1 -G2
M	M	M																		FP2 -F4
M	M	M																		F4 -C4
M	M	M																		C4 -P4
M	M	M																		P4 -O2
M	M	M																		FP2 -F8
M	M	M																		F8 -T4
M	M	M																		T4 -T6
M	M	M																		T6 -O2
M	M	M																		FP1 -F3
M	M	M																		F3 -C3
M	M	M																		C3 -P3
M	M	M																		P3 -O1
M	M	M																		FP1 -F7
M	M	M																		F7 -T3
M	M	M																		T3 -T5
M	M	M																		T5 -O1
BrainTech 40+ ver: 4.57																				

35
MR. CHATLAL RATHORE
52 Years/M

Date: 31-Jul-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 15:58:43
Page:21/38
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

