


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:20:59
Page:3/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

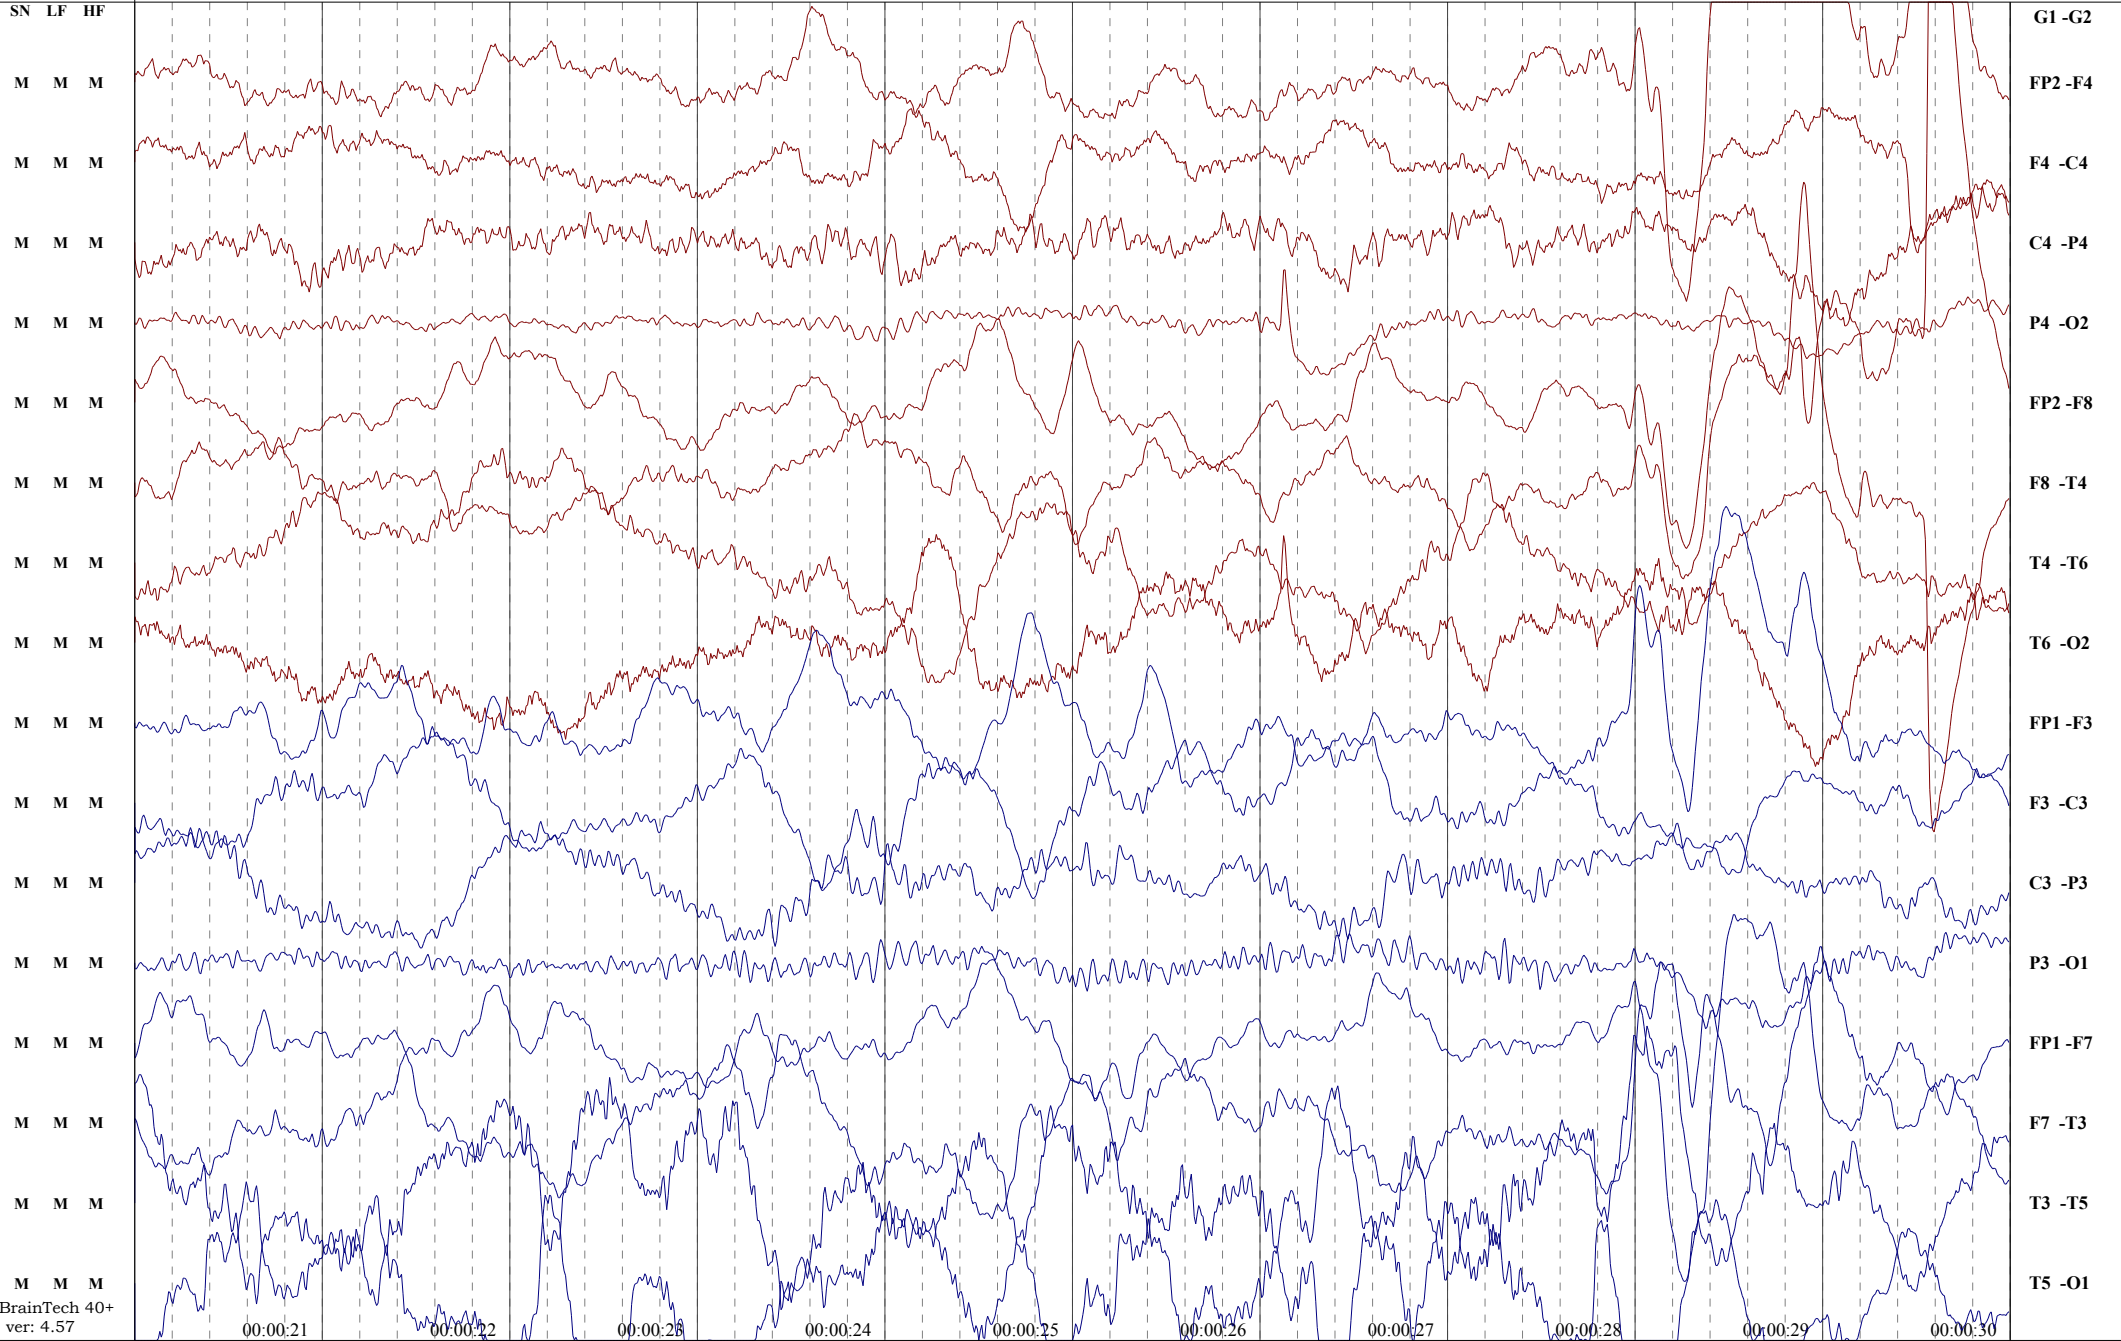


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:21:09
Page:4/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

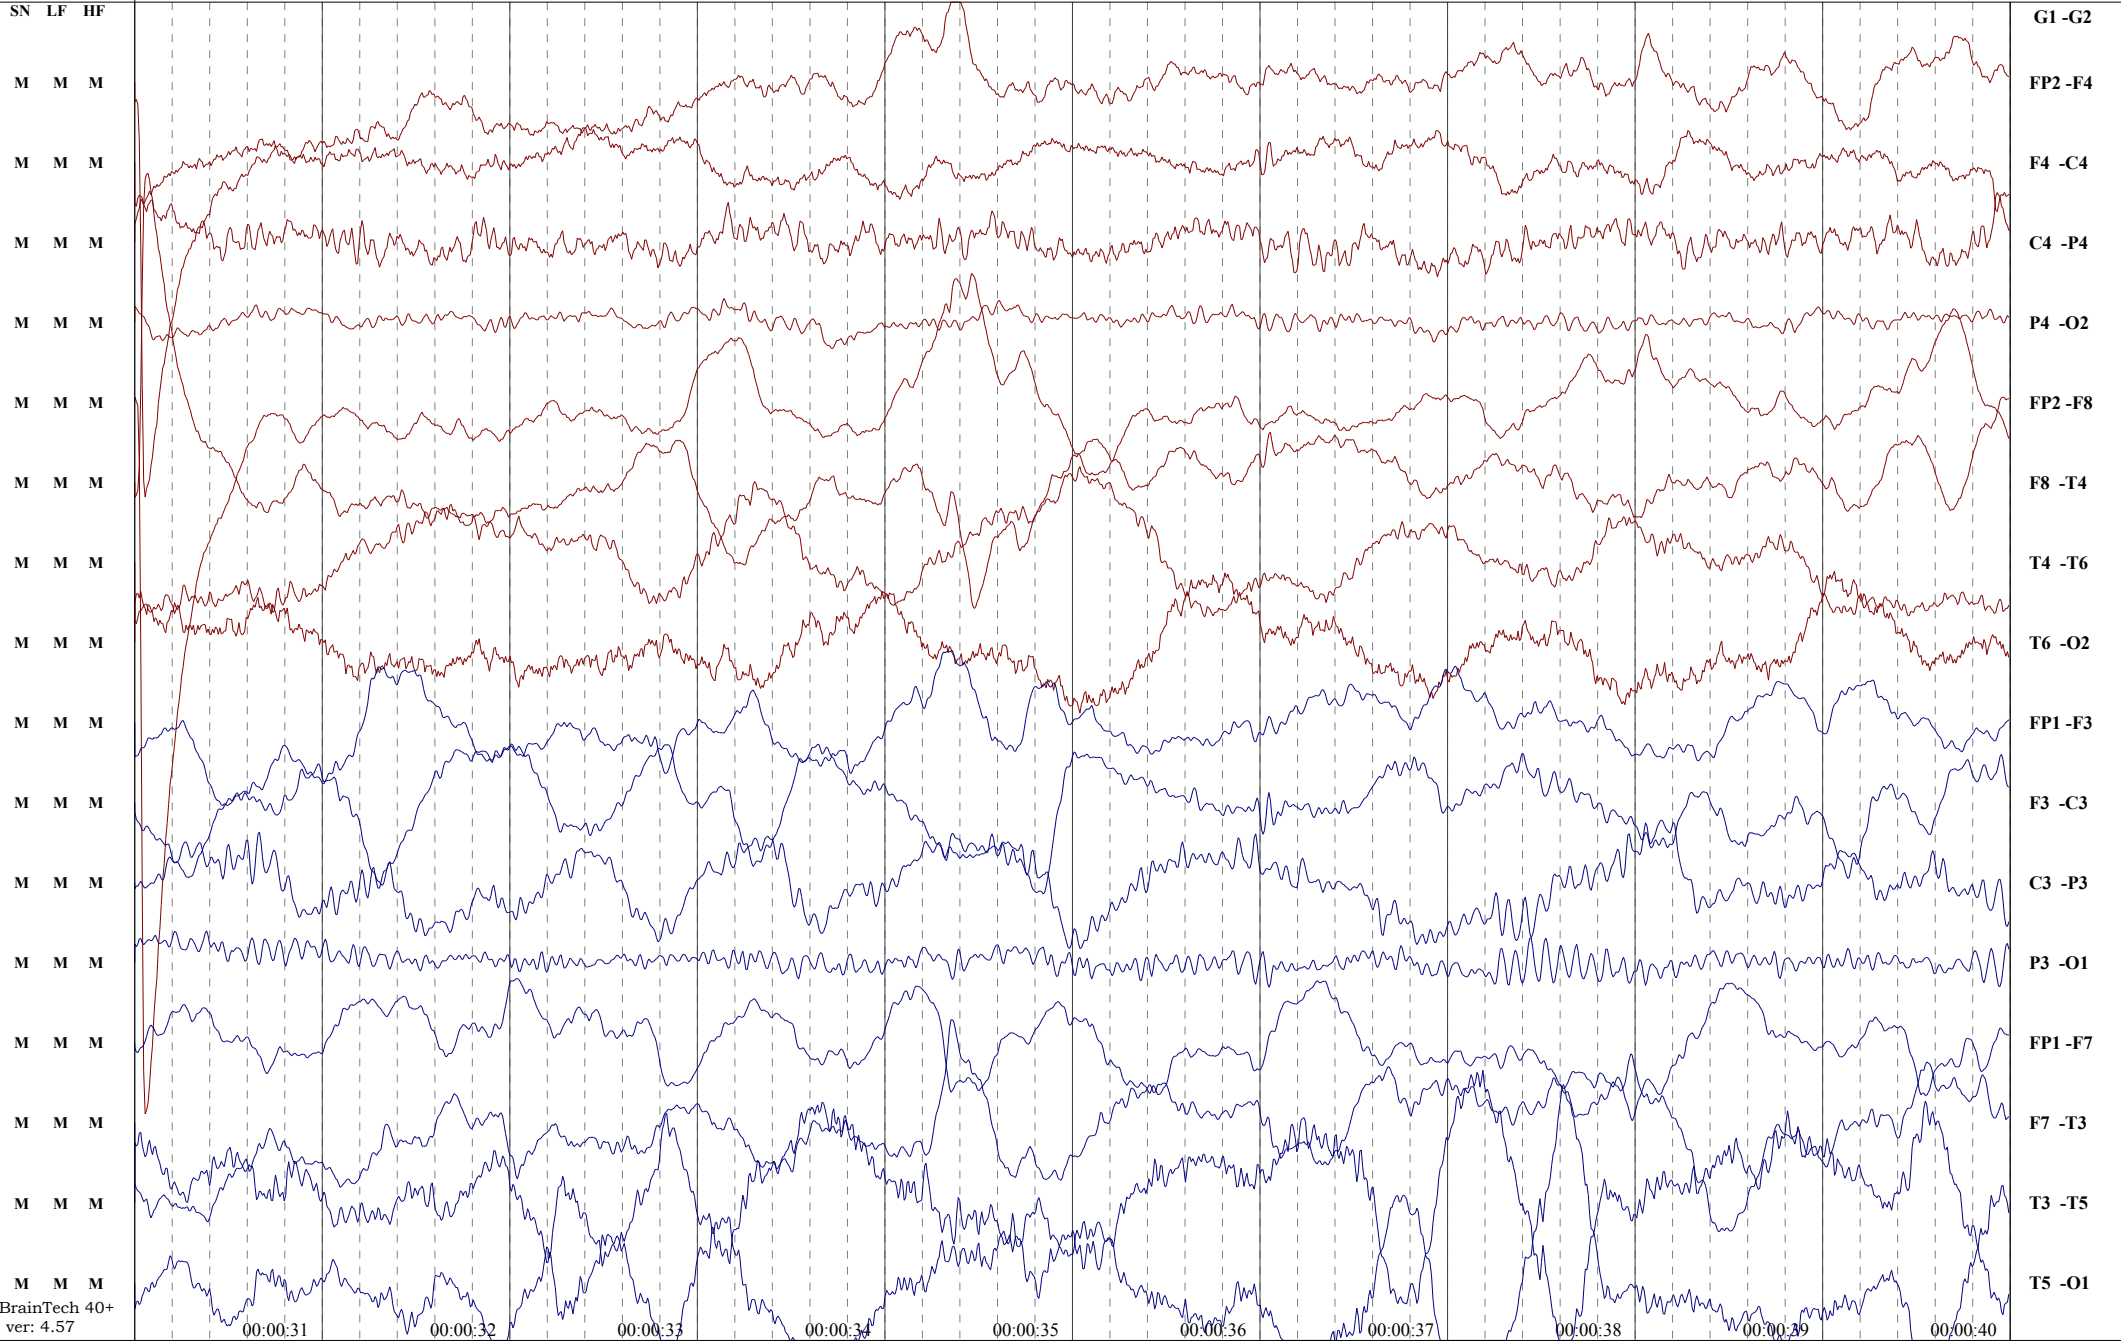


102
MRS BIRASPATI BAI NISHAD
45 Years/F


Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:21:19
Page:5/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

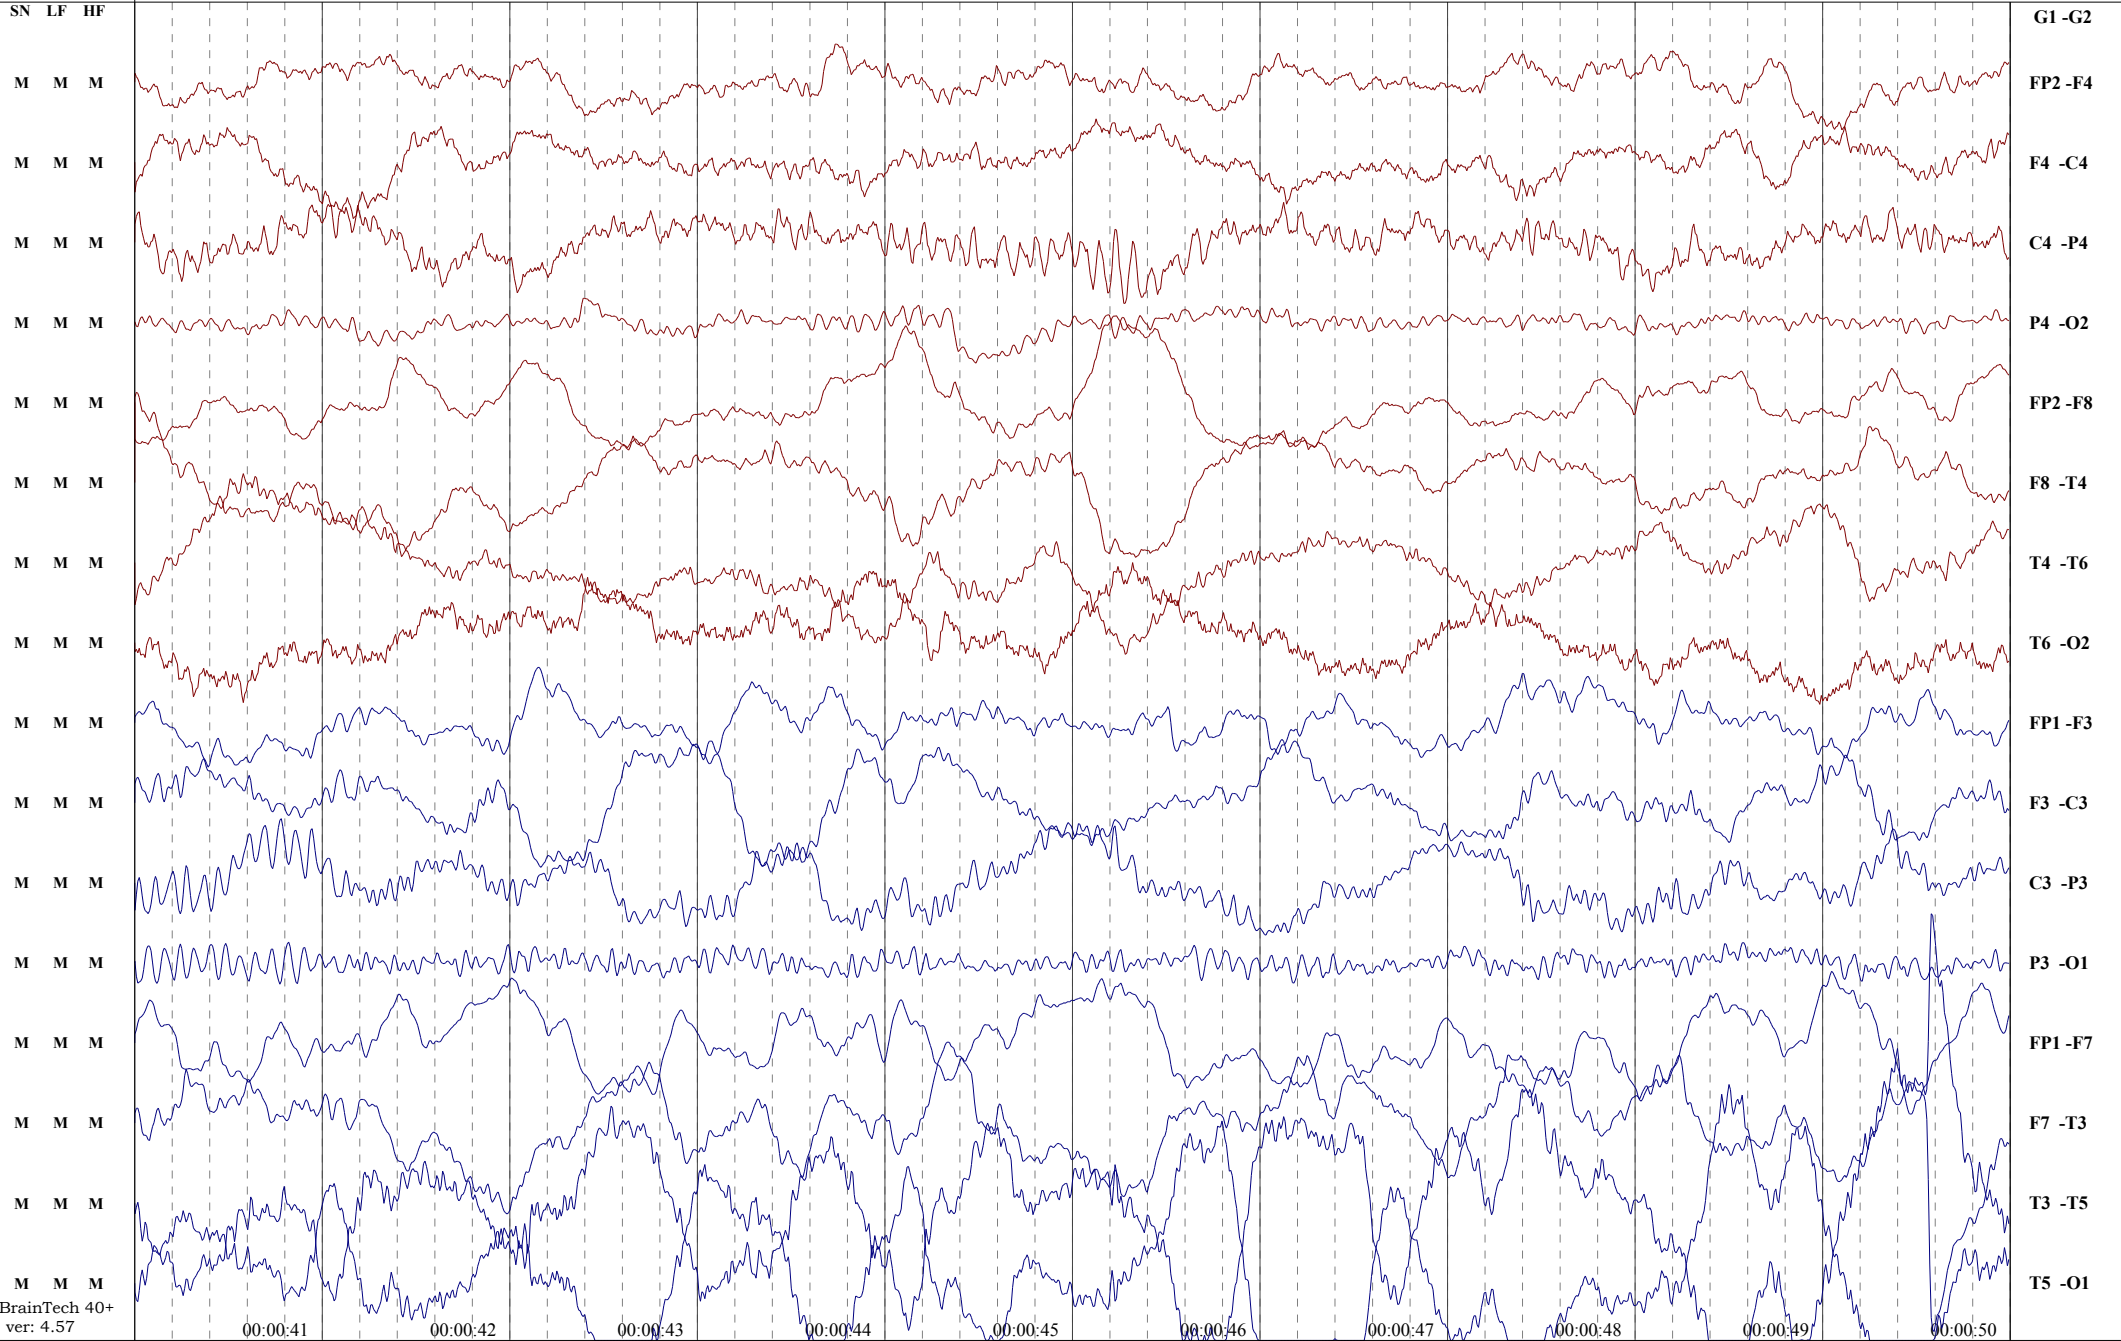

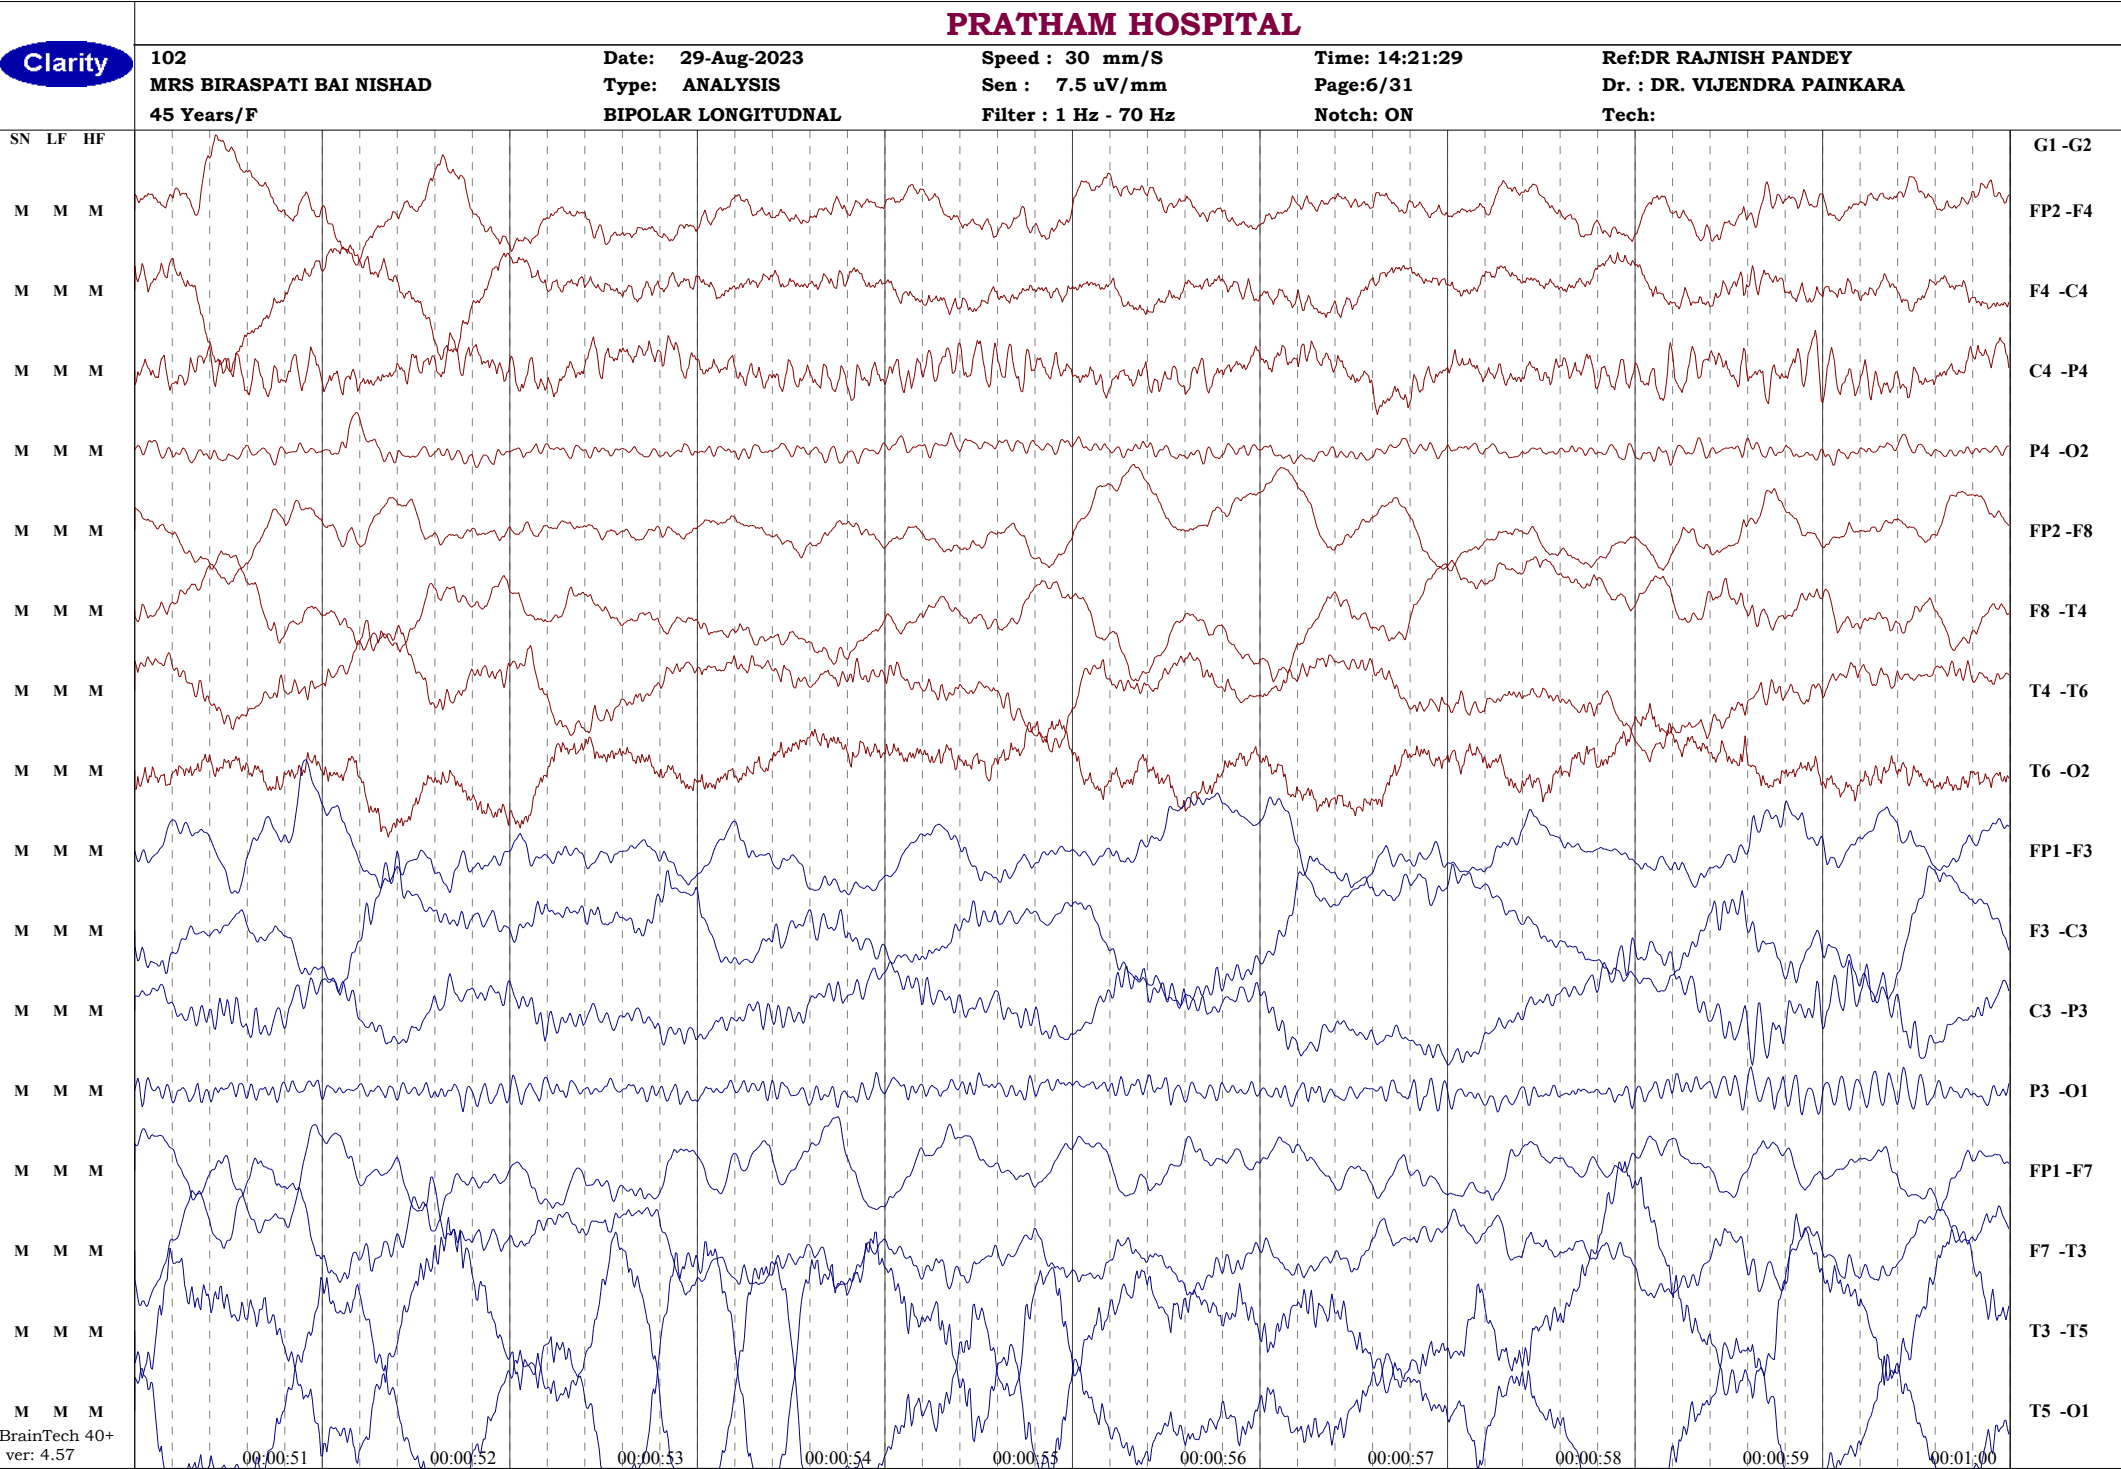

Clarity

PRATHAM HOSPITAL


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:21:39
Page:7/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

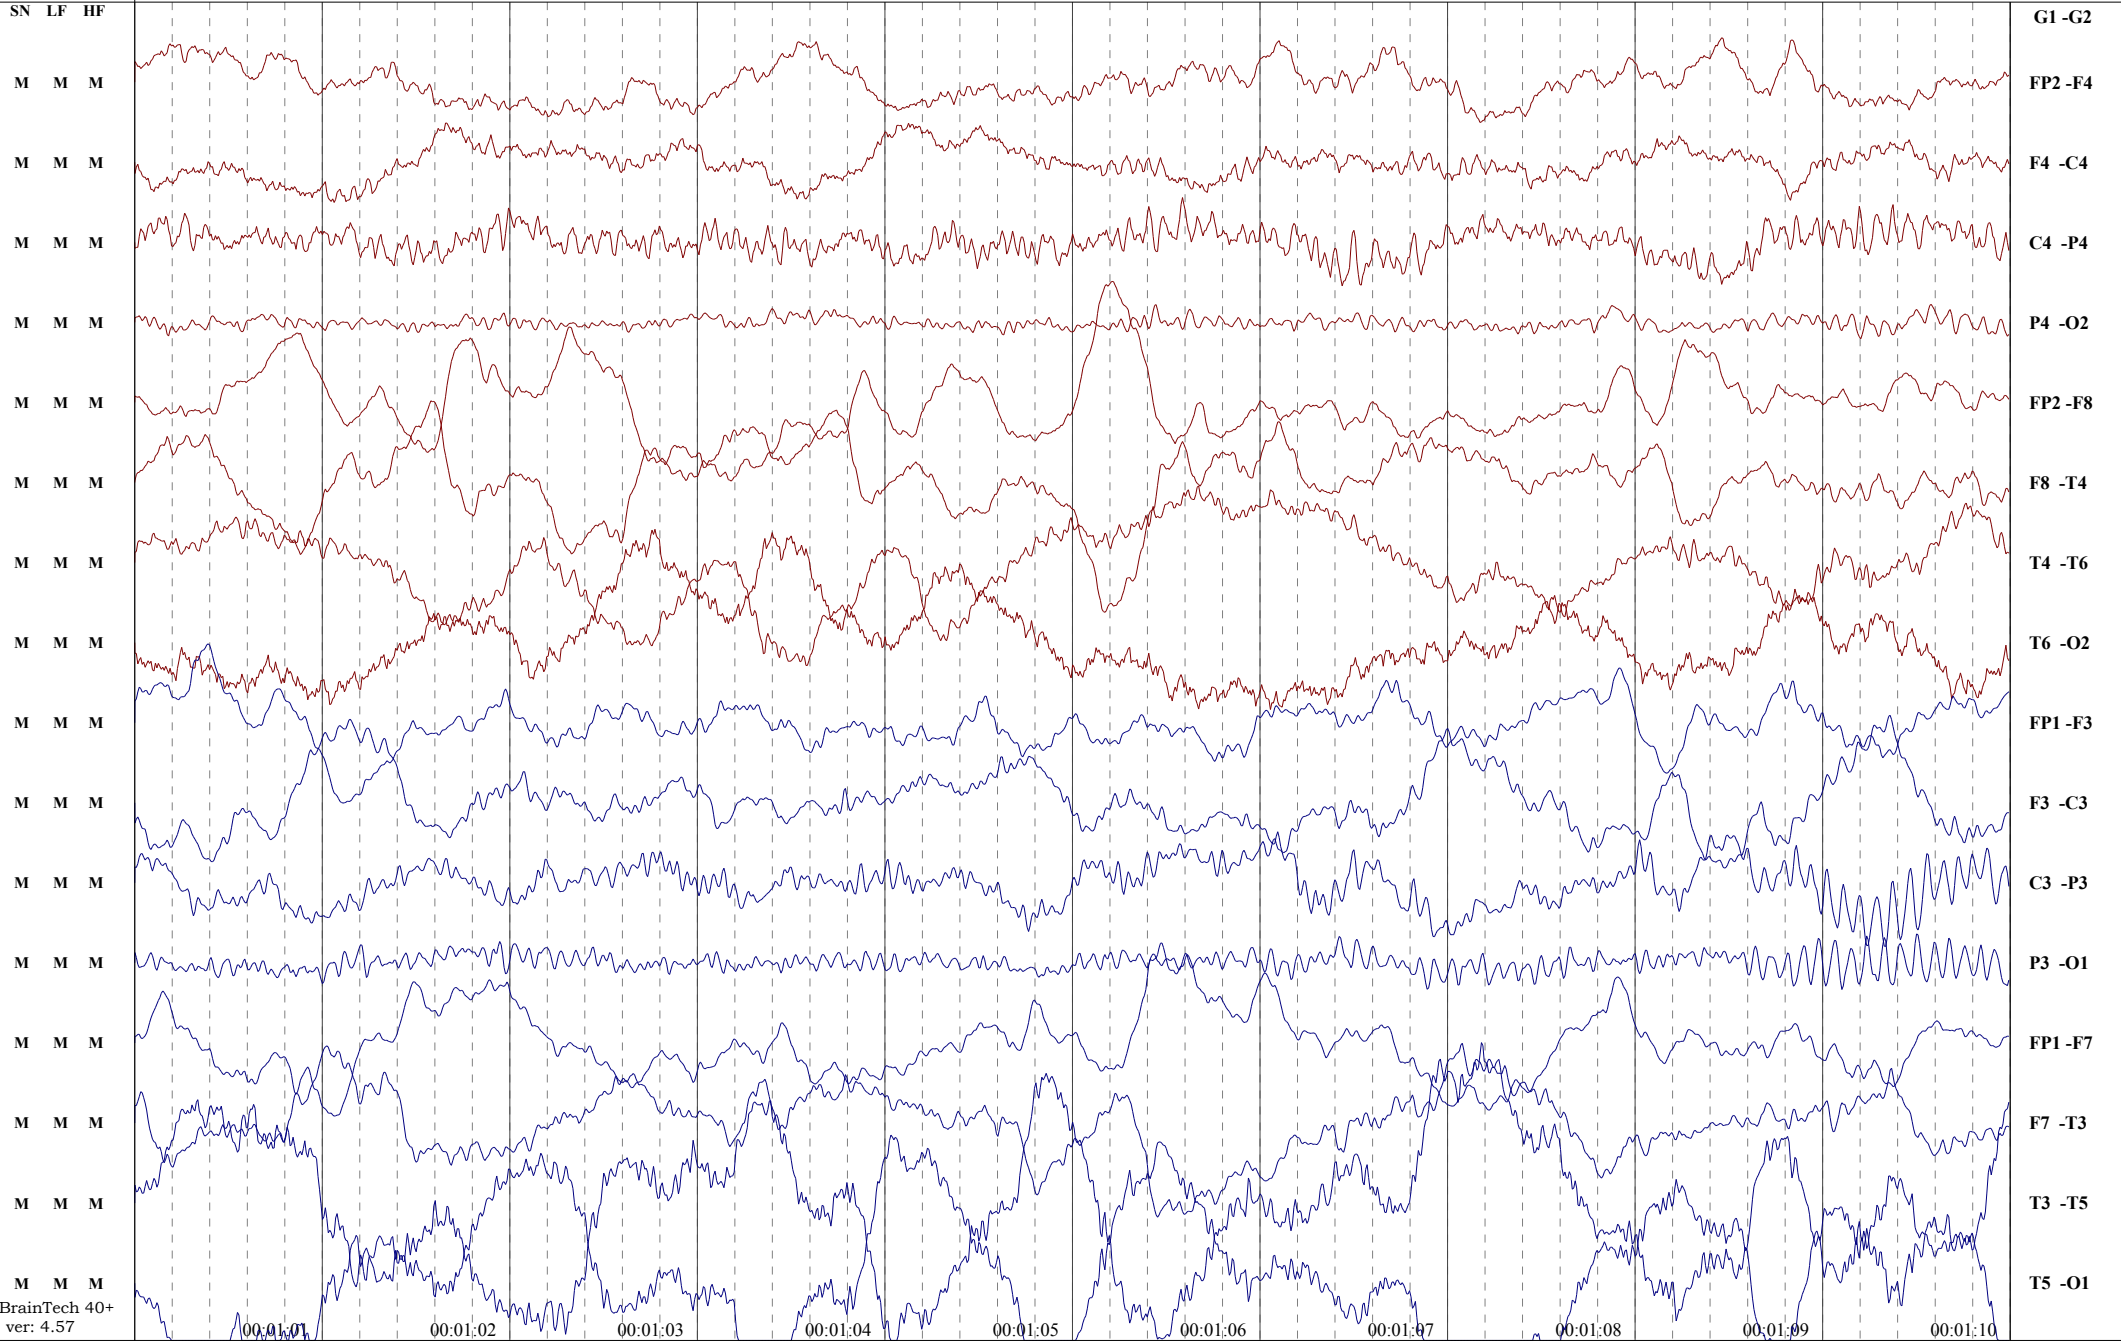


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:21:49
Page:8/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

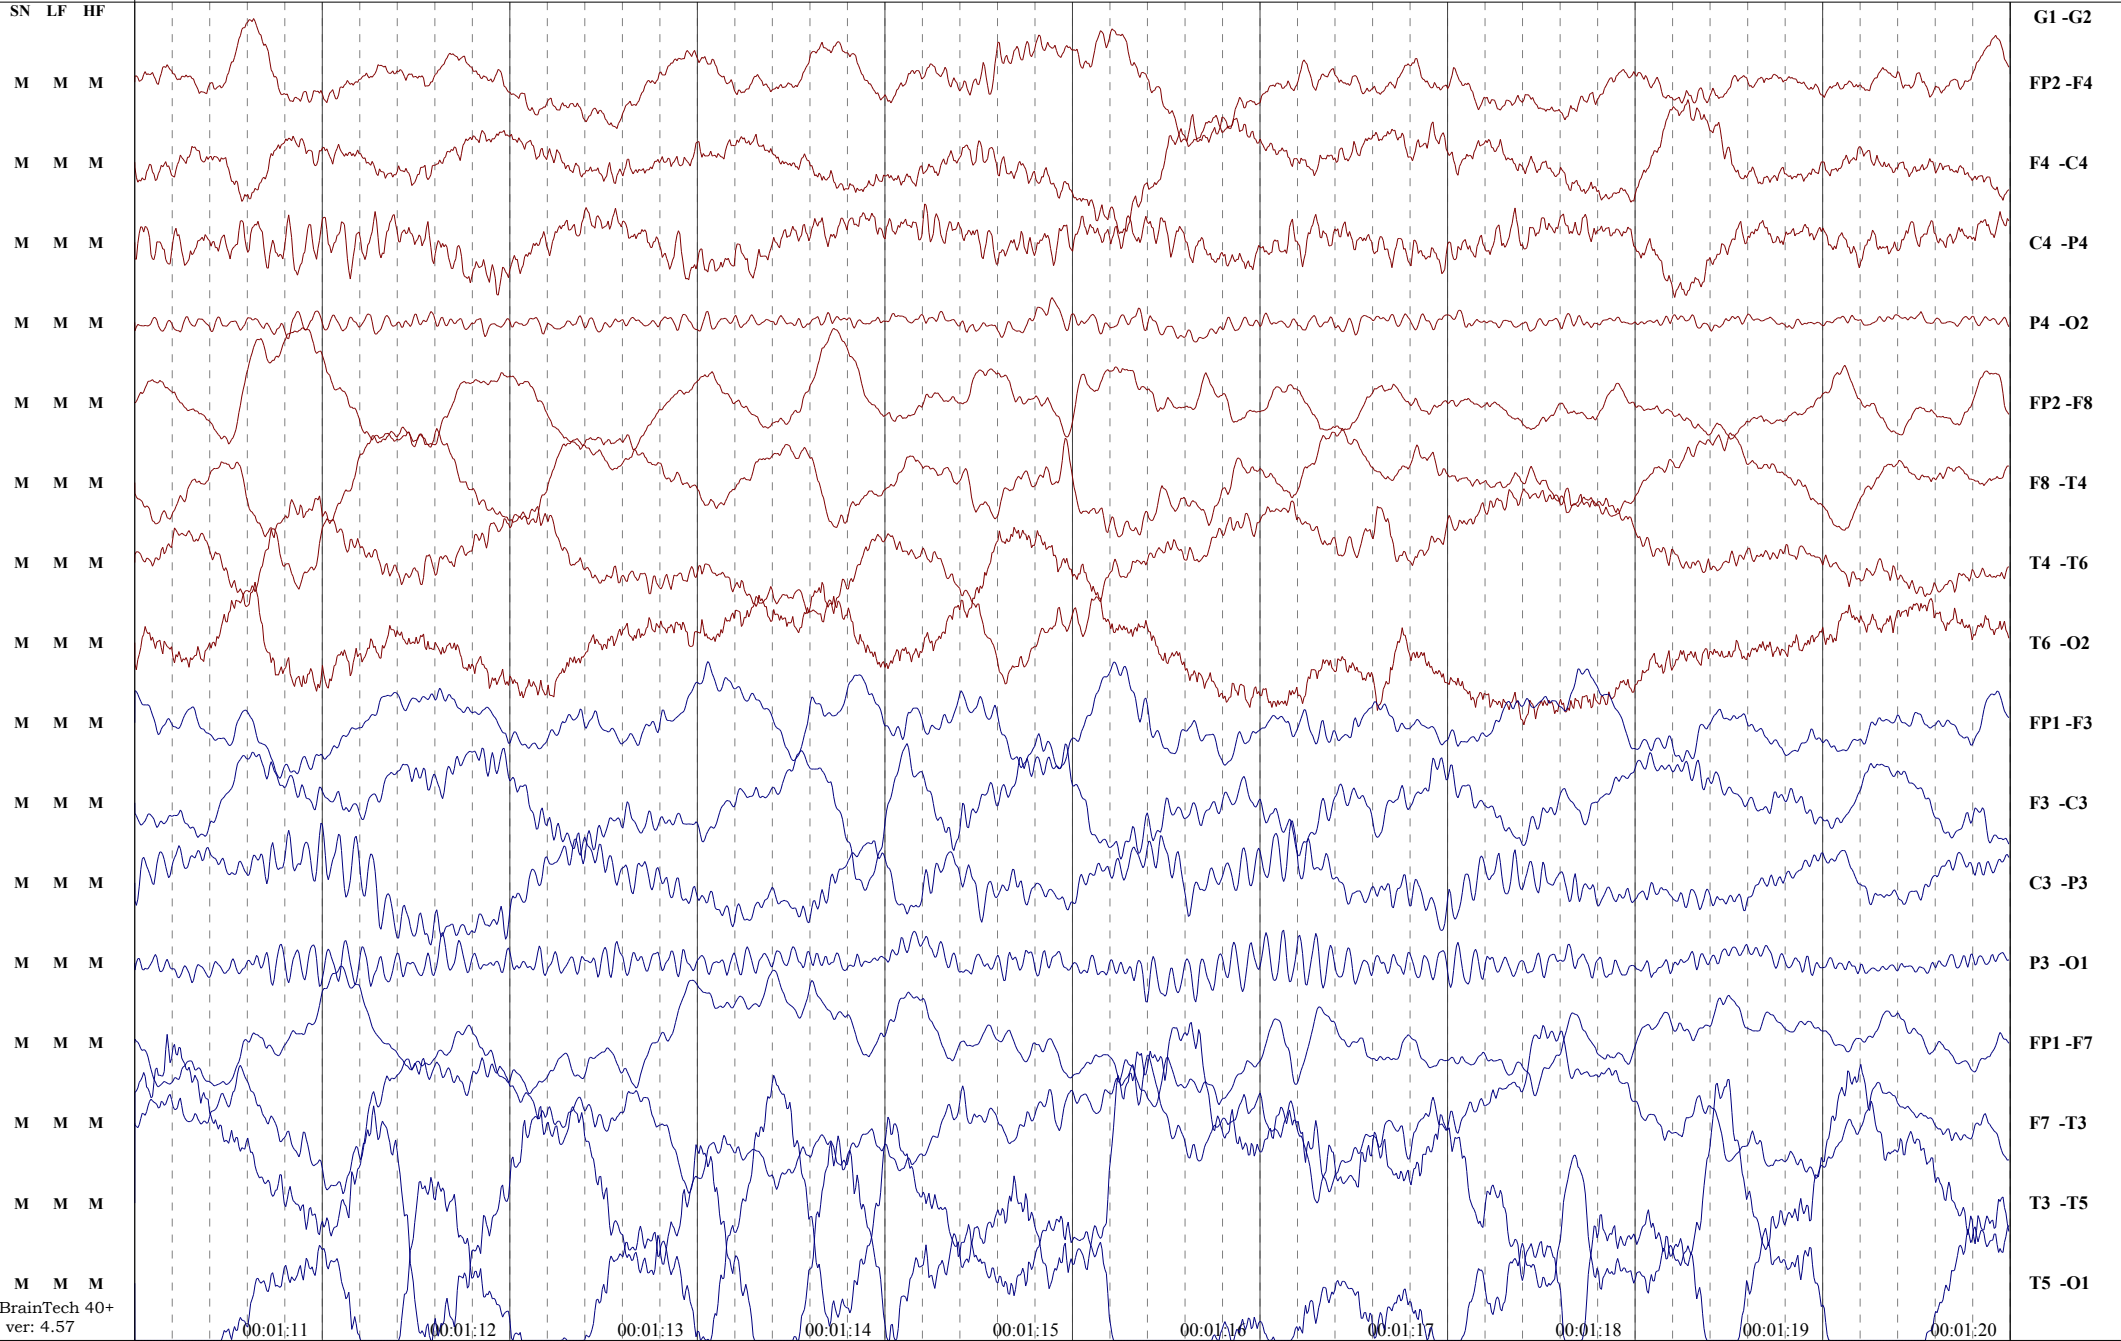


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:21:59
Page:9/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

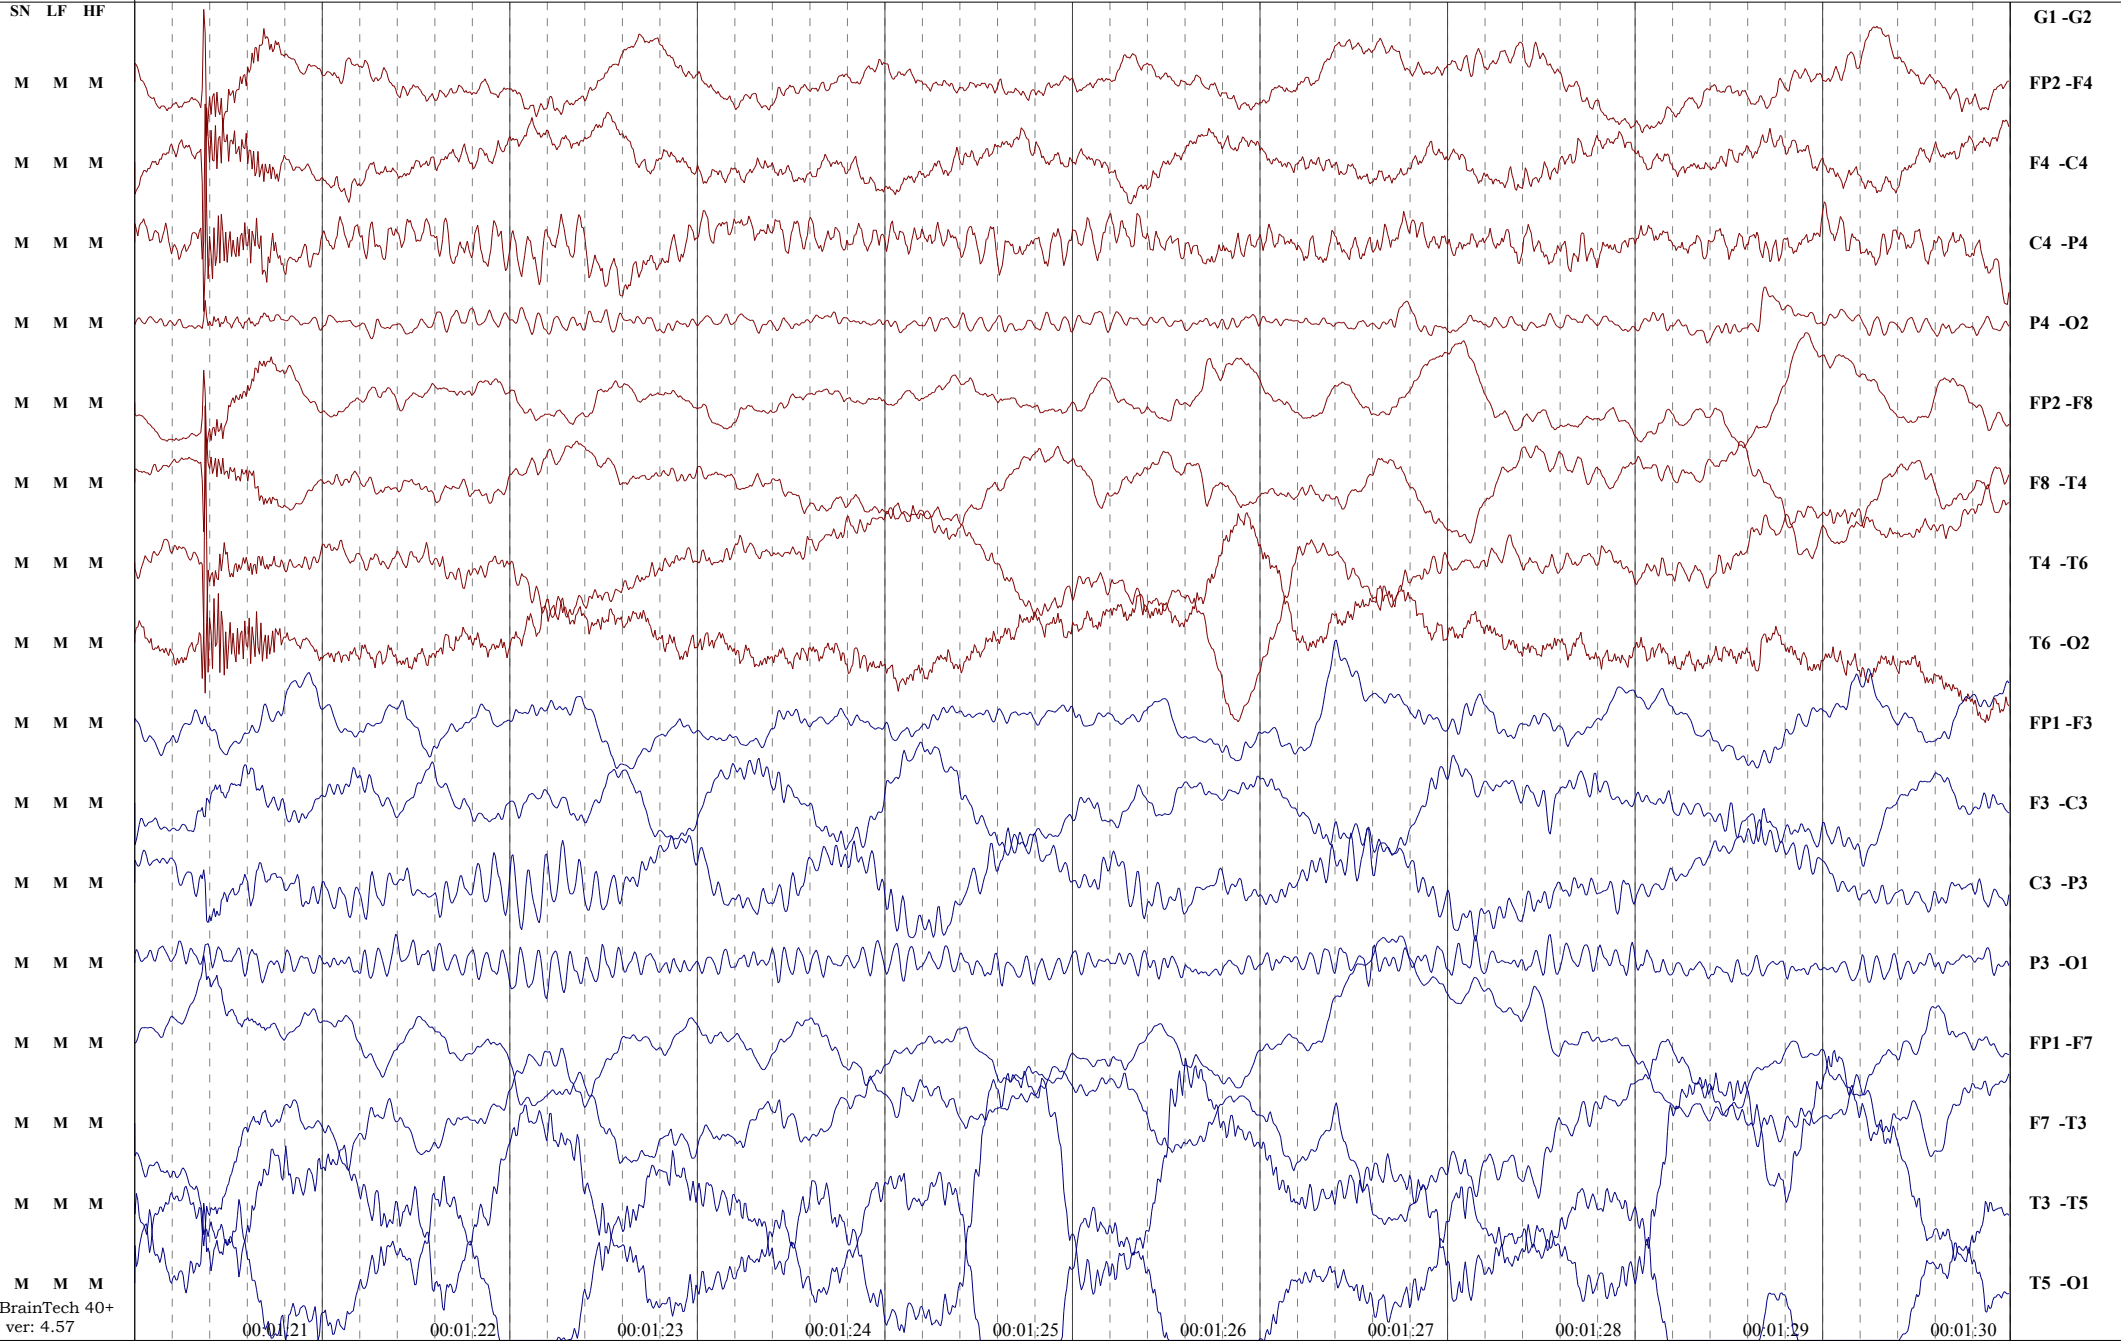


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:22:09
Page:10/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

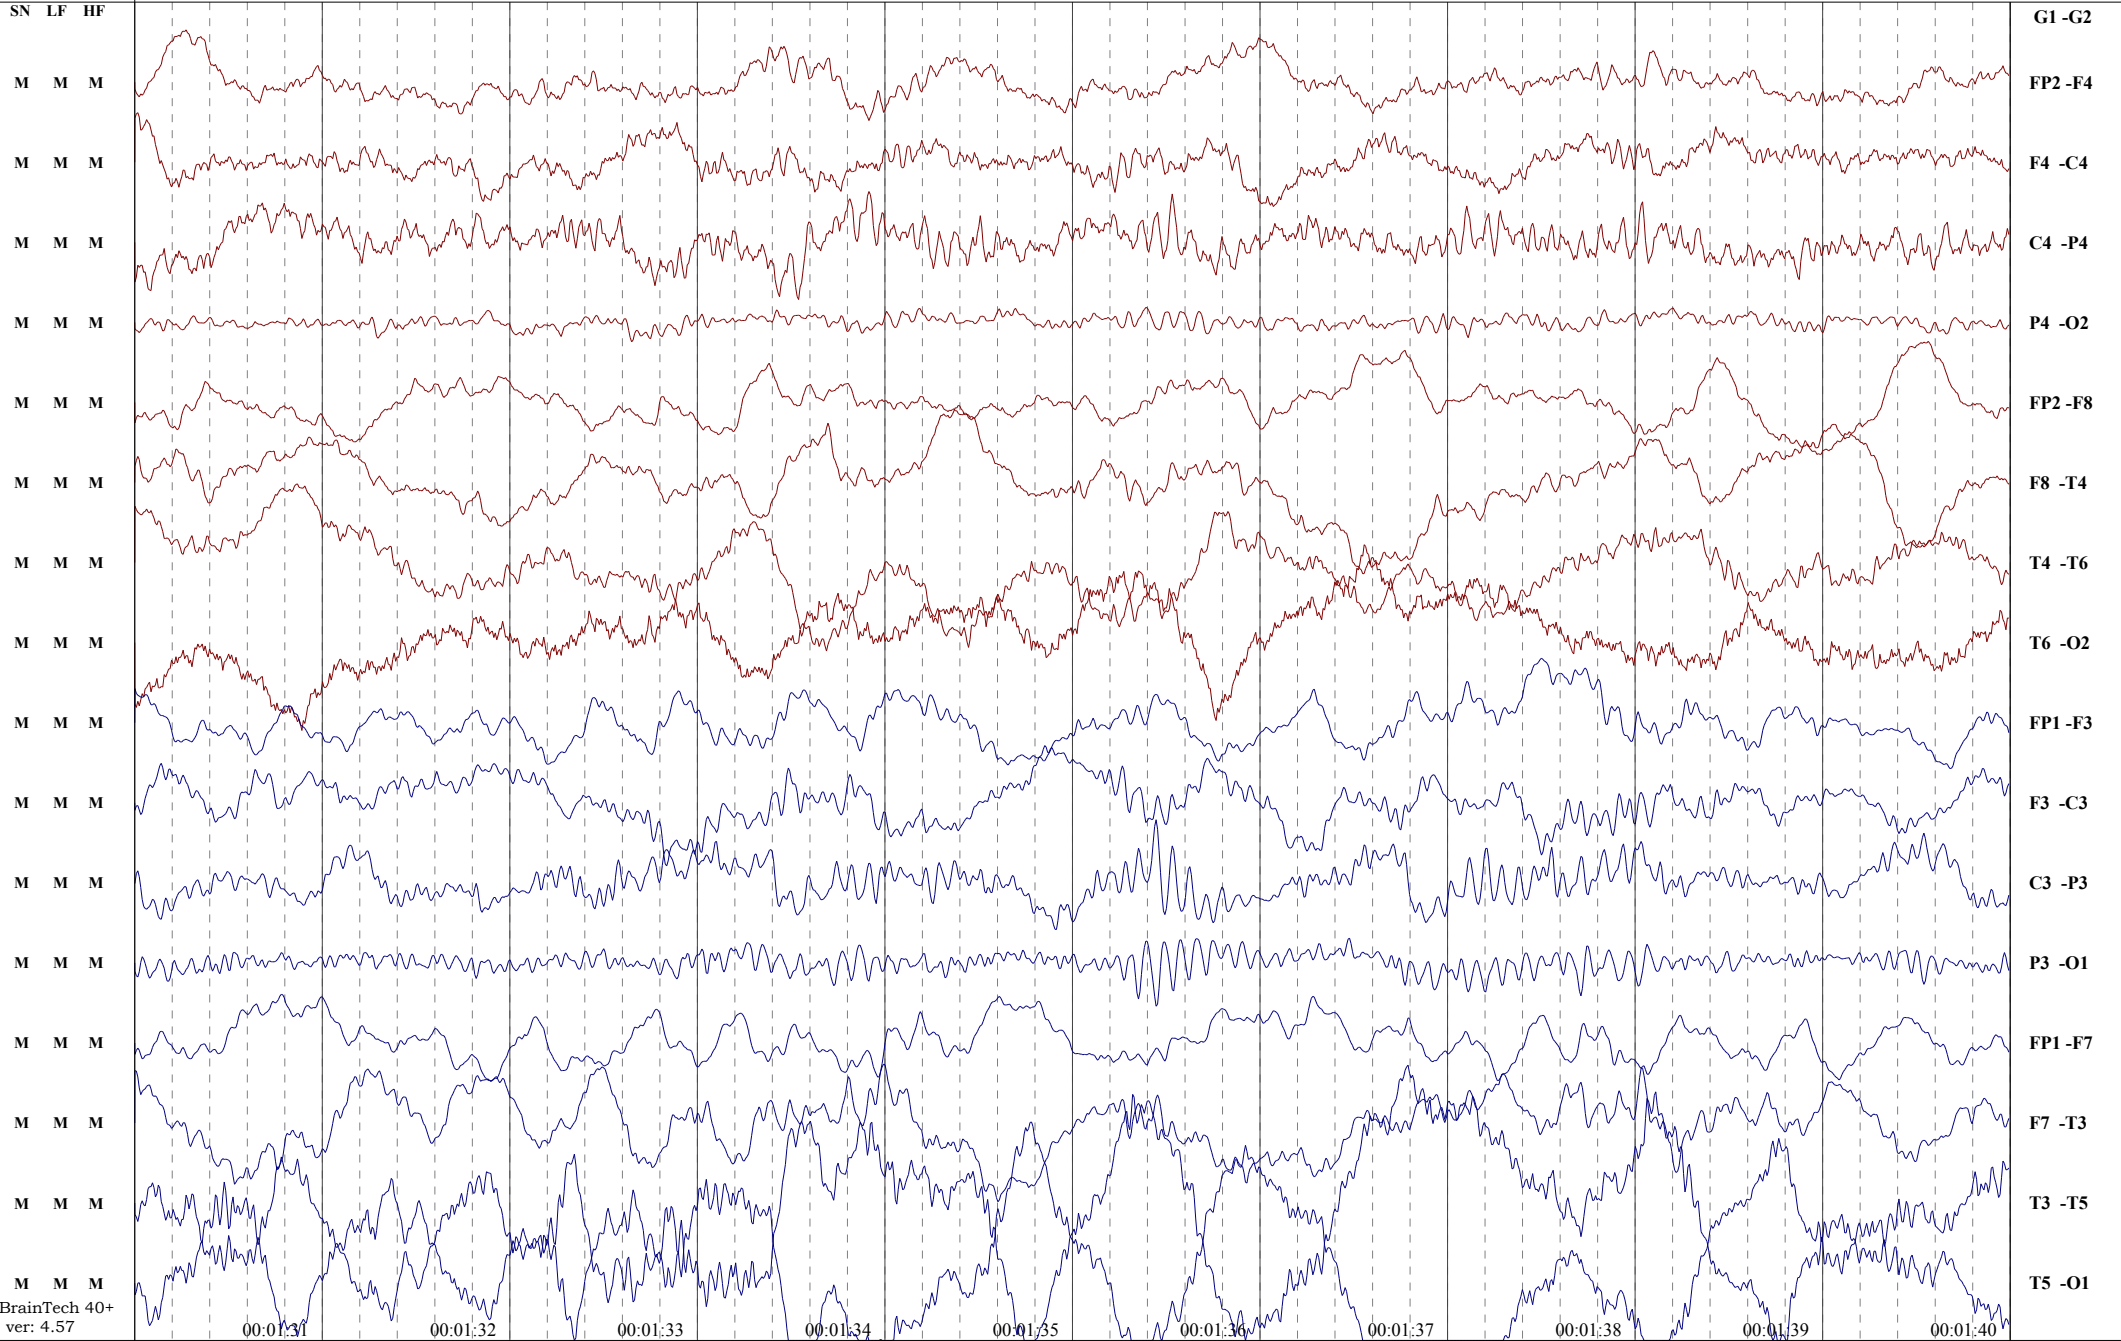


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:22:19
Page:11/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

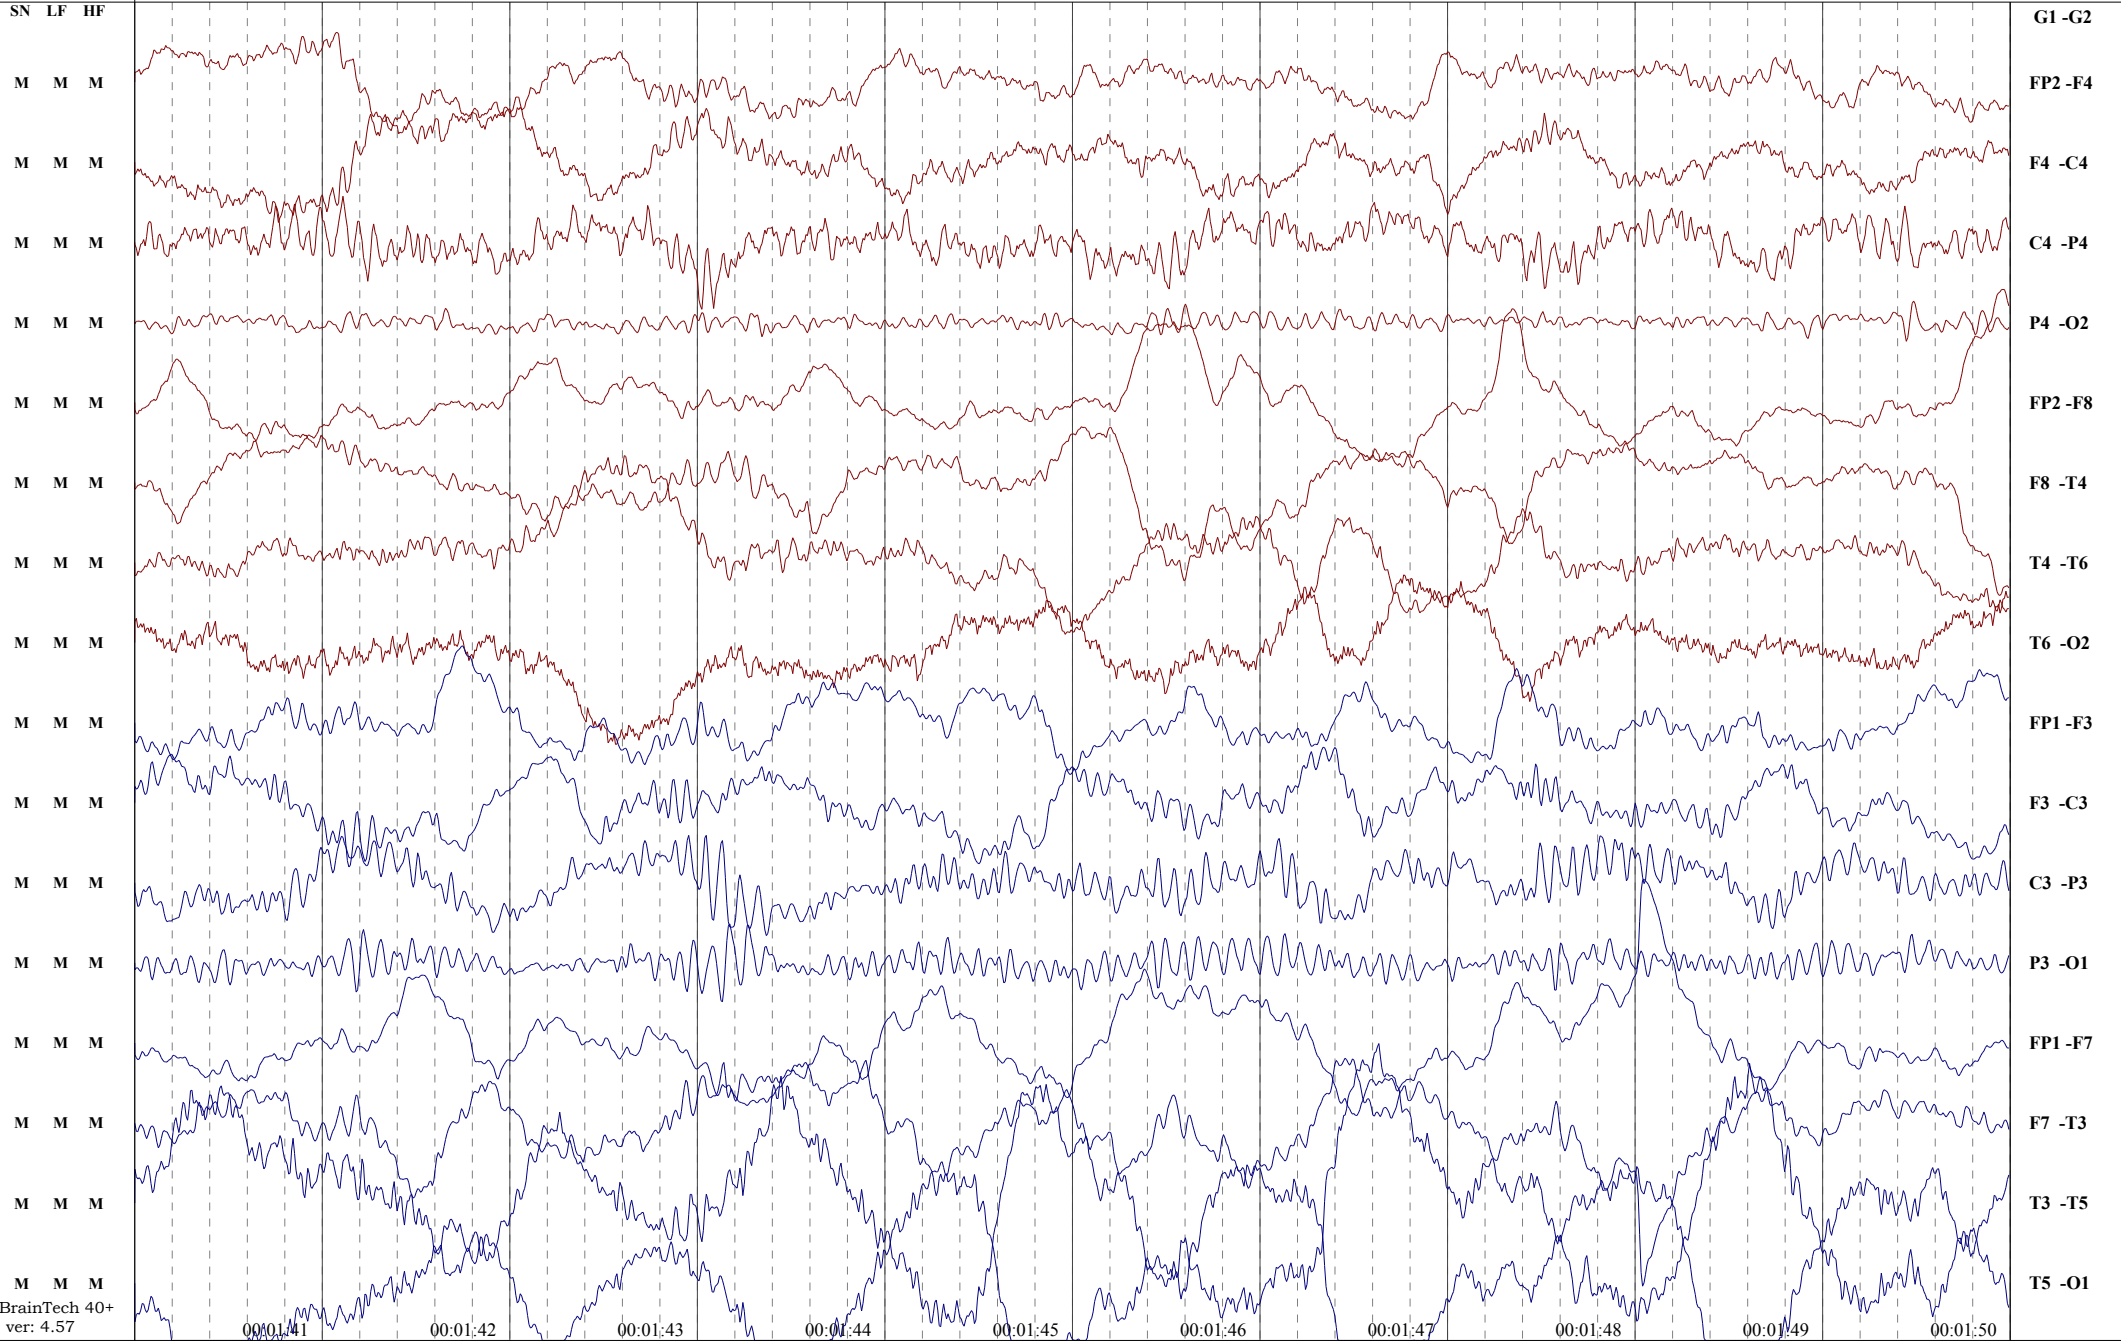


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:22:29
Page:12/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

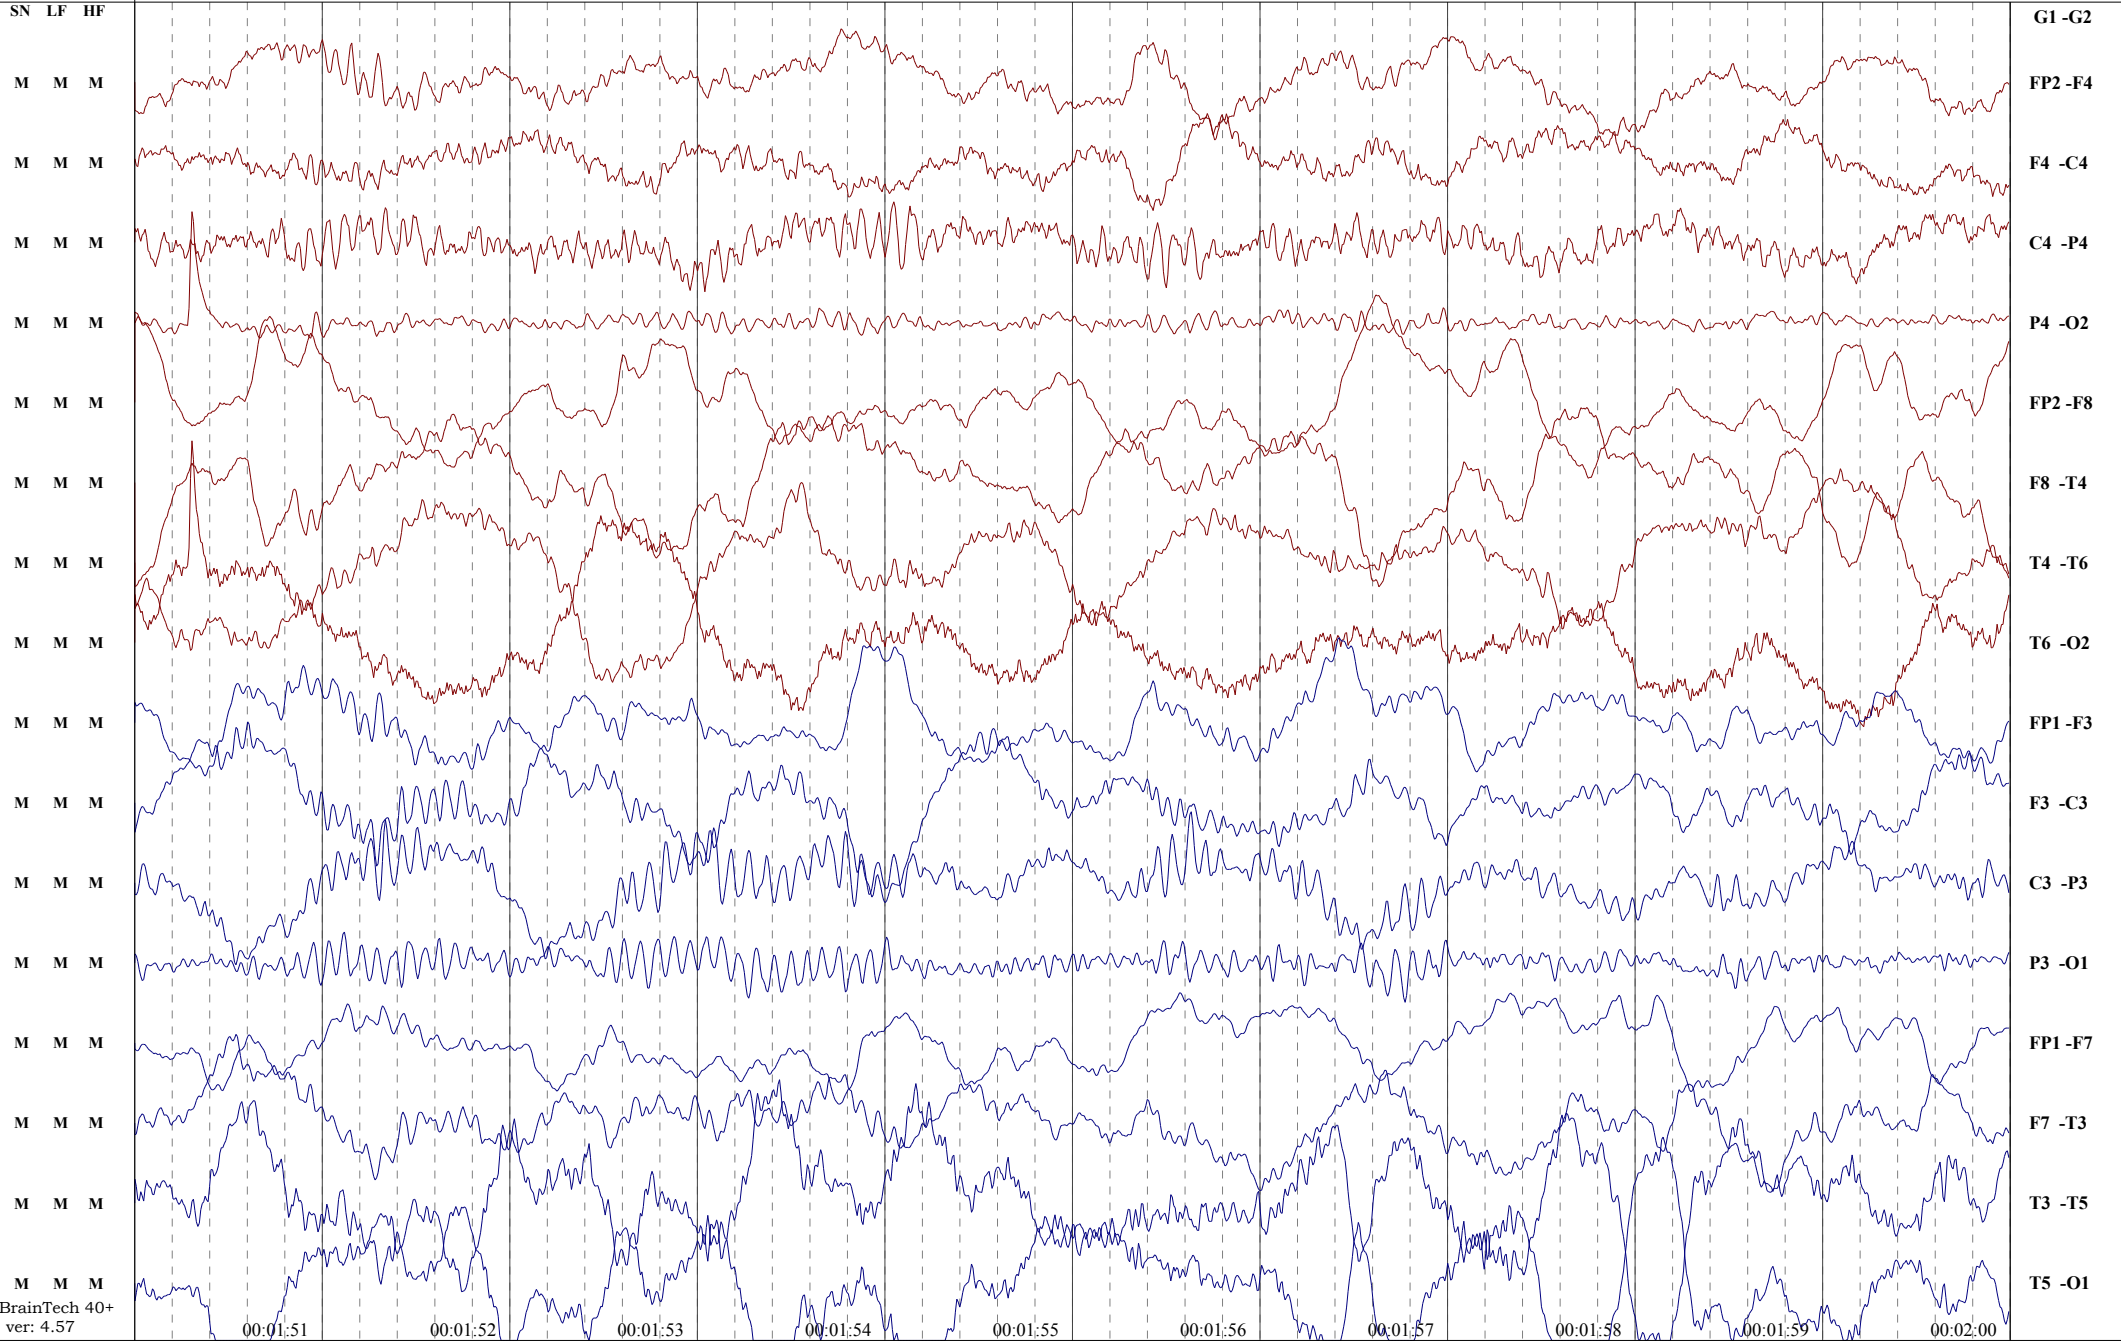


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:22:39
Page:13/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

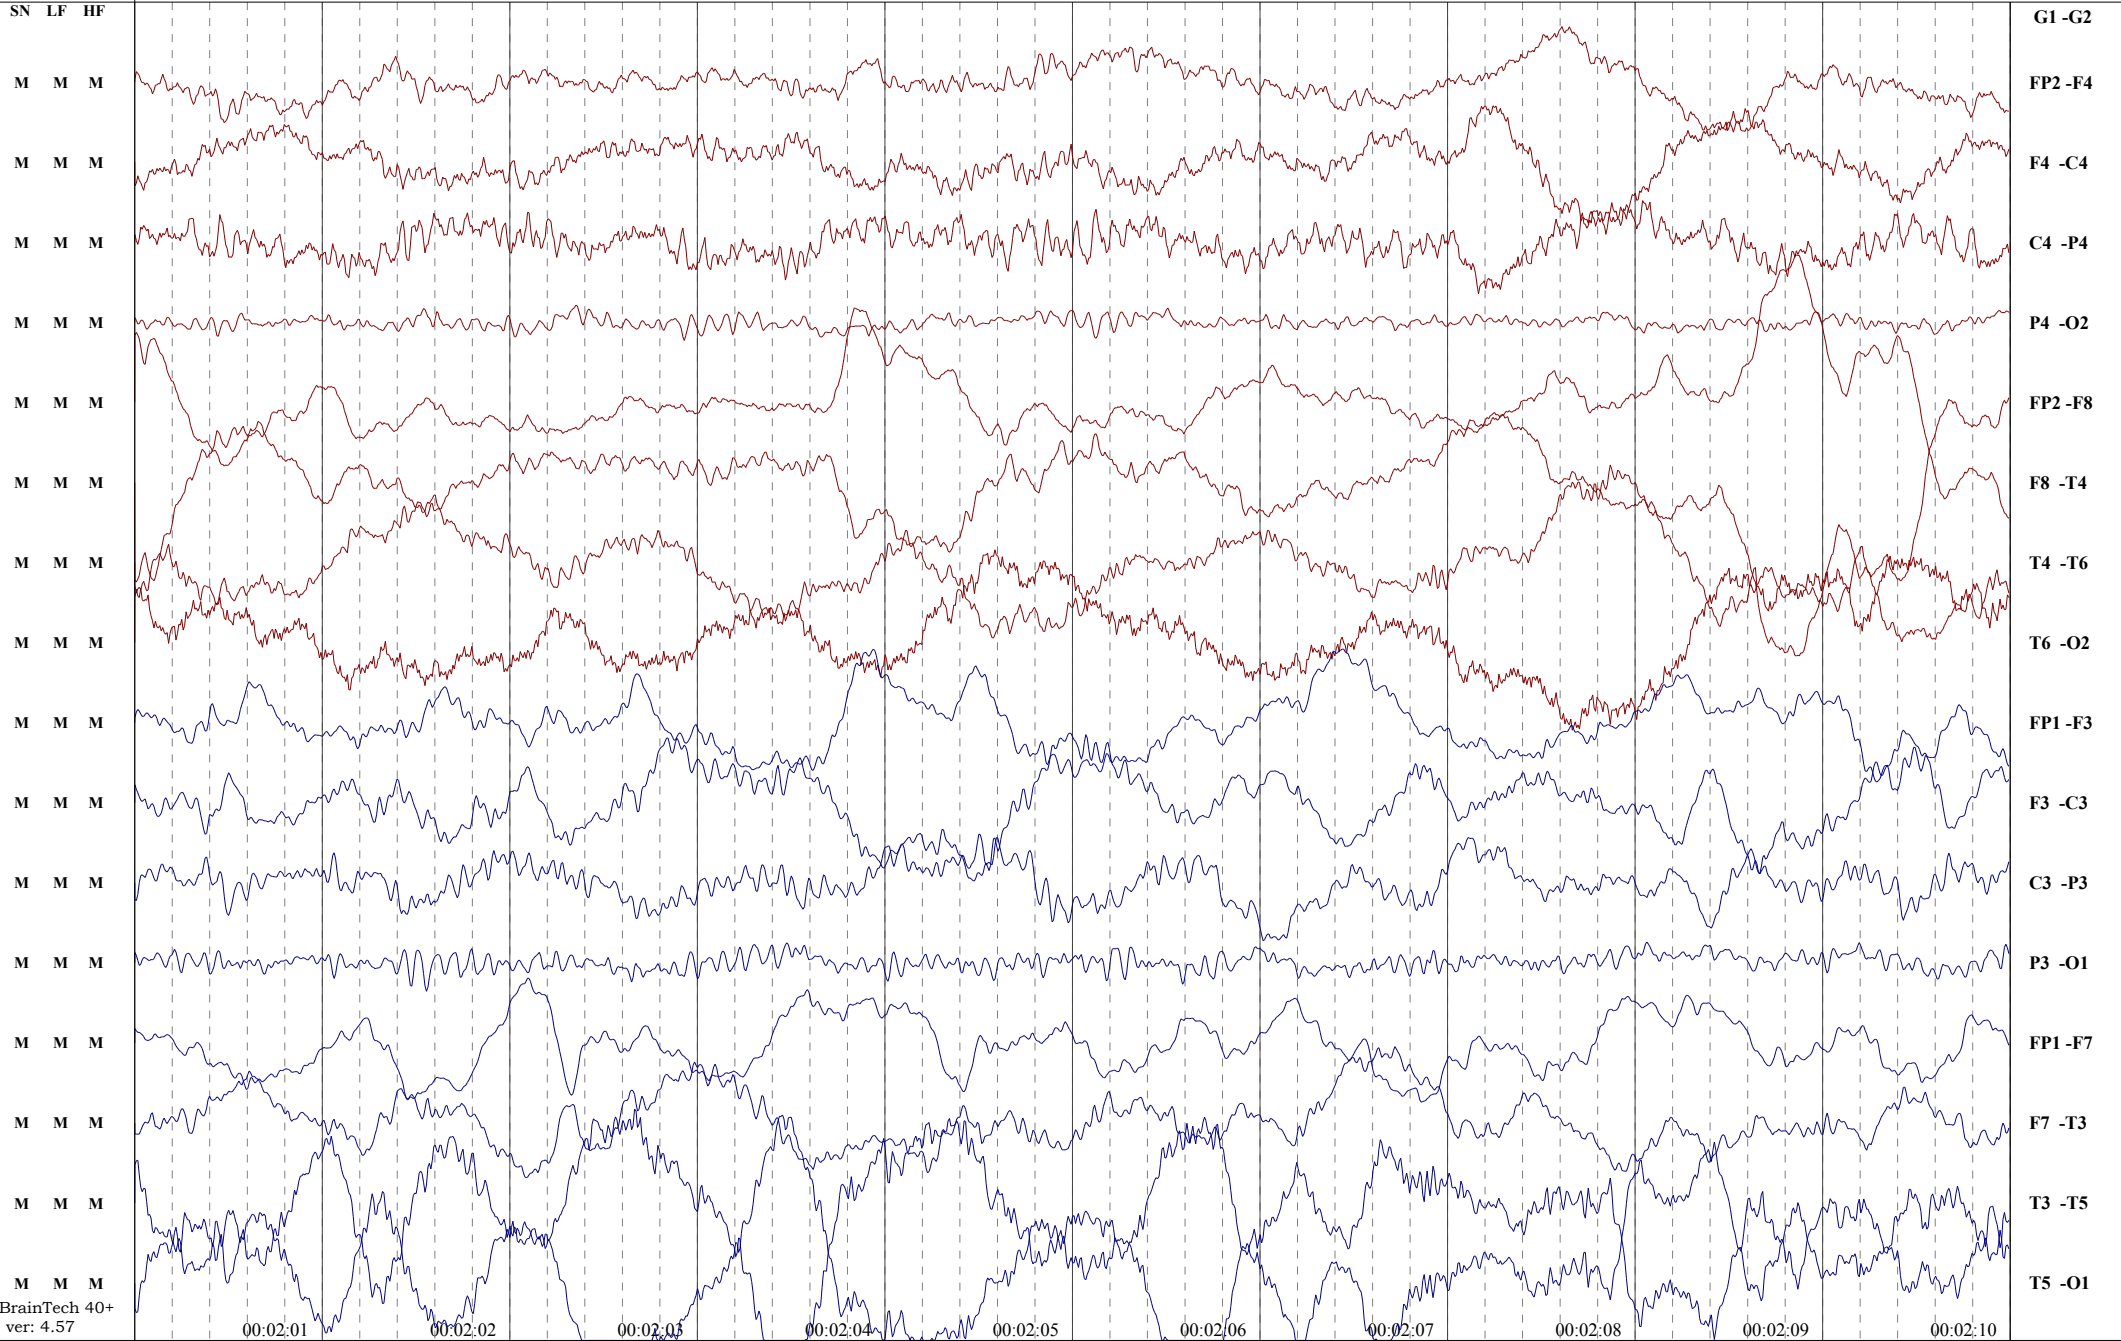


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:22:49
Page:14/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

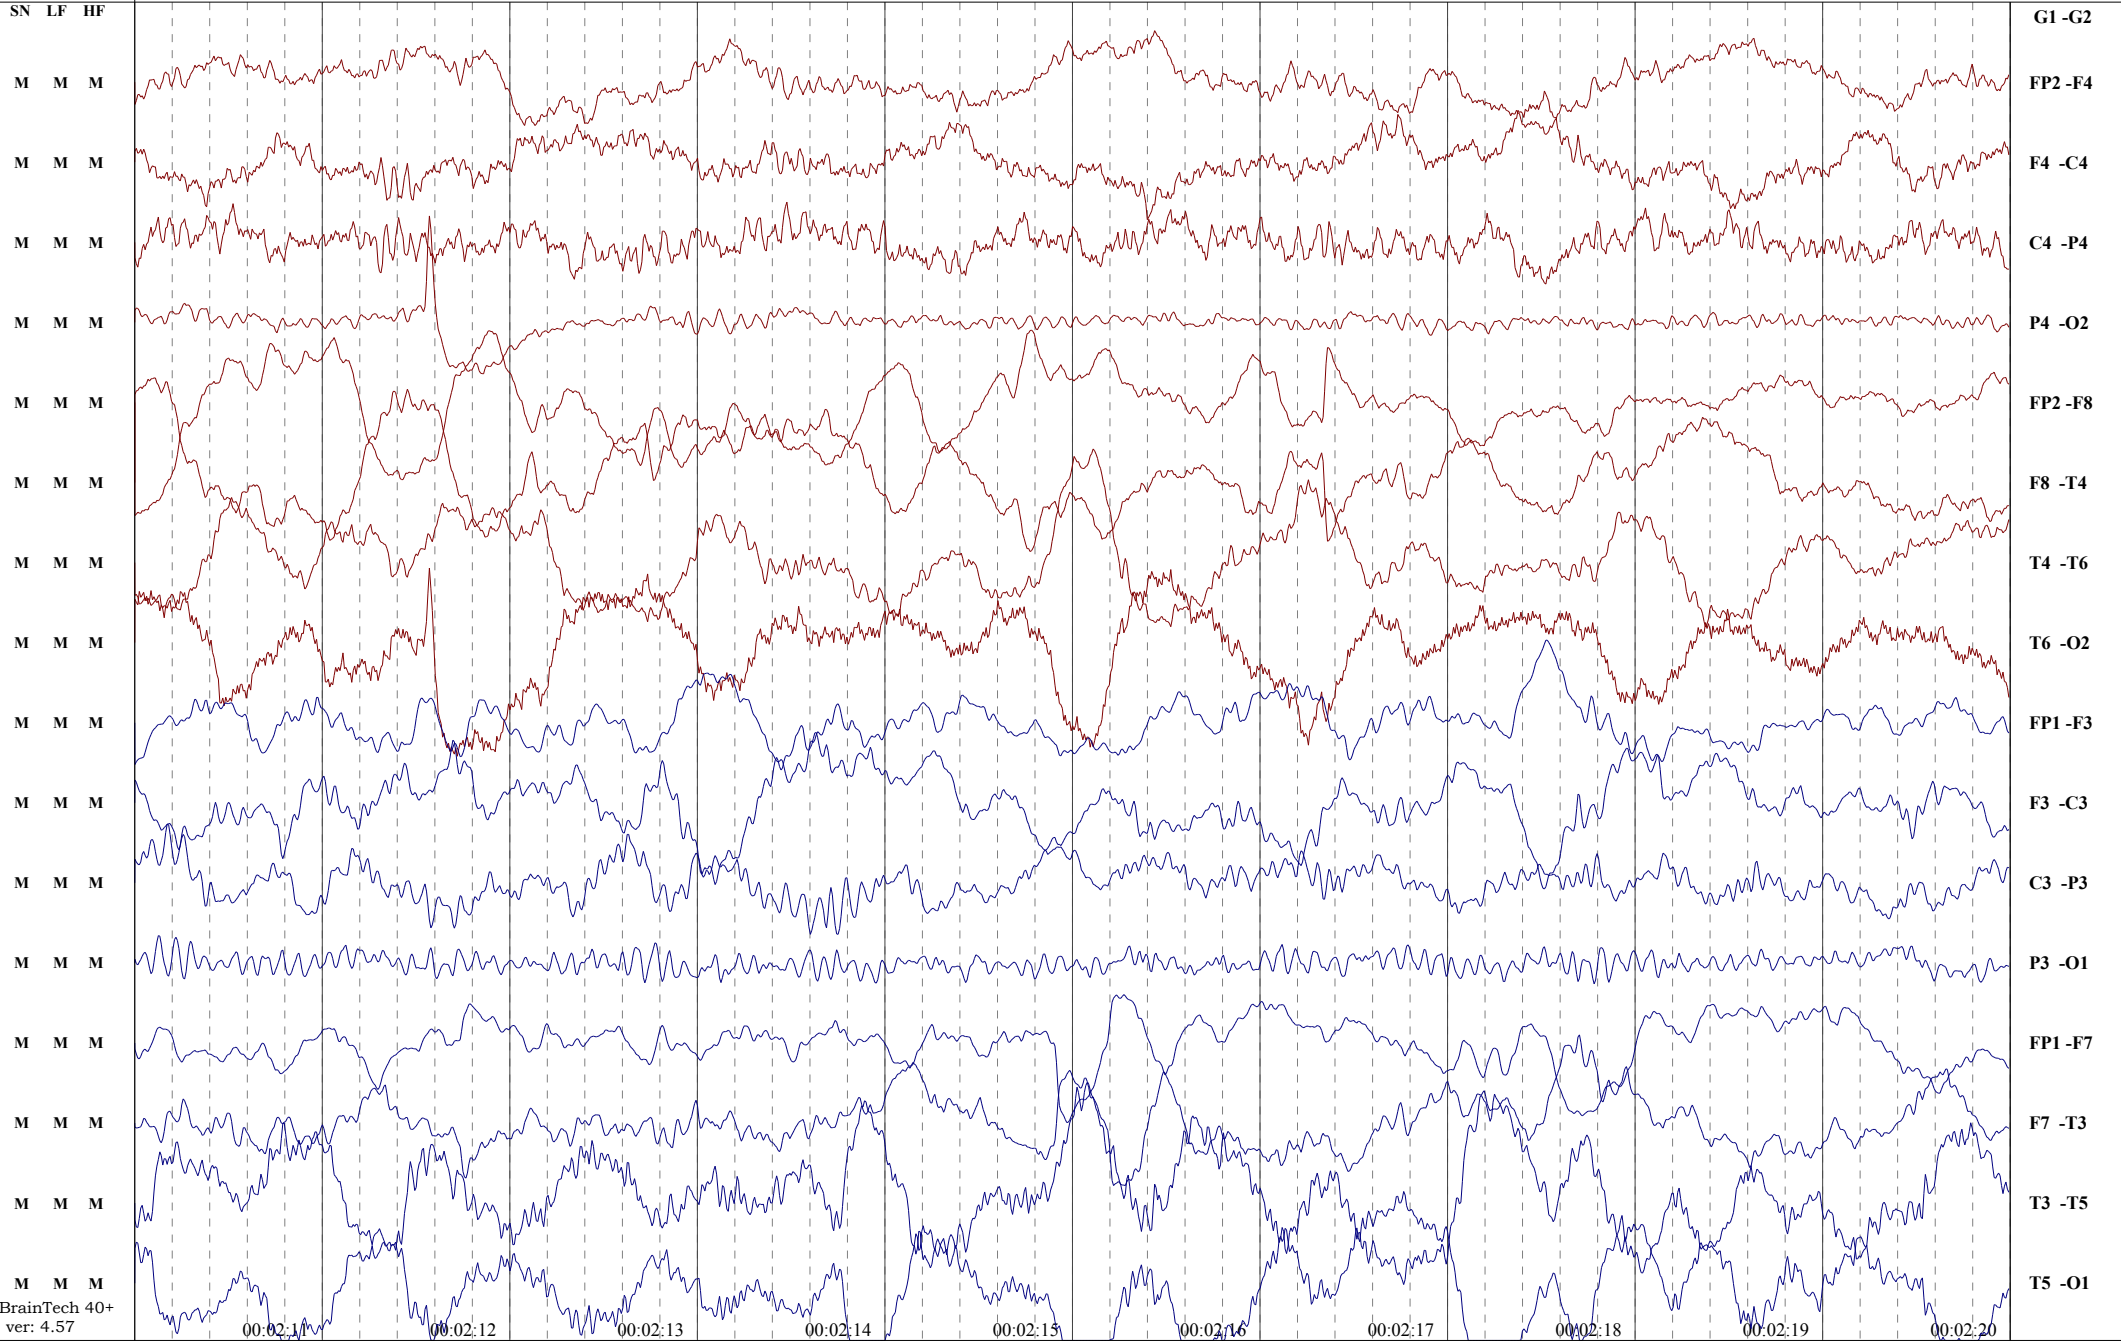


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:22:59
Page:15/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

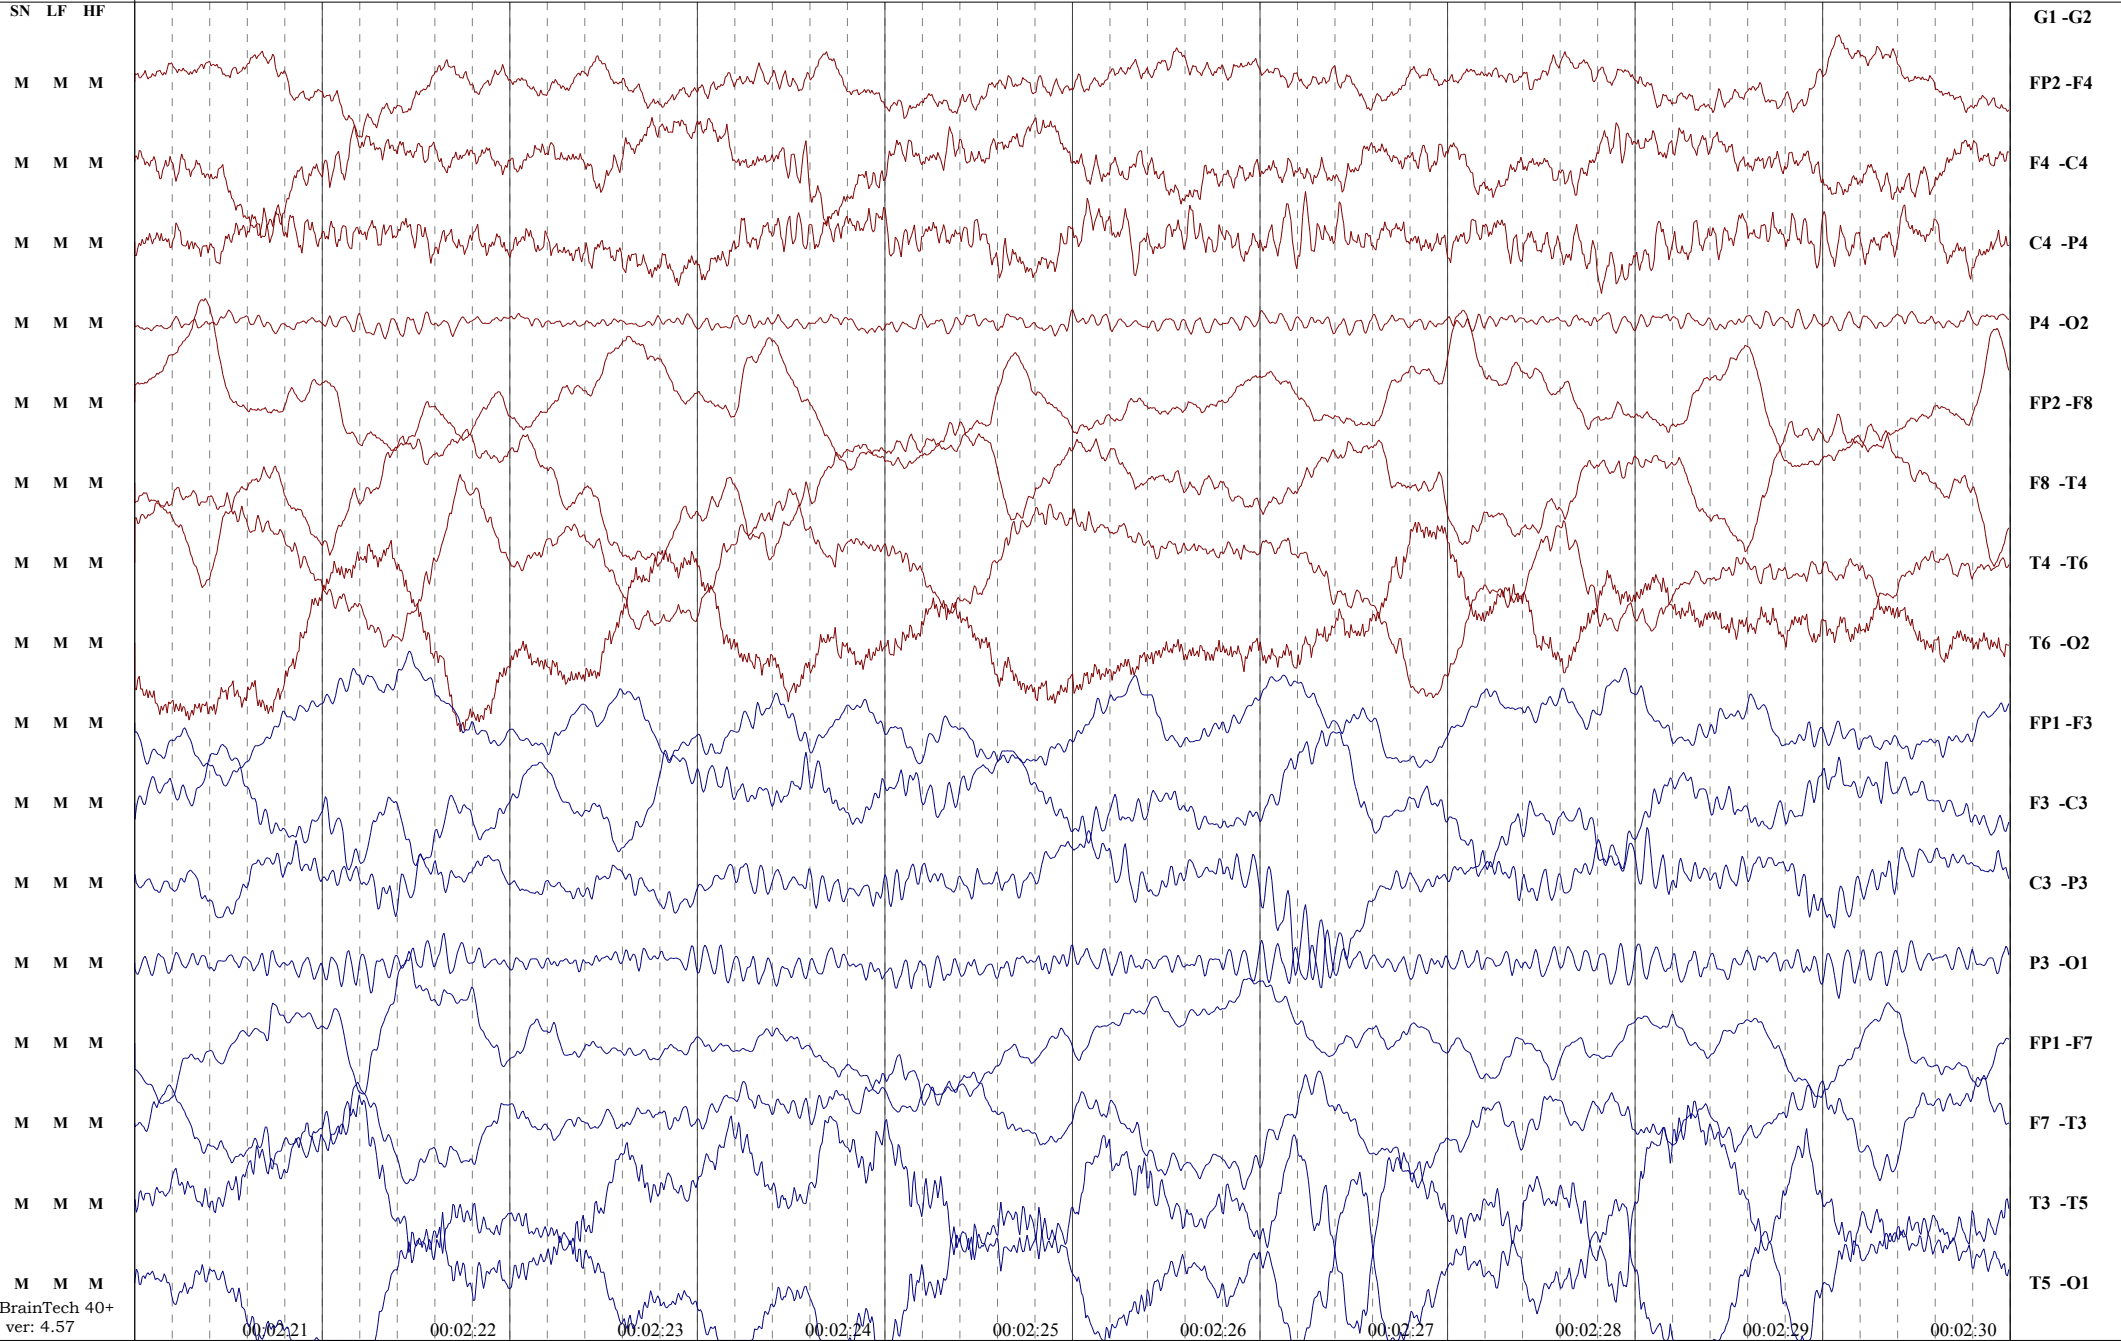


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:23:19
Page:17/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

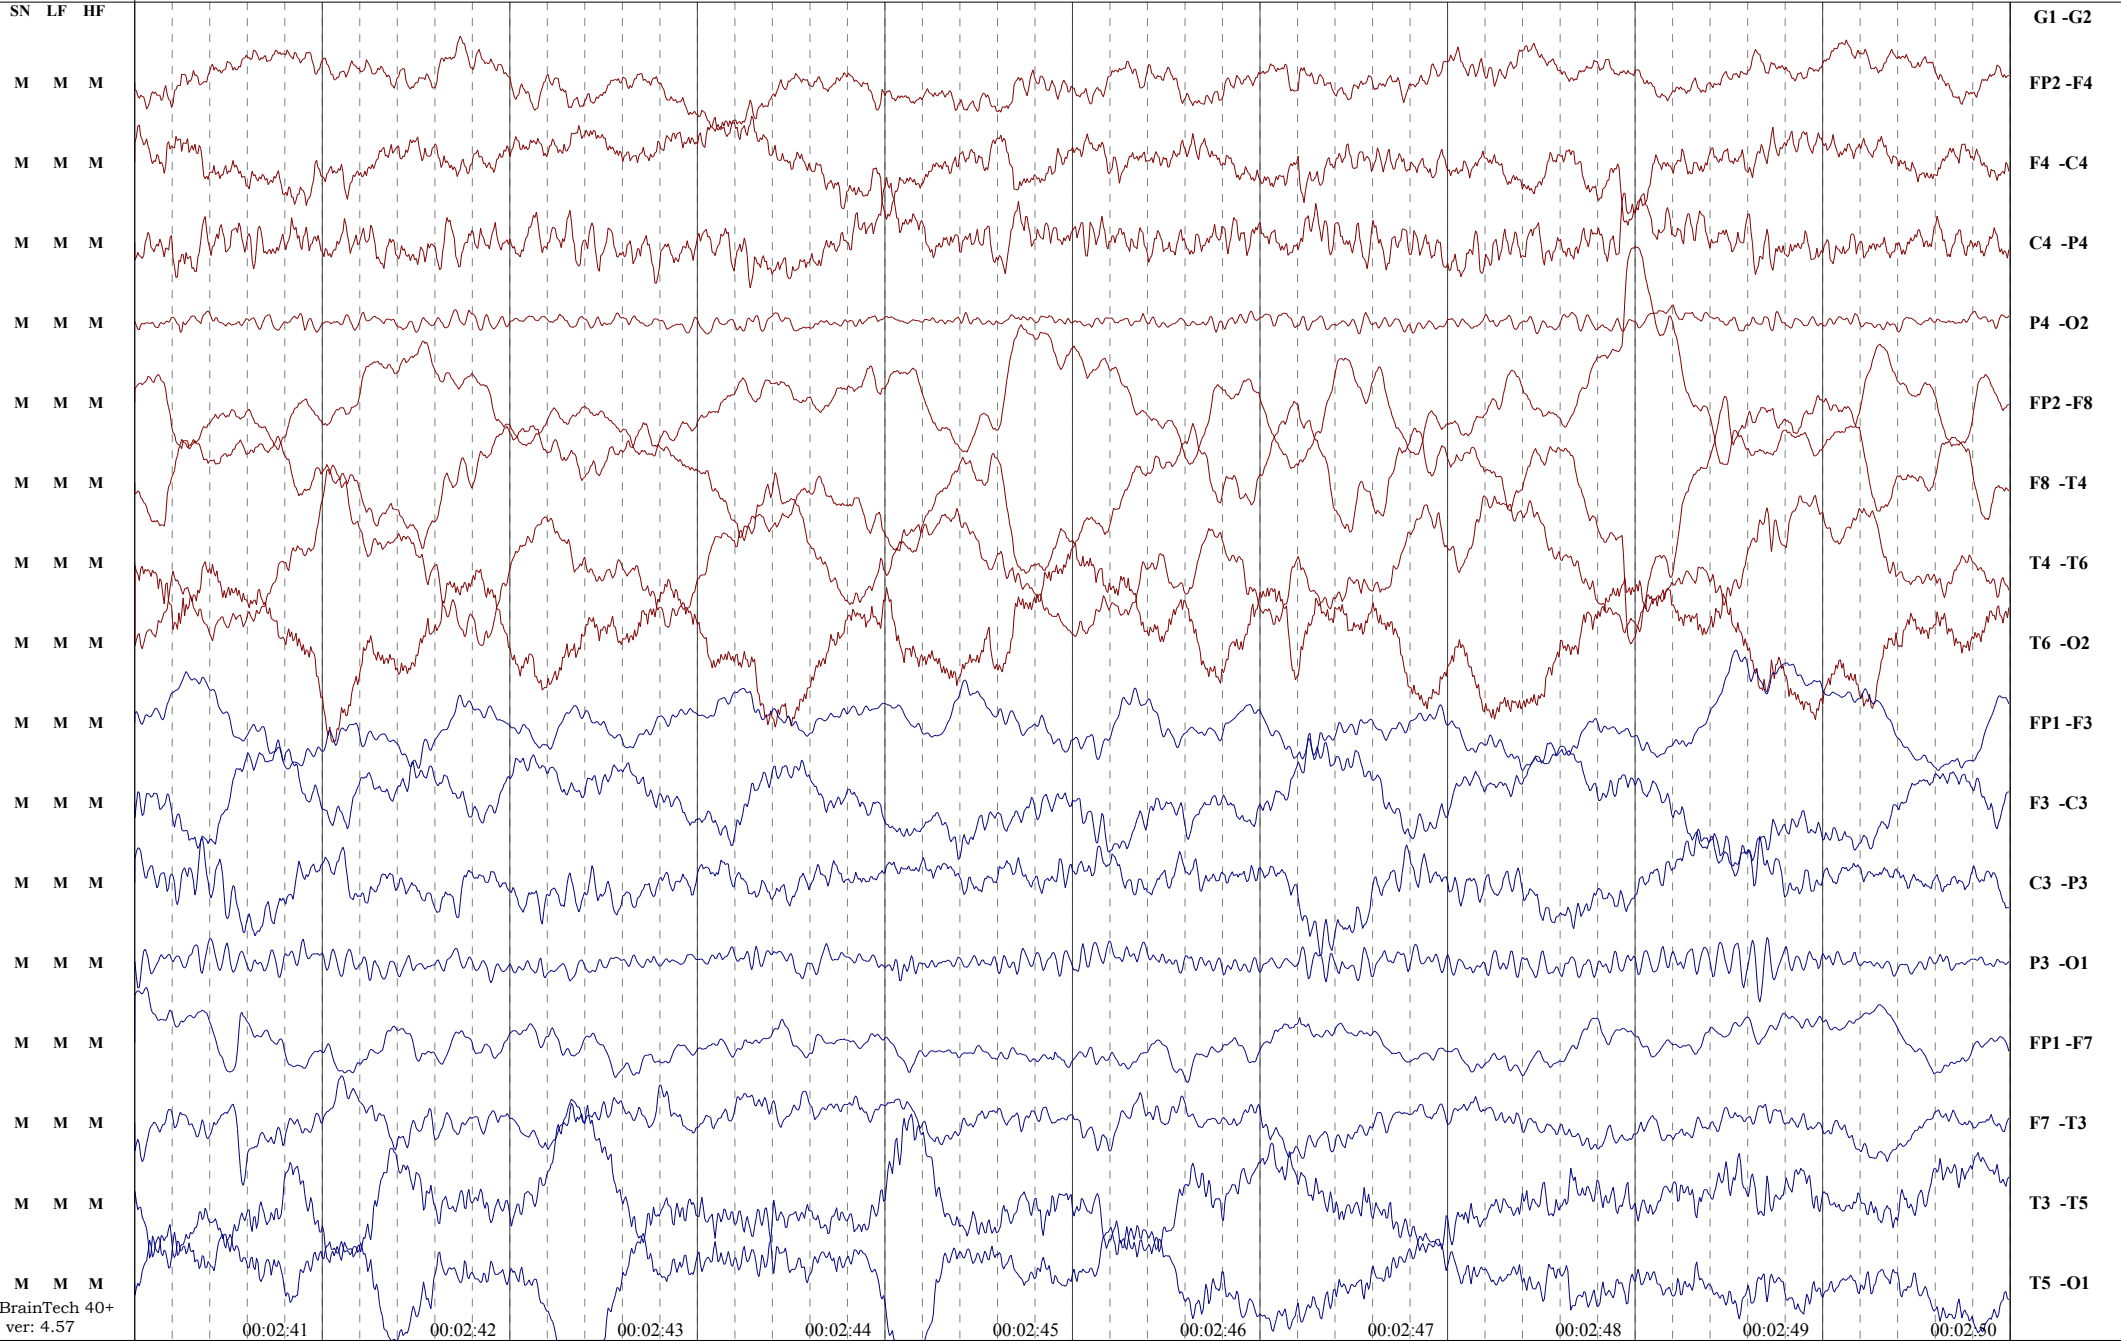


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:23:29
Page:18/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

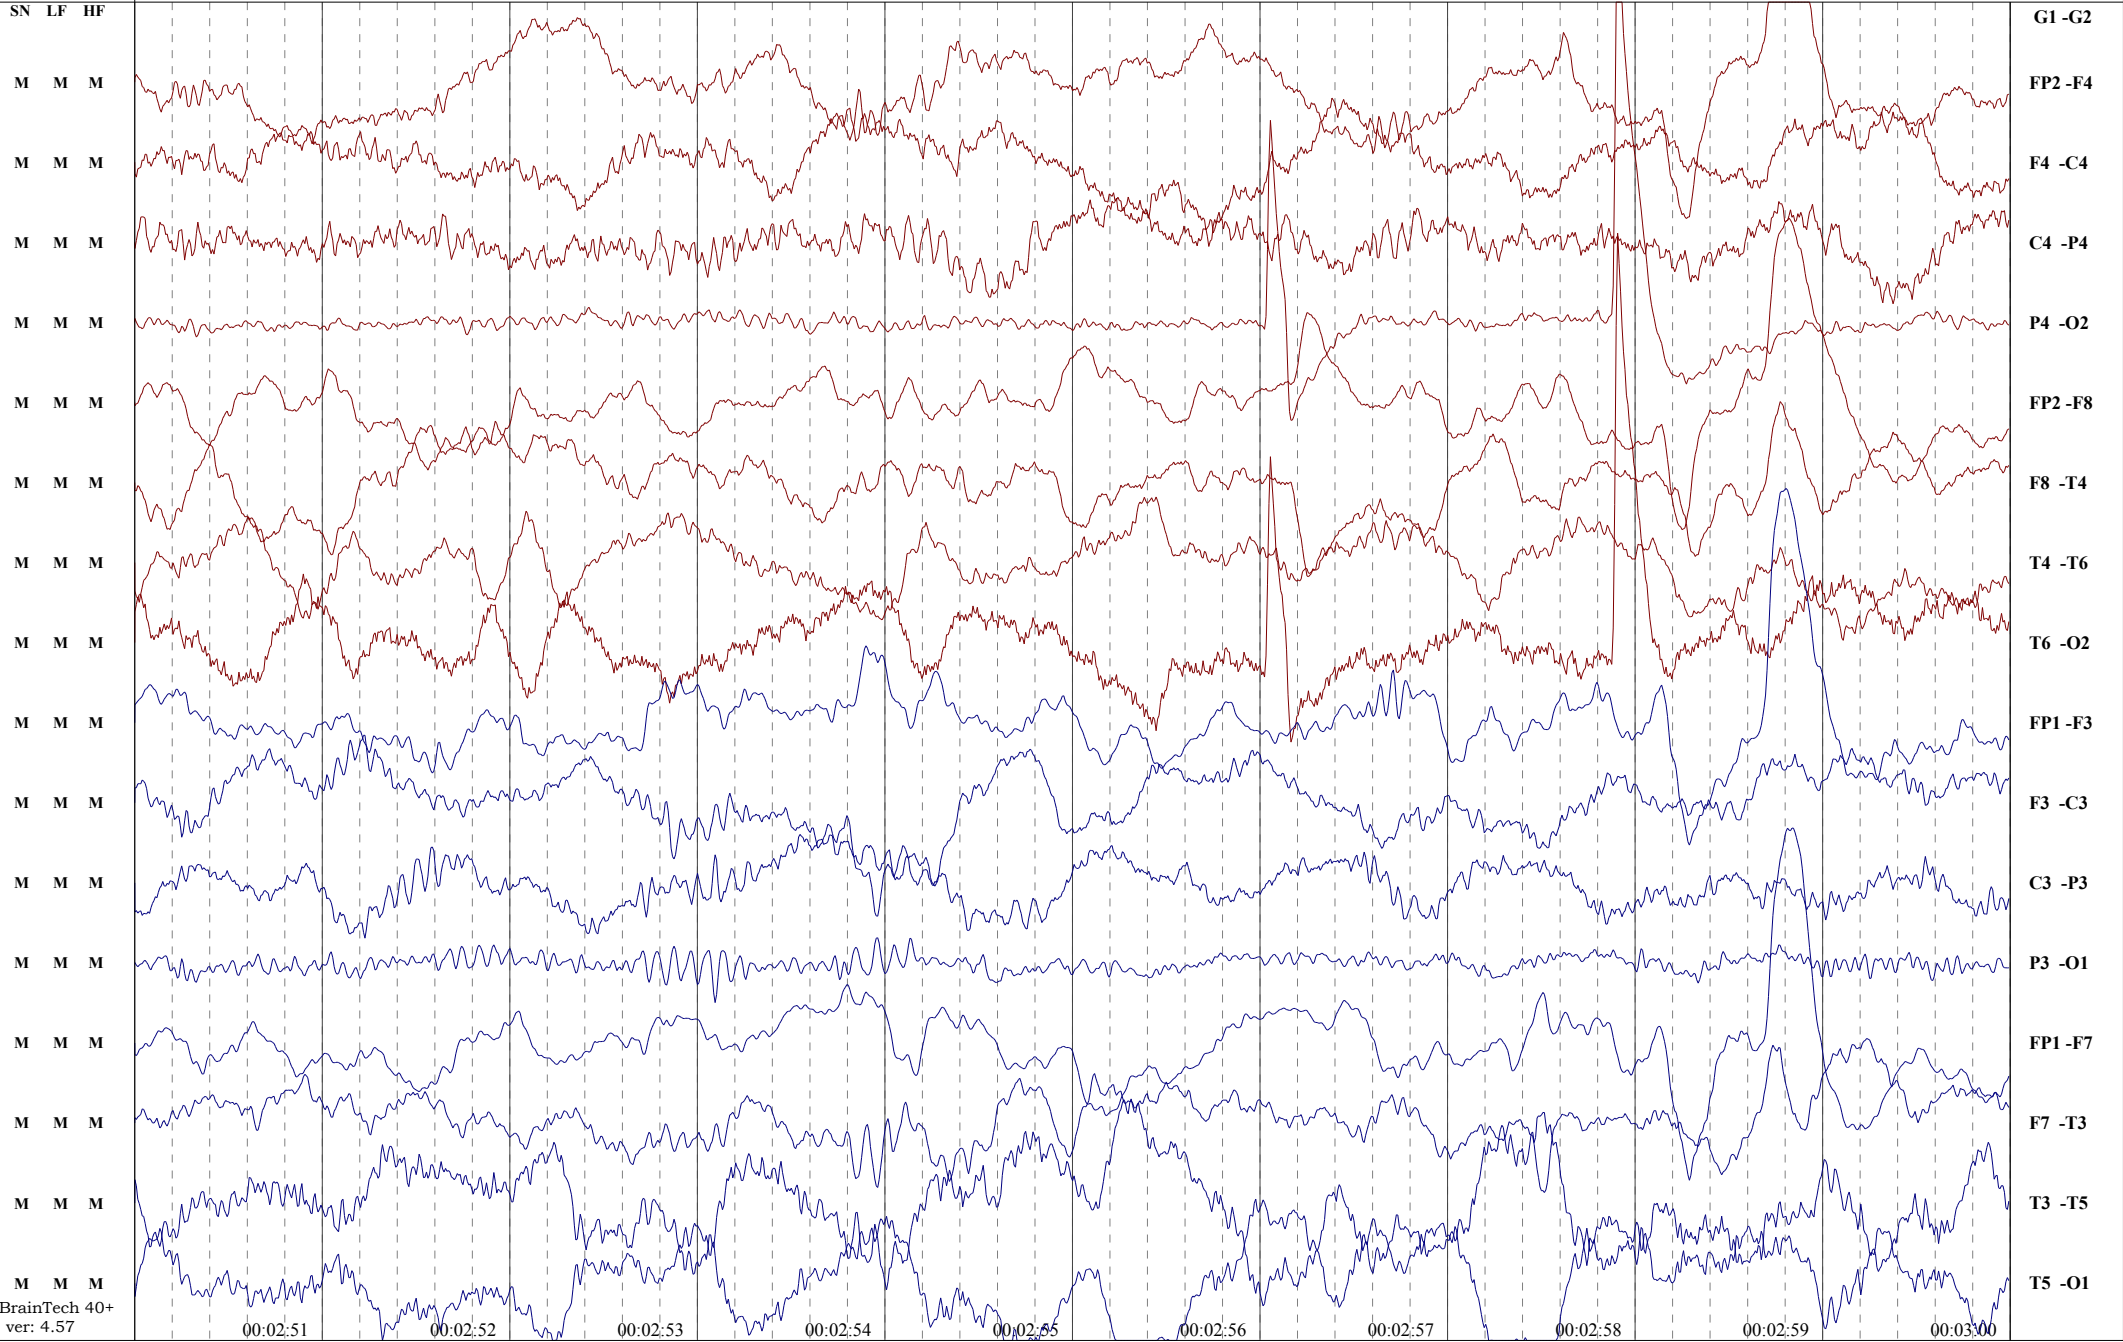


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:23:29
Page:18/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

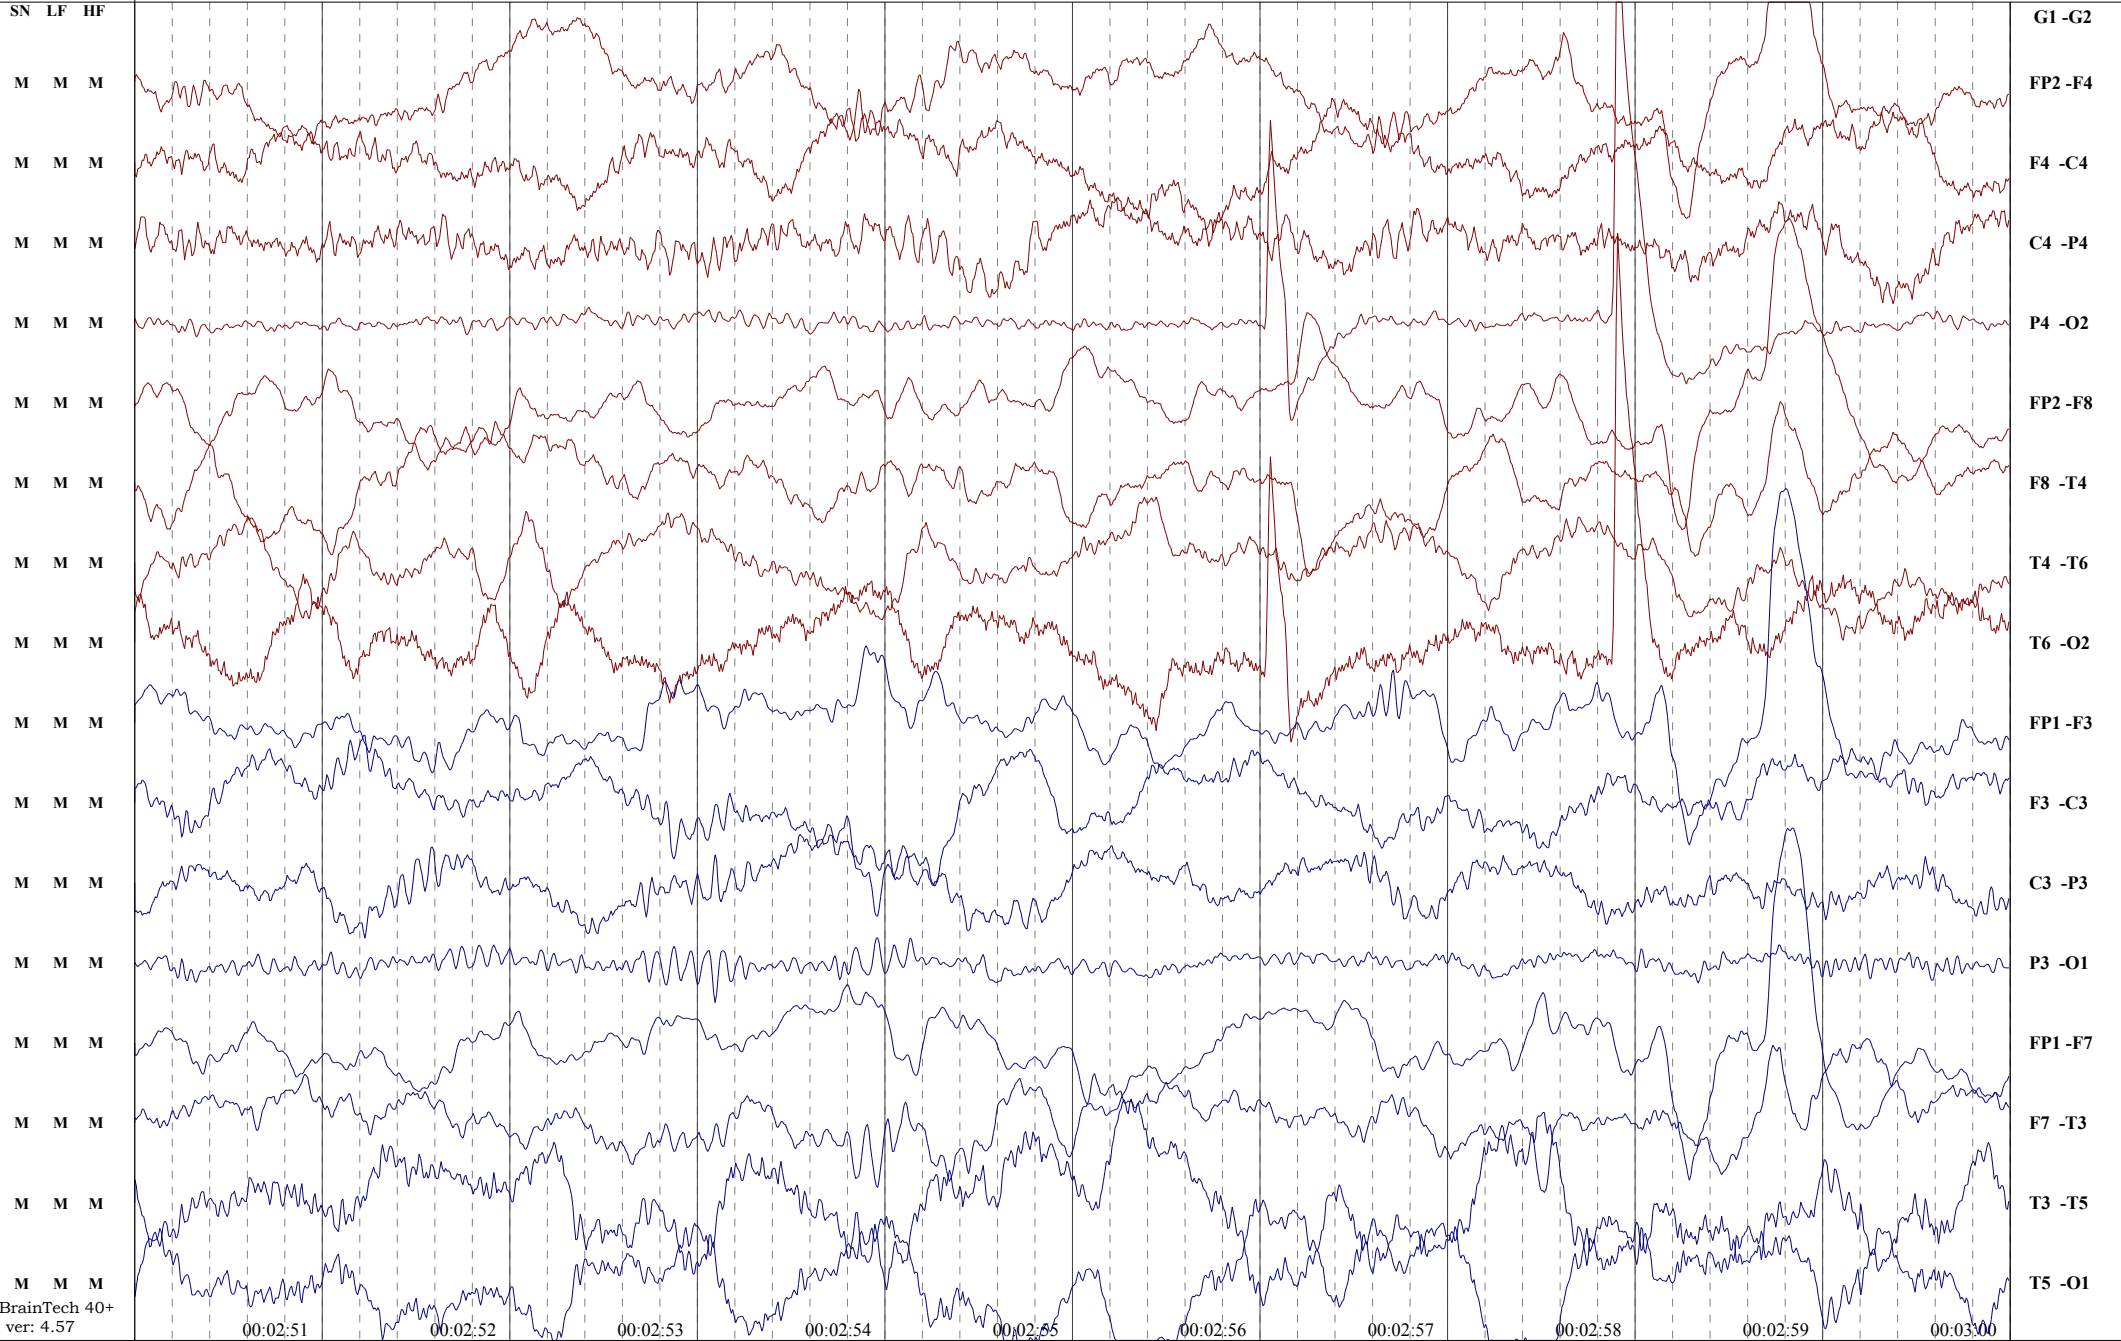


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:23:39
Page:19/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

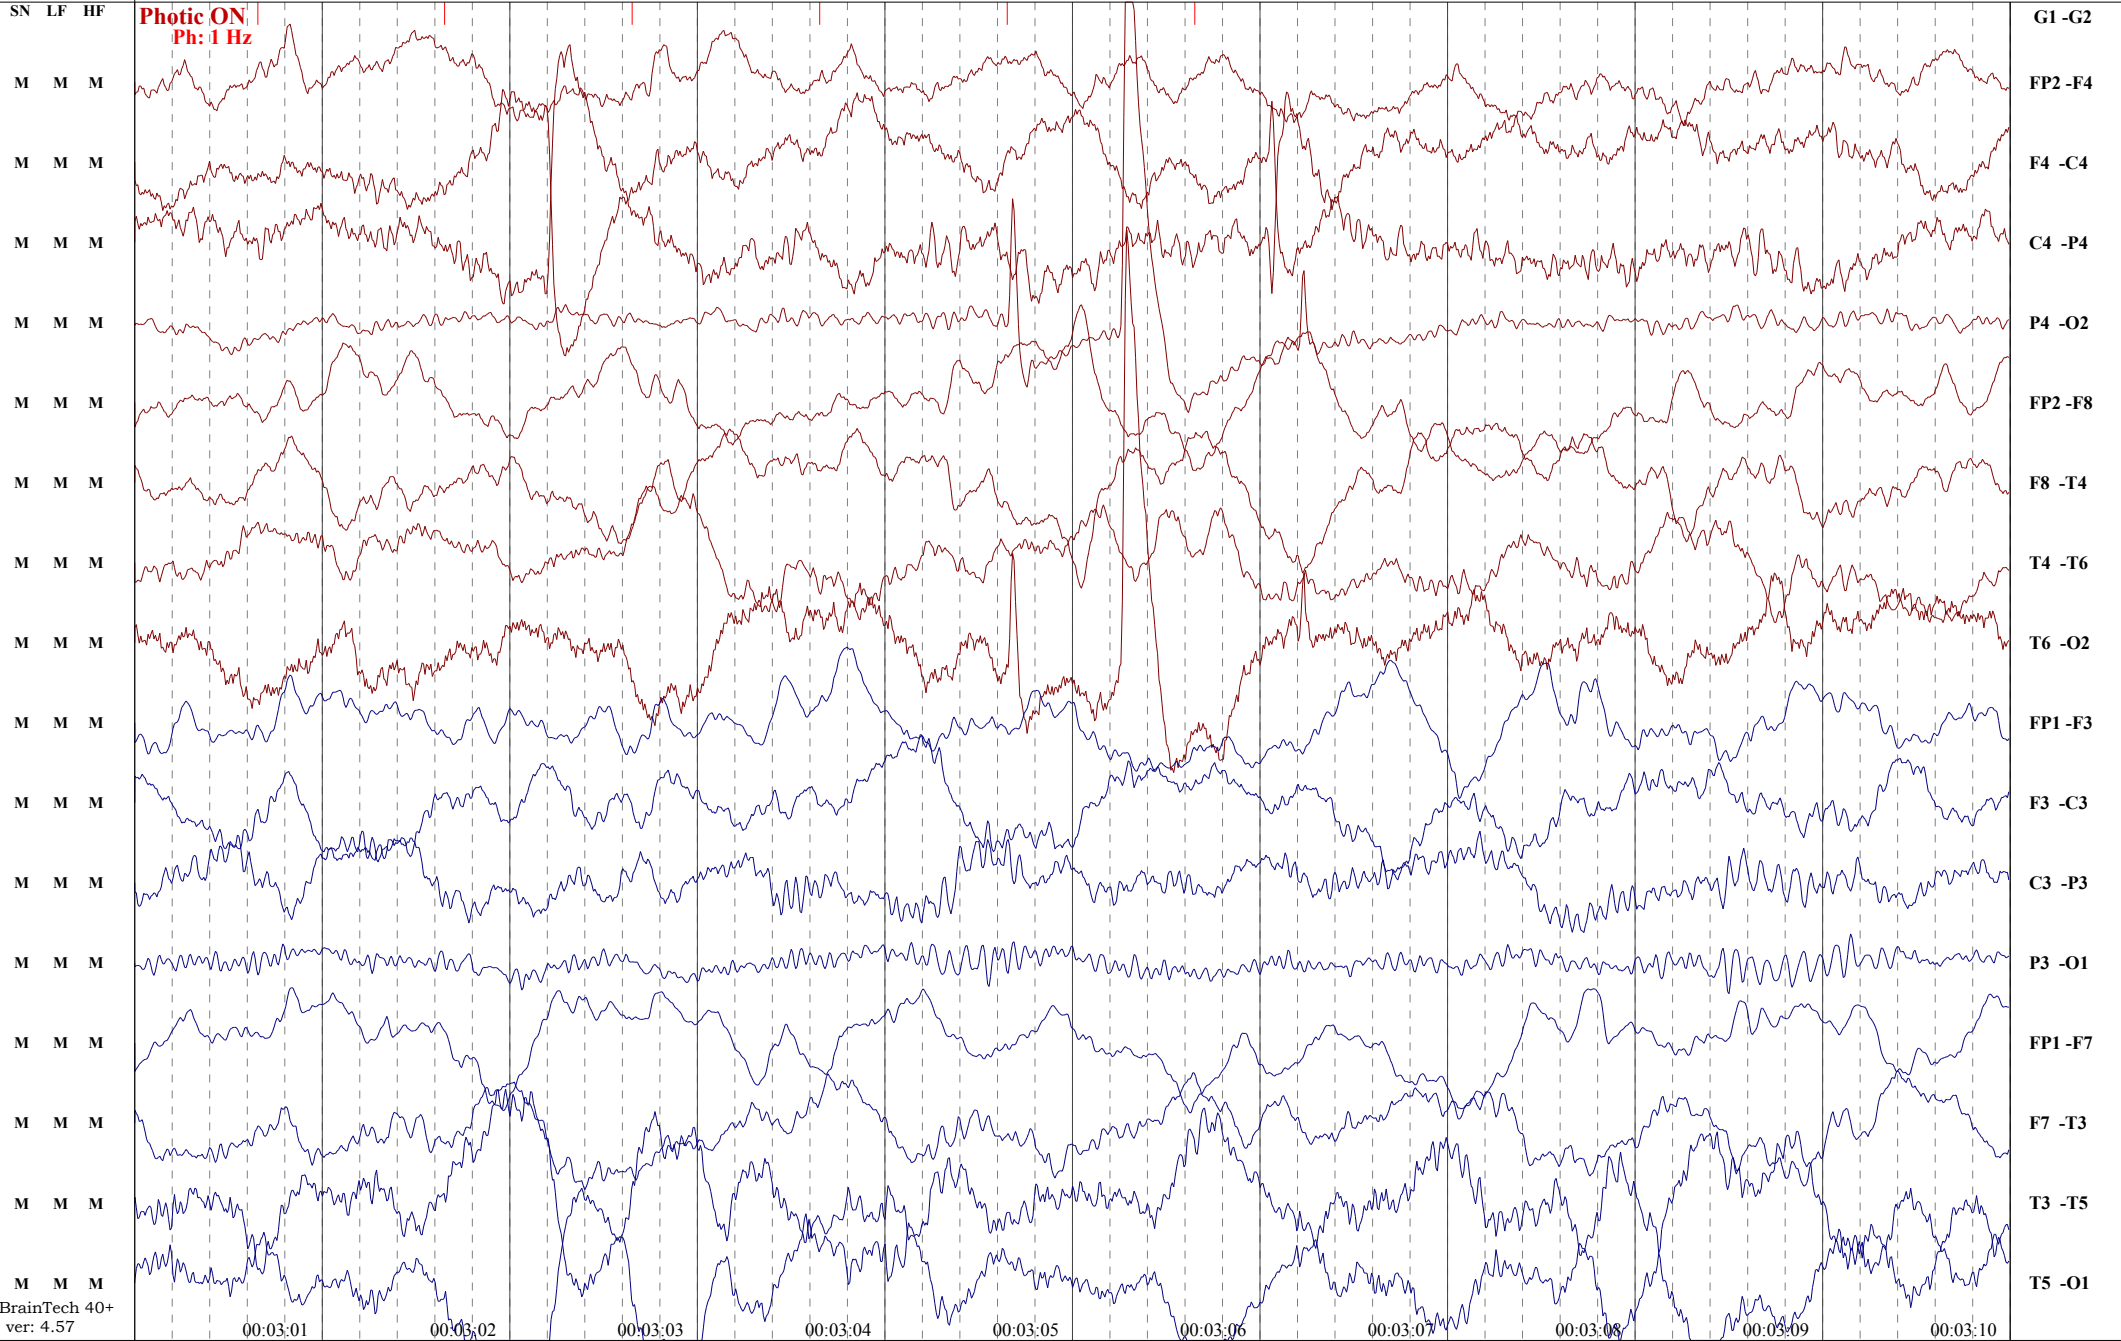


102
MRS BIRASPATI BAI NISHAD
45 Years/F


Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:23:49
Page:20/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

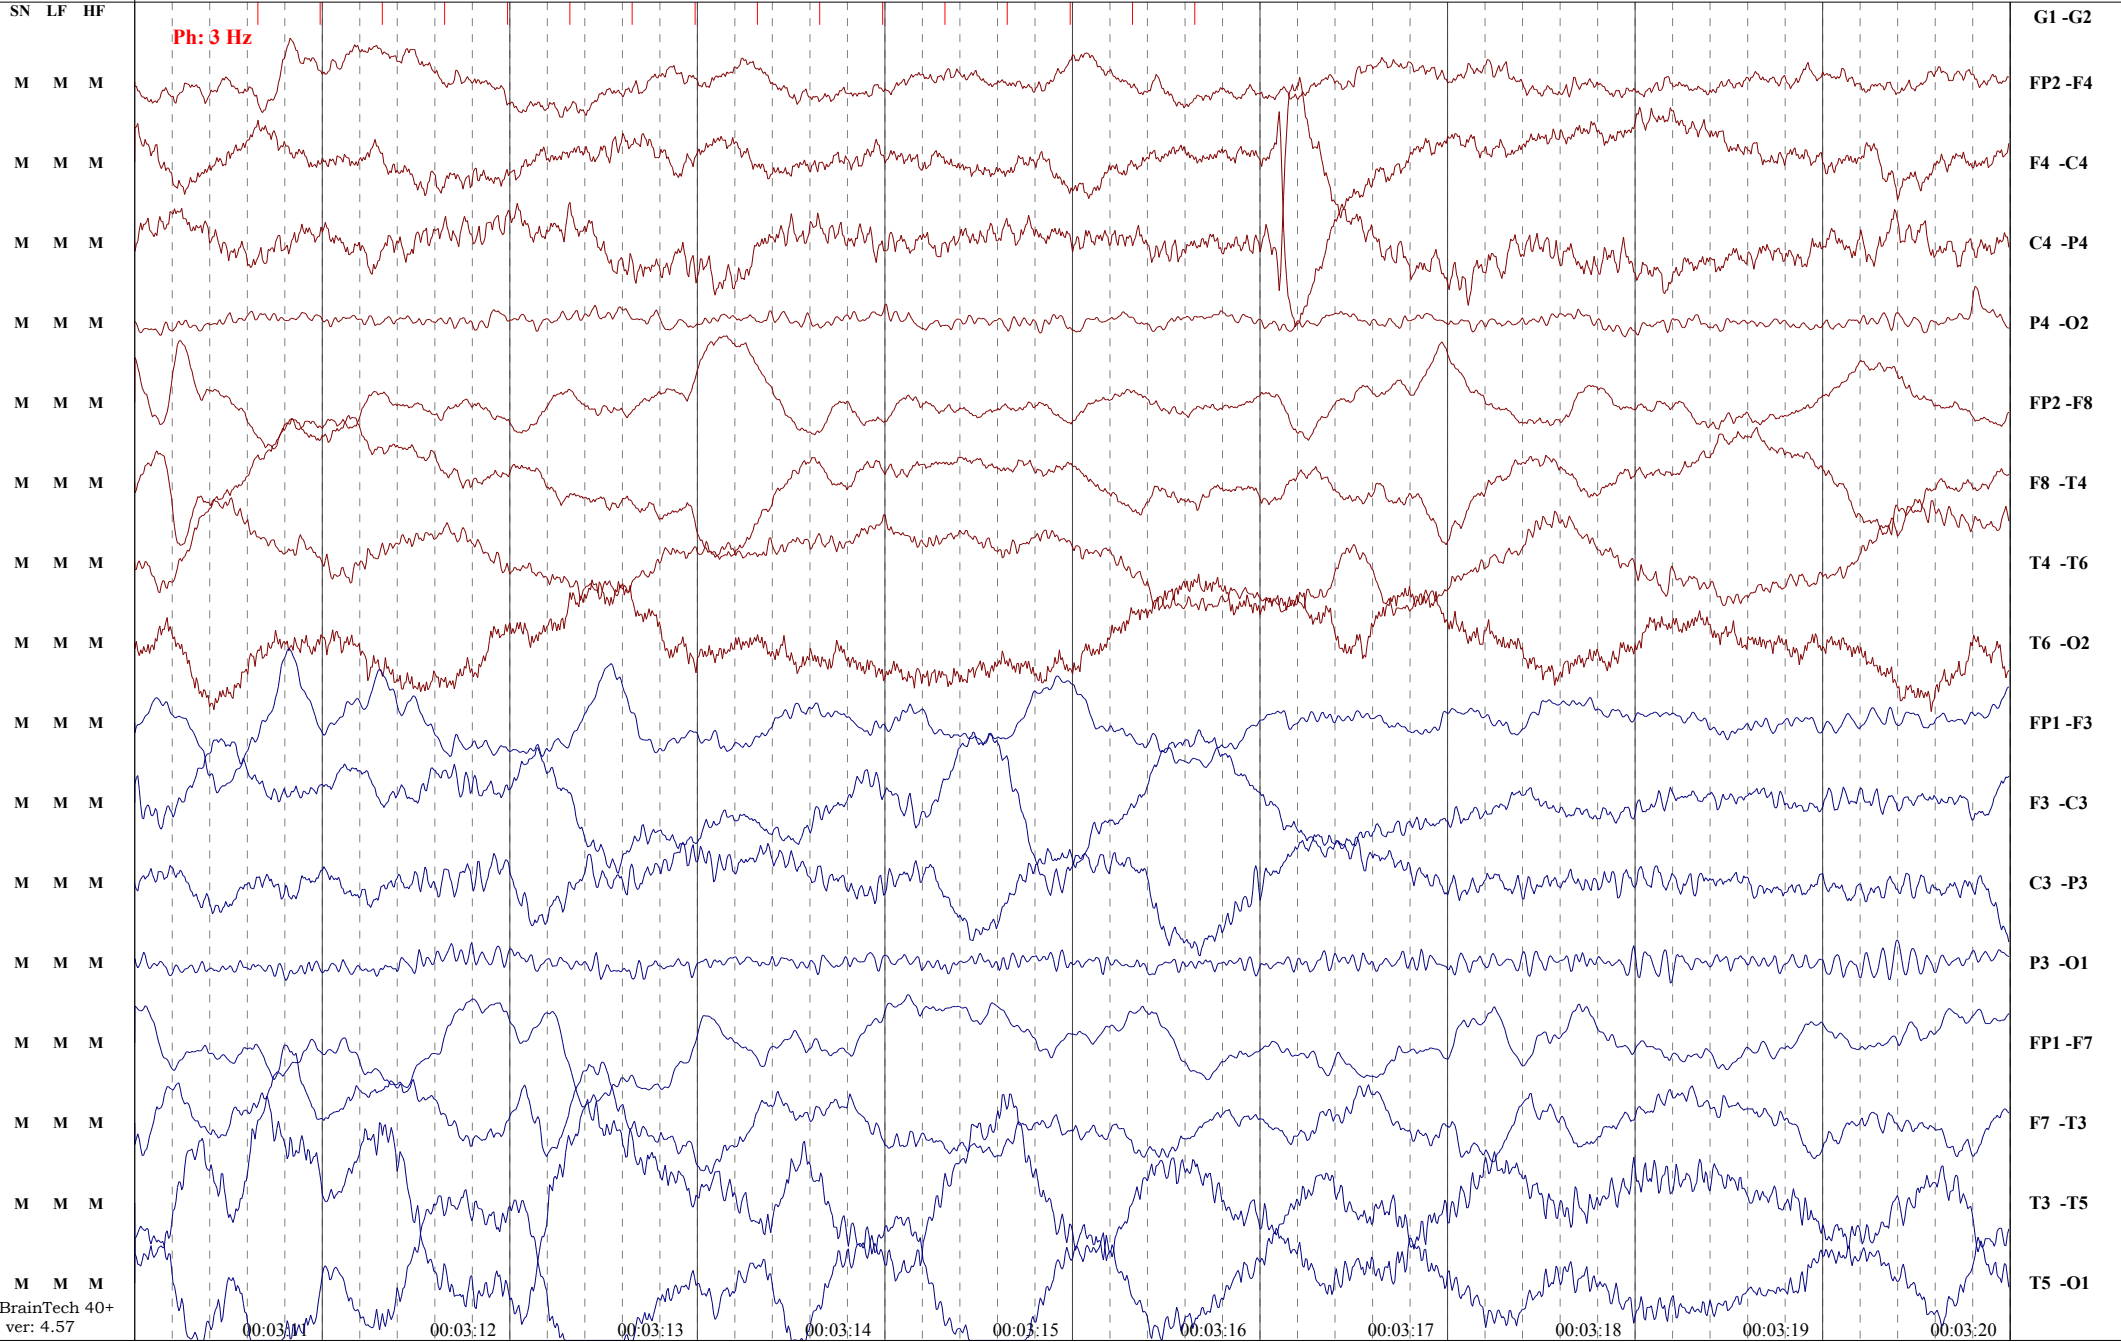

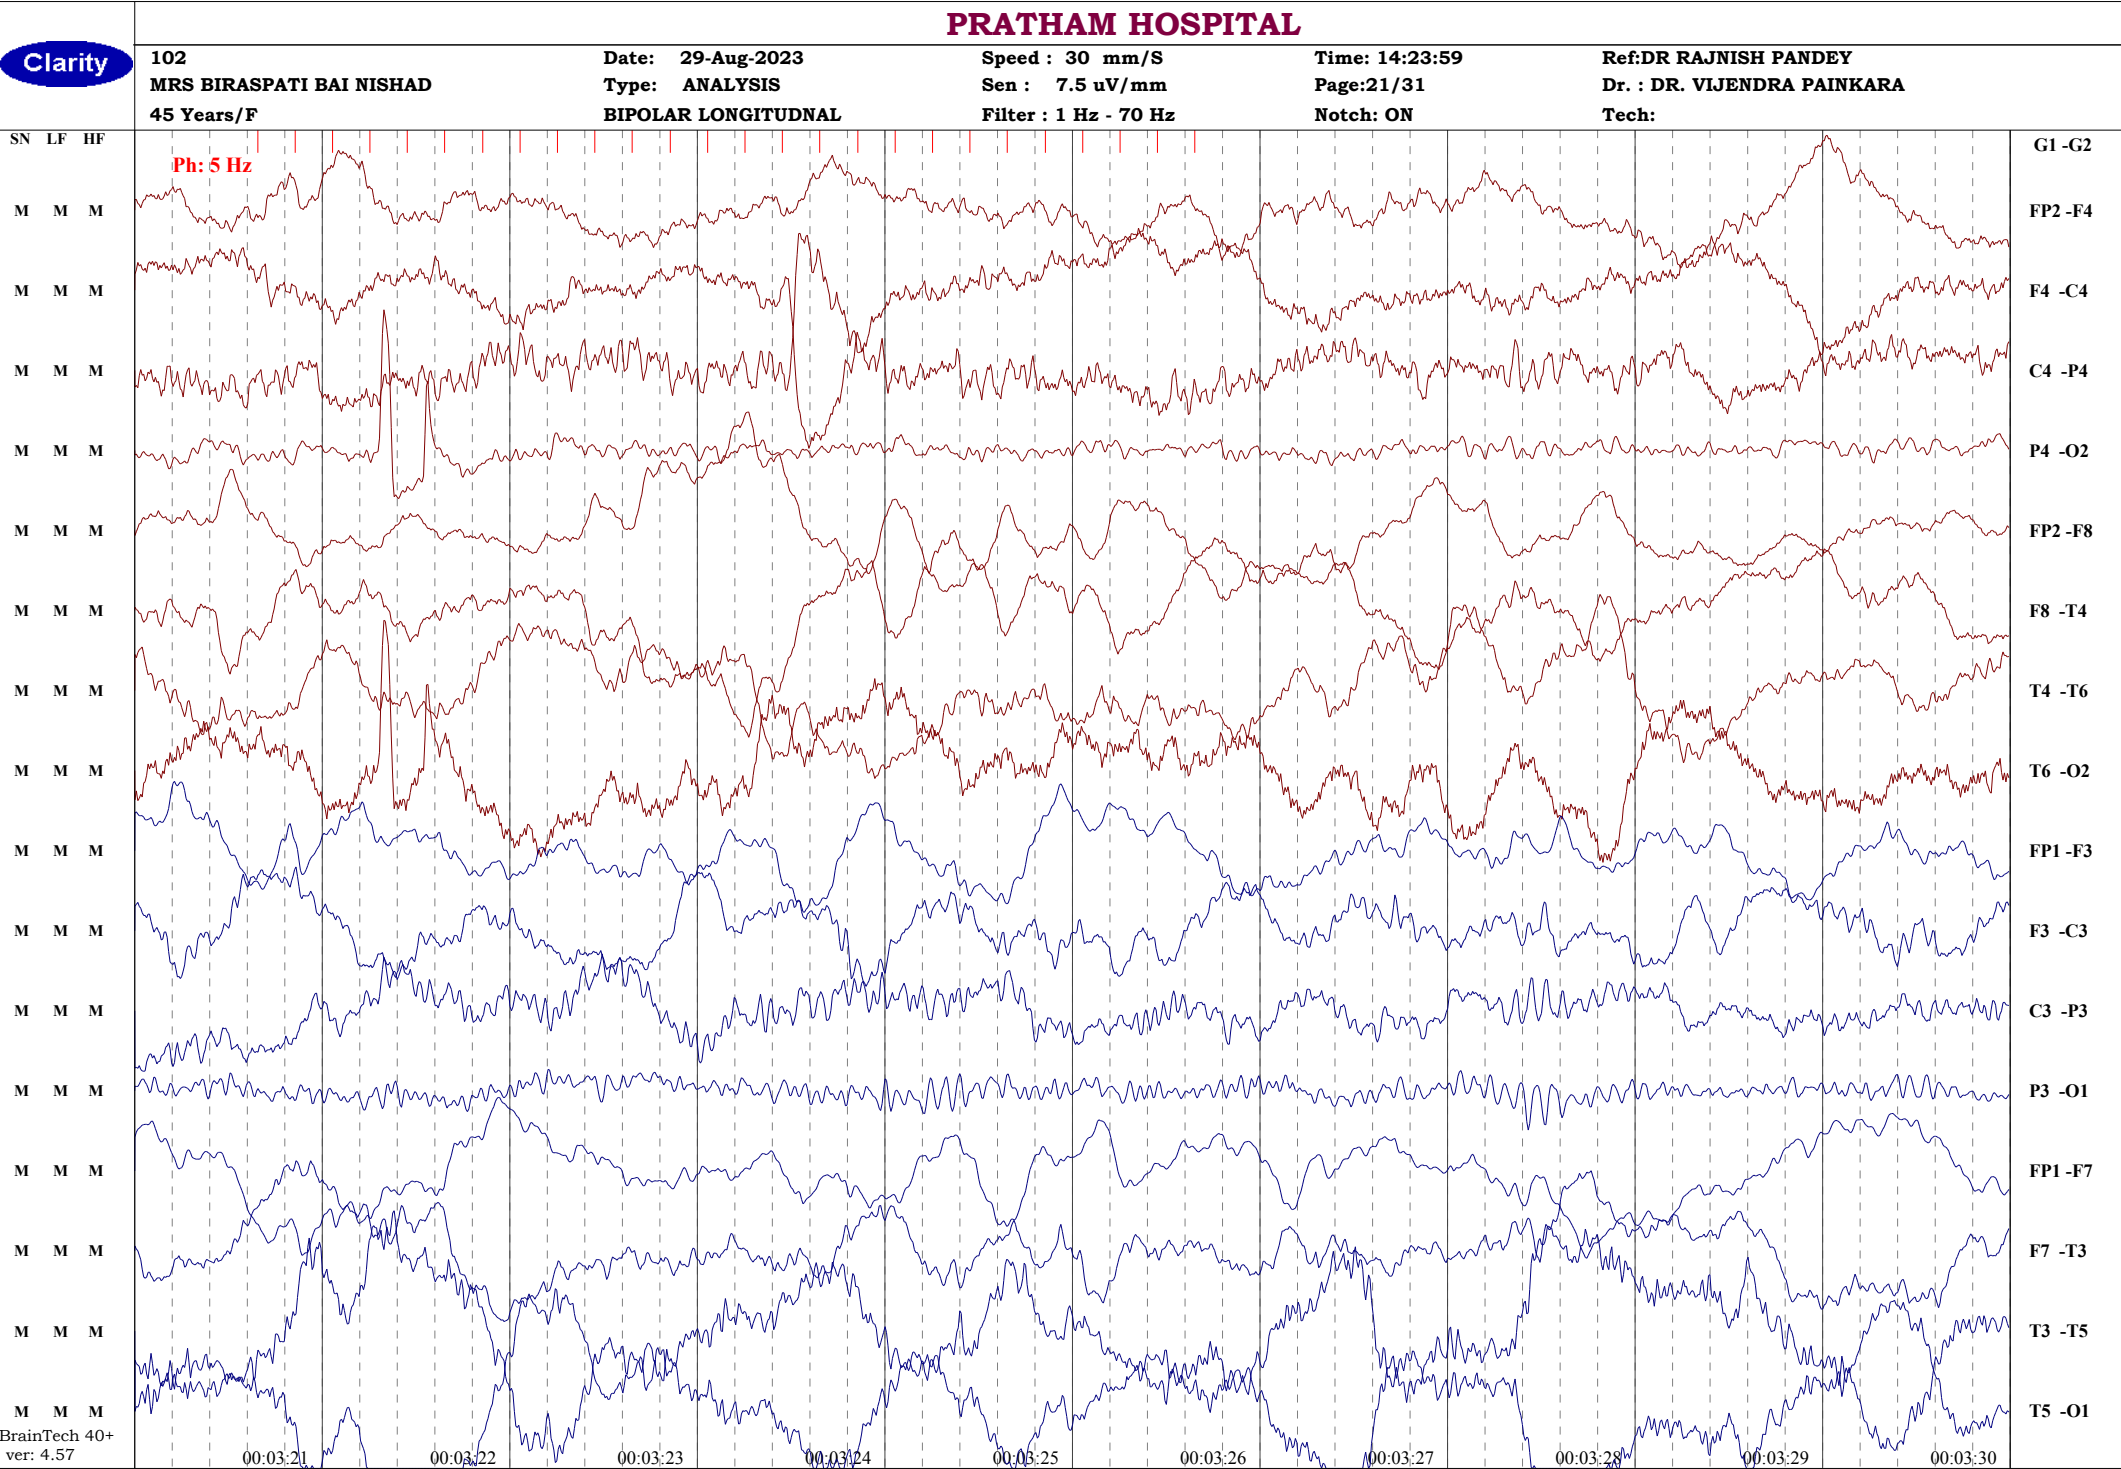


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:24:09
Page:22/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

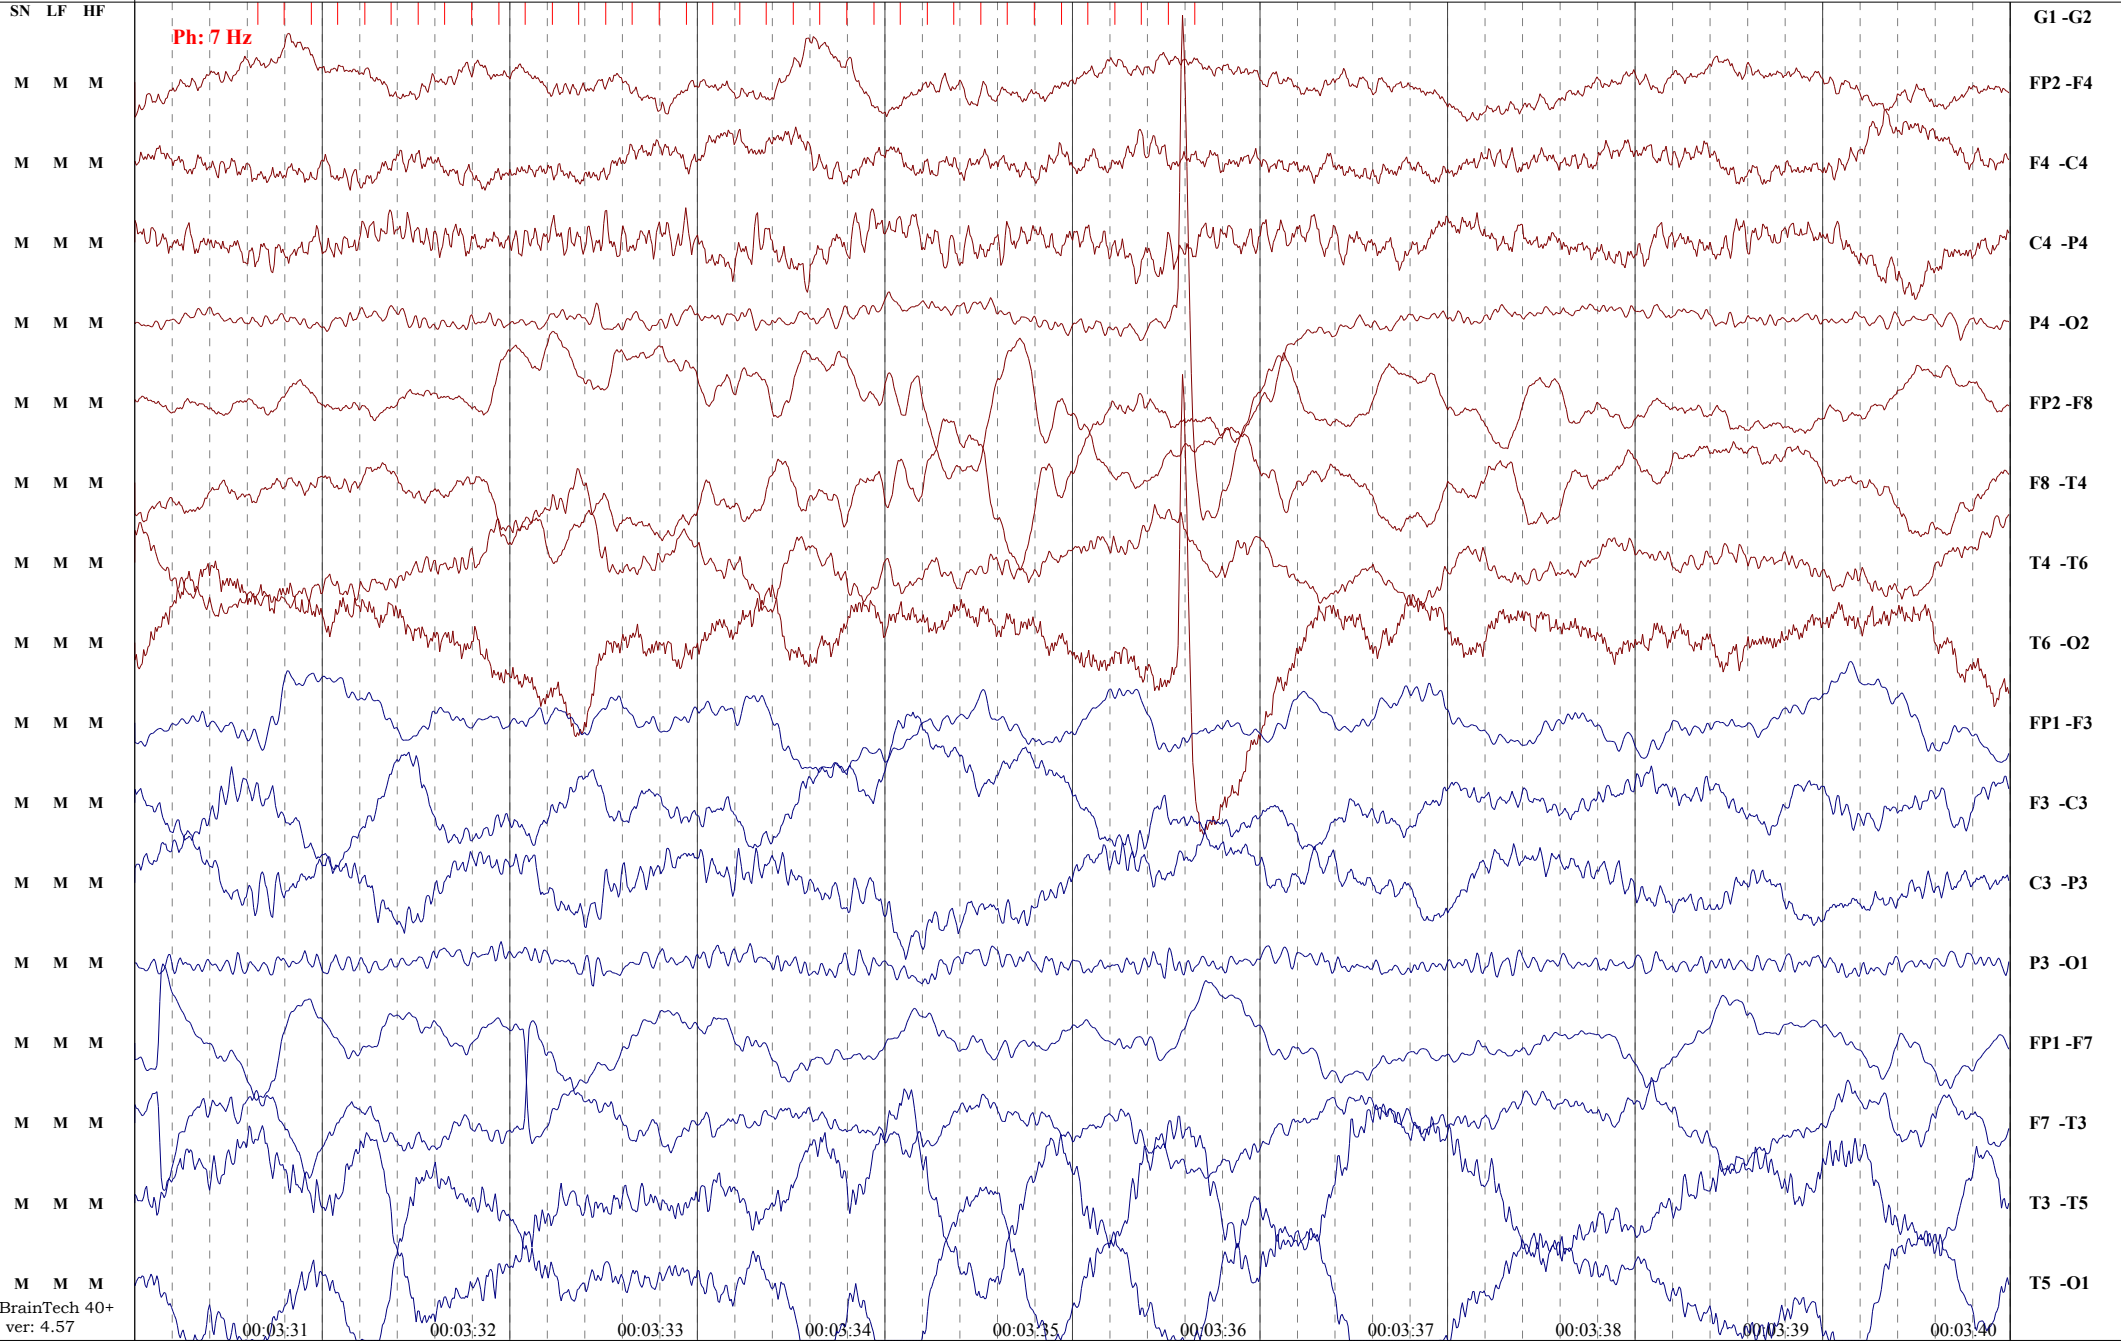


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:24:39
Page:25/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

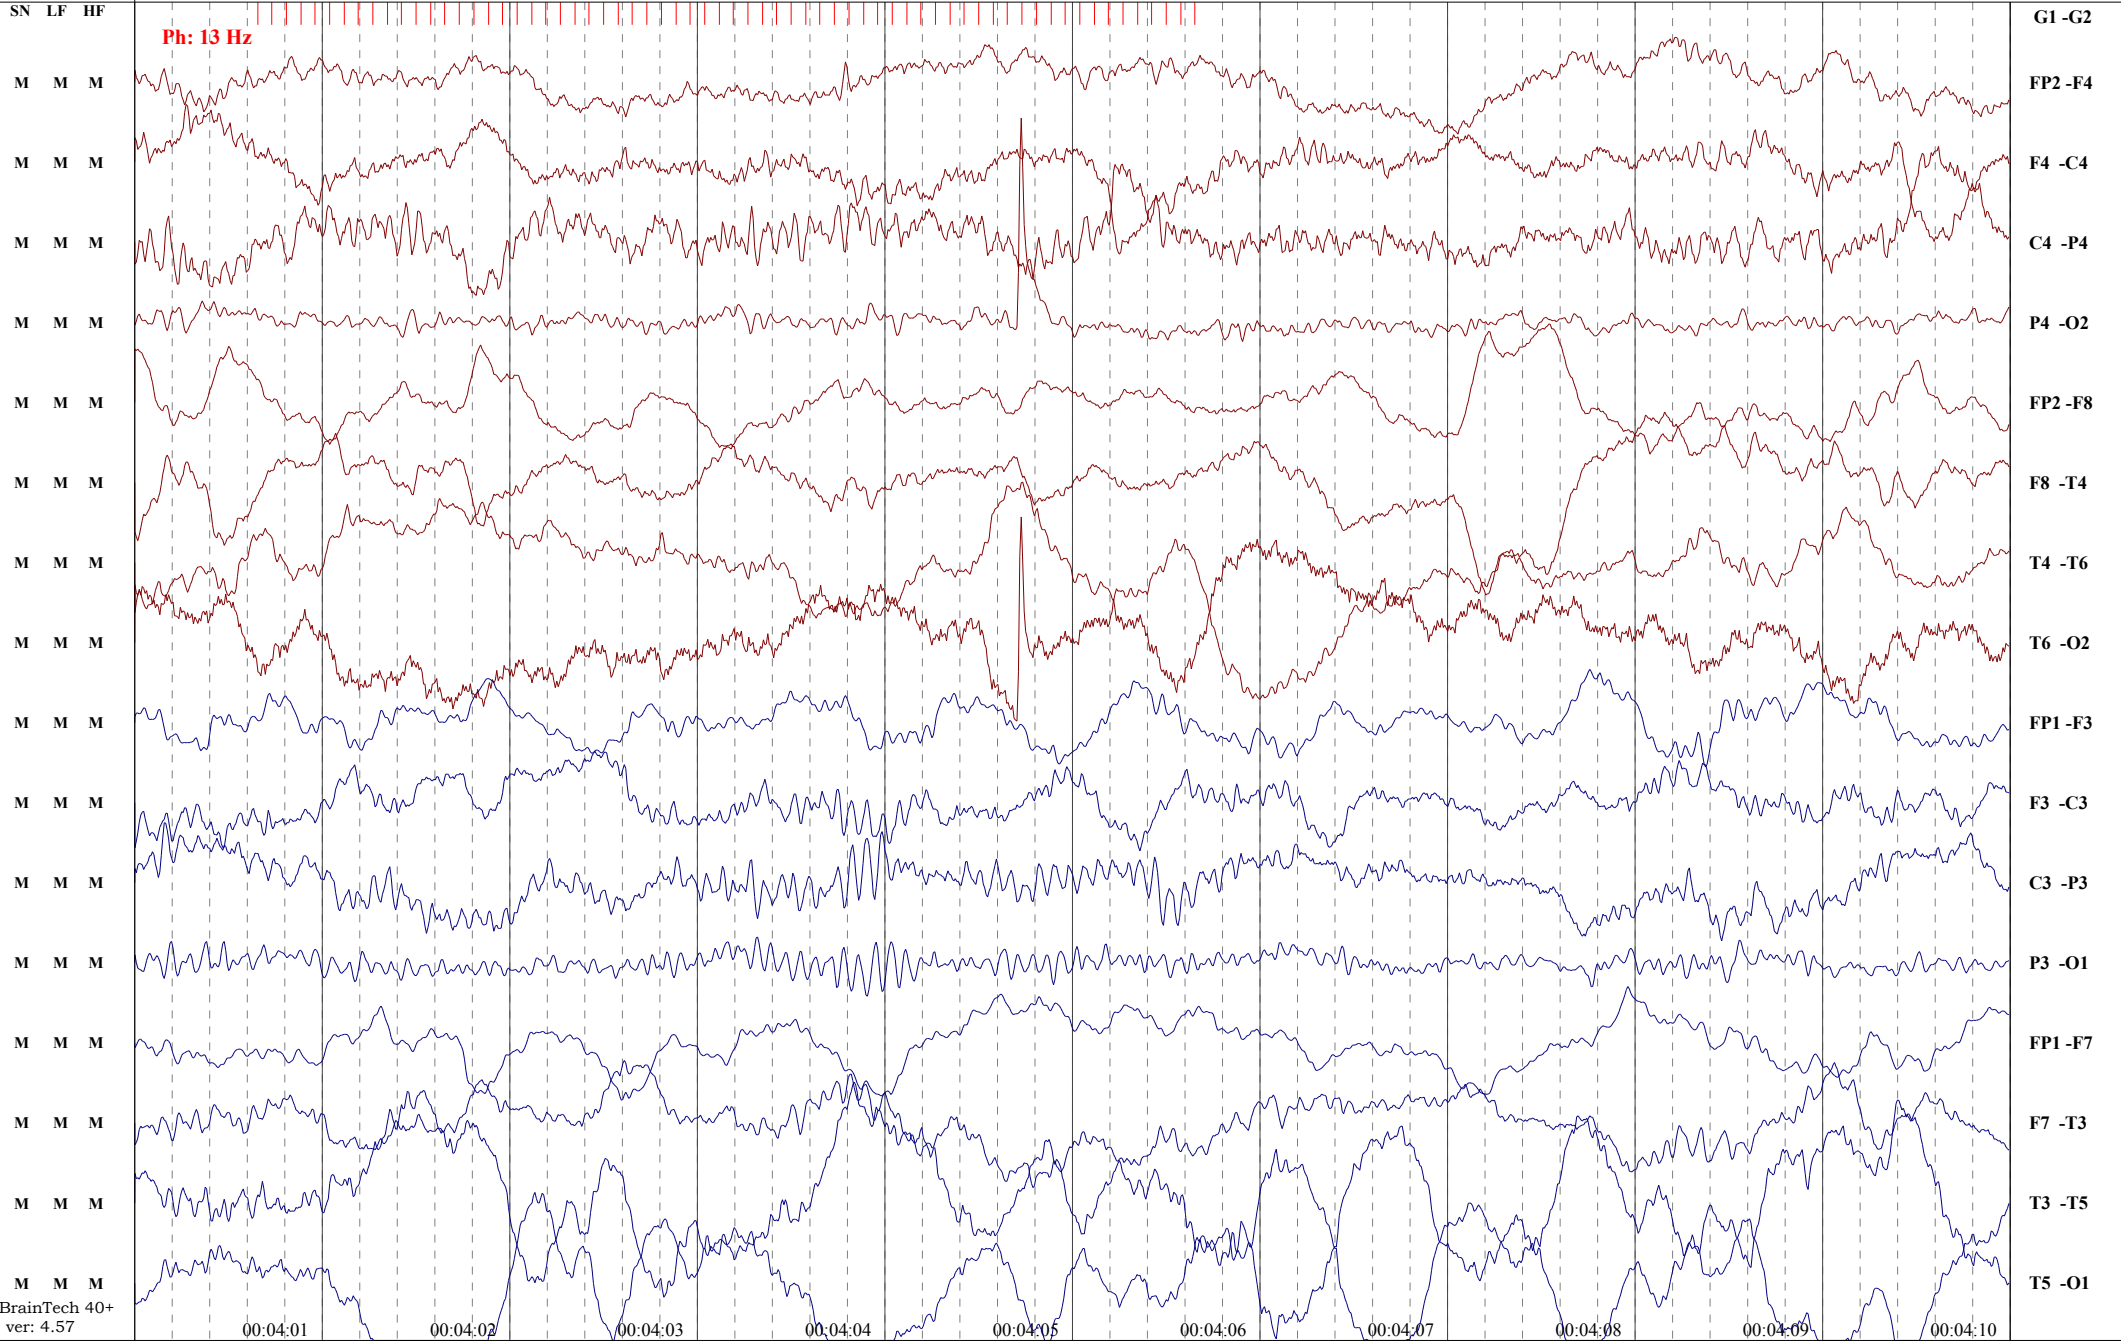


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:24:49
Page:26/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

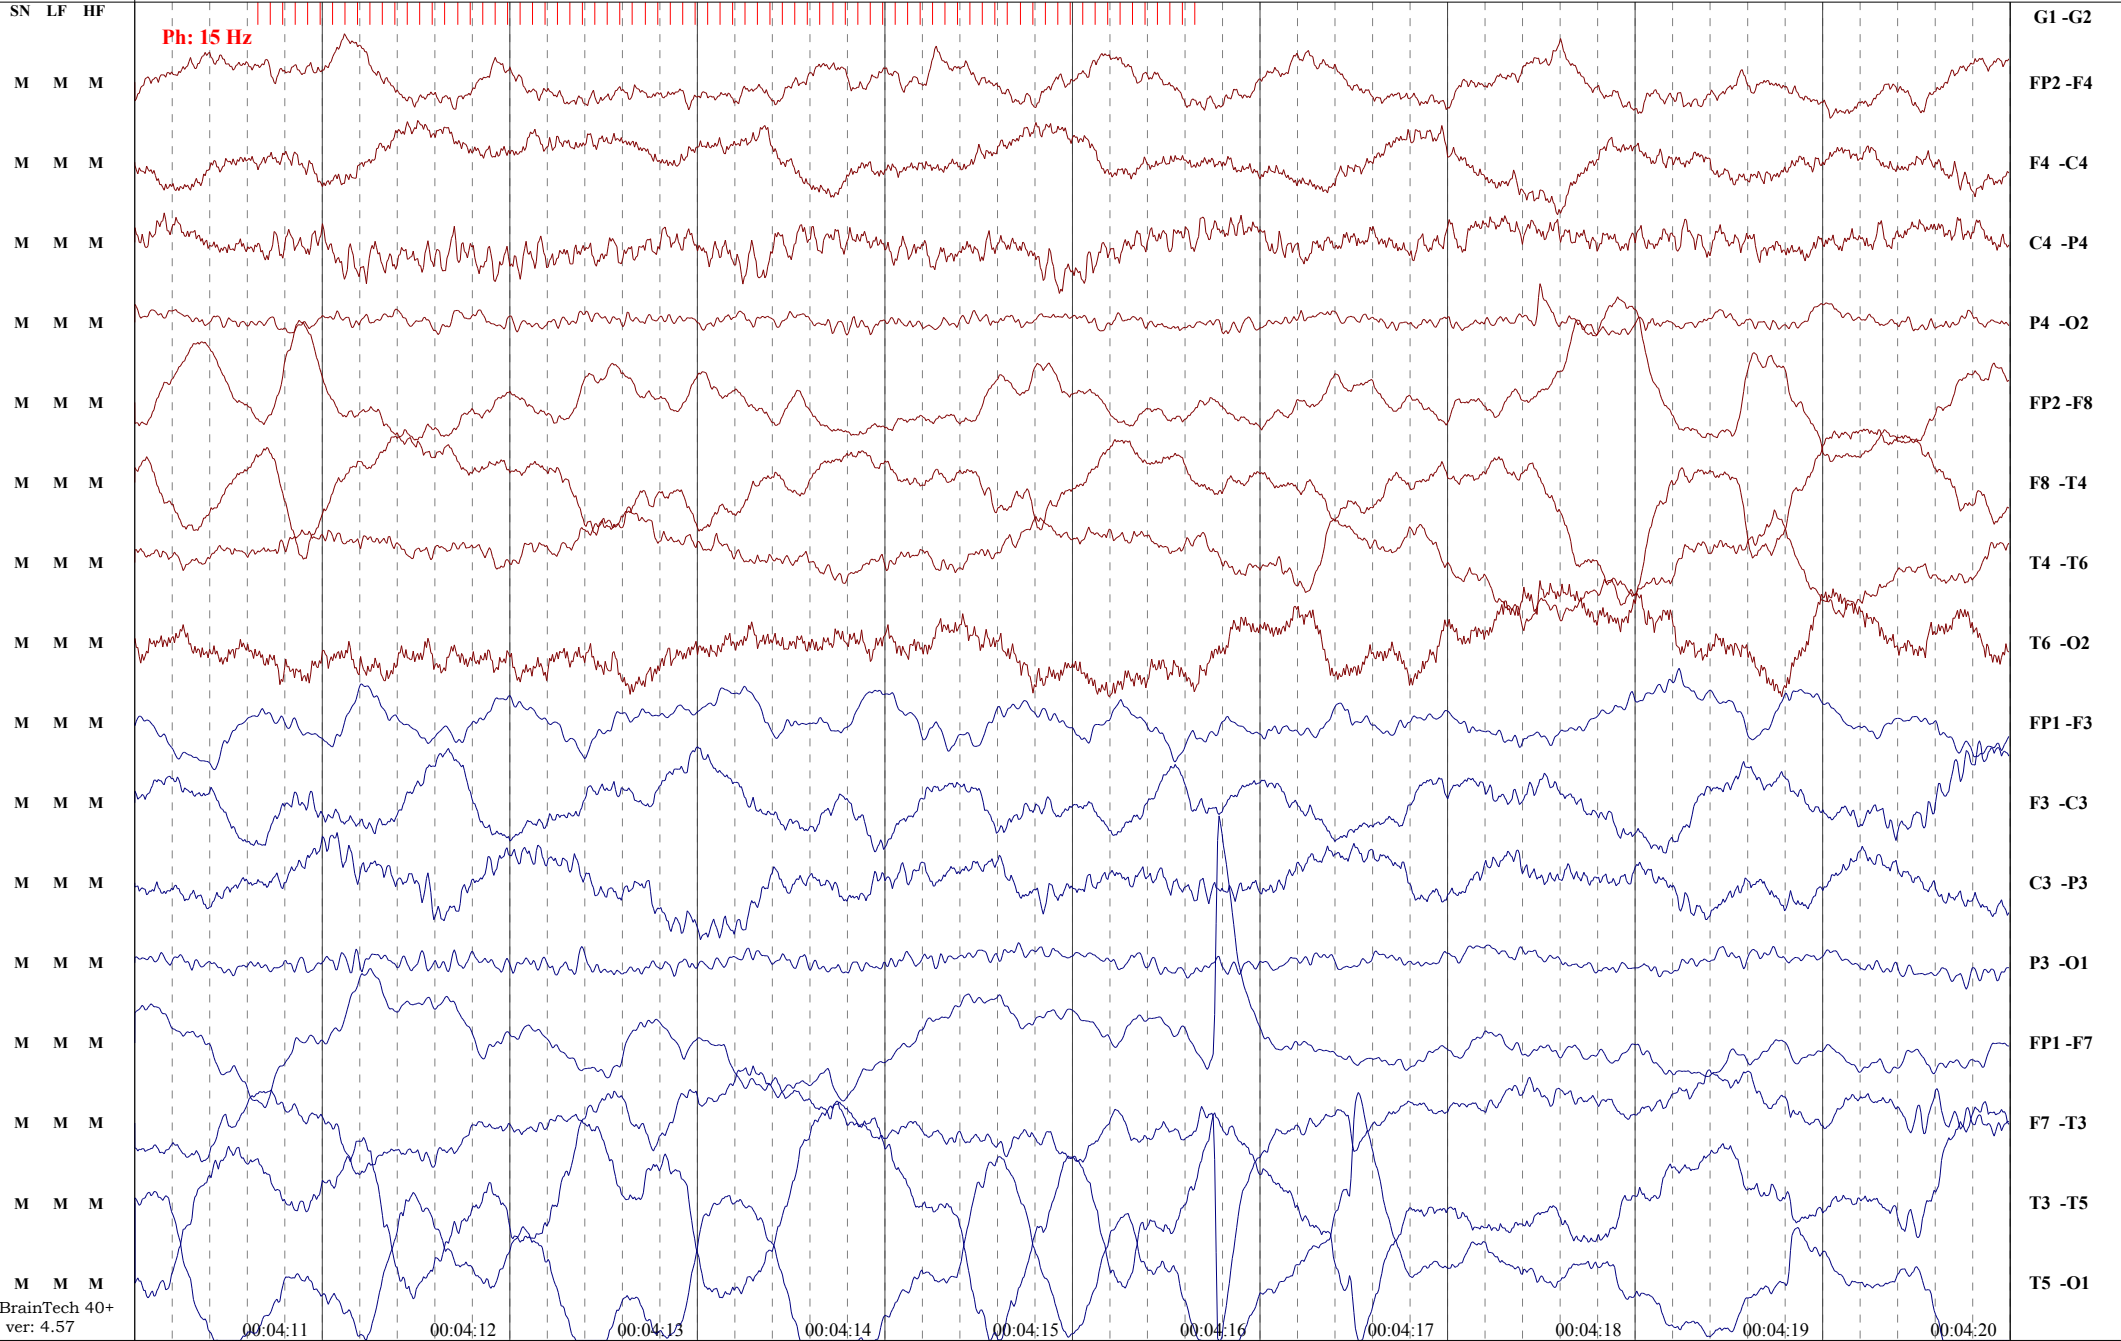


102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:25:19
Page:29/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

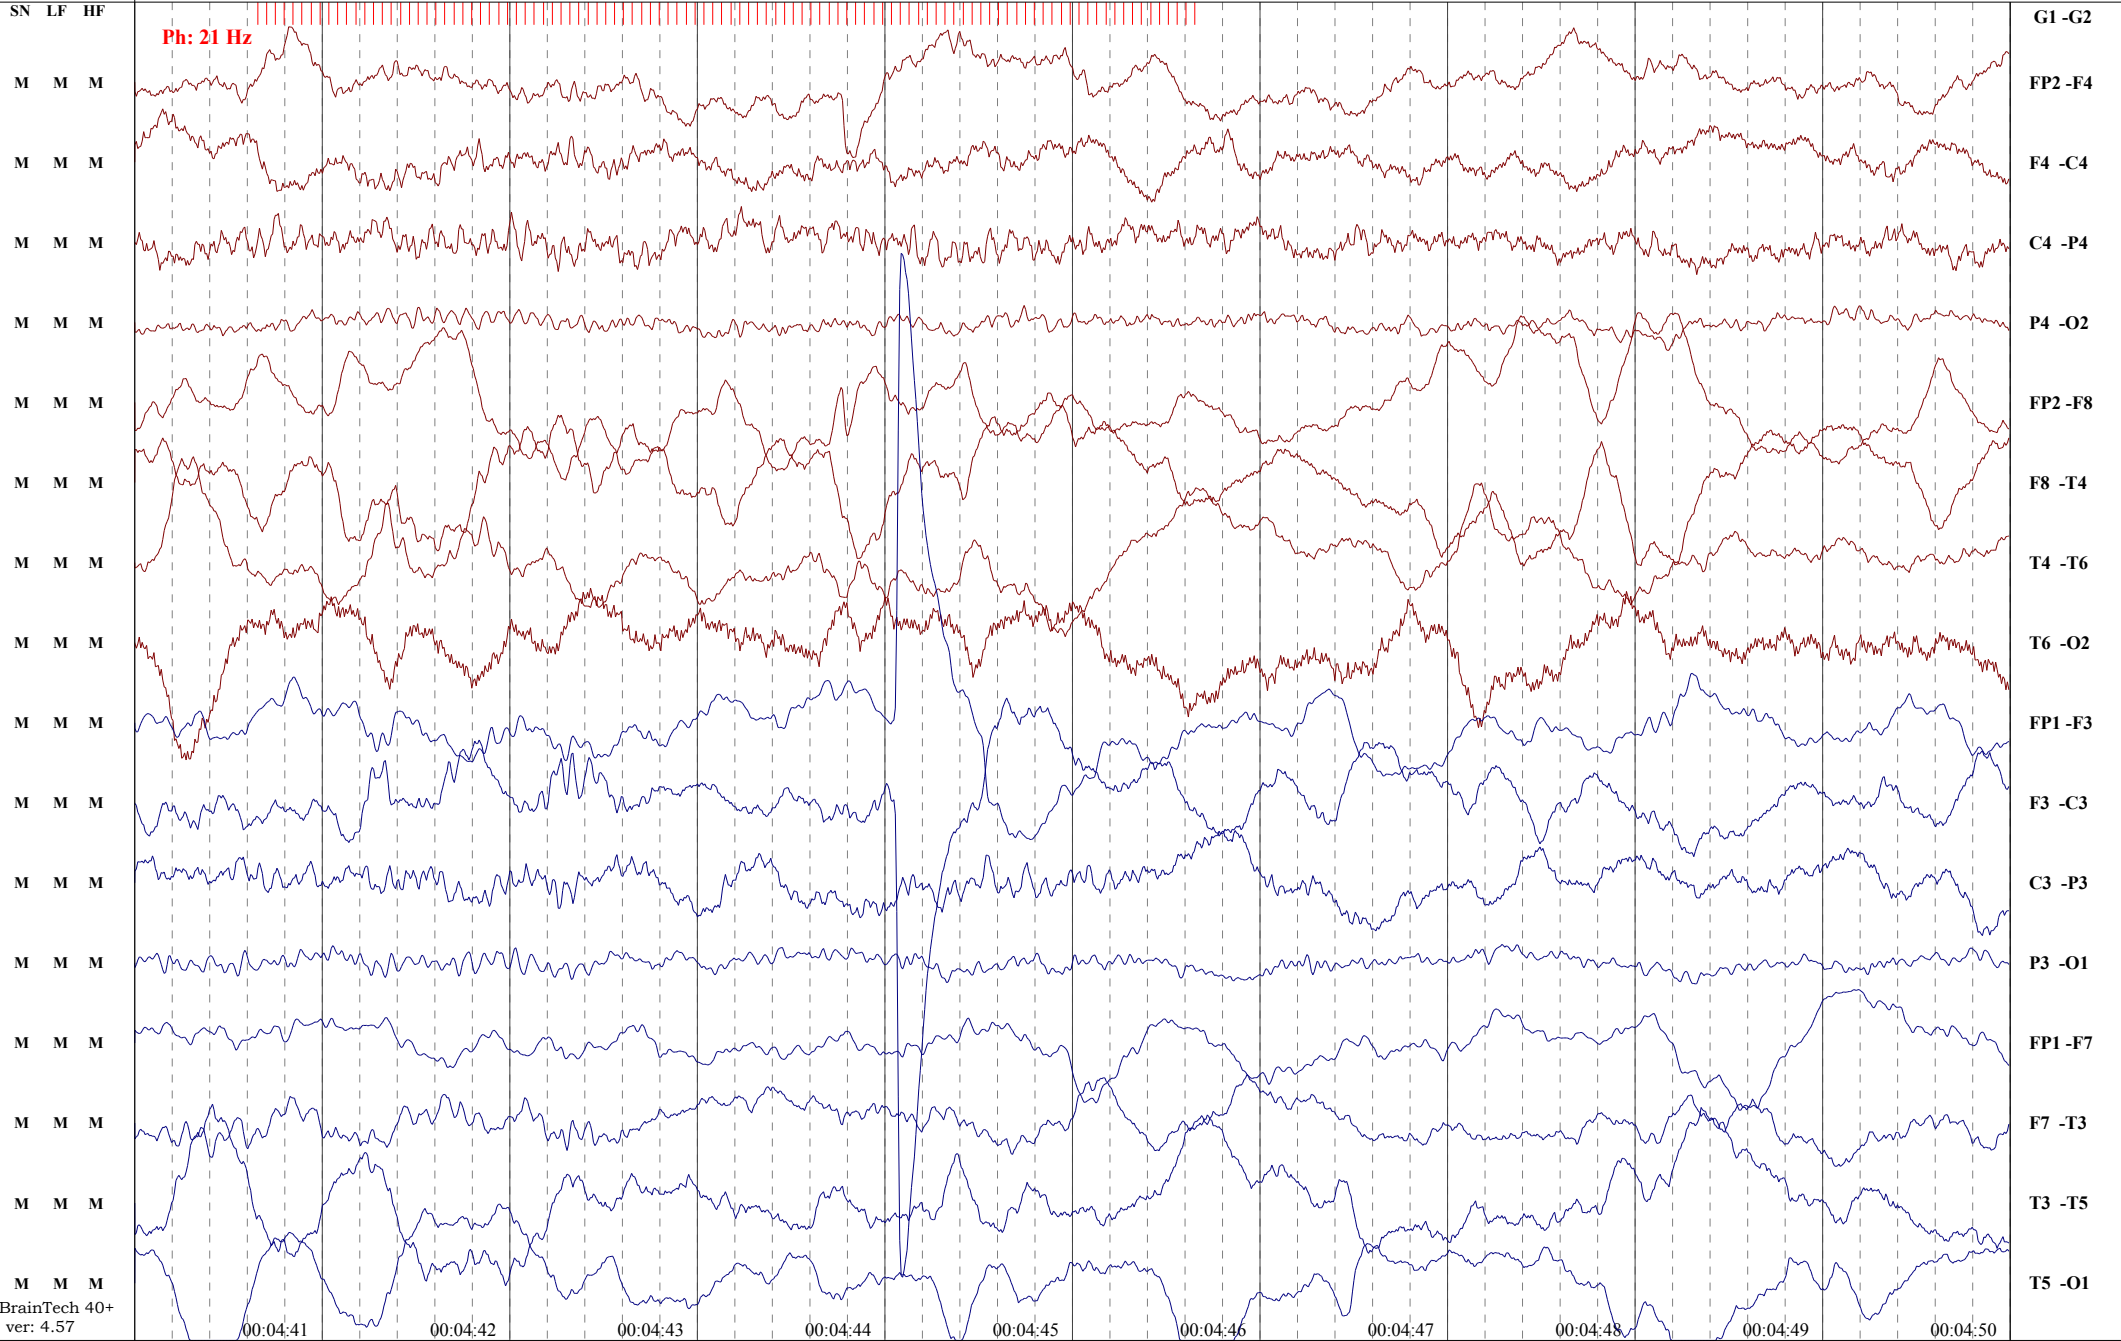

102
MRS BIRASPATI BAI NISHAD
45 Years/F

Date: 29-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:25:29
Page:30/31
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

