


74
MRS. SHABNAM BEGAM
48 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL


Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz


Time: 13:55:04
Page:10/35
Notch: ON


Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

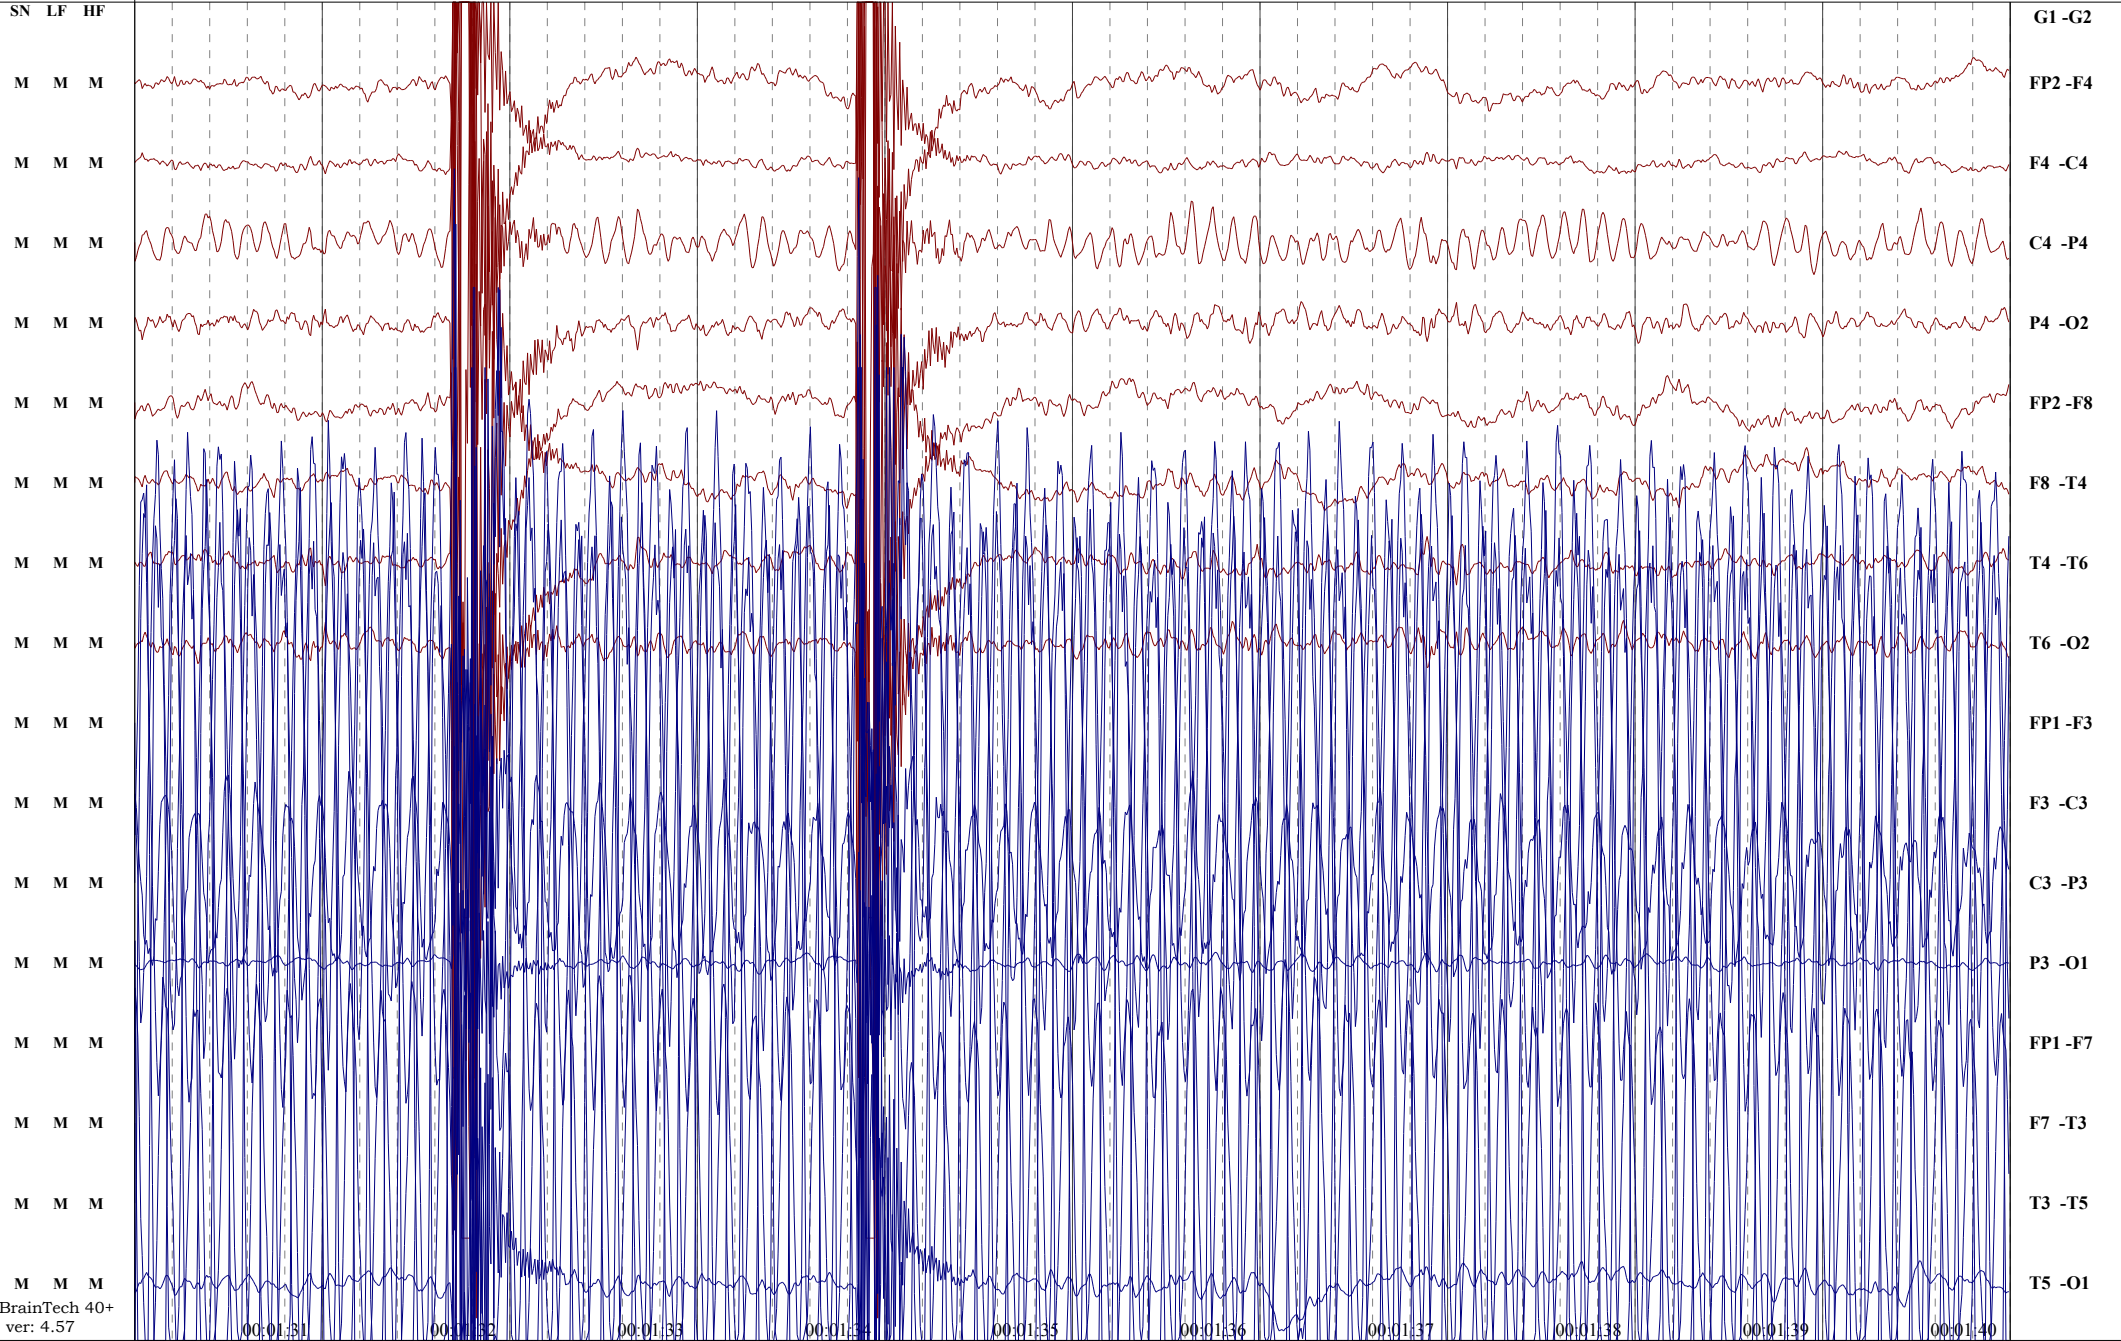

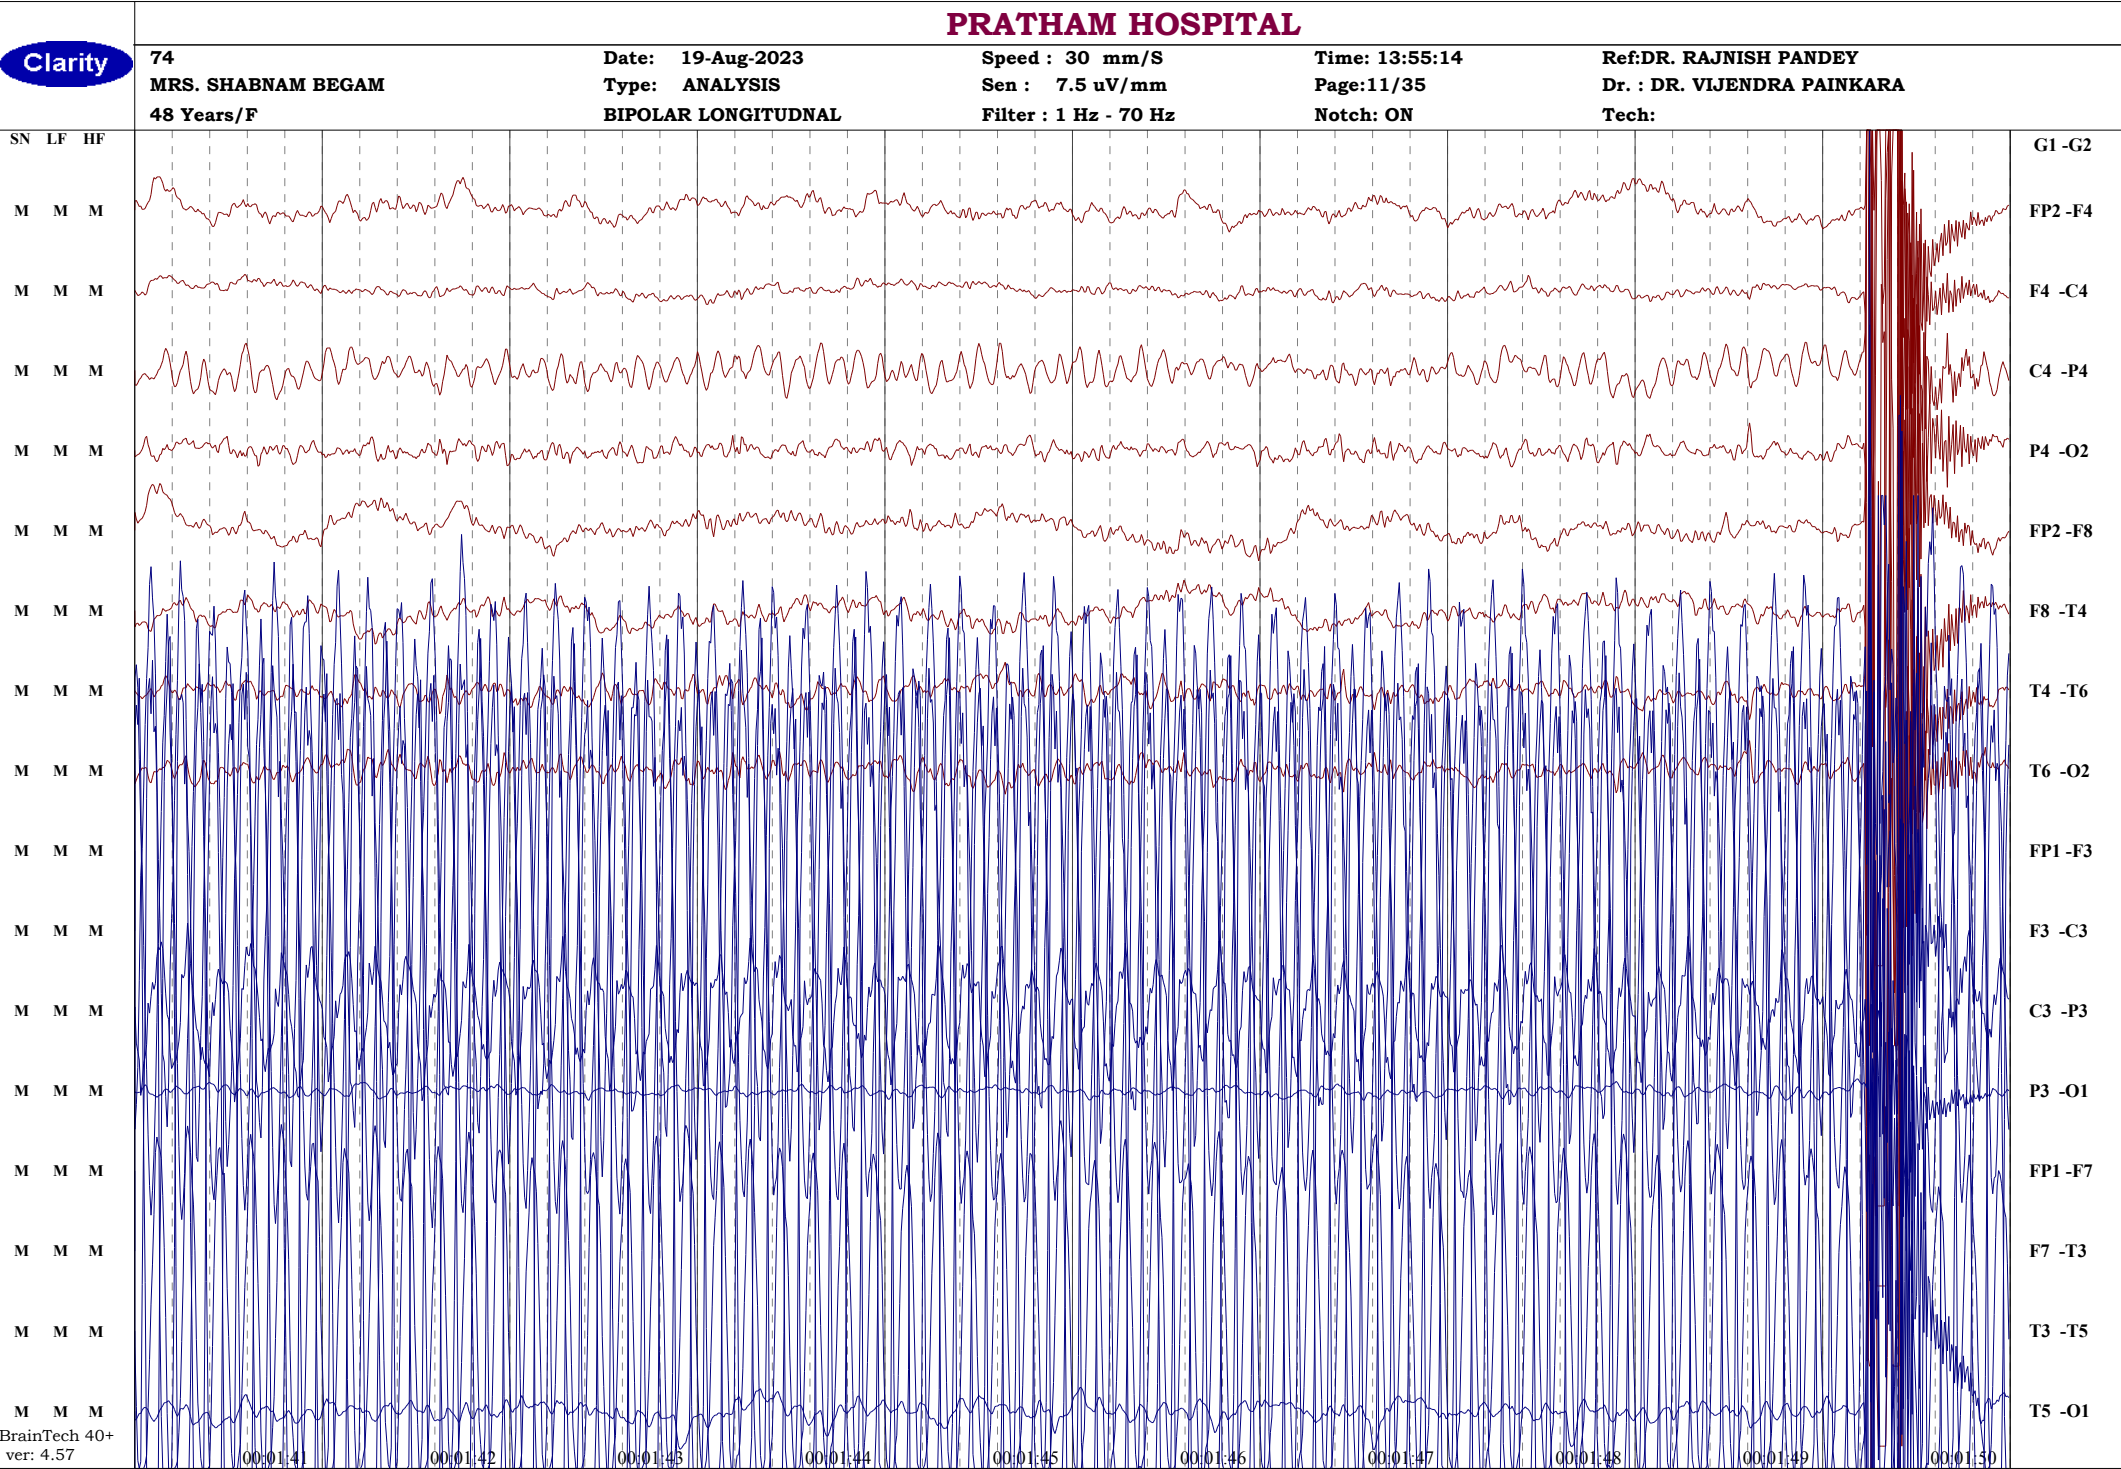

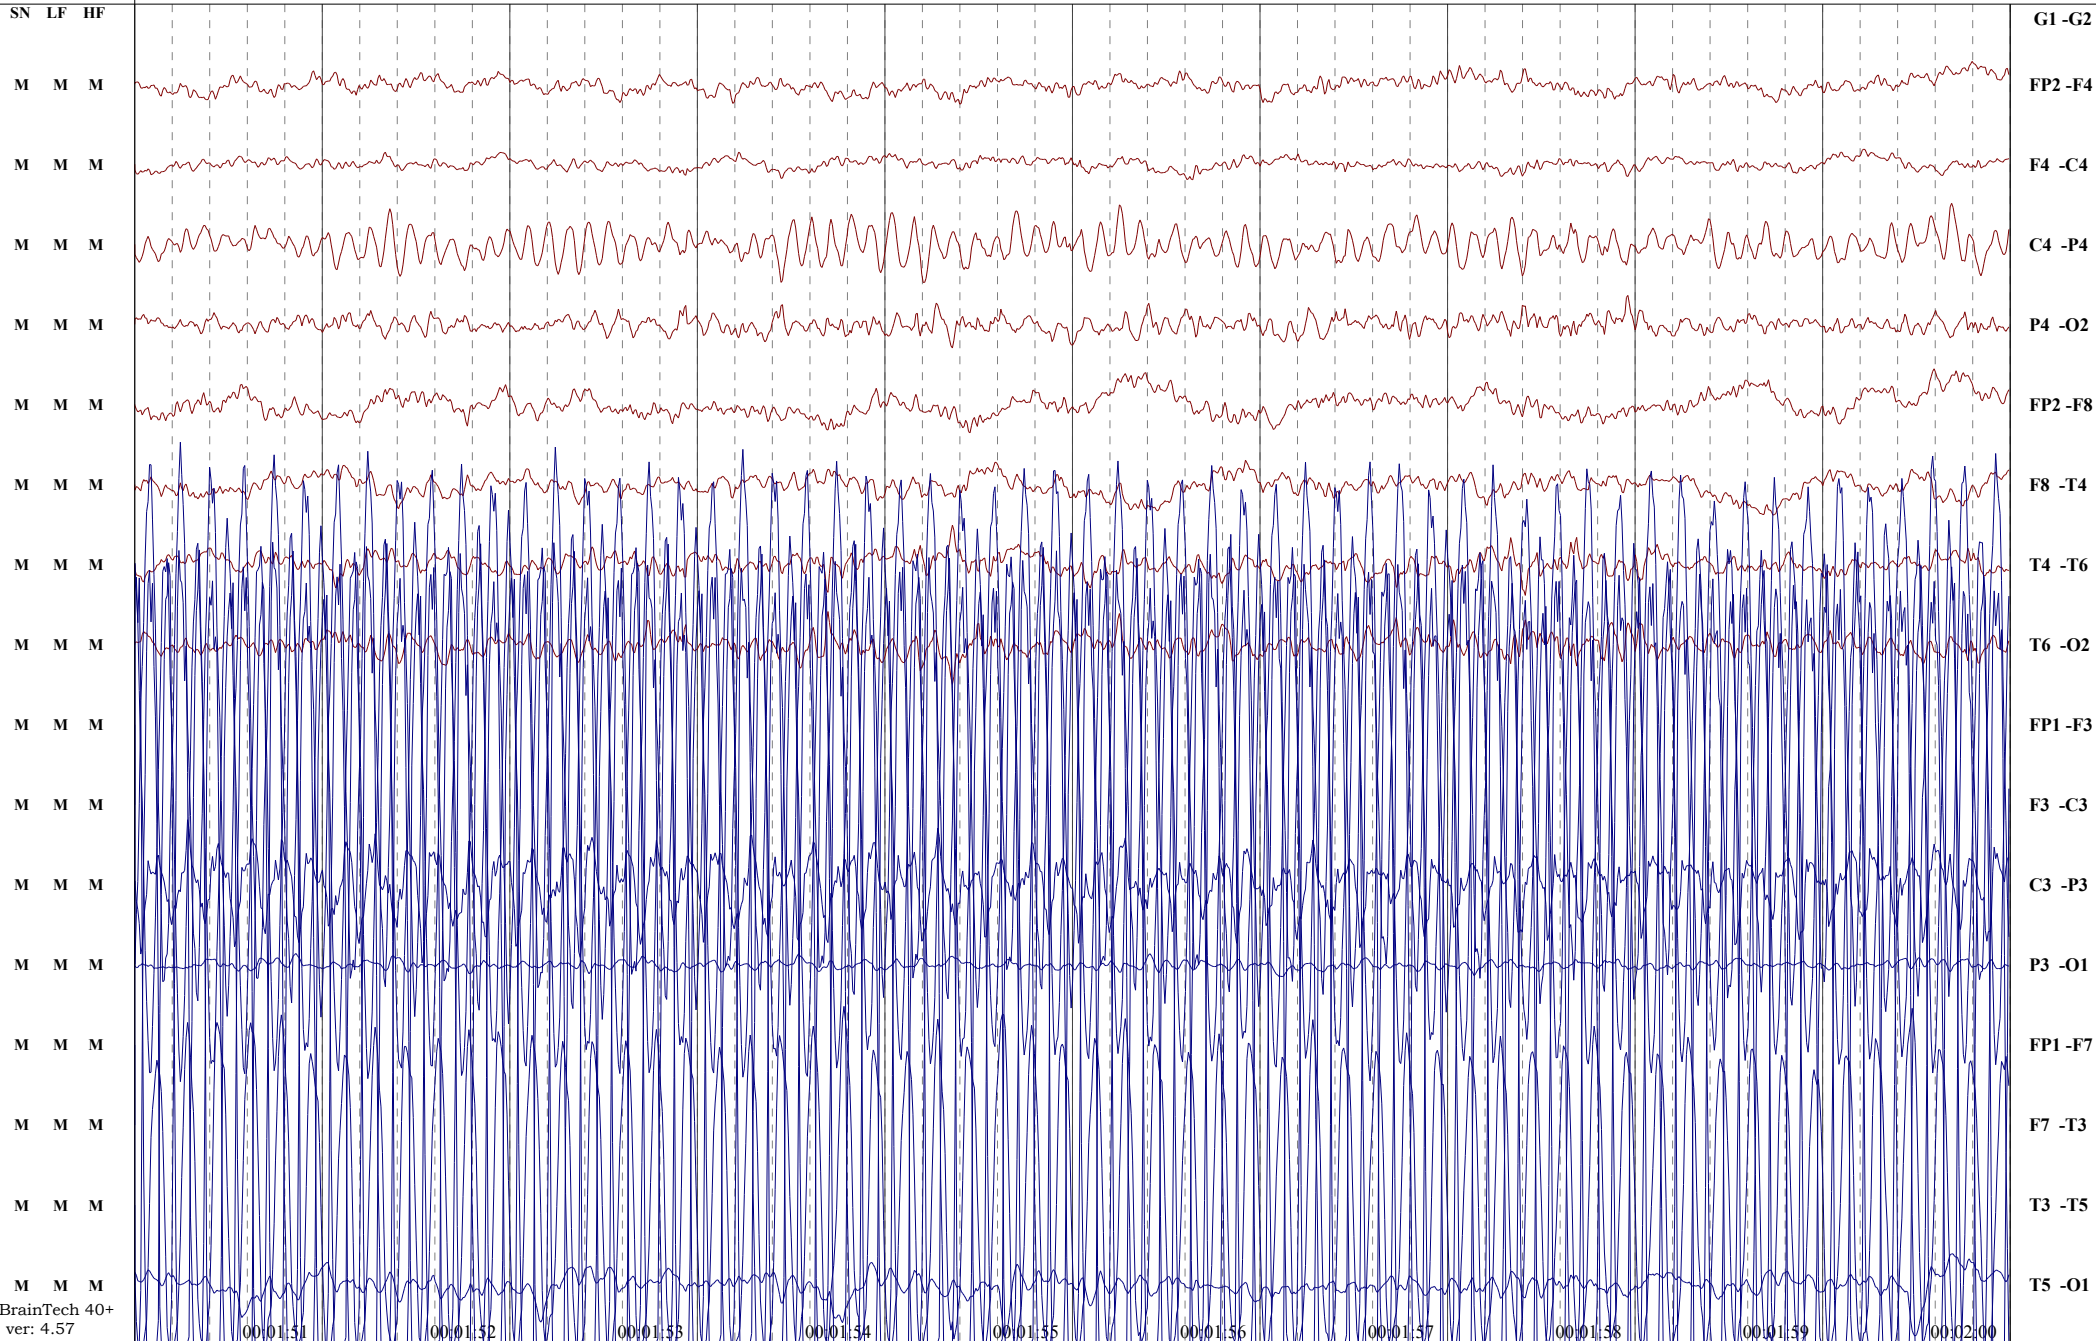

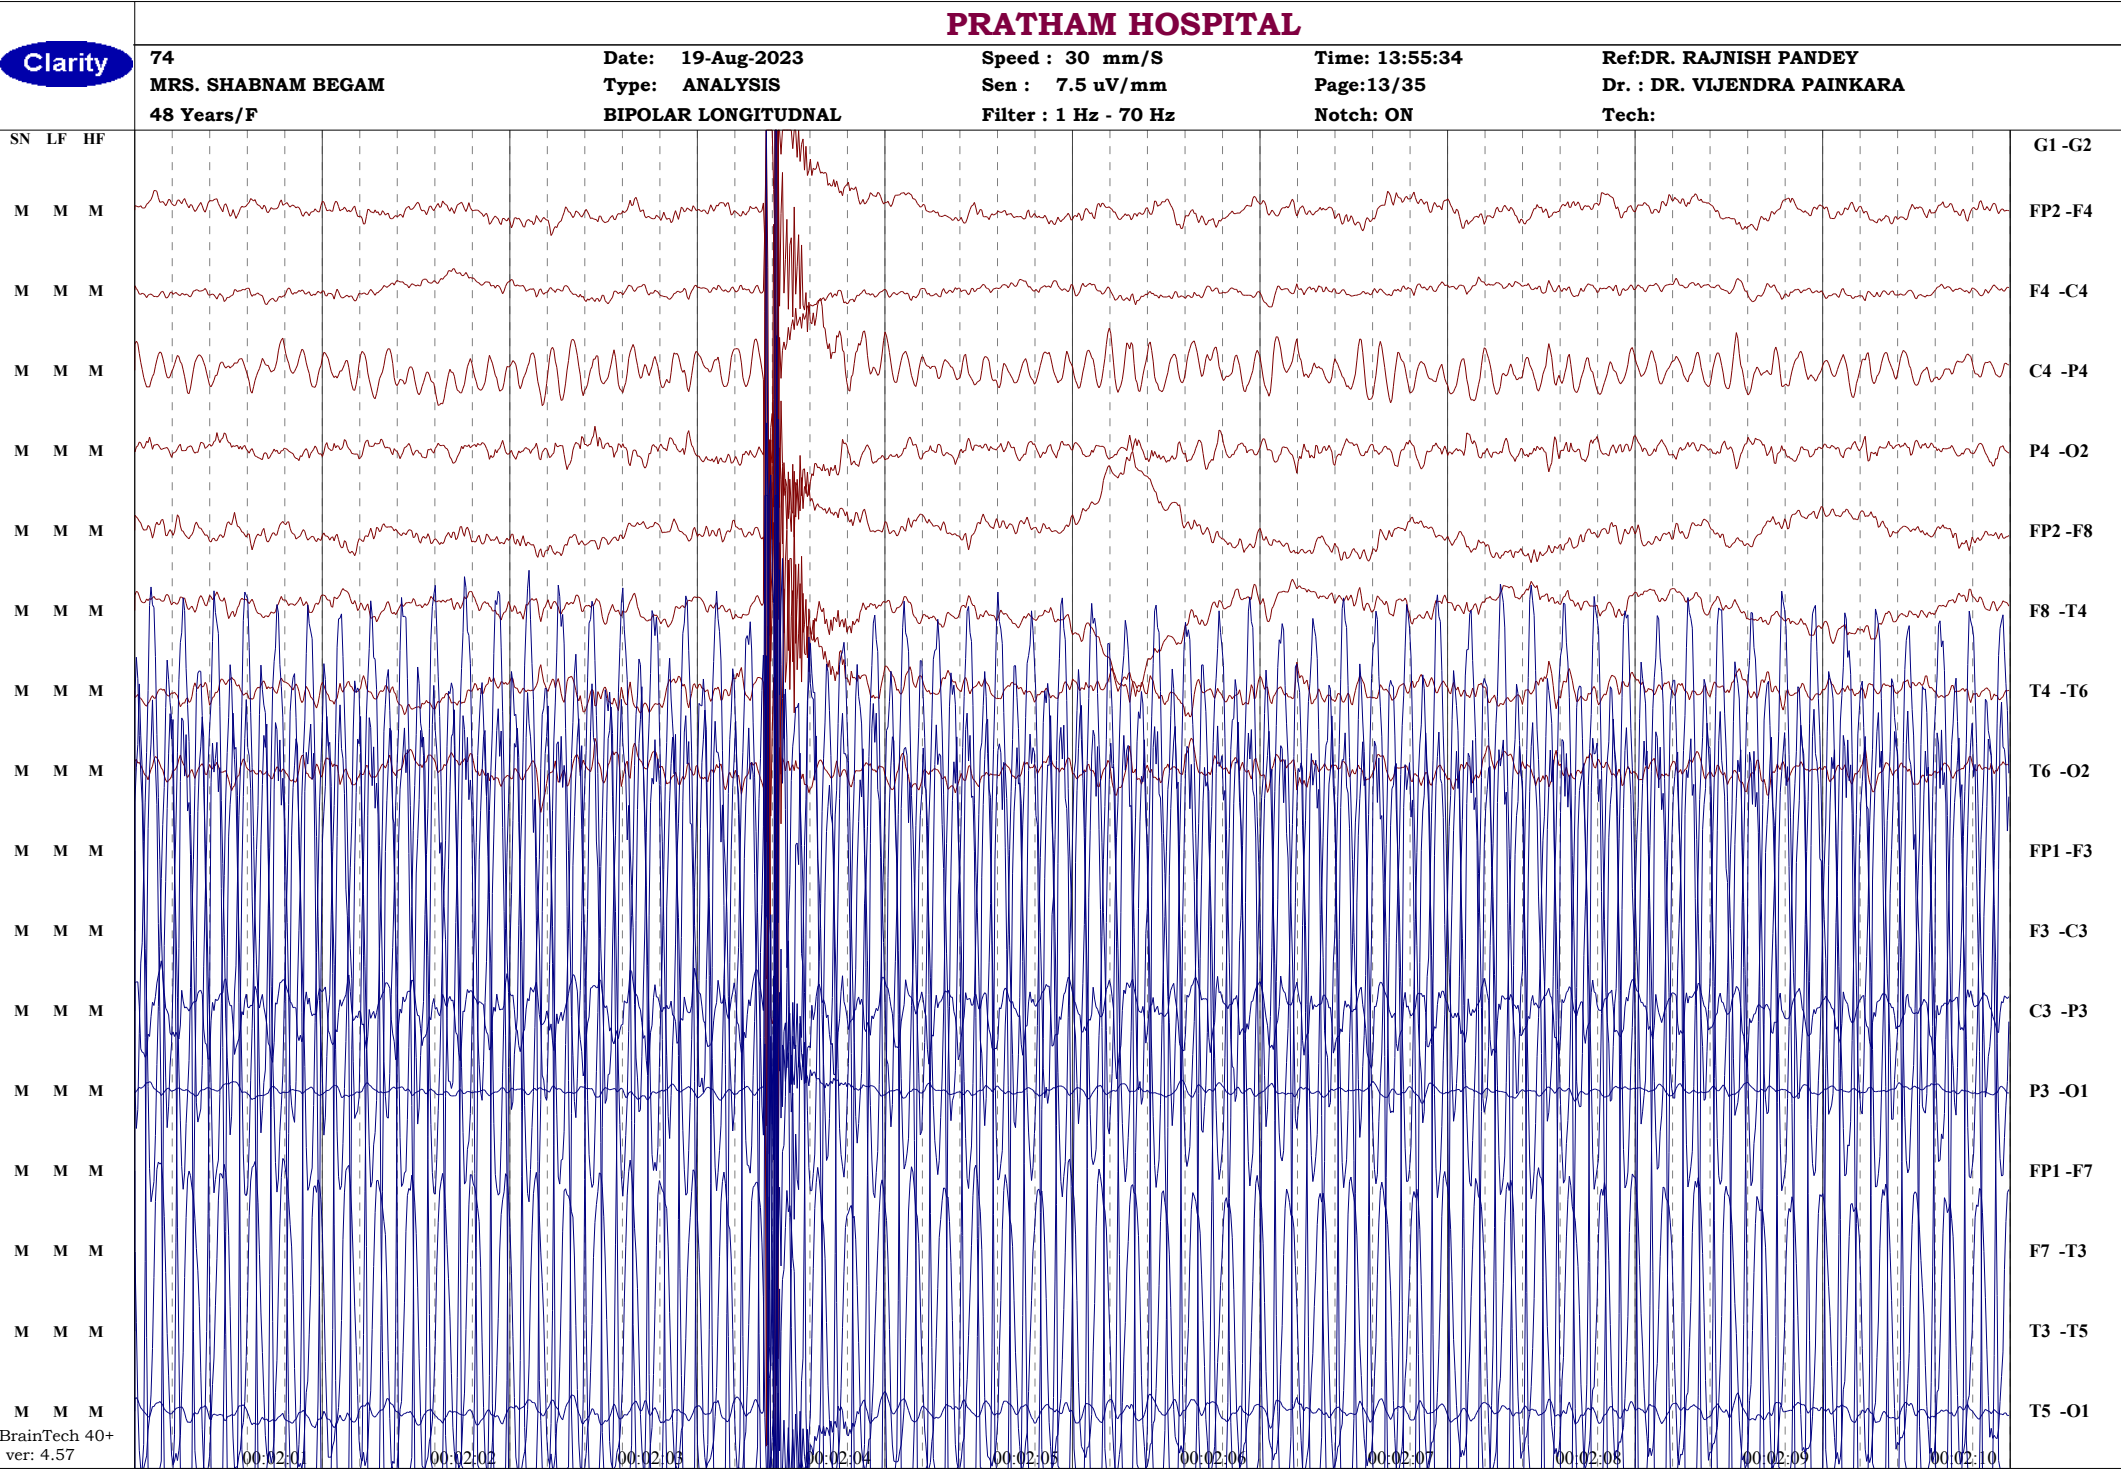

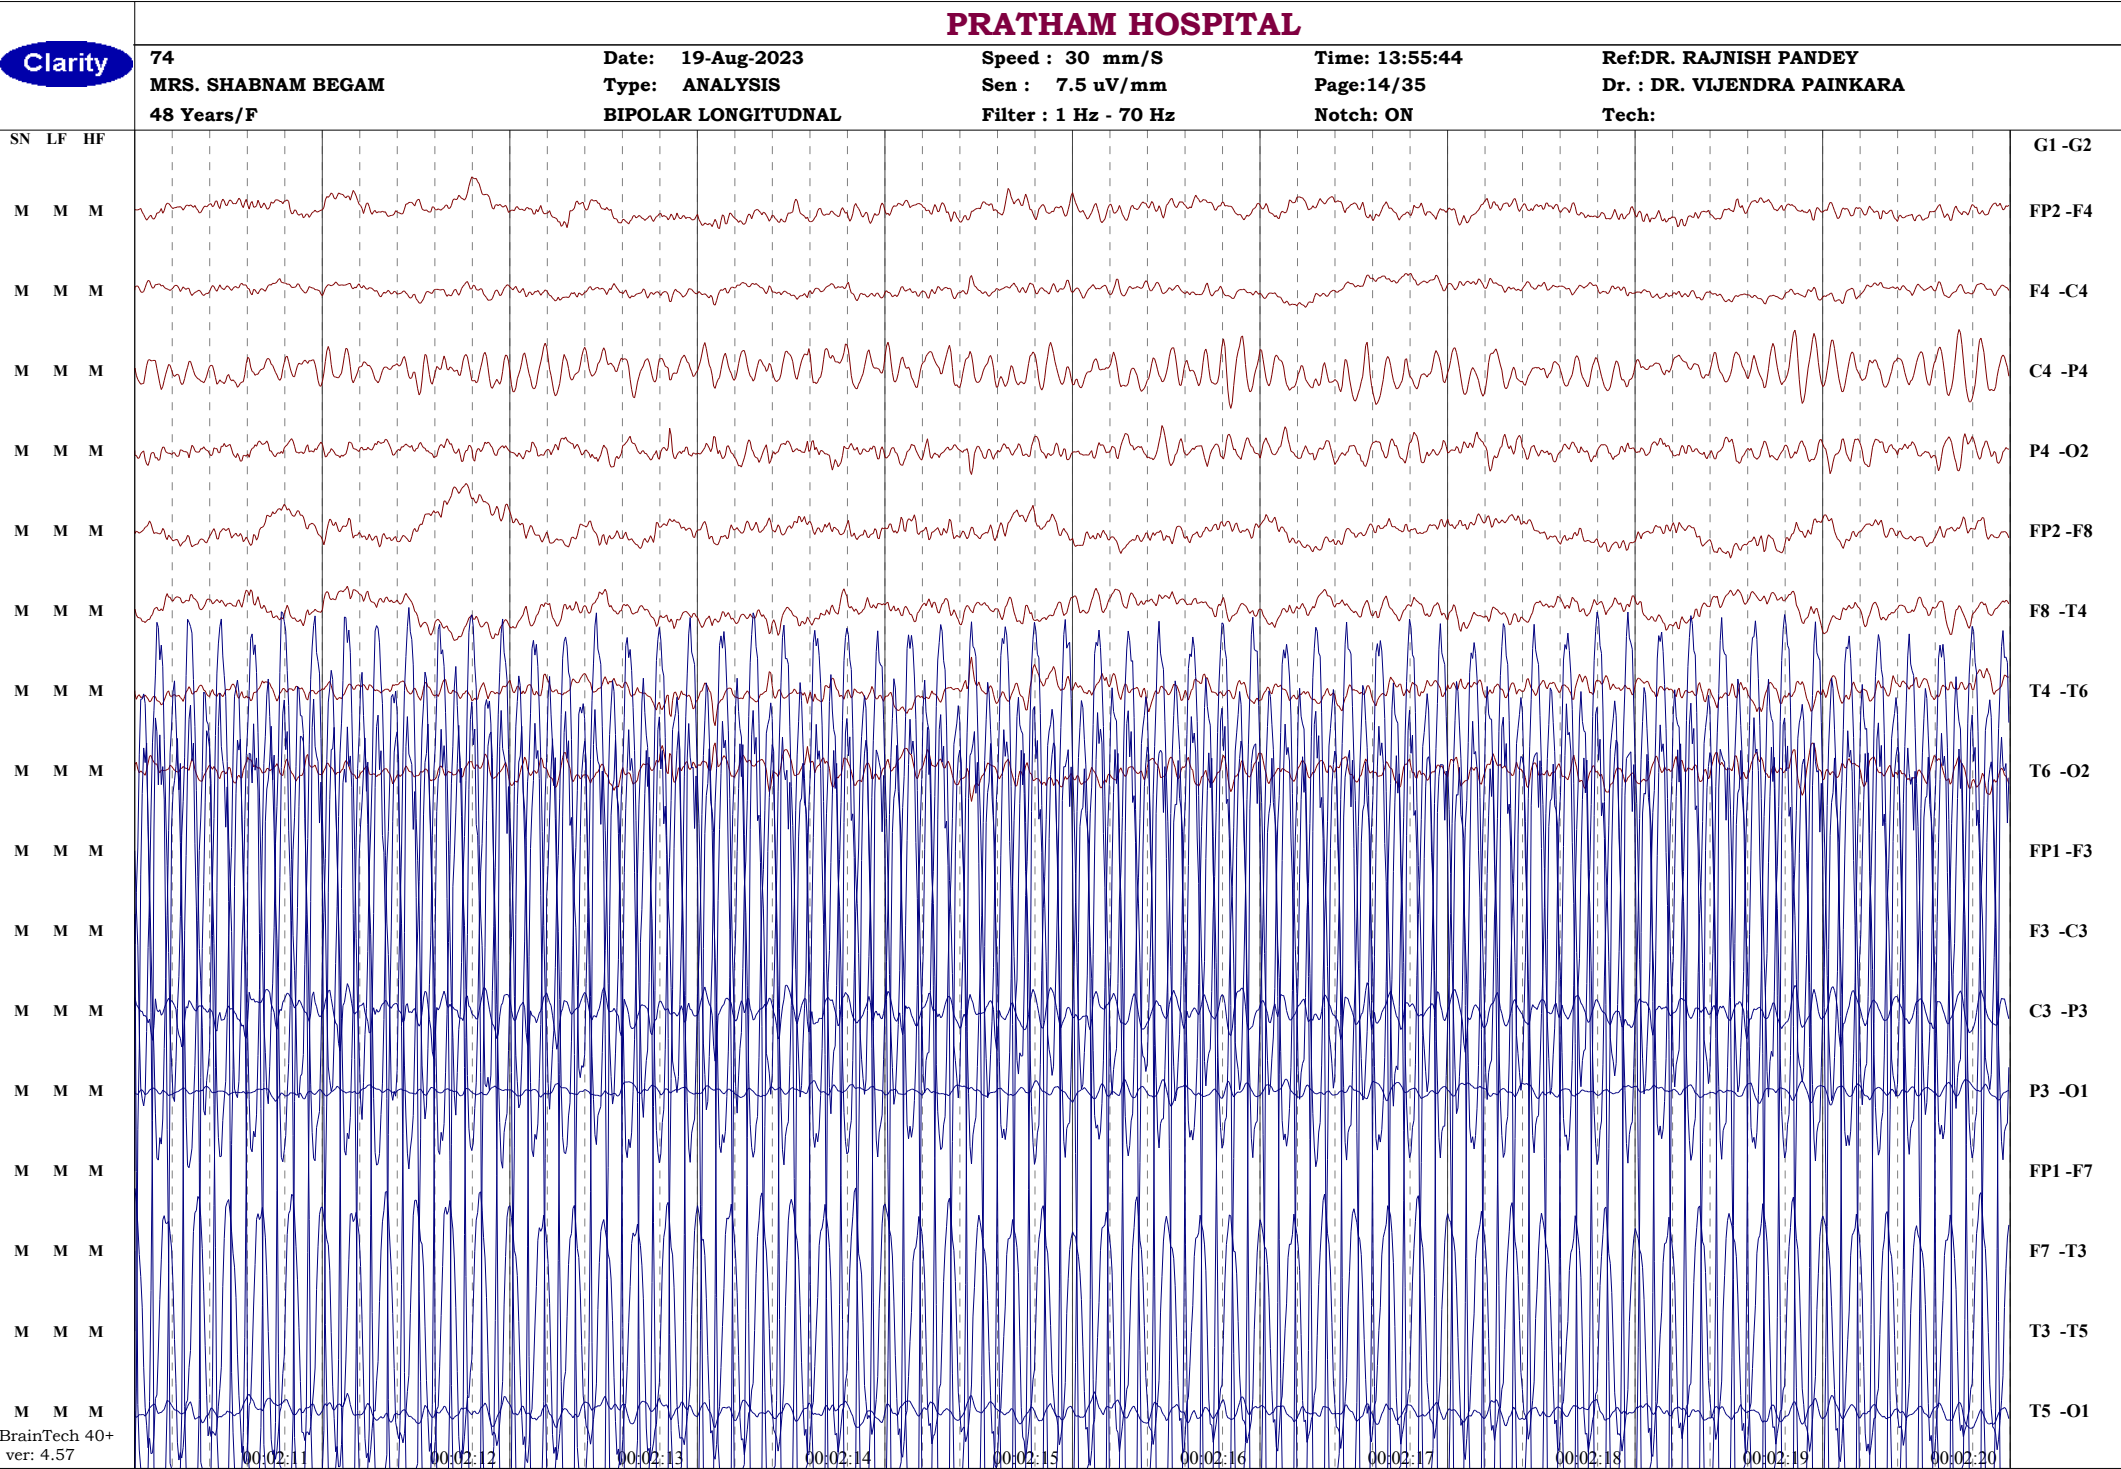


74
MRS. SHABNAM BEGAM
48 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL


Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz


Time: 13:55:54
Page:15/35
Notch: ON


Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

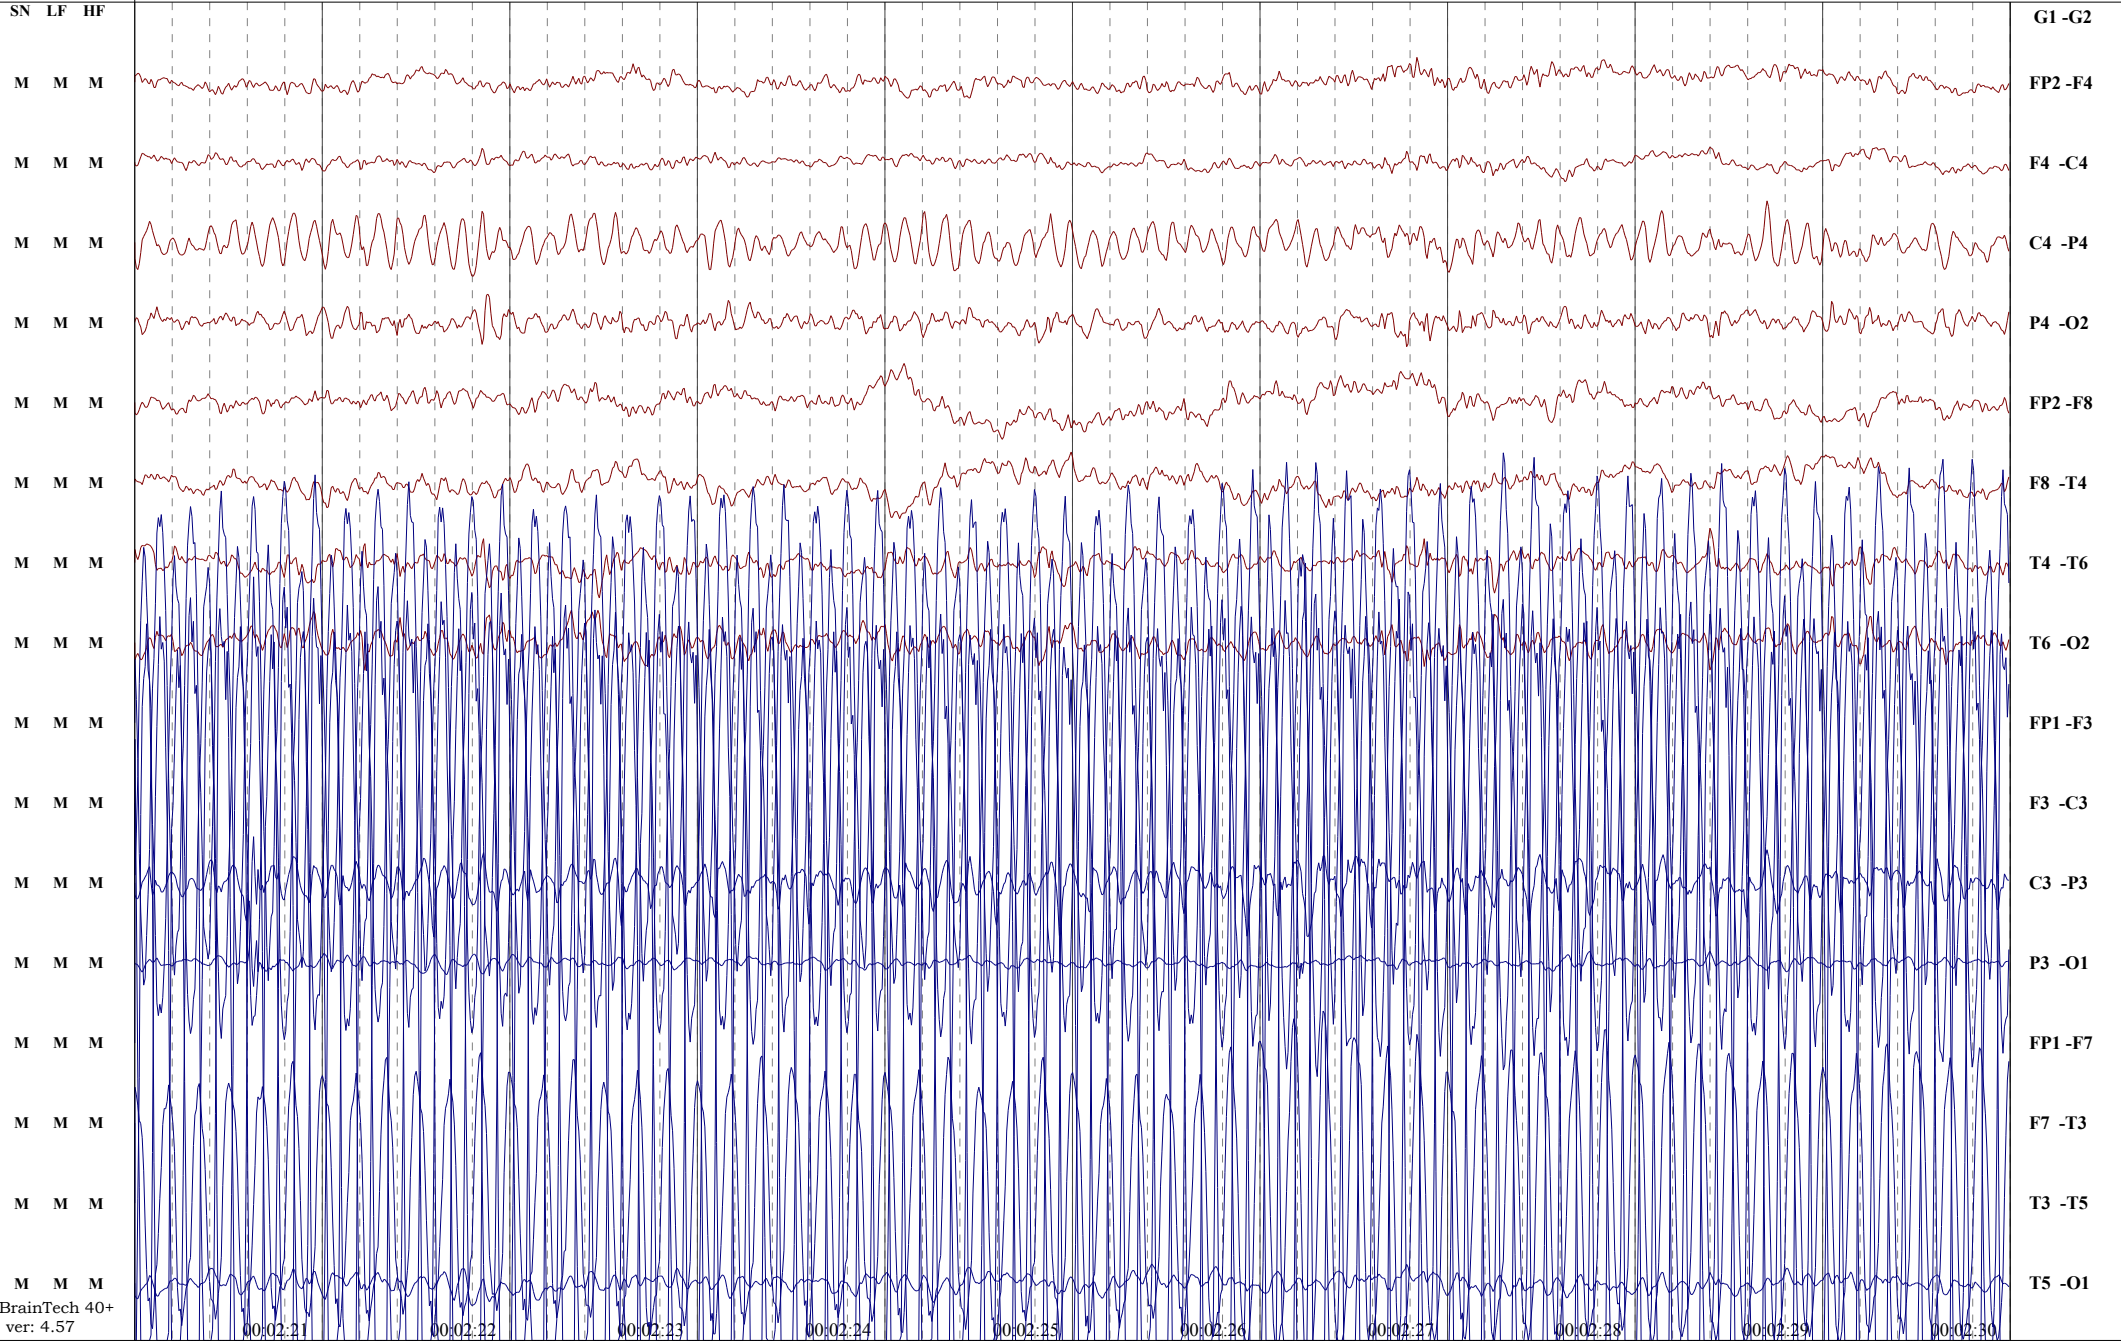


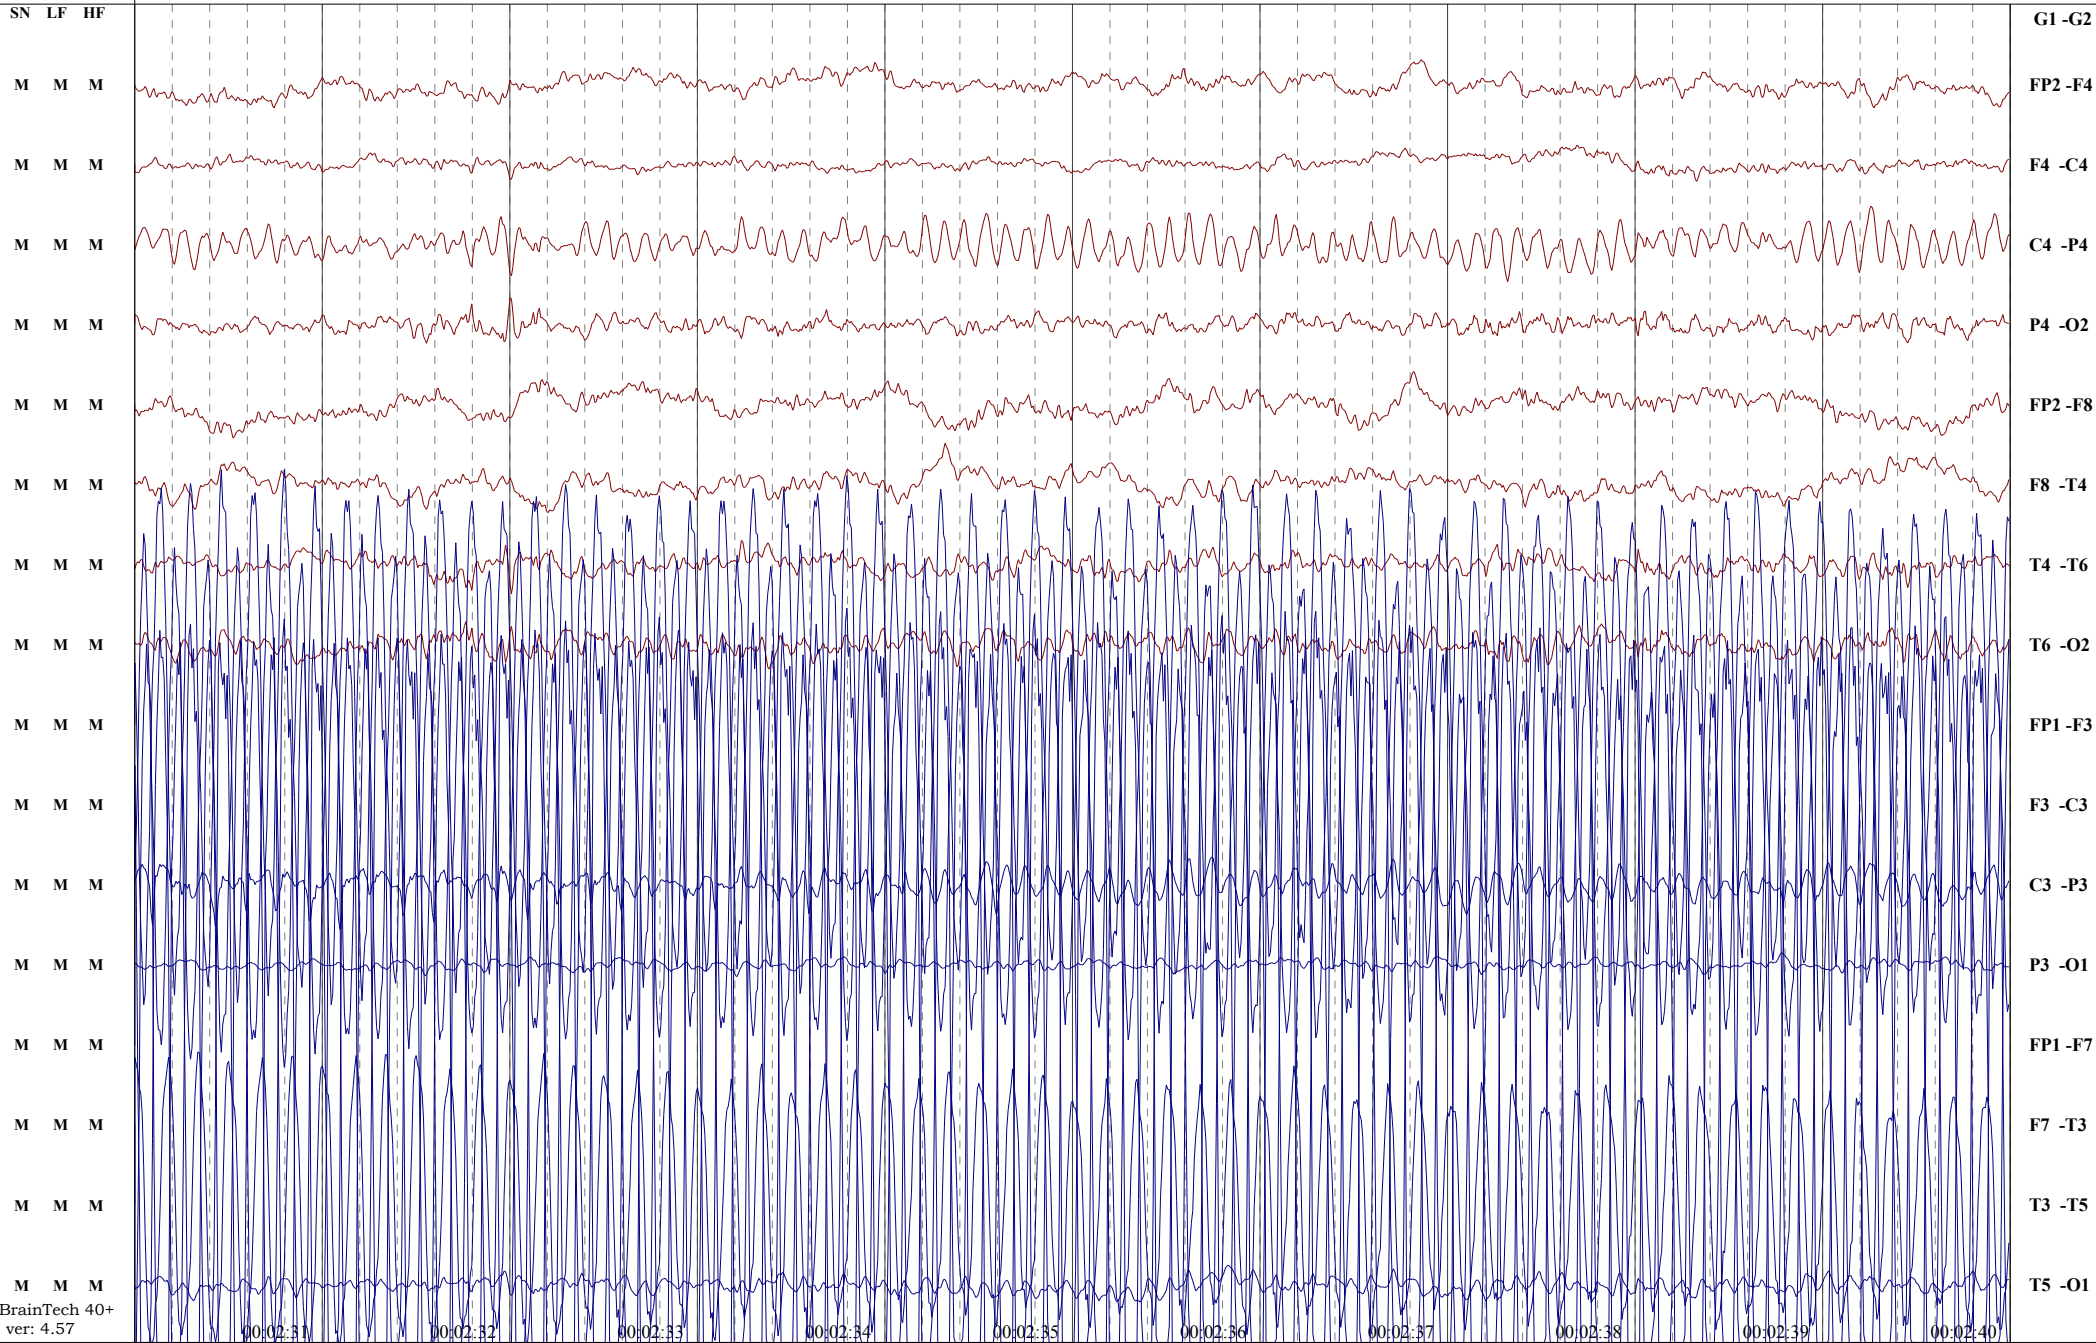


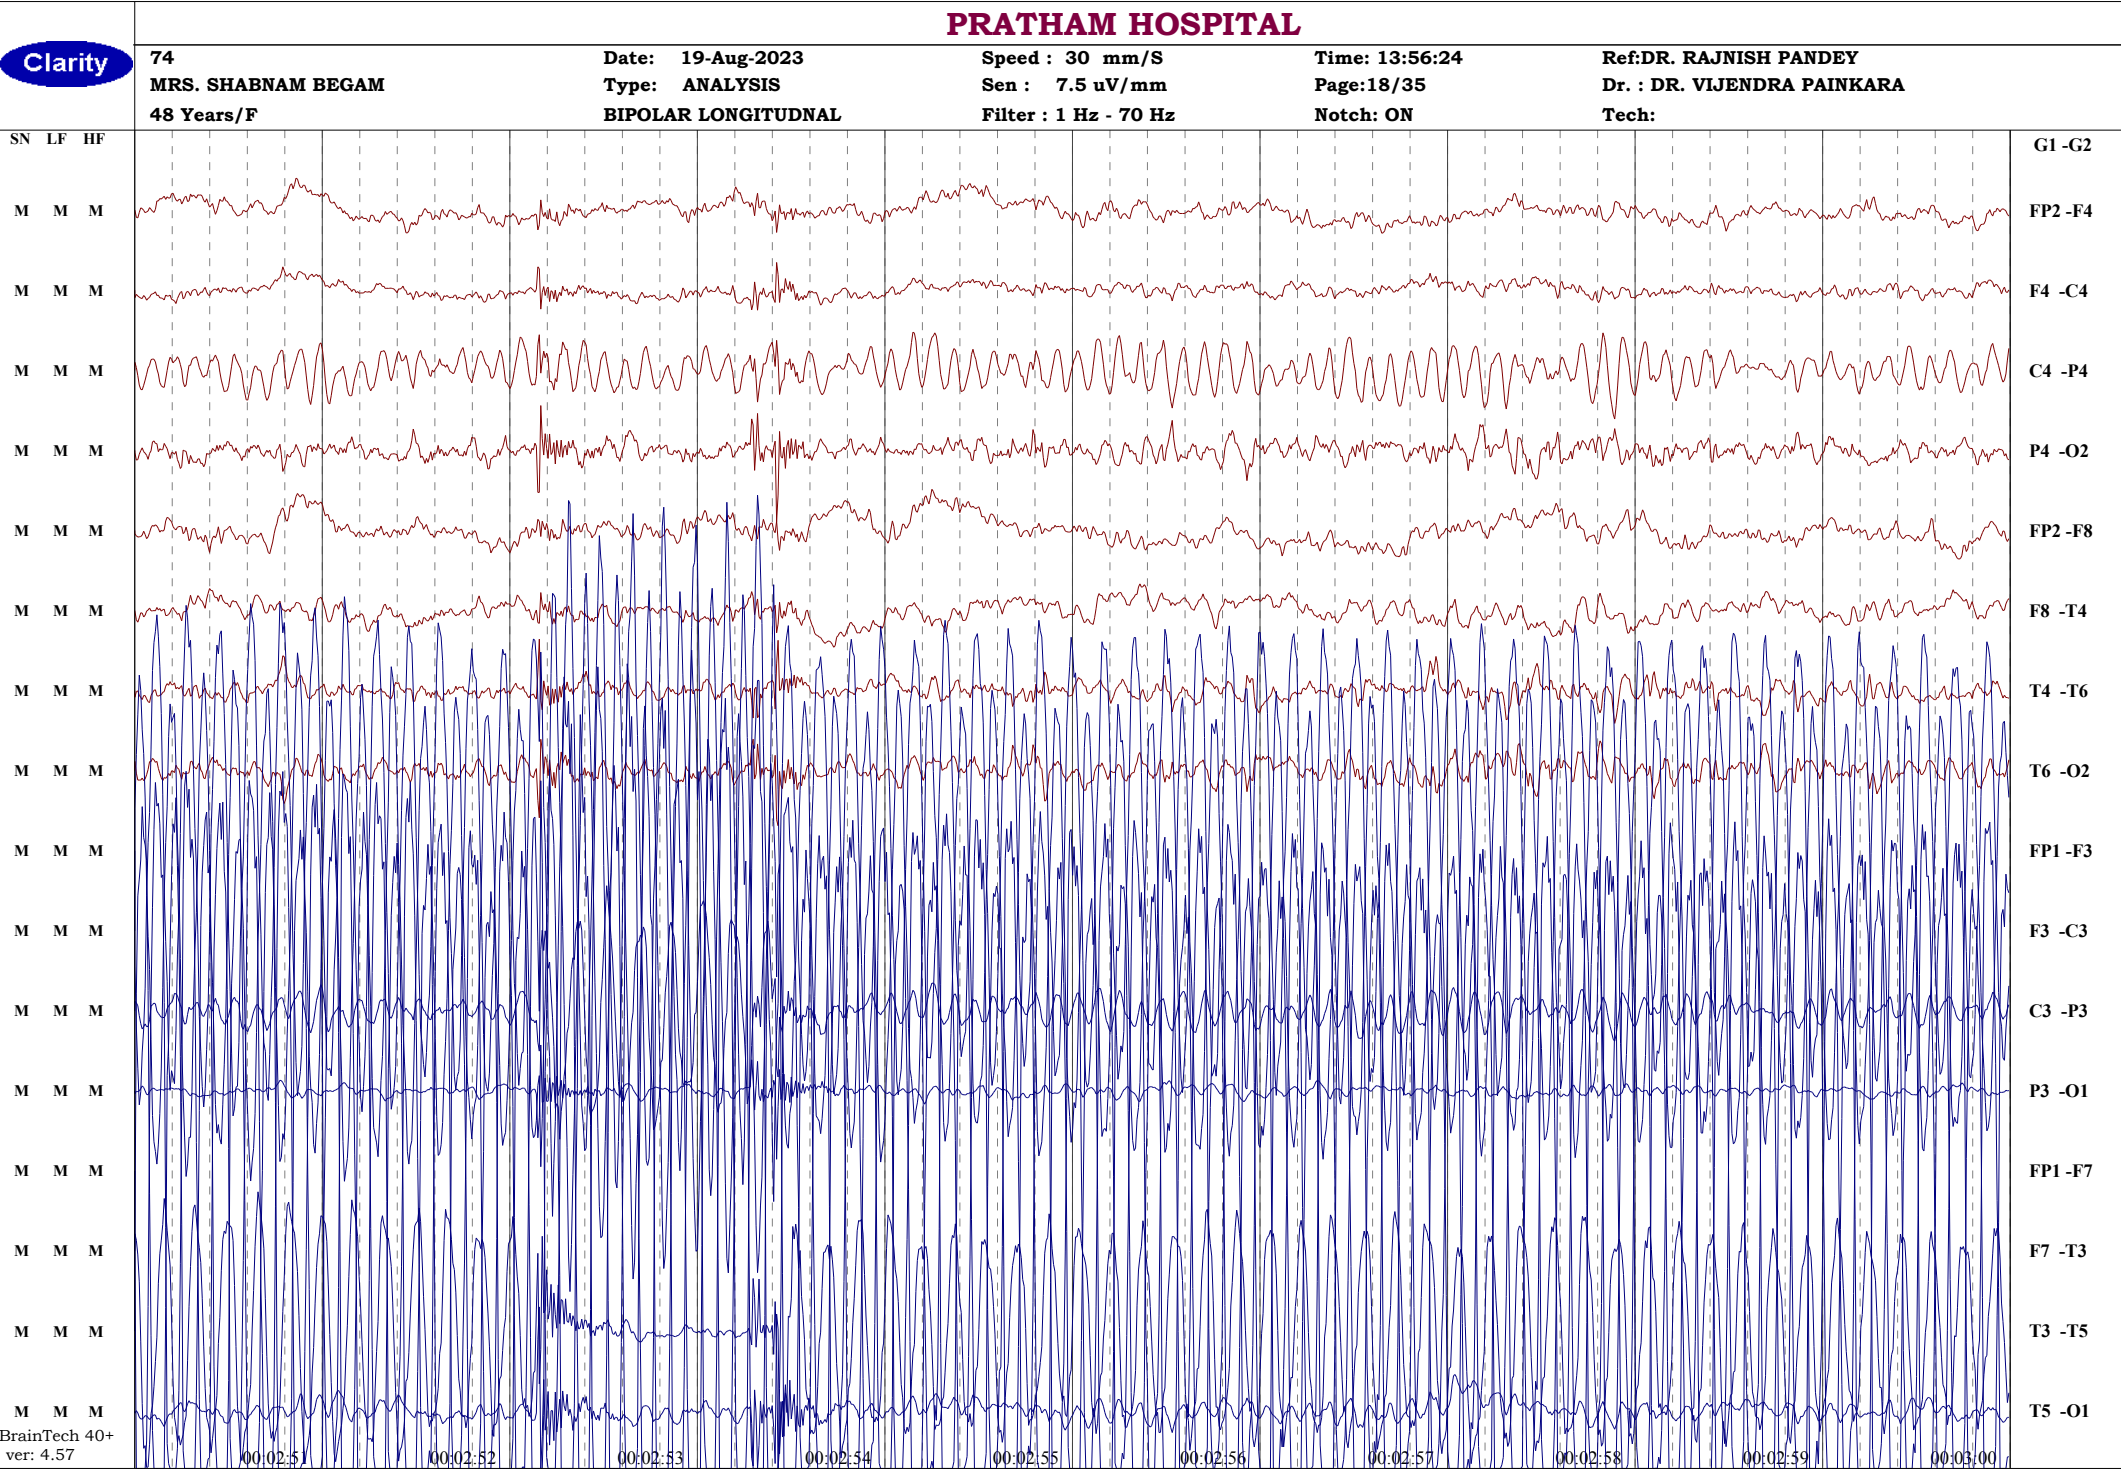

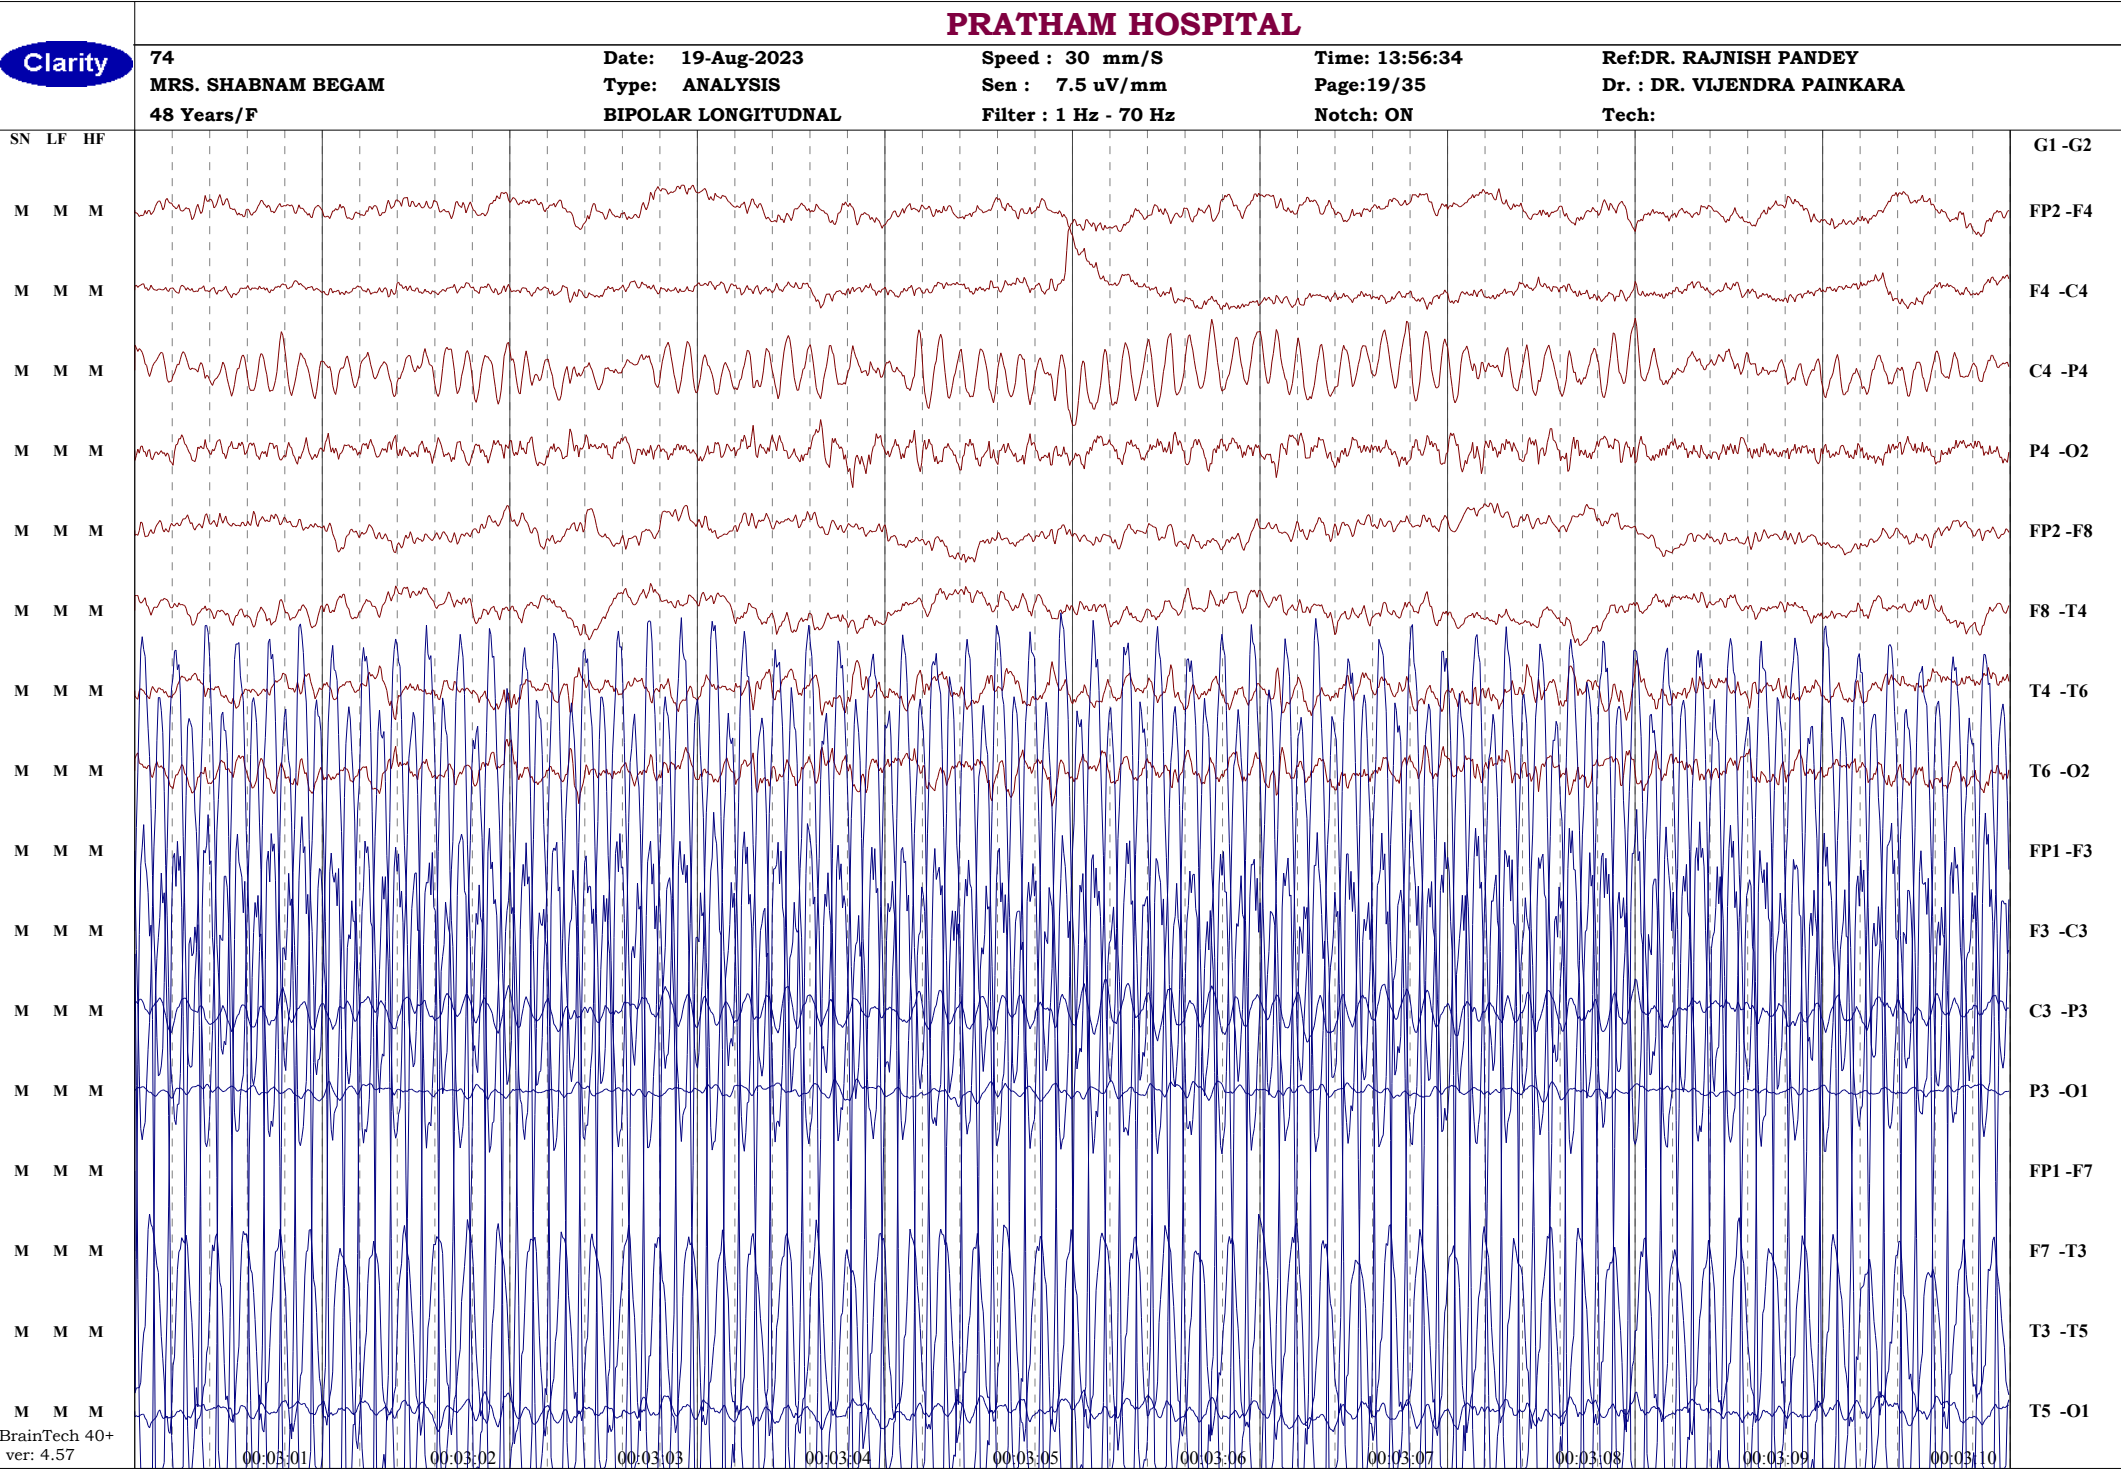

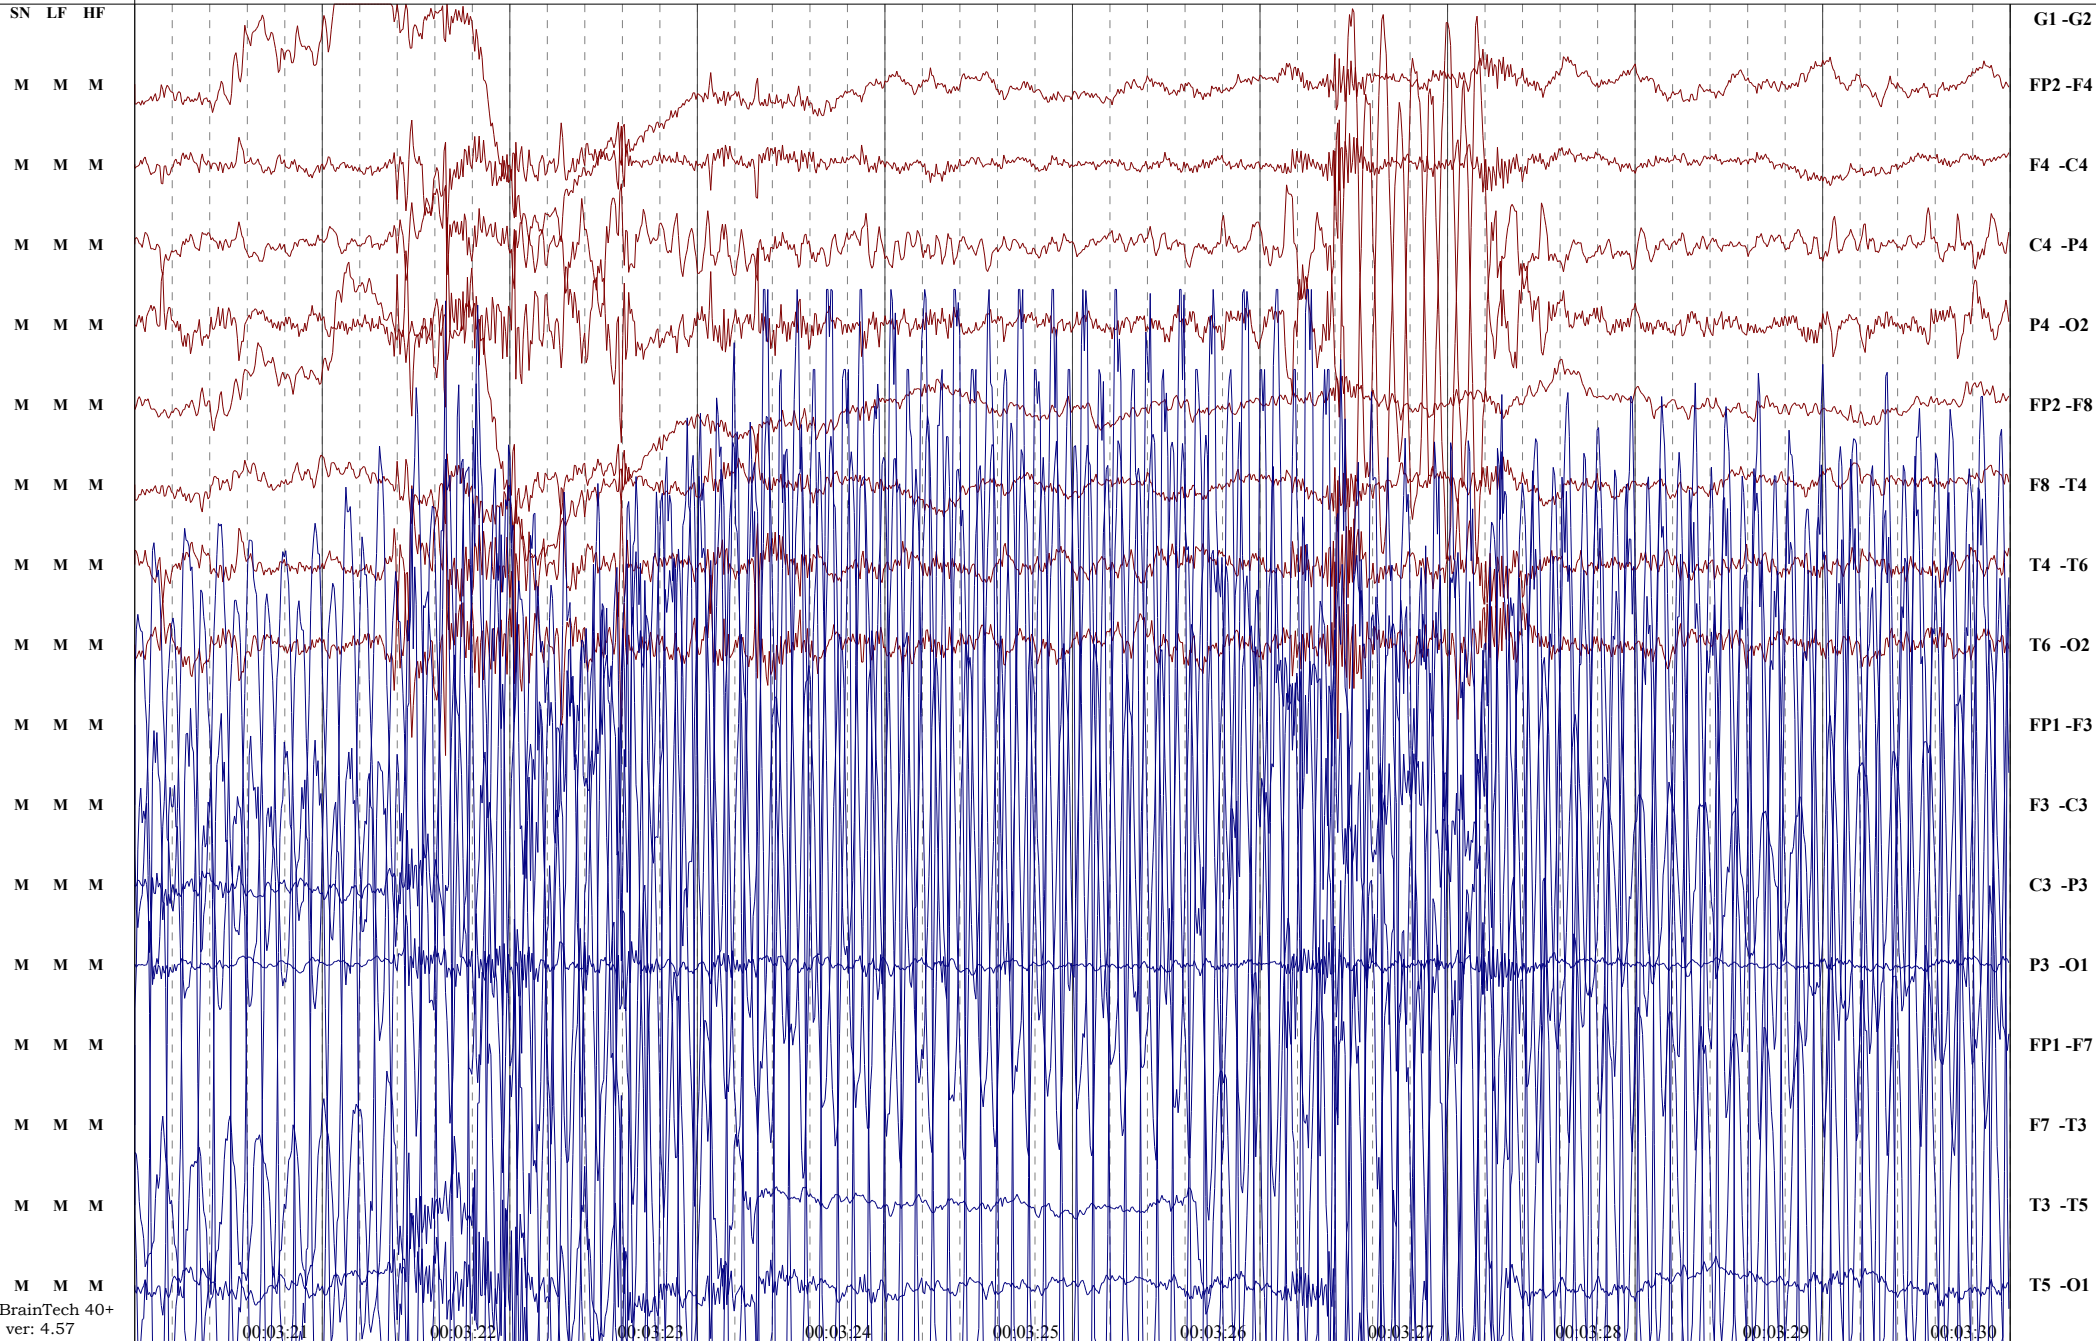

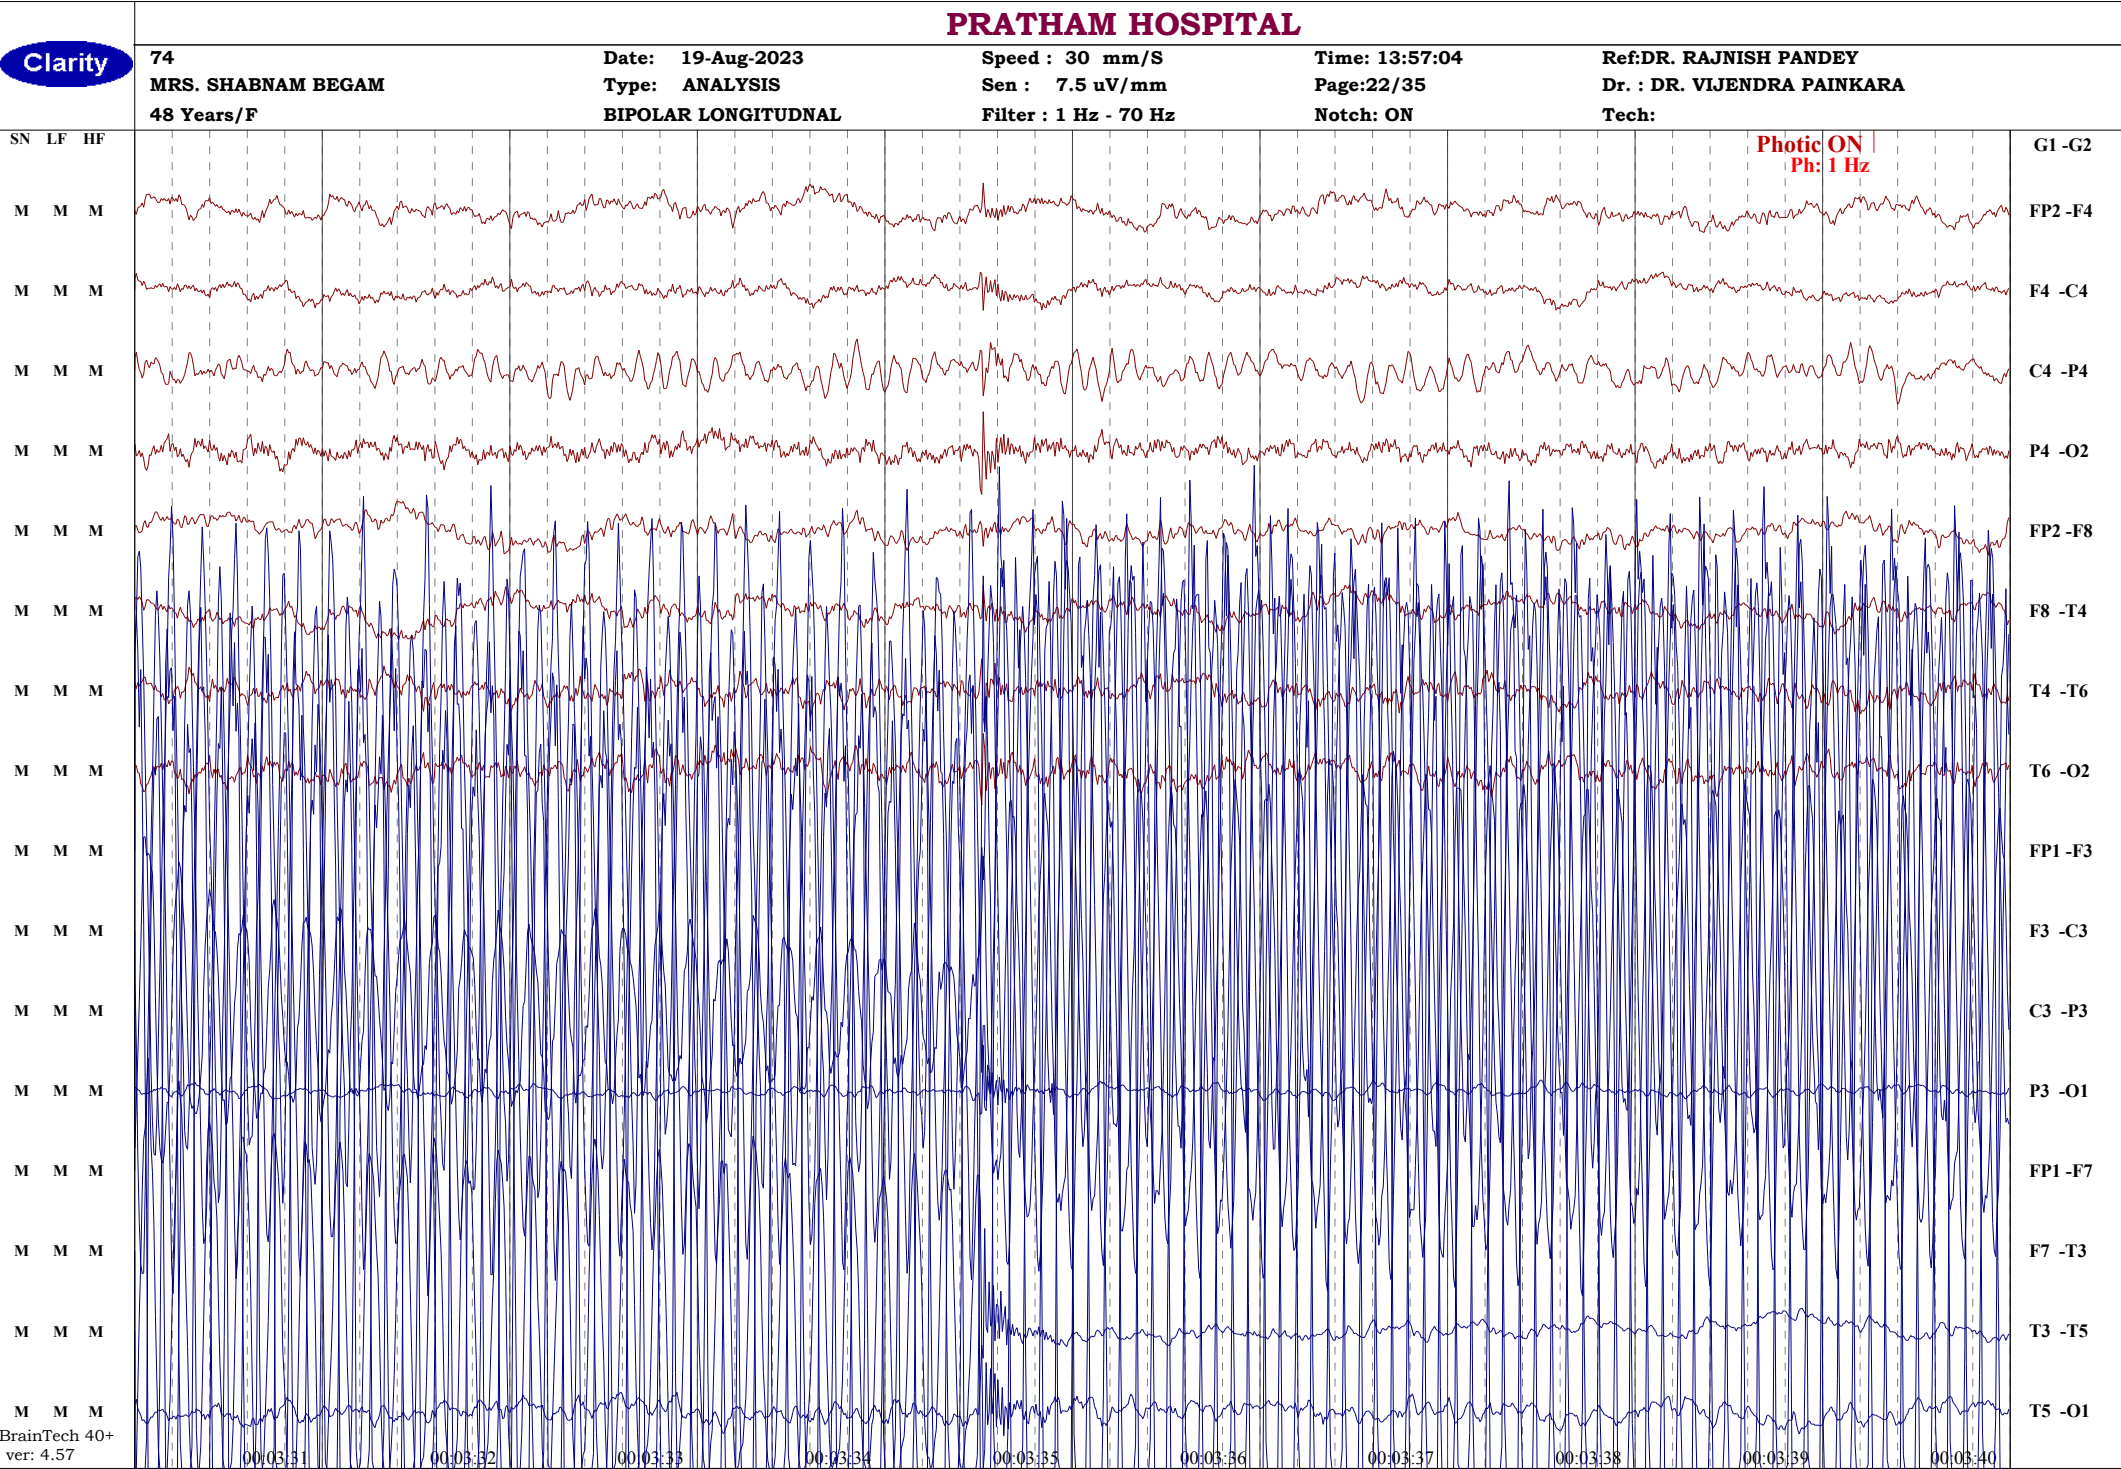

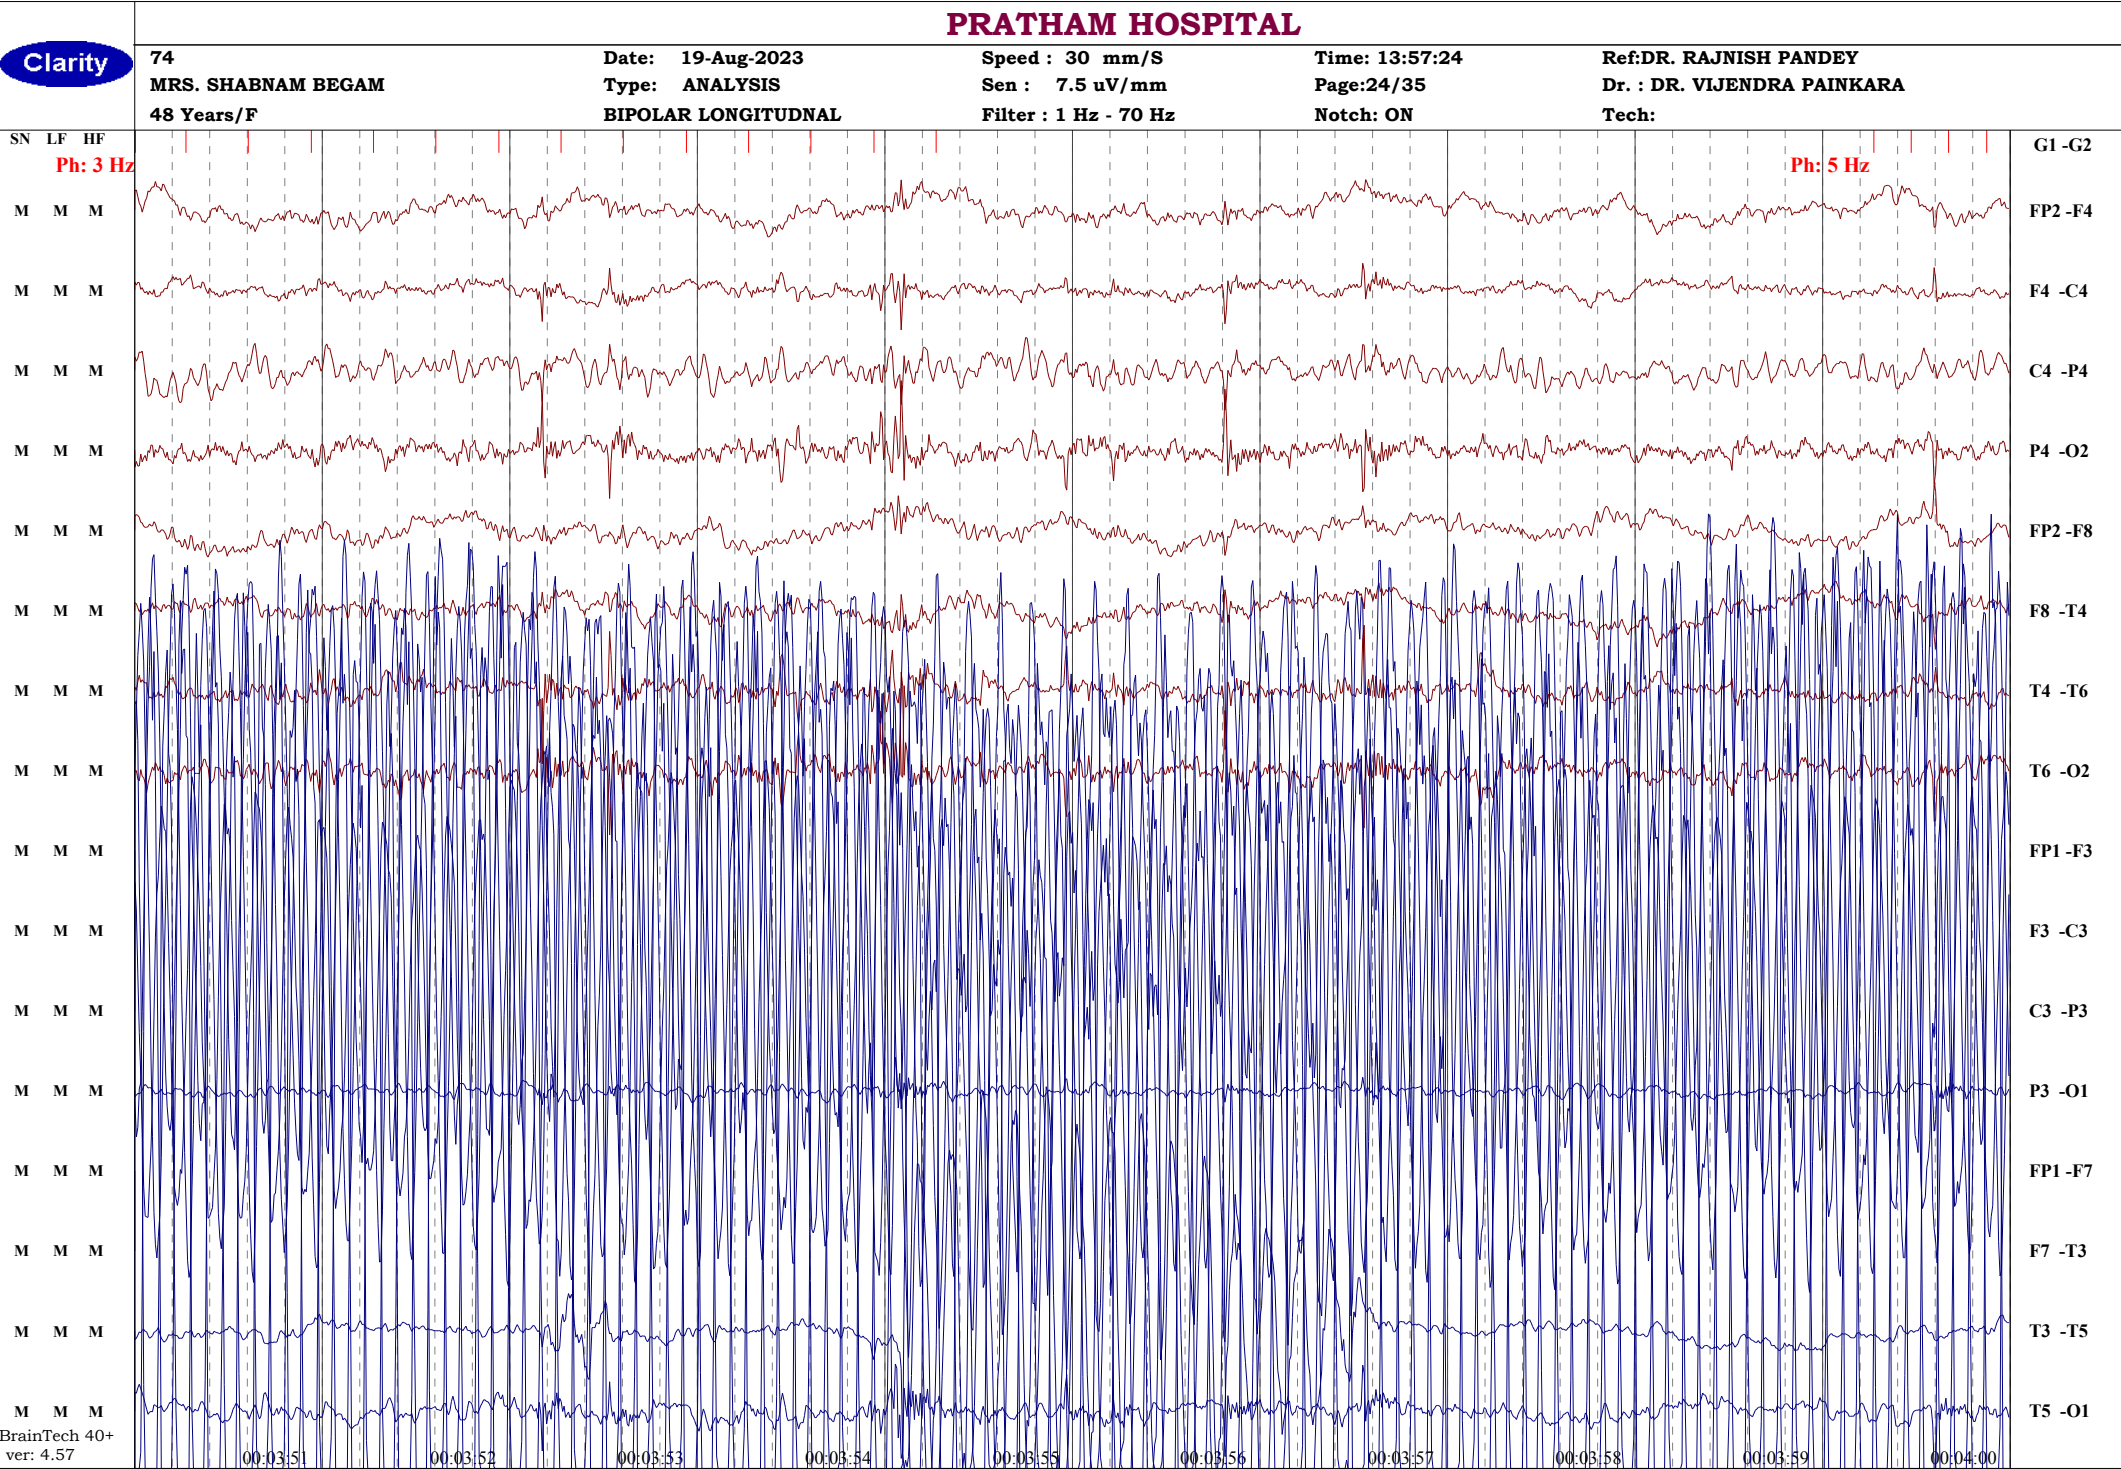

74

MRS. SHABNAM BEGAM

48 Years/F

Date: 19-Aug-2023

Type: ANALYSIS

BIPOLAR LONGITUDNAL

Speed : 30 mm/S

Sen : 7.5 uV/mm

Filter : 1 Hz - 70 Hz

Time: 13:57:34


Page:25/35


Notch: ON


Ref:DR. RAJNISH PANDEY

Dr. : DR. VIJENDRA PAINKARA

Tech:

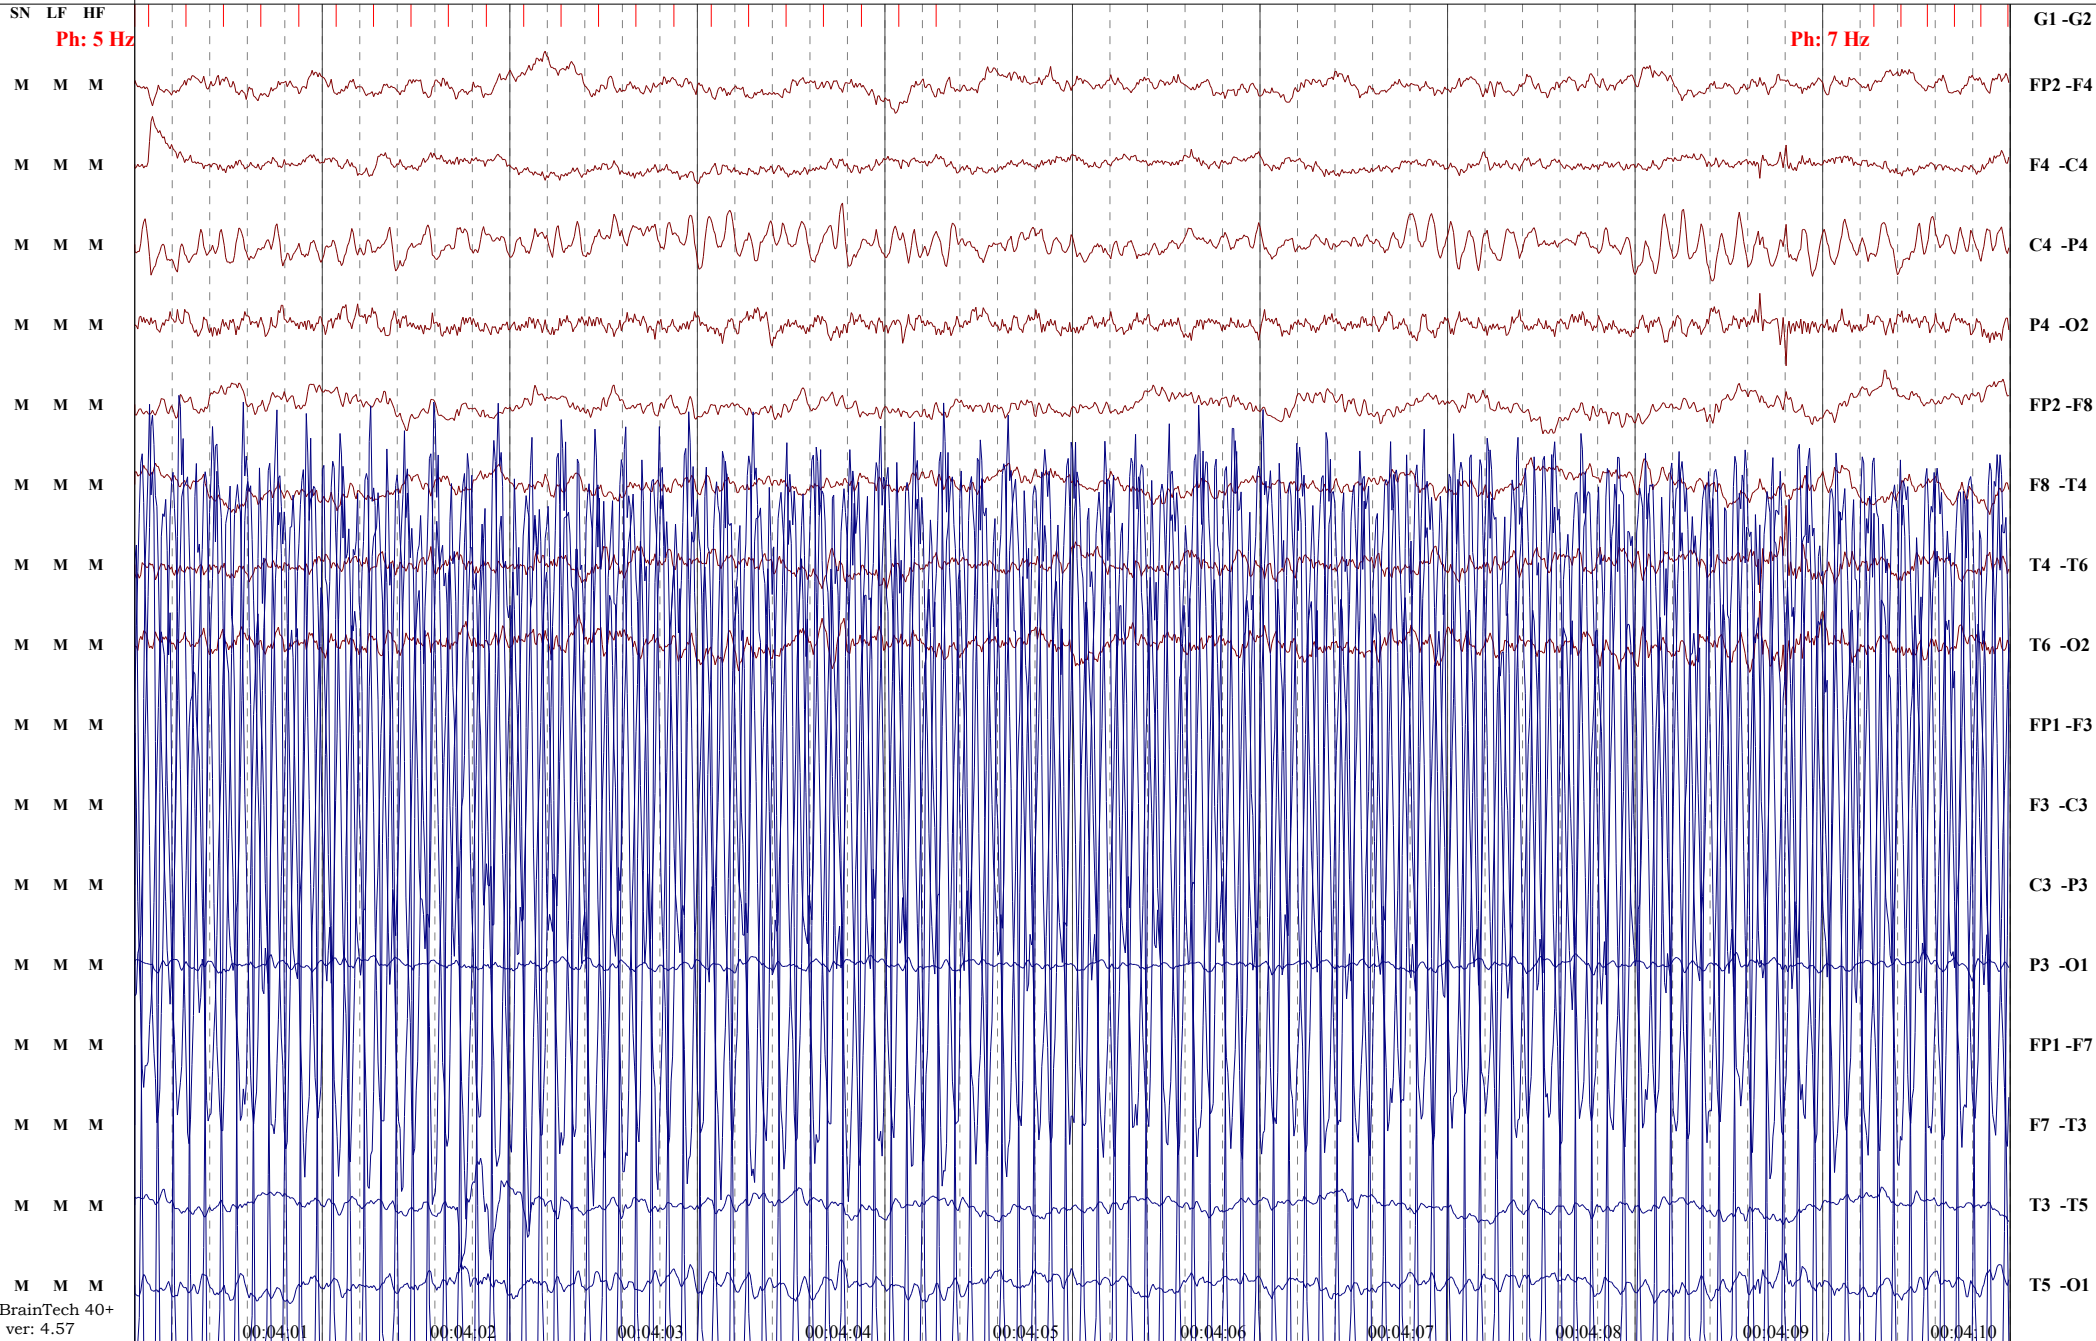

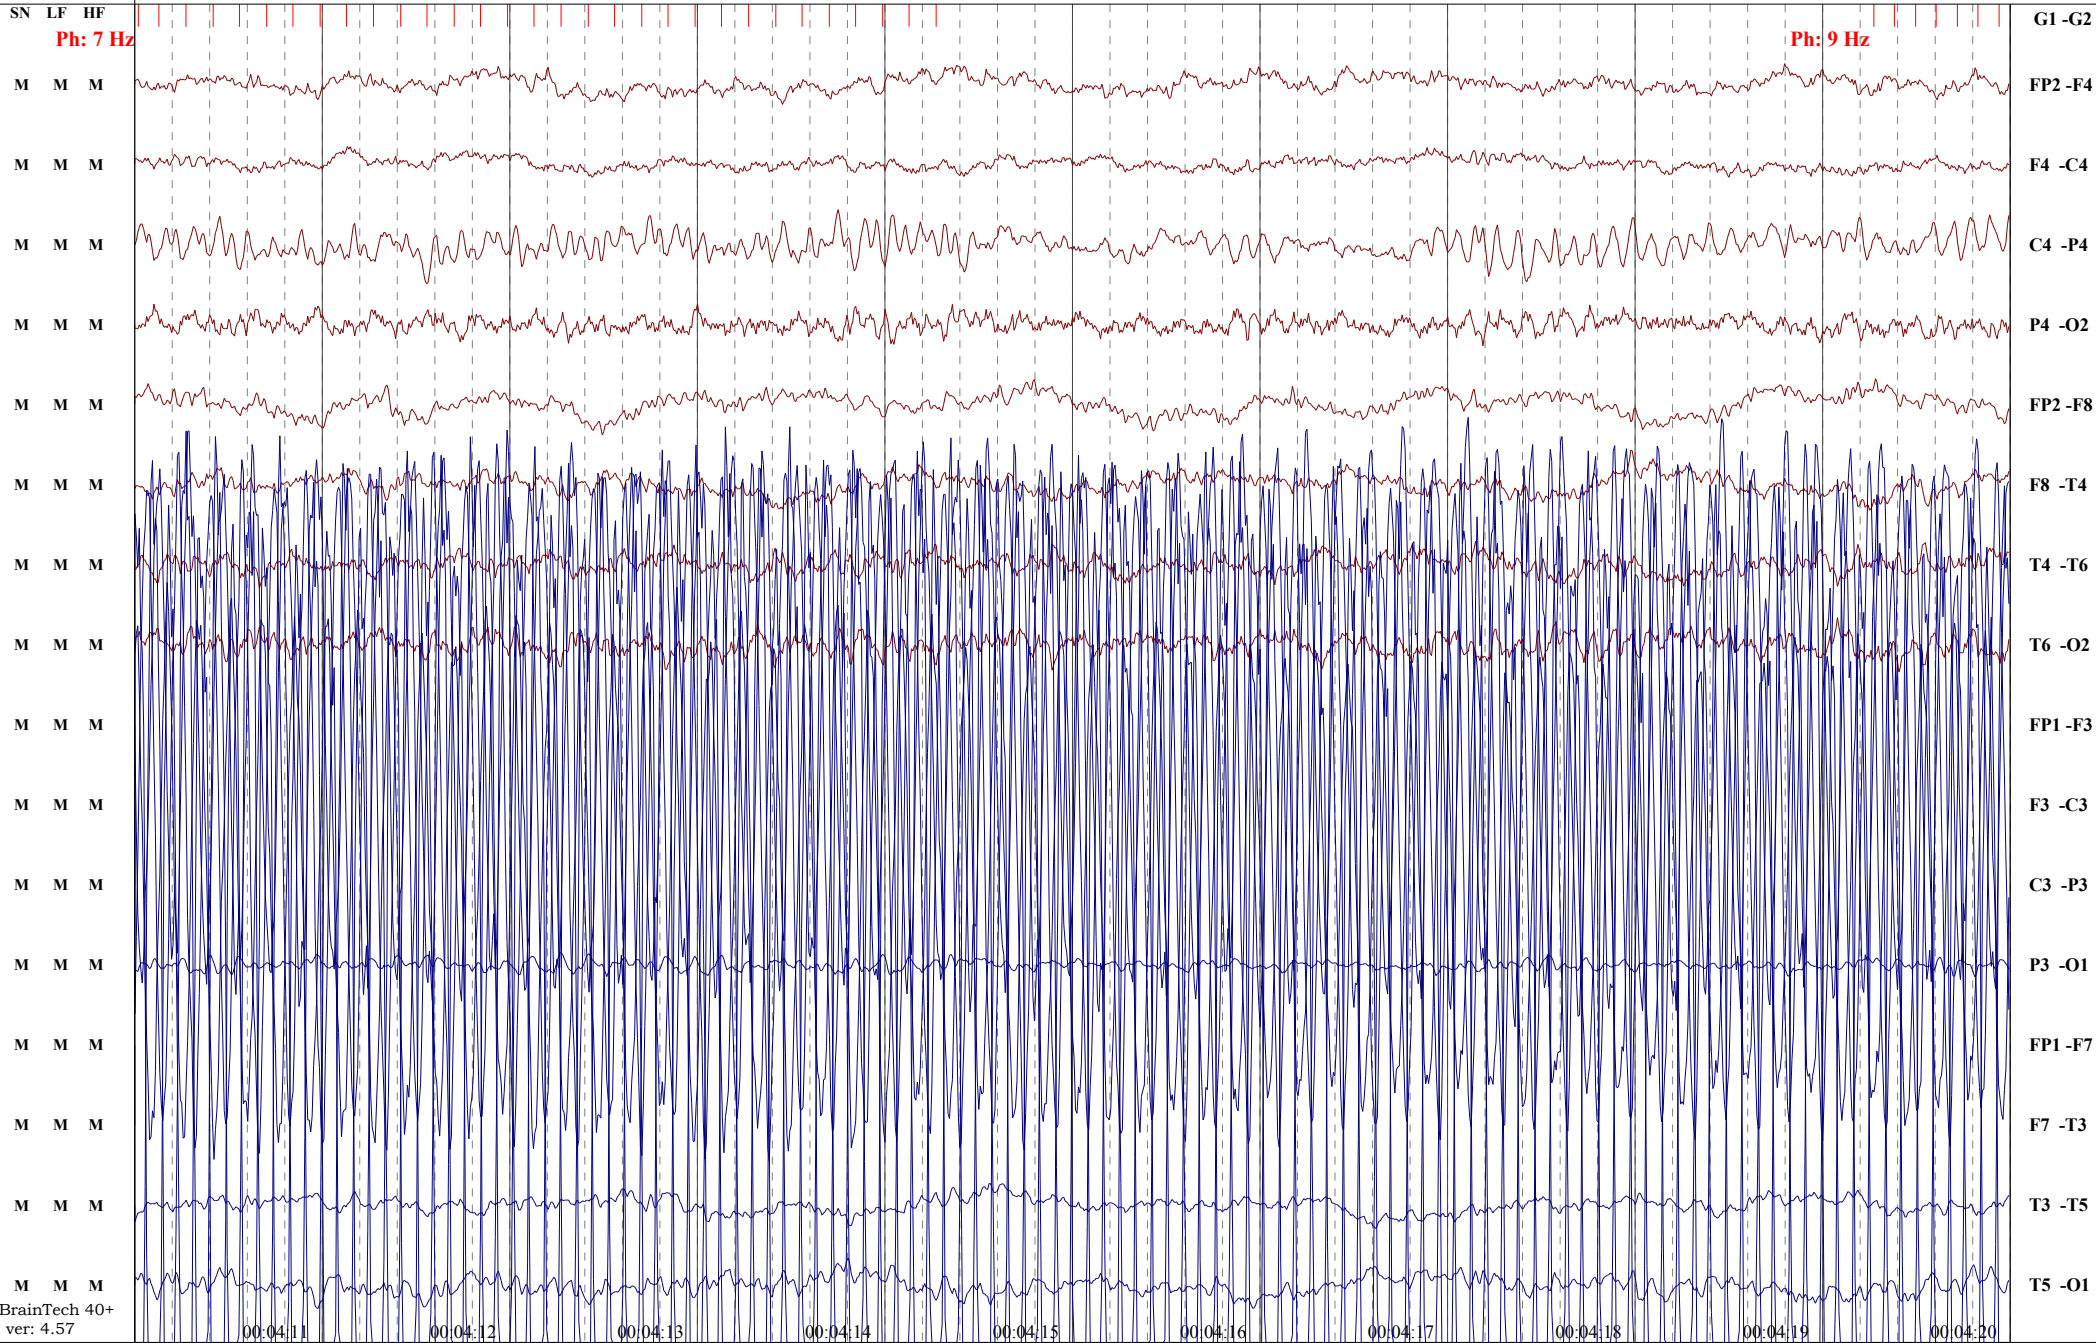

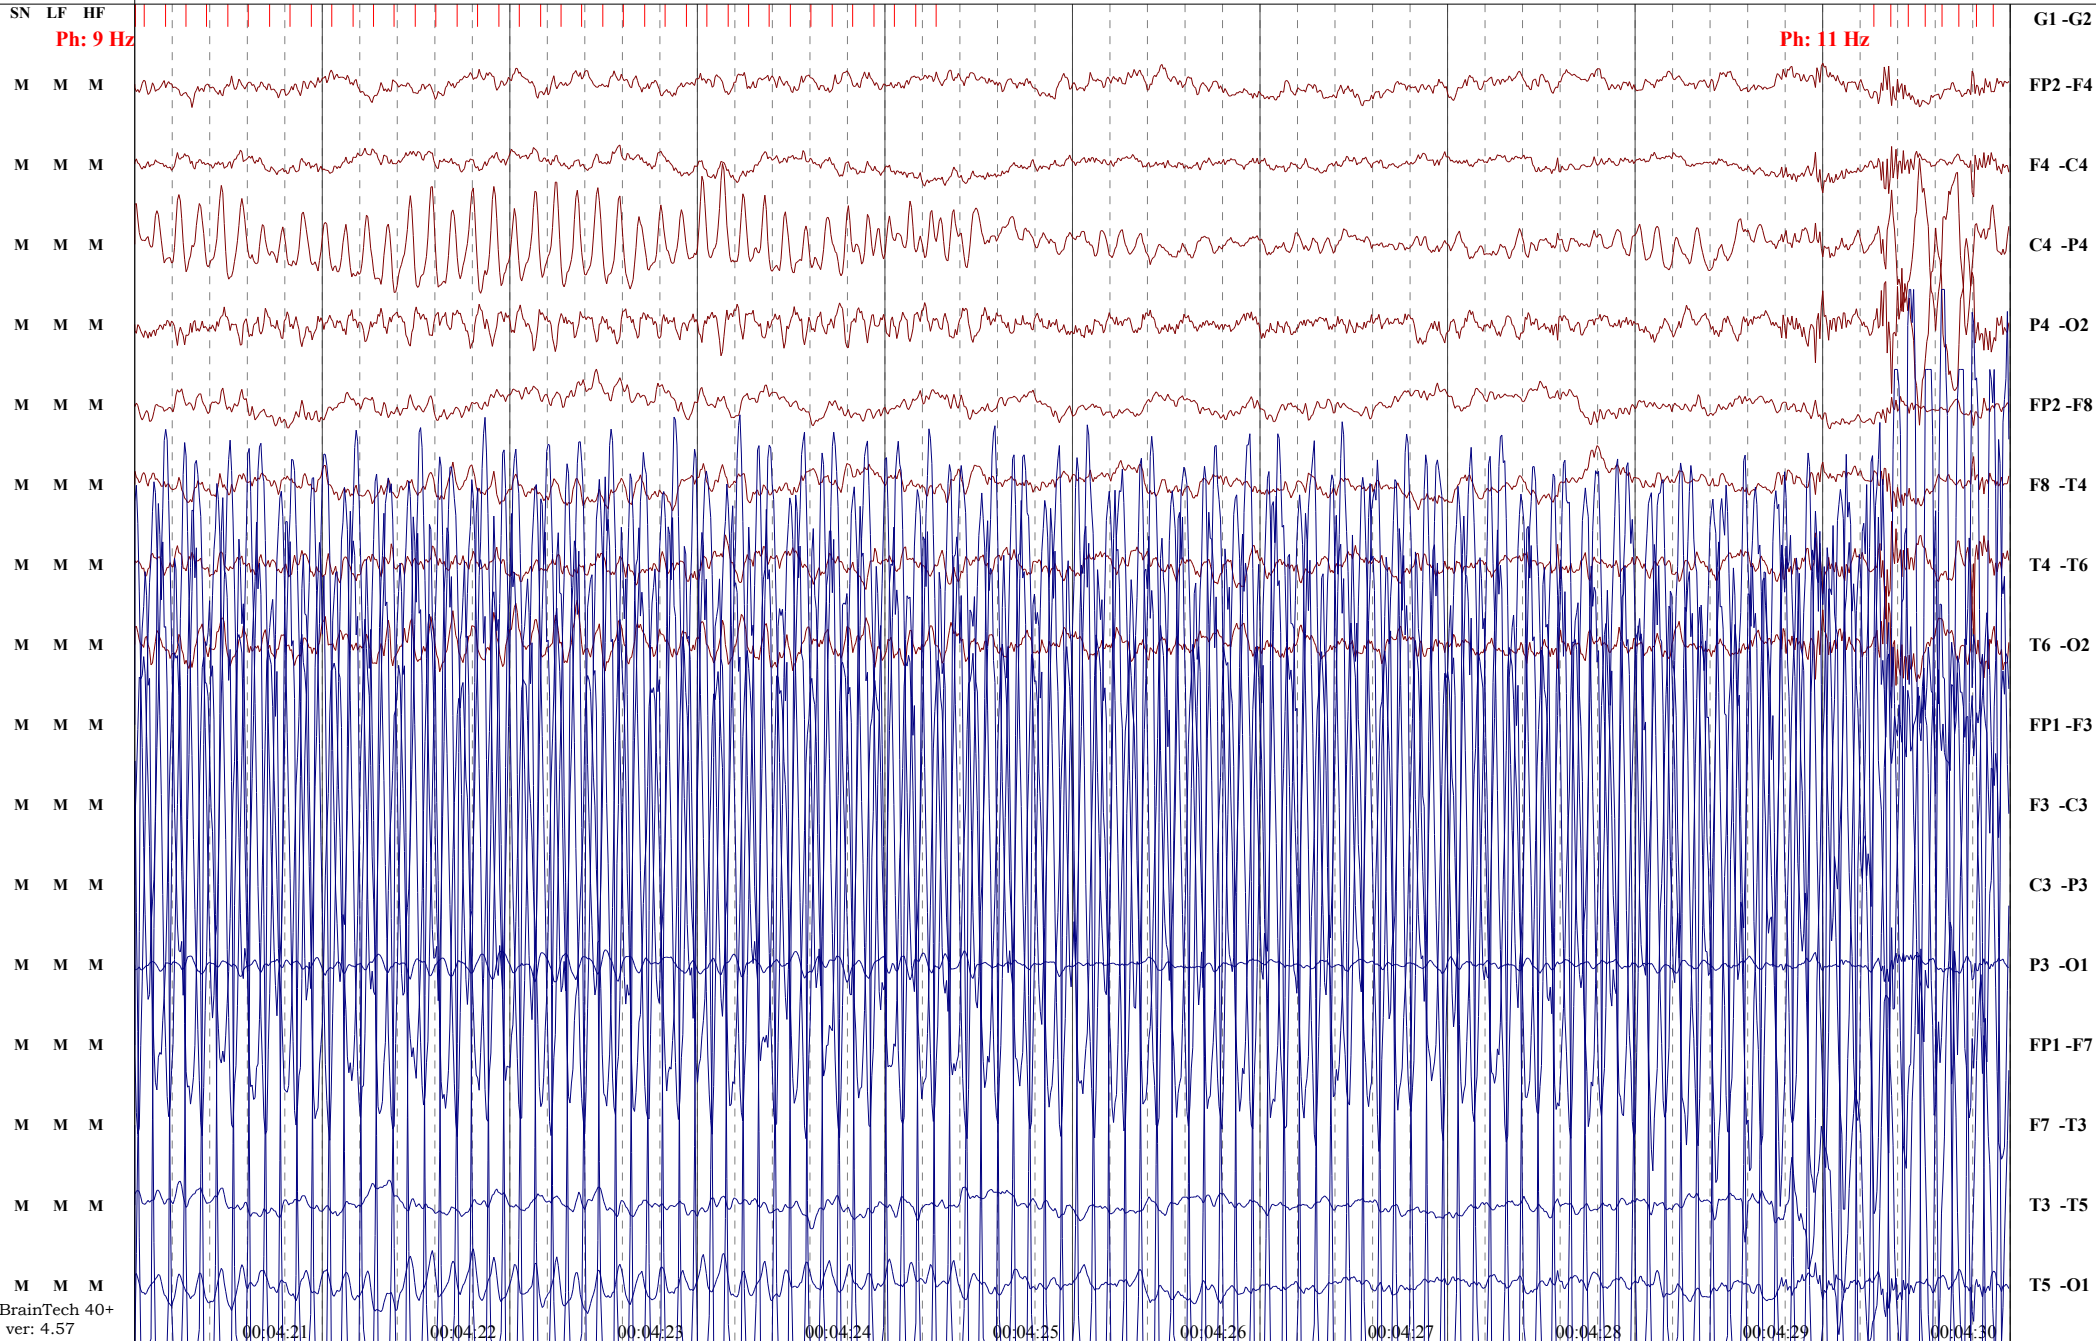

Clarity

PRATHAM HOSPITAL


74
MRS. SHABNAM BEGAM
48 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL


Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 13:58:04
Page:28/35
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

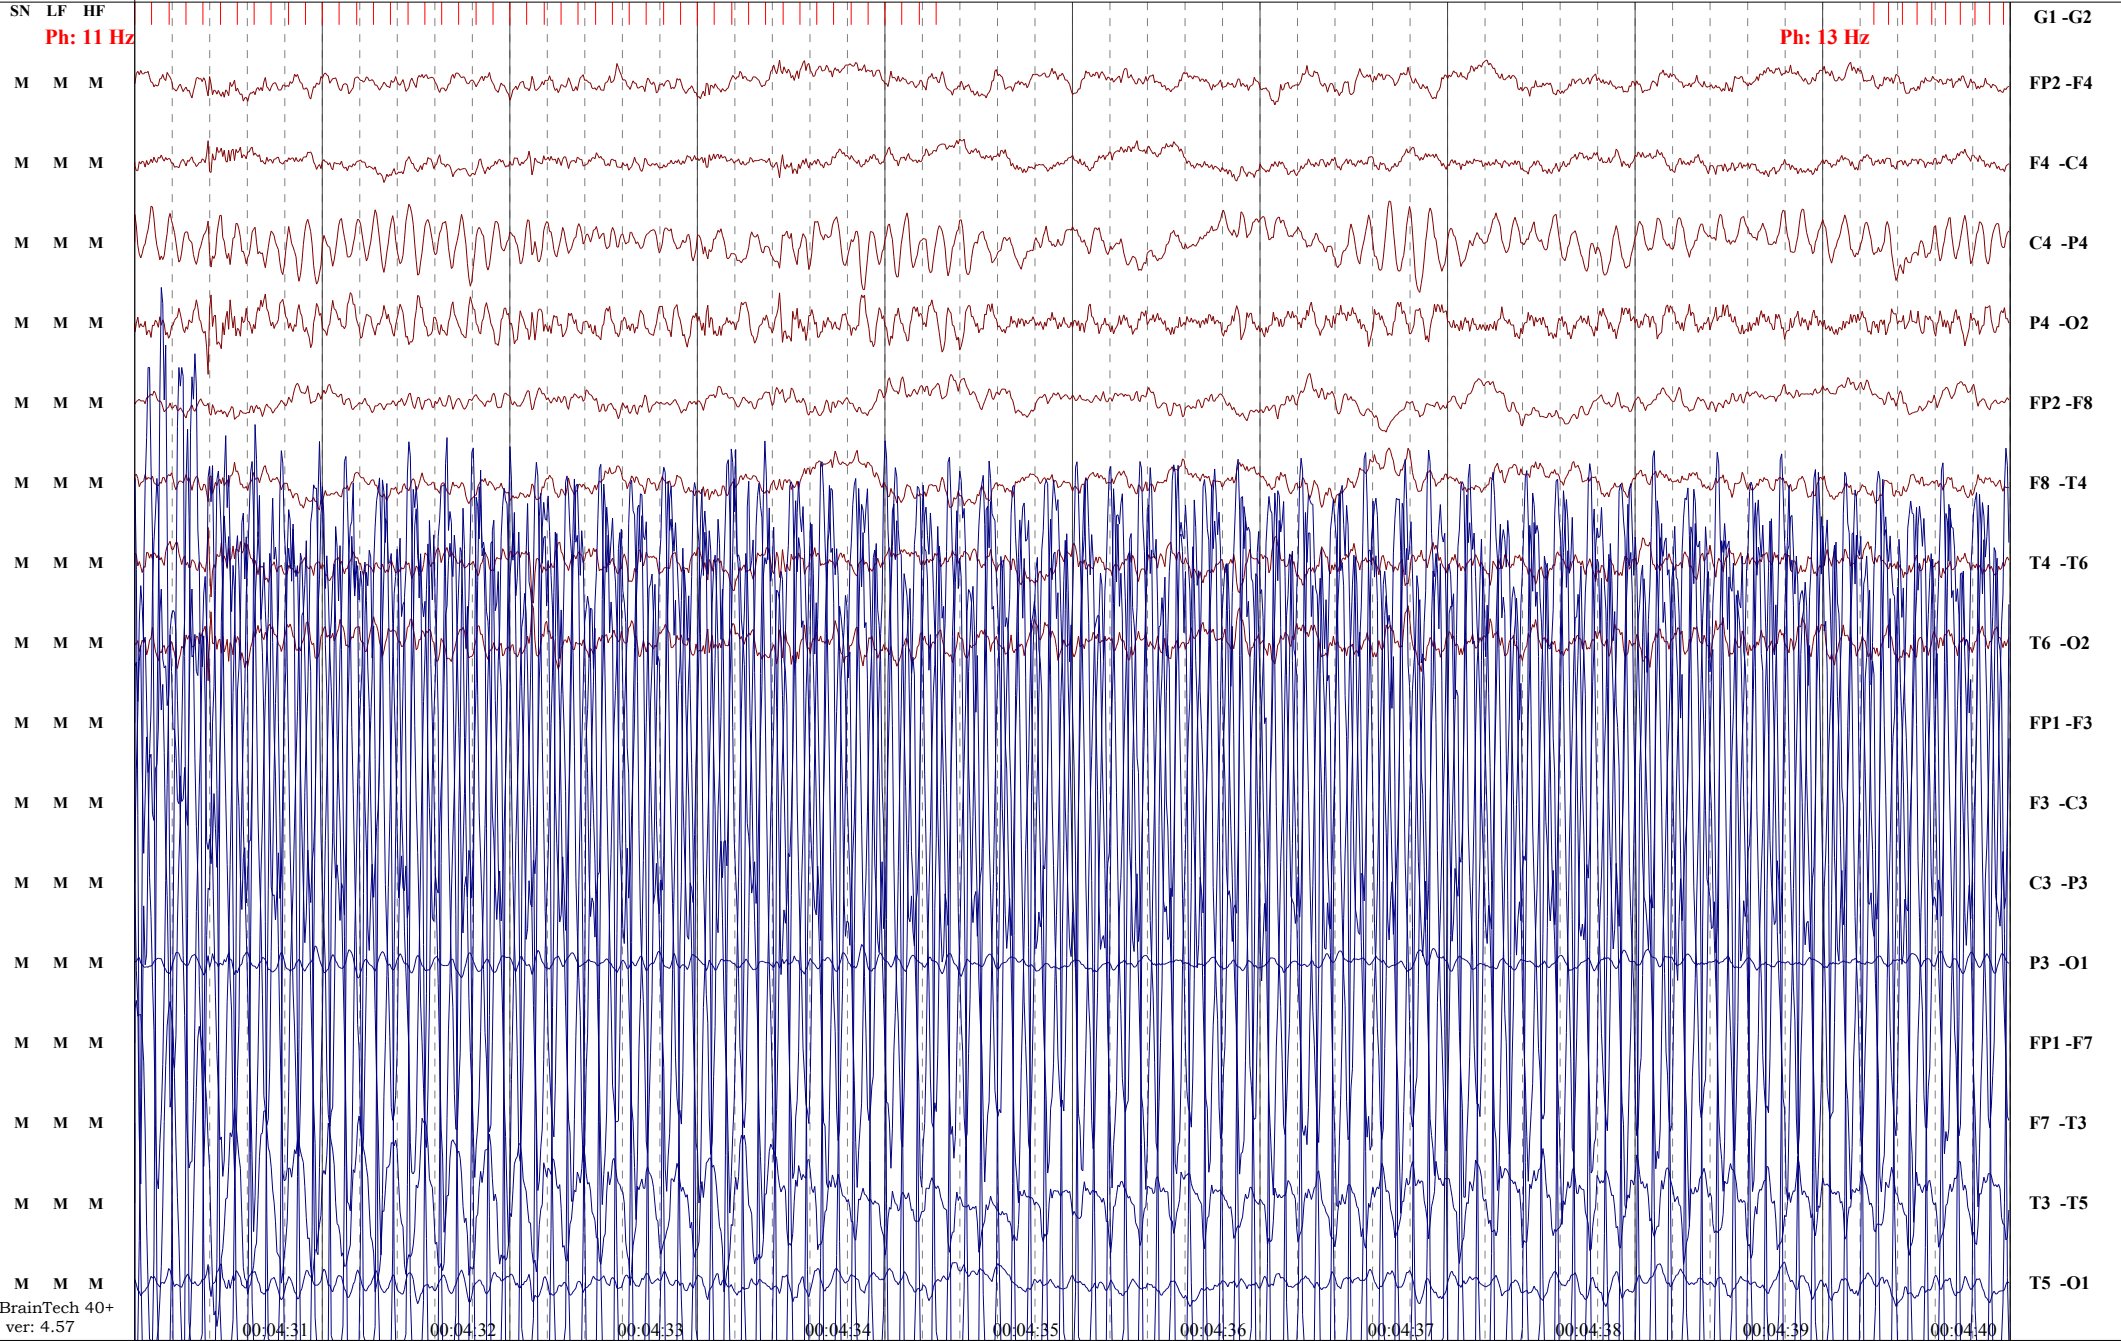

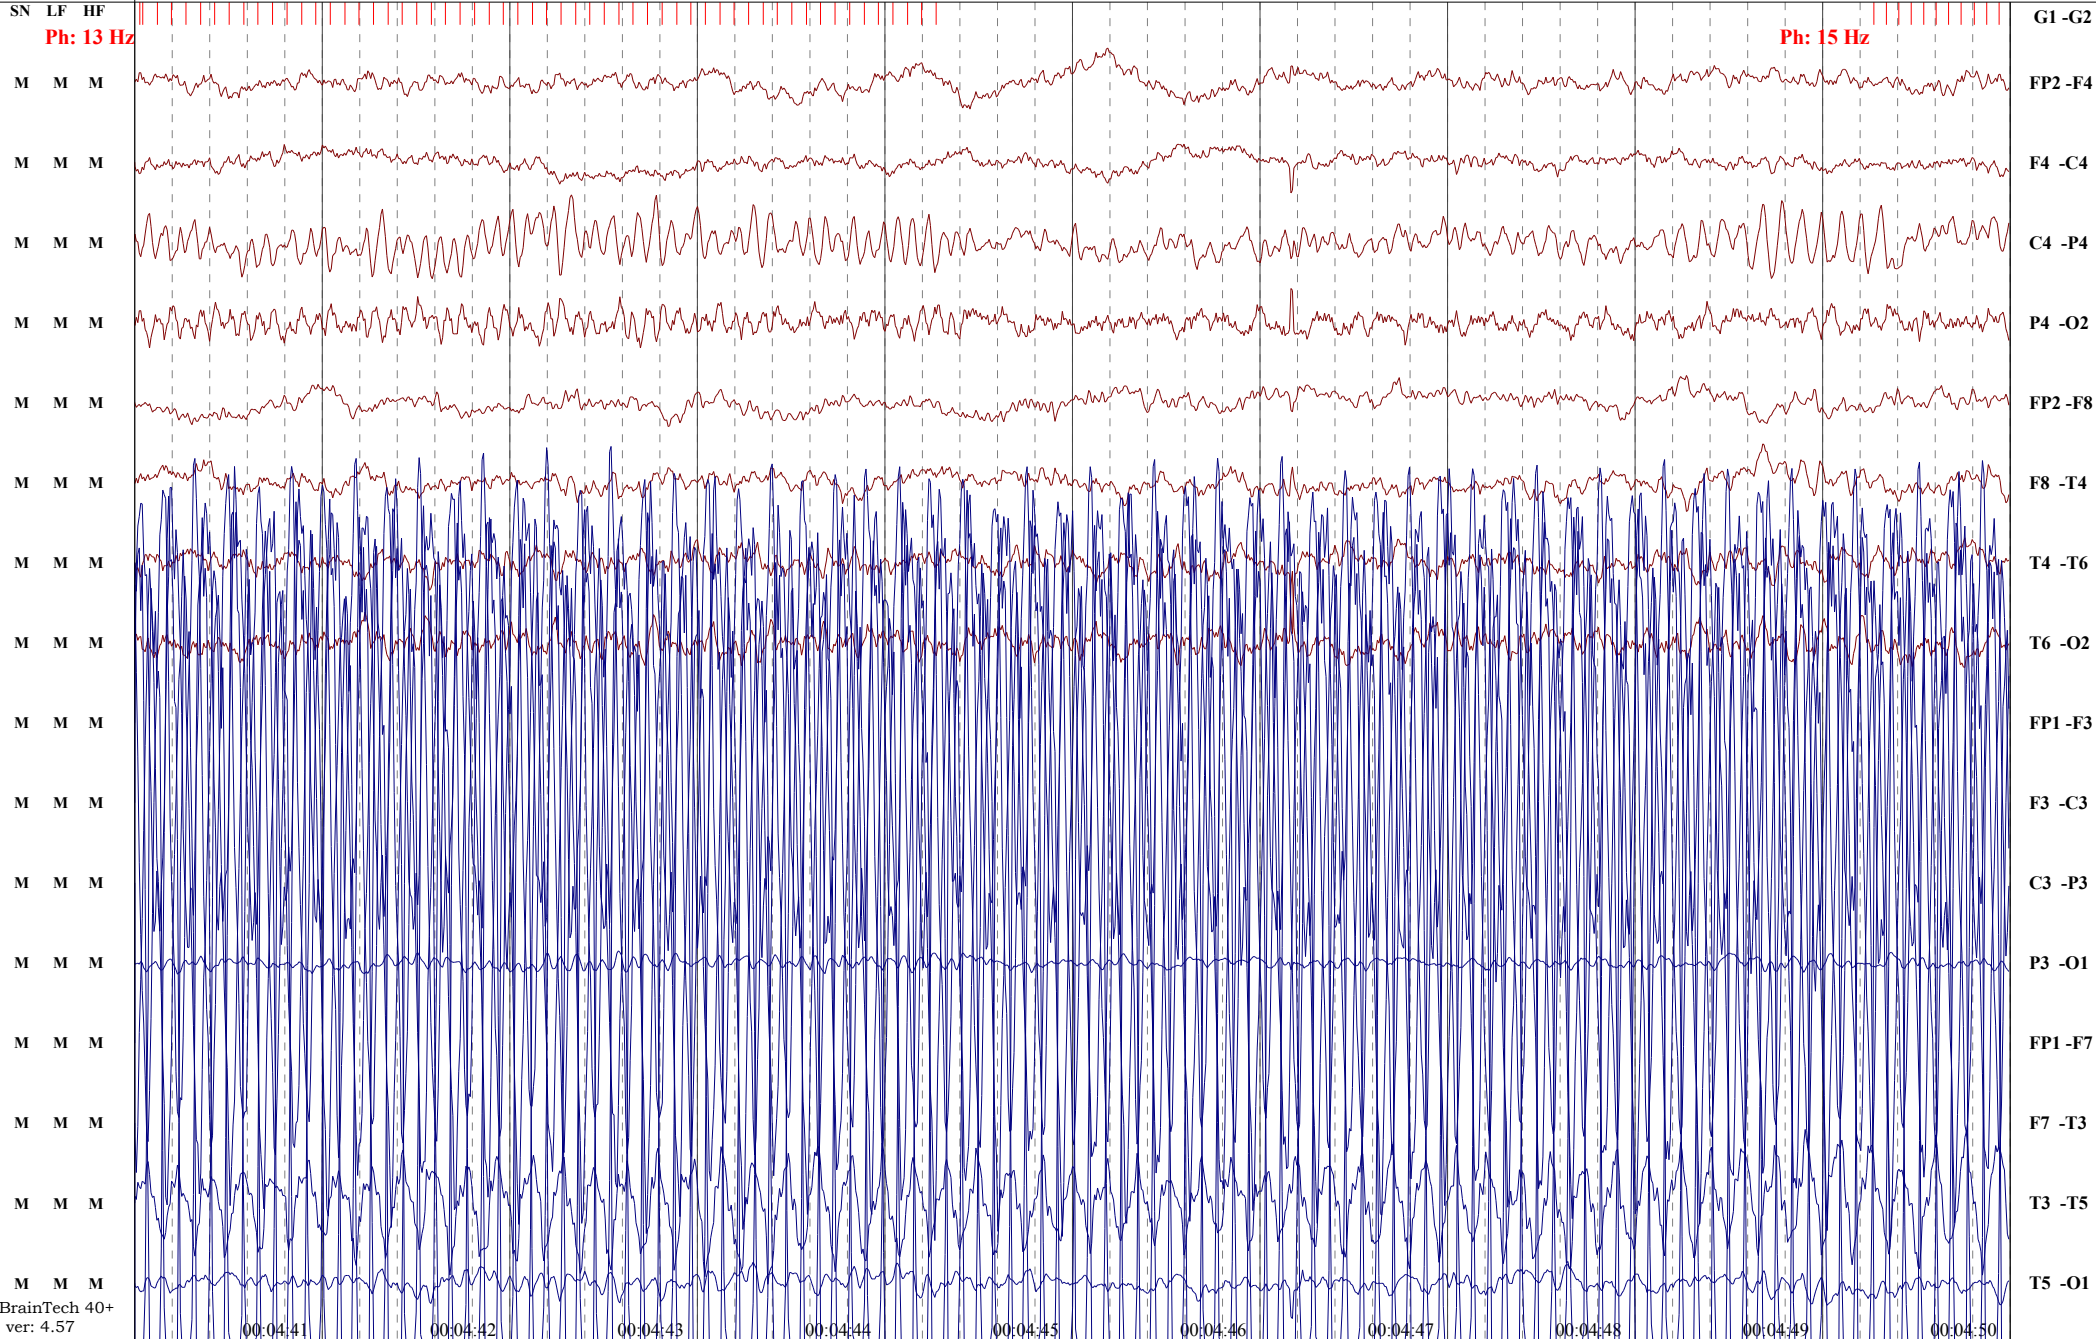

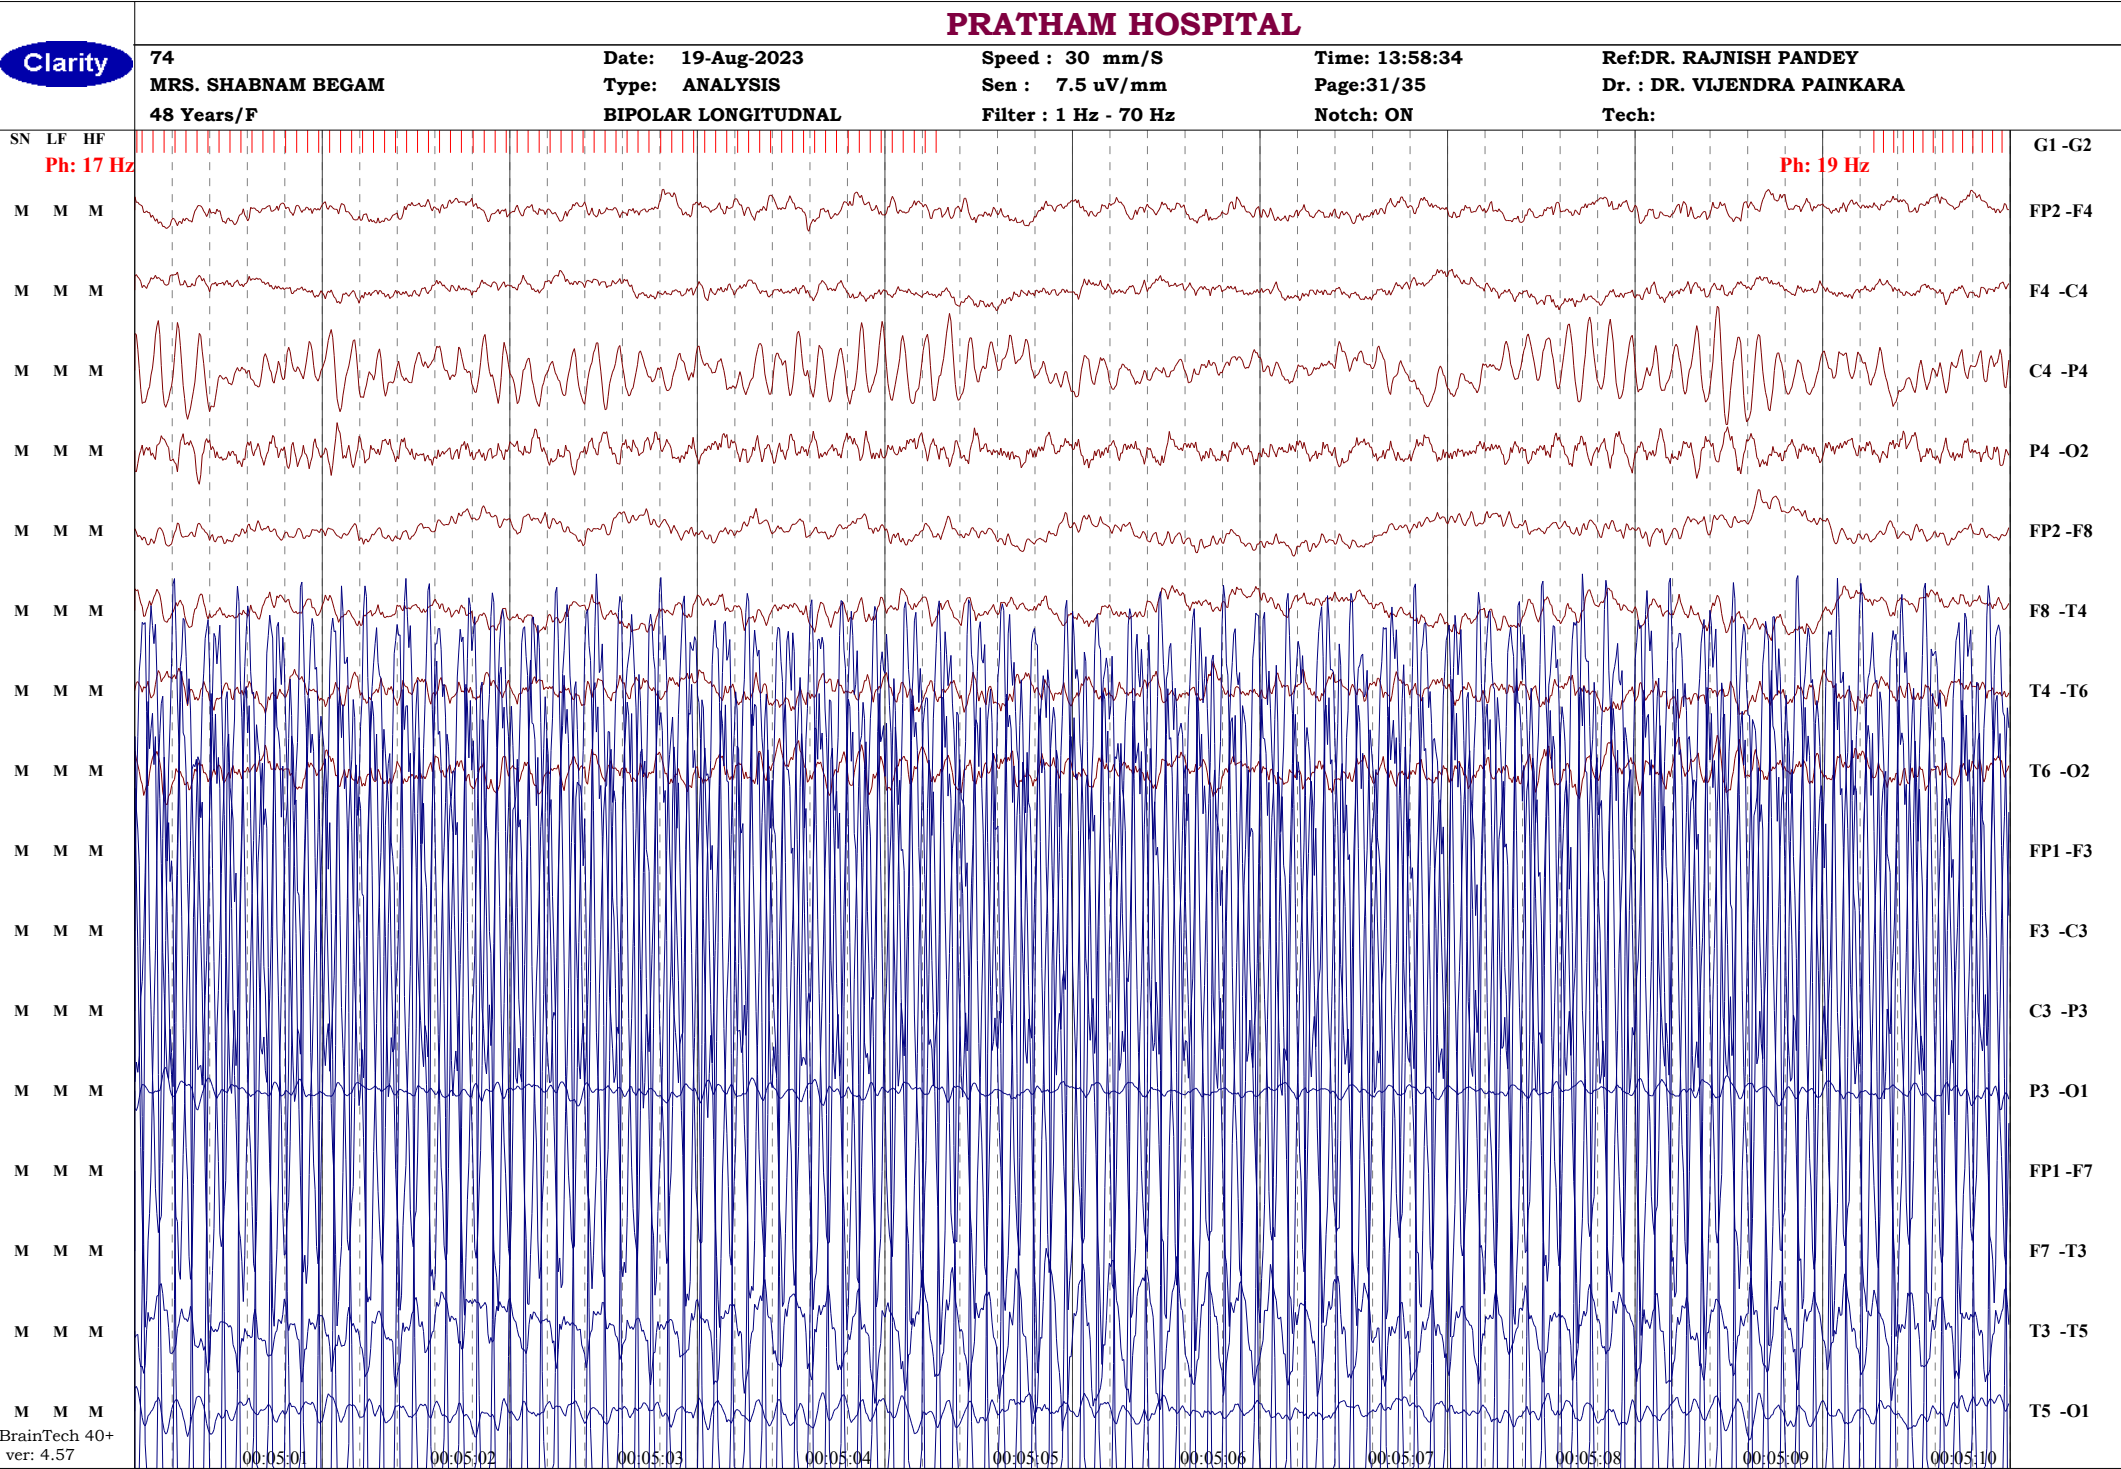

Clarity

PRATHAM HOSPITAL

74

MRS. SHABNAM BEGAM

48 Years/F

Date: 19-Aug-2023

Type: ANALYSIS

BIPOLAR LONGITUDNAL

Speed : 30 mm/S

Sen : 7.5 uV/mm

Filter : 1 Hz - 70 Hz

Time: 13:58:44

Page:32/35

Notch: ON

Ref:DR. RAJNISH PANDEY

Dr. : DR. VIJENDRA PAINKARA

Tech:

