


132
MRS ANJANI LASKAR
33 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:45:36
Page:1/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

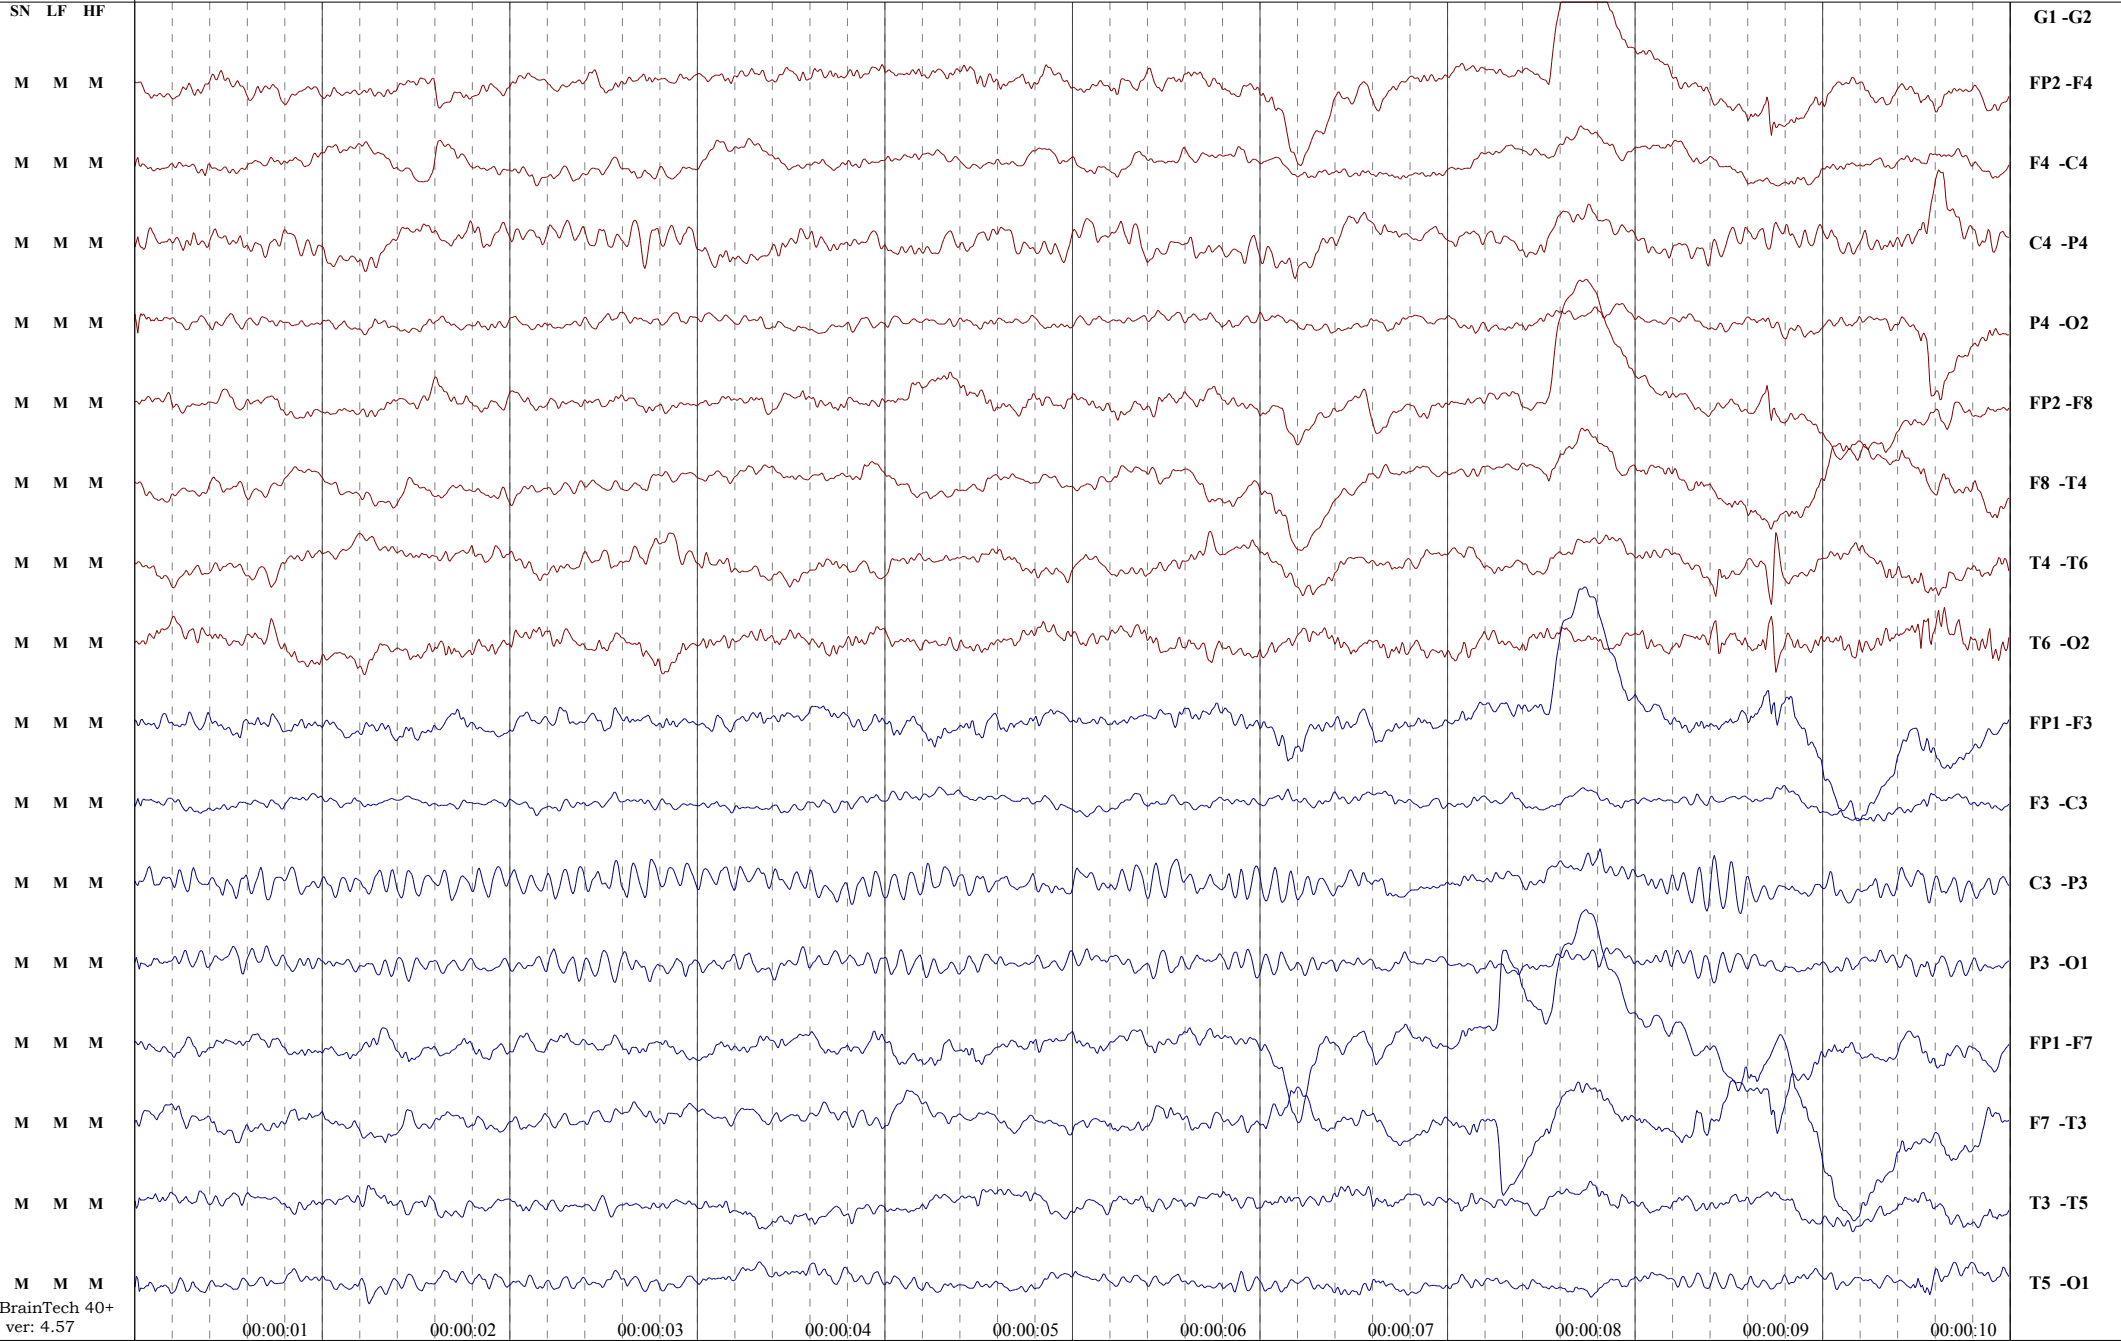

132
MRS ANJANI LASKAR
33 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:45:46
Page:2/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:






132
MRS ANJANI LASKAR
33 Years/F


Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:46:16
Page:5/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

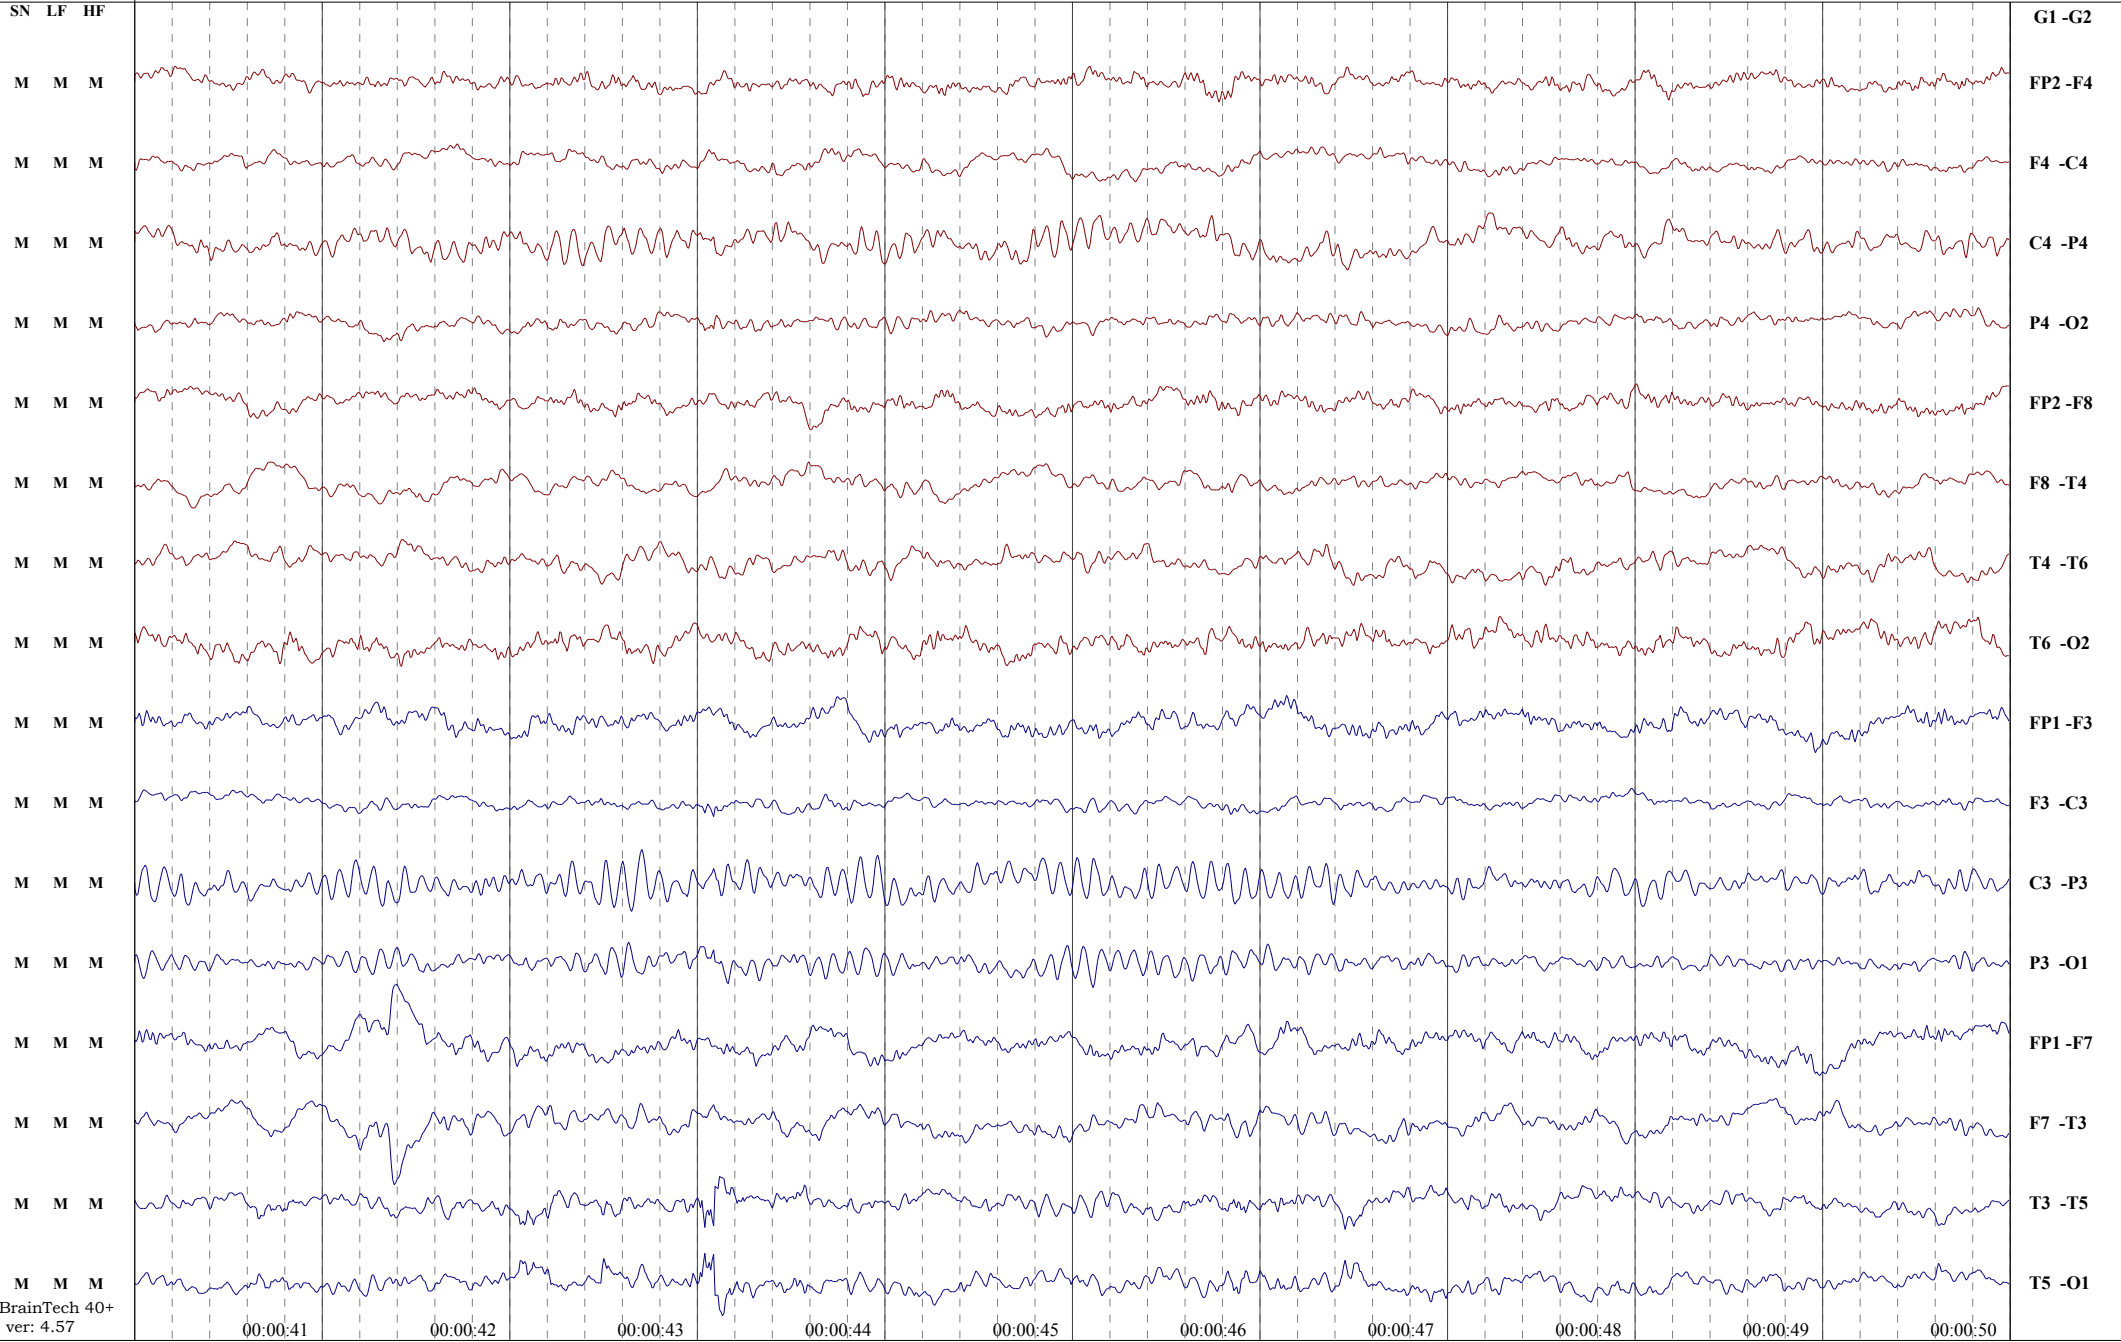

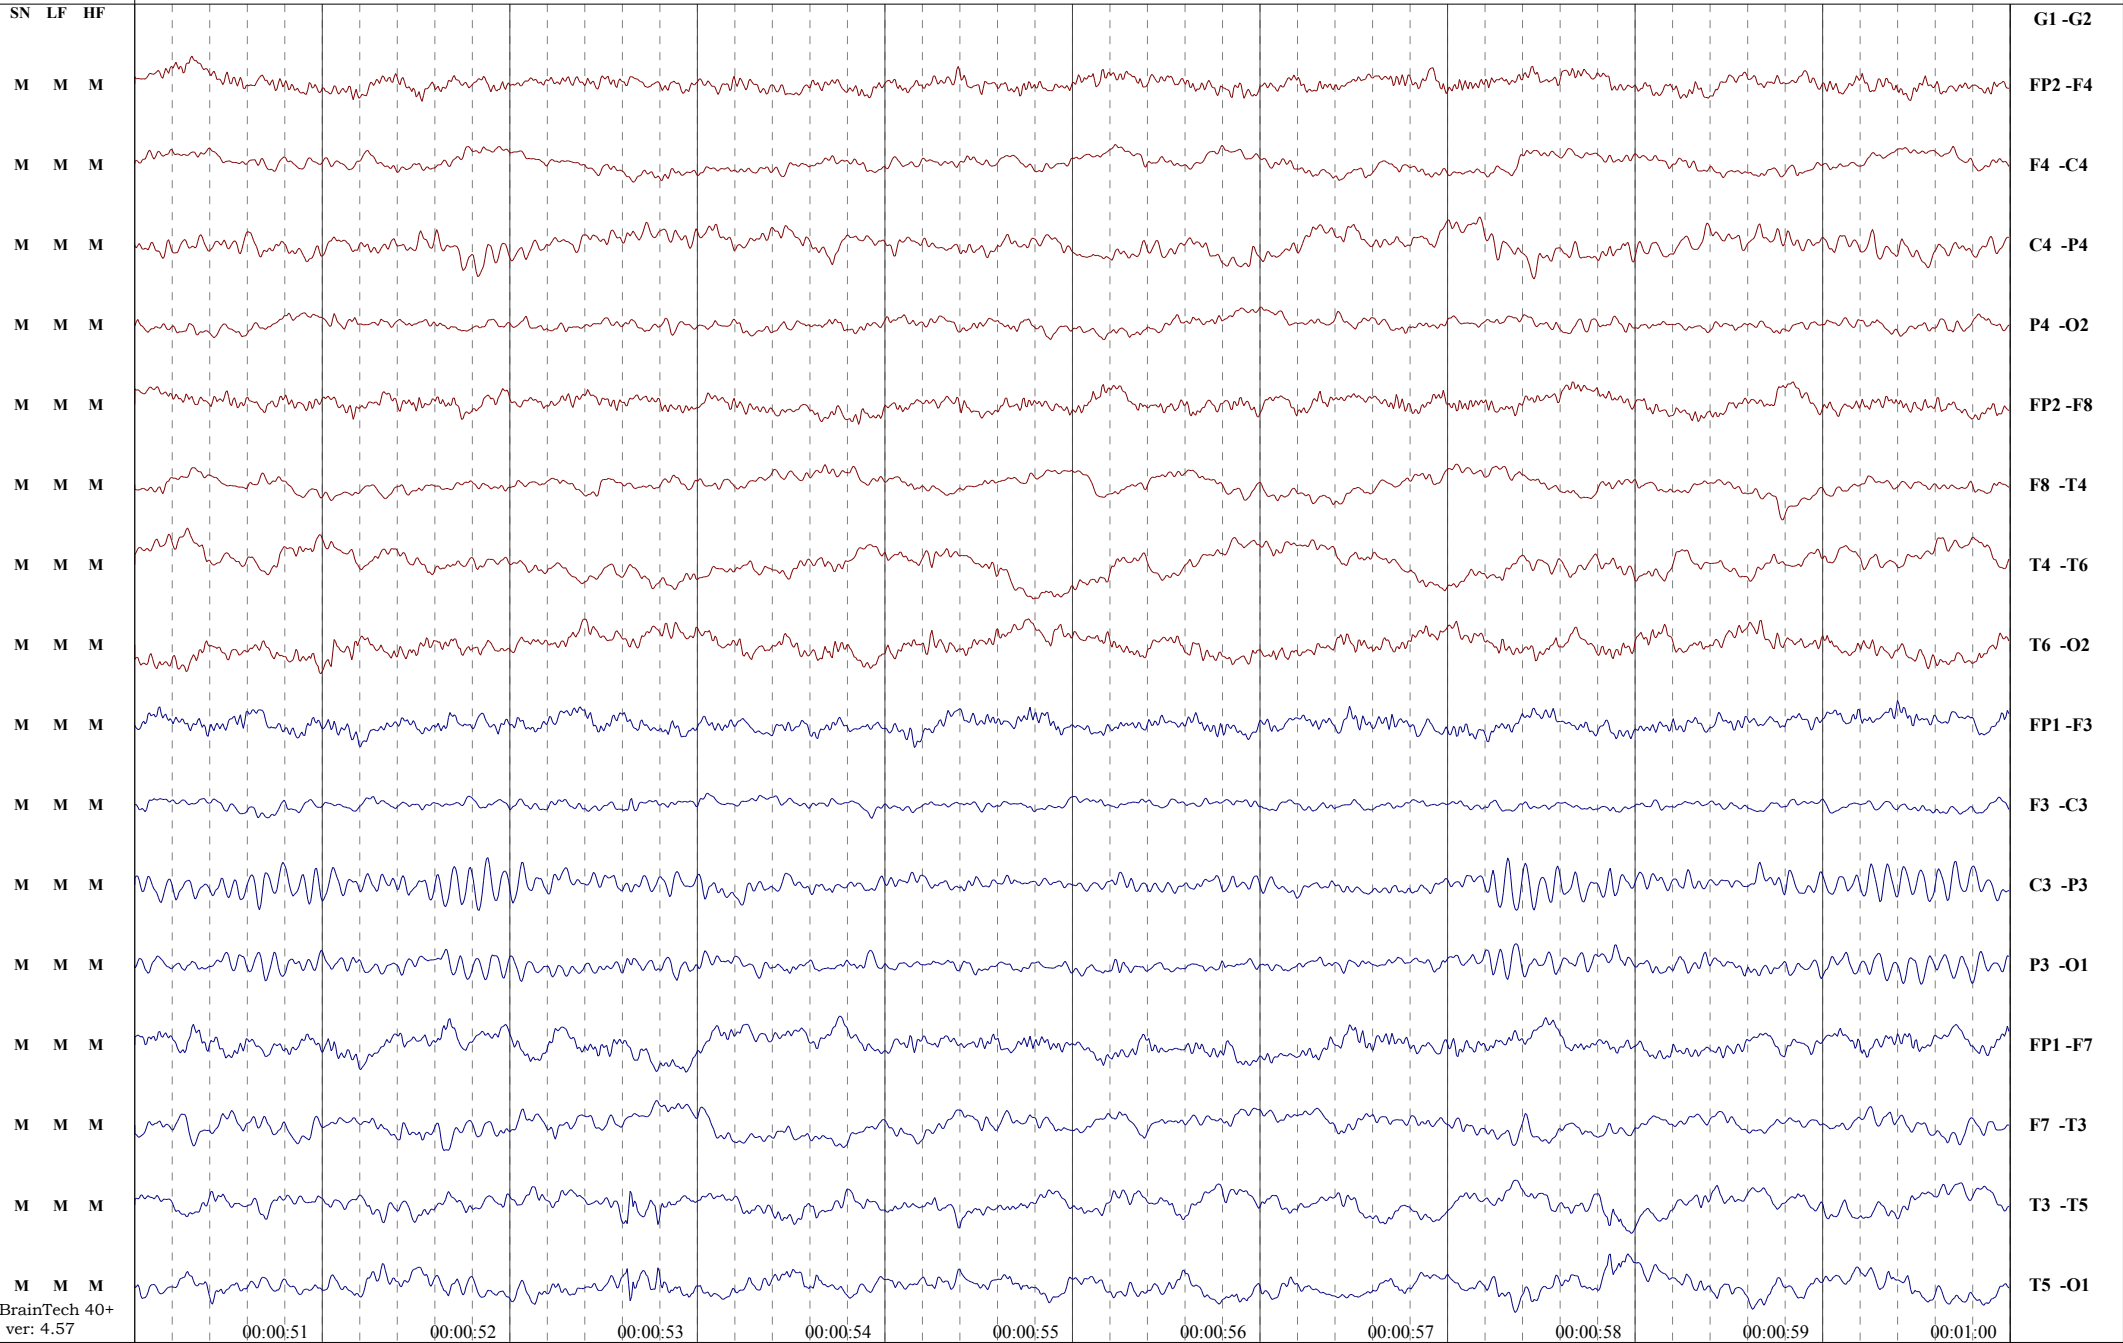

Clarity

132
MRS ANJANI LASKAR
33 Years/F


Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

PRATHAM HOSPITAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:46:36
Page:7/28
Notch: ON


Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

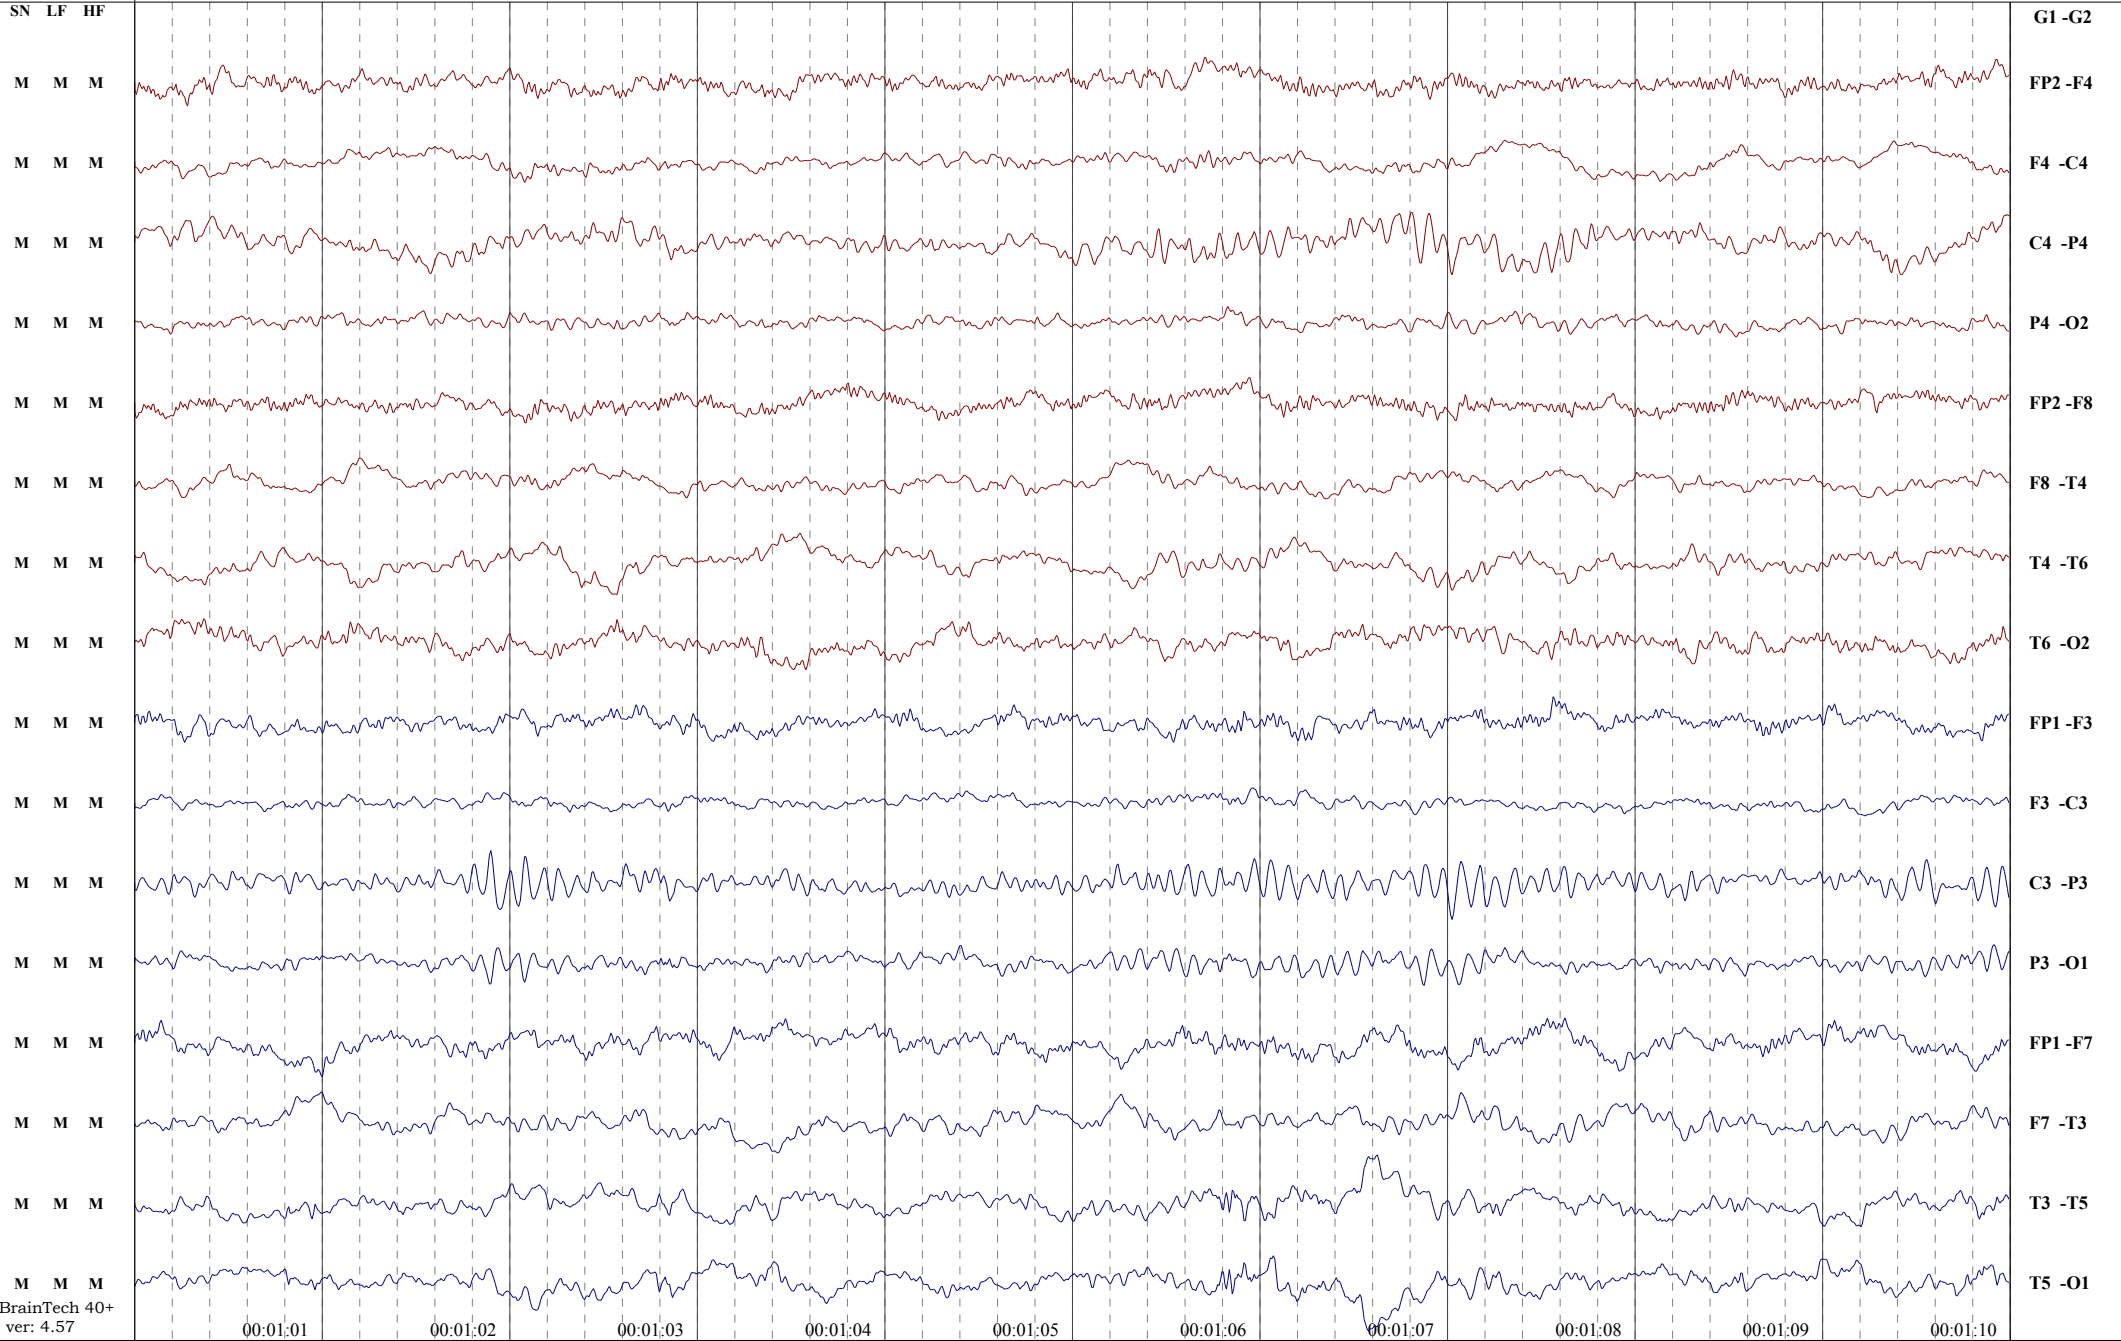



<div>Clarity</div>			<div>PRATHAM HOSPITAL</div>															
132			Date: 11-Sep-2023				Speed : 30 mm/S				Time: 17:46:56				Ref:DR RAJNISH PANDEY			
MRS ANJANI LASKAR			Type: ANALYSIS				Sen : 7.5 uV/mm				Page:9/28				Dr. : DR. VIJENDRA PAINKARA			
33 Years/F			BIPOLAR LONGITUDNAL				Filter : 1 Hz - 70 Hz				Notch: ON				Tech:			
SN	LF	HF													G1 -G2			
M	M	M													FP2 -F4			
M	M	M													F4 -C4			
M	M	M													C4 -P4			
M	M	M													P4 -O2			
M	M	M													FP2 -F8			
M	M	M													F8 -T4			
M	M	M													T4 -T6			
M	M	M													T6 -O2			
M	M	M													FP1 -F3			
M	M	M													F3 -C3			
M	M	M													C3 -P3			
M	M	M													P3 -O1			
M	M	M													FP1 -F7			
M	M	M													F7 -T3			
M	M	M													T3 -T5			
M	M	M													T5 -O1			
BrainTech 40+ ver: 4.57																		
			00:01:21 00:01:22 00:01:23 00:01:24 00:01:25 00:01:26 00:01:27 00:01:28 00:01:29 00:01:30															

BrainTech 40+
ver: 4.57

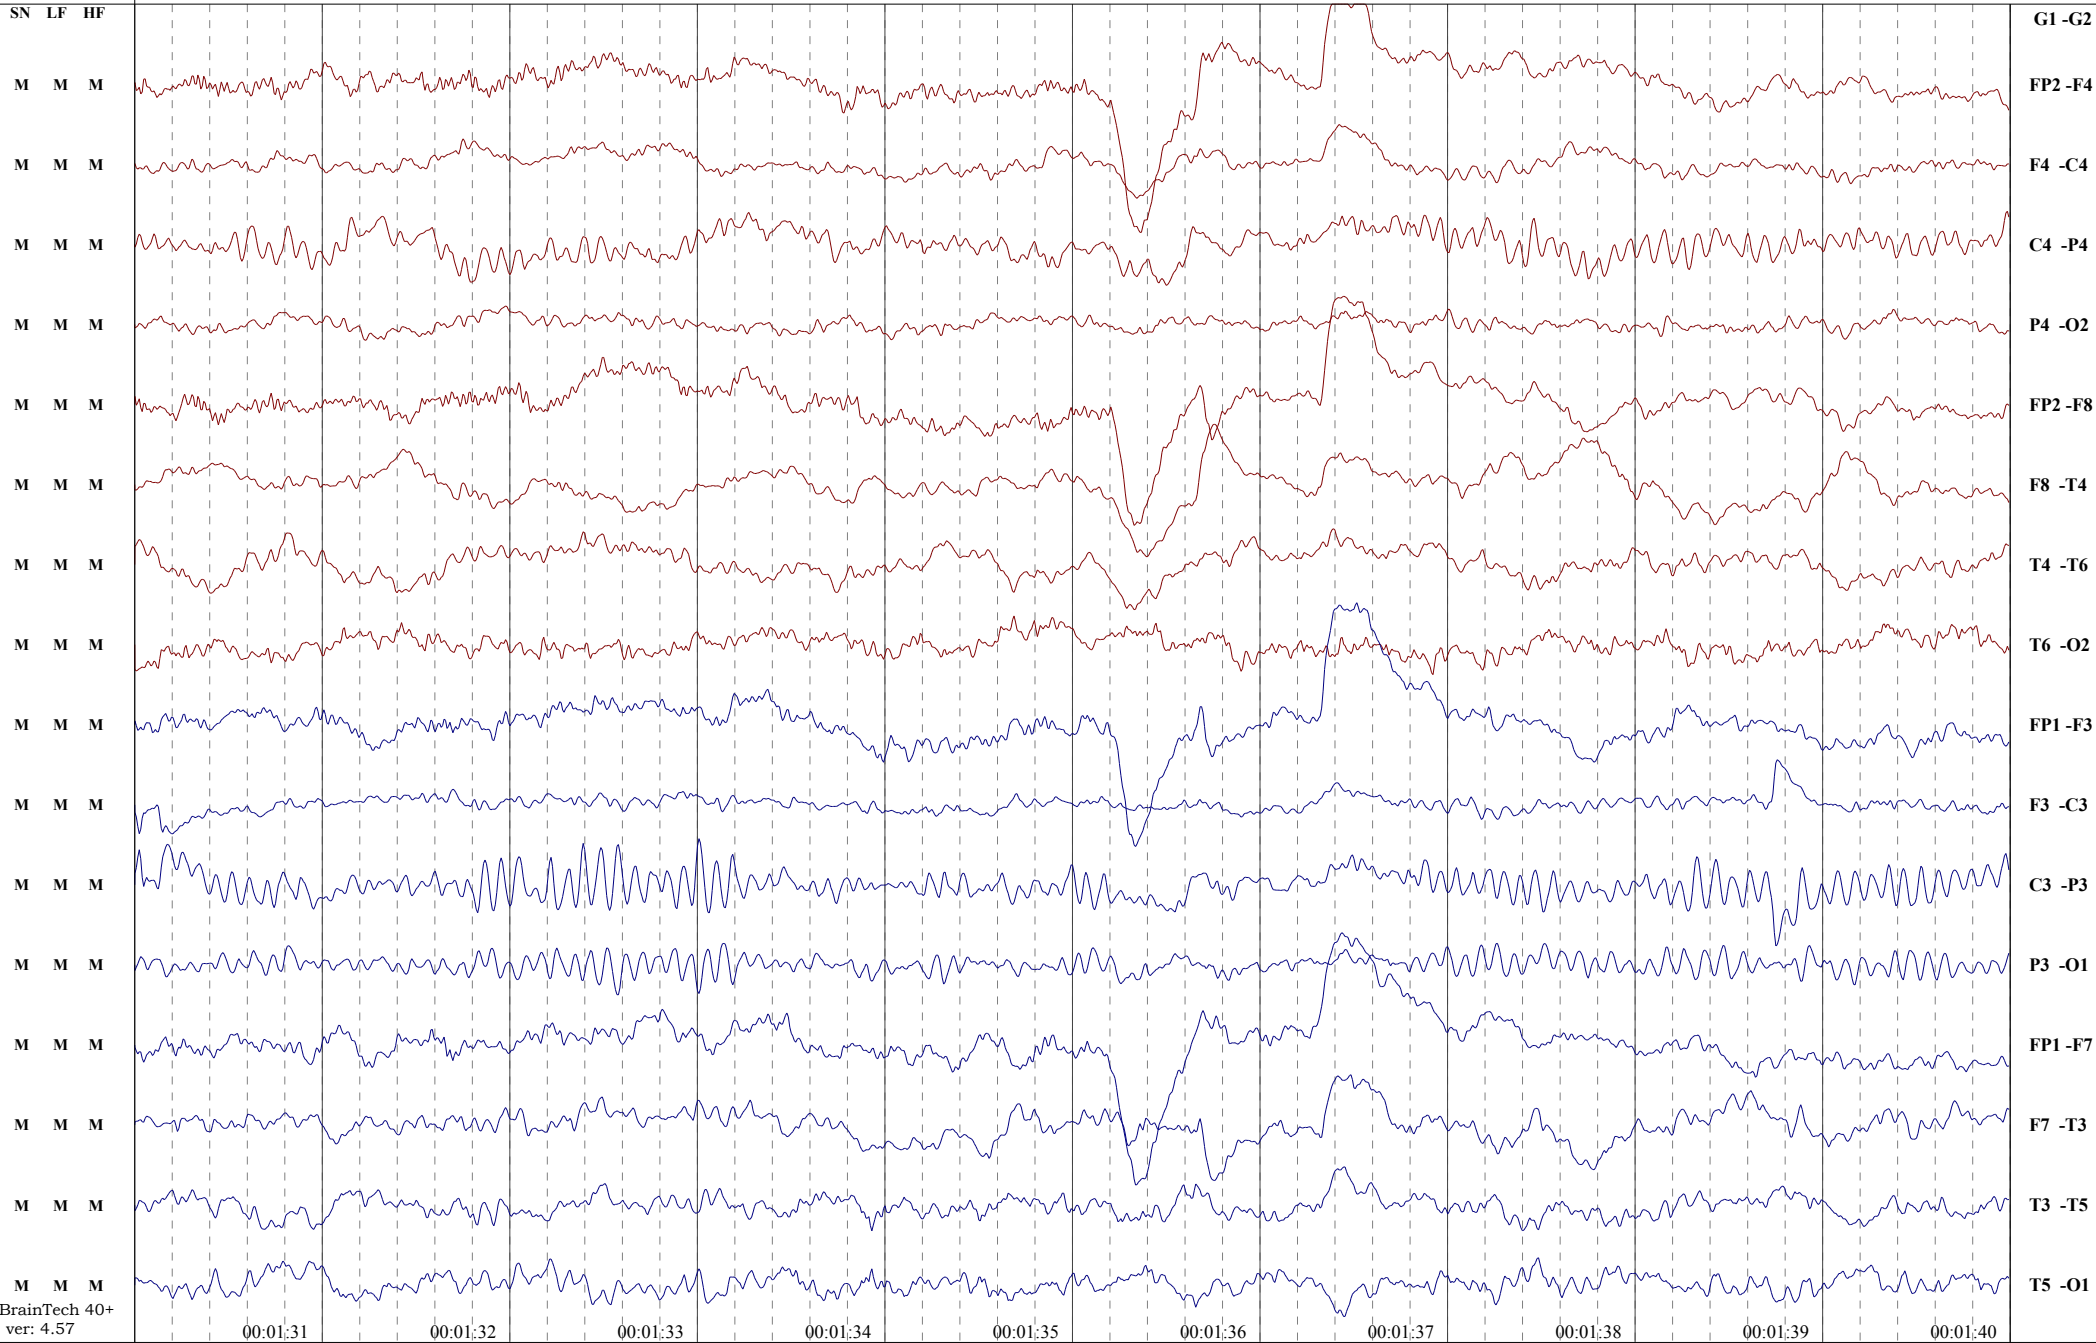


132
MRS ANJANI LASKAR
33 Years/F


Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:47:26
Page:12/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

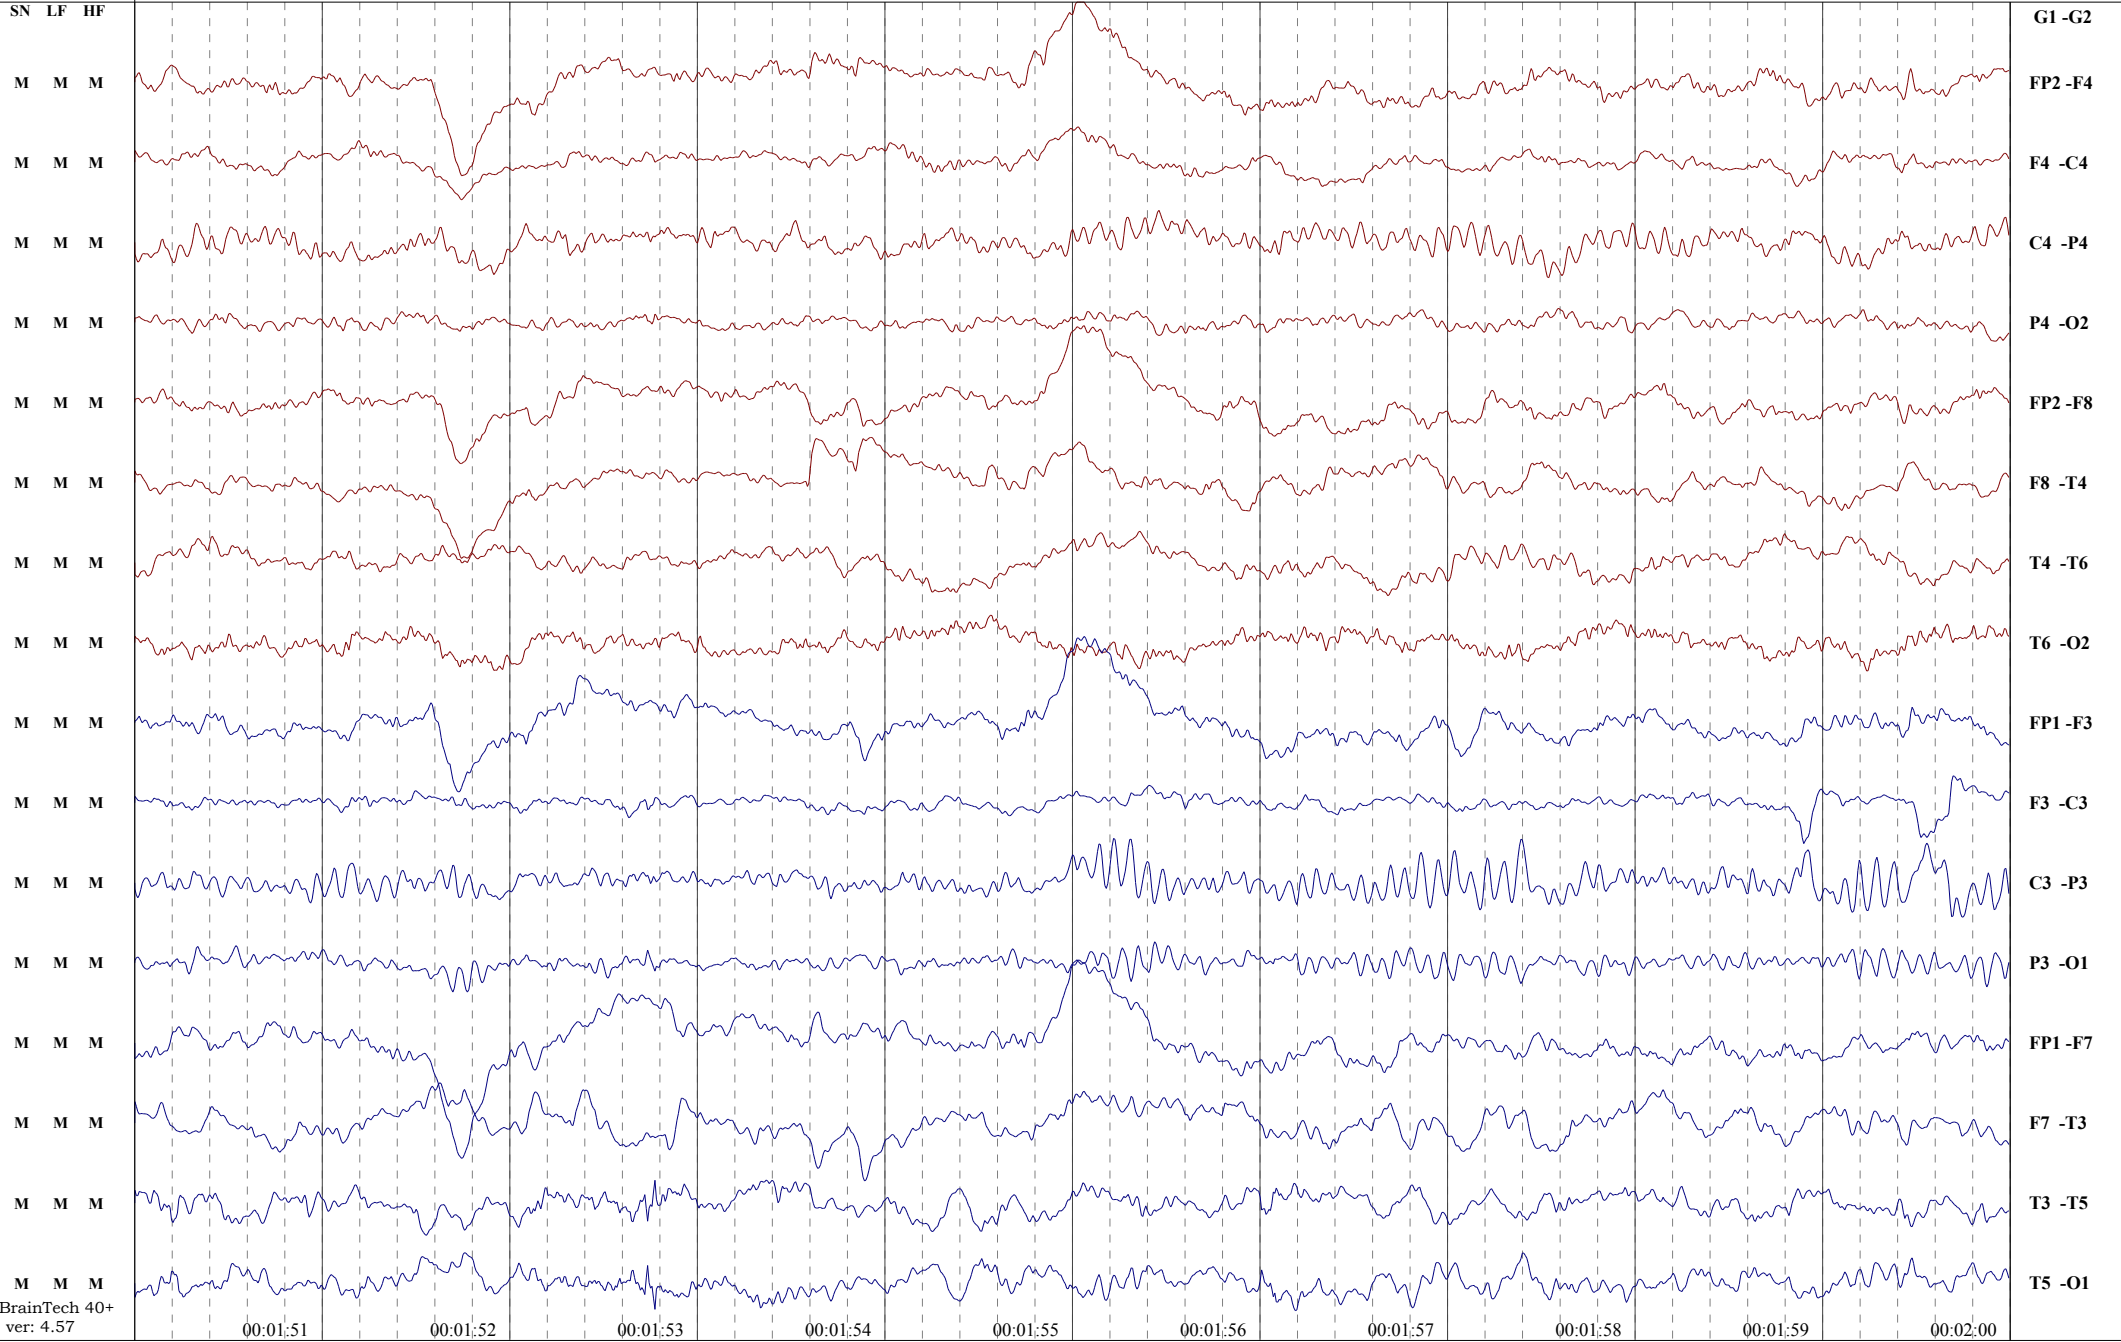

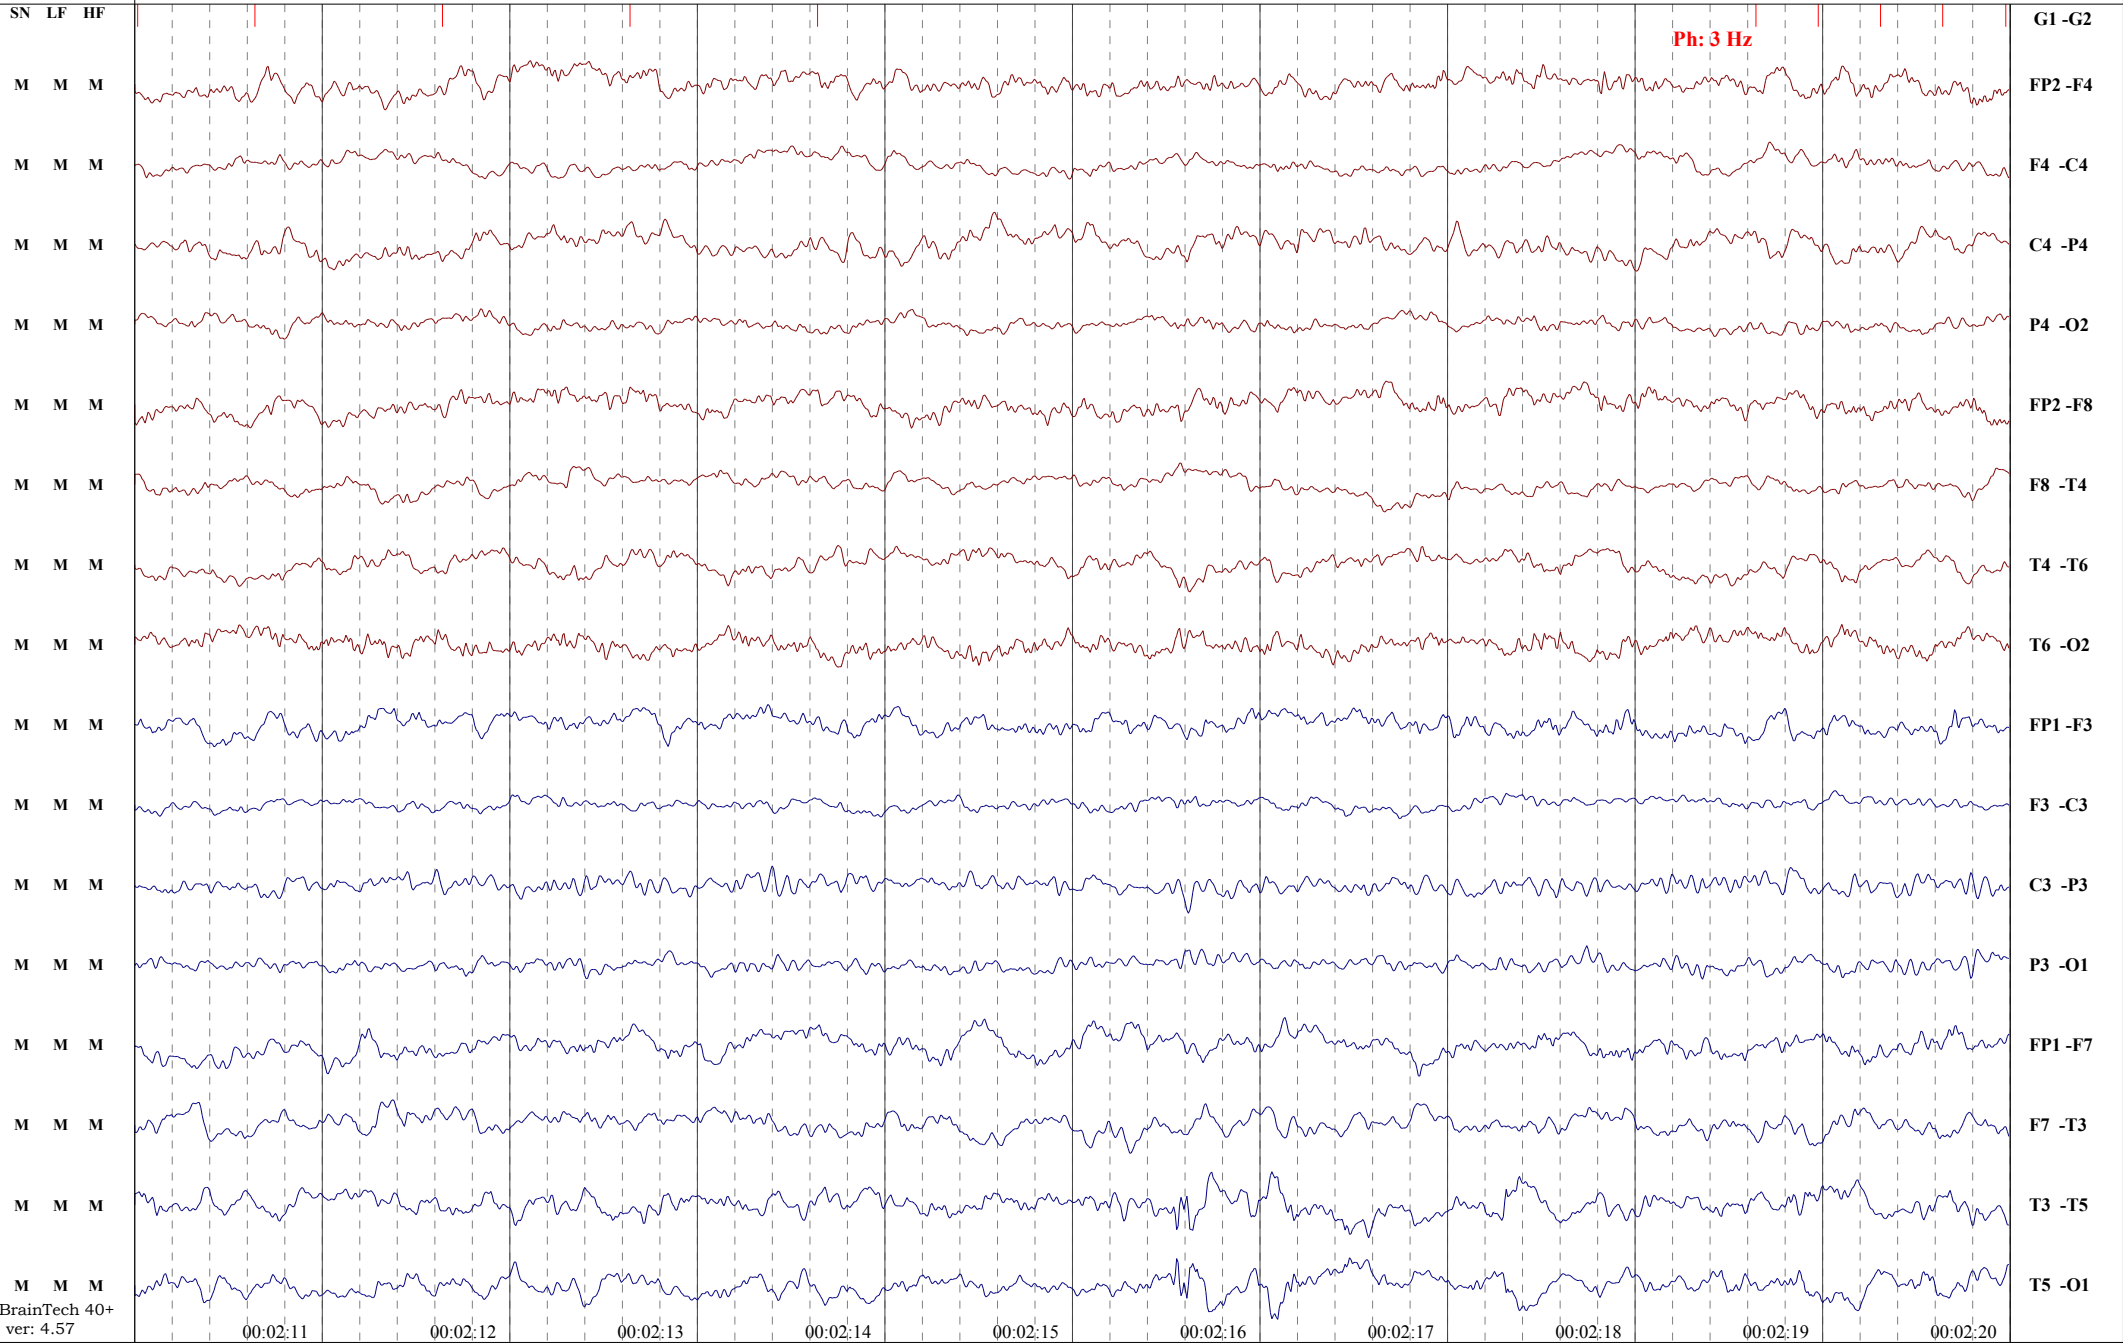


132
MRS ANJANI LASKAR
33 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:48:06
Page:16/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

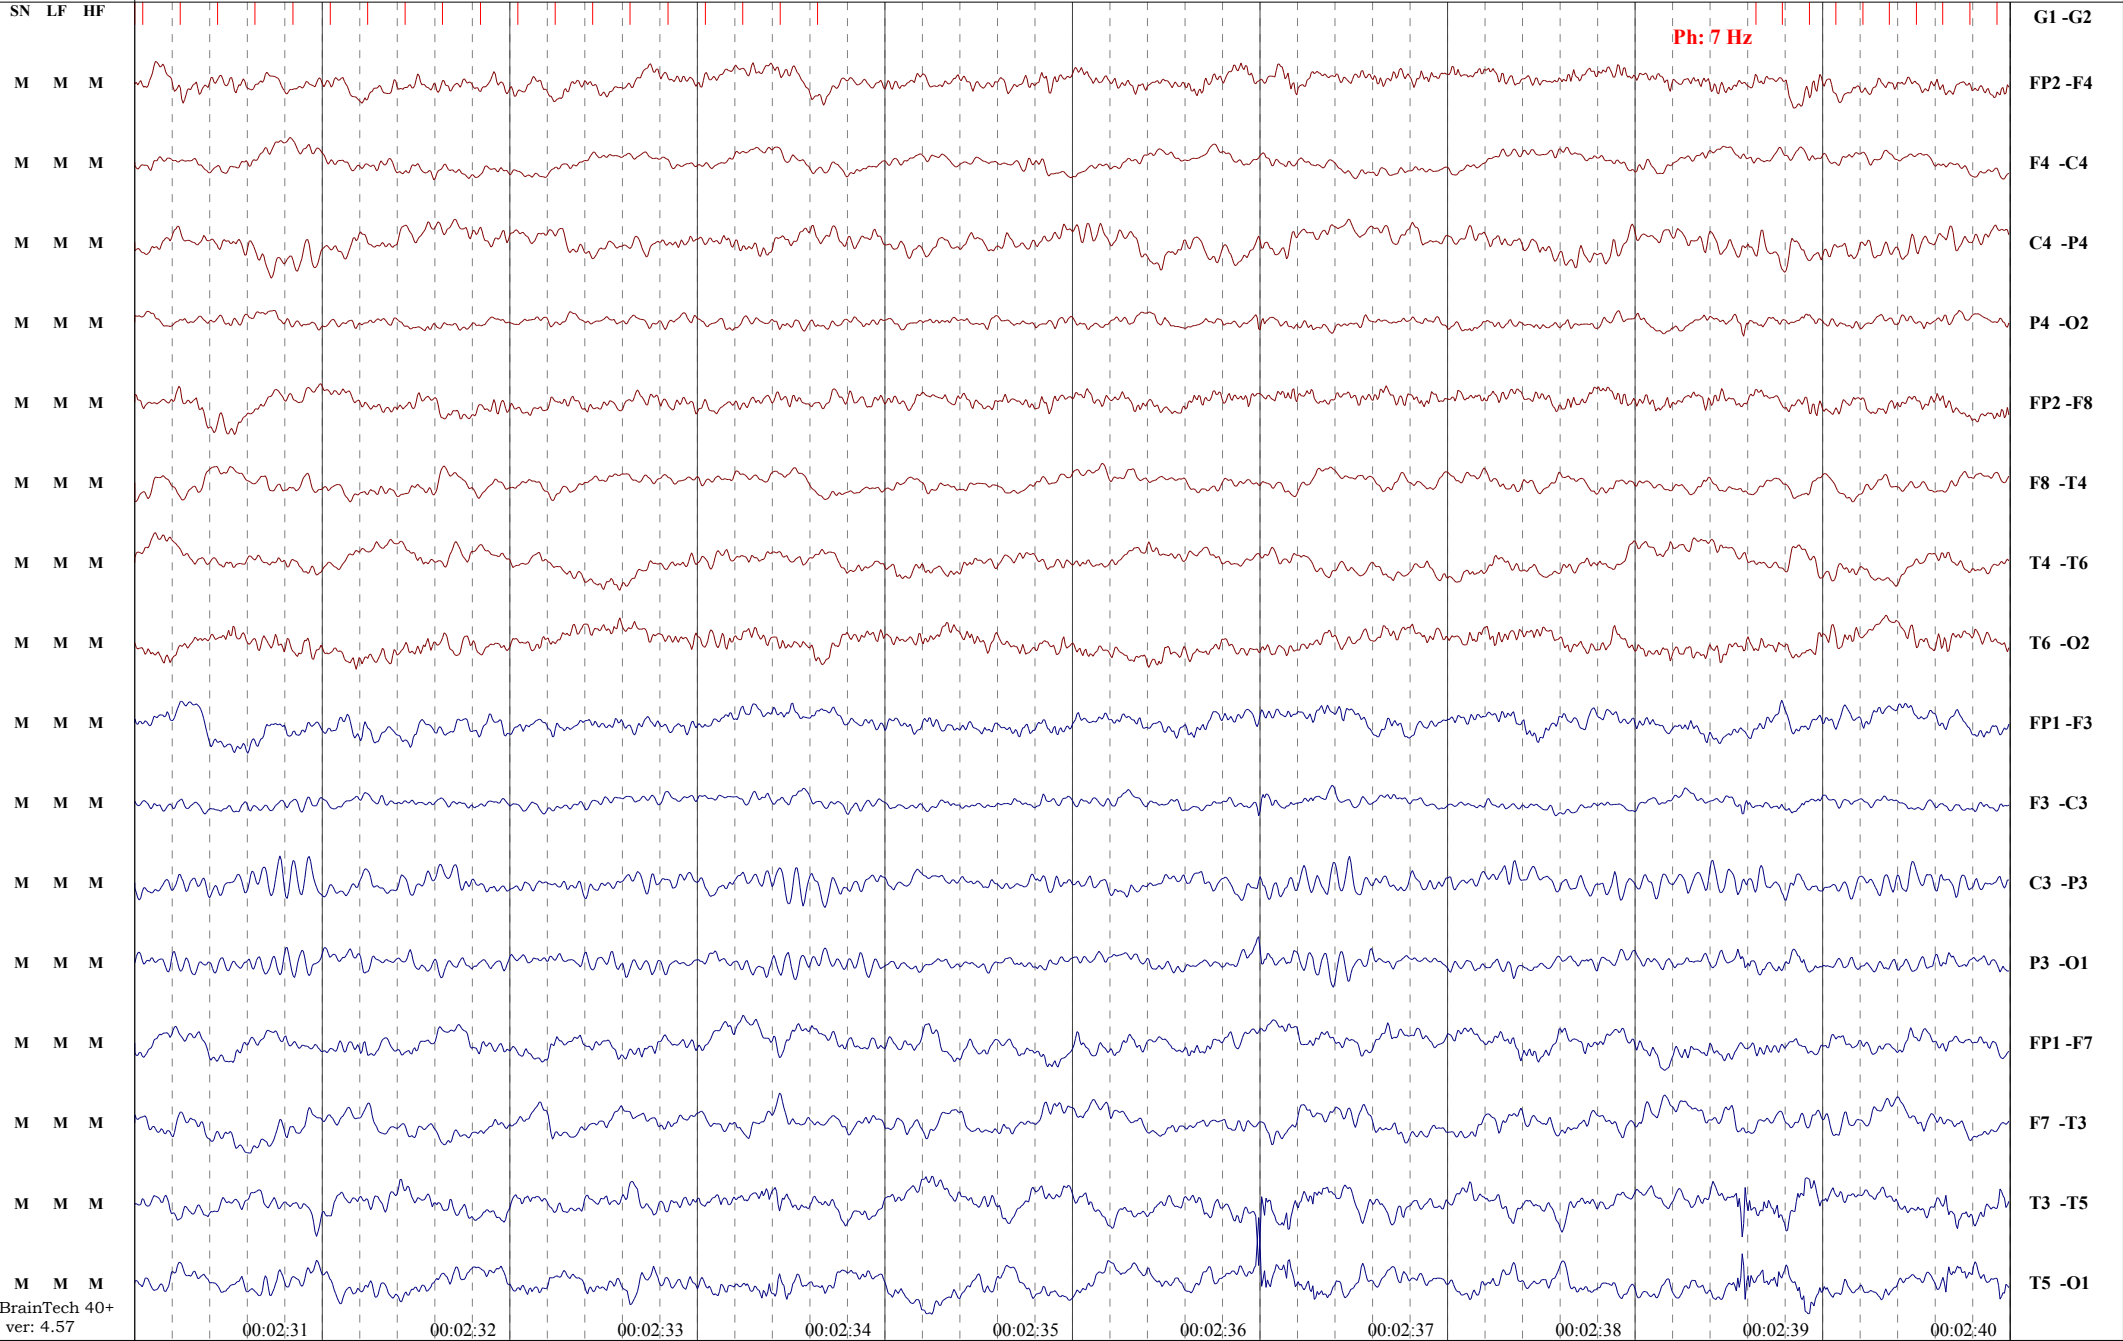




132
MRS ANJANI LASKAR
33 Years/F


Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:48:36
Page:19/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

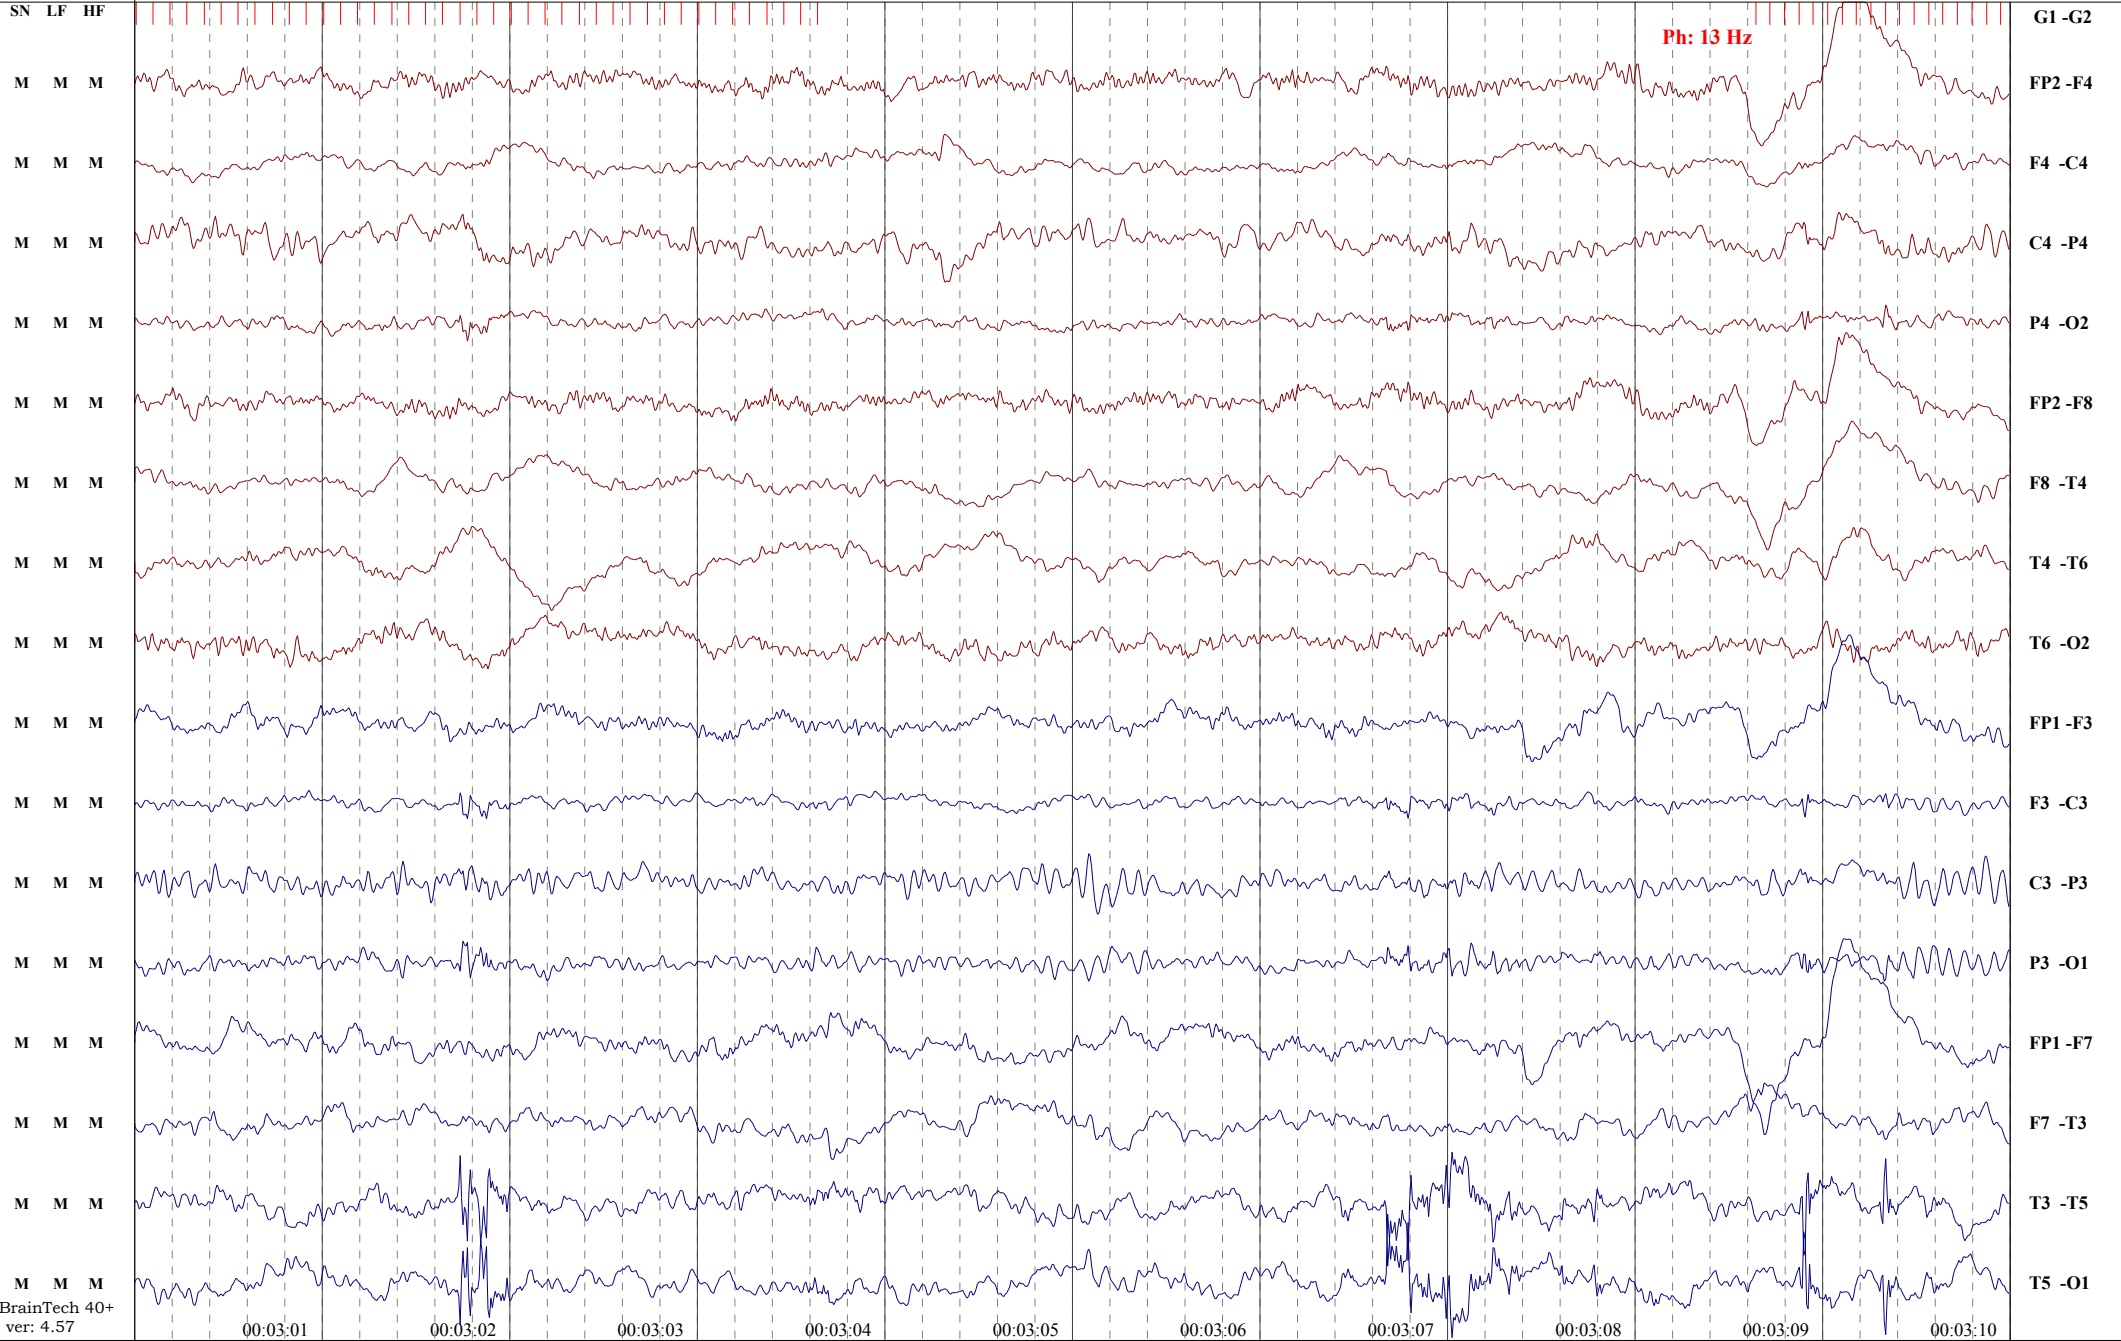

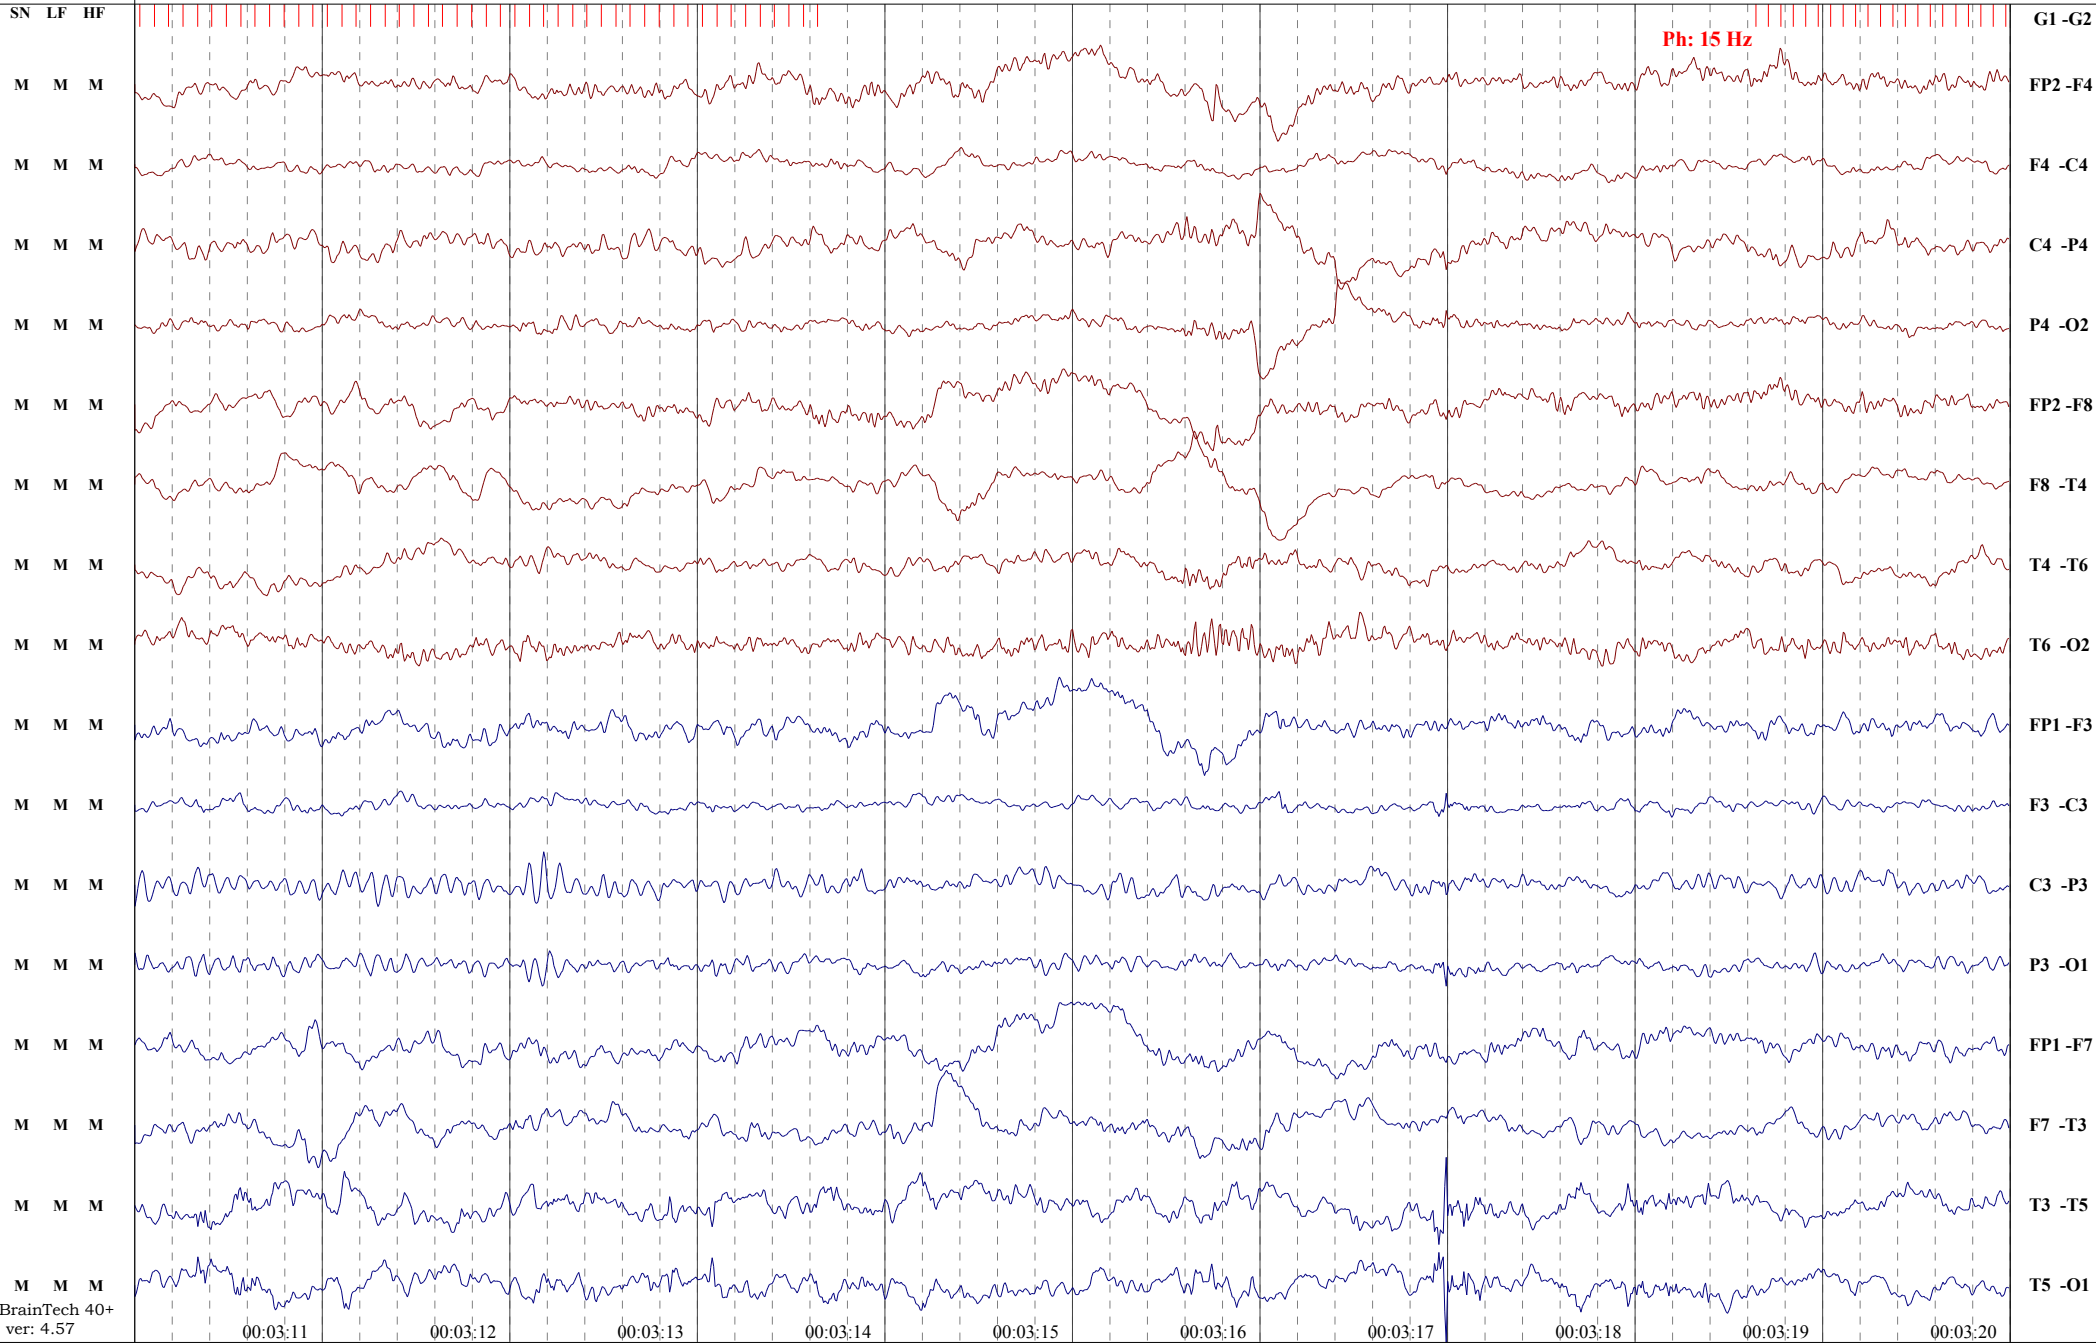


132
MRS ANJANI LASKAR
33 Years/F


Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:48:56
Page:21/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

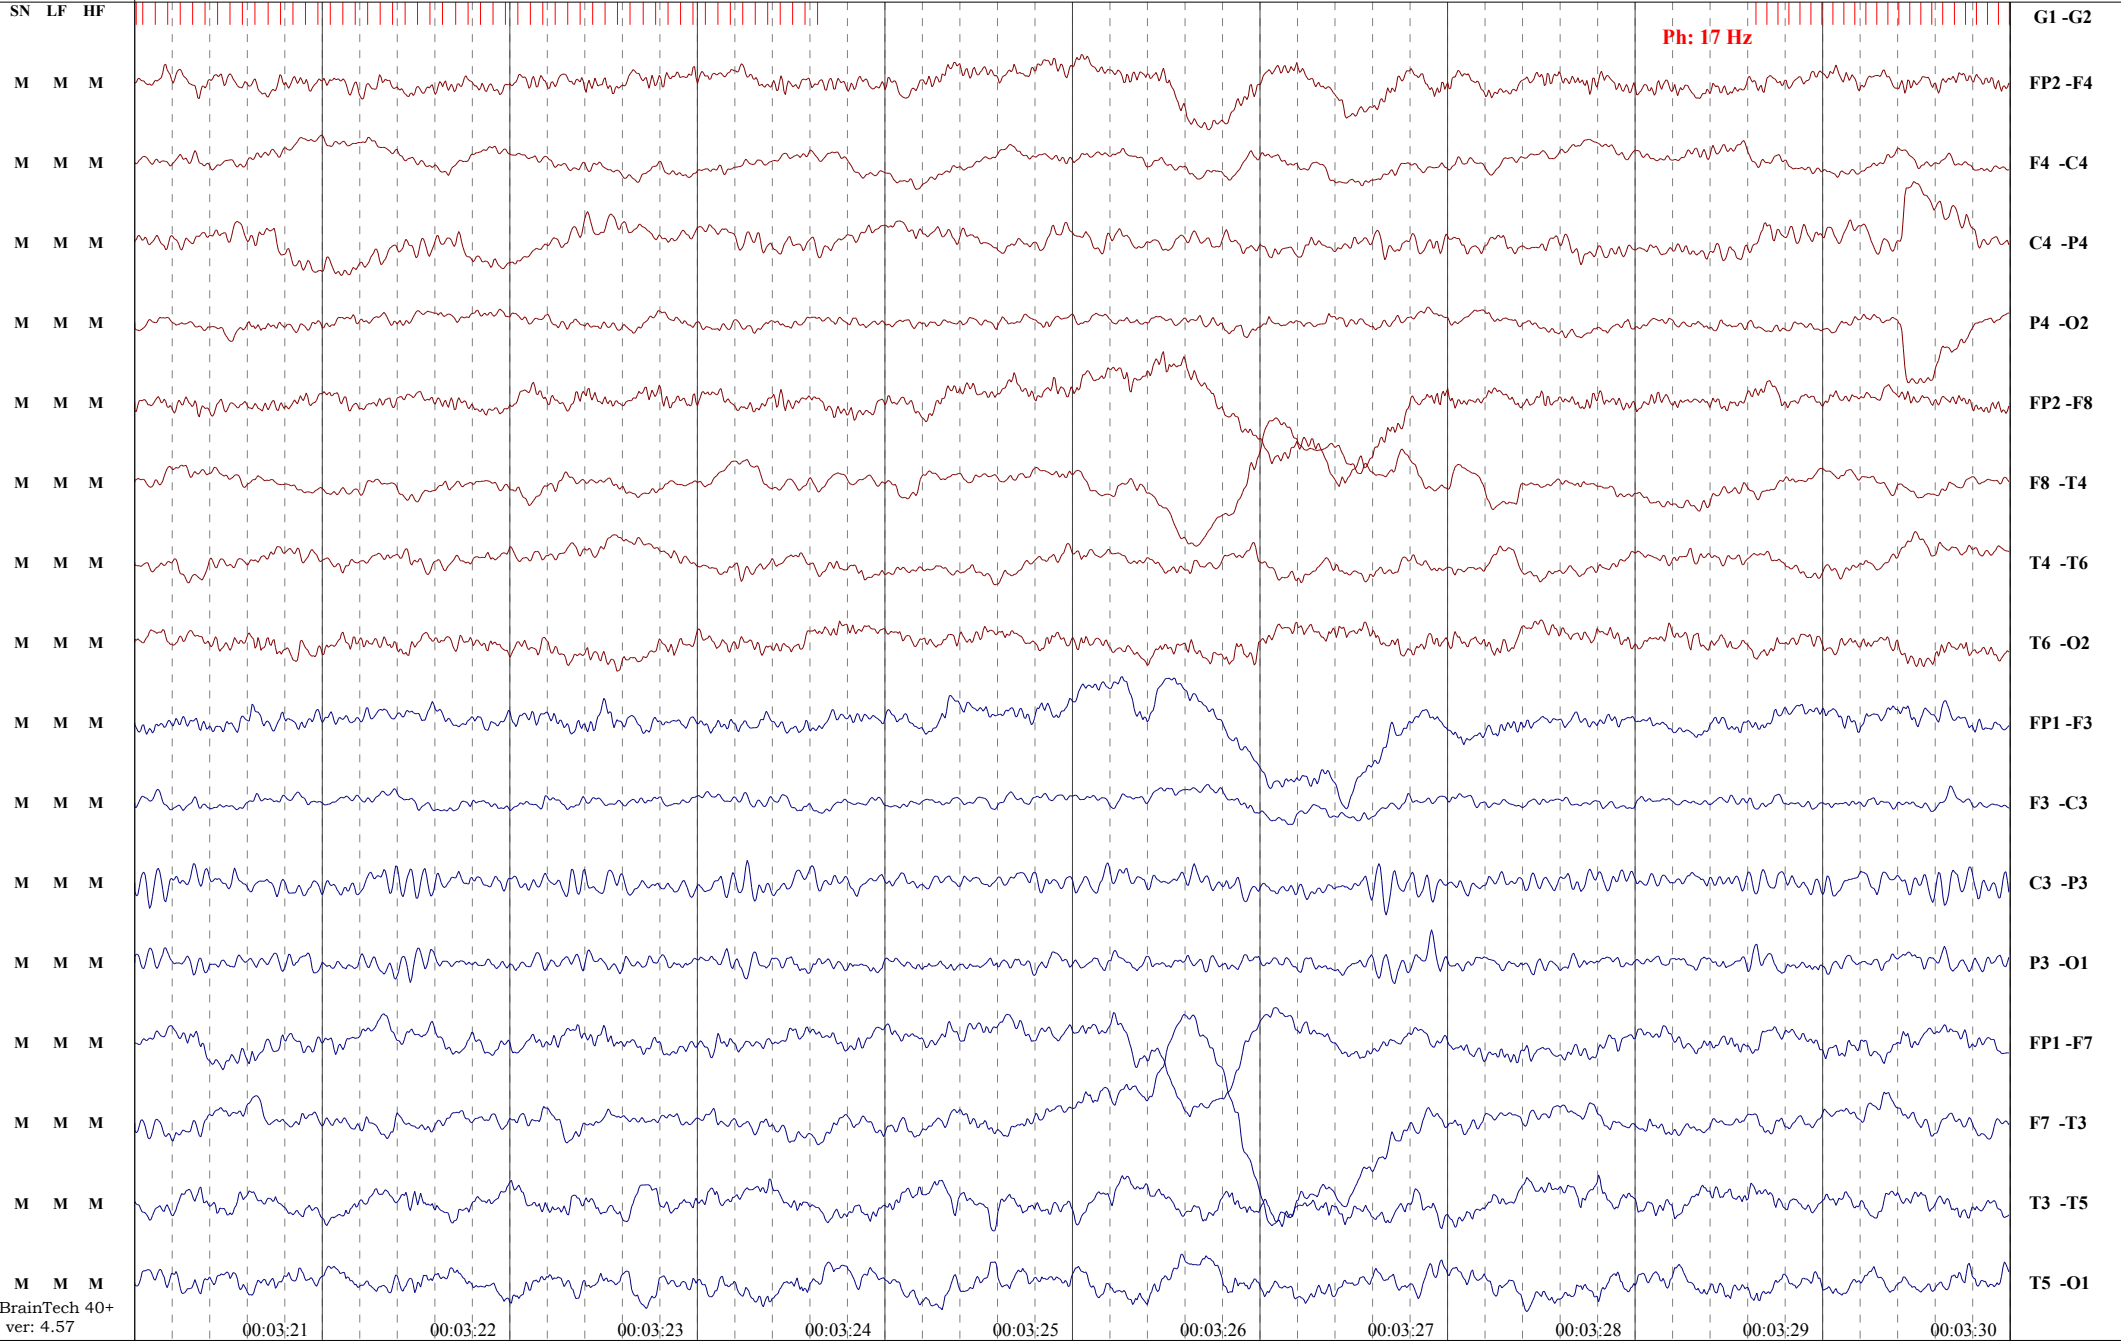

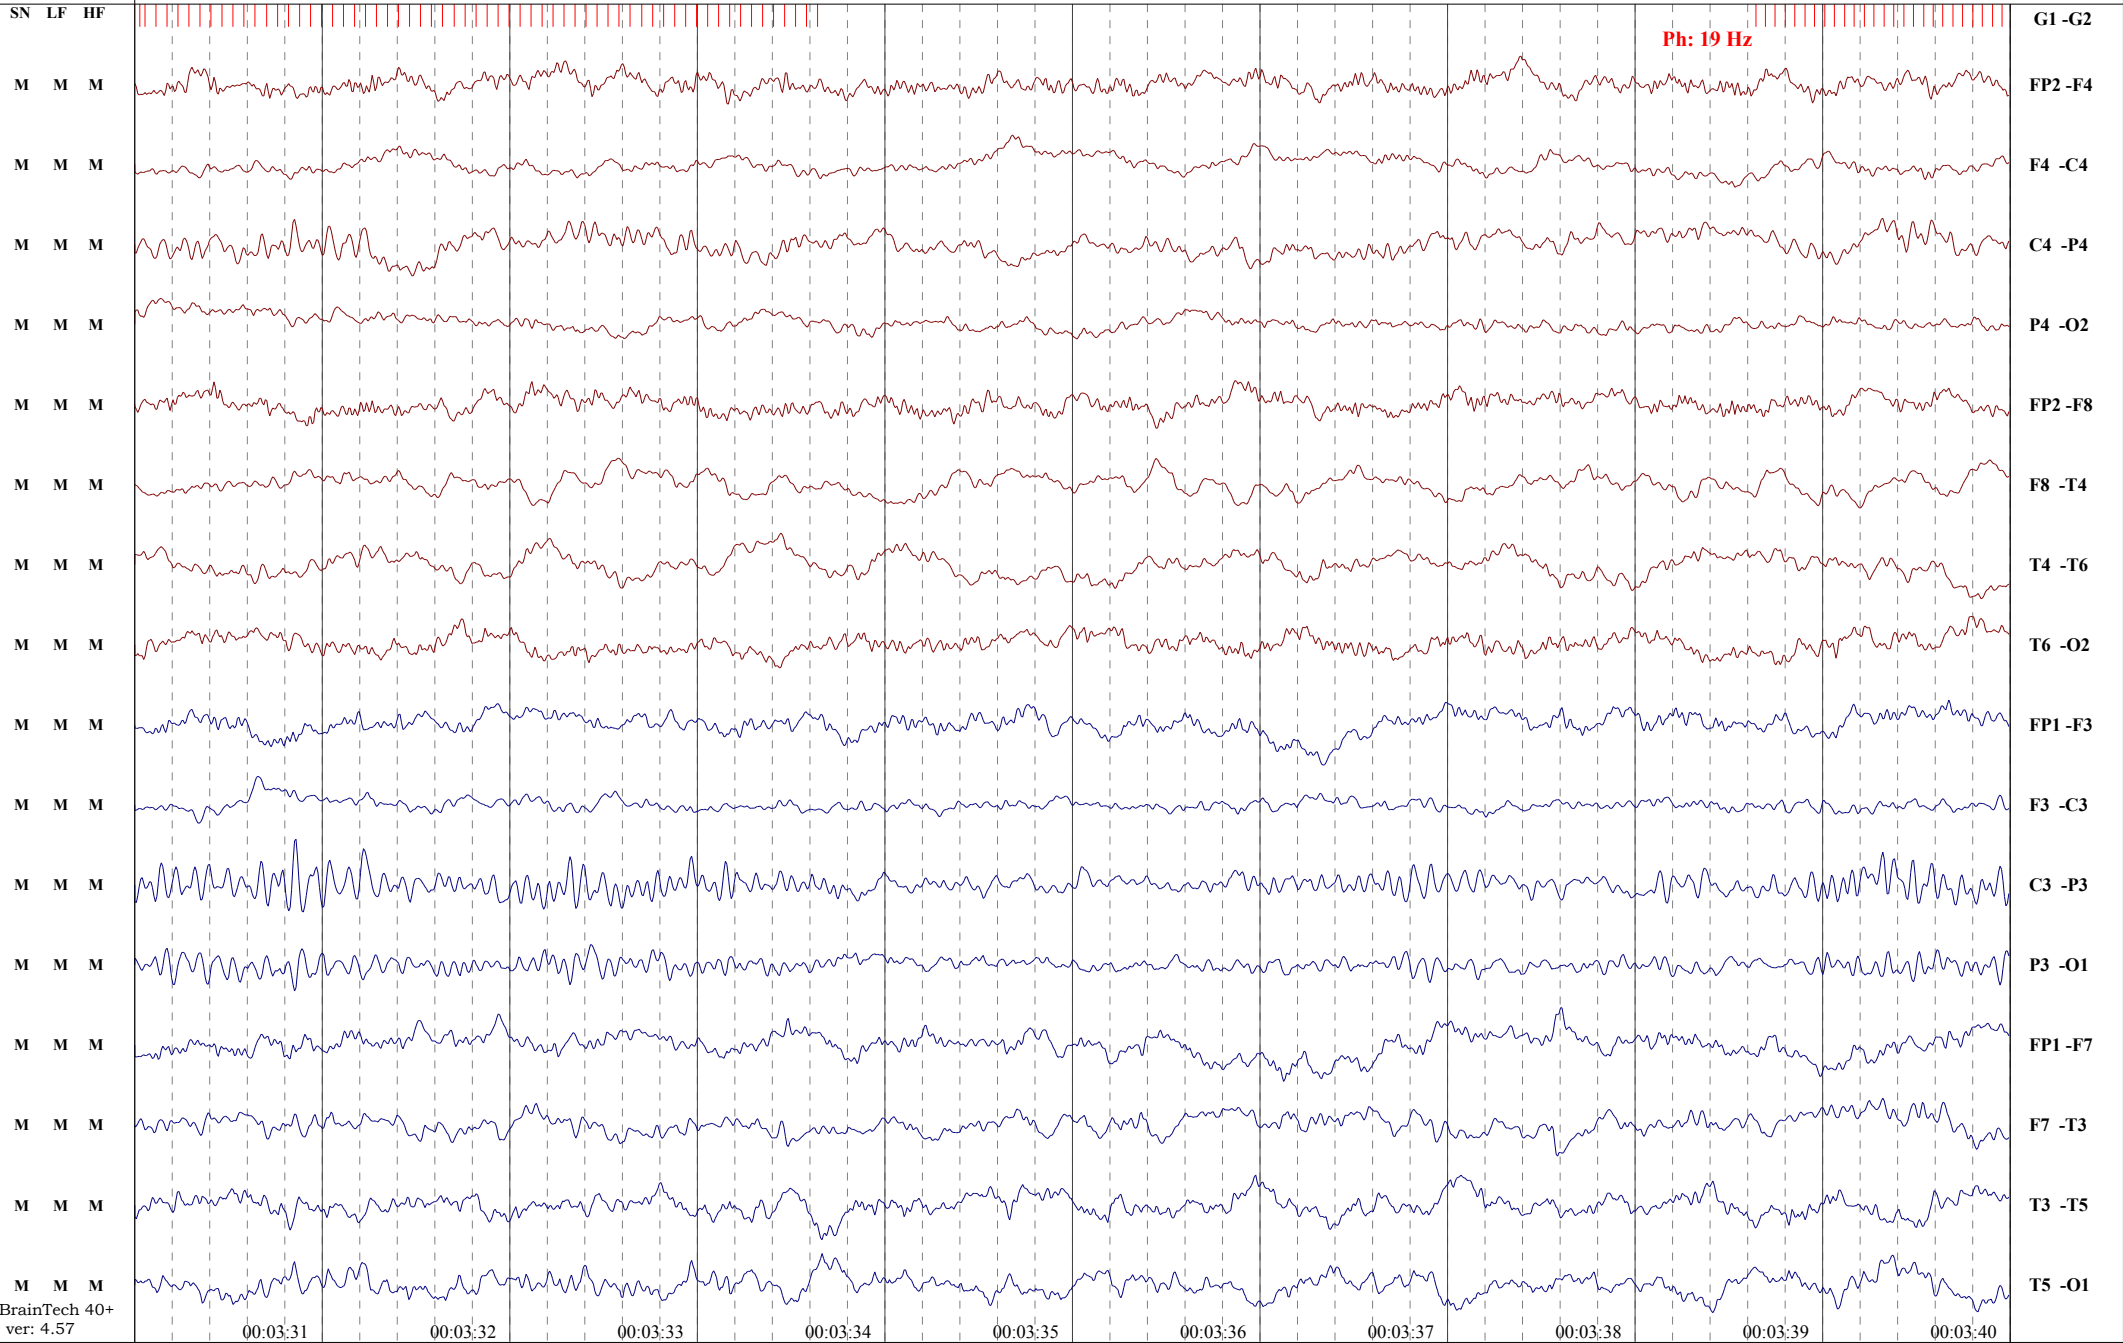


132
MRS ANJANI LASKAR
33 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:49:16
Page:23/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

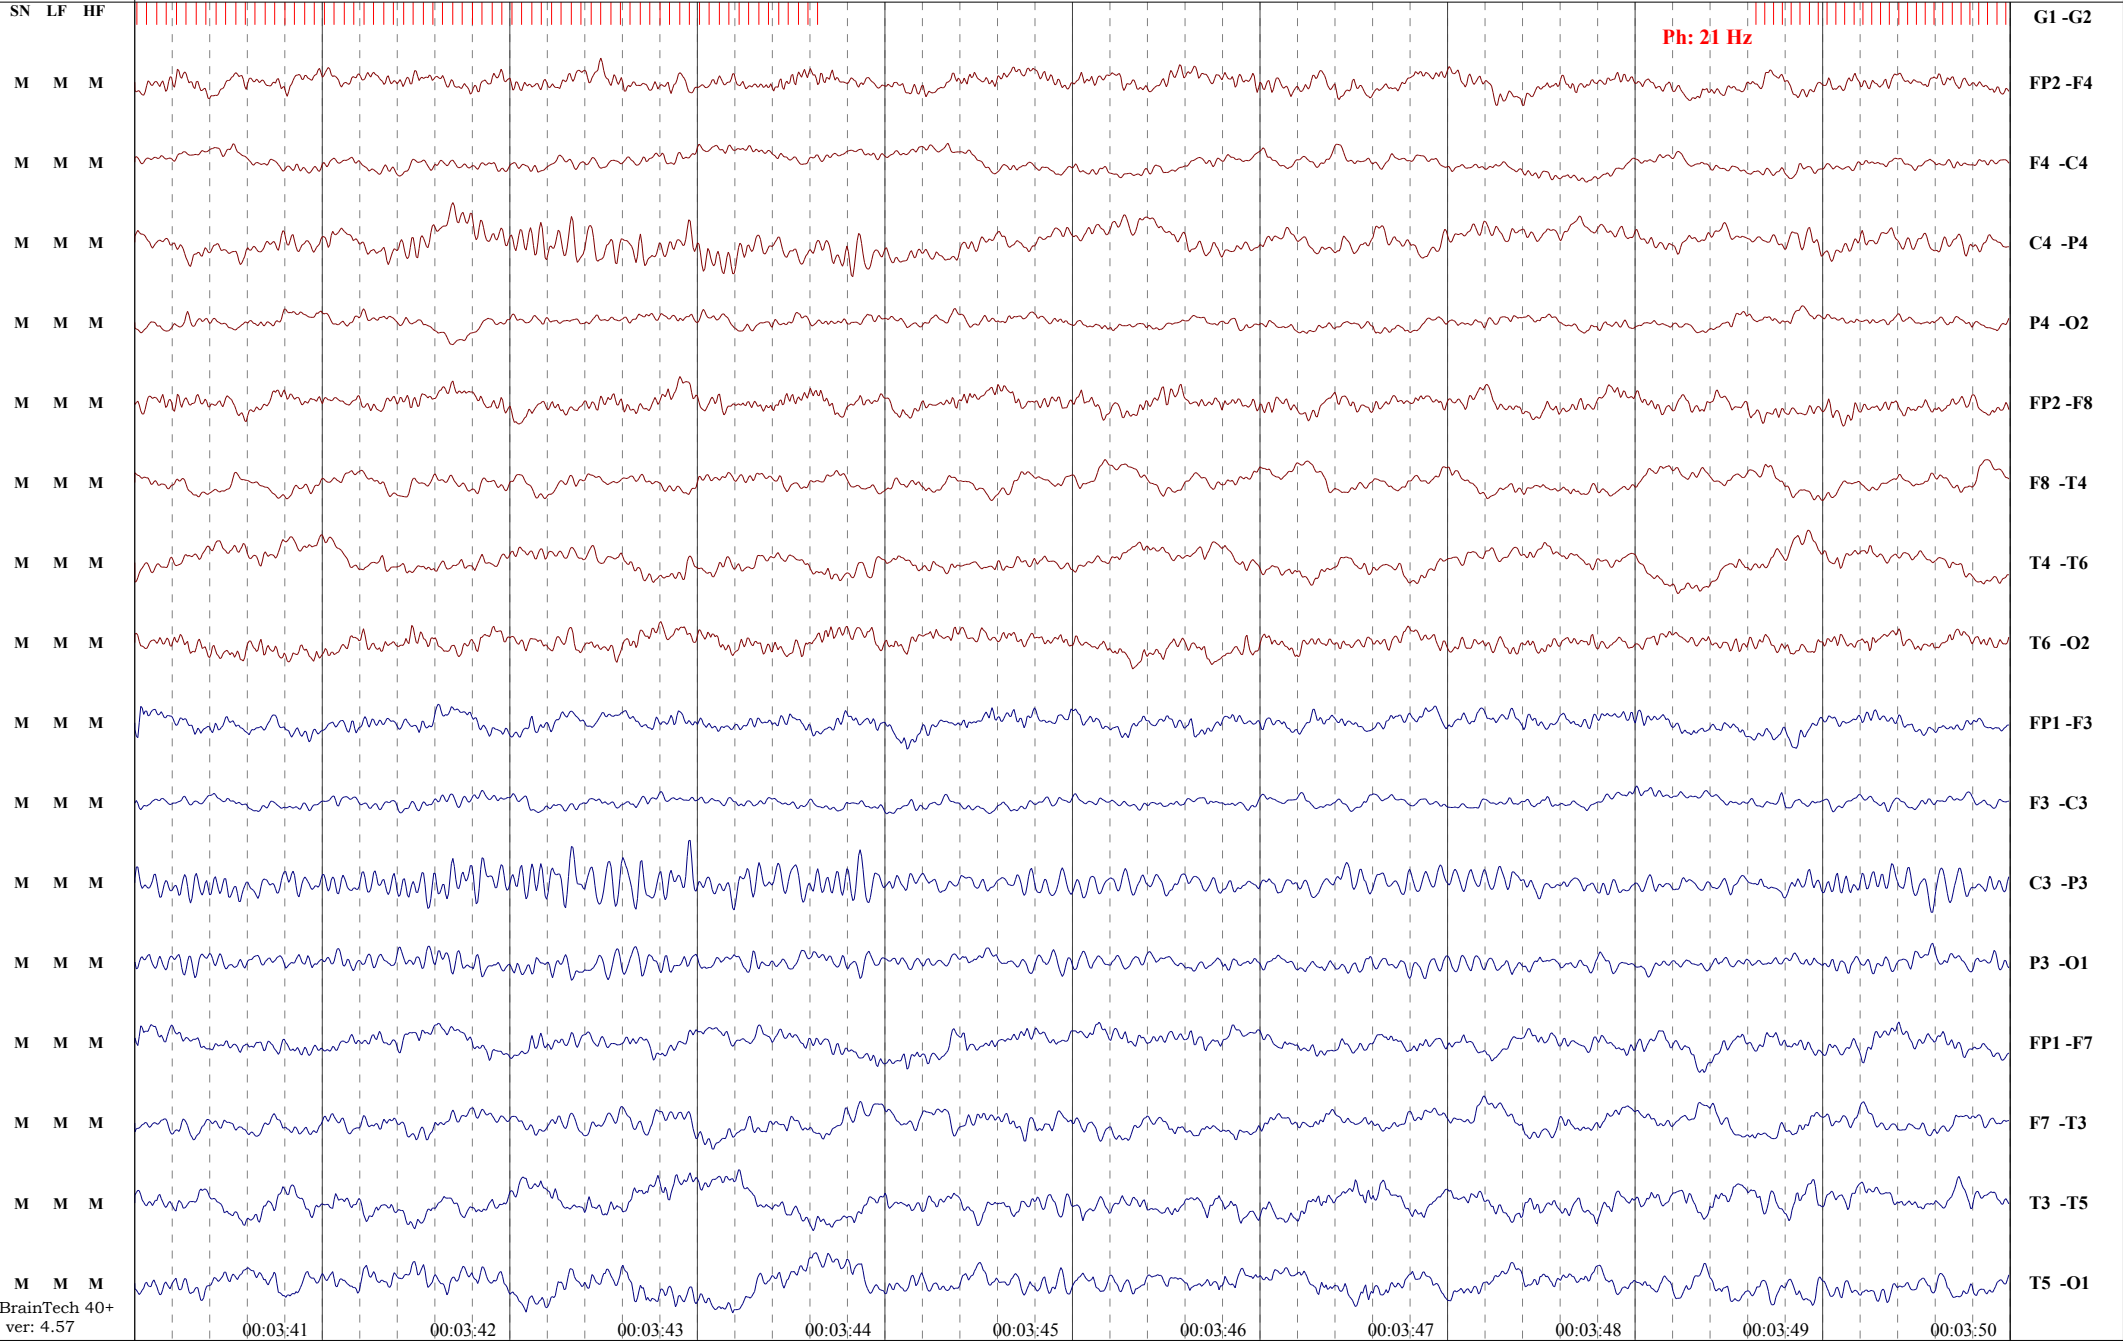

132
MRS ANJANI LASKAR
33 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:49:26
Page:24/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

Photic OFF



132
MRS ANJANI LASKAR
33 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 17:49:36
Page:25/28
Notch: ON

Ref:DR RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

