CR-EXT-R1 | electrical domains and named connections

Module/interface schematic. Internal supplier schematics, pin-level design and factory tests are required for S01/S02/S03.

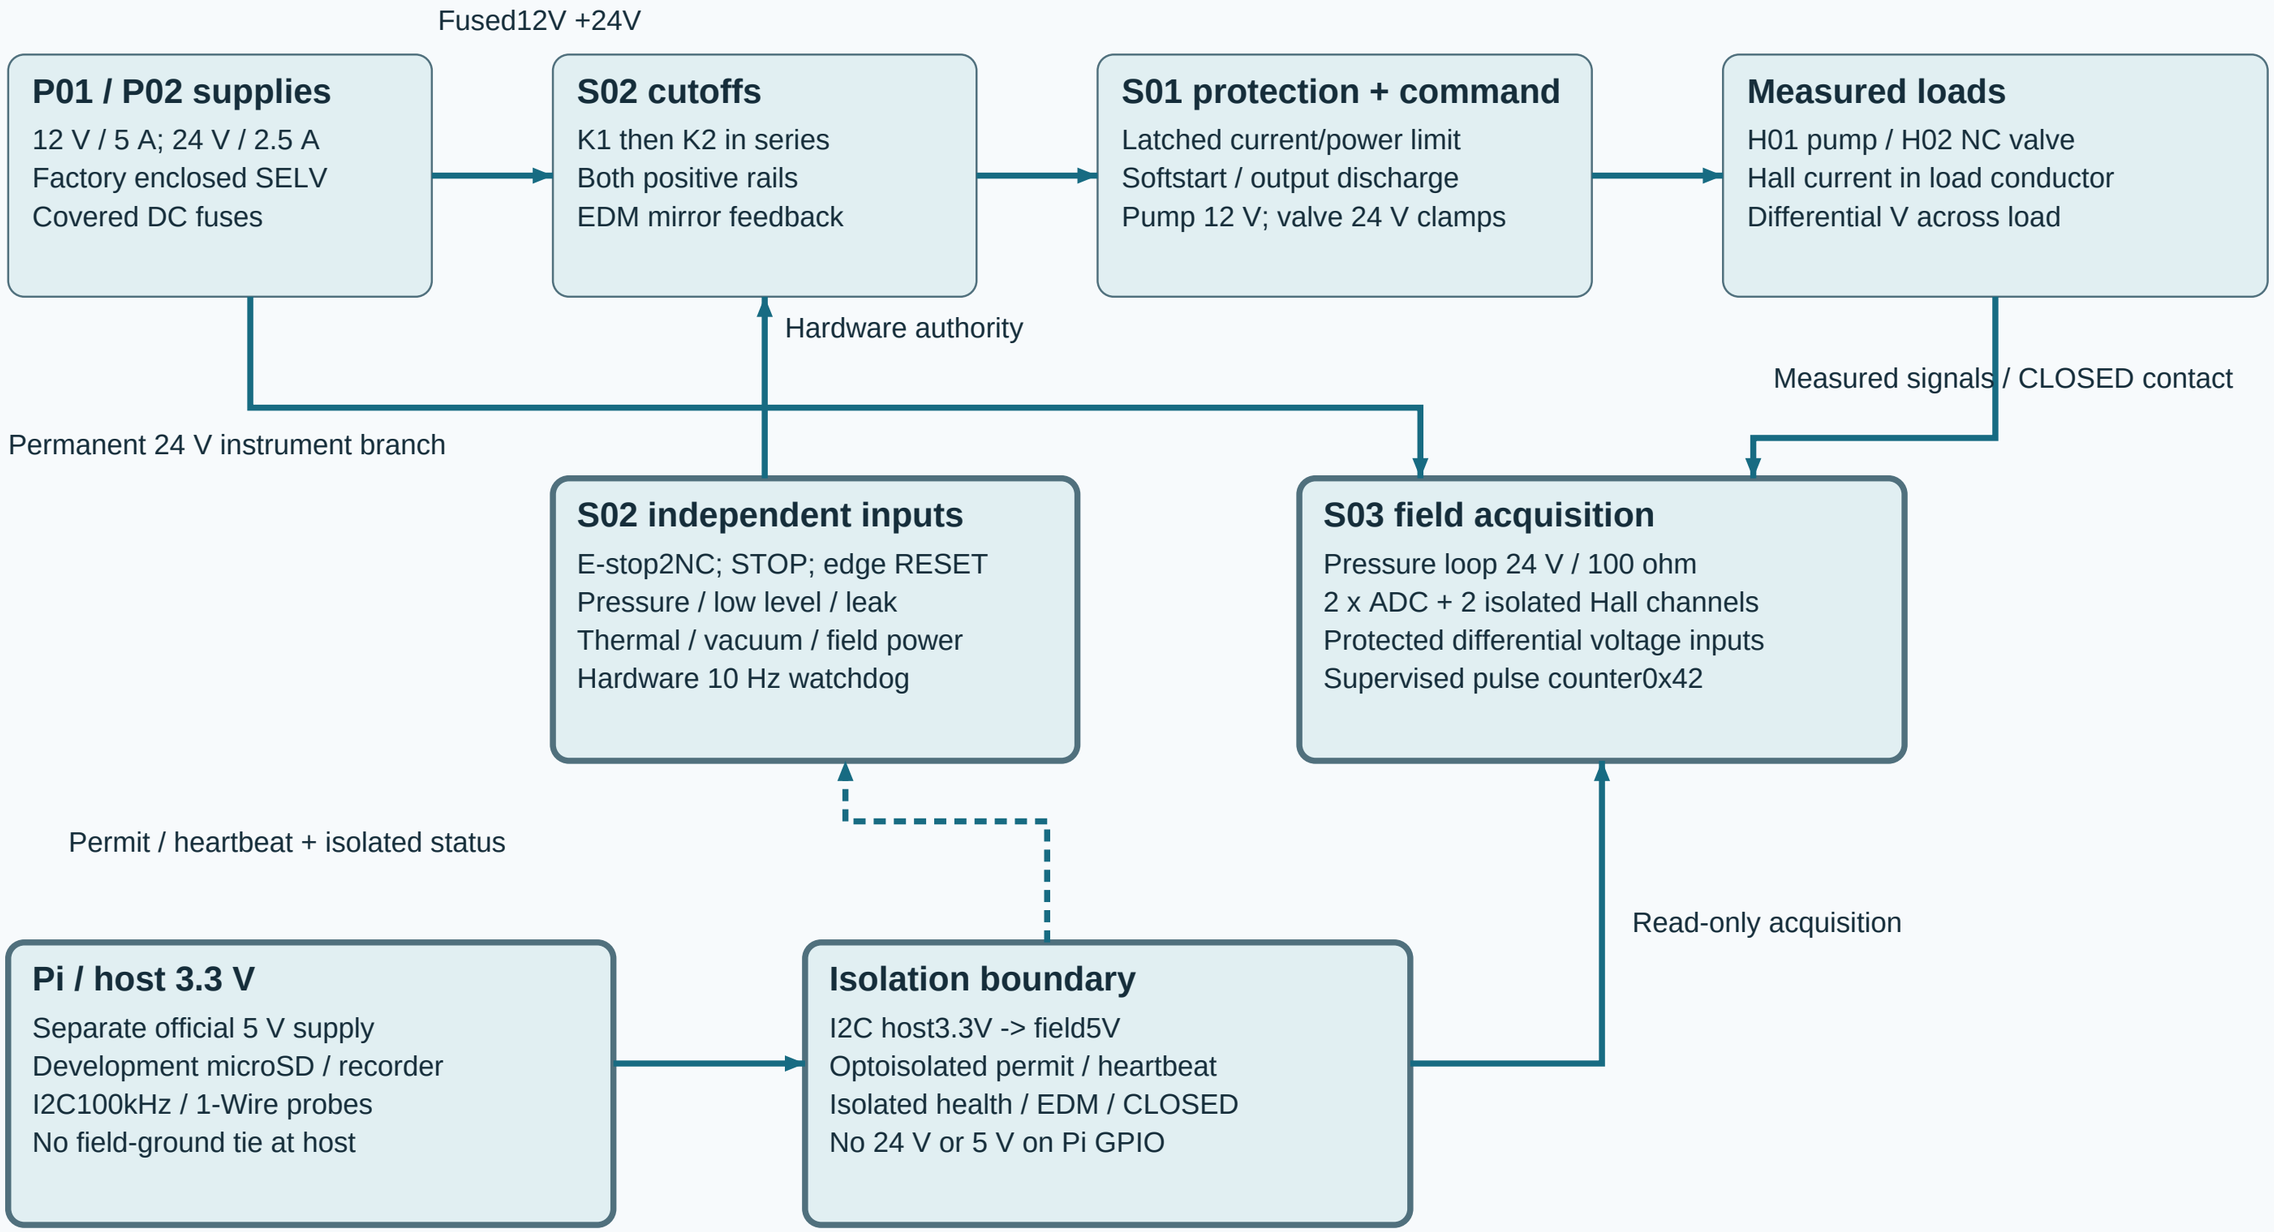

Sequence: reset/arm with permit LOW -> wait up to1.1s for S01 READY -> fresh reviewed execution permit.
Early/held permit must not start when READY appears. Any trip removes authority; recovery needs reset and new approval.
Cutoff removes actuator power while Pi and instrument acquisition stay powered. This topology does not assert SIL/PL certification.