

Packet Index and Revision Control

Six artifacts assembled from CAD, network, electrical, and RFI exports


Page	Artifact	Review focus
1	Index	Rev C and Rev B warning
2	Floor plan	Rooms, dimensions, doors, egress, and callouts
3	Rack elevation	Rack units and device names
4	Network topology	Arrow direction, VLANs, subnets, and dashed path
5	Panel schedule	Circuit/load/breaker/emergency fields
6	RFI markup	Revision cloud, answer, and final field states

Superseded source warning

Rev B labels Lab B door as D-214A. Rev C changes the corridor door to D-214B and adds card reader CR-6 on the corridor side. Rev C controls.

Floor Plan A2.14 - Suite 214

Room dimensions, egress, and callout binding

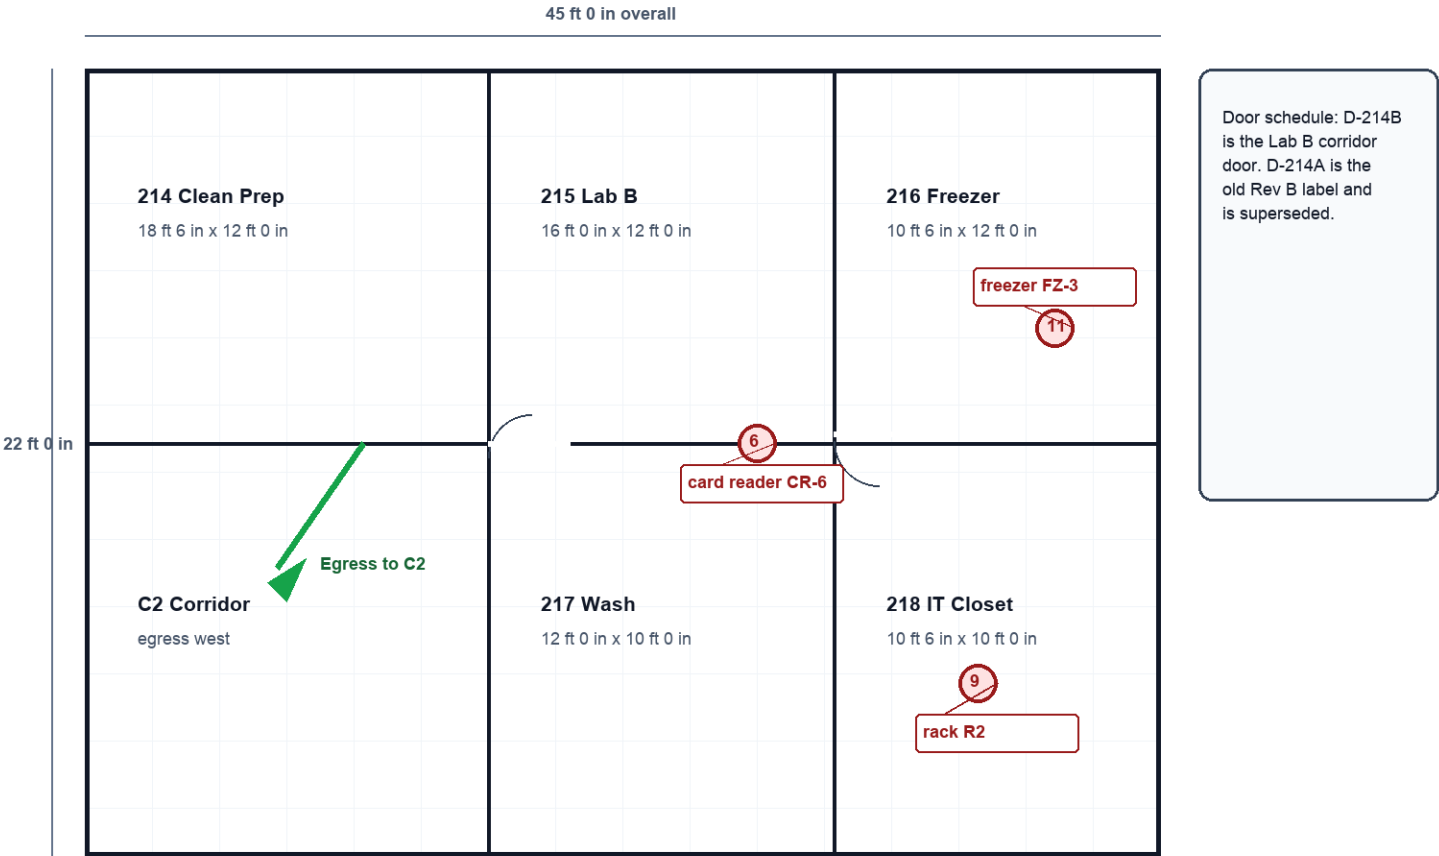

DOOR AND ROOM COORDINATION SCHEDULE

Room/door	Rev C field condition	Linked artifact
214 Clean Prep	tablet dock on D214-01	rack port CS-2/01
215 Lab B / D-214B	CR-6 corridor side; panel L2-15	RFI-214B final
216 Freezer	FZ-3 monitor at callout 11	VLAN 240 + L2-17
218 IT Closet	rack R2, UPS A	panel L2-19

Field measurement note
Overall suite width is 45 ft 0 in. Overall depth is 22 ft 0 in. Door D-214B is the only door label revised by RFI-214B.

Rack Elevation R2

U positions, devices, and patch mapping

U42

U42

Core switch CS-2
48p PoE

U36

U36

Patch panel PP-7
lab drops 214-218

U30

U30

Firewall FW-02
HA secondary

U24

U24

UPS A
2.2 kVA

U18

U18

Freezer monitor GW-3
Modbus gateway

U12

U12

NVR camera bridge
VLAN 240


U6

U0

Port	Drop	Room	Device	VLAN
CS-2/01	D214-01	214 Clean Prep	tablet dock	210
CS-2/07	D215-03	215 Lab B	card reader CR-6	230
CS-2/12	D216-02	216 Freezer	FZ-3 monitor	240
CS-2/19	D218-01	218 IT Closet	FW-02 mgmt	99

Rack note

Firewall FW-02 occupies U30-U31. Core switch CS-2 is U42-U43. NVR camera bridge belongs to VLAN 240, not VLAN 230.

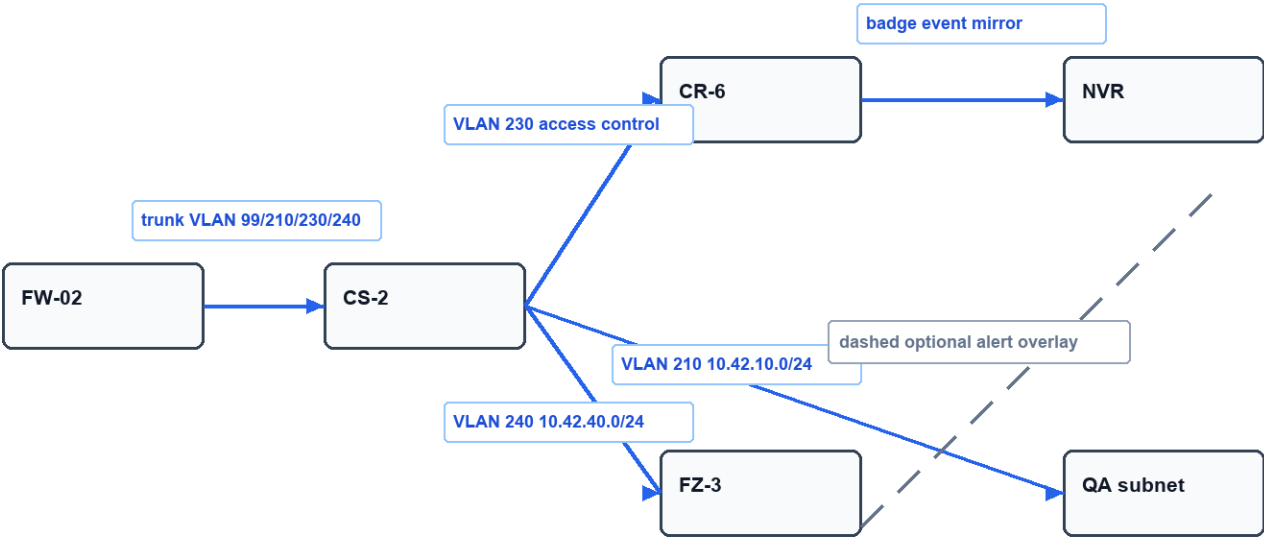

Subnet note

VLAN 240 maps to freezer and camera telemetry subnet 10.42.40.0/24. VLAN 230 is access control. VLAN 210 is QA devices.

PORT AND FIREWALL RULE EXTRACT

Rule/port	Source	Destination	VLAN	State
ACL-230-06	CR-6	NVR event mirror	230 to 240	permit one-way
ACL-240-11	FZ-3	QA subnet telemetry	240 to 210	deny except broker
TRK-CS2-FW02	CS-2	FW-02	99/210/230/240	tagged trunk
OPT-CAM	FZ-3 optional overlay	NVR	240	dashed / not base scope

Electrical Panel LP-2 Schedule

Circuit/load/breaker/emergency fields

Circuit	Load	Breaker	Emergency?	Room	Note
L2-11	Bench outlets B	20A/1P	No	215 Lab B	GFCI
L2-13	Autoclave AC-1	30A/2P	No	217 Wash	dedicated
L2-15	Door controller DC-6	20A/1P	Yes	215 Lab B	feeds CR-6
L2-17	Freezer FZ-3	20A/1P	Yes	216 Freezer	monitor required
L2-19	Rack R2 UPS	20A/1P	Yes	218 IT Closet	UPS A
L2-21	Spare	20A/1P	No	-	hold for Rev D

Panel note

Emergency circuits are L2-15, L2-17, and L2-19. L2-17 is Freezer FZ-3 and must match callout 11 on the floor plan.

LOAD SUMMARY AND EMERGENCY BRANCH CHECK

Branch	Connected load	Emergency load	Reviewer note
Normal receptacles	3.2 kVA	0.0 kVA	bench + autoclave only
Access control	0.4 kVA	0.4 kVA	DC-6 on L2-15
Cold storage	0.7 kVA	0.7 kVA	FZ-3 on L2-17
IT / UPS	1.1 kVA	1.1 kVA	R2 UPS on L2-19
Spare capacity	2.6 kVA	-	L2-21 held for Rev D

- ☒ Emergency branch labels match floor plan callouts
- ☐ L2-21 released for construction
- ☐ Freezer monitor moved to normal power


RFI-214B Markup and Final Answer

Revision cloud, answer, and final field states

RFI	Discipline	Opened	Answered	Status
214B	Access control / architectural	2026-06-09	2026-06-12	Issued Rev C

Question: Door label conflict. CAD Rev B shows D-214A at Lab B corridor. Field sticker and security rough-in show D-214B. Which label controls for access control schedule?

Response: Use D-214B for the Lab B corridor door. Add CR-6 card reader on corridor side. Update access control schedule and panel LP-2 circuit L2-15. Rev C dated 2026-06-12 controls.

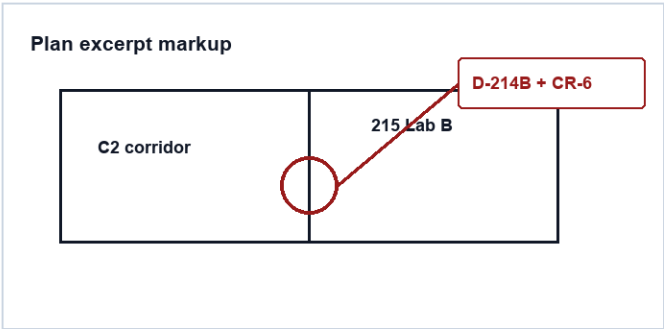

Field	Rev B	Rev C final
Door label	D-214A	D-214B
Reader	none	CR-6 corridor side
Circuit	unassigned	L2-15
Schedule status	draft	issued

Signoff
Answered by A. Verma, Architect of Record. Security reviewer initials: TN. Contractor acknowledged in field log 2026-06-13.