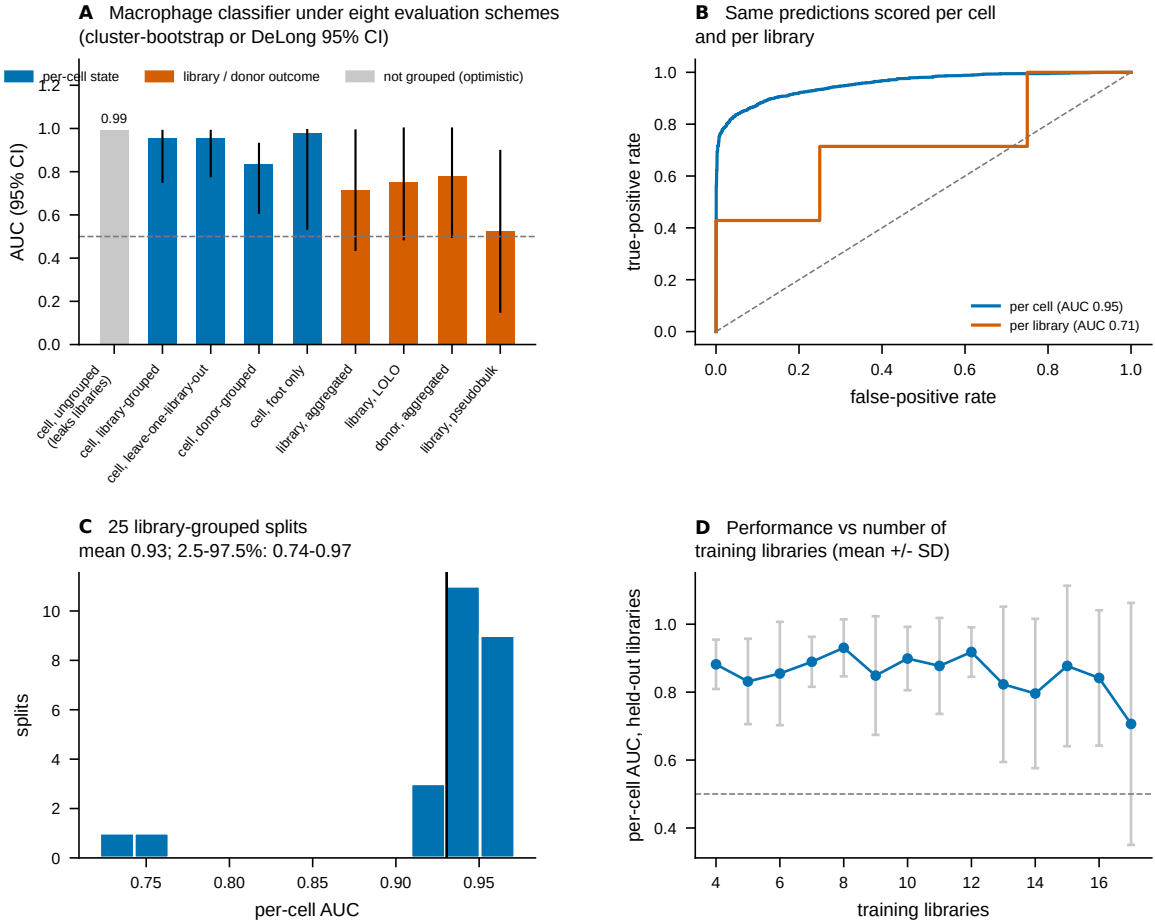
A Macrophage classifier under eight evaluation schemes
(cluster-bootstrap or DeLong 95% CI)
per-cell state
library / donor outcome
not grouped (optimistic)
AUC (95% CI)
0.99
cell, ungrouped (leaks libraries)
cell, library-grouped
cell, leave-one-library-out
cell, donor-grouped
cell, foot only
library, aggregated
library, LOLO
donor, aggregated
library, pseudobulk
B Same predictions scored per cell
and per library
true-positive rate
false-positive rate
per cell (AUC 0.95)
per library (AUC 0.71)
C 25 library-grouped splits
mean 0.93; 2.5-97.5%: 0.74-0.97
splits
per-cell AUC
D Performance vs number of
training libraries (mean +/- SD)
per-cell AUC, held-out libraries
training libraries