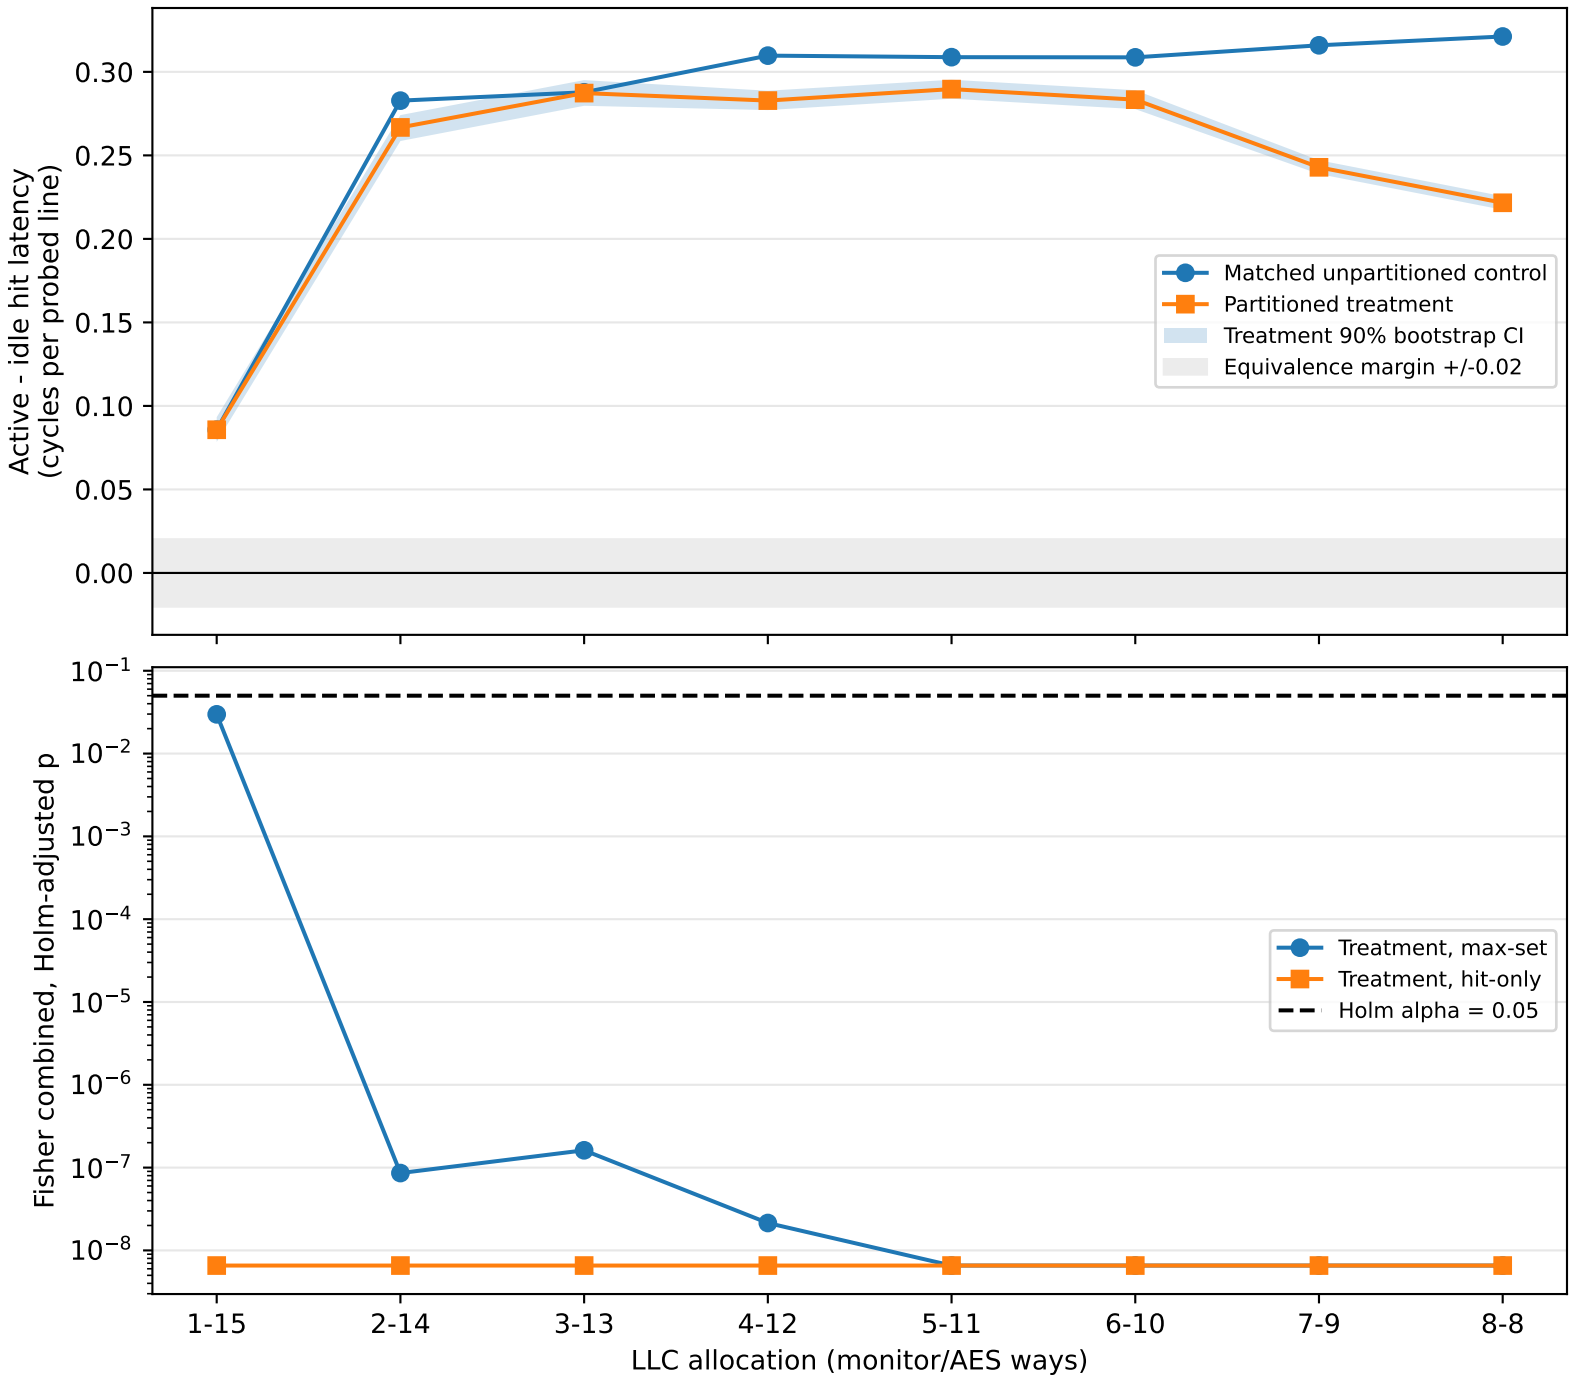
Active - idle hit latency
(cycles per probed line)
0.30
0.25
0.20
0.15
0.10
0.05
0.00
Matched unpartitioned control
Partitioned treatment
Treatment 90% bootstrap CI
Equivalence margin +/-0.02
Fisher combined, Holm-adjusted p
10^{-1}
10^{-2}
10^{-3}
10^{-4}
10^{-5}
10^{-6}
10^{-7}
10^{-8}
Treatment, max-set
Treatment, hit-only
Holm alpha = 0.05
1-15
2-14
3-13
4-12
5-11
6-10
7-9
8-8
LLC allocation (monitor/AES ways)