The SAS System

The TTEST Procedure

Difference: bdi_pre - bdi_2m

N	Mean	Std Dev	Std Err	Minimum	Maximum
97	6.2371	9.4745	0.9620	-17.0000	41.0000

Mean	95% CL Mean		Std Dev	95% CL Std Dev	
6.2371	4.3276	8.1466	9.4745	8.3030	11.0339

DF	t Value	Pr > |t|
96	6.48	<.0001

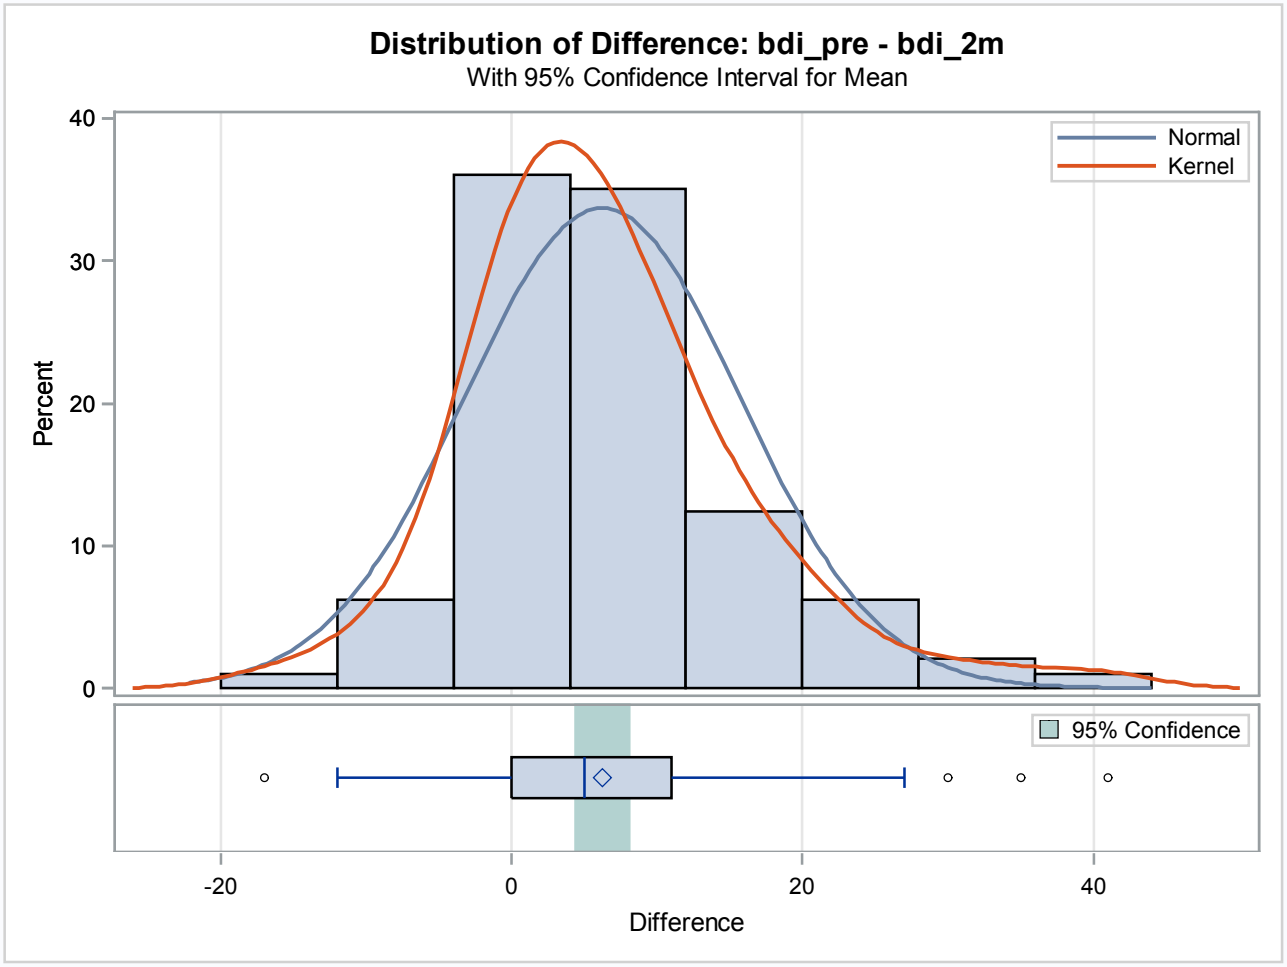

The TTEST Procedure

Difference: bdi_pre - bdi_2m

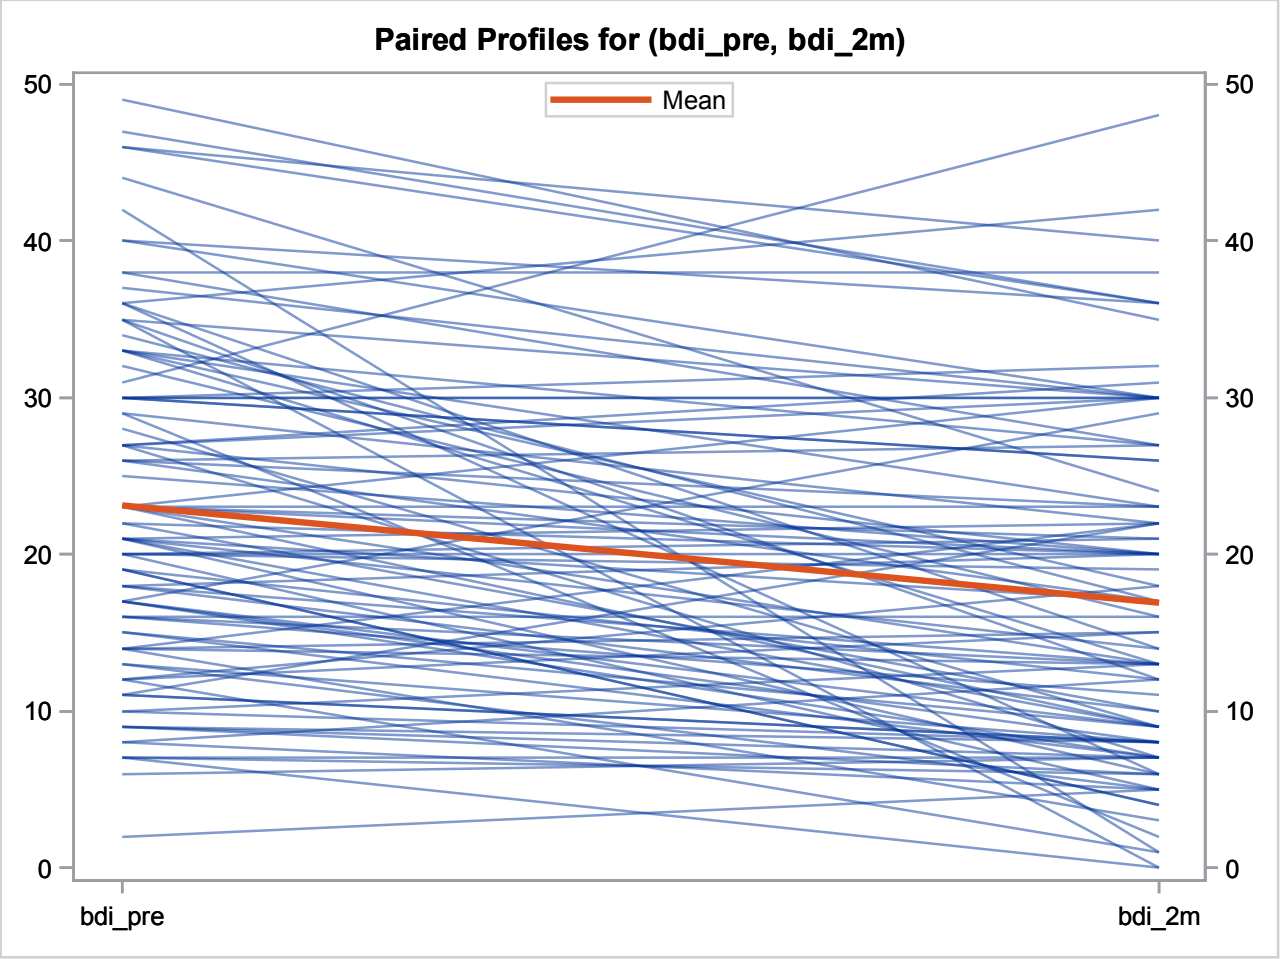

The TTEST Procedure

Difference: bdi_pre - bdi_2m

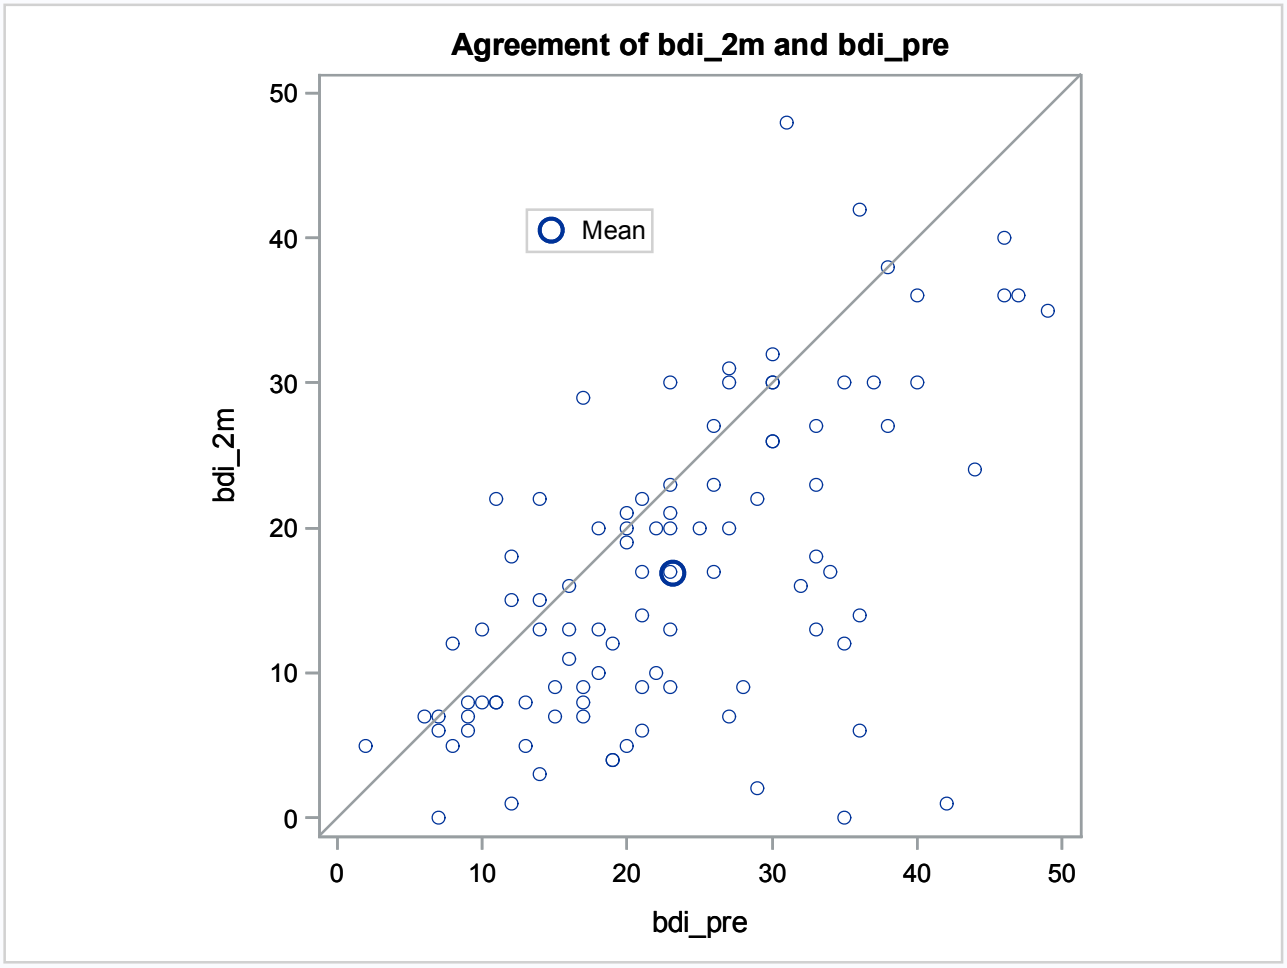

The TTEST Procedure
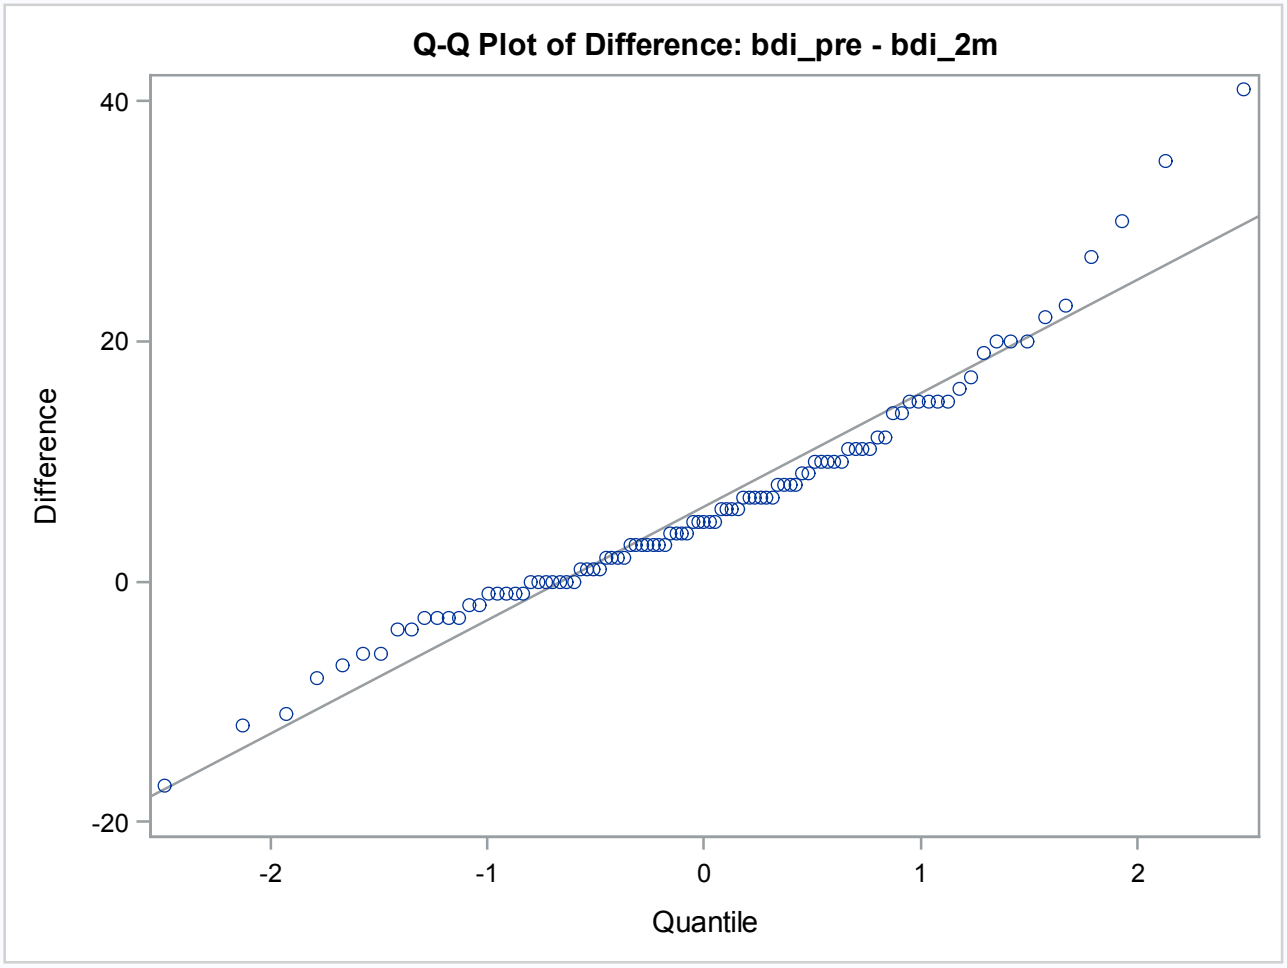
Difference: bdi_pre - bdi_2m