




TCN18-057 (spider+UGD2), normalized during counting

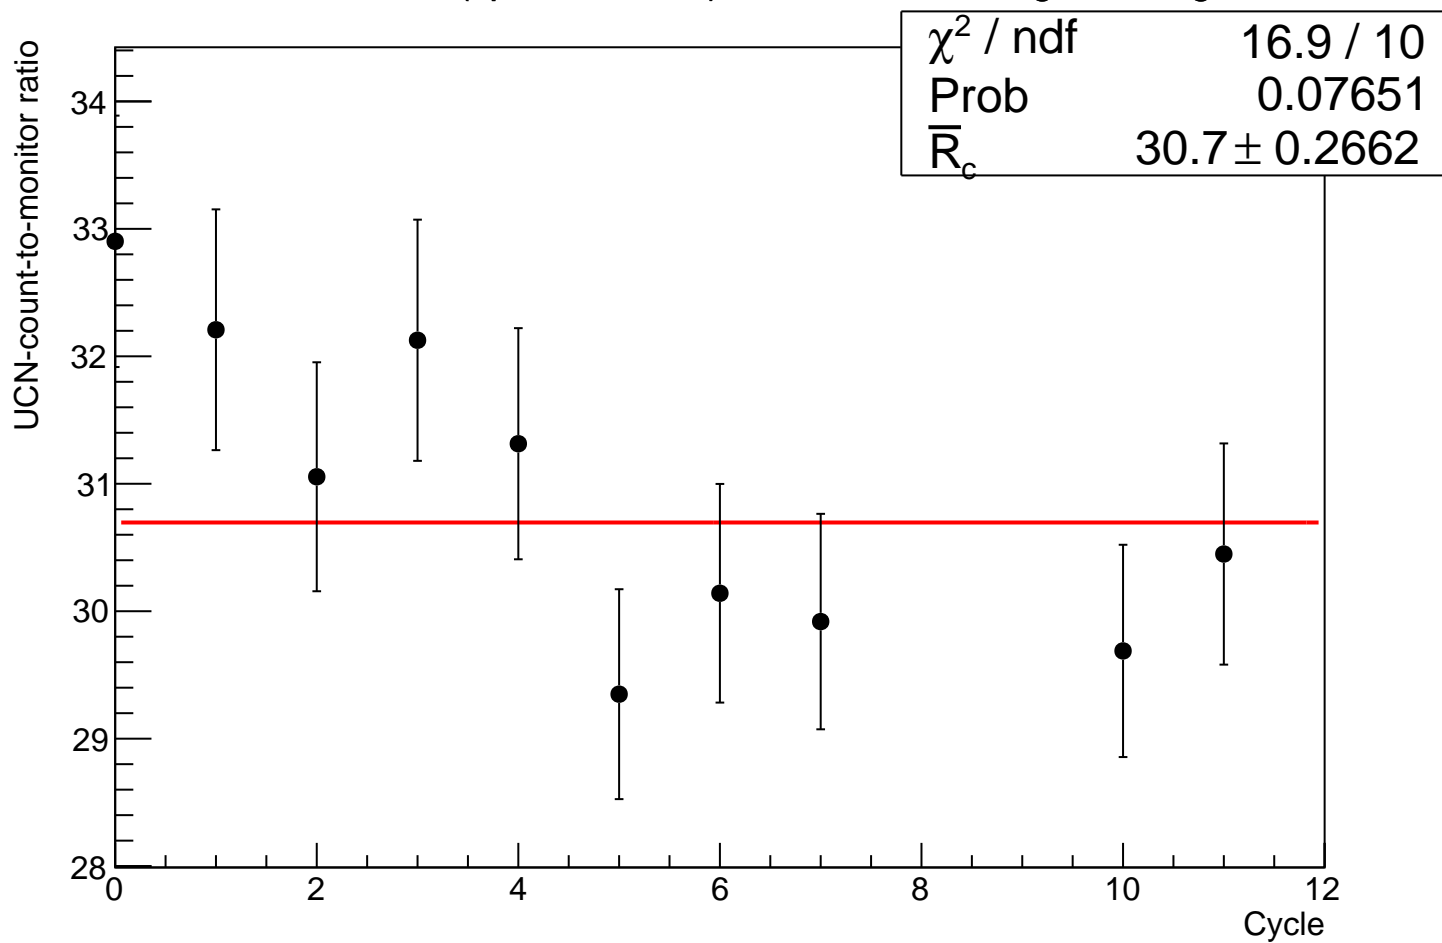



TCN18-057 (spider+UGD2), normalized during irradiation

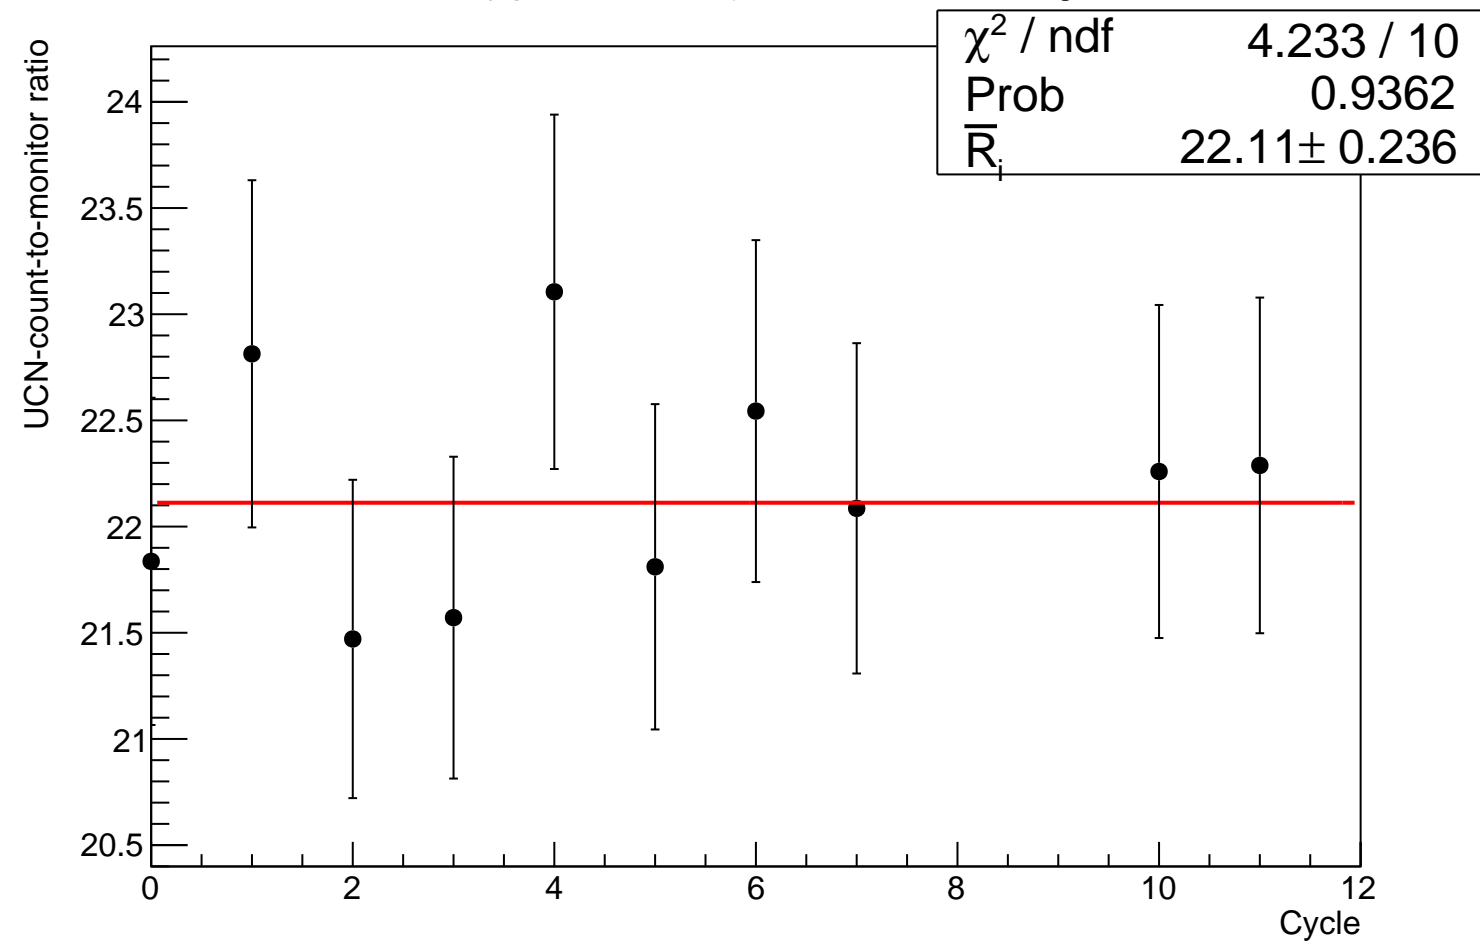


Graph

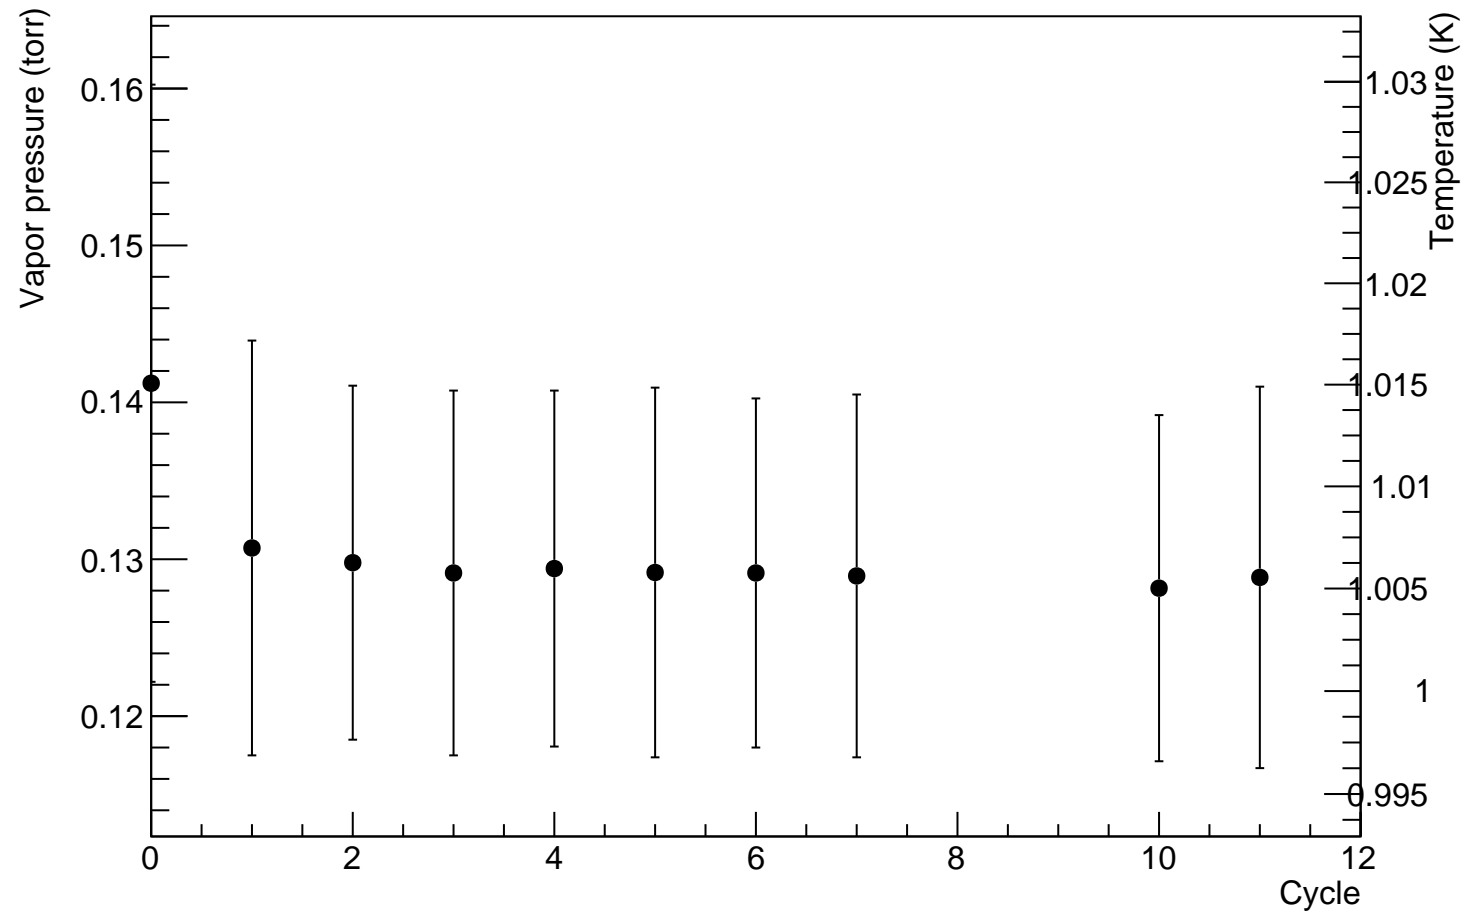

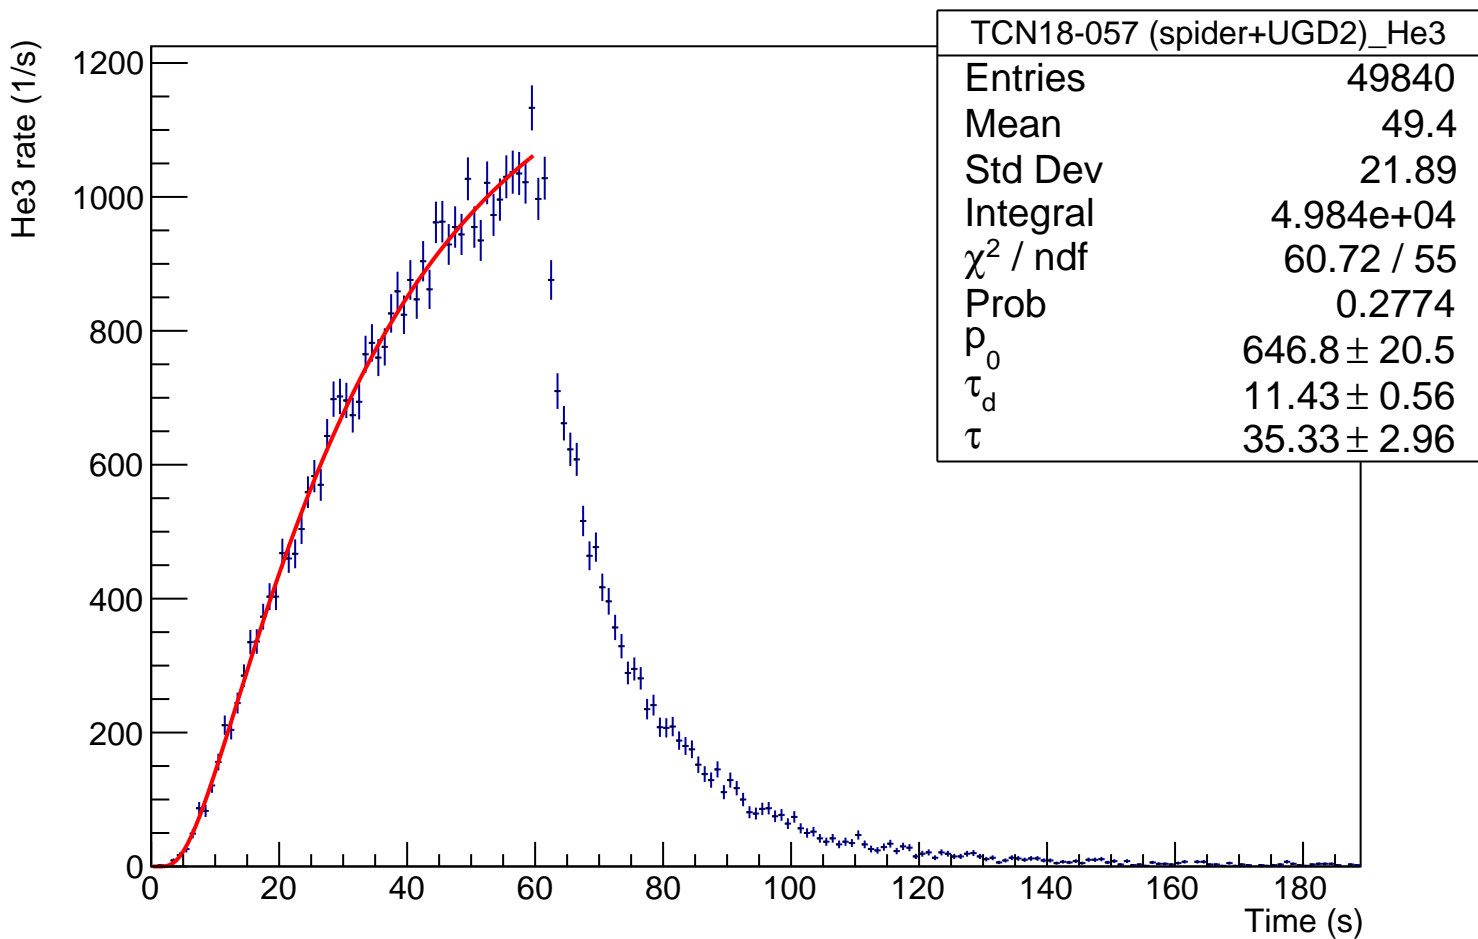

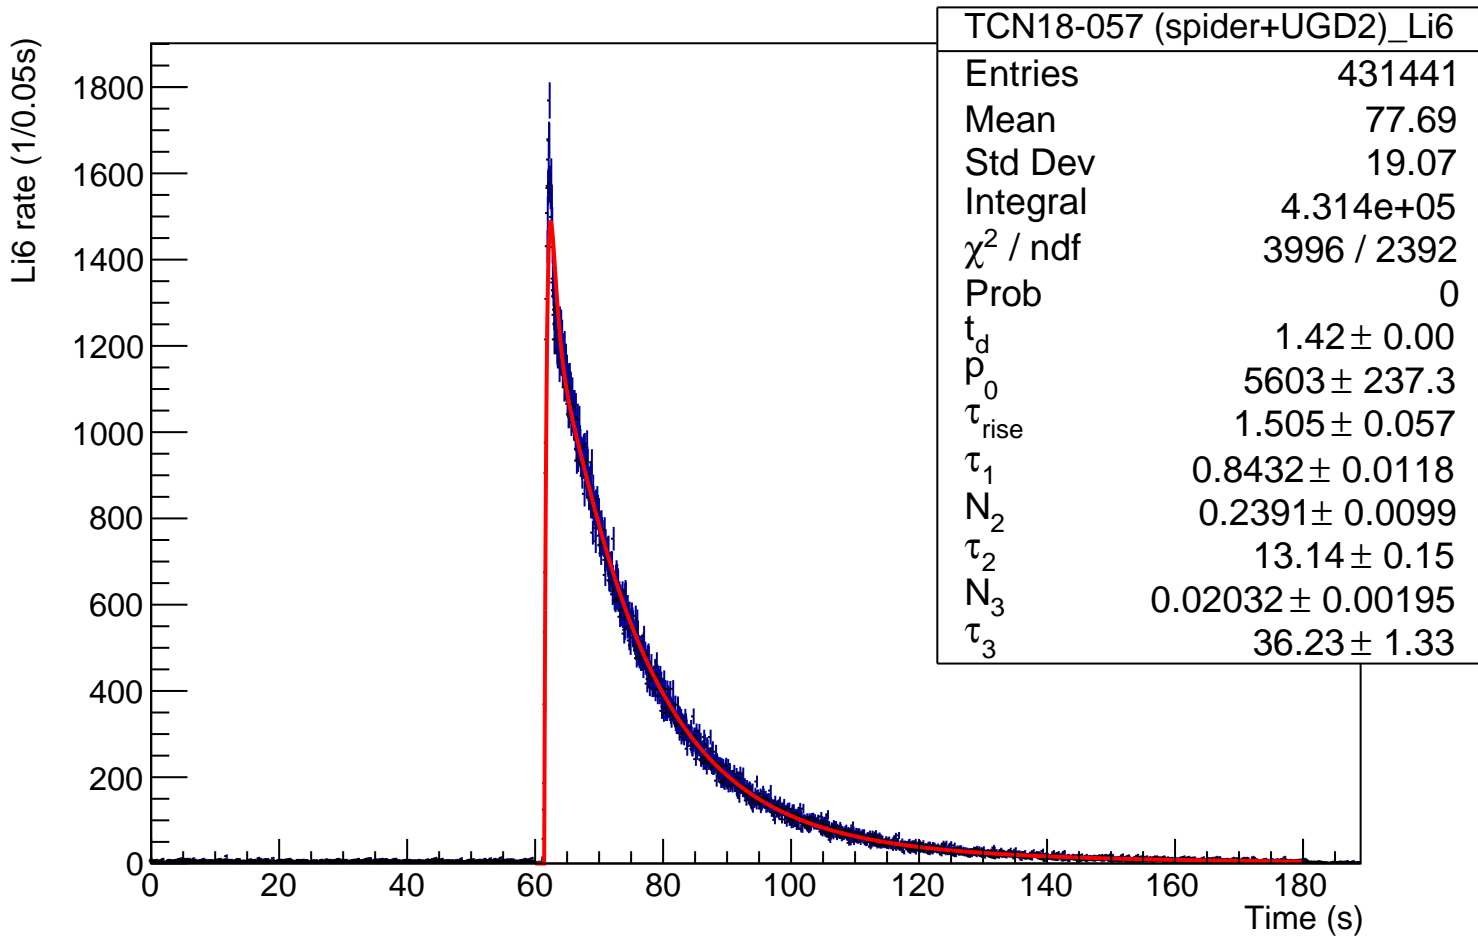


Li6 rate normalized during counting (1/0.05s)

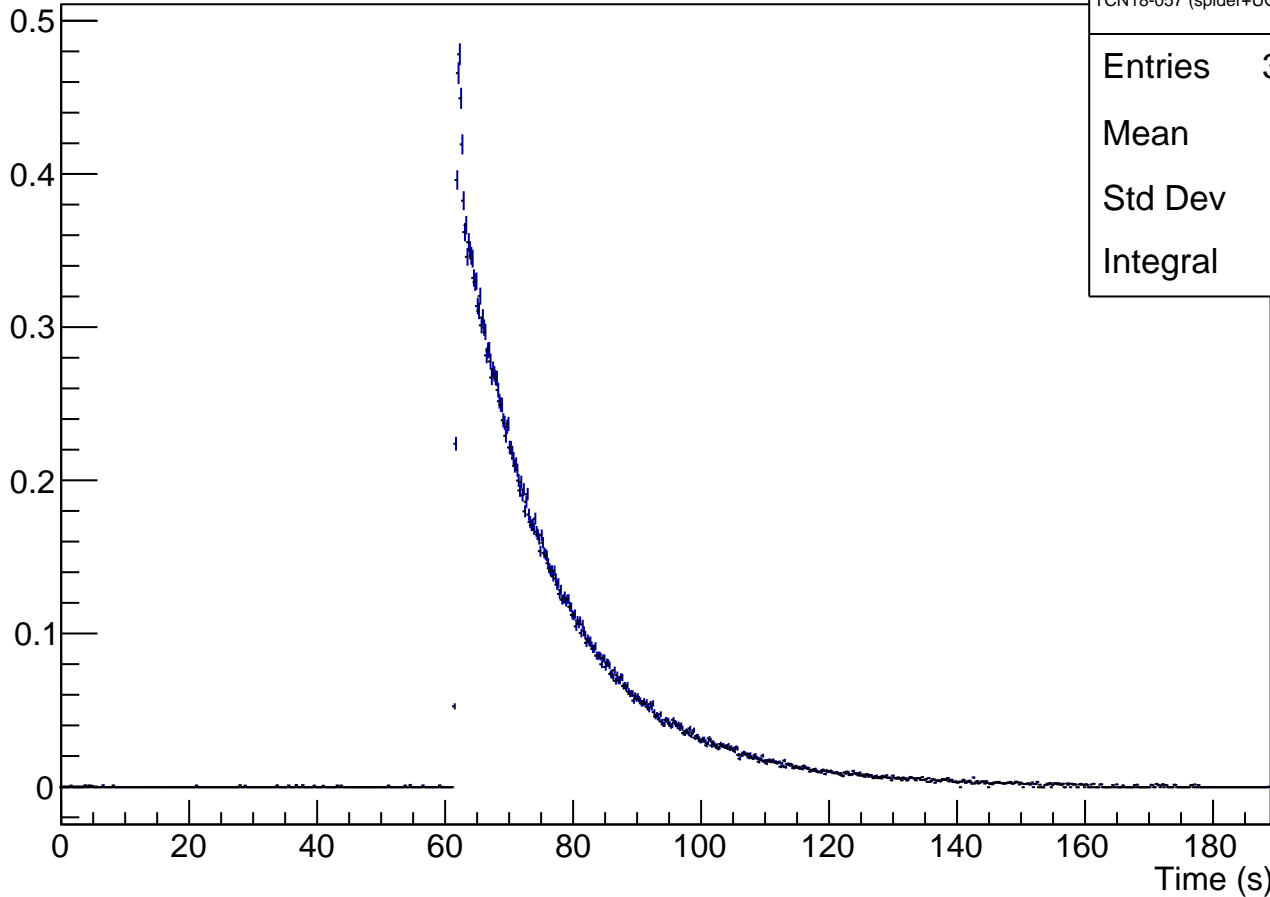

TCN18-057 (spider+UGD2)_Li6_norm

Entries	352758
Mean	77.51
Std Dev	18.25
Integral	30.07

Li6 rate normalized during irradiation (1/0.05s)

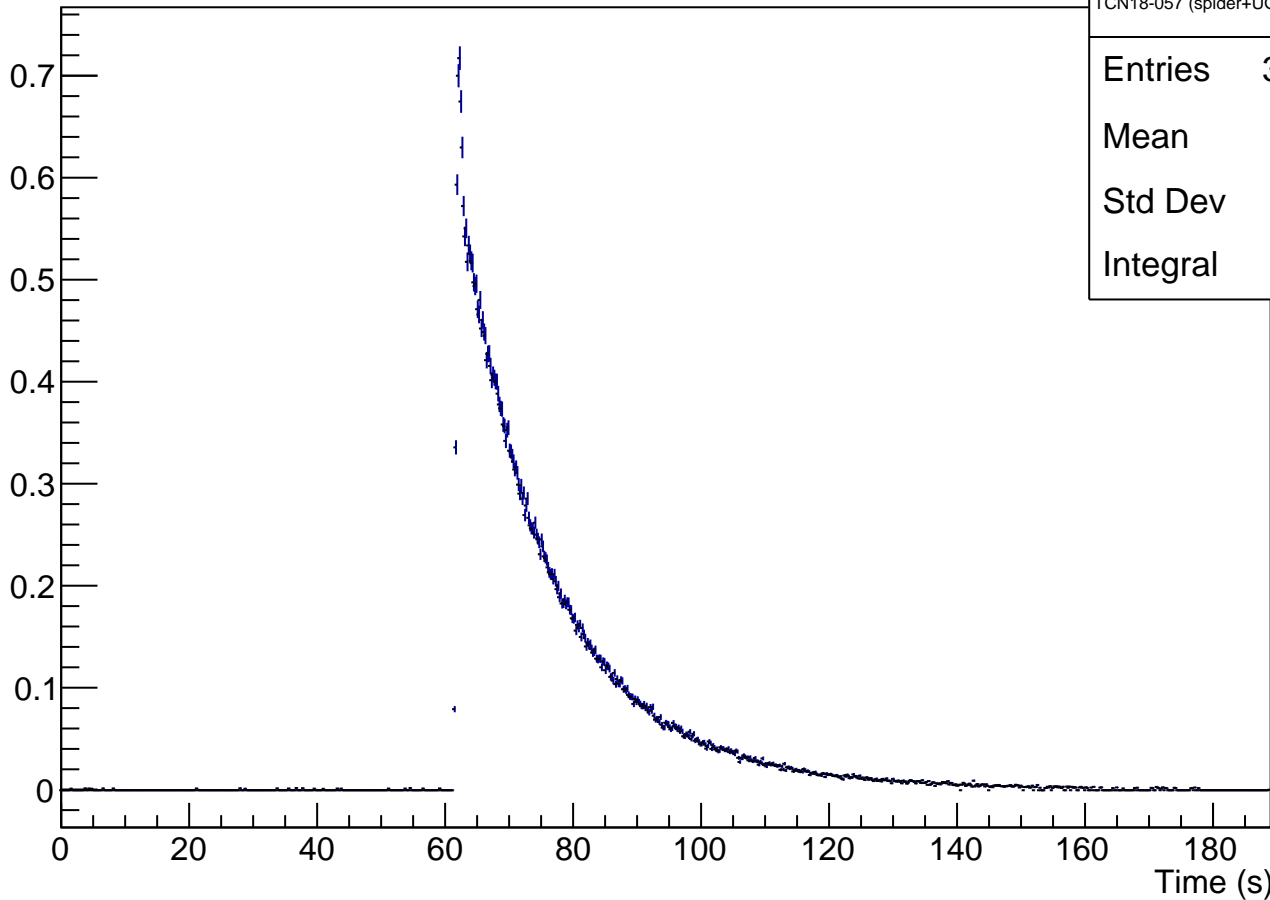

TCN18-057 (spider+UGD2)_Li6_norm


Entries 326034

Mean 77.52


Std Dev 18.26

Integral 45.07

Ratio of cumulated rates

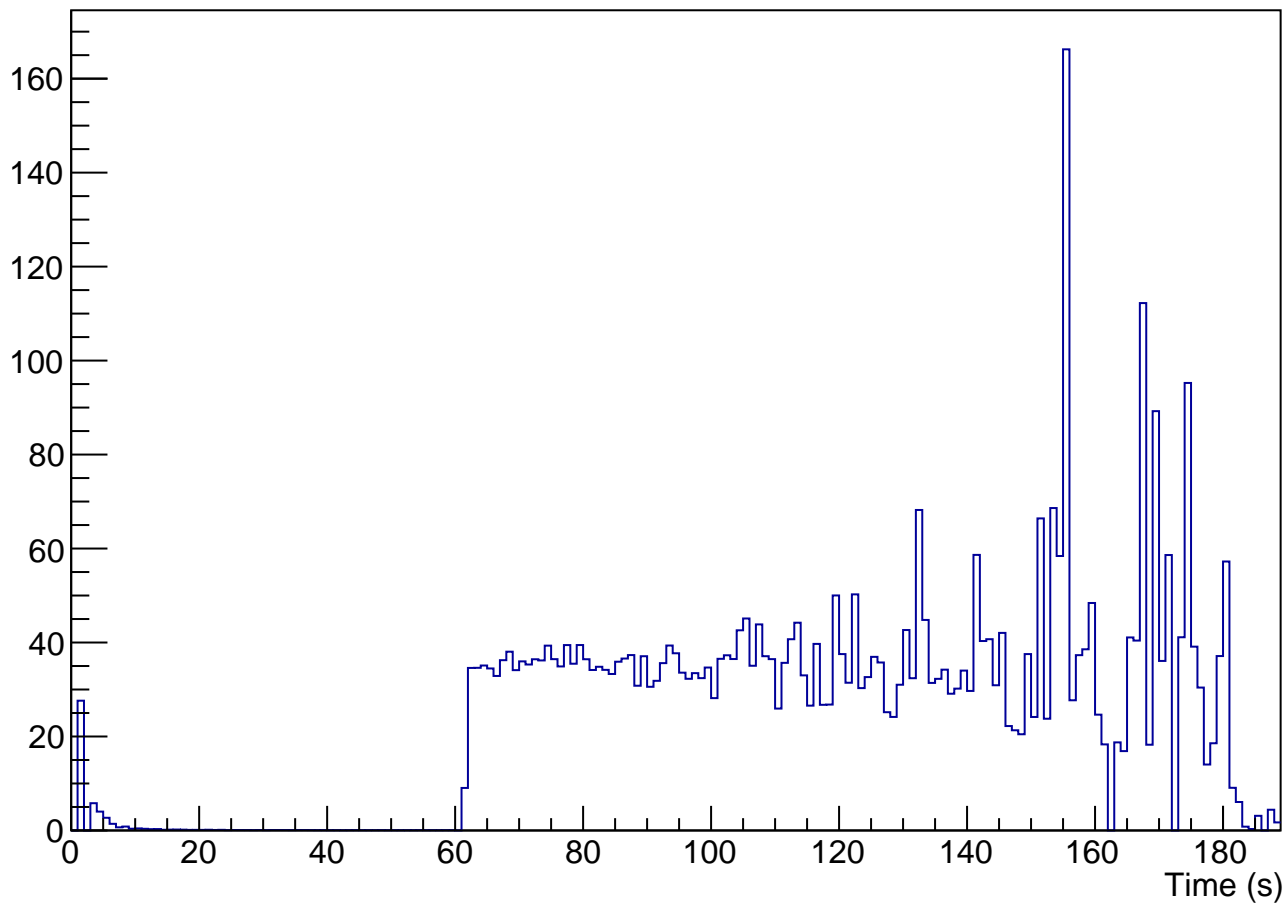

Average rate ratio

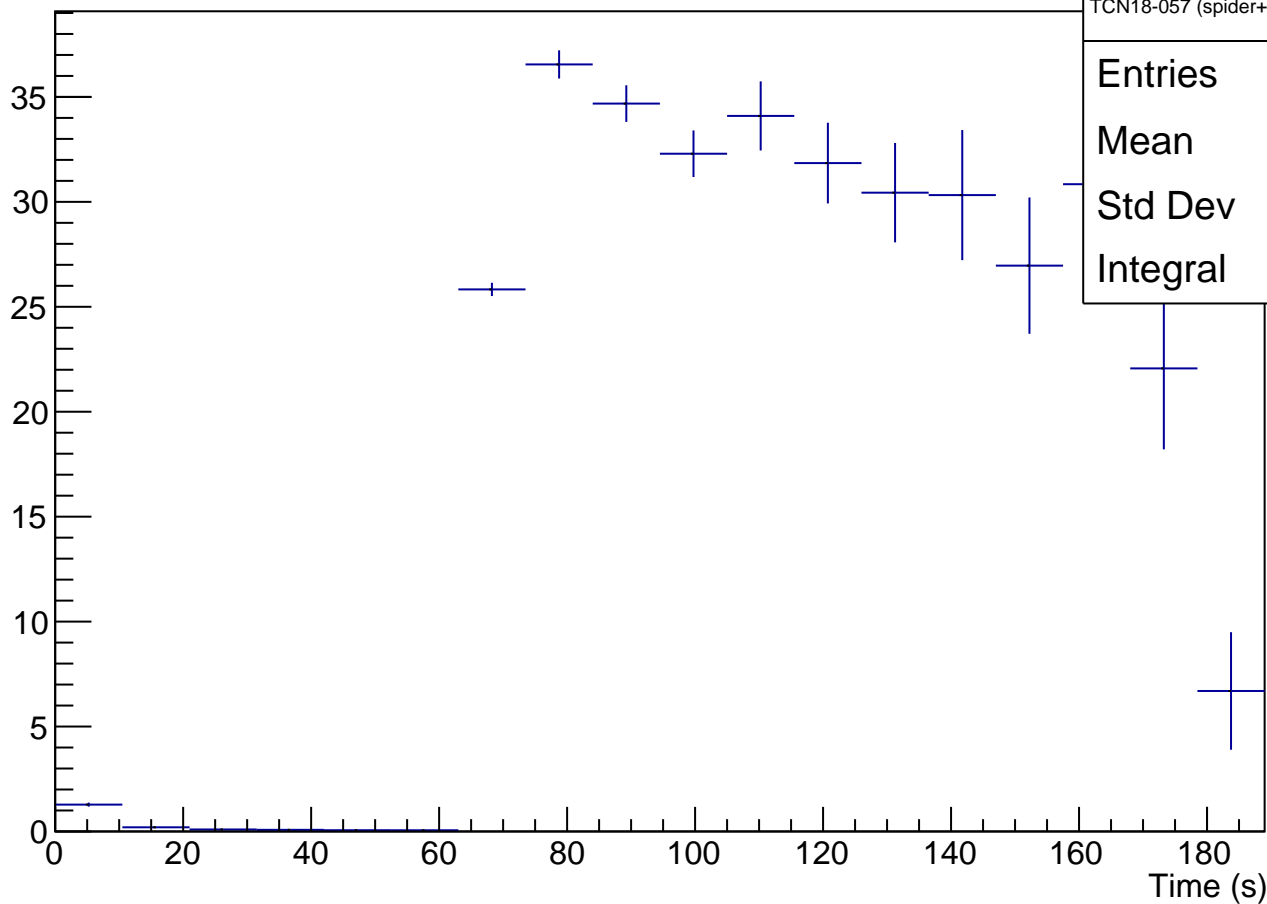

TCN18-057 (spider+UGD2)_ratio


Entries 664

Mean 122.2


Std Dev 34.6

Integral 344.4

TCN18-057 (spider+UGD2)

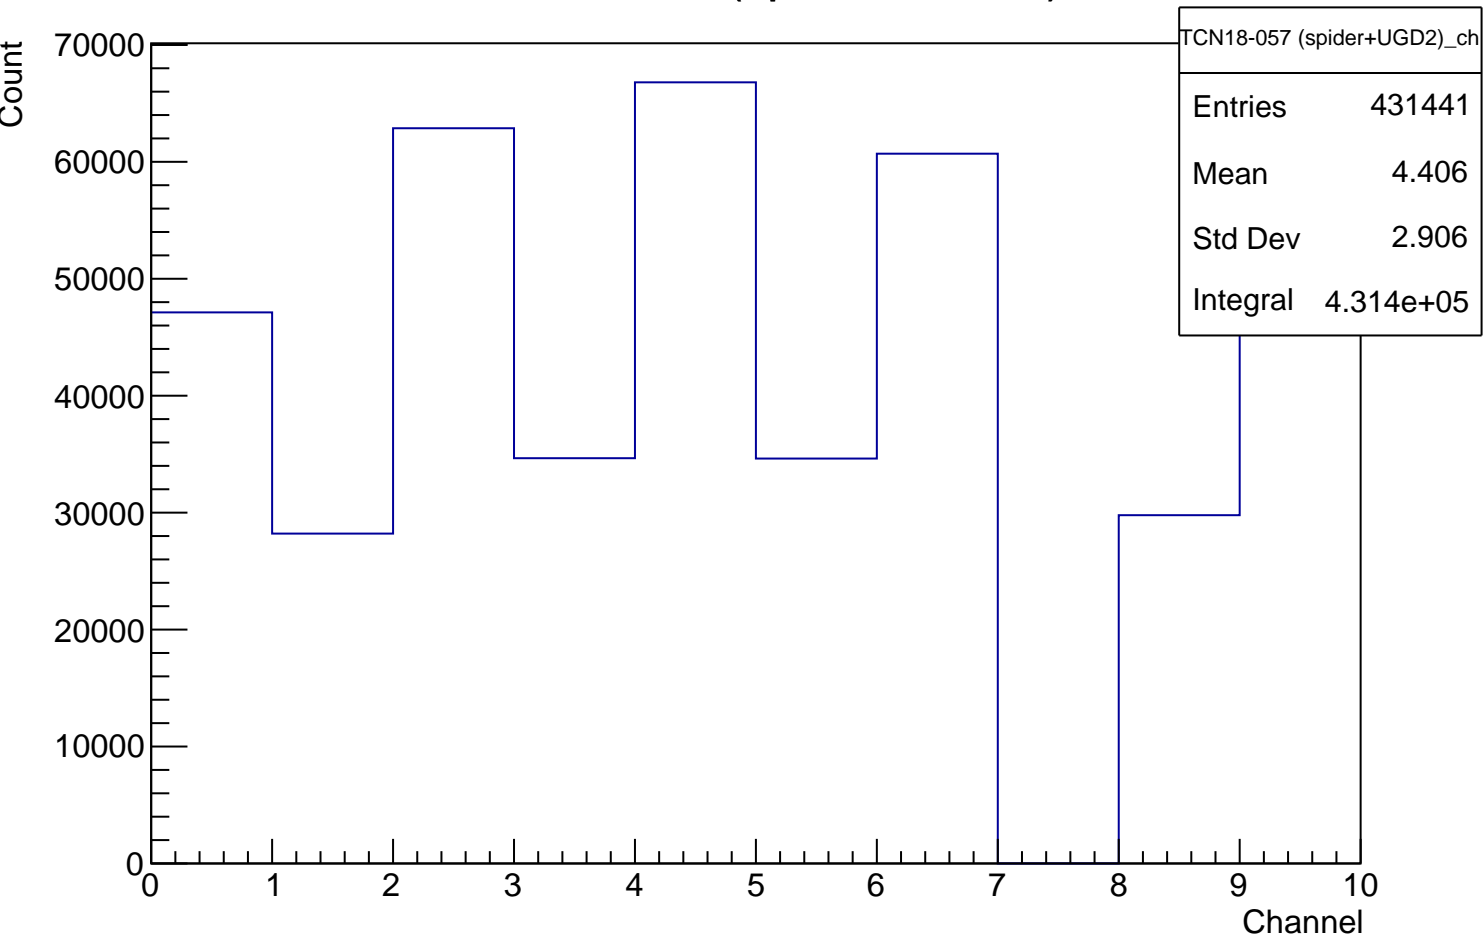

Li6 window

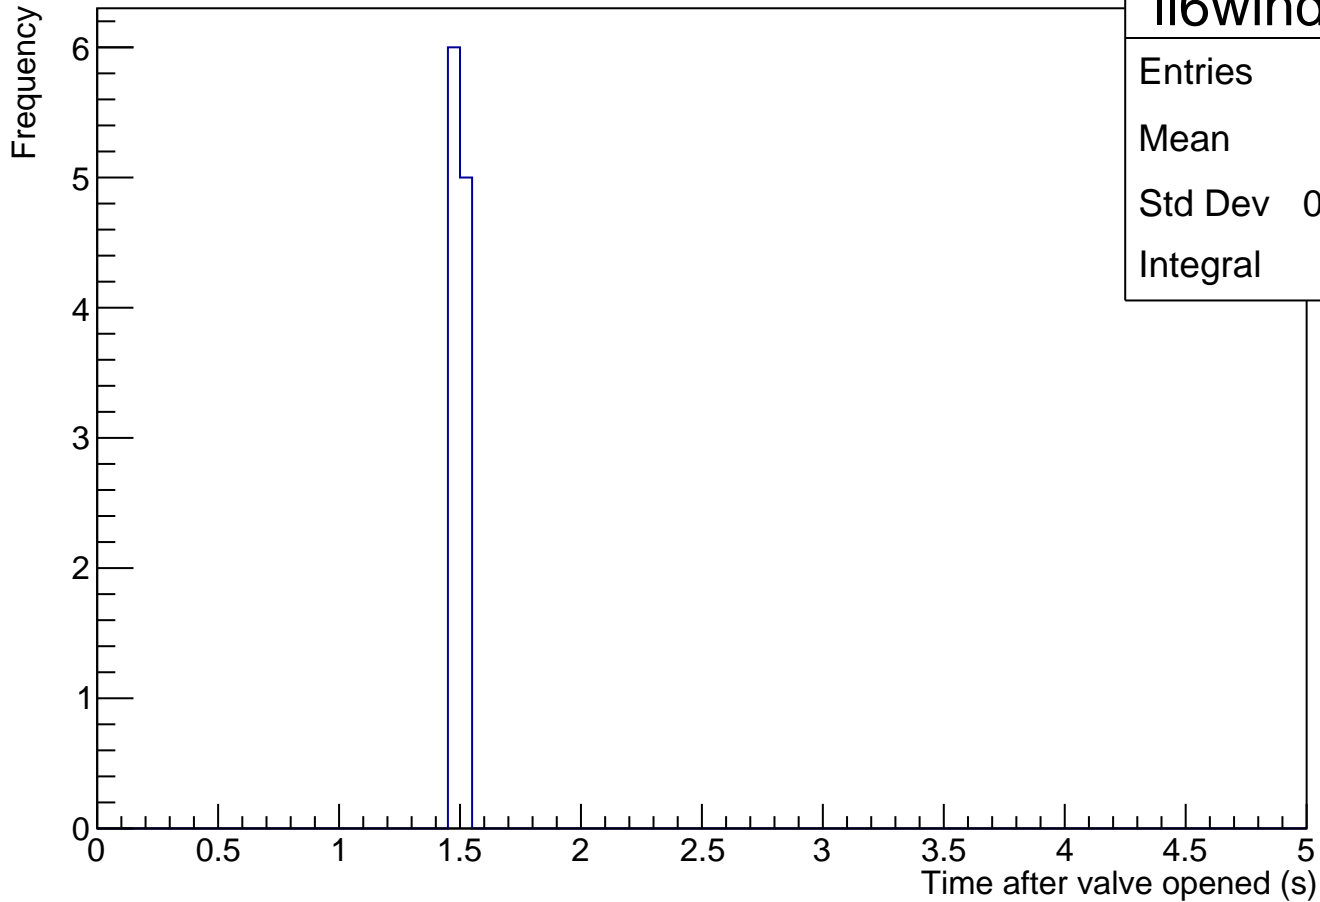

li6window

Entries	11
Mean	1.473
Std Dev	0.0249
Integral	11