



NOTICE INVITING TENDER

ब्रह्मपुत्र वैली फर्टिलाइजर कारपोरेशन लिमिटेड BRAHMAPUTRA VALLEY FERTILIZER CORPORATION LIMITED (A GOVT. OF INDIA UNDERTAKING) NAMRUP

PUR 7

Please reply to:
Chief Materials Manager
BVFCL, Namrup
P.O. Parbatpur – 786 623
Dist. Dibrugarh (Assam), India

REGISTERED/ U. C. OF POSTING

BVFCL IN: FAX: +91 (0)374 250 0204 / 250 0317, P.O. Parbatpur, Distt. Dibrugarh, Assam, e-mail: matmgt@bvfc.co.in,
Website: www.bvfcl.com, Cin: U24123AS2002GOI006786

For Reply Please Quote:

Ref. No: AN/2015/93-003/531/VKT/ENQ- 0418

Date: 01/07/2016

To,

M/s. As per 2018

Please submit your quotation in SINGLE STAGE/TWO STAGE in DUPLICATE in SEALED COVER on or before 29/07/2016, 2:30 PM, and shall be opened thereafter at 3:00 PM (IST) on the same date. The quotation as well as the envelope shall be addressed to Materials Manager with our reference no. cited above and date of opening DULY SUPERSCRIBED on the cover for the under-noted stores subject to the TERMS AND CONDITIONS printed overleaf.

Please quote prices FOR Station of Despatch/ FOR Destination.

Delivery of the materials would be required by :Minimum Delivery Period may be quoted

Earnest Money Deposit: **Rs. 500.00**

SL. No.	DESCRIPTON	QUANTITY
1.	Seal Type Electronic Pressure Transmitter Details as per annexure – I	as per annexure – I

NOTE:

1. Tenders must be accompanied by Earnest Money Deposit for an amount of **Rs. 500.00** in the form of Demand Draft drawn in favour of Brahmaputra Valley Fertilizer Corporation Limited, payable at NAMRUP/ Bank pay order (available on our website) or NSIC Certificate under "Single Point" registration scheme in lieu of EMD.
2. **Tenderers not registered with BVFCL** have to furnish self-certified documentary evidence in support of qualifying requirements of their tenders as stipulated below:
 - a) Experience & Past Performance of similar contract for last 2 years.
 - b) Capability with respect to Personnel, equipment and manufacturing facilities.
 - c) Financial standing through Annual Report (Balance sheet and profit & loss account) of last 3 years.
 - d) Statutory requirement such as Central Excise, Sales Tax, PAN, TAN, TIN, ESI, Labour Licence no. EPF registration no. etc wherever applicable.

Note.


- The participation of MSE will be considered as per Govt. guidelines.
- BVFCL is committed to a corruption free work environment. "All the above purchases, services and commitments of BVFCL will be honoured without the citizen having to pay any bribe". In case any person demands any bribe, it is the duty of the responsible to inform the matter to vigilance office, BVFCL, Namrup, P. O. Parbatpur, Dist. Dibrugarh, Assam PIN; 786623. (Tel no: 0374-2507092 / 0374-2507167).
- "The Goods bearing the ISI Mark will be given preference."

for and on behalf of
Brahmaputra Valley Fertilizer Corporation Limited.,


V. K. Tamboli

V. K. Tamboli
Asstt. Materials manager

Encls: 1. Annexure - I
2. Drg: N-II/Inst/582

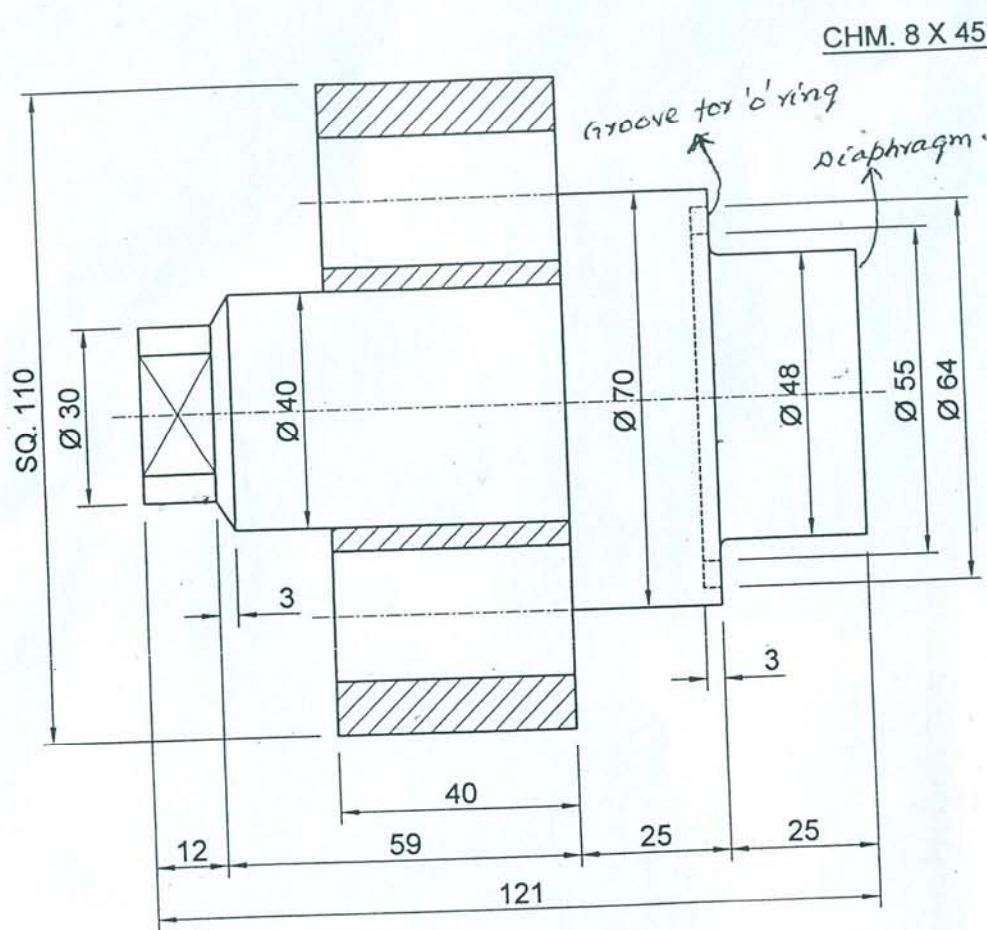

SECTIONAL ELEVATION
(SECTION AT A - A')

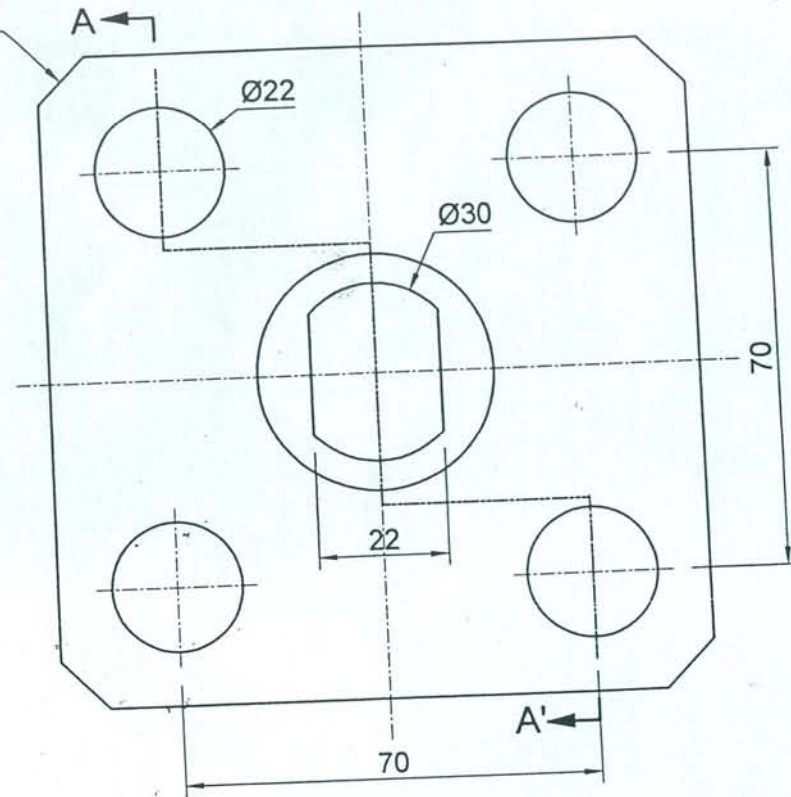

L.H. SIDE VIEW

BRAHMAPUTRA VALLEY FERTILIZER CORPORATION LIMITED, NAMRUP			
SCALE: N.T.S.	DATE: 21/08/12	TITLE:- PAD TYPE PRESSURE INDICATOR FOR CARBAMATE PUMP IN UREA - II	
DRAW: D. BORA	11.09.12		
CHKD: R. Bora	11.09.12		
COMP:			
APPD: R. Bora	11.09.12	DRAWING NO. :- N-II / INST - 582	

Annexure-I

Ref. No.: 2015/93-03
Date: 20.10.2015

Seal type Electronic Pressure Transmitter with separator diaphragm and capillary for Carbamate Pumps
Instrument Tag No: PT-01A/B. Folio/Code No.: 6868000012

Sl. No.	Process Specification	Discharge pump line.
01.	Location.	Carbamate solution
02.	Fluid	Pressure Transmitter.
03.	Function	IP67
04.	Case	Crystal Capsule
05.	Element type	Mfr. Std.
06.	Case Material	AISI 316L.
07.	Socket and Wetted parts material.	Yoke.
08.	Mounting	½ NPT.
09.	Connection type	24VDC-2 Wires.
10.	Supply.	4-20 mA.
11.	Output Signal.	Direct.
12.	Action	Smart-Hart
13.	Execution	½ NPTF
14.	Electrical connection	10.5 To 42VDC.
15.	Electrical rating and supply.	0 to 250 kg/cm ²
16.	Set	0 to 500 kg/cm ²
17.	Range	100:1 for the actual upper range limit.
18.	Range ability	Safe
19.	Installation area	110° C
20.	Max. Temperature	230kg/cm ²
21.	Max. Pressure	2 Bracket
22.	Options	Separator diaphragm with 1.5 mm capillary with SS-304 PVC covered armouring.
23.		1
24.	Quantity(nos.)	Required
25.	Calibration test certificate	Ambient temp. 4° C min. 40° C max.
26.	Tropicalised	STD.
27.	Colour	

Note: Installation in safe area. Presence of ammonia, urea dust and occasionally sulphuric acid mist.

No Cu or Cu alloys shall be used for parts in contact with atmosphere.

Process connection flange dimension is detailed in Drg. No. N-II/ Inst. / 582 is attached herewith and pressure transmitter to be supplied should strictly match with our attached drawing.

Party should provide technical literature containing features, specifications and mechanical dimensions.