


Cable assemblies coordinated with acceptance testing

Align cable preparation, factory testing and field acceptance testing at a defined equipment connection.

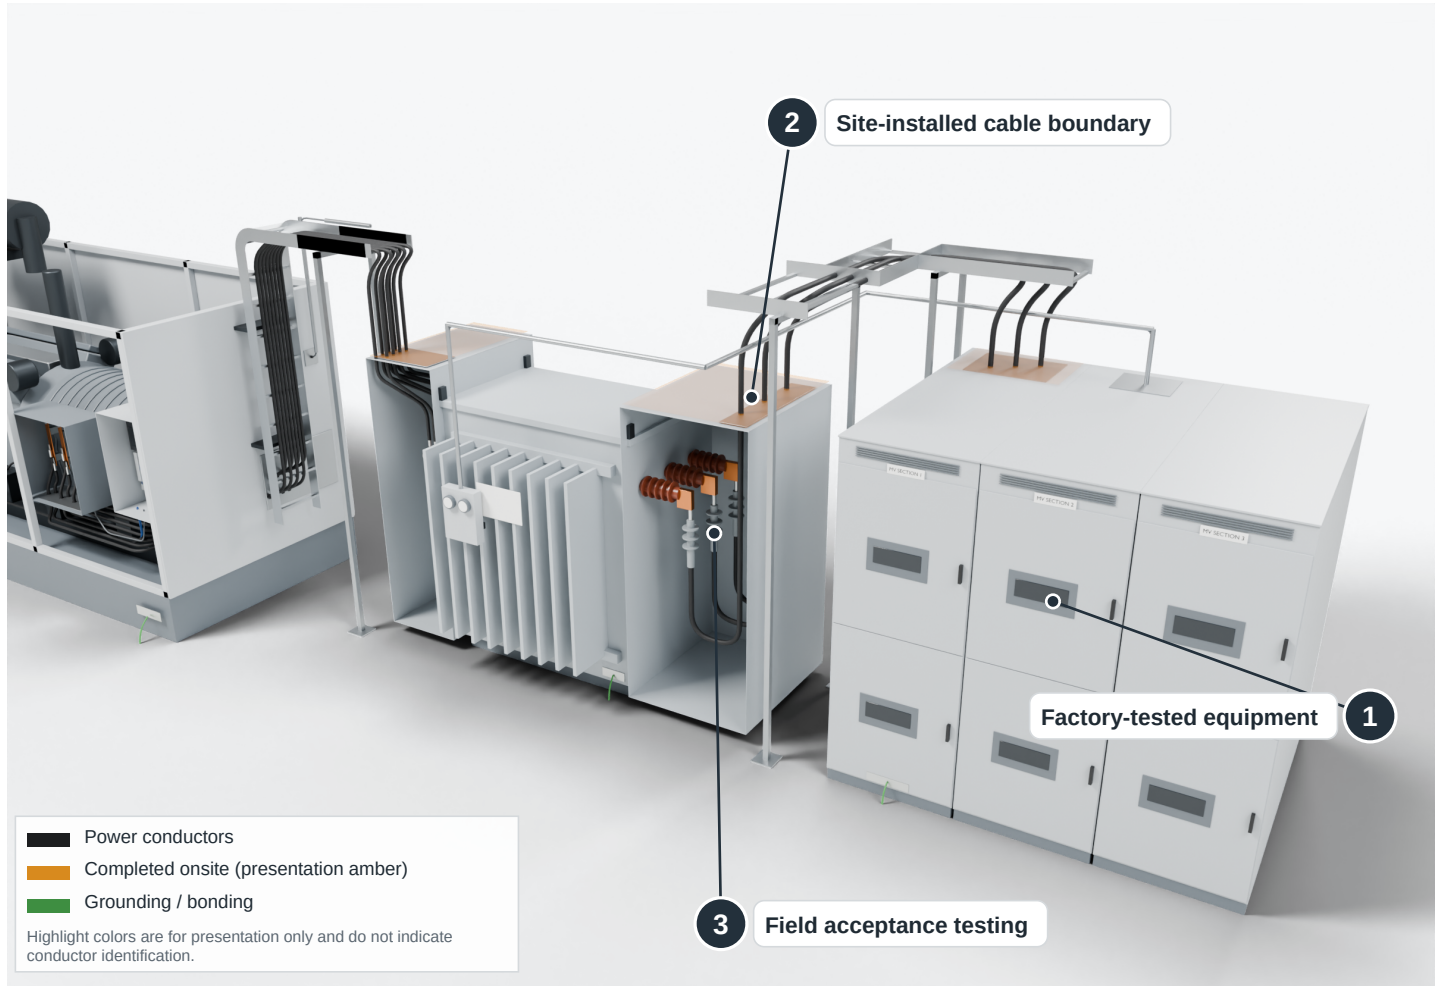

APPLICATIONS TO EVALUATE

1 Factory-tested equipment

Transformer and switchgear terminations as delivered, with their factory test records and documented connection points.

2 Site-installed cable boundary

Cables and terminations installed onsite, prepared and identified for the defined connection points.

3 Field acceptance testing

Test methods, responsibilities and records agreed before installation rather than after, so results can be traced to each cable.

Established: Southwire wire and cable manufacturing and supply.

For evaluation: the prepared kits, cable packages and assemblies shown are application concepts, not qualified Southwire products.

Illustrative model. Ratings, cable sizes, clearances and termination selections are subject to application engineering. No code compliance, engineering approval or certification is implied.

PROPOSED NEXT STEP

Define one application, the responsibilities at each boundary and the acceptance criteria for the cable connection.

Stephan Hardt

Director, Power Generation Solutions,
Southwire

[Phone] [Email]