


Defining interconnections for modular electrical skids

Clarify which connections are completed in the factory and which are made after the sections are placed onsite.

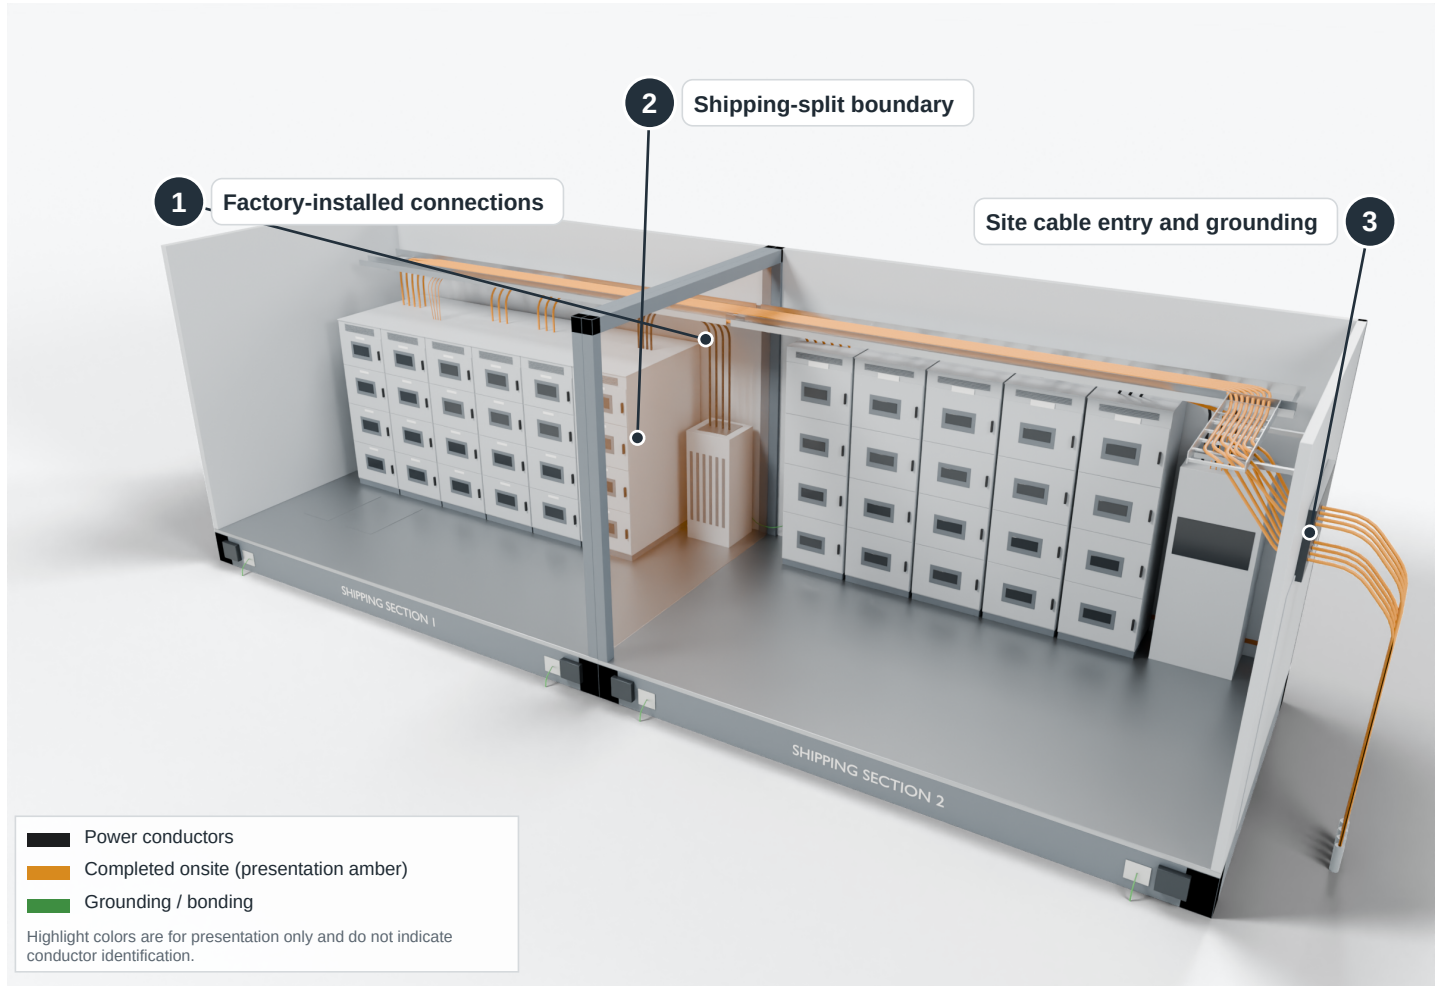

APPLICATIONS TO EVALUATE

- | | | |
|---|--|---|
| <p>1 Factory-installed connections</p> <p>Cables routed and terminated within each section and checked before shipment, per the agreed plan.</p> | <p>2 Shipping-split boundary</p> <p>Split-crossing cables prepared, identified and staged to match the reconnection sequence.</p> | <p>3 Site cable entry and grounding</p> <p>External feeders, cable transits and grounding pads defined as a clear site interface, with ownership agreed for each item.</p> |
|---|--|---|

Established: Southwire wire and cable manufacturing and supply.

For evaluation: the prepared kits, cable packages and assemblies shown are application concepts, not qualified Southwire products.

Illustrative model. Ratings, cable sizes, clearances and termination selections are subject to application engineering. No code compliance, engineering approval or certification is implied.

PROPOSED NEXT STEP

Review one skid interface and its installation sequence to identify which interconnections could be prepared in advance.

Stephan Hardt

Director, Power Generation Solutions,
Southwire

[Phone] [Email]