


[COMPANY LOGO]

# GAS POWER SOLUTIONS


WIRE & CABLE FOR COMBINED CYCLE AND  
MODULAR GAS POWER

2026 EDITION [COMPANY.COM]

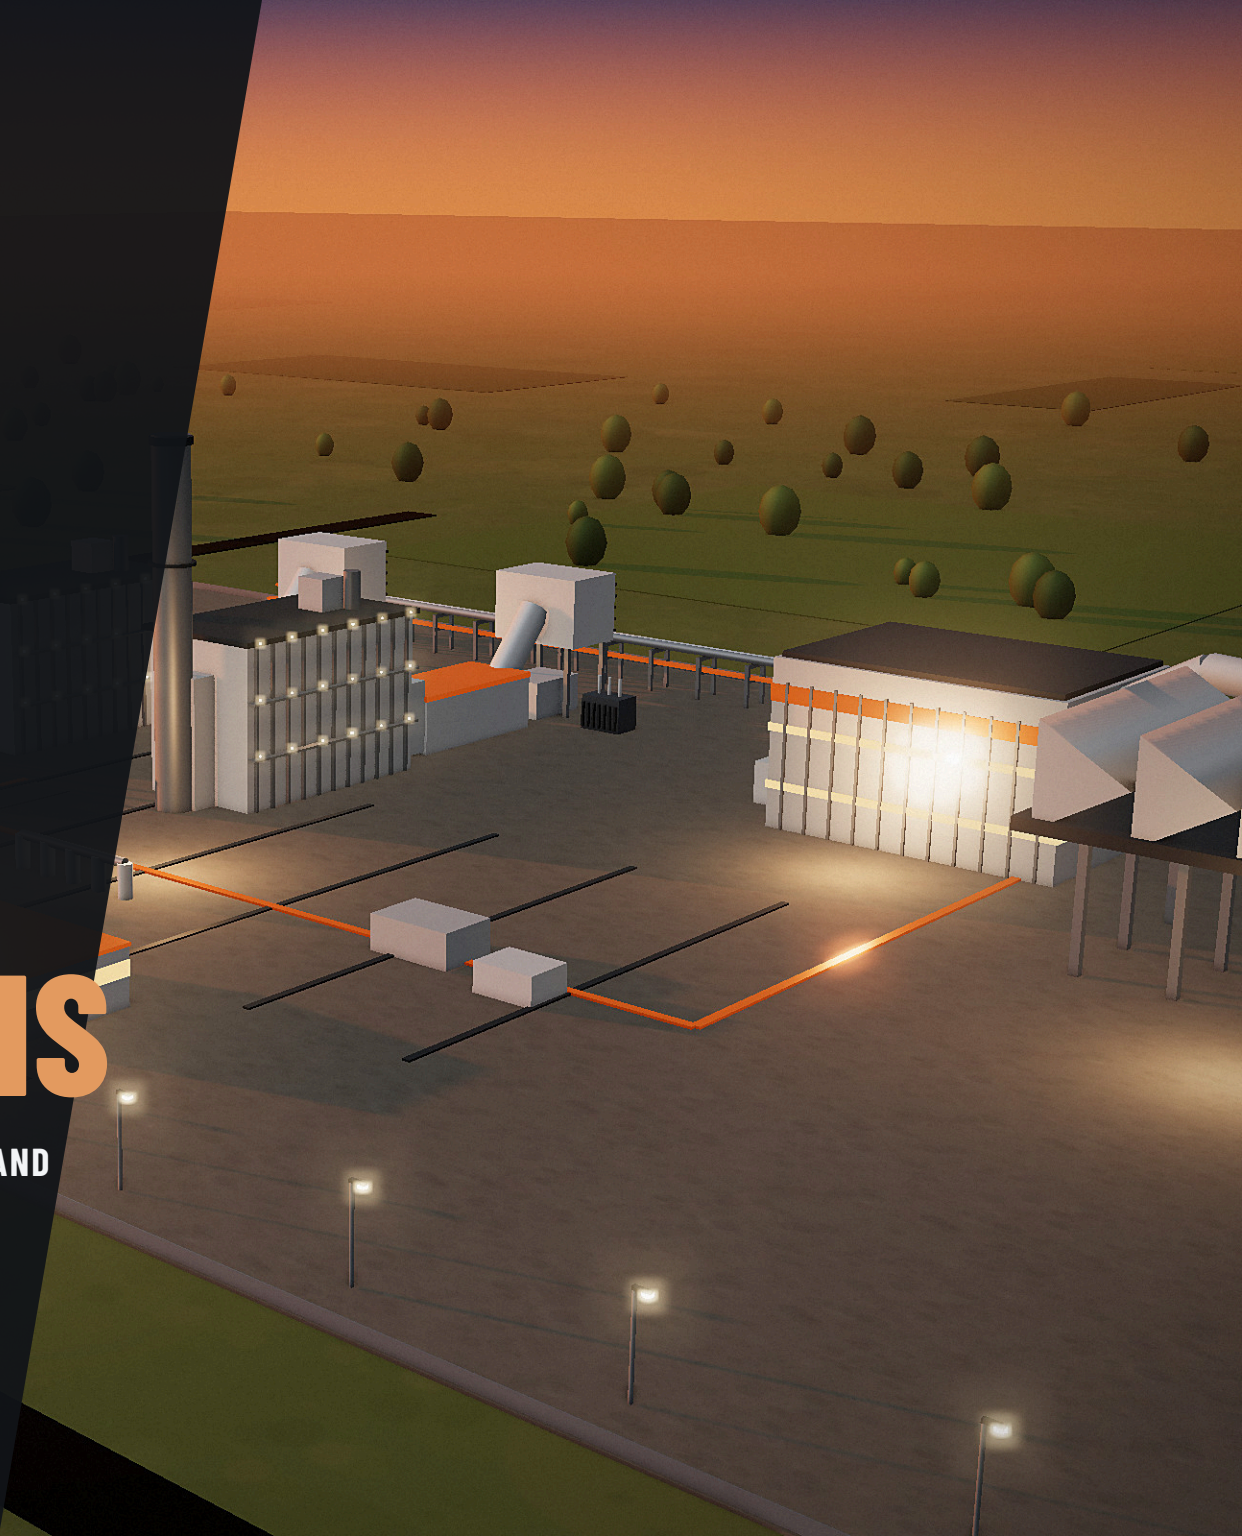

# EVERY MEGAWATT TRAVELS THROUGH A CABLE

Gas-fired generation now runs to a new brief: start fast, cycle often and keep the grid steady as renewables rise. The cables that connect turbine to grid, and sensor to control room, have to meet that brief for decades.

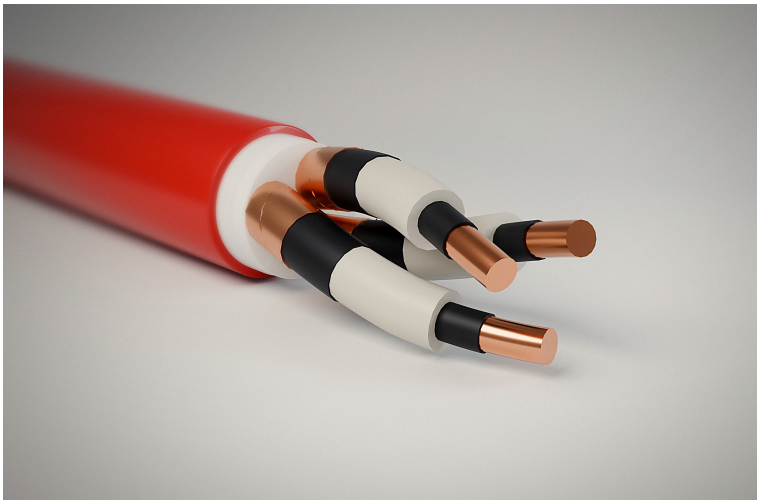

LARGE-SCALE · BASELOAD TO FLEXIBLE

## COMBINED CYCLE PLANTS

### HEAT AT THE HOT SECTION

Routes beside gas turbines, HRSGs and steam lines need insulation rated for high ambient temperatures.

### DAILY CYCLING

Plants that balance renewables start and stop often, stressing terminations and joints.

### FIRE AND SMOKE

Turbine halls and control buildings call for flame-retardant, halogen-free cables.

### ELECTRICAL NOISE

Drives and HV switchgear sit metres from sensitive DCS and protection circuits.

SKID-MOUNTED · CONTAINERISED

## MODULAR GAS POWER

### COMPACT SKIDS

High-density containers need flexible cables with tight bend radii.

### CONSTANT VIBRATION

Engines and aeroderivatives demand fine-stranded conductors and secure glands.

### HARSH SITES

Oil, fuel, UV and wide ambient ranges on remote and temporary sites.

### SPEED TO POWER

Pre-terminated, factory-tested harnesses cut site hours from every unit.


# APPLICATIONS & CAPABILITIES

|                          |    |
|--------------------------|----|
| COMBINED CYCLE OVERVIEW  | 04 |
| PLANT ZONES              | 05 |
| CABLE LINEUP             | 06 |
| CABLE IN DETAIL          | 07 |
| MODULAR GAS POWER        | 08 |
| ENGINEERING & COMPLIANCE | 09 |
| LIFECYCLE SERVICES       | 10 |




# COMBINED CYCLE OVERVIEW

Illustrative 1×1 block. Cable diameters exaggerated for clarity.

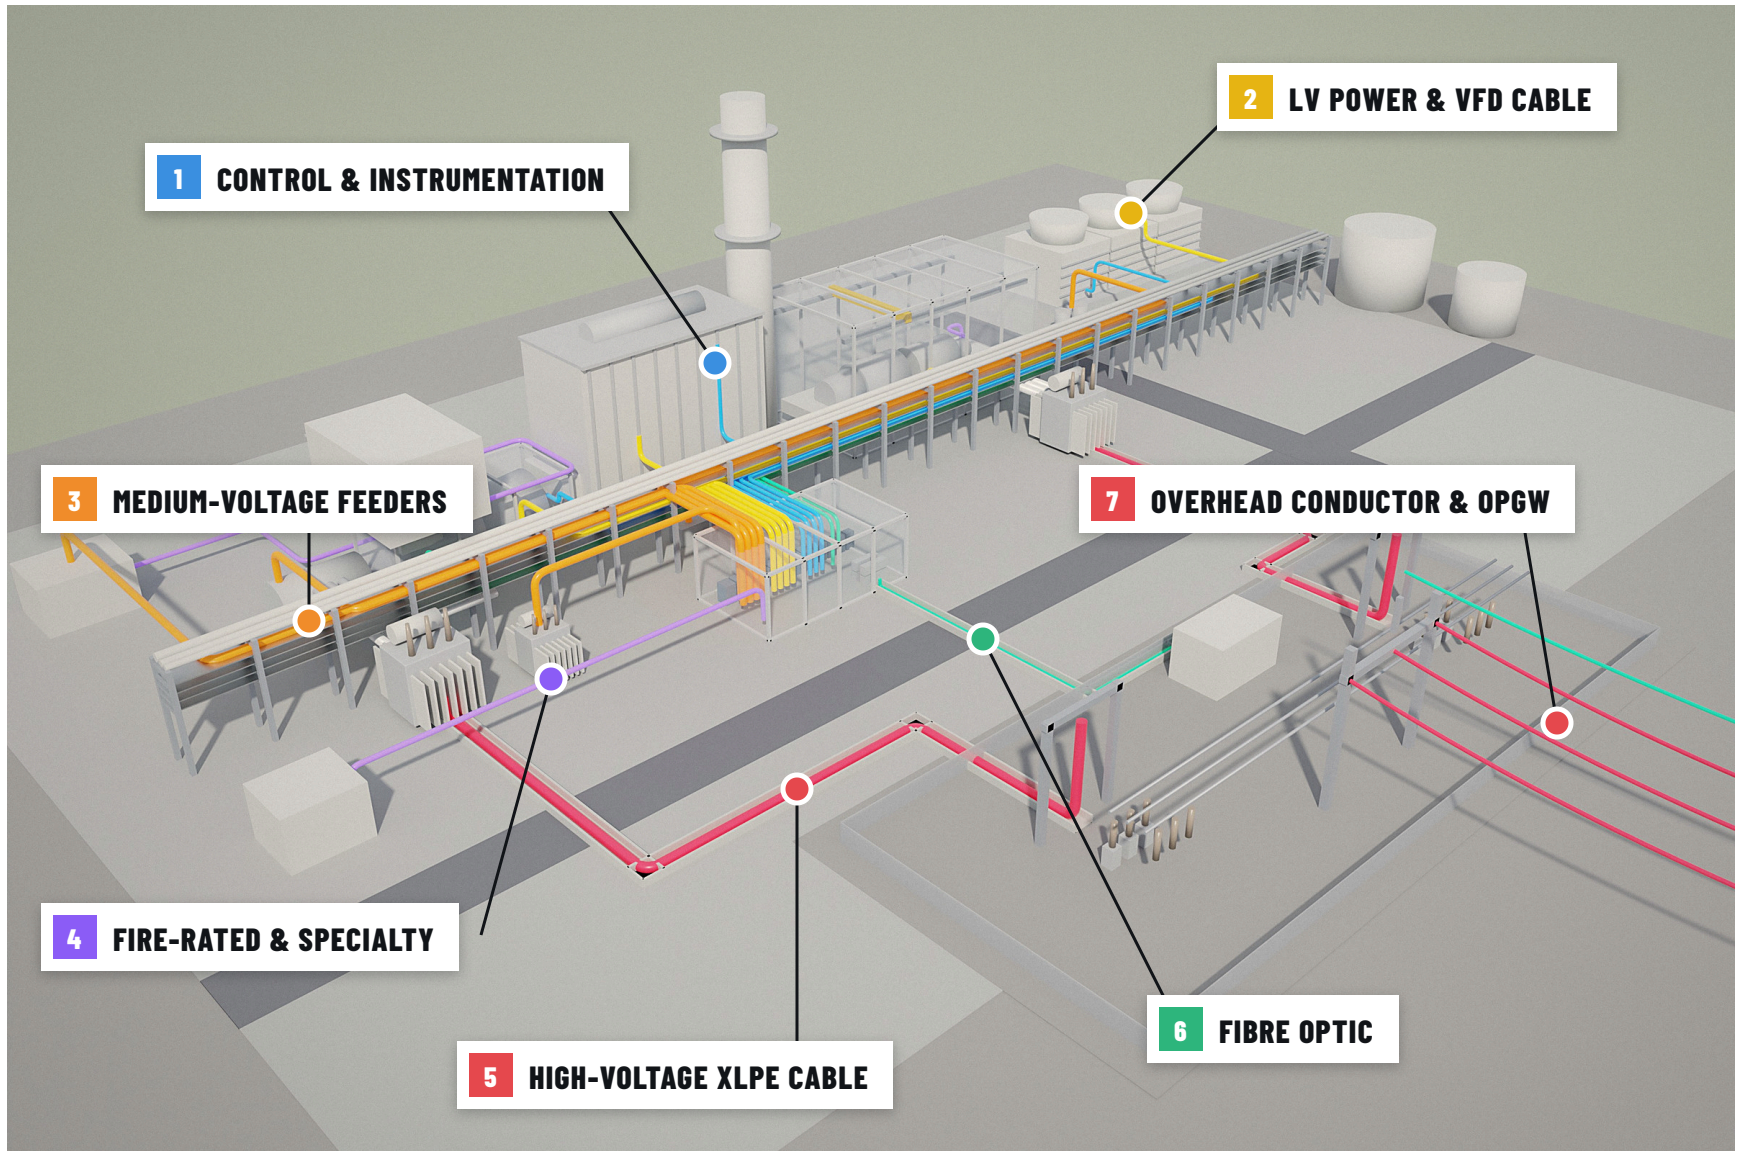

# GENERATOR TO GRID, ZONE BY ZONE

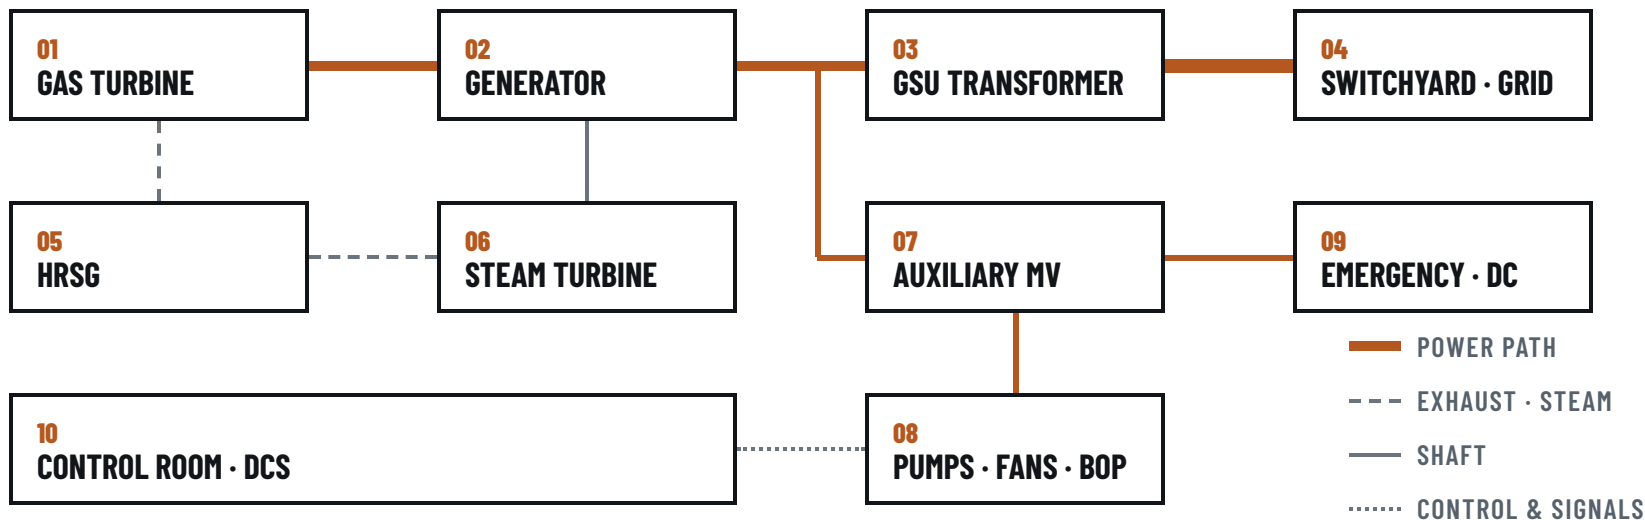

## ZONE 01 · 02

### TURBINE & GENERATOR HALL

Generator connections, high-temperature control and thermocouple cables, fire-resistant instrumentation.

## ZONE 03 · 04

### STEP-UP & GRID CONNECTION

HV and EHV XLPE cables with terminations and joints; earthing; protection fibre.

## ZONE 05 · 06

### HEAT RECOVERY & STEAM CYCLE

Heat-resistant instrumentation, armoured control, LV power for valves and actuators.

## ZONE 07 · 08

### AUXILIARIES & BOP

MV cables for feed and cooling water pumps, VFD motor cables, LV distribution.

## ZONE 09

### EMERGENCY & DC SYSTEMS

Circuit-integrity cables for fire and gas detection, emergency lighting and lube-oil pumps.

## ZONE 10

### CONTROL & DCS

Screened multi-pair instrumentation, fieldbus, industrial Ethernet and fibre backbone.

# ONE SUPPLIER. EVERY CIRCUIT.



## HV HV & EHV POWER

Step-up transformer to switchyard and grid, with terminations, joints and sheath bonding.


XLPE · IEC 60840 · IEC 62067



## MV MEDIUM VOLTAGE

Auxiliary transformers, feed and cooling water pump motors, switchgear interconnects.

3.6/6 TO 18/30 KV · IEC 60502-2



## LV LV POWER & VFD

Distribution and small power, plus symmetrical screened cables for drives.

0.6/1 KV · IEC 60502-1



## CI CONTROL & INSTRUMENTATION

Screened pairs and triads, thermocouple extension and fieldbus for DCS and protection.

EN 50288-7 · IEC 60584-3



## FR FIRE-RESISTANT

Circuit integrity for fire and gas, emergency lighting, lube-oil and DC systems.

IEC 60331 · BS 8491



## FO FIBRE & DATA

Armoured, rodent-resistant fibre and industrial Ethernet for control and protection.

ITU-T G.652.D · CAT 6A



## MX FLEXIBLE & MODULAR

Fine-stranded, oil- and UV-resistant cables and pre-terminated harnesses for skids.

IEC 60228 CLASS 5




## AC ACCESSORIES & SYSTEMS

Terminations, joints, glands, cleats and cable management, matched to each cable.

IEC 60502-4 · IEC 61914

# CABLE IN DETAIL

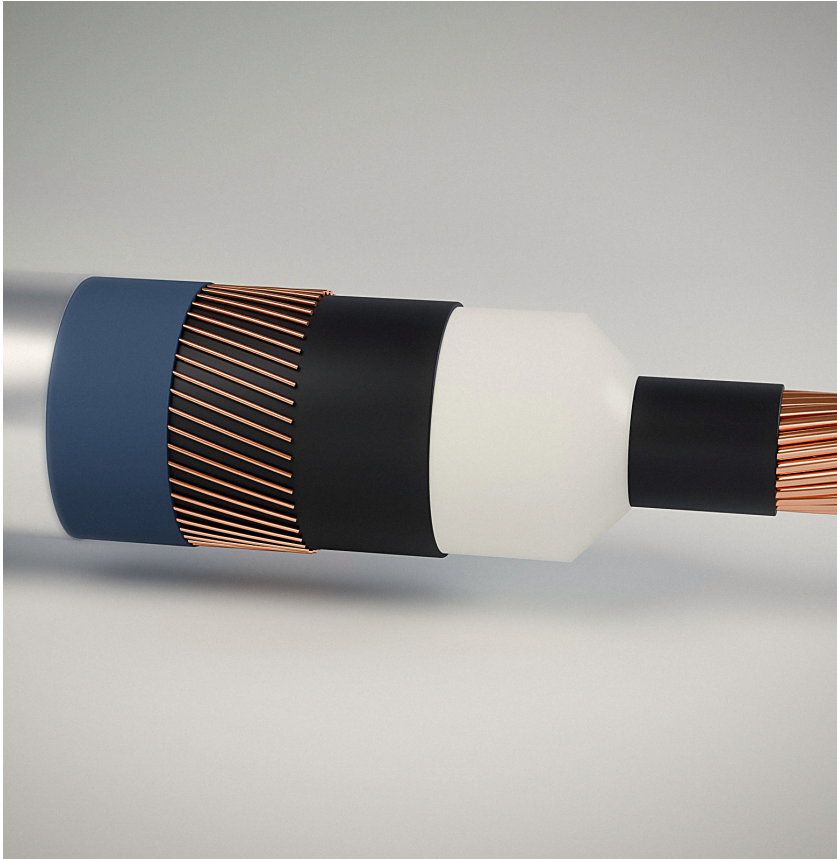


**HV SINGLE-CORE XLPE.** Stranded conductor, triple-extruded dry-cured XLPE, copper wire screen for fault current, and water-blocking tape with a bonded aluminium laminate under a tough PE jacket.




**MV THREE-CORE.** Screened cores feeding feed-water pumps, cooling water pumps and fuel gas compressors.



**CIRCUIT INTEGRITY.** A mica-tape barrier keeps fire pumps, alarms and shutdown circuits working in a fire.

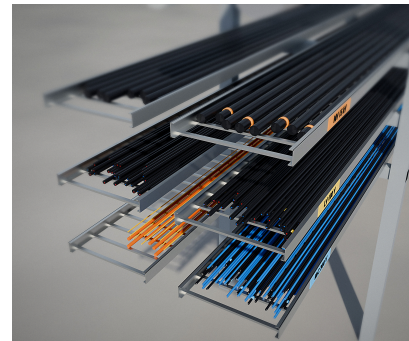


**SEGREGATED TRAYS.** Voltage classes stacked highest on top, keeping power-cable noise away from signals.

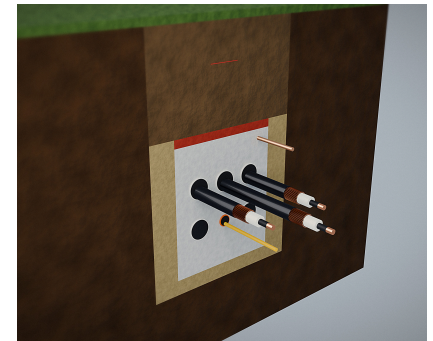

**DUCT BANK.** One phase per conduit, with spare ducts, a fibre duct and a bare copper earth.

# BUILT FOR POWER THAT SHIPS IN A CONTAINER

Aeroderivatives, reciprocating engines and containerised gensets bring capacity online in months, not years. We supply their cabling as a kit, engineered for the skid and ready for the site.

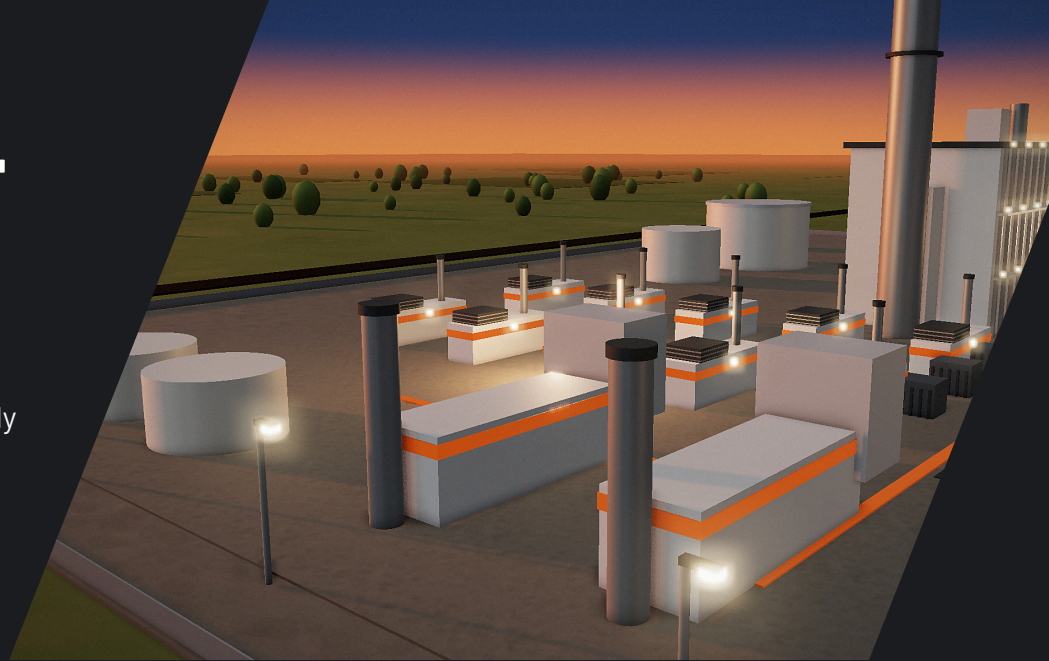

## 01

### PRE-TERMINATED HARNESSES

Cut to length, terminated and tested in the factory, each end labelled to the wiring schedule.

## 02

### FLEXIBLE AND COMPACT

Class 5 conductors and tight bend radii for high-density skids and containers.

## 03

### BUILT FOR VIBRATION

Fine stranding, tough sheaths and anti-vibration glands for engines and aeroderivatives.

## 04

### RATED FOR THE SITE

Oil-, fuel- and UV-resistant sheaths for outdoor, remote and fast-track installations.

#### DELIVERED AS A KIT

01

DESIGN

02

CUT & TERMINATE

03

FACTORY TEST

04

LABEL & PACK

05

PLUG IN ON SITE

# TESTED TO THE STANDARDS YOUR OWNER’S ENGINEER WILL ASK FOR

| STANDARD            | SCOPE                                              |
|---------------------|----------------------------------------------------|
| IEC 60228           | Conductors of insulated cables                     |
| IEC 60502-1 · -2    | Extruded-insulation power cables, 1 kV to 30 kV    |
| IEC 60840           | Power cables above 30 kV up to 150 kV              |
| IEC 62067           | Power cables above 150 kV up to 500 kV             |
| IEC 60332-1 · -3    | Flame propagation: single and bunched cables       |
| IEC 60331           | Fire resistance: circuit integrity                 |
| IEC 61034           | Smoke density                                      |
| IEC 60754-1 · -2    | Halogen acid gas content and acidity               |
| IEEE 1202 · UL 1685 | Vertical tray flame tests, North American projects |

## MATERIALS

### XLPE

Insulation for MV to EHV, 90 °C continuous

### EPR

Flexible insulation for moving and vibrating duty

### LSZH · HFFR

Sheaths for occupied and enclosed spaces

### SWA · AWA


Steel or aluminium wire armour

## QUALITY

Routine, sample and type tests to each applicable standard, with factory witness testing open to owners and EPCs. Certified to [ISO 9001 · ISO 14001 · ISO 45001].

# FROM CABLE SCHEDULE TO FIRST FIRE

One team stays with the project from the first calculation to energisation, so the cable on site is the cable in the design.

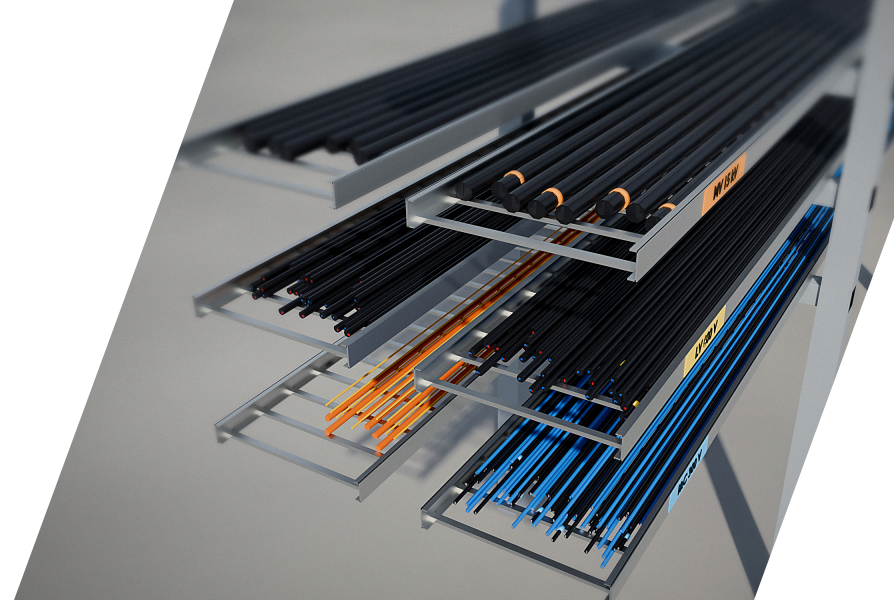

## 01

### FRONT-END ENGINEERING

Cable sizing, derating, voltage-drop and short-circuit calculations; route and tray-fill studies.

## 02

### SCHEDULES & OPTIMISATION

Drum lengths planned against the cable schedule to cut offcuts and joints.

## 03

### MANUFACTURING & WITNESS TESTING

Production slotted to your EPC milestones, with factory tests open to owner's engineers.

## 04

### LOGISTICS

Drum tracking, sequenced deliveries and site-ready packing for modular units.

## 05

### INSTALLATION SUPPORT

Pulling calculations, supervision, and jointing and termination by certified technicians.

## 06

### COMMISSIONING & LIFECYCLE

After-laying tests such as VLF and partial discharge, with optional temperature monitoring on HV routes.

[COMPANY LOGO]

# GAS POWER SOLUTIONS



[AWARD NAME]

[Awarding body ·  
Year]



[AWARD NAME]

[Awarding body ·  
Year]



[AWARD NAME]

[Awarding body ·  
Year]

CONTACT [Name, Title]

EMAIL [email@company.com]

PHONE [+00 000 000 0000]

WEB [company.com/power]

[QR CODE]

