


- 01 Copper conductor
IEC 60228 Class 2
- 02 Copper tape screen
Earth-fault return
- 03 XLPE insulation
90 °C conductor rating
- 04 Steel wire armour
Mechanical protection
- 05 LSZH outer sheath
Low smoke, zero halogen

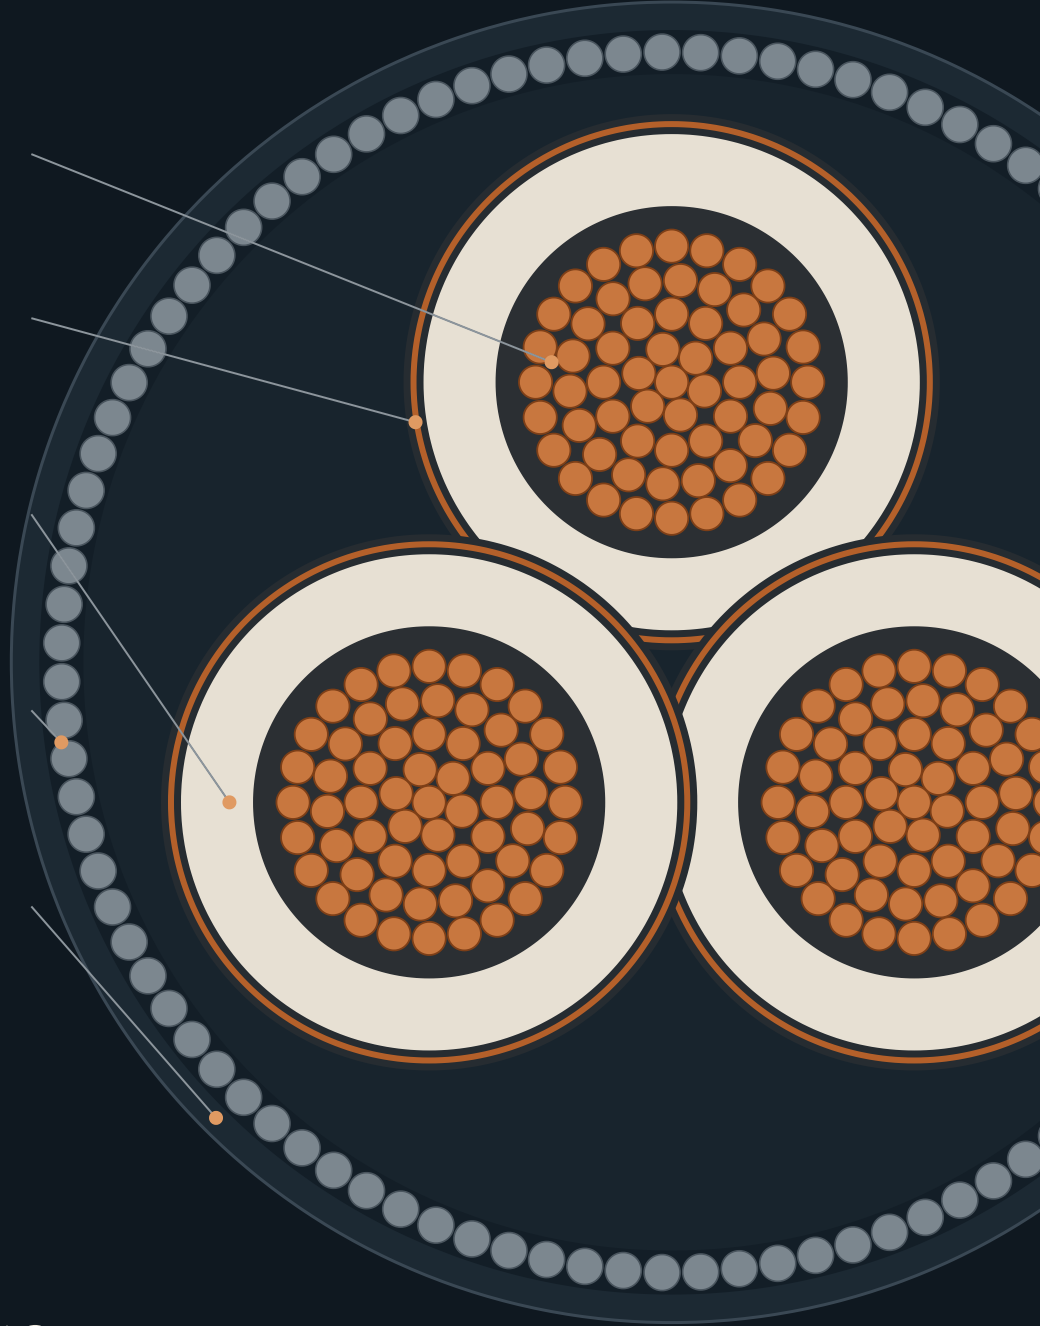

Power, *carried.*

Wire & cable solutions for combined cycle
power plants and modular gas power.

Every megawatt travels through a cable.

Gas-fired generation now runs to a new brief: start fast, cycle often, and keep the grid steady as renewables rise. The cables that connect turbine to grid, and sensor to control room, have to meet that brief for decades.

LARGE-SCALE · BASELOAD TO FLEXIBLE

Combined cycle plants

Heat at the hot section

Routes beside gas turbine enclosures, HRSGs and steam lines need insulation and sheaths rated for high ambient temperatures.

Daily cycling

Plants that balance renewables start and stop often, stressing terminations and joints thermally.

Fire and smoke

Turbine halls, spreading rooms and control buildings call for flame-retardant, halogen-free cables.

Electrical noise

Drives, generators and HV switchgear sit metres from sensitive DCS and protection circuits.

SKID-MOUNTED · CONTAINERISED

Modular gas power

Compact skids

High-density containers need flexible constructions with tight bend radii.

Constant vibration


Reciprocating engines and aeroderivative packages demand fine-stranded conductors and secure glands.

Harsh sites

Oil, fuel, UV and wide ambient ranges on remote, outdoor and temporary installations.

Speed to power

Pre-terminated, factory-tested harnesses cut hours of site work from every unit.

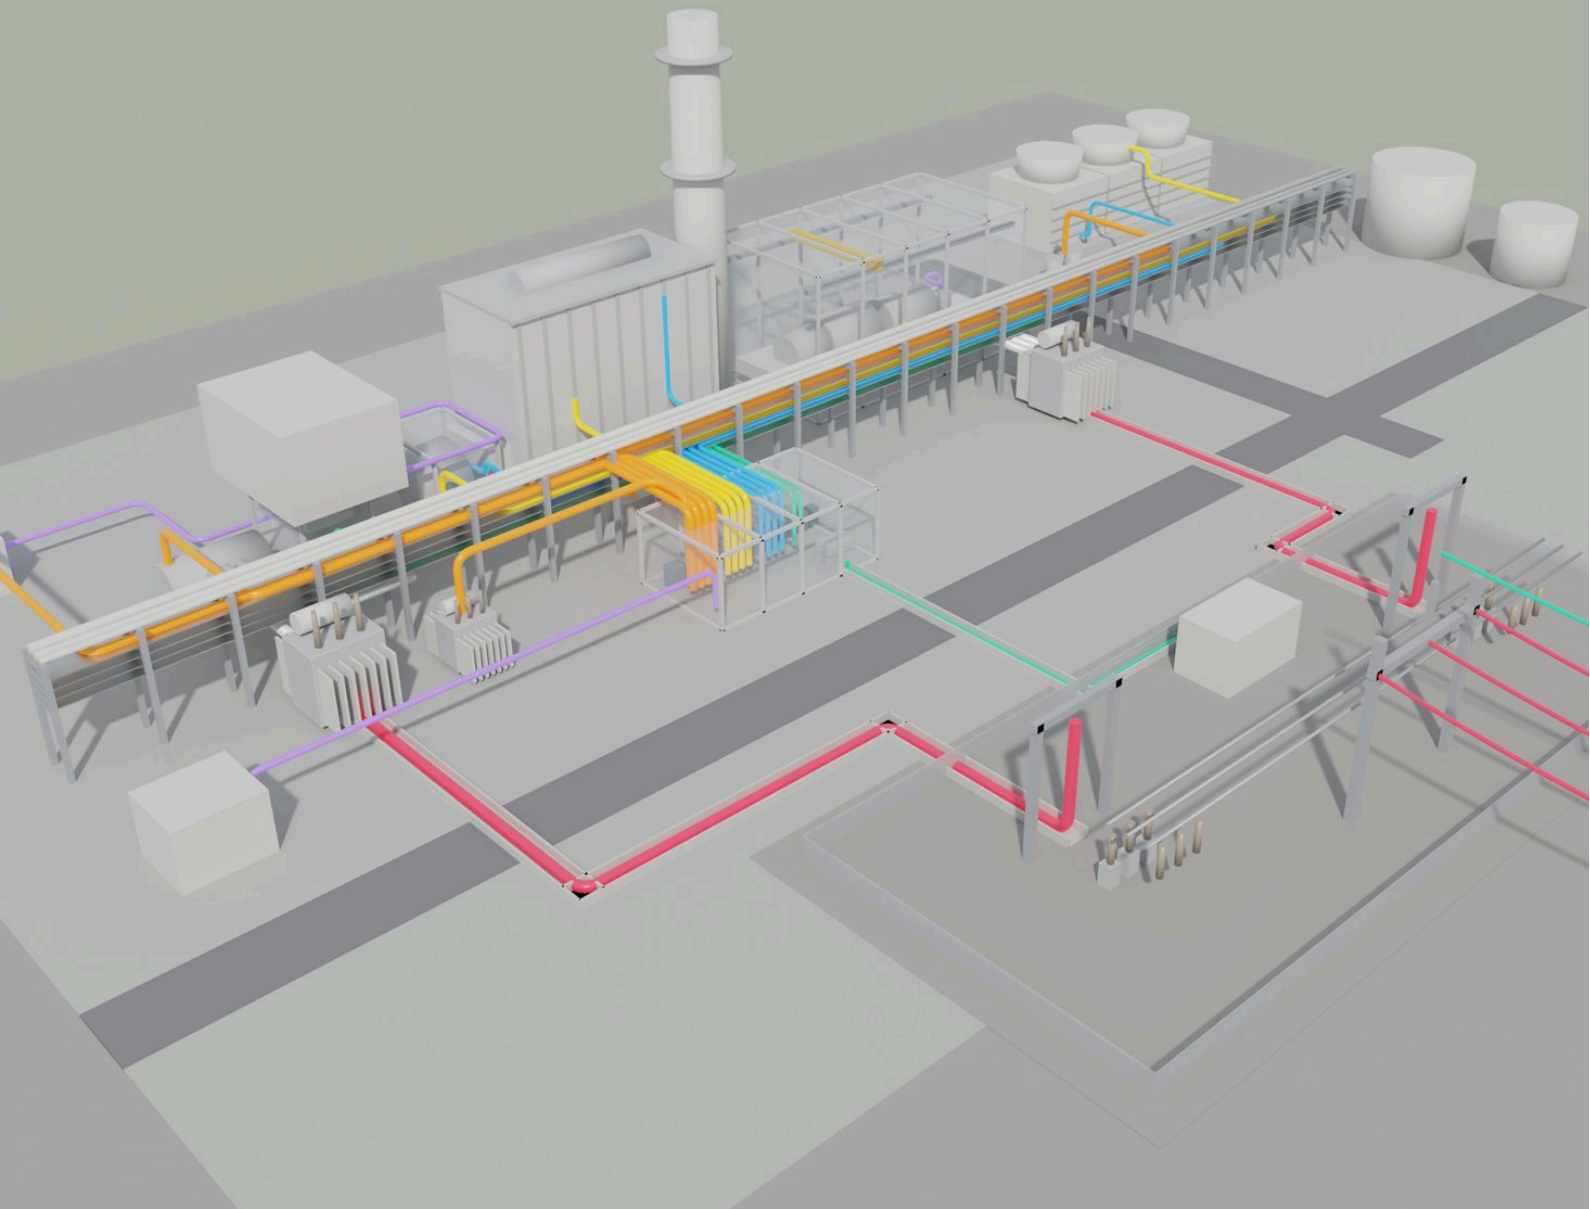

02 — COMBINED CYCLE PLANT


Hundreds of kilometres of cable *in a single block.*

From the circuits leaving the step-up transformers to the thermocouple pairs that protect the gas turbine, each system has its own construction, its own route and its own standards.

— HV — MV — LV power — Control & instr. — Fibre — Fire-rated — Earthing

Illustrative 1×1 combined-cycle block. Cable diameters exaggerated for clarity.

Generator to grid, sensor to screen.

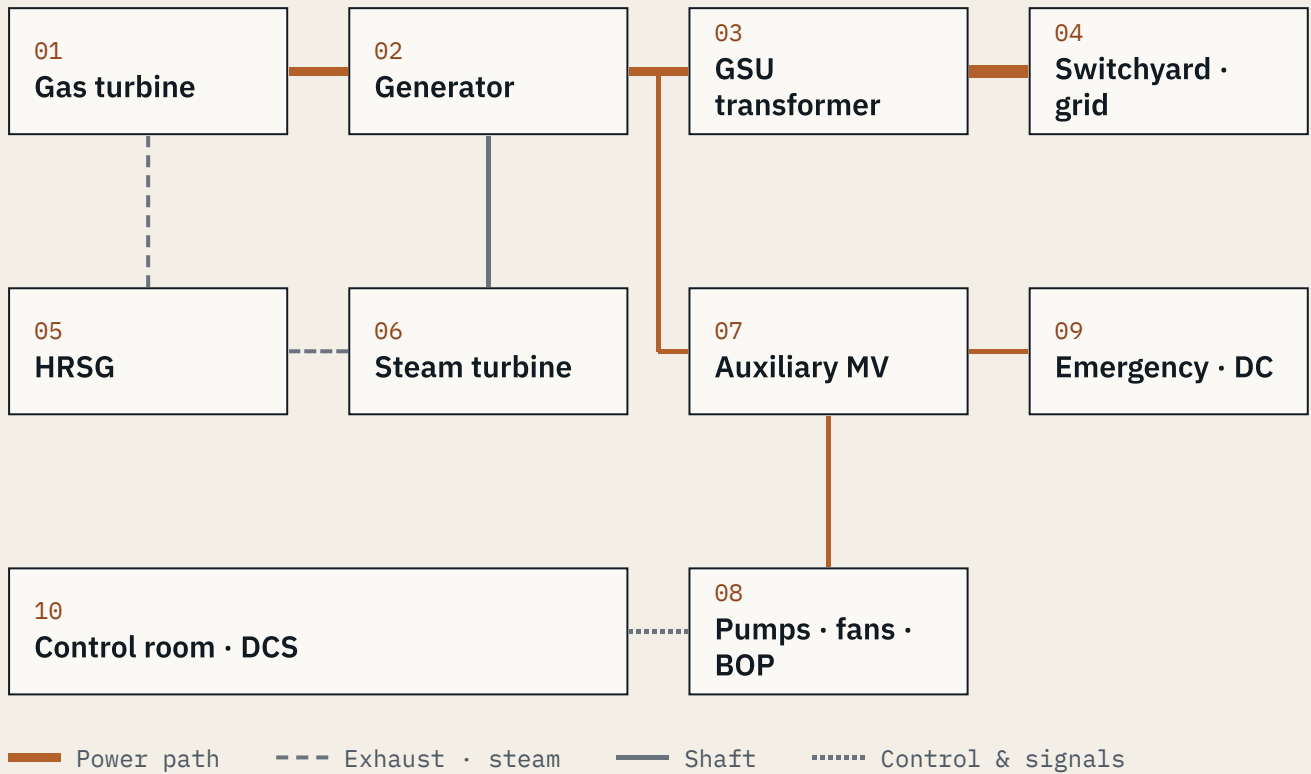

01 · 02 Turbine & generator hall

Generator connections, high-temperature control and thermocouple cables, fire-resistant instrumentation.

03 · 04 Step-up & grid connection

HV and EHV XLPE cables with terminations and joints; earthing; protection fibre.

05 · 06 Heat recovery & steam cycle

Heat-resistant instrumentation, armoured control, LV power for valves and actuators.

07 · 08 Auxiliaries & balance of plant

MV cables for feed and cooling water pumps, VFD motor cables, LV distribution.

09 Emergency & DC systems

Circuit-integrity cables for fire and gas detection, emergency lighting and lube-oil pumps.

10 Control & DCS

Screened multi-pair instrumentation, fieldbus, industrial Ethernet and fibre backbone.

One supplier, *every circuit.*

HV



HV & EHV power

Step-up transformer to switchyard and grid, with terminations, joints and sheath bonding.

XLPE · IEC 60840 · IEC 62067

MV



Medium voltage

Auxiliary transformers, feed and cooling water pump motors, switchgear interconnects.

3.6/6 to 18/30 kV · IEC 60502-2

LV



LV power & VFD

Distribution, lighting and small power, plus symmetrical screened cables for drives.

0.6/1 kV · IEC 60502-1

CI



Control & instrumentation

Screened pairs and triads, thermocouple extension and fieldbus for DCS and protection.

EN 50288-7 · IEC 60584-3

FR



Fire-resistant

Circuit integrity for fire and gas, emergency lighting, lube-oil and DC systems.

IEC 60331 · BS 8491

F0



Fibre & data

Armoured, rodent-resistant fibre and industrial Ethernet for control and protection.

ITU-T G.652.D · Cat 6A

MX



Flexible & modular

Fine-stranded, oil- and UV-resistant cables and pre-terminated harnesses for skids.

IEC 60228 Class 5

AC




Accessories & systems

Terminations, joints, glands, cleats and cable management, matched to each cable.

IEC 60502-4 · IEC 61914

Cable *in detail.*

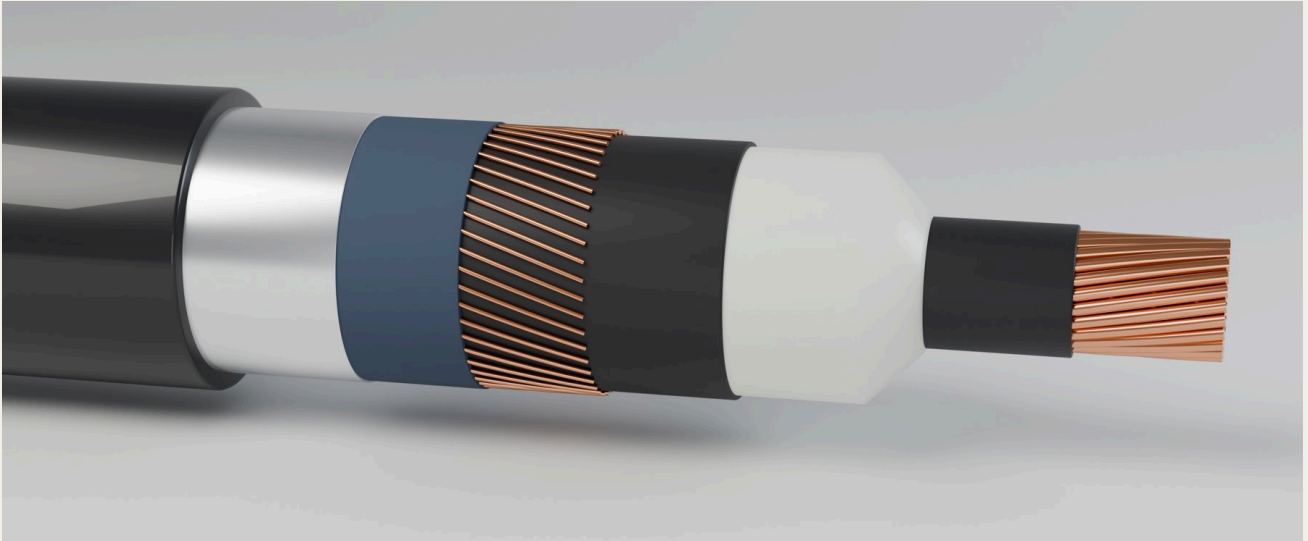


HV single-core XLPE. Stranded conductor, triple-extruded dry-cured XLPE, copper wire screen for fault current, and water-blocking tape with a bonded aluminium laminate under a tough PE jacket.




MV three-core. Screened cores feeding feed-water pumps, cooling water pumps and fuel gas compressors.



Circuit integrity. A mica-tape barrier keeps fire pumps, alarms and shutdown circuits working in a fire.

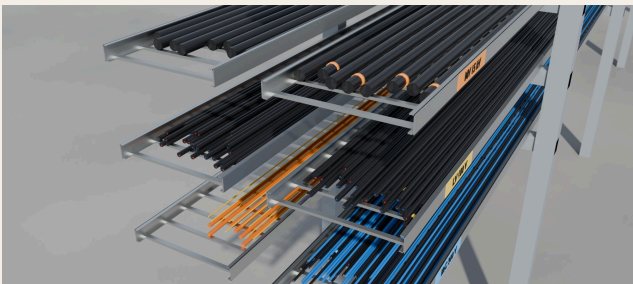

Segregated trays. Voltage classes stacked highest on top, keeping power-cable noise away from signals.

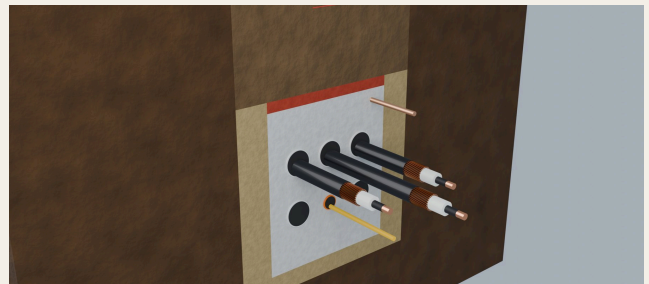

Duct bank. One phase per conduit, with spare ducts, a fibre duct and a bare copper earth.

Built for power that ships *in a container*.

Aeroderivative turbines, reciprocating engines and containerised gensets bring capacity online in months, not years. We supply their cabling as a kit, engineered for the skid and ready for the site.

01

Pre-terminated harnesses

Cut to length, terminated and tested in the factory, each end labelled to the wiring schedule.

02

Flexible and compact

Class 5 conductors and tight bend radii for high-density skids and containers.

03

Built for vibration

Fine stranding, tough sheaths and anti-vibration glands for engines and aeroderivatives.

04

Rated for the site

Oil-, fuel- and UV-resistant sheaths for outdoor, remote and fast-track installations.

DELIVERED AS A KIT

01

Design

02

Cut & terminate

03

Factory test

04

Label & pack

05

Plug in on site

Tested to the standards your owner's engineer will ask for.

IEC 60228	Conductors of insulated cables
IEC 60502-1 · -2	Extruded-insulation power cables, 1 kV to 30 kV
IEC 60840	Power cables above 30 kV up to 150 kV
IEC 62067	Power cables above 150 kV up to 500 kV
IEC 60332-1 · -3	Flame propagation: single cable and bunched cables
IEC 60331	Fire resistance: circuit integrity
IEC 61034	Smoke density
IEC 60754-1 · -2	Halogen acid gas content and acidity
IEEE 1202 · UL 1685	Vertical tray flame tests for North American projects

MATERIALS

XLPE

Insulation for MV to EHV, 90 °C continuous

EPR

Flexible insulation for moving and vibrating duty

LSZH · HFFR

Sheaths for occupied and enclosed spaces

SWA · AWA

Steel or aluminium wire armour

- Routine, sample and type tests to each applicable standard, with factory witness testing open to owners and EPCs. Certified to [ISO 9001 · ISO 14001 · ISO 45001].

From cable schedule *to first fire.*

One team stays with the project from the first calculation to energisation, so the cable on site is the cable in the design.

01

Front-end engineering

Cable sizing, derating, voltage-drop and short-circuit calculations; route and tray-fill studies.

02

Schedules & optimisation

Drum lengths planned against the cable schedule to cut offcuts and joints.

03

Manufacturing & witness testing

Production slotted to your EPC milestones, with factory tests open to owner's engineers.

04

Logistics

Drum tracking, sequenced deliveries and site-ready packing for modular units.

05

Installation support

Pulling calculations, supervision, and jointing and termination by certified technicians.

06

Commissioning & lifecycle

After-laying tests such as VLF and partial discharge, with optional temperature monitoring on HV routes.



[Award
name]

[Awarding body
· Year]




[Award
name]

[Awarding body
· Year]



[Award
name]

[Awarding body
· Year]

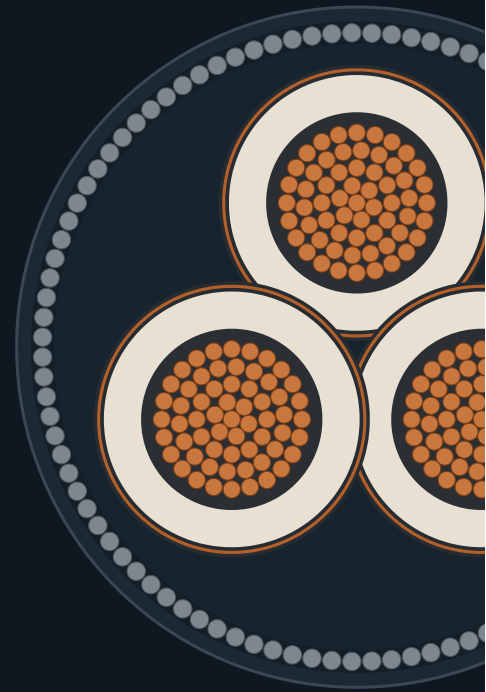

Let's connect *your next
plant.*

CONTACT

[Name, Title]

EMAIL

[email@company.com]

PHONE

[+00 000 000 0000]

WEB

[company.com/power]

[QR code]

Datasheets &
enquiries