


Cable packages for generator electrical interfaces

Review where output leads, control wiring and external cable connections on a generator platform could be prepared before final assembly.

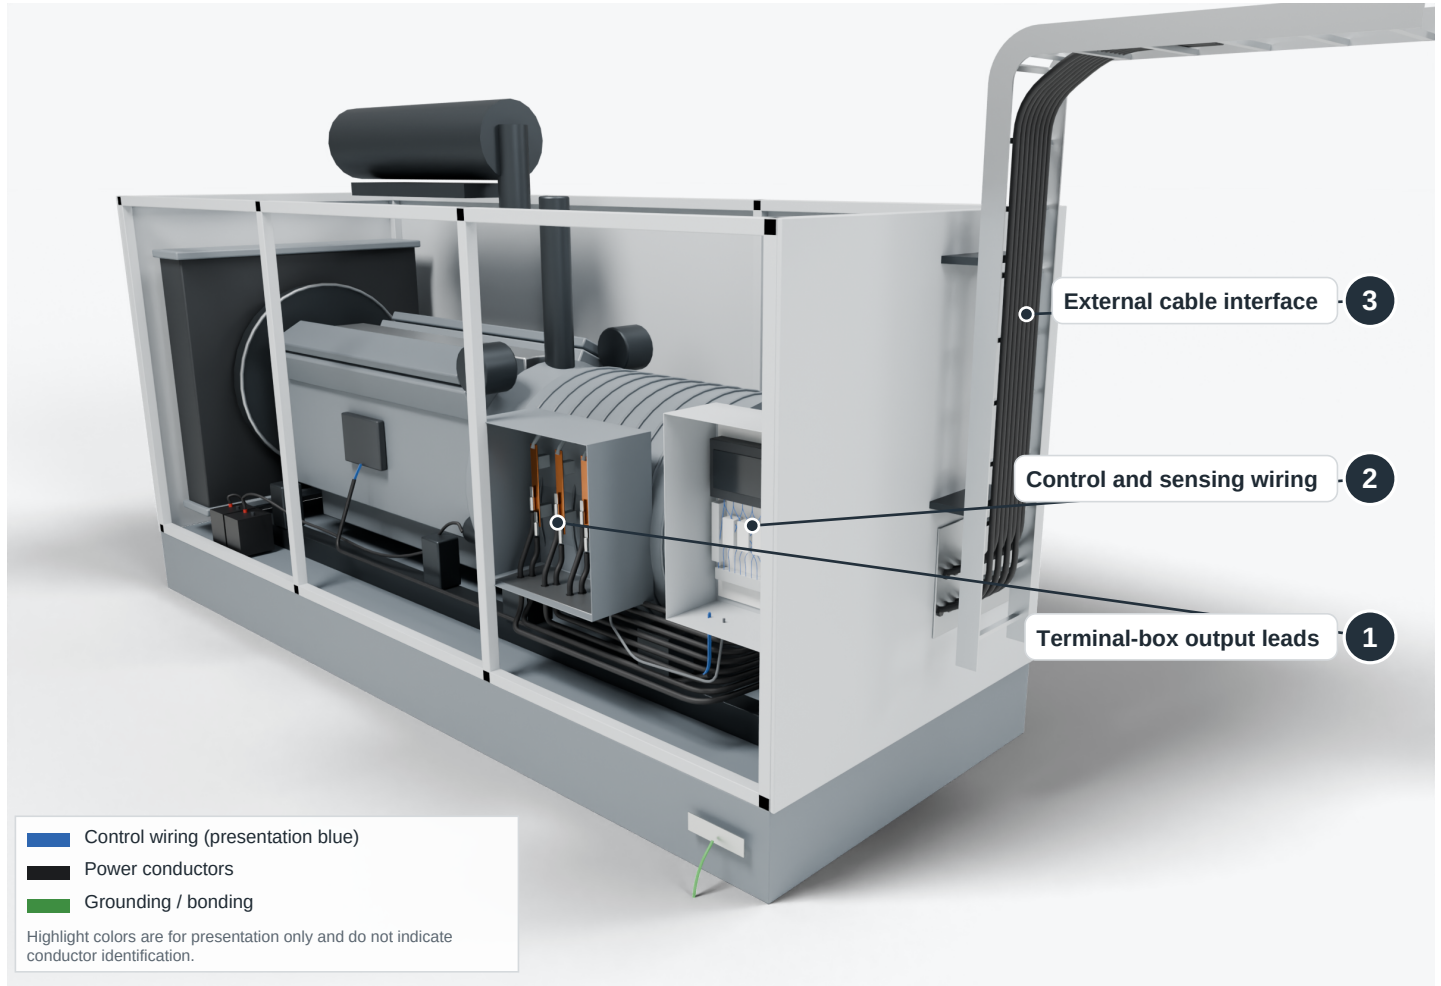

APPLICATIONS TO EVALUATE

- 1 Terminal-box output leads**

Leads cut, terminated and identified to the terminal arrangement, compared with current preparation at assembly.
- 2 Control and sensing wiring**

Engine, regulator and remote-control conductors grouped by platform option and routed to a defined harness drawing.
- 3 External cable interface**

A defined hand-off at the cable exit: what the package supplies, what the installer connects, and how each is identified.

Established: Southwire wire and cable manufacturing and supply.

For evaluation: the prepared kits, cable packages and assemblies shown are application concepts, not qualified Southwire products.

Illustrative model. Ratings, cable sizes, clearances and termination selections are subject to application engineering. No code compliance, engineering approval or certification is implied.

PROPOSED NEXT STEP

Identify the engineering and sourcing owners for one generator platform and review its terminal-box and control-wiring requirements together.

Stephan Hardt

Director, Power Generation Solutions,
Southwire

[Phone] [Email]