


Repeatable generator-testing connection sets

Review the lead sets used to connect generators to load banks for testing, including handling, storage and replacement.

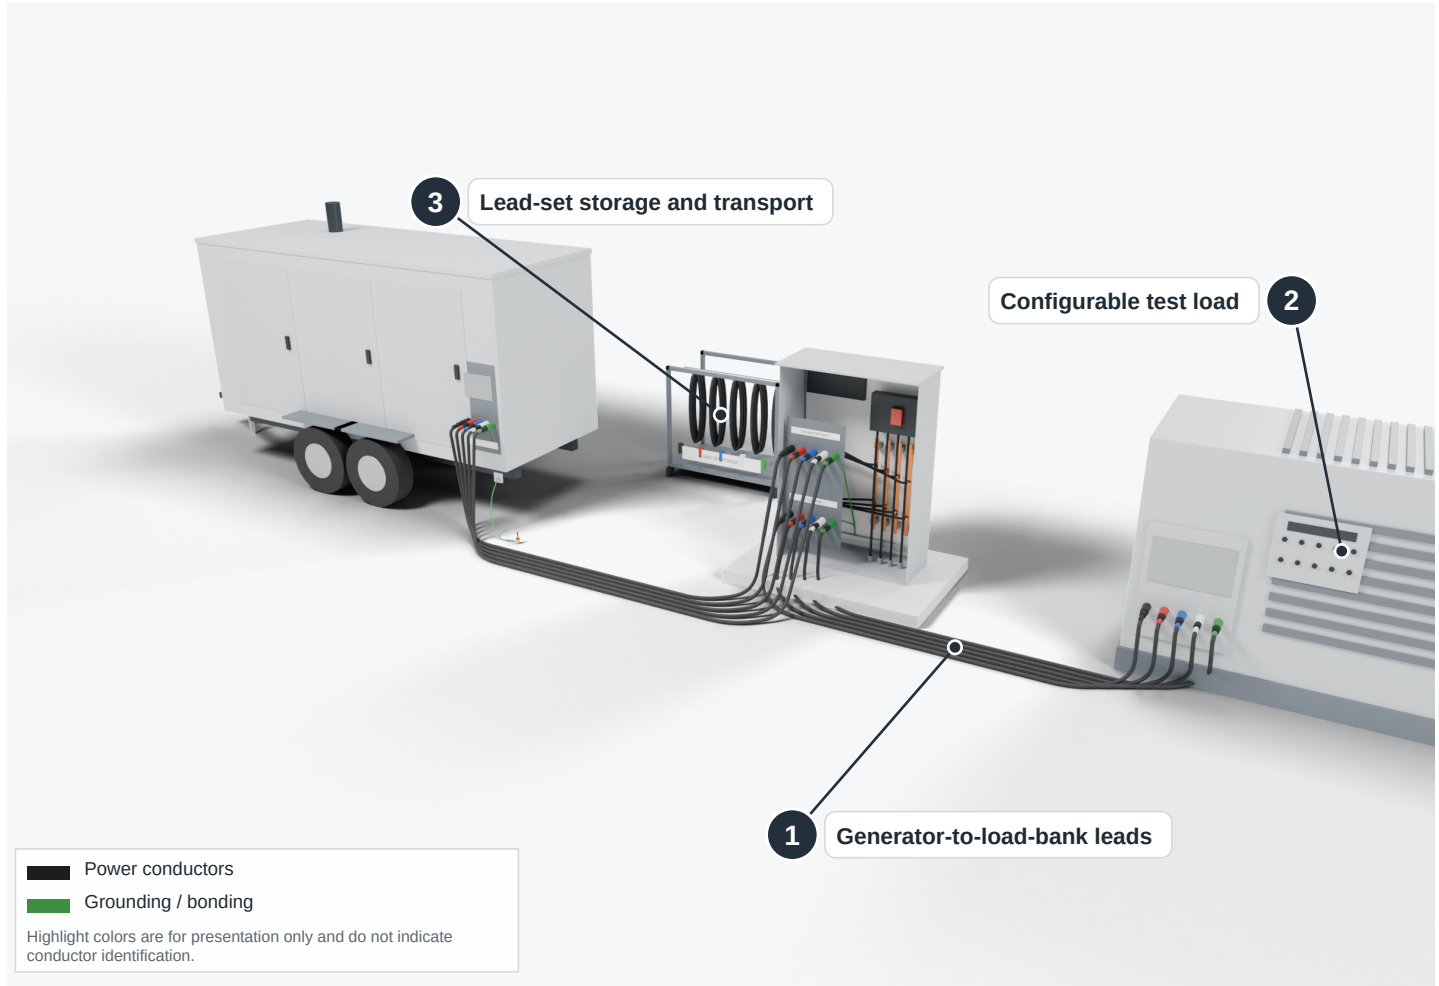

APPLICATIONS TO EVALUATE

- | | | |
|---|---|--|
| <p>1 Generator-to-load-bank leads</p> <p>Portable sets with connectors, lengths and identification matched to the load bank connection panel and typical site layouts.</p> | <p>2 Configurable test load</p> <p>The load bank is a configurable test load, connected through a dedicated port, not to facility loads.</p> | <p>3 Lead-set storage and transport</p> <p>Coiled sets, labels and inspection records kept together for repeated deployments, with a defined point for retiring worn leads.</p> |
|---|---|--|

Established: Southwire wire and cable manufacturing and supply.

For evaluation: the prepared kits, cable packages and assemblies shown are application concepts, not qualified Southwire products.

Illustrative model. Ratings, cable sizes, clearances and termination selections are subject to application engineering. No code compliance, engineering approval or certification is implied.

PROPOSED NEXT STEP

Review duty, ratings, connectors and replacement needs for one load-bank lead set.

Stephan Hardt

Director, Power Generation Solutions,
Southwire

[Phone] [Email]