


Repeatable wiring packages for generator production

Evaluate whether power leads and control wiring for recurring builds could arrive prepared, identified and grouped for the assembly line.

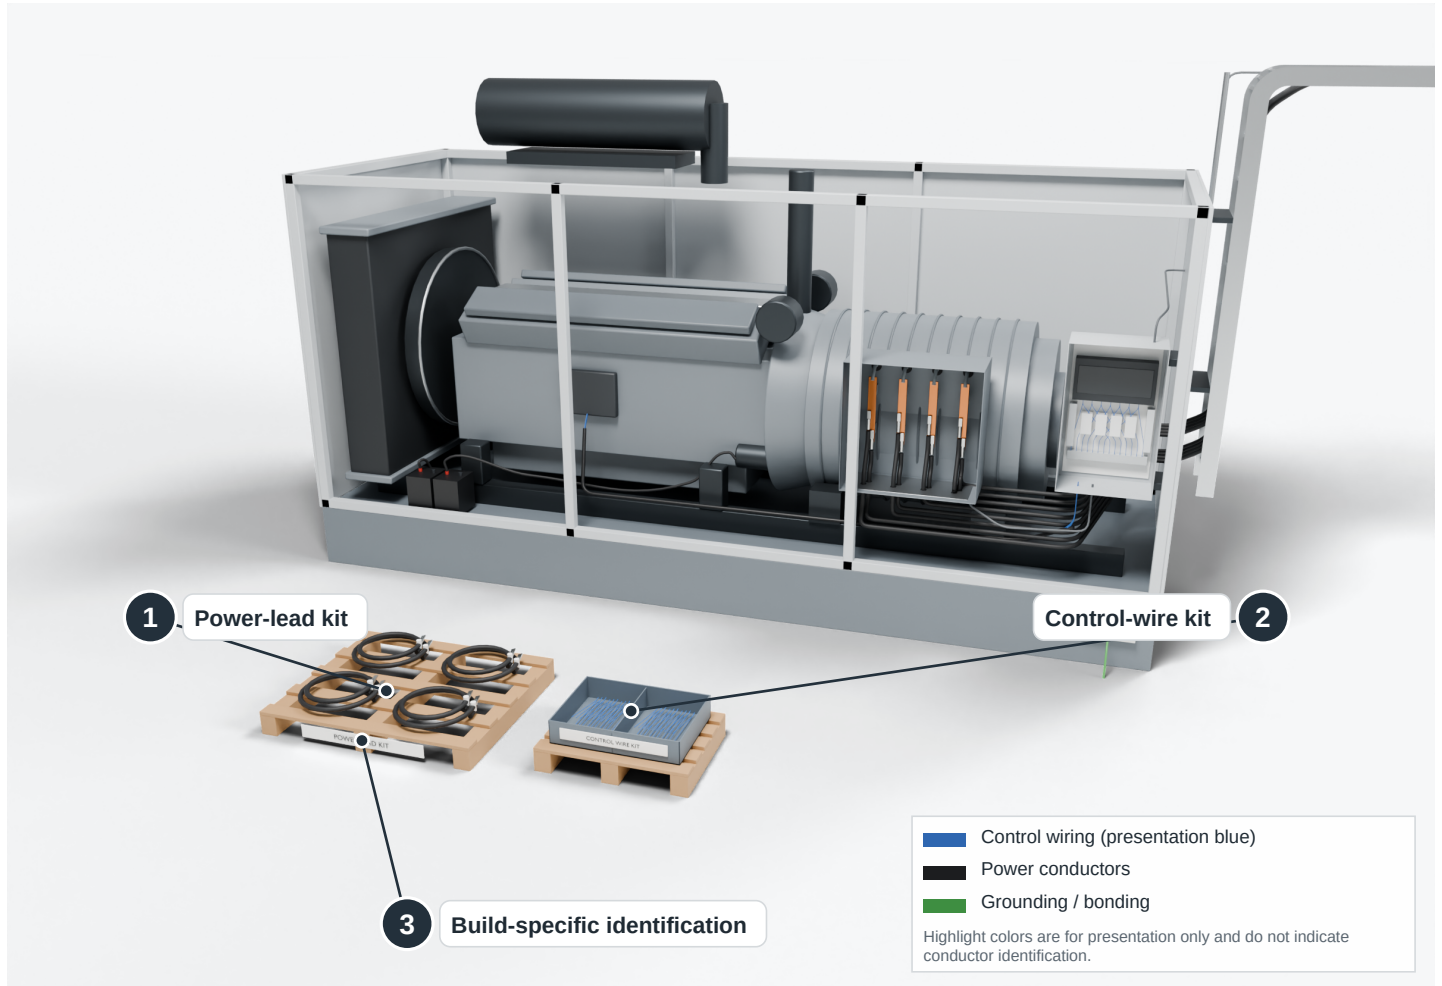

APPLICATIONS TO EVALUATE

- | | | |
|---|---|---|
| <p>1 Power-lead kit</p> <p>Leads cut, terminated and labeled to the terminal-box layout of a recurring build, delivered as one set per unit.</p> | <p>2 Control-wire kit</p> <p>Conductors grouped by harness or assembly step, with identification at both ends and a packing list that matches the build sheet.</p> | <p>3 Build-specific identification</p> <p>Kit labels tied to the build record so material, revision and destination can be checked at the station.</p> |
|---|---|---|

Established: Southwire wire and cable manufacturing and supply.

For evaluation: the prepared kits, cable packages and assemblies shown are application concepts, not qualified Southwire products.

Illustrative model. Ratings, cable sizes, clearances and termination selections are subject to application engineering. No code compliance, engineering approval or certification is implied.

PROPOSED NEXT STEP

Review one recurring build and its wiring requirements. Compare current preparation, installation and rework steps with a proposed kit.

Stephan Hardt

Director, Power Generation Solutions,
Southwire

[Phone] [Email]