



ANIXTER GLOBAL ACCOUNTS MEETING

POWER GENERATION SOLUTIONS

SOUTHWIRE × ANIXTER/WESCO


ACCELERATING TIME TO POWER™

OCTOBER 6, 2026

Stephan Hardt · Power Generation Solutions
stephan.hardt@southwire.com

Confidential · Do not distribute

© 2026 Southwire Company, LLC. All rights reserved.

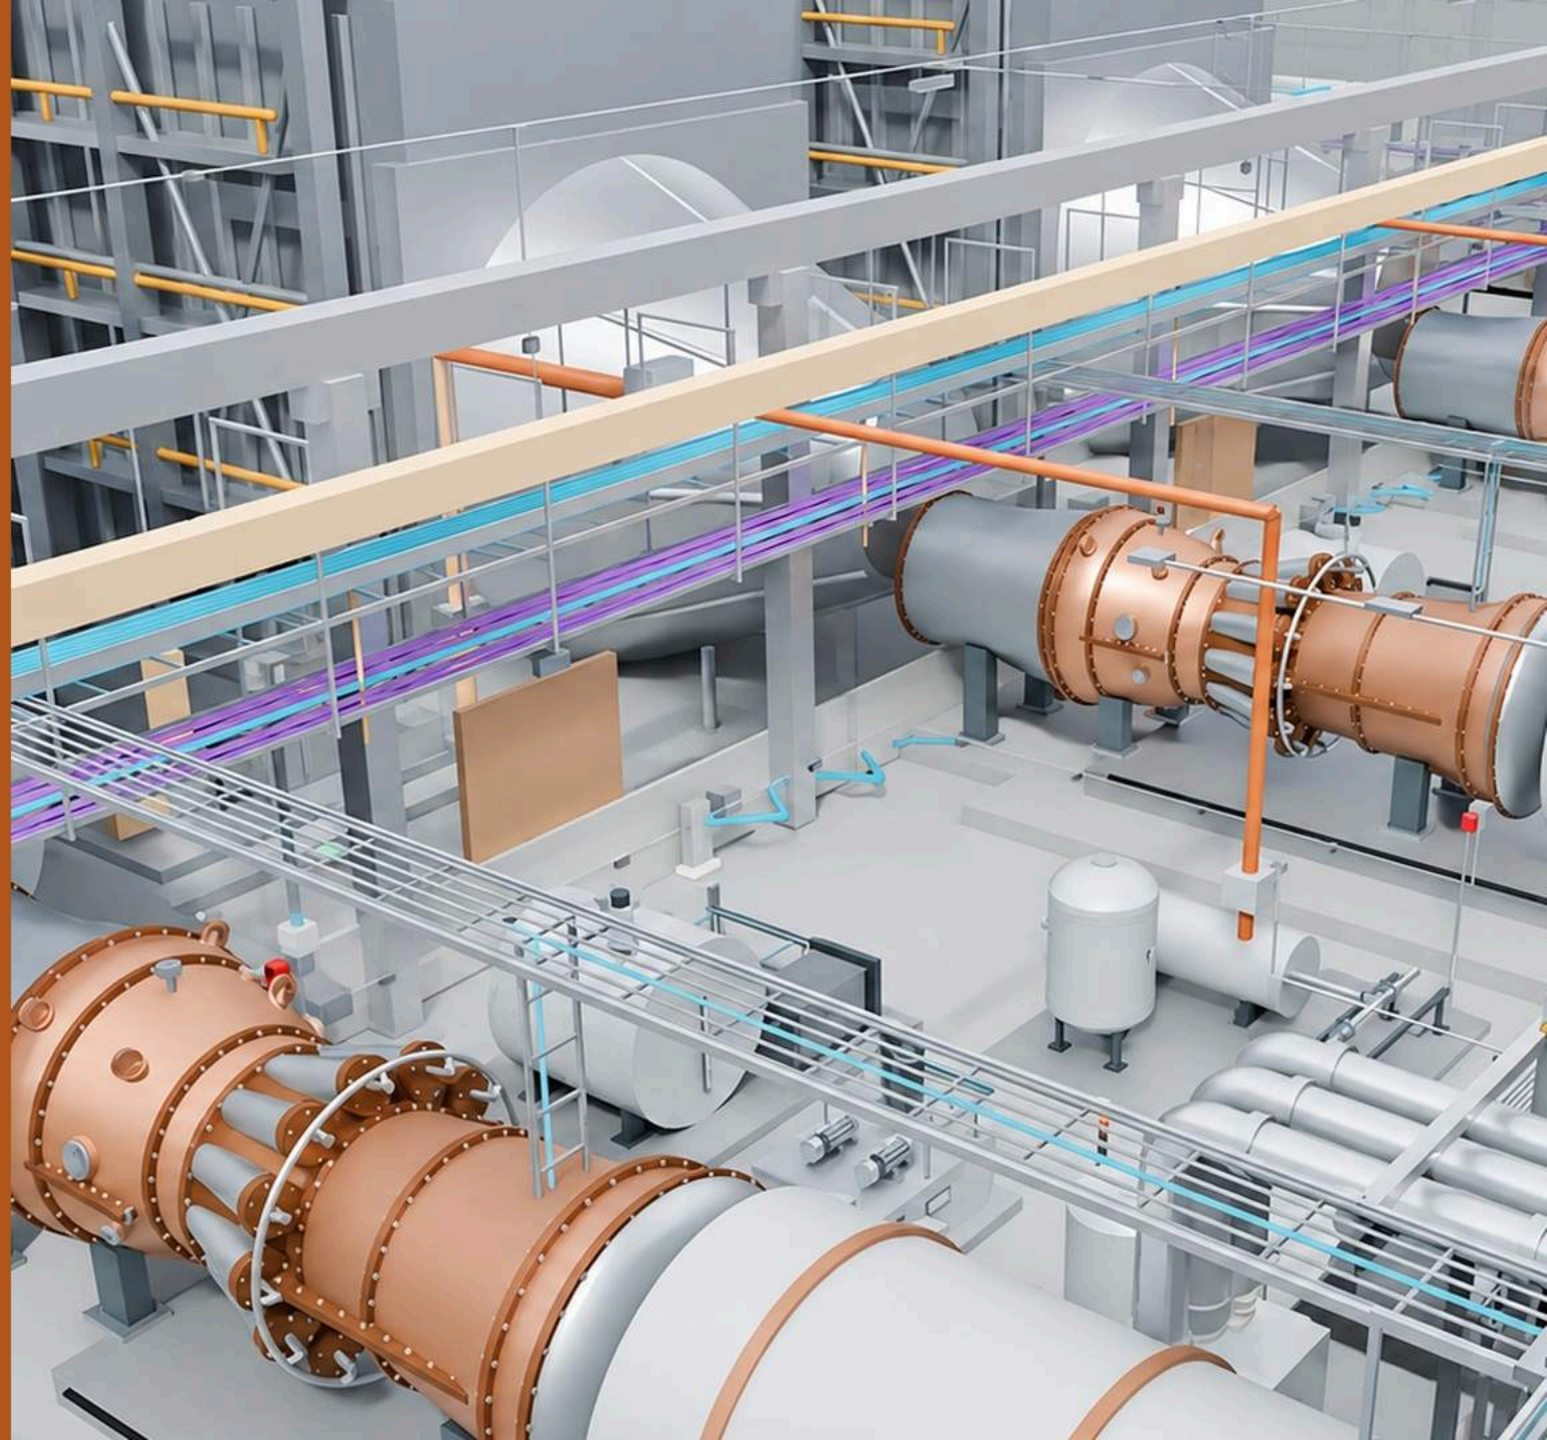

MEETING OBJECTIVE

LEAVE TODAY WITH A JOINT-ACCOUNT WORKING MODEL

01

BUSINESS UPDATE

Market, OEM order books, the cable opportunity and Southwire progress

02

GAS POWER SOLUTIONS

One plant-wide cable scope, from combined cycle to modular packages


03

WINNING TOGETHER

Package builders and OEMs we both call on, and three decisions for today

THE OPPORTUNITY AT A GLANCE

A BOOM-SCALE GAS BUILD, AND CABLE IS ON THE CRITICAL PATH

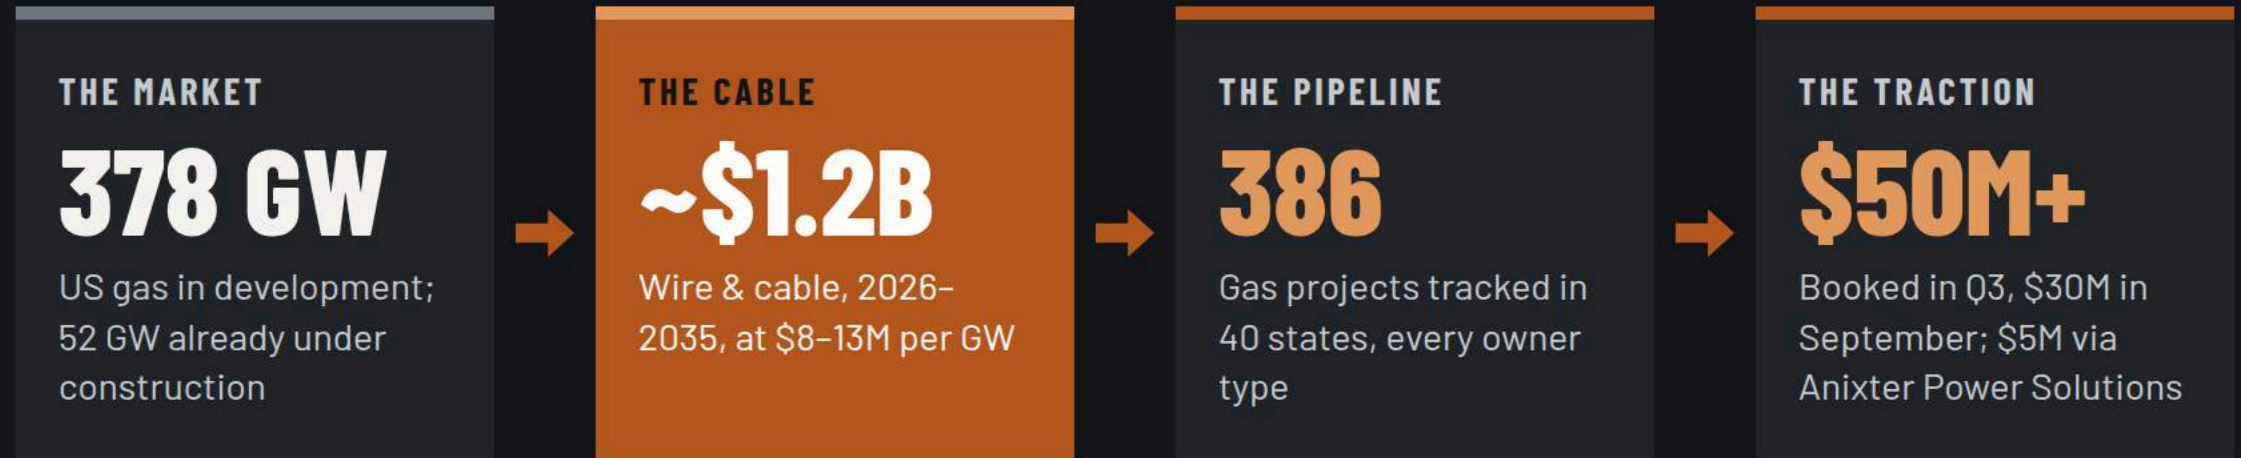

TODAY'S ASK: PICK THE FIRST JOINT TARGETS, ASSIGN OWNERSHIP, BOOK THE FIRST CALLS

01

BUSINESS UPDATE


GAS POWER GENERATION ONLY

MARKET, HISTORY AND OEM ORDER BOOKS

THE ~\$1.2B CABLE OPPORTUNITY

WHERE THE BUILD IS, OWNERS AND BUYERS

PURSUIT, PROGRESS AND COVERAGE

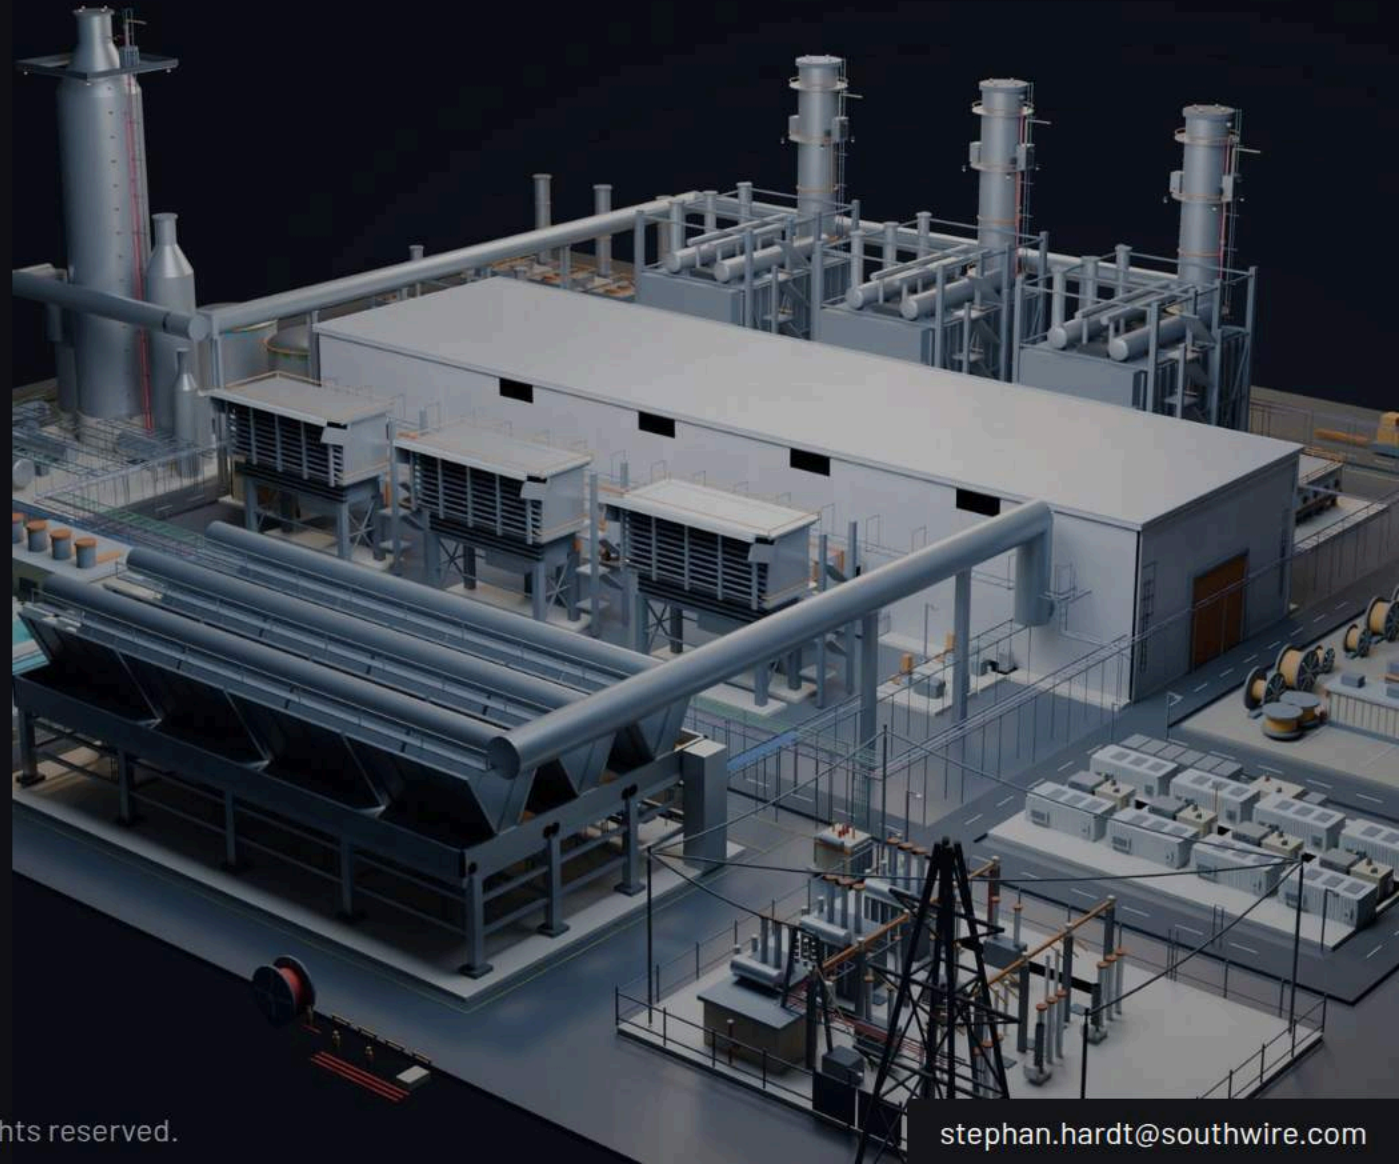

MARKET CONTEXT

LOAD GROWTH IS PULLING GAS POWER FORWARD

166 GW

US peak load growth forecast by 2030

About 90 GW of it from data centers

378 GW

US gas power in development, mid-2026

189 GW tied to data centers

52 GW

under construction, up 76% in H1 2026

The largest gas build in the world

Up to 7 yrs

quoted lead time for some large gas turbines

Procurement decisions are being made now


US GAS CAPACITY ADDED PER YEAR, GW · PROVISIONAL



Sources: Grid Strategies, 2025; GEM, Aug 2026; S&P Global, May 2025. History: EIA and Southwire provisional series, to be verified.

OEM ORDER BOOKS

TURBINE BACKLOGS ARE FULL

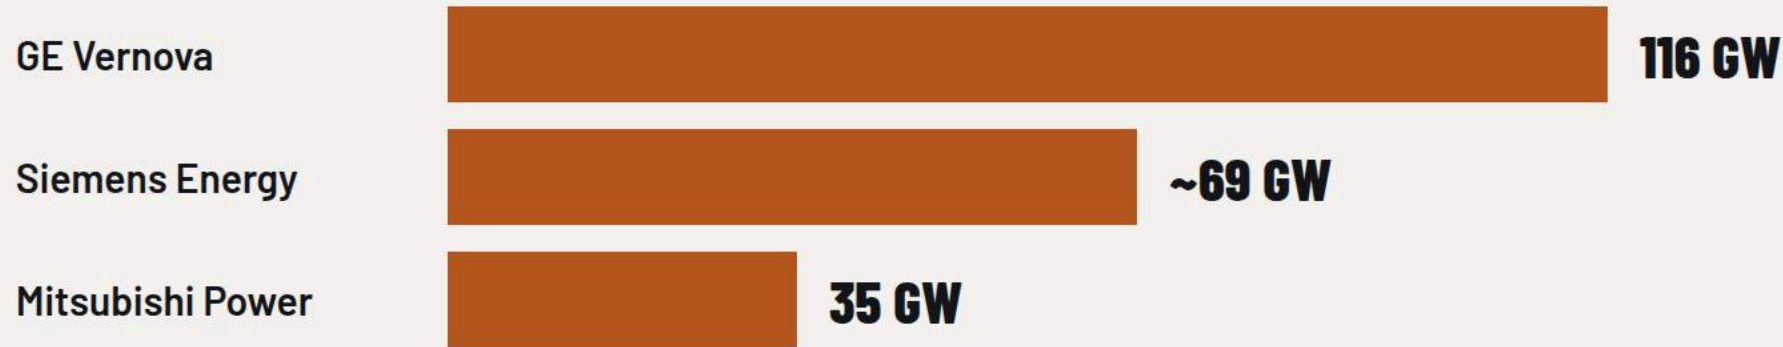

GE Vernova: firm backlog plus slot reservations, Q2 2026. Siemens Energy: gas turbine backlog, Q3 FY26. Mitsubishi: large-frame backlog, Aug 2026.

+72%

Caterpillar Power Generation sales, Q2 2026

2.3 GW

VoltaGrid modular gas fleet for Oracle's Texas AI data centers, plus 1 GW for Vantage

500 MW

standard modular SGT-800 plant from Siemens Energy and Eaton

US GAS GENERATION: A \$1B+ WIRE & CABLE PRIZE

CAPACITY ASSUMPTIONS

378 GW

Reported development pipeline

52 GW under construction

× 90% = 46.8 GW

326 GW in earlier stages

× 13.5% = 44.0 GW

+ 2.9 GW already operating in 2026

93.7 GW

Modeled additions through 2036

WHOLE-PLANT INVESTMENT

~\$180B

Total plant investment over the period

93.7 GW × \$1,923/kW

Blended cost: CCGT, peakers and gas engines

Whole-plant CapEx includes

Generation equipment, auxiliaries, electrical systems and construction

\$2,000–2,400/kW is a whole-plant CCGT reference range

PLANT-WIDE WIRE & CABLE

\$0.75–1.2B

Cable materials, 2026–2035

93.7 GW × \$8–13M per GW

Wire & cable content: \$8M low · \$13M high per GW
= \$750M low · \$1.22B high


UNDER 1% OF PLANT CAPEX, ON THE CRITICAL PATH TO FIRST POWER

Pipeline: Global Energy Monitor, Aug 2026. Completion rates, blended cost and the \$8–13M per GW cable range are Southwire planning assumptions.

HOW BIG IS THE OPPORTUNITY?

~\$1.2B OF CORE GAS CABLE POS, 2026-2035

Core gas cable by purchase-order year. Project likelihood and supply caps are already in the model.

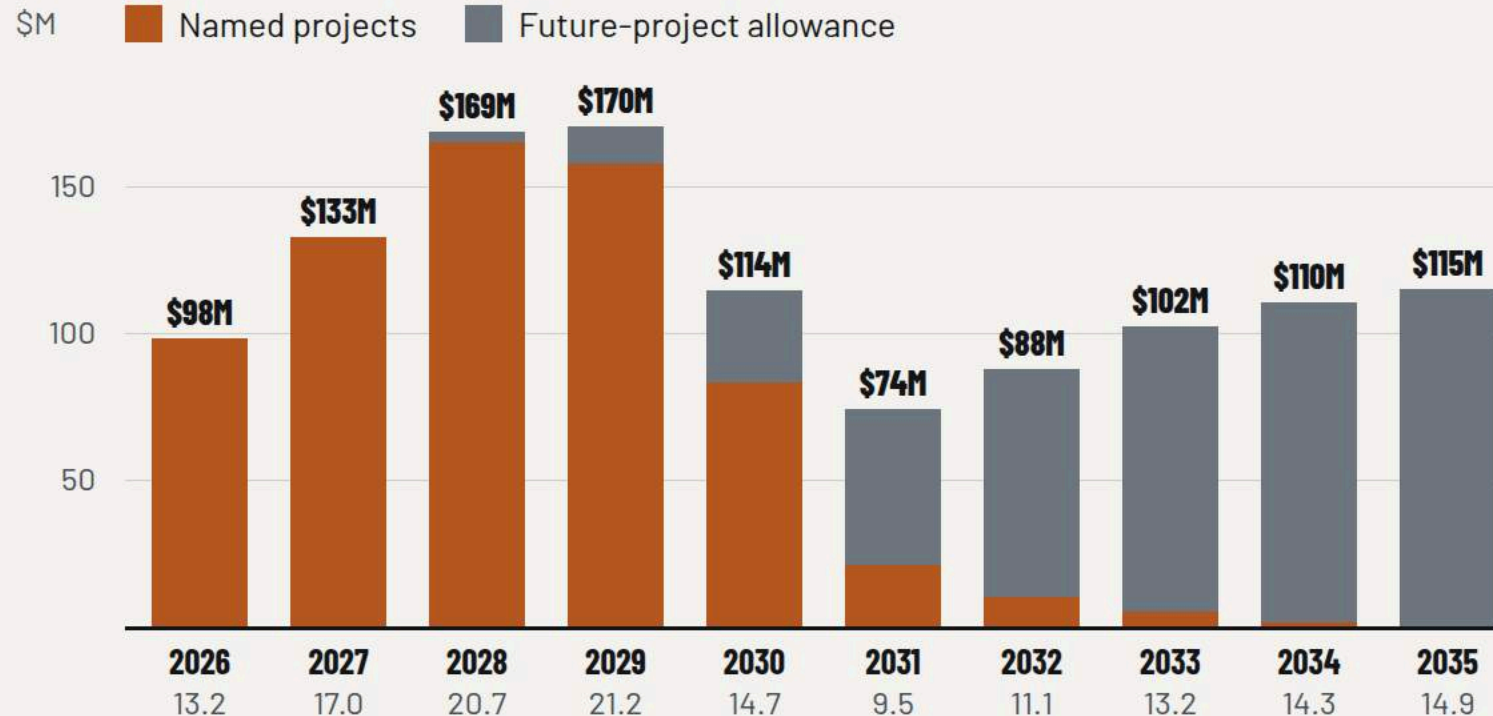

Below each year: modeled PO-year GW equivalents, not installed GW. Allowance has no named projects. Core rates (\$/kW): combined cycle 9.06 · simple cycle 6.79 · engines 5.44. OEM internal wiring and HV excluded.

~\$1.2B

2026-2035 priced core ·
provisional planning case

■ **\$673M named**

■ **\$501M allowance**


GW × \$/kW = \$M

× **addressable share**

× **win probability**

REVIEWED PROJECT REGISTER

205.8 GW ELIGIBLE, MOST OF IT STILL EARLY

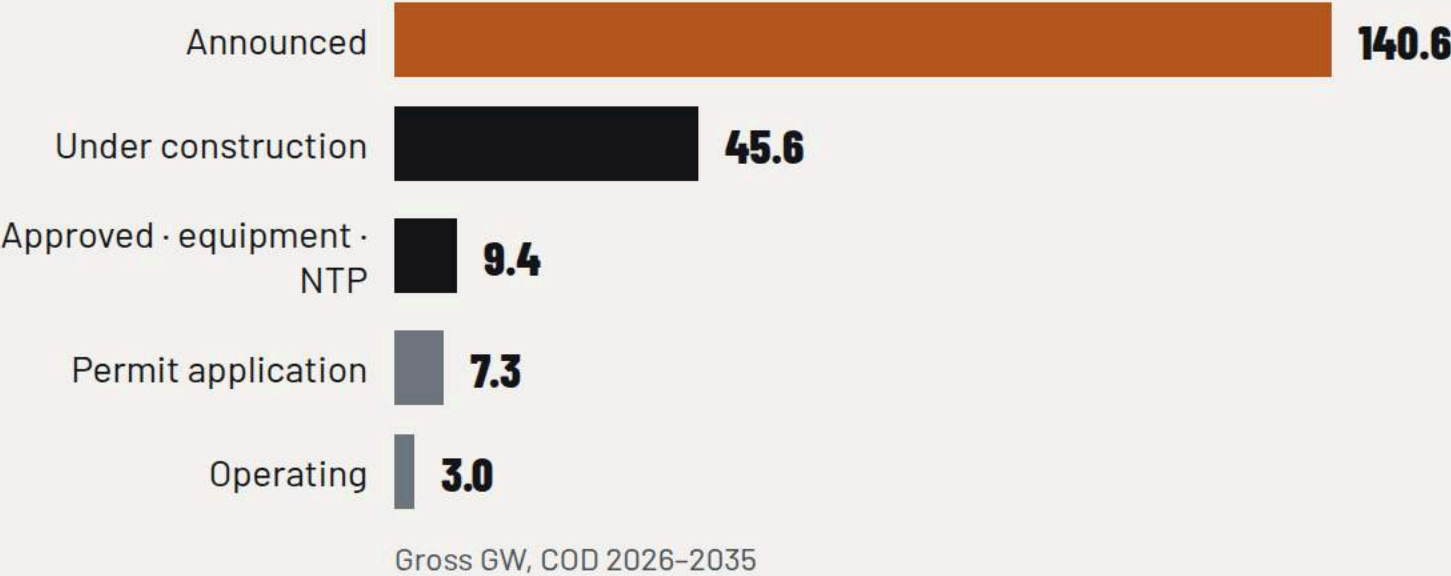

68%

OF ELIGIBLE CAPACITY IS ONLY ANNOUNCED


Being on the register does not mean a cable package is open.

Source: Southwire PowerGen register, Sep 11, 2026: 386 records across 305 site groups. Excludes queue-only and undated records.


PROJECT CONCENTRATION

WHERE THE BUILD IS, WHO OWNS IT, WHAT KIND OF SITE

GROSS GW BY STATE · 386 PROJECTS, COD 2026-2035

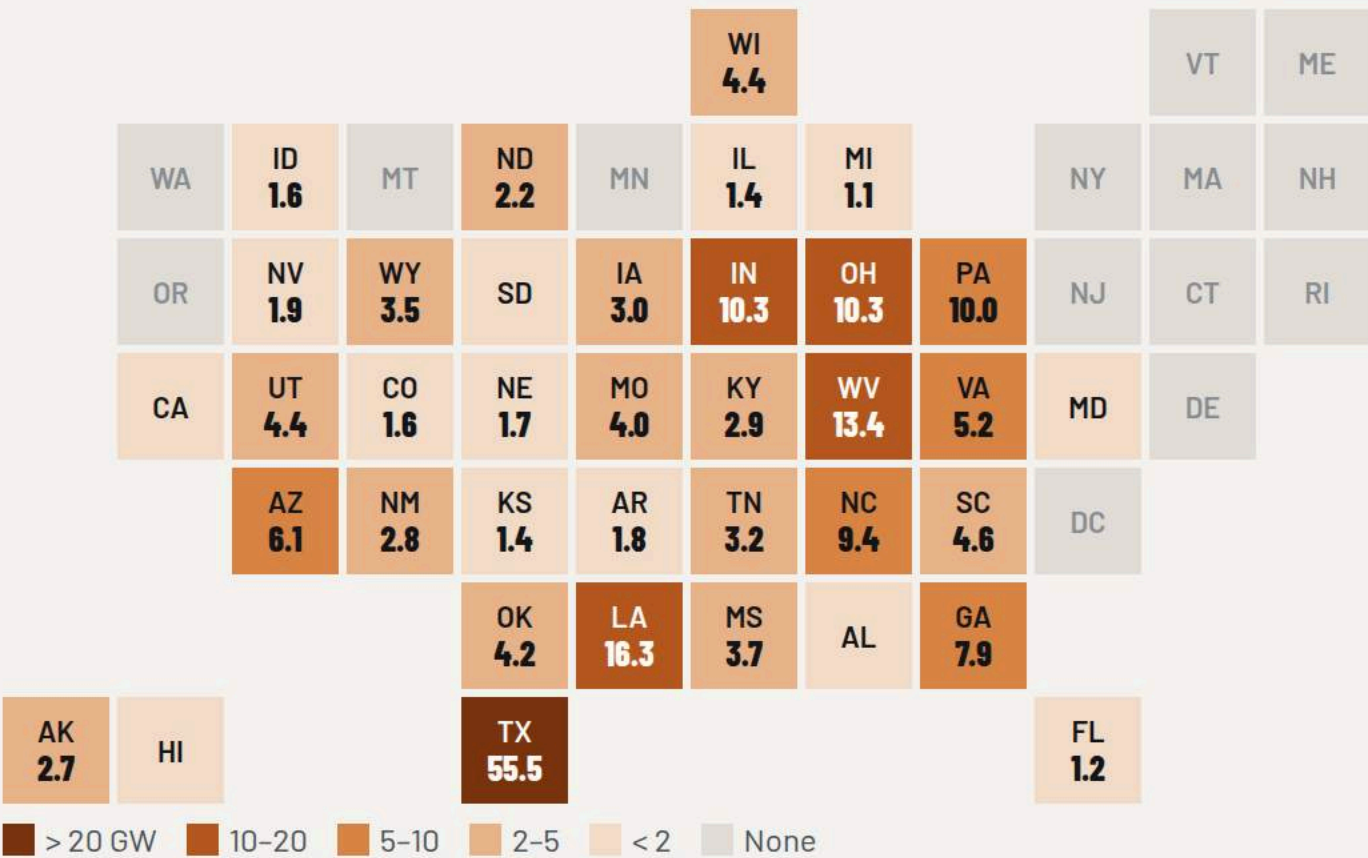

OWNER × SITE, GROSS GW

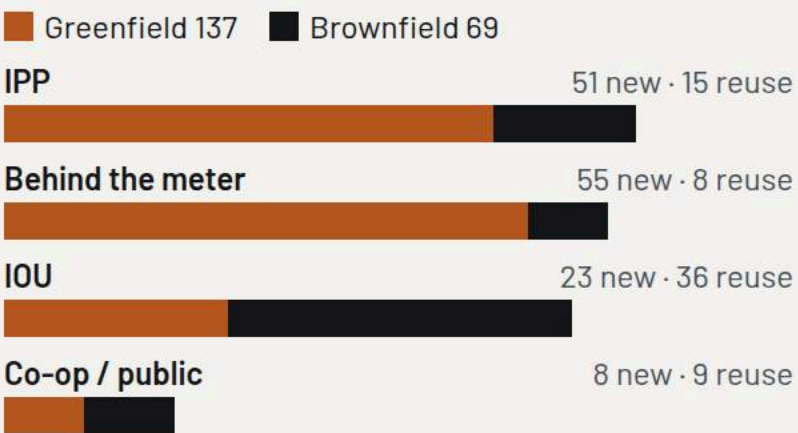

IOUS REUSE OLD SITES; IPPS AND BTM BUILD NEW


Greenfield, grid-connected	77.0
Data-center / BTM campus	54.5
Coal-site repower	41.3
Expansion at operating plant	21.4
Industrial captive and site reuse	11.6

Source: Southwire PowerGen register, Sep 11, 2026. Gross GW, unweighted. Site classes provisional (Rev01).

OEMS AND EPCS

THREE TURBINE OEMS CARRY 40% OF THE CAPACITY

GROSS GW BY OEM

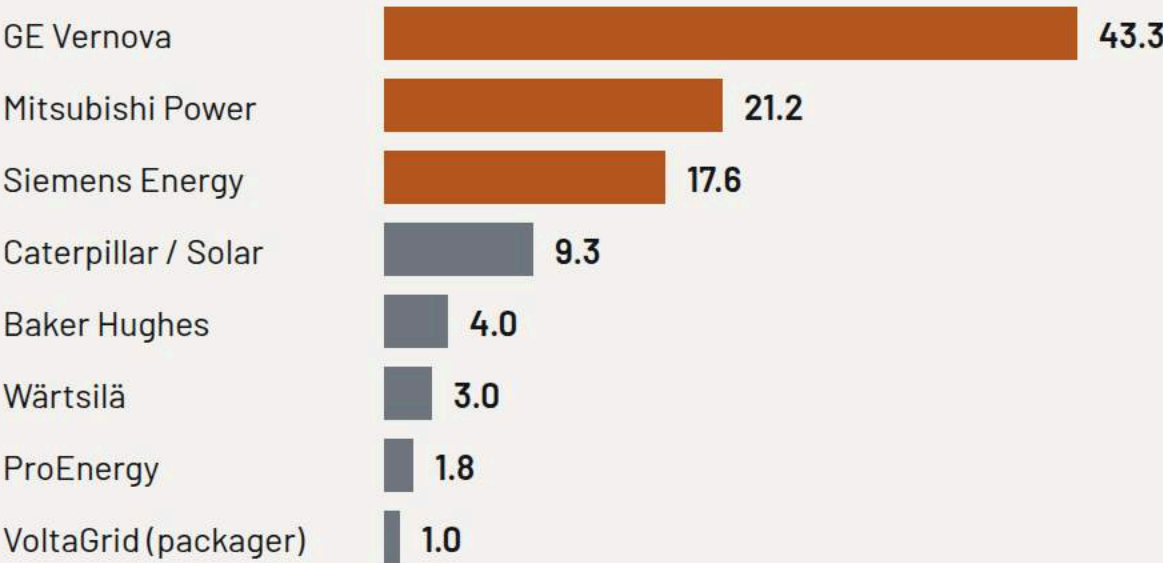

NAMED EPCS, GROSS GW

EPC / constructor	GW
Kiewit / TIC	6.8
Zachry / Quanta	2.6
Gemma Power Systems	2.5
PCL	1.5
Burns & McDonnell	0.4

87% of gross capacity has no confirmed constructor yet: buyer discovery is the next job.

Source: Southwire PowerGen commercial priorities model, Sep 11, 2026. Gross GW, unweighted. Copper = the three turbine OEMs; grey = engines, aeroderivatives and VoltaGrid.

INDUSTRY PARTICIPANTS

PRIORITY PLAYERS ACROSS THE BUYING CHAIN

Buying lane	Examples	What to establish
Owners · developers	NRG, CPV, Entergy, Homer City Redevelopment	Project phase, EPC, procurement route
EPC · engineering	Kiewit, Gemma, Burns & McDonnell, Black & Veatch	Electrical package buyer and spec access
Turbine · engine OEMs	GE Vernova, Siemens Energy, Mitsubishi Power	Equipment interfaces, approved cable constructions
Modular · package builders	VoltaGrid, nVent, Powell, Fibrebond, Panelmatic	Internal BOM, repeat demand, assembly and channel fit

The owner influences the spec. Another party often buys the cable.

NAMED PROJECT PURSUITS

TOP 7 OF 17 PRIORITY PURSUITS

Project · owner group	State	Gross MW	Constructor · next check	Gross POs 27-29, \$M
Homer City · IPP	PA	4,396	Kiewit: campus phase releases	21.9
Roxboro CC1 + CC2 · IOU	NC	2,549	Zachry: separate unit packages	13.0
Bison 1 + 2 · co-op	ND	1,458	PCL electrical buyer; B&M engineering	8.0
CPV Basin Ranch · IPP	TX	1,345	Gemma: remaining purchase releases	7.8
Smarr · co-op	GA	1,335	TIC: specification and cable schedule	7.8
Sadow Lakes · IPP	TX	1,200	Gemma: whether bulk cable is awarded	5.2
Lowman LEC 3 · co-op	AL	401	B&M: simple-cycle expansion scope	2.3

Source: Southwire PowerGen model, Sep 11, 2026. Rounded gross MW, unweighted; modeled POs shown gross, before completion probability.

SOUTHWIRE PROGRESS

FROM DISCOVERY TO EXECUTION IN SIX MONTHS

386

PROJECTS TRACKED

New gas generation in 40 states, all owner types

17

PRIORITY PURSUITS

Validated, about \$200M of cable potential

\$50M+

BOOKED IN Q3

\$30M in September alone

\$5M


ANIXTER POWER SOLUTIONS

Booked in Q3

Power Generation became its own Southwire vertical in early 2026. Owner conversations showed that cable is specified and bought through EPCs and package builders, so the pursuit model now follows that path.

GO-TO-MARKET MODEL

WE FOLLOW THE WAY THE PROJECT IS BOUGHT

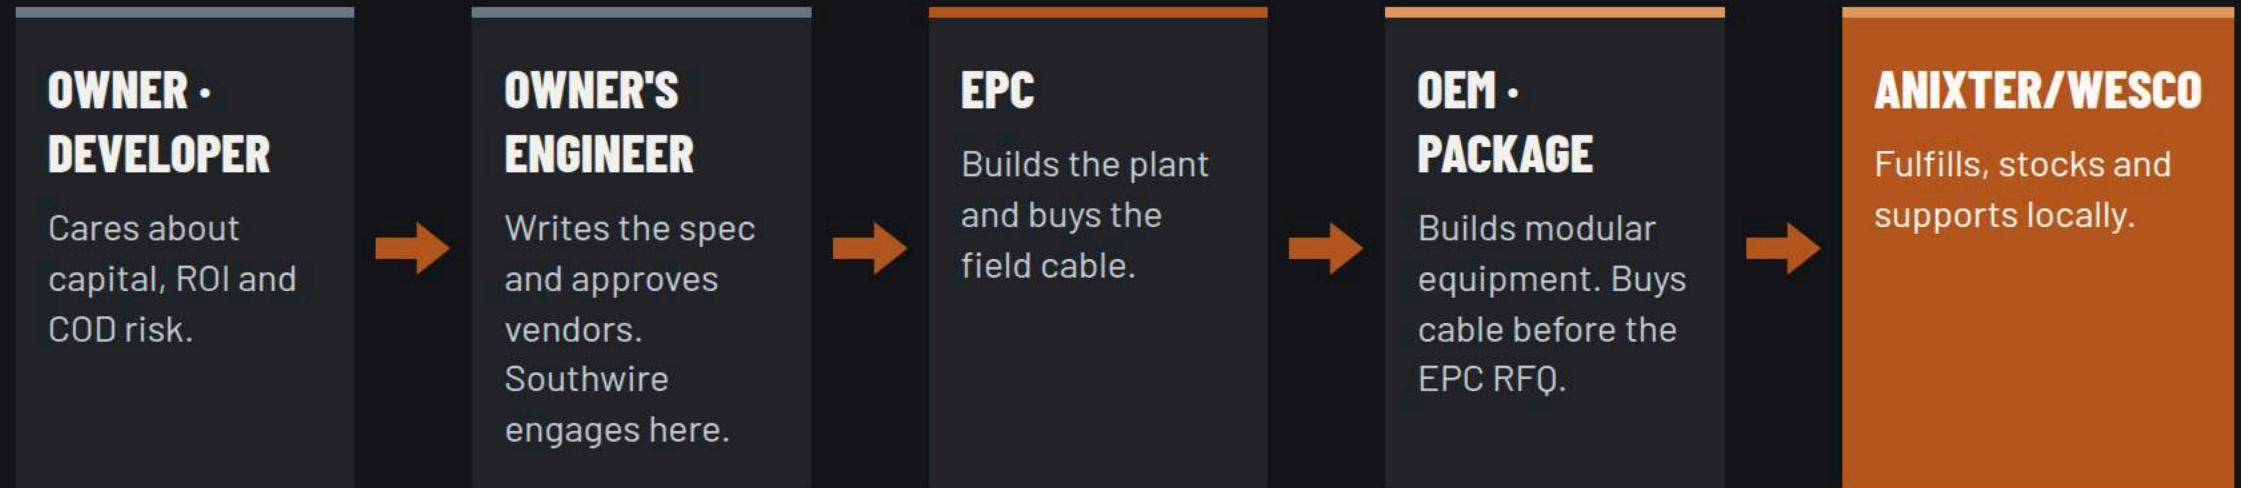

Influence flows back: the owner's engineer and EPC shape what the owner approves, so specification wins are made upstream.

CABLE INSIDE PACKAGED EQUIPMENT IS BOUGHT MONTHS BEFORE THE EPC ISSUES ITS FIELD-CABLE RFQ.

COVERAGE MODEL

NAMED COVERAGE AT EVERY BUYING POINT

Name	Role	Focus
Stephan Hardt	PowerGen strategy, plant model, owners and OEMs	National
Patrick Ritchie	EPC account manager, Kansas City	Kiewit, Burns & McDonnell, Black & Veatch
Greyson	EPC outreach to more gas-plant builders	National
Phil Metz · Bob Benish	OEMs and package builders: e-houses, switchgear, modular power, panel shops	National
Anixter/Wesco	Modular OEM Solutions: the same package builders, channel side	National

Priority geography: Texas · Ohio · Indiana

Priority EPCs: Kiewit and Burns & McDonnell

02

GAS POWER SOLUTIONS

THE PLANT MODEL AND CABLE SYSTEMS

CABLE LINEUP AND DETAIL

MODULAR GAS POWER

STANDARDS AND SERVICES



THE CHALLENGE

EVERY MEGAWATT TRAVELS THROUGH A CABLE

COMBINED CYCLE PLANTS


HEAT	Routes beside turbines, HRSGs and steam lines
DAILY CYCLING	Frequent starts stress terminations and joints
FIRE AND SMOKE	Flame-retardant, low-smoke cable in halls and control rooms
ELECTRICAL NOISE	Drives and switchgear next to DCS and protection

MODULAR GAS POWER

COMPACT SKIDS	Flexible cable with tight bend radii
VIBRATION	Fine stranding and secure glands for engines
HARSH SITES	Oil, fuel, sunlight and wide temperature ranges
SPEED TO POWER	Pre-terminated, tested harnesses cut site hours

THE PLANT IS THE MODEL


16 ZONES, 75 EQUIPMENT NODES

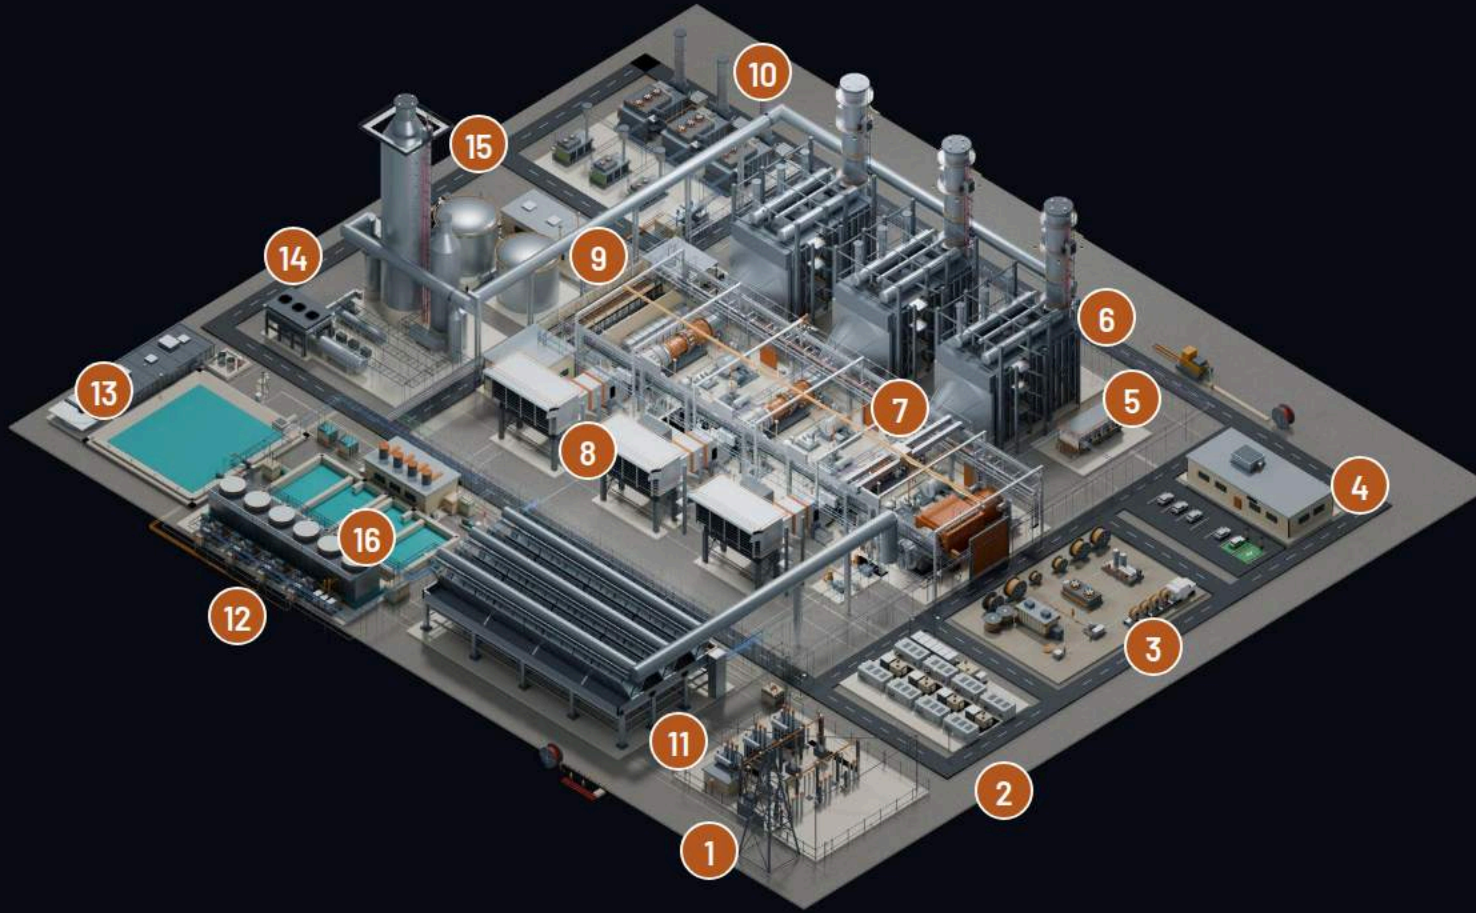

- 01 Switchyard, GSU & grid tie
- 02 BESS yard
- 03 Reel staging & prefab
- 04 Admin & control room
- 05 E-house
- 06 HRSG trains & stacks
- 07 Turbine hall
- 08 GT air inlets
- 09 MCC, VFD & UPS room
- 10 Modular power yard
- 11 Air-cooled condenser
- 12 Chillers & cooling towers
- 13 Water treatment
- 14 Carbon capture (CCS)
- 15 Gas metering
- 16 Cable corridor & MV


PLANT · EQUIPMENT · CABLE · DELIVERY

SEVEN CABLE SYSTEMS IN ONE PLANT

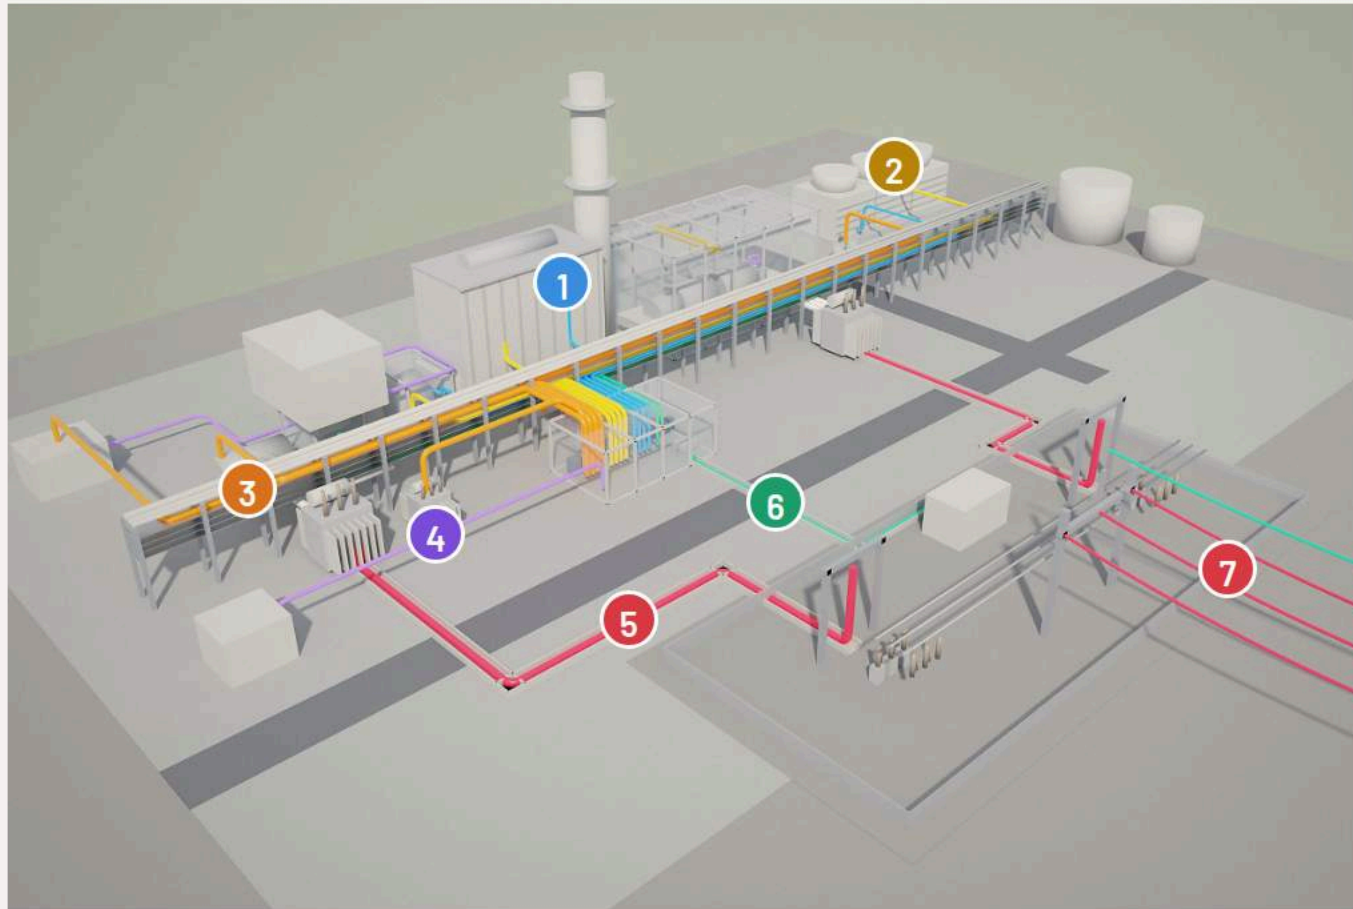

- 1 Control & instrumentation
- 2 LV power & VFD cable
- 3 Medium-voltage feeders
- 4 Fire-rated & specialty
- 5 High-voltage XLPE cable
- 6 Fibre optic
- 7 Overhead conductor & OPGW

ILLUSTRATIVE 1×1 COMBINED CYCLE BLOCK · CABLE DIAMETERS EXAGGERATED

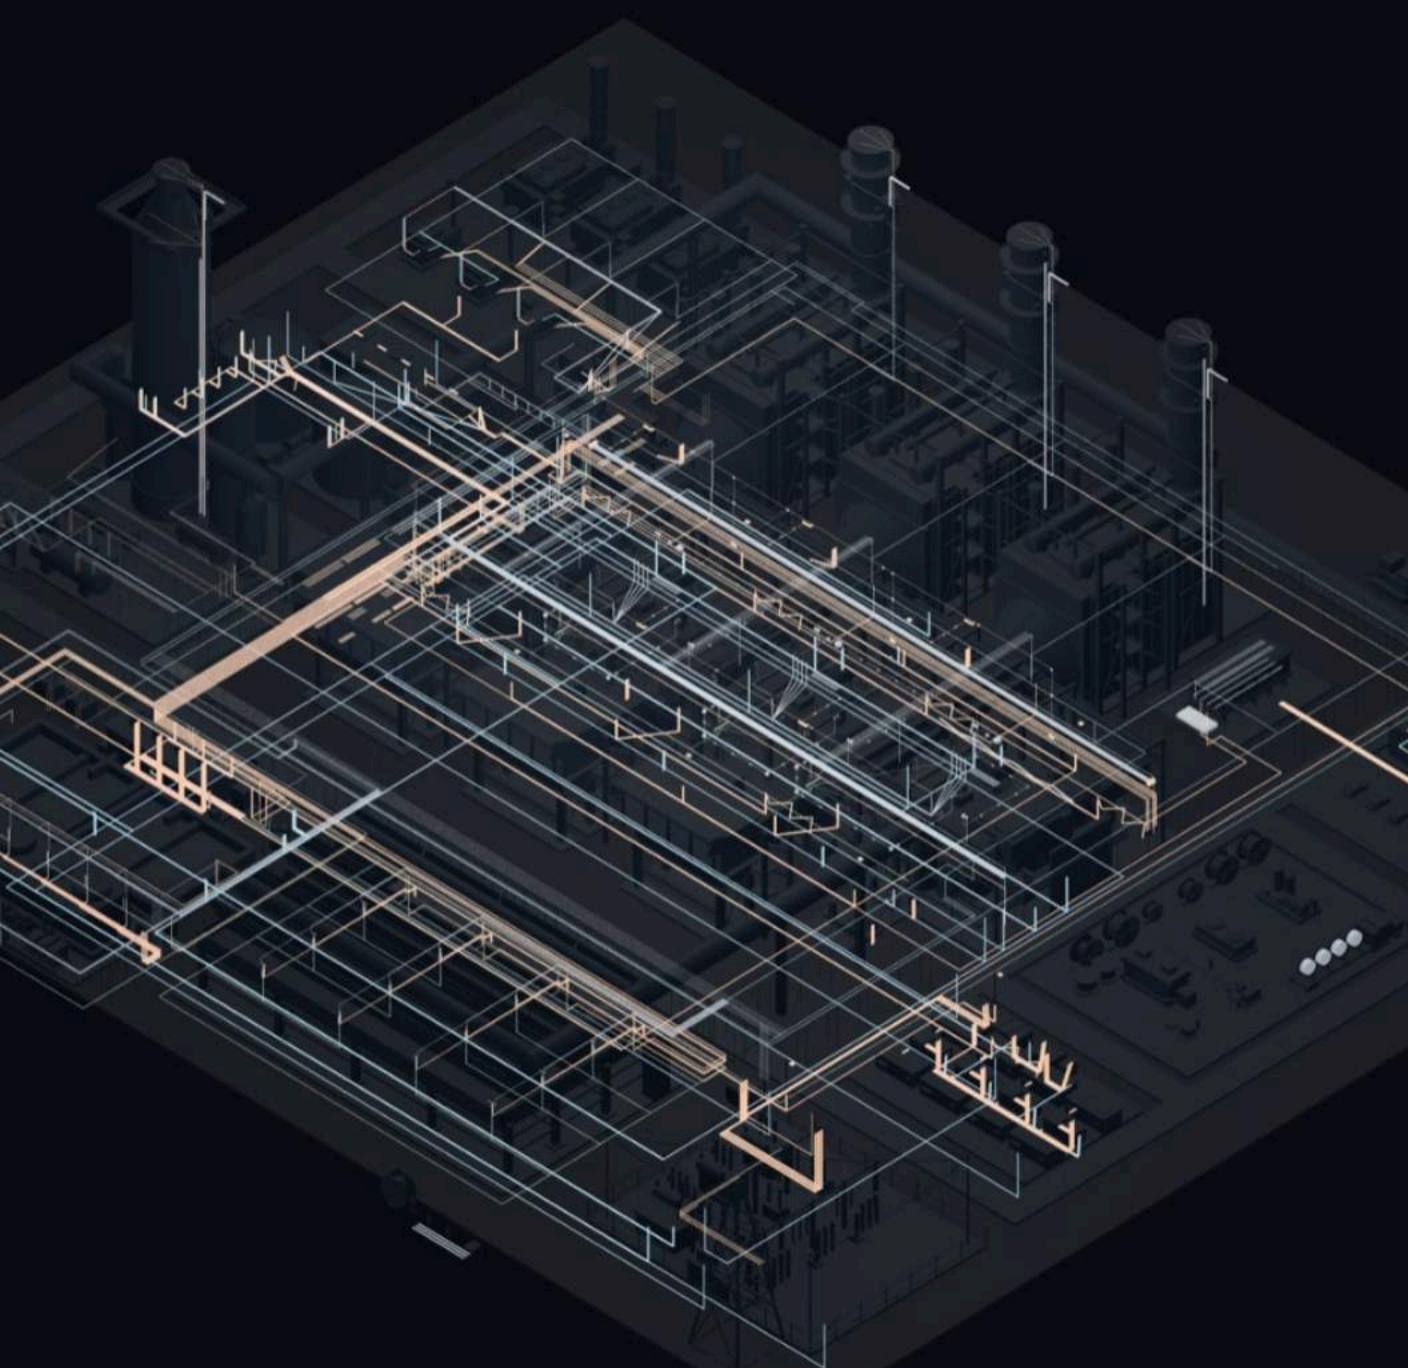

TECHNICAL SCOPE

ONE CONNECTED CABLE SCOPE

MV / HV POWER

Plant feeders, transformer ties, collection

CONTROL & INSTRUMENTATION

CT/VT, breaker control, shielded pairs and triads

LV POWER & AUXILIARIES

Motors, panels, Machine FLEX VFD cable

GROUNDING & BARE

Ground grid and equipment bonds

HAZARDOUS & SPECIALTY

Classified areas and DC circuits

ONE SUPPLIER. EVERY CIRCUIT.



HV 69-345 KV

XLPE from step-up transformer to switchyard

AEIC CS9 · ICEA S-108-720



MV 5-35 KV

Feeders to pumps, fans, compressors and GT start-up

UL 1072 · ICEA S-93-639



LV POWER & VFD

MCC feeders, VFD motor leads, lighting

UL 1277 TC-ER · UL 44 XHHW-2



C&I CONTROL

Shielded pairs, triads and thermocouple extension

UL 2250 ITC · UL 13 PLTC



FR FIRE-RATED

2-hour circuit integrity for fire pumps, alarms, ESD

UL 2196 · IEC 60331



FO FIBRE

Relay links, plant network and OPGW

ICEA S-87-640 · IEEE 1138



MX MODULAR

Flexible, oil-resistant cable and harnesses for skids

Class K stranding · UL 1277




GR GROUNDING

Bare copper grid and equipment bonding

IEEE 80 · IEEE 665

CABLE IN DETAIL

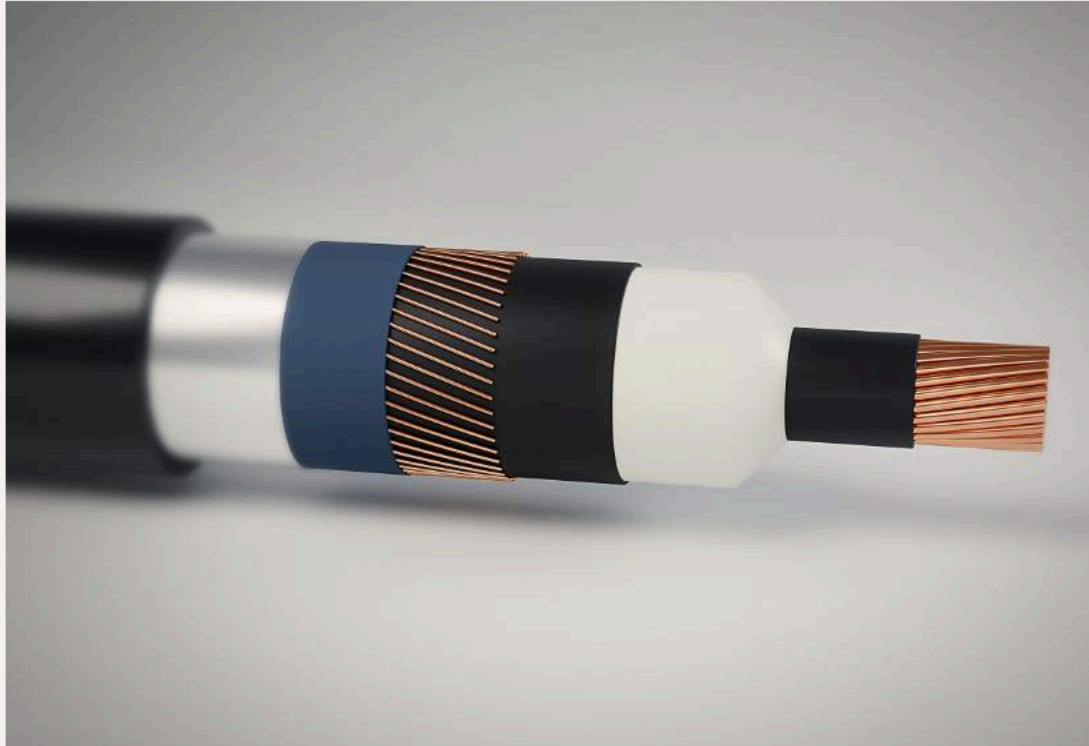

HV single-core XLPE. Triple-extruded insulation, copper wire screen and water-blocking under a tough PE jacket.




MV three-core for large auxiliary motors



Circuit integrity for fire and shutdown circuits



Segregated trays by voltage class

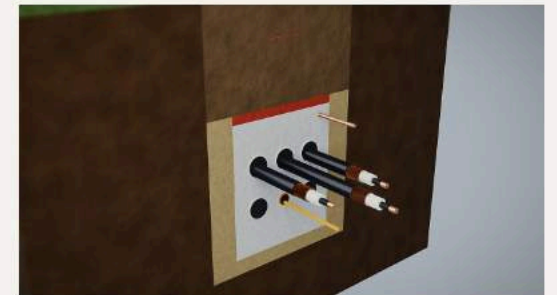

Duct bank for HV runs to the switchyard

BUILT TO NORTH AMERICAN SPECS

Cable family	North American standards	International
HV 69–345 kV	AEIC CS9 · ICEA S-108-720	IEC 60840 · IEC 62067
MV 5–35 kV	UL 1072 · ICEA S-93-639	IEC 60502-2
LV power & VFD	UL 1277 TC-ER · UL 44 XHHW-2	IEC 60502-1
Control & instrumentation	UL 2250 ITC · UL 13 PLTC	EN 50288-7
Fire-rated	UL 2196 circuit integrity	IEC 60331
Flame propagation	IEEE 1202 · UL 1685	IEC 60332-3
Fibre & OPGW	ICEA S-87-640 · IEEE 1138	ITU-T G.652.D
Grounding	IEEE 80 · IEEE 665	IEC 61936-1

CONFIRM LISTINGS PER PRODUCT DATASHEET



BUILT FOR POWER THAT SHIPS IN A CONTAINER

PRE-TERMINATED

Cut, terminated, tested and labelled in the factory

FLEXIBLE

Fine stranding and tight bend radii for dense skids

VIBRATION-PROOF

Built for engines and aeroderivative packages

SITE-RATED

Oil-, fuel- and sunlight-resistant jackets

DESIGN

CUT &
TERMINATE

TEST & LABEL


PLUG IN ON SITE

RENDERED ILLUSTRATION

25

MODULAR GAS POWER

EVERY PACKAGE NEEDS CABLE

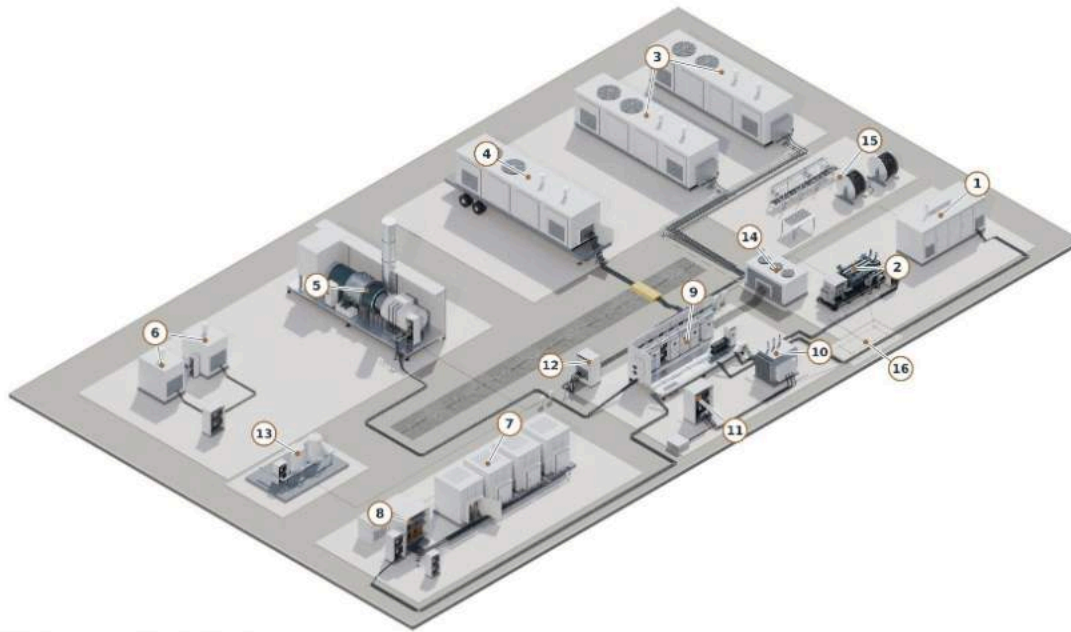

Stephan Hardt | Power Generation Solutions - illustrative modular power block

- 1-4 Gas gensets: enclosed, open, containerized, mobile
- 5 Packaged gas turbine
- 6-8 Microturbines, fuel cells and inverters
- 9-11 E-house, step-up transformer, MV tie-in
- 15 Cable reels and preparation area
- 16 Grounding grid and bonding

ILLUSTRATIVE ARRANGEMENT • GENERIC EQUIPMENT AND CIRCUITS

HOW WE BACK THE CHANNEL

01

SPEC SUPPORT

Cable sizing, derating and spec reviews for EPCs and OEMs

02

CUT-TO-LENGTH

Drum lengths planned against the cable schedule

03

HARNESS KITS

Pre-terminated, labelled kits for skids and panels

04

STOCKING PROGRAM

Core control and power SKUs held at [Anixter/Wesco locations]

05

PROJECT LOGISTICS

Drum tracking and sequenced site deliveries

06

FIELD SUPPORT

Pulling calcs, termination and commissioning tests



VALUE PROPOSITION

ACCELERATING TIME TO POWER

LESS INSTALLATION TIME

Prefab and standard designs across projects

MATERIAL READINESS

Reel IDs, kits and sequenced delivery

SUPPLY CERTAINTY

Forecasts tied to a confirmed supply plan

EXECUTION SPEED

Earlier decisions and repeat designs

03


WINNING TOGETHER

PROJECTS WORTH A JOINT REVIEW

PACKAGE BUILDERS AND PANEL SHOPS

JOINT OPERATING MODEL

DECISIONS FOR TODAY

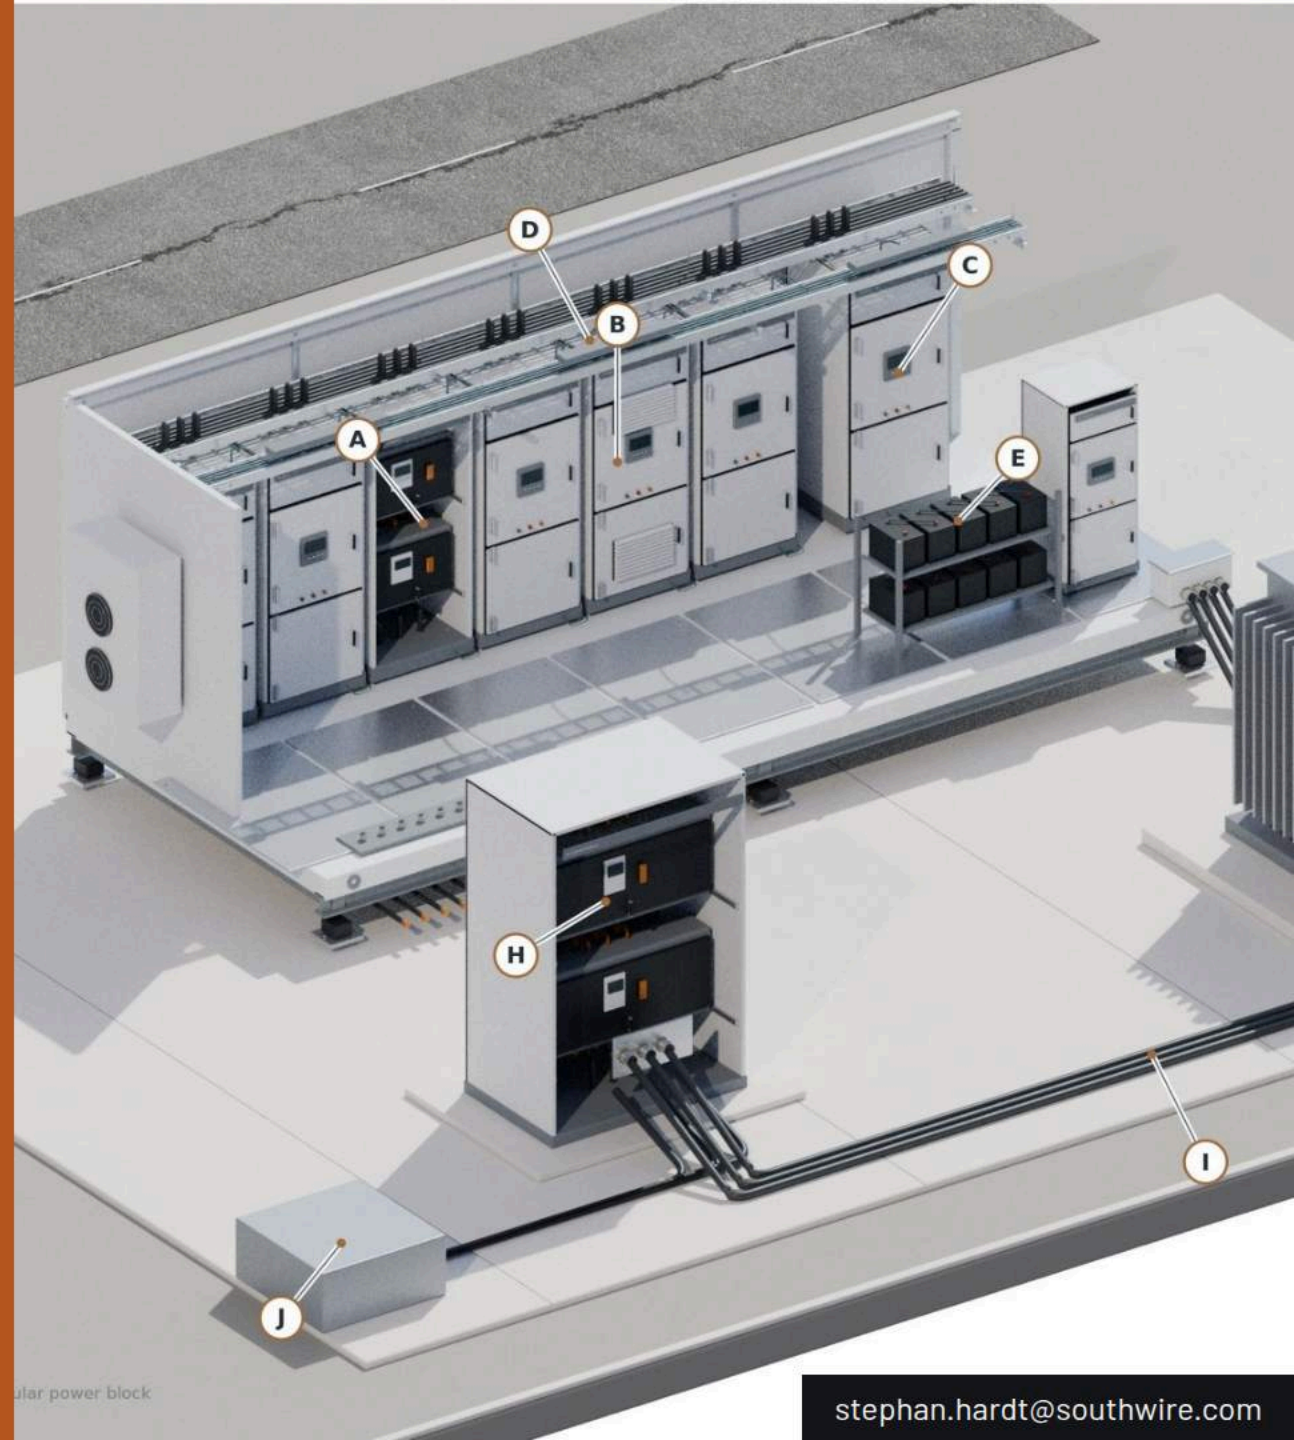

ular power block

PUBLIC PROJECT SIGNALS


PROJECTS WORTH A JOINT REVIEW

Project · program	Public evidence	Joint review question
CPV Basin Ranch, TX	1,350 MW CCGT, construction under way	Who buys the remaining electrical packages?
Homer City, PA	Up to 4.4 GW under construction; Kiewit, GE Vernova	Which site and OEM packages remain open?
NRG Texas Energy Fund	Three projects, 1.5 GW, financed construction program	Which units and packages still need supply?
VoltaGrid	2.3 GW Oracle fleet; 1.5 GW, 300-engine order for delivery by 2028	Where does internal wiring split from site collection?
Entergy · IOU	16 gas units, ~14 GW in LA, TX, MS, AR; 5.8 GW building, incl. Meta's Richland Parish	S&L/TIC/Mitsubishi consortium on 8 units: who buys BOP and field cable?

Public status as of the Oct 2 source review. Anixter/Wesco access to be confirmed.

PACKAGE BUILDER OPPORTUNITY

FROM FIELD CABLE INTO THE PACKAGE

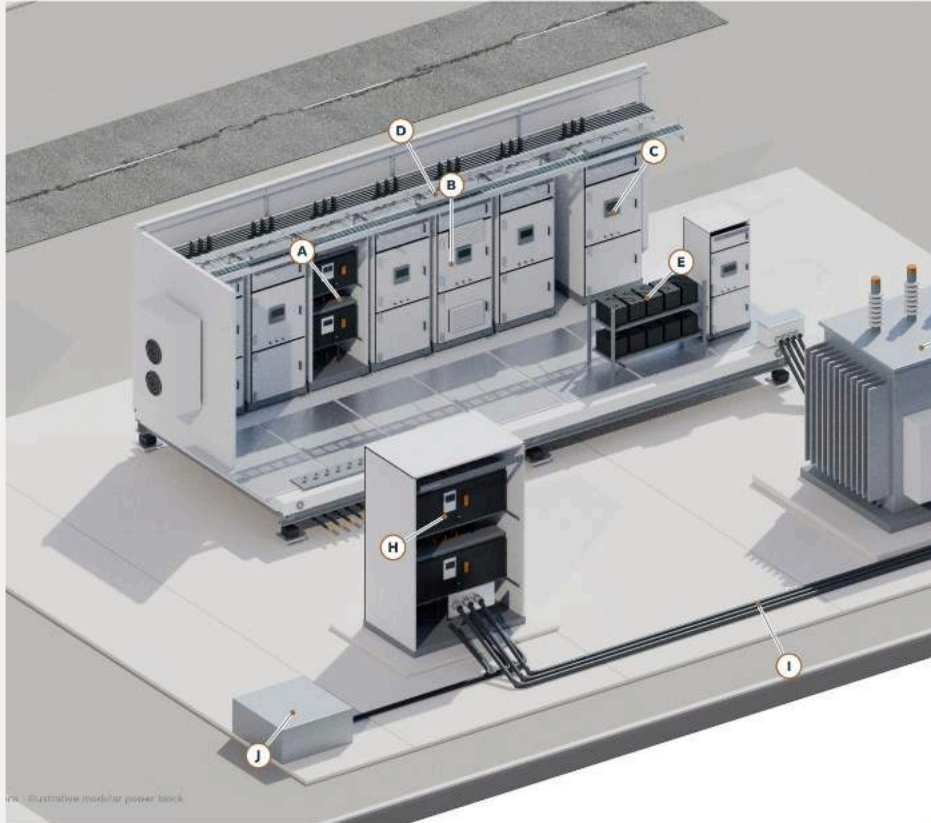

E-HOUSE • POWER ENCLOSURE

Powell Industries (Anixter/Wesco global account), Fibrebond (Eaton), TAS, EAS
North Carolina

MV EPR switchgear ties, Machine FLEX, tray and panel wire

PANEL • INTEGRATION SHOP

Panelmatic Houston, industrial HVAC and BMS panel shops

AWM panel wire, SAFEGUARD cord, control and instrumentation

MOBILE • MODULAR POWER

VoltaGrid

DLO, MV and tray cable for generator, collection and auxiliaries

ALL BOUGHT BEFORE THE EPC FIELD-CABLE RFQ

JOINT OPERATING MODEL

TARGET, OWN, STOCK AND QUOTE, ACT

SOUTHWIRE BRINGS

- 386 tracked projects in 40 states
- Spec support and plant-wide cable scoping
- Named EPC and OEM relationships
- Application guides and line cards

ANIXTER/WESCO BRINGS

- Global accounts, Powell Industries and more
- Local stocking and fulfillment
- Modular OEM Solutions coverage
- Quotes, logistics and access in TX, OH, IN

1 TARGET THE ACCOUNT

2 OWN THE RELATIONSHIP

3 AGREE STOCK & QUOTE

4 ACT TOGETHER

FIRST 90 DAYS

A SMALL SHORTLIST WITH NAMED NEXT ACTIONS

Days 0-30

EXCHANGE AND SELECT

Swap account lists; pick 5-10 projects or builders

Output: lead contact, package scope, open questions

Days 31-60

CALL AND QUALIFY

Joint calls and technical qualification

Output: buyer, spec, timing and quote route

Days 61-90

PROPOSE SUPPLY

Supply and inventory proposals where qualified

Output: written next action and delivery plan

START WITH THE 17 PRIORITY PURSUITS AND THE PACKAGE BUILDERS WE BOTH CALL ON

THREE DECISIONS FOR TODAY

1

CONFIRM TARGETS

The first 3-5 package builders, OEMs or projects to pursue jointly in TX, OH and IN, starting with Powell

2

ASSIGN OWNERSHIP

Who leads each account, who stocks and who quotes, for every builder we both call on

3

BOOK THE FIRST CALLS

2-3 joint customer meetings with panel builders and OEM packagers before year-end

Why it works: demand is durable, Southwire has real PowerGen traction, and we already call on the same package builders. A joint plan turns that overlap into an advantage.



Southwire[®]

POWER GENERATION SOLUTIONS

FASTER TIME TO POWER. LOWER EXECUTION RISK.

ENGINEERED FOR LONG-TERM RELIABILITY.

— WE DELIVER POWER RESPONSIBLY —

powergen@southwire.com

APPENDIX

SOURCES AND QUALIFIERS

Figure	Source
Load growth, data centers	Grid Strategies, National Load Growth Report, 2025 (forecast)
378 GW pipeline, 52 GW building	Global Energy Monitor, Aug 2026; early-stage proposals will not all be built
Turbine lead times	S&P Global Commodity Insights, May 20, 2025
OEM backlogs and orders	GE Vernova 2Q'26; Siemens Energy Q3 FY26; Utility Dive, Aug 13, 2026 (MHI); Caterpillar 2Q'26; Eaton, Jun 2025; POWER Magazine on VoltaGrid (Oracle, Oct 2025; Vantage, Feb 2026)
Cable opportunity, OEM, EPC, projects	Southwire PowerGen commercial priorities model, Sep 11, 2026: assumed rates and probabilities, no statistical confidence interval
Register, owners, geography, buyers	Southwire PowerGen capacity and buyer strategy, Oct 2026 (register snapshot Sep 11, 2026)
Progress and coverage	Southwire internal, 2026
Plant and yard renders	Southwire PowerGen plant model: conceptual and illustrative, not engineering data

VERIFY ALL FIGURES AGAINST PRIMARY SOURCES BEFORE EXTERNAL USE