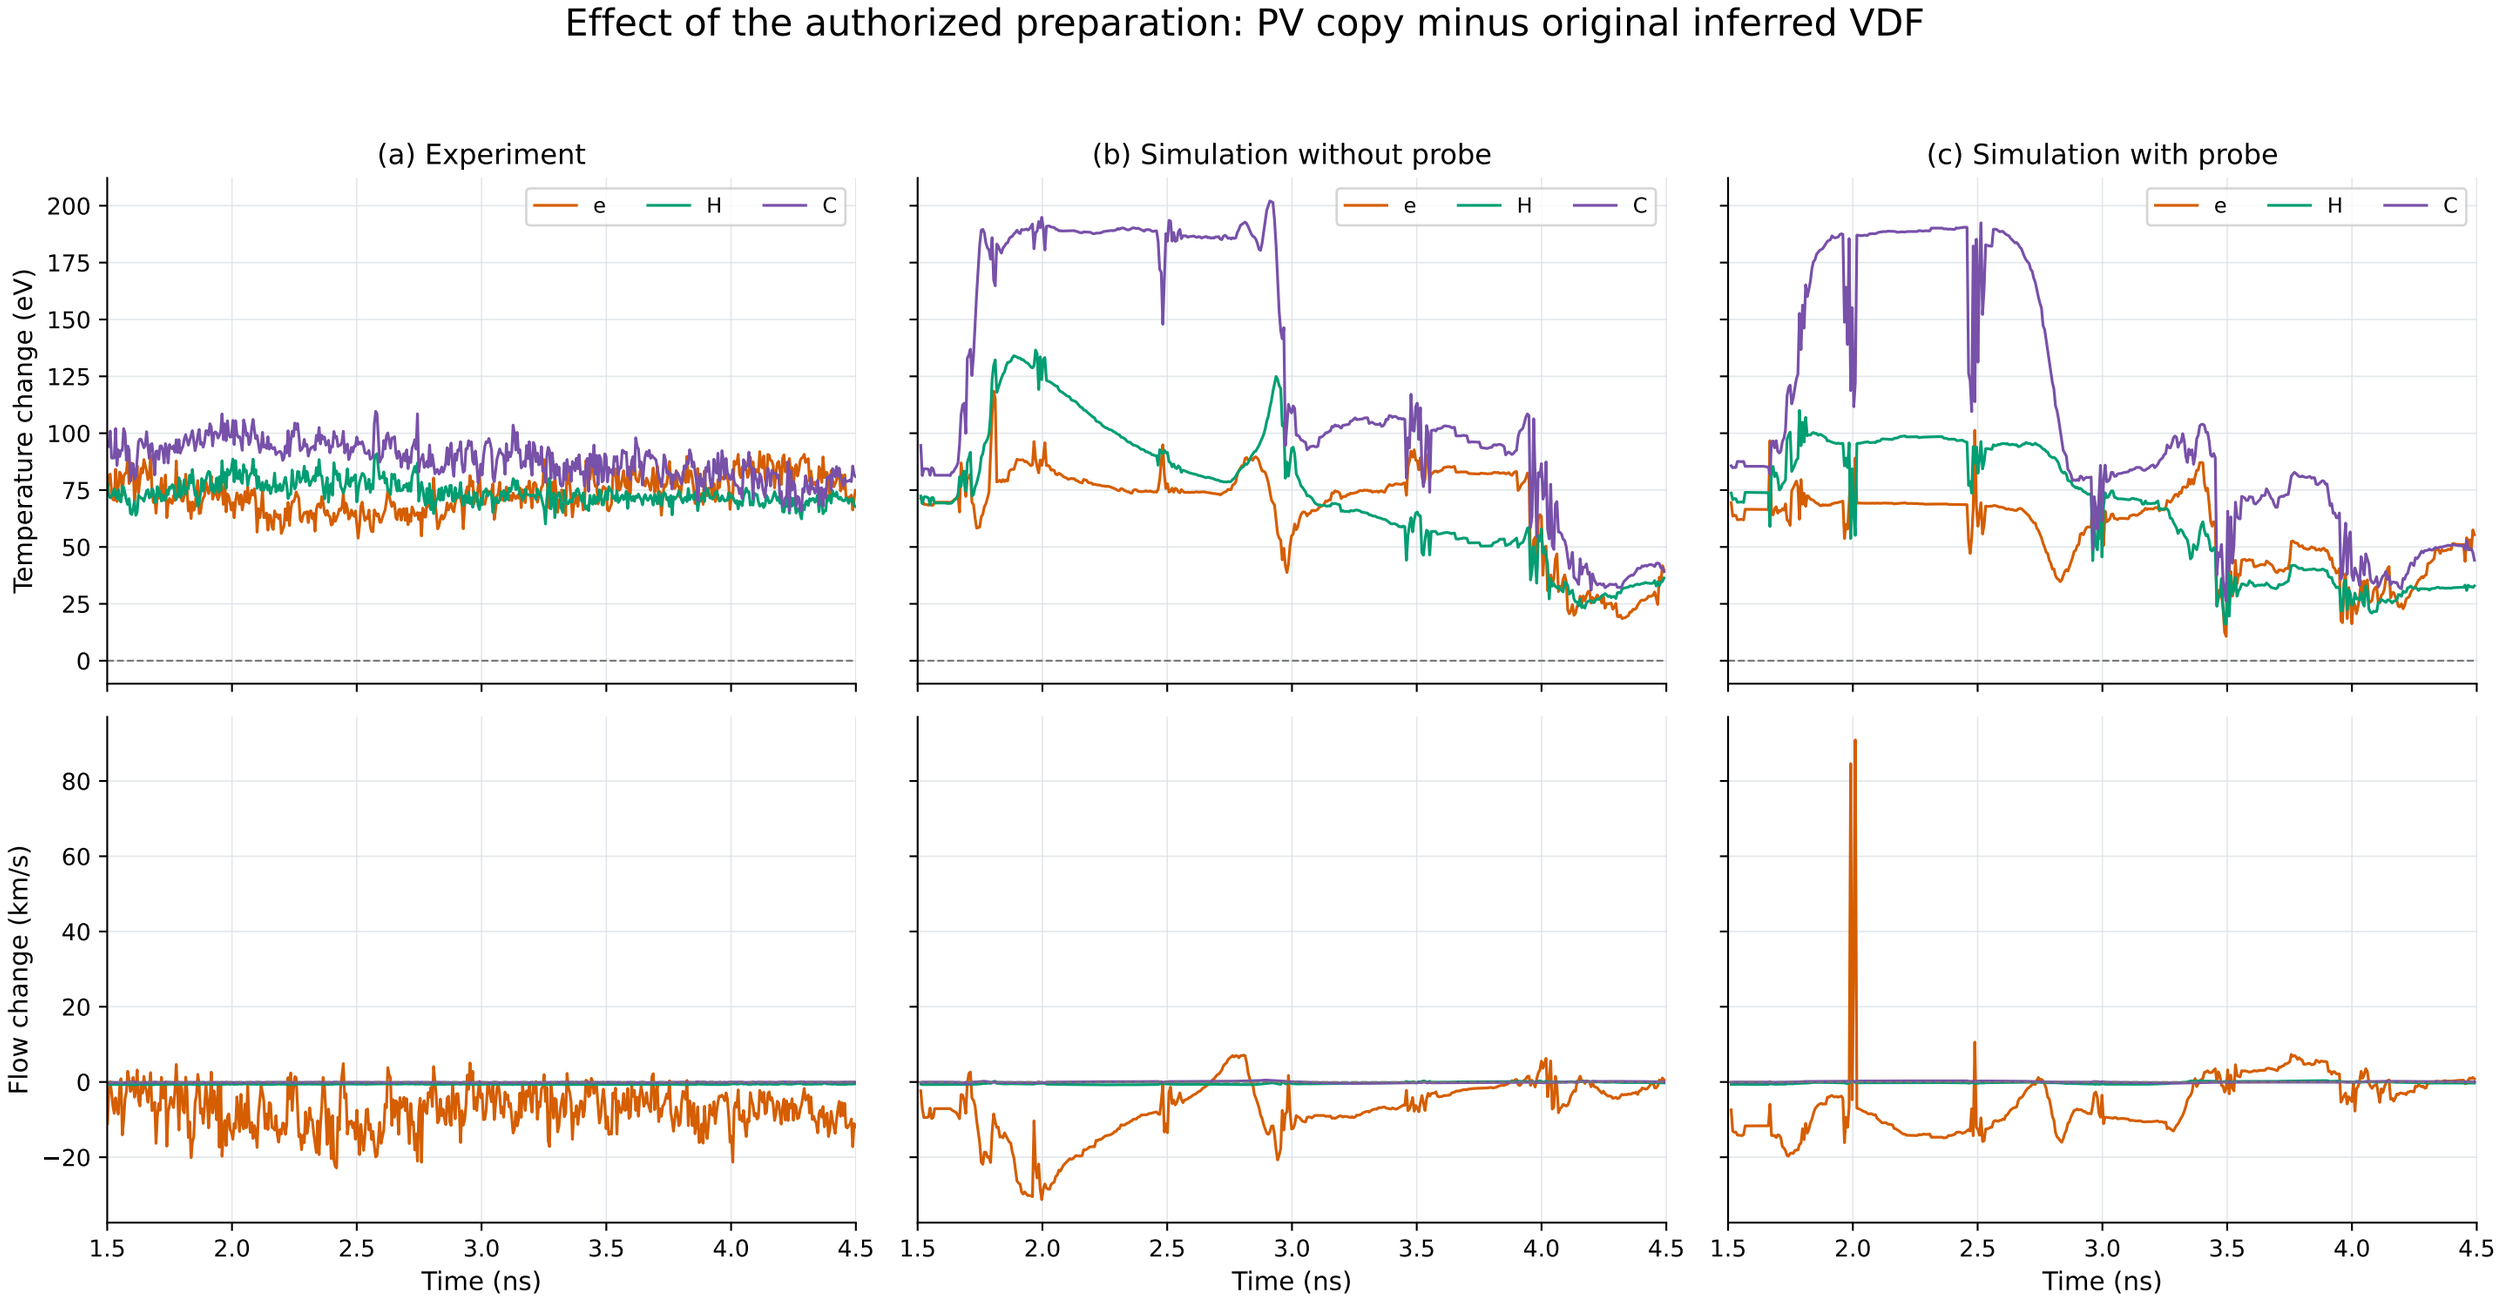

Effect of the authorized preparation: PV copy minus original inferred VDF
(a) Experiment
(b) Simulation without probe
(c) Simulation with probe
e
H
C
Temperature change (eV)
200
175
150
125
100
75
50
25
0
Flow change (km/s)
80
60
40
20
0
−20
1.5
2.0
2.5
3.0
3.5
4.0
4.5
Time (ns)
Uniform float64 grid → linear interpolation → negative values set to zero → unit integral. Original inference arrays remain unchanged.