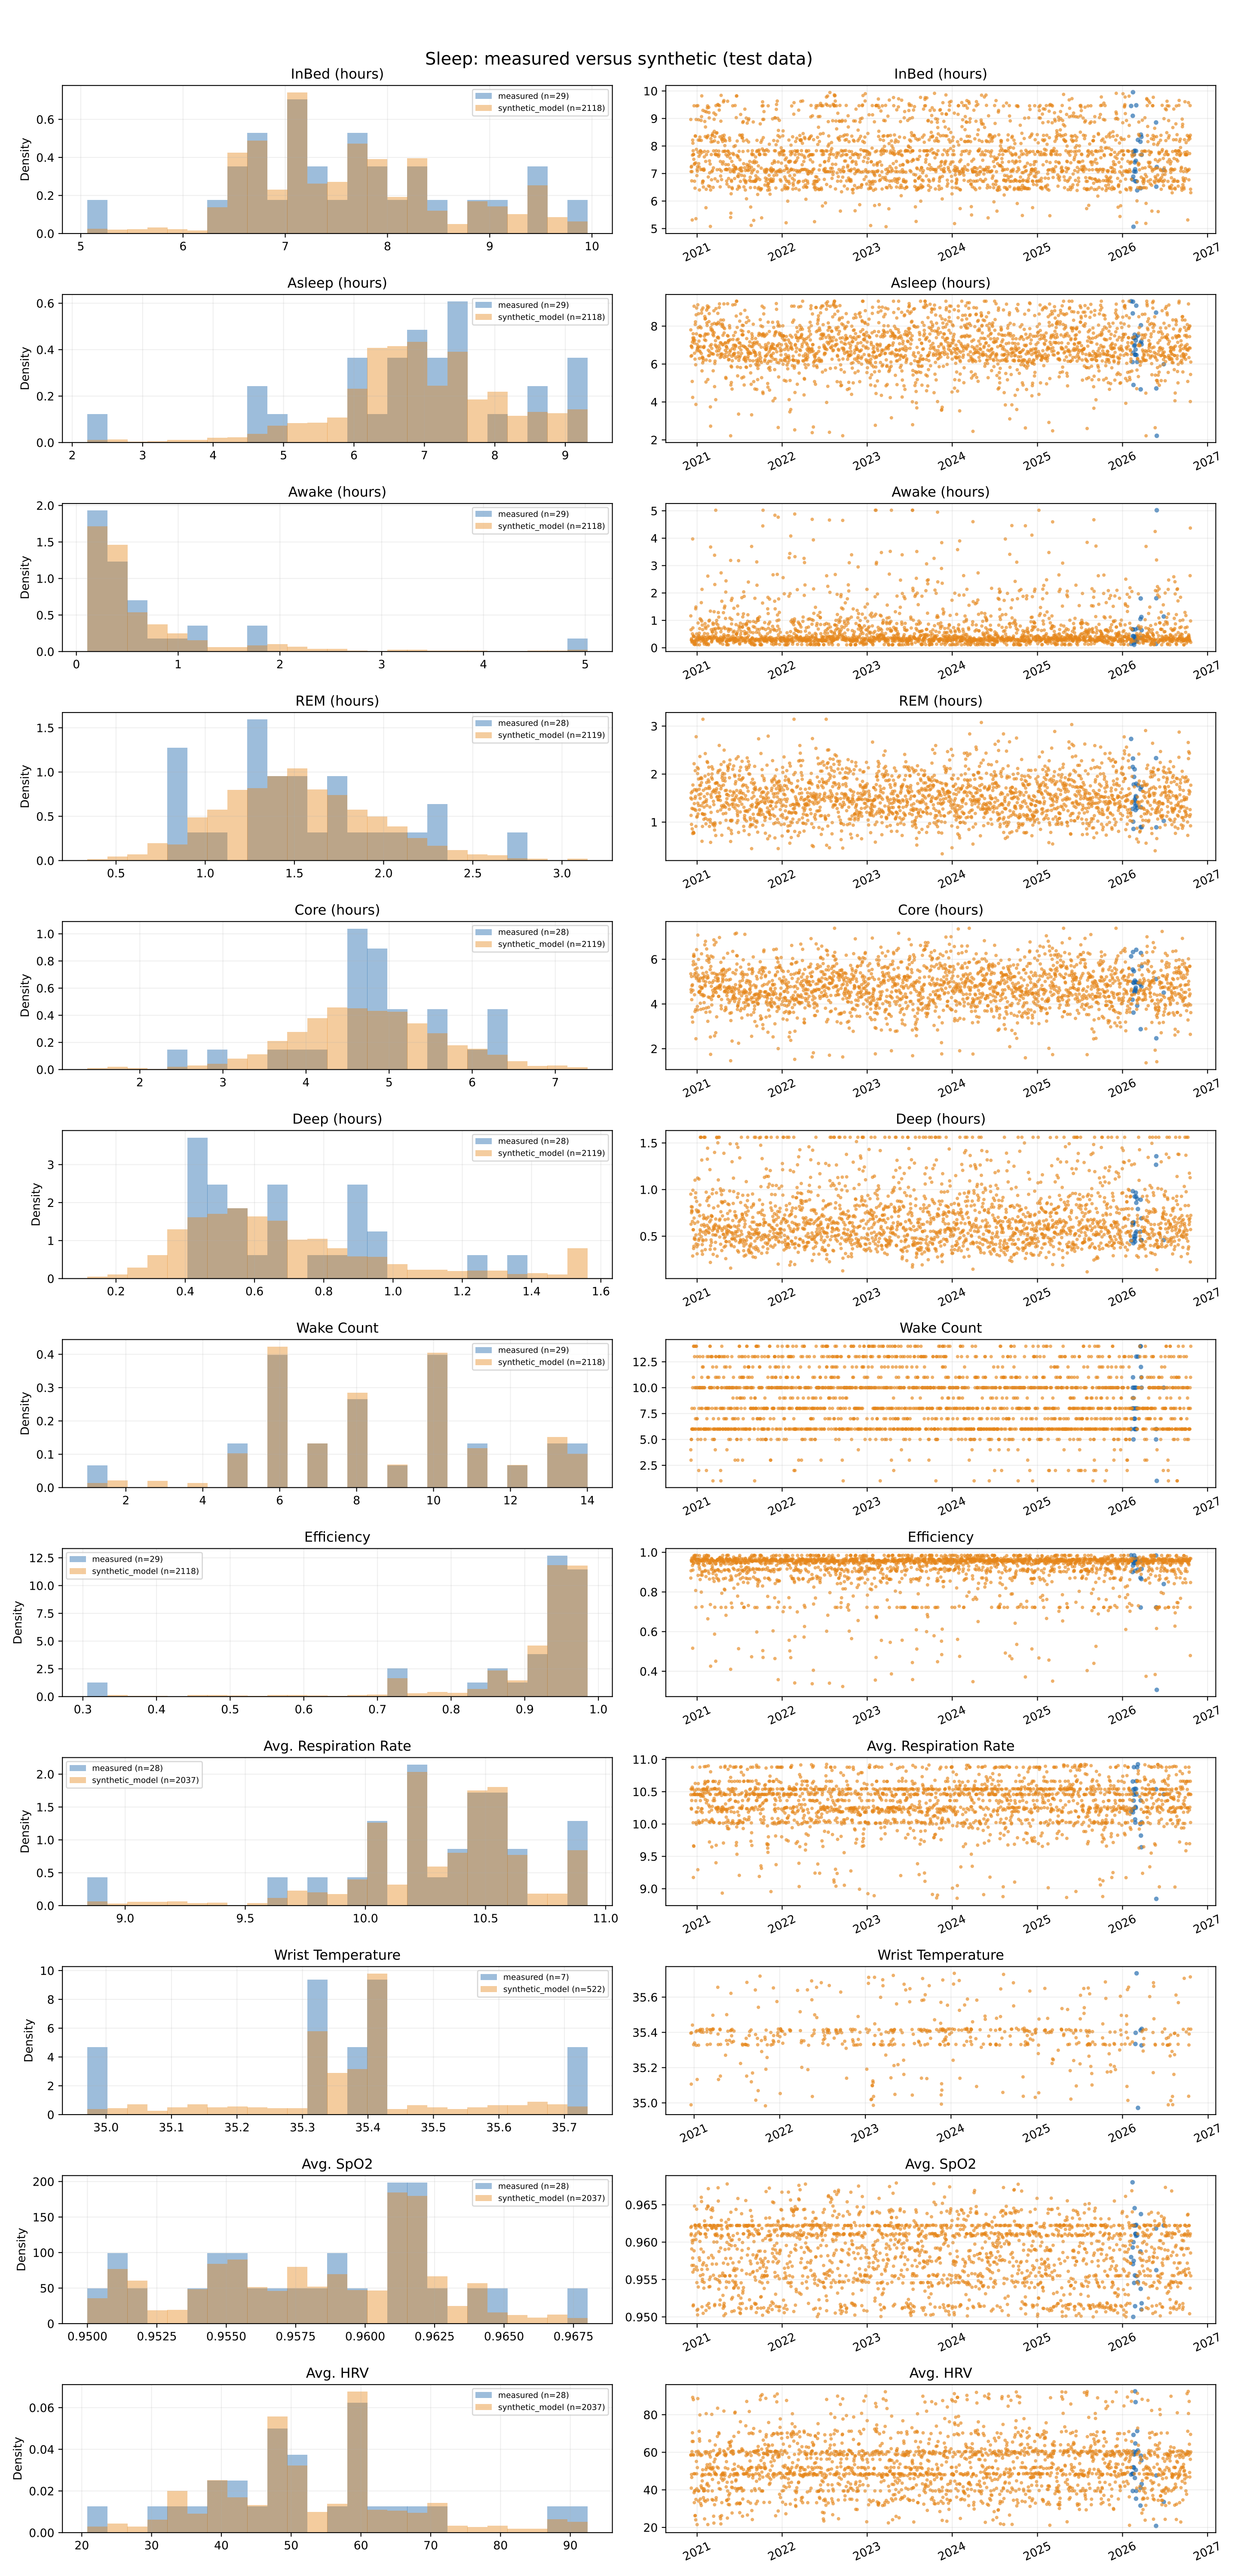

Sleep: measured versus synthetic (test data)
InBed (hours)
measured (n=29)
synthetic_model (n=2118)
Density
InBed (hours)
Asleep (hours)
measured (n=29)
synthetic_model (n=2118)
Density
Asleep (hours)
Awake (hours)
measured (n=29)
synthetic_model (n=2118)
Density
Awake (hours)
REM (hours)
measured (n=28)
synthetic_model (n=2119)
Density
REM (hours)
Core (hours)
measured (n=28)
synthetic_model (n=2119)
Density
Core (hours)
Deep (hours)
measured (n=28)
synthetic_model (n=2119)
Density
Deep (hours)
Wake Count
measured (n=29)
synthetic_model (n=2118)
Density
Wake Count
Efficiency
measured (n=29)
synthetic_model (n=2118)
Density
Efficiency
Avg. Respiration Rate
measured (n=28)
synthetic_model (n=2037)
Density
Avg. Respiration Rate
Wrist Temperature
measured (n=7)
synthetic_model (n=522)
Density
Wrist Temperature
Avg. SpO2
measured (n=28)
synthetic_model (n=2037)
Density
Avg. SpO2
Avg. HRV
measured (n=28)
synthetic_model (n=2037)
Density
Avg. HRV