

SC003 Surge Counter with Leakage Current Indicator


The Surge Arrester monitoring instruments are fully tested for use with any manufacturers surge arrester. The SC003 is a Surge Counter & also provides the additional measurement of total leakage current. The analogue instrument provides a means of monitoring the current through the arrester and the leakage current over the surface of the arrester housing. Significant changes after installation may indicate a deterioration in the arrester or a buildup of surface contamination.



SC003

Surge Counter with Leakage Current Indicator

These instruments, which require no auxiliary supply, are designed for installation in the earth connections of a single surge arrester or alternatively the SC003 may be used with the common earth of a three phase set. Fully weatherproofed and sealed for life they are housed in a one piece gravity die cast aluminum case coated to enhance its already high degree of resistance to surface corrosion. The glass viewing window is sealed in place, using a silicon rubber adhesive, and a desiccator is enclosed to ensure any residual moisture trapped during sealing is absorbed for the service life of the counter. Mounting is effected by means of an integrally cast lug at the rear of the case providing a single clearance hole for the galvanized steel M12 bolt supplied. The SC003 is service proven and require no special maintenance or servicing apart from general cleaning of the glass viewing window and the moulded epoxy resin line terminal bushing.

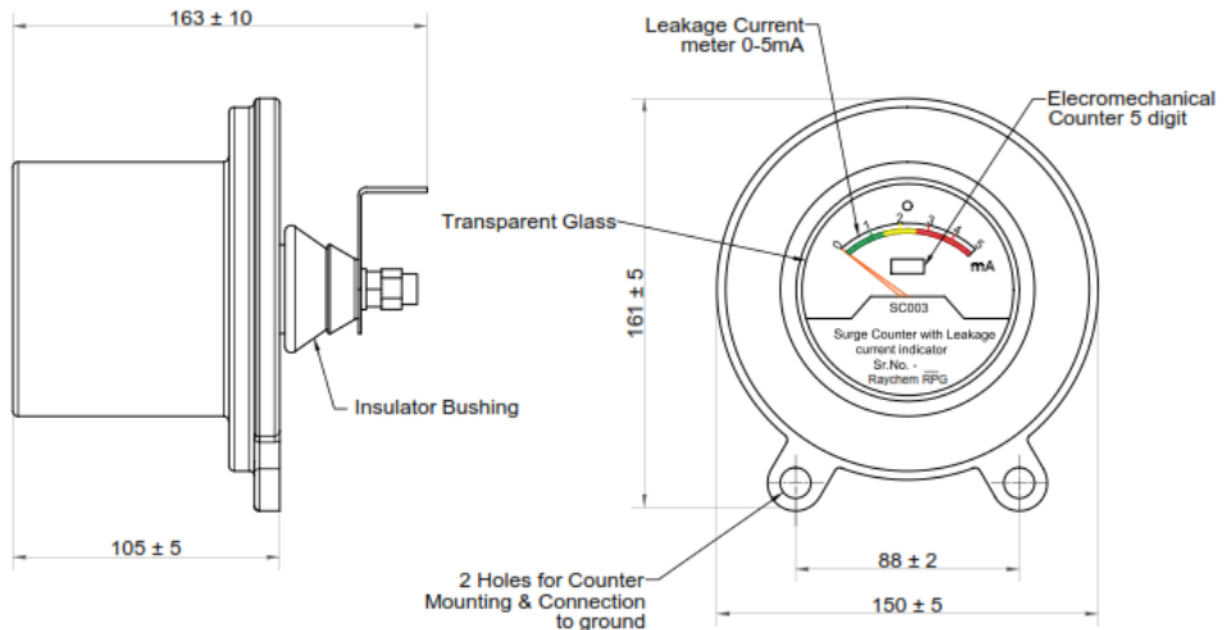

Meter: 5 digit cyclometer at least 5 counts/ second

Meter scale: 0 - 5 mA $\sqrt{\frac{\text{Peak}}{2}}$ (bilinear scale)

Rated Voltage Range of the Application Power System (Virtual Value): 10 ~ 220 kV

Nominal Discharge Current: 10 kA

Lower Limit of Actuating Current 8/20 μ S Peak) : 50 kA

Low residual voltage of normal discharging current: ≤ 1.5 kV

Withstanding Square wave Current 2000 μ S (Peak): 800 A

Maximum High Current Withstand: 100 kA 4/10 microsecond wave

Nominal Residual Voltage at 100 kA: 5 kV peak with 4/10 Microsecond Wave

Current Measuring Range and Indication Error (ACA): AC 0 ~ 3mA $< \%5$