

**Acuren Group Inc.**

2 - 240 Taiganova Crescent
Fort McMurray, AB, Canada T9K 0T4
www.acuren.com

Phone: 780.790.1776
Fax: 780.790.9061

**A Higher Level of Reliability****NONDESTRUCTIVE EXAMINATION**

Client: **Suncor Energy Inc.**
Suncor Oil Sands
Fort McMurray, AB

PAGE: 1 of 4

DATE: February 23, 2026

ACUREN JOB #: 272-J280794

REPORT #: **UT-BELKAR-26-051**

CONTRACT/PO: SUENTQ00169932 WO: 300616728

ATTENTION: **Condition Monitoring Group**

WORK LOCATION: Plant 52

PROJECT: Corrosion 2026

ITEM(S) EXAMINED: **CML 1.01 & 1.05**

PART #: See results MATERIAL: Carbon Steel & Stainless Steel THICKNESS: Various

SCOPE: Perform UT Thickness scans as per request.

TYPE OF INSPECTION: Ultrasonic

TEST DETAILS:

ACCEPTANCE STANDARD: Client's Information

REVISION: N/A

PROCEDURE/TECHNIQUE: CAN-UT-14T001

REVISION: 12

TYPE: Thickness

METHOD: Contact

INSTRUMENT: Olympus

MODEL: 38 DL Plus

S/N: 193352801

CAL DUE: September 24, 2026

CAL. BLOCK: Step Block

S/N: 1941-21 CS(1"-.5")

CABLE-TYPE: Coaxial

LENGTH: 5ft

CAL. BLOCK: Step Block

S/N: UT-1883 SS(1"-.5")

COUPLANT: Sono 600

Probe & Technique Details:

	TEST ANGLE (°)	PROBE TYPE	CRYSTAL SIZE	FREQ. (MHZ)	SERIAL NUMBER	DAMPING Ω	TEST FROM	REFERENCE REFLECTOR	TRANSFER VALUE	REFERENCE		SCAN dB	RANGE
										dB	% FSH		
1													
2	0	D799	.312"	5	1527747	N/A	OD	Backwall	0	65	80	N/A	2.00"
3													
4													

TEST SURFACE CONDITION: Bare

TEST SURFACE TEMPERATURE: 40F & -5F

RESULTS:

Circuit:
52-021K 1-2
CML
1.01 & 1.05

Client acknowledges receipt and custody of the report or other work ("Deliverable"). Client agrees that it is responsible for assuring that acceptance standards, specifications and criteria in the Deliverable and Statement of Work ("SOW") are correct. Client acknowledges that Acuren is providing the Deliverable according to the SOW, and not any other standards. Client acknowledges that it is responsible for the failure of any items inspected to meet standards, and for remediation. Client has 15 business days following the date Acuren provides the Deliverable to inspect it, identify deficiencies in writing, and provide written rejection, or else the Deliverable will be deemed accepted. The Deliverable and other services provided by Acuren are governed by a Master Services Agreement ("MSA"). If the parties have not entered into an MSA, then the Deliverable and services are governed by the SOW and the "Acuren Standard Service Terms" (www.acuren.com/serviceterms) in effect when the services were ordered.

CLIENT:

CLIENT PRINTED NAME

CLIENT SIGNATURE
ACCEPTED & ACKNOWLEDGED BY

ACUREN

TECHNICIAN:

Karl Bellen


1st Technician
CGSB UT1
CGSB Reg. #298752nd Technician
CGSB UT1
CGSB Reg. #0000


REVIEWER:



JOSHUA ROBERTSON
#28293

DTR No.: N/A

(Generated Using: CAN-QUA-02F007 R10 - 12/09/2021)



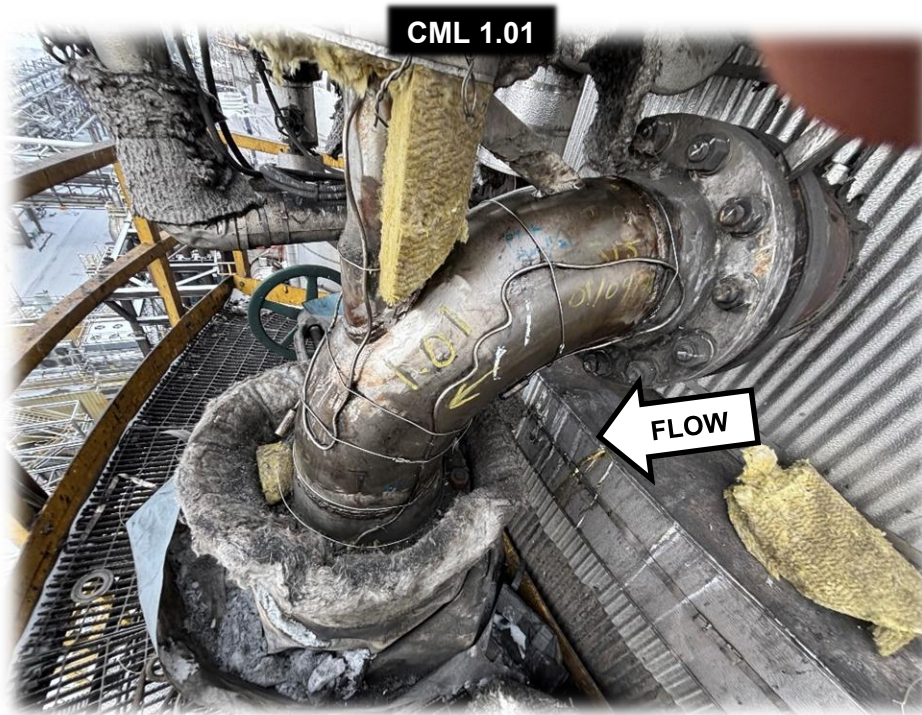

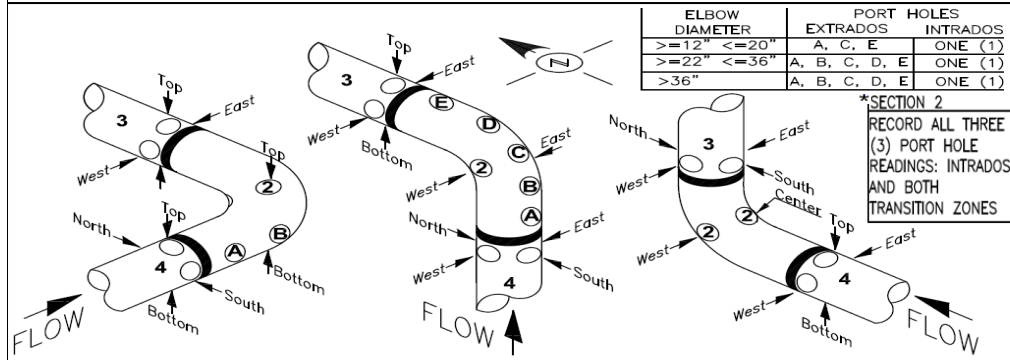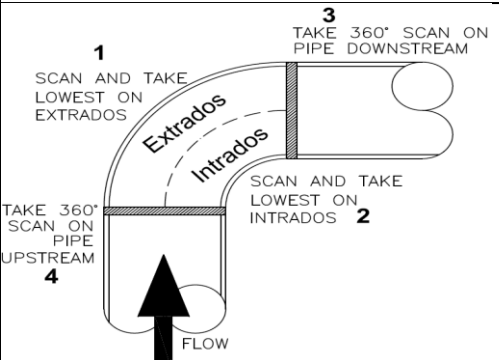UT REPORT - ELBOW																												
		DATE (MM/DD/YYYY):		02/23/2026		METHOD:		Corrosion ☐		Erosion ☒																		
		COMPANY:		ACUREN		MATERIAL:		Carbon Steel ☒		Stainless Steel ☒																		
		TECHNICIAN:		Karl Bellen		ADDITIONAL INFORMATION:		SURFACE TEMP 40F & -5F																				
		ASSISTANT:																										
PORT HOLES - CORROSION  <table border="1" style="margin: 10px auto; font-size: 8px;"> <thead> <tr> <th rowspan="2">ELBOW DIAMETER</th> <th colspan="2">PORT HOLES</th> </tr> <tr> <th>EXTRADOS</th> <th>INTRADOS</th> </tr> </thead> <tbody> <tr> <td>>=12" <=20"</td> <td>A, C, E</td> <td>ONE (1)</td> </tr> <tr> <td>>=22" <=36"</td> <td>A, B, C, D, E</td> <td>ONE (1)</td> </tr> <tr> <td>>36"</td> <td>A, B, C, D, E</td> <td>ONE (1)</td> </tr> </tbody> </table> *SECTION 2 RECORD ALL THREE (3) PORT HOLE READINGS: INTRADOS AND BOTH TRANSITION ZONES FULL SCAN - EROSION 															ELBOW DIAMETER	PORT HOLES		EXTRADOS	INTRADOS	>=12" <=20"	A, C, E	ONE (1)	>=22" <=36"	A, B, C, D, E	ONE (1)	>36"	A, B, C, D, E	ONE (1)
ELBOW DIAMETER	PORT HOLES																											
	EXTRADOS	INTRADOS																										
>=12" <=20"	A, C, E	ONE (1)																										
>=22" <=36"	A, B, C, D, E	ONE (1)																										
>36"	A, B, C, D, E	ONE (1)																										
CIRCUIT	CML	SECTION	DIAM.	A	B	C	D	E	NORTH	SOUTH	EAST	WEST	TOP	BOTTOM	CENTER	HIGH	COMMENTS											
52-021K 1-2	1.01	1	8"									0.285				0.380	40F											
		2	8"											0.299		0.370	STAINLESS STEEL											
		3	8"														N/A FLANGE											
		4	8"														N/A FLANGE											
52-021K 1-2	1.05	1	6"								0.456					0.503	(-5F)											
		2	6"						0.450							0.474	CARBON STEEL											
		3	6"											0.393		0.433												
		4	6"							0.405						0.469												