



Conformal intervals are calibrated in-distribution but under-cover for unseen perturbations and small calibration sets


a

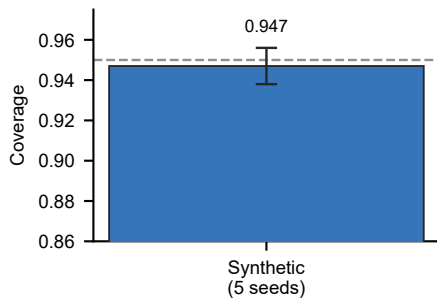


b

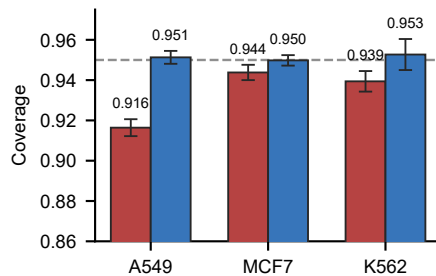


c

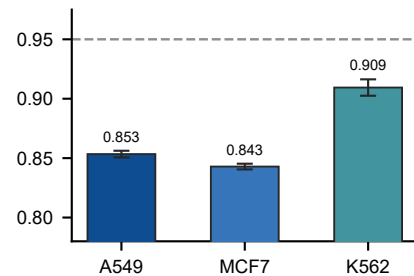


d

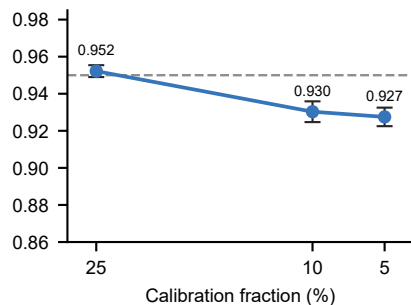

e

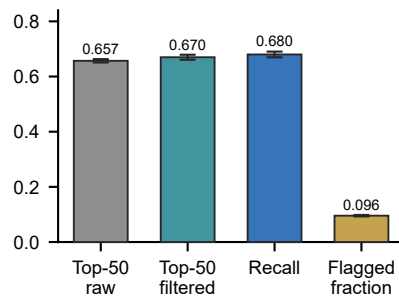

f

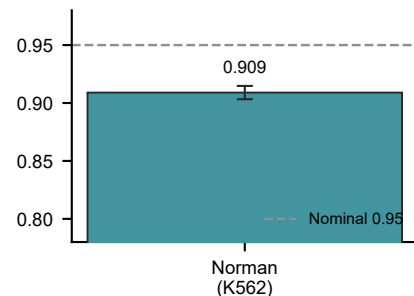

g

	Base predictor ablation (six sci-Plex3 conditions)		Precision@50
	Coverage	Median width	
delta	0.943	0.029	0.777
w1ot	0.948	0.056	0.717