Date 2026/7/3

MTROTD at GF MTR Hung Hom Building

Created with DIALux

Luminaire list

Φ_{total}	P_{total}	Luminous efficacy
1865149 lm	16029.4 W	116.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	7.2 W	630 lm	87.5 lm/W
124	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm	87.5 lm/W
56	PROS		L10-PS-EF-AP-D30-L1400-20W-4000K-270D-LB-R90	28.0 W	3528 lm	126.0 lm/W
8	PROS		L11-PS-KC-07-022A06000-15W-4000K-110D-BK-R90	15.0 W	1392 lm	92.8 lm/W
8	PROS		L12-PS-KC-07-021A12000-12W-4000K-35D-BK-R90	12.0 W	1188 lm	99.0 lm/W
153	PROS		L13-PS-EF-2835-L100-10W-4000K-120D-R90	1.0 W	175 lm	175.2 lm/W
98	PROS		L14-PS-A2835-120-S-L100-5W-3500K-120D-BK-R90	0.5 W	70 lm	140.2 lm/W
80	PROS		L14A-PS-A2835-120-S-L100-2.5W-3500K-120D-BK-R90	0.3 W	35 lm	140.2 lm/W
32	PROS		L15-PS-AC10032-BK-6.1W-4000K-36D-R90	6.1 W	707 lm	115.9 lm/W
10	PROS		L16-PS-AS-AC10937-WH-12W-4000K-WW-R90	12.0 W	869 lm	72.4 lm/W
312	PROS		L17-PS-EF-2835-120-L100-4.9W-4000K-105D-AL-R90	0.5 W	39 lm	79.7 lm/W
60	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	16.6 W	2500 lm	150.6 lm/W
307	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm	131.3 lm/W
17	PROS		L19-PS-KS-DL03-WH-14W-4000K-90D-R90	14.0 W	1330 lm	95.0 lm/W
11	PROS		L19A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm	95.0 lm/W
4	PROS		L21-PS-LPLR1.5FT-L2000-20W-4000K-120D-R90	40.0 W	3204 lm	80.1 lm/W
57	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	32.0 W	4205 lm	131.4 lm/W
1	PROS		L22A-PS-PNRC14-T5-2×8W-4000K-120D-WH-R90	16.0 W	2102 lm	131.4 lm/W

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	PROS	L23-PS-BJD7052-300-WH-6W-4000K-90D-GD-R90		6.0 W	550 lm	91.7 lm/W
4	PROS		L23A-PS-BJD7052-200-WH-6W-4000K-90D-GD-R90	6.0 W	550 lm	91.7 lm/W
2	PROS		L25-PS-LB-1512B-16.5W-4000K-120D-WH-R90	16.5 W	2503 lm	151.7 lm/W
3	PROS		L25A-PS-LB-1512B-8W-4000K-120D-WH-R90	8.0 W	1051 lm	131.4 lm/W
46	PROS		L26-PS-KLM-30Wm-4000K-ASYM15D-WH-R90	3.0 W	247 lm	82.3 lm/W
5	PROS		L27-PS-SY6118-LED-9-2×8W-4000K-120D-WH-R90	16.0 W	2102 lm	131.4 lm/W
29	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm	95.0 lm/W
23	PROS		L3-PS-KN-SL1001-WH-7.5W-4000K-36D-R90	7.5 W	630 lm	84.0 lm/W
346	PROS		L4-PS-EF-2835-120-L100-10W-4000K-105D-AL-R90	1.0 W	140 lm	140.2 lm/W
35	PROS		L5-PS-LF-FB-L1400-20W-4000K-120D-YL-R90	28.0 W	2243 lm	80.1 lm/W
72	PROS		L6-PS-EF-NA1826ST-L100-10W-4000K-120D-R90	1.0 W	35 lm	35.0 lm/W
8	PROS		L7D-PS-EF-AP-D30-L750-17W-4000K-270D-BL-R90	12.8 W	1607 lm	126.0 lm/W
17	PROS		L7E-PS-EF-AP-D30-L1450-17W-4000K-270D-BL-R90	24.7 W	3106 lm	126.0 lm/W
16	PROS		L8-PS-LF-FB-L1000-21W-4000K-120D-GR-R90	21.0 W	1682 lm	80.1 lm/W
68	PROS		L9-PS-LF-IPLS2.5-S-L1960-10W-4000K-120D-BK-R90	19.6 W	1570 lm	80.1 lm/W

Building 1 · Storey 1 (Light scene 1)

Room list

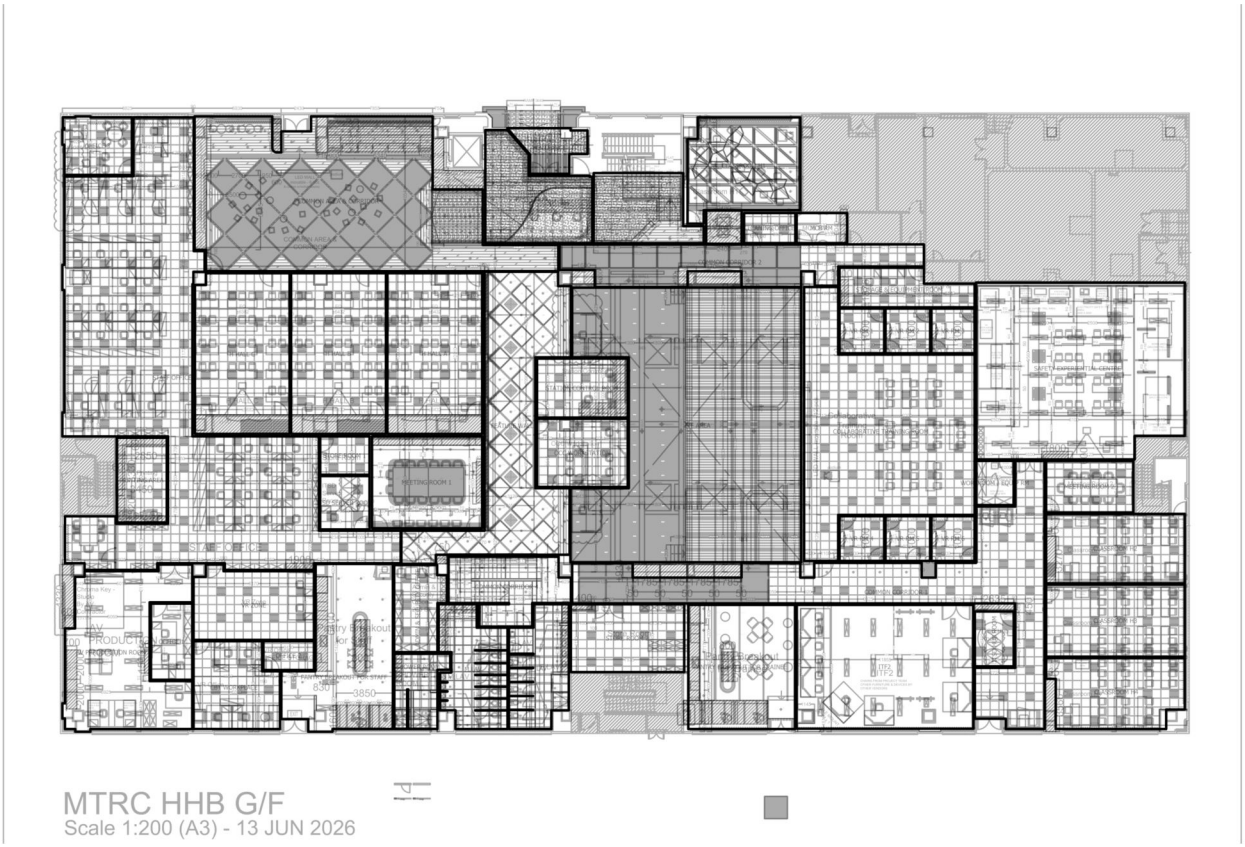

Building 1 · Storey 1 (Light scene 1)

Room list

ADMIN & SECURITY OFFICE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
96.0 W	18.55 m²	5.18 W/m² = 1.42 W/m²/100 lx (Room)	363 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
6	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

AV PRRODUCTION ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
480.0 W	75.52 m²	6.36 W/m² = 1.35 W/m²/100 lx (Room)	472 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
15	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	32.0 W	4205 lm

CBT WORKPLACE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
128.0 W	32.43 m²	3.95 W/m² = 1.22 W/m²/100 lx (Room)	323 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
8	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

CLASSROOM H1

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
386.4 W	48.09 m²	8.03 W/m² = 1.80 W/m²/100 lx (Room)	446 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
7	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm
16	PROS		L8-PS-LF-FB-L1000-21W-4000K-120D-GR-R90	21.0 W	1682 lm

CLASSROOM H2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
240.0 W	44.30 m²	5.42 W/m² = 1.26 W/m²/100 lx (Room)	429 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
15	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

CLASSROOM H3

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
240.0 W	45.99 m²	5.22 W/m² = 1.23 W/m²/100 lx (Room)	423 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
15	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

CLASSROOM H4

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
224.0 W	41.36 m²	5.42 W/m² = 1.27 W/m²/100 lx (Room)	426 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
14	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

CLEANING OFFICE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
32.0 W	7.09 m²	4.51 W/m² = 1.95 W/m²/100 lx (Room)	231 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
2	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

COLLABORATIVE TRAINING ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
624.0 W	143.58 m²	4.35 W/m² = 1.02 W/m²/100 lx (Room)	427 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
39	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

COMMON AREA & CORRIDOR

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
1355.6 W	192.79 m²	7.03 W/m² = 1.63 W/m²/100 lx (Room)	432 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
33	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm
46	PROS		L26-PS-KLM-30Wm-4000K-ASYM15D-WH-R90	3.0 W	247 lm
35	PROS		L5-PS-LF-FB-L1400-20W-4000K-120D-YL-R90	28.0 W	2243 lm

COMMON CORRIDOR 1

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
613.6 W	129.57 m²	4.74 W/m² = 1.92 W/m²/100 lx (Room)	247 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
8	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm
20	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm
3	PROS		L7D-PS-EF-AP-D30-L750-17W-4000K-270D-BL-R90	12.8 W	1607 lm
8	PROS		L7E-PS-EF-AP-D30-L1450-17W-4000K-270D-BL-R90	24.7 W	3106 lm

Building 1 · Storey 1 (Light scene 1)

Room list

COMMON CORRIDOR 2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
350.3 W	55.56 m²	6.31 W/m² = 3.42 W/m²/100 lx (Room)	185 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm
5	PROS		L7D-PS-EF-AP-D30-L750-17W-4000K-270D-BL-R90	12.8 W	1607 lm
9	PROS		L7E-PS-EF-AP-D30-L1450-17W-4000K-270D-BL-R90	24.7 W	3106 lm

COMMON CORRIDOR 3

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
122.4 W	30.45 m²	4.02 W/m² = 1.54 W/m²/100 lx (Room)	261 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
17	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm

COMMON CORRIDOR 4

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
93.6 W	30.47 m²	3.07 W/m² = 1.54 W/m²/100 lx (Room)	199 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
13	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm

Building 1 · Storey 1 (Light scene 1)

Room list

ENTRANCE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
99.0 W	11.63 m²	8.51 W/m² = 2.83 W/m²/100 lx (Room)	301 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
11	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm

F.LAV

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
169.0 W	30.03 m²	5.63 W/m² = 2.31 W/m²/100 lx (Room)	244 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
5	PROS		L19-PS-KS-DL03-WH-14W-4000K-90D-R90	14.0 W	1330 lm
5	PROS		L19A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm
6	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm

FEATURE WALL

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
697.2 W	100.67 m²	6.93 W/m² = 1.94 W/m²/100 lx (Room)	357 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
32	PROS		L15-PS-AC10032-BK-6.1W-4000K-36D-R90	6.1 W	707 lm
312	PROS		L17-PS-EF-2835-120-L100-4.9W-4000K-105D-AL-R90	0.5 W	39 lm
346	PROS		L4-PS-EF-2835-120-L100-10W-4000K-105D-AL-R90	1.0 W	140 lm

Building 1 · Storey 1 (Light scene 1)

Room list

H HALL A

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
353.6 W	70.09 m²	5.05 W/m² = 0.99 W/m²/100 lx (Room)	510 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
3	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	7.2 W	630 lm
20	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	16.6 W	2500 lm

H HALL B

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
353.6 W	70.12 m²	5.04 W/m² = 0.99 W/m²/100 lx (Room)	511 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
3	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	7.2 W	630 lm
20	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	16.6 W	2500 lm

H HALL C

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
353.6 W	69.44 m²	5.09 W/m² = 0.99 W/m²/100 lx (Room)	513 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
3	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	7.2 W	630 lm
20	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	16.6 W	2500 lm

Building 1 · Storey 1 (Light scene 1)

Room list

ITF AREA

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
2900.8 W	255.94 m²	11.33 W/m² = 2.31 W/m²/100 lx (Room)	492 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
56	PROS		L10-PS-EF-AP-D30-L1400-20W-4000K-270D-LB-R90	28.0 W	3528 lm
68	PROS		L9-PS-LF-IPLS2.5-S-L1960-10W-4000K-120D-BK-R90	19.6 W	1570 lm

ITF2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
560.0 W	100.83 m²	5.55 W/m² = 1.03 W/m²/100 lx (Room)	542 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
17	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	32.0 W	4205 lm
1	PROS		L22A-PS-PNRC14-T5-2×8W-4000K-120D-WH-R90	16.0 W	2102 lm

ITSD HUB ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	9.81 m²	6.52 W/m² = 1.88 W/m²/100 lx (Room)	348 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

ITSD SERVER ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	12.13 m²	5.28 W/m² = 1.64 W/m²/100 lx (Room)	321 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

M.LAV

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
222.0 W	33.20 m²	6.69 W/m² = 2.40 W/m²/100 lx (Room)	279 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
12	PROS		L19-PS-KS-DL03-WH-14W-4000K-90D-R90	14.0 W	1330 lm
6	PROS		L19A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm

MCB RM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
57.0 W	7.00 m²	8.15 W/m² = 2.54 W/m²/100 lx (Room)	321 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
2	PROS		L25-PS-LB-1512B-16.5W-4000K-120D-WH-R90	16.5 W	2503 lm
3	PROS		L25A-PS-LB-1512B-8W-4000K-120D-WH-R90	8.0 W	1051 lm

Building 1 · Storey 1 (Light scene 1)

Room list

MEETING ROOM 1

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
413.8 W	46.56 m²	8.89 W/m² = 2.44 W/m²/100 lx (Room)	365 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
14	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm
153	PROS		L13-PS-EF-2835-L100-10W-4000K-120D-R90	1.0 W	175 lm
4	PROS		L21-PS-LPLR1.5FT-L2000-20W-4000K-120D-R90	40.0 W	3204 lm

MEETING ROOM 2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
96.0 W	20.71 m²	4.64 W/m² = 1.40 W/m²/100 lx (Room)	331 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
6	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

OCC WORKSTATION

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
144.0 W	28.39 m²	5.07 W/m² = 1.37 W/m²/100 lx (Room)	371 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
9	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

OFFICE 1

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
96.0 W	14.46 m²	6.64 W/m² = 1.54 W/m²/100 lx (Room)	431 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
3	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	32.0 W	4205 lm

OFFICE 2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
32.0 W	6.69 m²	4.78 W/m² = 2.03 W/m²/100 lx (Room)	236 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
2	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

OFFICE 3

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
80.0 W	18.21 m²	4.39 W/m² = 1.47 W/m²/100 lx (Room)	298 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
5	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

PANTRY BREAKOUT FOR STAFF

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
230.5 W	66.96 m²	3.44 W/m² = 1.23 W/m²/100 lx (Room)	279 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
98	PROS		L14-PS-A2835-120-S-L100-5W-3500K-120D-BK-R90	0.5 W	70 lm
2	PROS		L23-PS-BJD7052-300-WH-6W-4000K-90D-GD-R90	6.0 W	550 lm
2	PROS		L23A-PS-BJD7052-200-WH-6W-4000K-90D-GD-R90	6.0 W	550 lm
21	PROS		L3-PS-KN-SL1001-WH-7.5W-4000K-36D-R90	7.5 W	630 lm

PANTRY BREAKOUT FOR TRAINEE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
328.8 W	61.01 m²	5.39 W/m² = 1.33 W/m²/100 lx (Room)	405 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
9	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm
8	PROS		L11-PS-KC-07-022A06000-15W-4000K-110D-BK-R90	15.0 W	1392 lm
8	PROS		L12-PS-KC-07-021A12000-12W-4000K-35D-BK-R90	12.0 W	1188 lm
80	PROS		L14A-PS-A2835-120-S-L100-2.5W-3500K-120D-BK-R90	0.3 W	35 lm
2	PROS		L23-PS-BJD7052-300-WH-6W-4000K-90D-GD-R90	6.0 W	550 lm
2	PROS		L23A-PS-BJD7052-200-WH-6W-4000K-90D-GD-R90	6.0 W	550 lm

Building 1 · Storey 1 (Light scene 1)

Room list

PRINTING AREA

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	19.41 m²	3.30 W/m² = 1.35 W/m²/100 lx (Room)	244 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

RECEPTION

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
328.8 W	41.07 m²	8.00 W/m² = 2.43 W/m²/100 lx (Room)	329 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
19	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm
10	PROS		L16-PS-AS-AC10937-WH-12W-4000K-WW-R90	12.0 W	869 lm
72	PROS		L6-PS-EF-NA1826ST-L100-10W-4000K-120D-R90	1.0 W	35 lm

SAFETY EXPERIENTIAL CENTRE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
784.0 W	164.60 m²	4.76 W/m² = 1.00 W/m²/100 lx (Room)	476 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
22	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	32.0 W	4205 lm
5	PROS		L27-PS-SY6118-LED-9-2×8W-4000K-120D-WH-R90	16.0 W	2102 lm

Building 1 · Storey 1 (Light scene 1)

Room list

SERVER

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
28.8 W	5.40 m²	5.33 W/m² = 1.85 W/m²/100 lx (Room)	288 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	7.2 W	630 lm

SHOWER ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
108.0 W	15.73 m²	6.87 W/m² = 2.75 W/m²/100 lx (Room)	250 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
12	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	9.0 W	855 lm

STAFF OFFICE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
1408.0 W	297.57 m²	4.73 W/m² = 1.06 W/m²/100 lx (Room)	445 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
88	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

STATION CONTROL ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
96.0 W	24.61 m²	3.90 W/m² = 1.28 W/m²/100 lx (Room)	304 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
6	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

STORAGE & EQUIPMENT ROOM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
128.0 W	20.86 m²	6.14 W/m² = 1.58 W/m²/100 lx (Room)	388 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
8	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

STORE ROOM 1

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	8.71 m²	7.35 W/m² = 2.02 W/m²/100 lx (Room)	364 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

STORE ROOM 2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
192.0 W	35.37 m²	5.43 W/m² = 1.31 W/m²/100 lx (Room)	416 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
12	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

VR RM 1

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	9.18 m²	6.97 W/m² = 2.53 W/m²/100 lx (Room)	276 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

VR RM 2

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	9.18 m²	6.97 W/m² = 2.54 W/m²/100 lx (Room)	275 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

VR RM 3

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	8.87 m²	7.22 W/m² = 2.59 W/m²/100 lx (Room)	279 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

VR RM 4

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	9.18 m²	6.97 W/m² = 2.53 W/m²/100 lx (Room)	276 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

VR RM 5

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	9.18 m²	6.97 W/m² = 2.51 W/m²/100 lx (Room)	278 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

Building 1 · Storey 1 (Light scene 1)

Room list

VR RM 6

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
64.0 W	8.87 m²	7.22 W/m² = 2.60 W/m²/100 lx (Room)	278 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

VR ZONE

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
128.0 W	38.30 m²	3.34 W/m² = 1.36 W/m²/100 lx (Room)	246 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
8	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	16.0 W	2100 lm

WORKROOM / EQUIP RM

P_{total}	A_{Room}	Lighting power density	$\bar{E}_{perpendicular\ (Working\ plane)}$
15.0 W	7.66 m²	1.96 W/m² = 1.34 W/m²/100 lx (Room)	146 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{Luminaire}$
2	PROS		L3-PS-KN-SL1001-WH-7.5W-4000K-36D-R90	7.5 W	630 lm

Building 1 · Storey 1 (Light scene 1)

Calculation objects

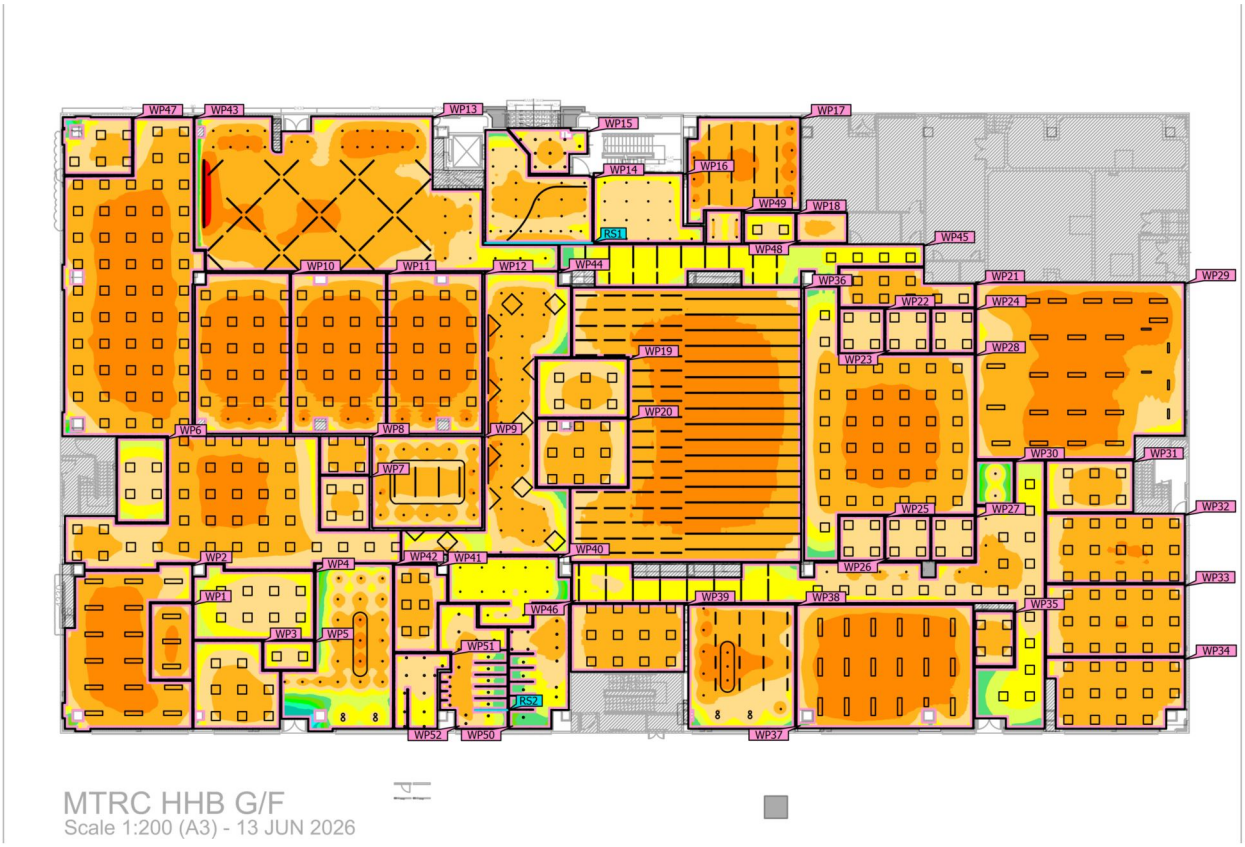



Building 1 · Storey 1 (Light scene 1)

Calculation objects

Working planes

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (OFFICE 1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	431 lx	296 lx	528 lx	0.69	0.56	WP1
Working plane (AV PRRODUCTION ROOM) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	472 lx	63.8 lx	587 lx	0.14	0.11	WP2
Working plane (CBT WORKPLACE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	323 lx	97.1 lx	430 lx	0.30	0.23	WP3
Working plane (VR ZONE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	246 lx	125 lx	324 lx	0.51	0.39	WP4
Working plane (OFFICE 2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	236 lx	193 lx	266 lx	0.82	0.73	WP5
Working plane (PRINTING AREA) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	244 lx	135 lx	335 lx	0.55	0.40	WP6
Working plane (ITSD SERVER ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	321 lx	251 lx	367 lx	0.78	0.68	WP7
Working plane (STORE ROOM 1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	364 lx	303 lx	400 lx	0.83	0.76	WP8
Working plane (MEETING ROOM 1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	365 lx	173 lx	516 lx	0.47	0.34	WP9
Working plane (H HALL C) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	513 lx	64.6 lx	640 lx	0.13	0.10	WP10
Working plane (H HALL B) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	511 lx	171 lx	637 lx	0.33	0.27	WP11

Building 1 · Storey 1 (Light scene 1)

Calculation objects

Working plane (H HALL A) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	510 lx	157 lx	623 lx	0.31	0.25	WP12
Working plane (COMMON AREA & CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	432 lx	35.8 lx	1942 lx	0.083	0.018	WP13
Working plane (RECEPTION) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	329 lx	78.7 lx	454 lx	0.24	0.17	WP14
Working plane (ENTRANCE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	301 lx	95.1 lx	381 lx	0.32	0.25	WP15
Working plane (COMMON CORRIDOR 3) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	261 lx	101 lx	314 lx	0.39	0.32	WP16
Working plane (CLASSROOM H1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	446 lx	89.9 lx	601 lx	0.20	0.15	WP17
Working plane (CLEANING OFFICE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	231 lx	187 lx	262 lx	0.81	0.71	WP18
Working plane (STATION CONTROL ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	304 lx	153 lx	390 lx	0.50	0.39	WP19
Working plane (OCC WORKSTATION) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	371 lx	216 lx	468 lx	0.58	0.46	WP20
Working plane (STORAGE & EQUIPMENT ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	388 lx	232 lx	492 lx	0.60	0.47	WP21
Working plane (VR RM 1) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	276 lx	241 lx	307 lx	0.87	0.79	WP22
Working plane (VR RM 2) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	275 lx	238 lx	303 lx	0.87	0.79	WP23

Building 1 · Storey 1 (Light scene 1)

Calculation objects

Working plane (VR RM 3) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	279 lx	245 lx	307 lx	0.88	0.80	WP24
Working plane (VR RM 4) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	276 lx	240 lx	306 lx	0.87	0.78	WP25
Working plane (VR RM 5) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	278 lx	239 lx	311 lx	0.86	0.77	WP26
Working plane (VR RM 6) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	278 lx	239 lx	311 lx	0.86	0.77	WP27
Working plane (COLLABORATIVE TRAINING ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	427 lx	95.4 lx	543 lx	0.22	0.18	WP28
Working plane (SAFETY EXPERIENTIAL CENTRE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	476 lx	170 lx	702 lx	0.36	0.24	WP29
Working plane (WORKROOM / EQUIP RM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	146 lx	21.7 lx	330 lx	0.15	0.066	WP30
Working plane (MEETING ROOM 2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	331 lx	197 lx	403 lx	0.60	0.49	WP31
Working plane (CLASSROOM H2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	429 lx	230 lx	511 lx	0.54	0.45	WP32
Working plane (CLASSROOM H3) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	423 lx	224 lx	506 lx	0.53	0.44	WP33
Working plane (CLASSROOM H4) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	426 lx	220 lx	500 lx	0.52	0.44	WP34
Working plane (ITSD HUB ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	348 lx	283 lx	390 lx	0.81	0.73	WP35

Building 1 · Storey 1 (Light scene 1)

Calculation objects

Working plane (ITF AREA) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	492 lx	283 lx	607 lx	0.58	0.47	WP36
Working plane (ITF2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	542 lx	39.1 lx	712 lx	0.072	0.055	WP37
Working plane (PANTRY BREAKOUT FOR TRAINEE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	405 lx	65.0 lx	975 lx	0.16	0.067	WP38
Working plane (STORE ROOM 2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	416 lx	244 lx	496 lx	0.59	0.49	WP39
Working plane (COMMON CORRIDOR 4) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	199 lx	29.4 lx	271 lx	0.15	0.11	WP40
Working plane (ADMIN & SECURITY OFFICE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	363 lx	226 lx	469 lx	0.62	0.48	WP41
Working plane (PANTRY BREAKOUT FOR STAFF) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	279 lx	11.7 lx	606 lx	0.042	0.019	WP42
Working plane (STAFF OFFICE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	445 lx	29.1 lx	559 lx	0.065	0.052	WP43
Working plane (FEATURE WALL) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	357 lx	46.6 lx	636 lx	0.13	0.073	WP44
Working plane (COMMON CORRIDOR 2) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	185 lx	75.2 lx	234 lx	0.41	0.32	WP45
Working plane (COMMON CORRIDOR 1) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	247 lx	80.9 lx	460 lx	0.33	0.18	WP46
Working plane (OFFICE 3) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	298 lx	30.1 lx	383 lx	0.10	0.079	WP47

Building 1 · Storey 1 (Light scene 1)

Calculation objects

Working plane (MCB RM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	321 lx	216 lx	392 lx	0.67	0.55	WP48
Working plane (SERVER) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	288 lx	155 lx	354 lx	0.54	0.44	WP49
Working plane (F.LAV) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	244 lx	57.7 lx	410 lx	0.24	0.14	WP50
Working plane (SHOWER ROOM) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	250 lx	144 lx	338 lx	0.58	0.43	WP51
Working plane (M.LAV) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	279 lx	75.0 lx	484 lx	0.27	0.15	WP52

Surface result objects

Properties	Ø	min	max	U_o (g_1)	g_2	Index
Surface result object 1 ( ) Perpendicular illuminance (adaptive) Height: 1.400 m	331 lx	65.1 lx	635 lx	0.20	0.10	RS1
Surface result object 1 ( ) Luminance Height: 1.400 m	52.7 cd/m²	10.4 cd/m²	101 cd/m²	0.20	0.10	RS1
Surface result object 2 ( ) Perpendicular illuminance (adaptive) Height: 1.200 m	129 lx	39.4 lx	490 lx	0.31	0.080	RS2
Surface result object 2 ( ) Luminance Height: 1.200 m	20.5 cd/m²	6.27 cd/m²	78.0 cd/m²	0.31	0.080	RS2

Building 1 · Storey 1 · ADMIN & SECURITY OFFICE (Light scene 1)

Summary

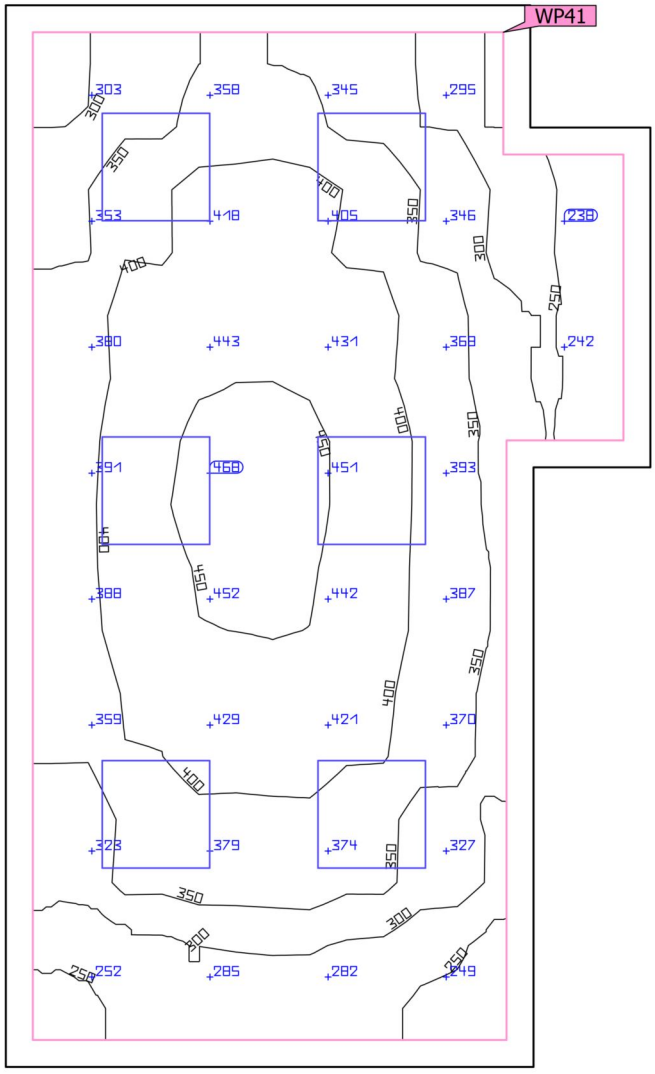

Ground area	18.55 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · ADMIN & SECURITY OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	363 lx	WP41
	U_o (g_1)	0.62	WP41
	Lighting power density	6.08 W/m²	
		1.67 W/m²/100 lx	
Energy estimation(2)	Consumption	238 kWh/a	
Room	Lighting power density	5.18 W/m²	
		1.42 W/m²/100 lx	

(1) Based on a rectangular space of 3.585 m x 5.905 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · ADMIN & SECURITY OFFICE (Light scene 1)

Working plane (ADMIN & SECURITY OFFICE)



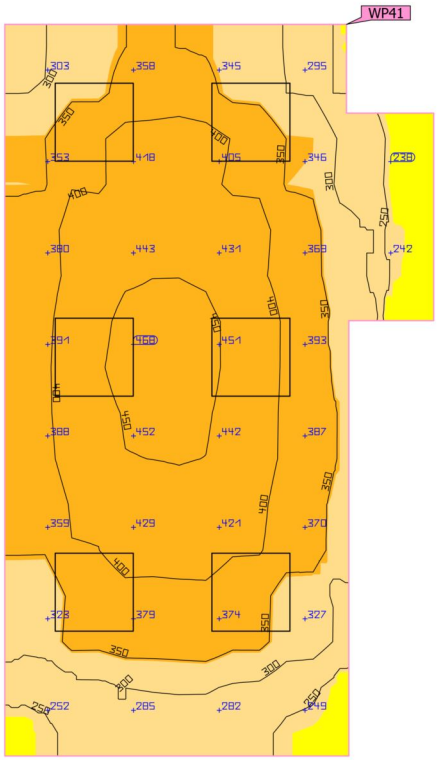



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (ADMIN & SECURITY OFFICE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	363 lx	226 lx	469 lx	0.62	0.48	WP41

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · AV PRRODUCTION ROOM (Light scene 1)

Summary

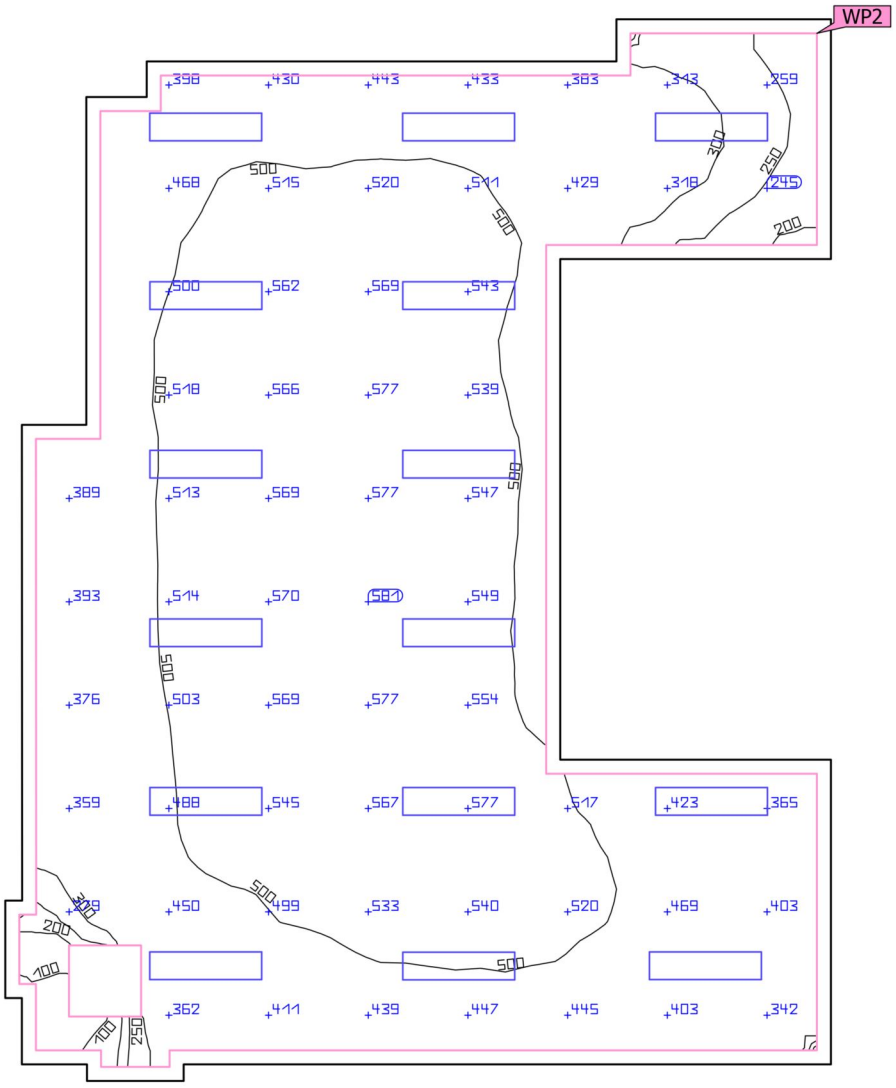

Ground area	75.52 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · AV PRRODUCTION ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	472 lx	WP2
	U_o (g_1)	0.14	WP2
	Lighting power density	6.99 W/m²	
		1.48 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	23	
Energy estimation(2)	Consumption	1188 kWh/a	
Room	Lighting power density	6.36 W/m²	
		1.35 W/m²/100 lx	

(1) Based on a rectangular space of 8.815 m x 11.335 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
15	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	23	32.0 W	4205 lm	131.4 lm/W

Building 1 · Storey 1 · AV PRRODUCTION ROOM (Light scene 1)

Working plane (AV PRRODUCTION ROOM)



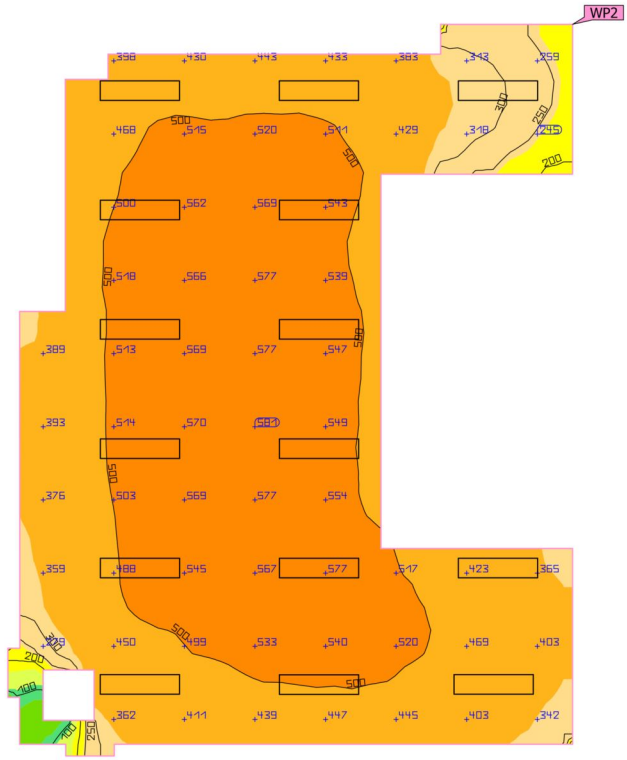



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (AV PRRODUCTION ROOM) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	472 lx	63.8 lx	587 lx	0.14	0.11	WP2

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · CBT WORKPLACE (Light scene 1)

Summary

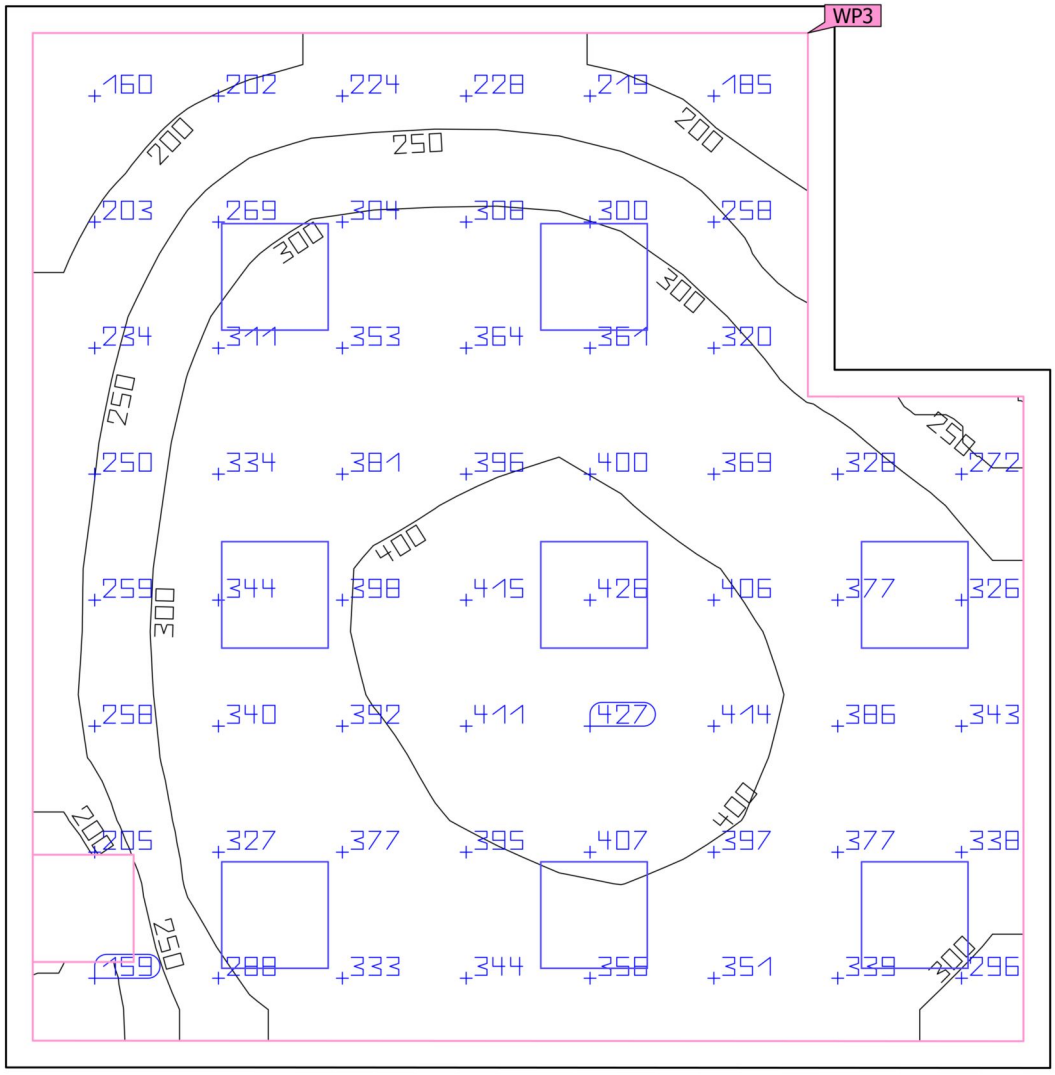

Ground area	32.43 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · CBT WORKPLACE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	323 lx	WP3
	U_o (g_1)	0.30	WP3
	Lighting power density	4.42 W/m²	
		1.37 W/m²/100 lx	
Energy estimation(2)	Consumption	317 kWh/a	
Room	Lighting power density	3.95 W/m²	
		1.22 W/m²/100 lx	

(1) Based on a rectangular space of 5.958 m x 5.860 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · CBT WORKPLACE (Light scene 1)

Working plane (CBT WORKPLACE)



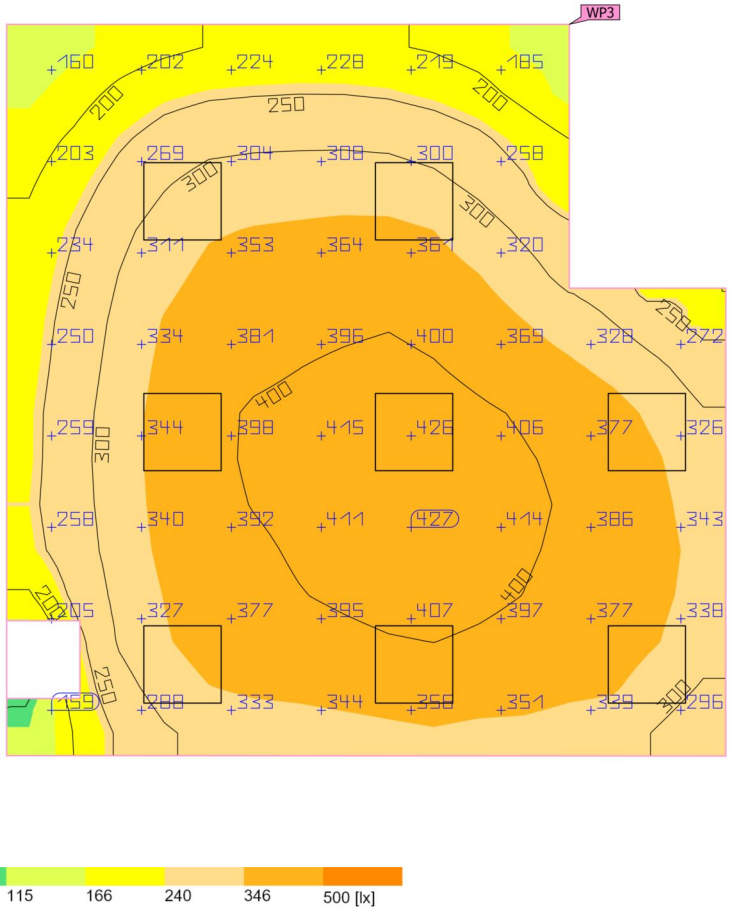

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (CBT WORKPLACE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	323 lx	97.1 lx	430 lx	0.30	0.23	WP3

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · CLASSROOM H1 (Light scene 1)

Summary

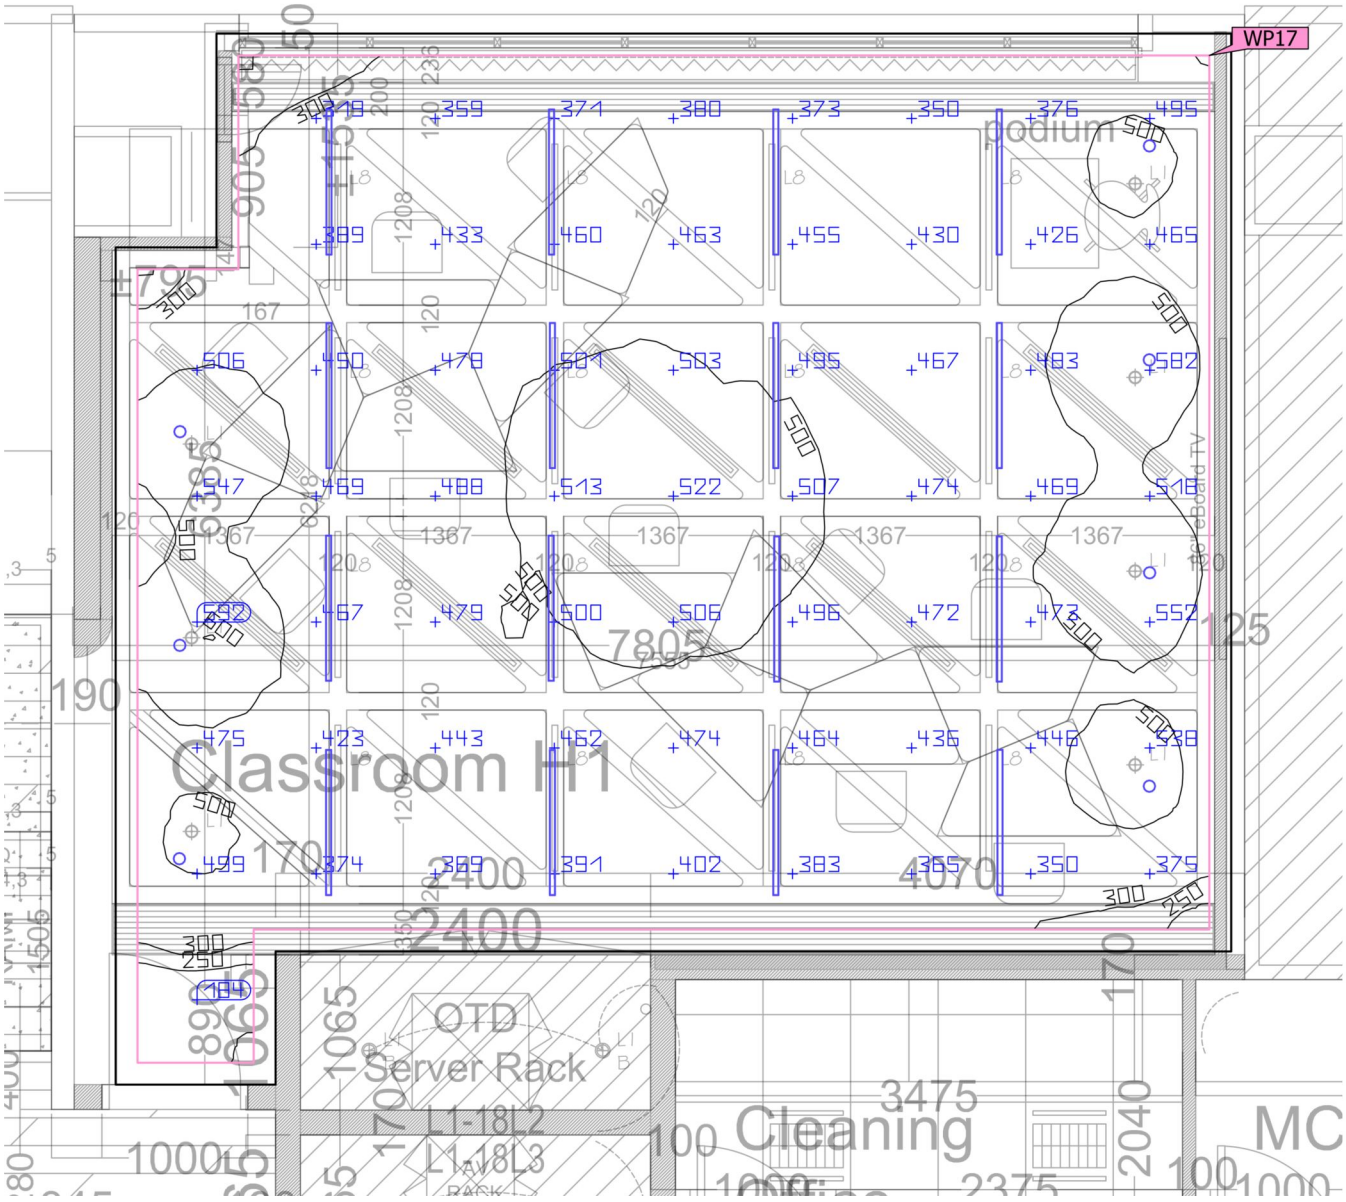

Ground area	48.09 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · CLASSROOM H1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	446 lx	WP17
	U_o (g_1)	0.20	WP17
	Lighting power density	8.84 W/m²	
		1.98 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	27	
Energy estimation(2)	Consumption	956 kWh/a	
Room	Lighting power density	8.03 W/m²	
		1.80 W/m²/100 lx	

(1) Based on a rectangular space of 7.206 m x 7.644 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
7	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W
16	PROS		L8-PS-LF-FB-L1000-21W-4000K-120D-GR-R90	27	21.0 W	1682 lm	80.1 lm/W

Building 1 · Storey 1 · CLASSROOM H1 (Light scene 1)

Working plane (CLASSROOM H1)



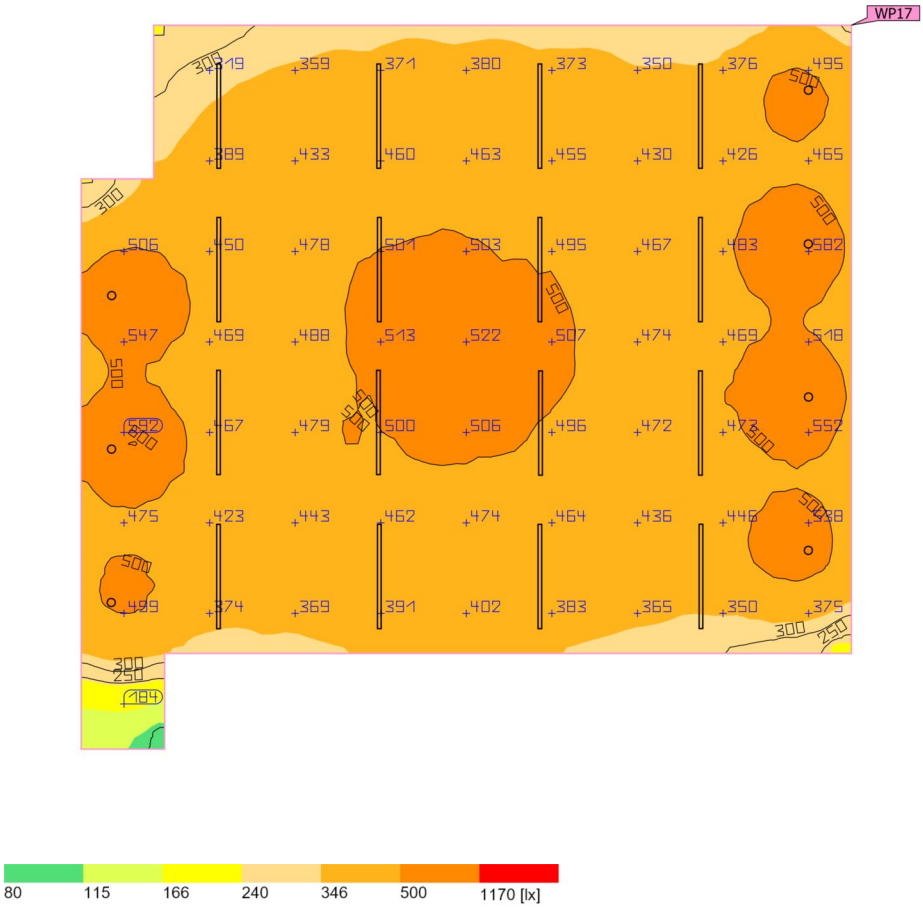

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (CLASSROOM H1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	446 lx	89.9 lx	601 lx	0.20	0.15	WP17

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · CLASSROOM H2 (Light scene 1)

Summary

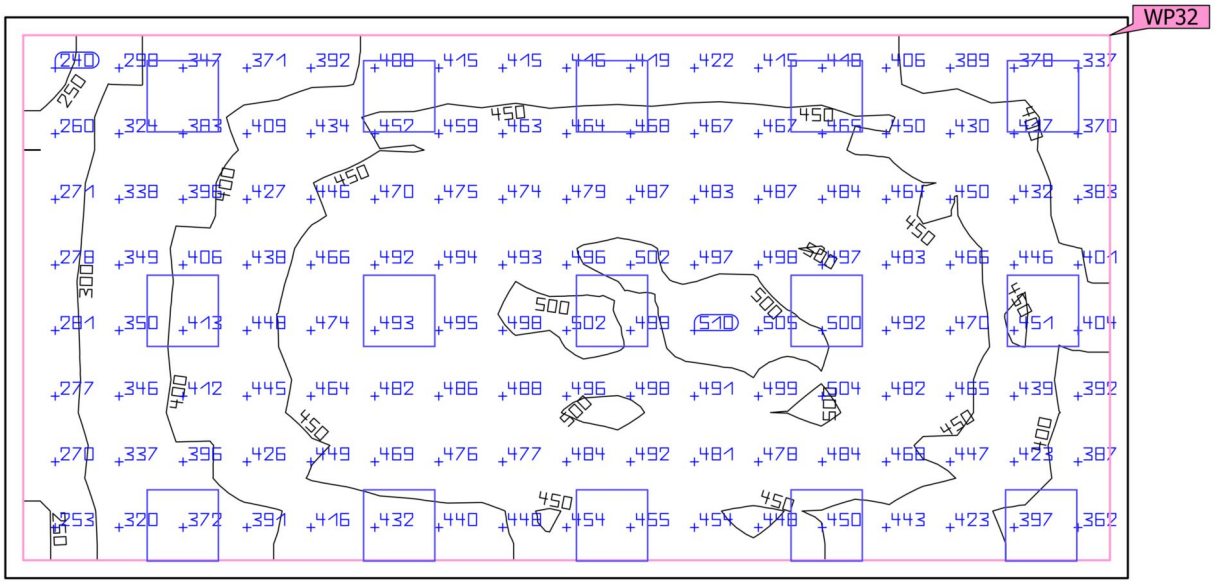

Ground area	44.30 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · CLASSROOM H2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	429 lx	WP32
	U_o (g_1)	0.54	WP32
	Lighting power density	5.98 W/m²	
		1.39 W/m²/100 lx	
Energy estimation(2)	Consumption	594 kWh/a	
Room	Lighting power density	5.42 W/m²	
		1.26 W/m²/100 lx	

(1) Based on a rectangular space of 4.705 m x 9.415 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
15	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · CLASSROOM H2 (Light scene 1)

Working plane (CLASSROOM H2)

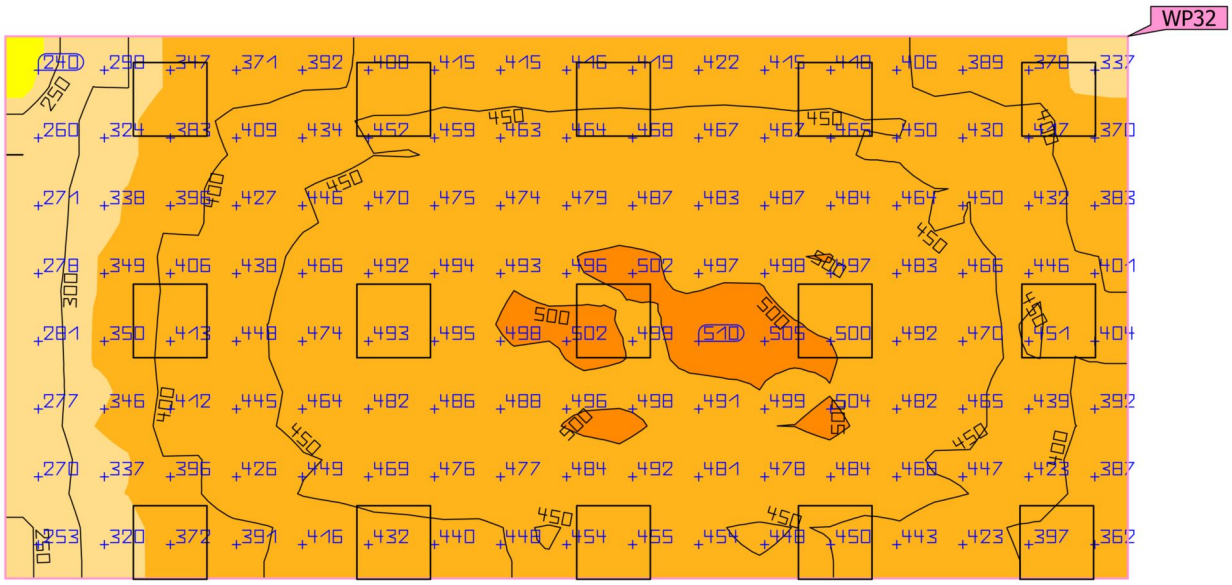

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (CLASSROOM H2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	429 lx	230 lx	511 lx	0.54	0.45	WP32

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · CLASSROOM H3 (Light scene 1)

Summary

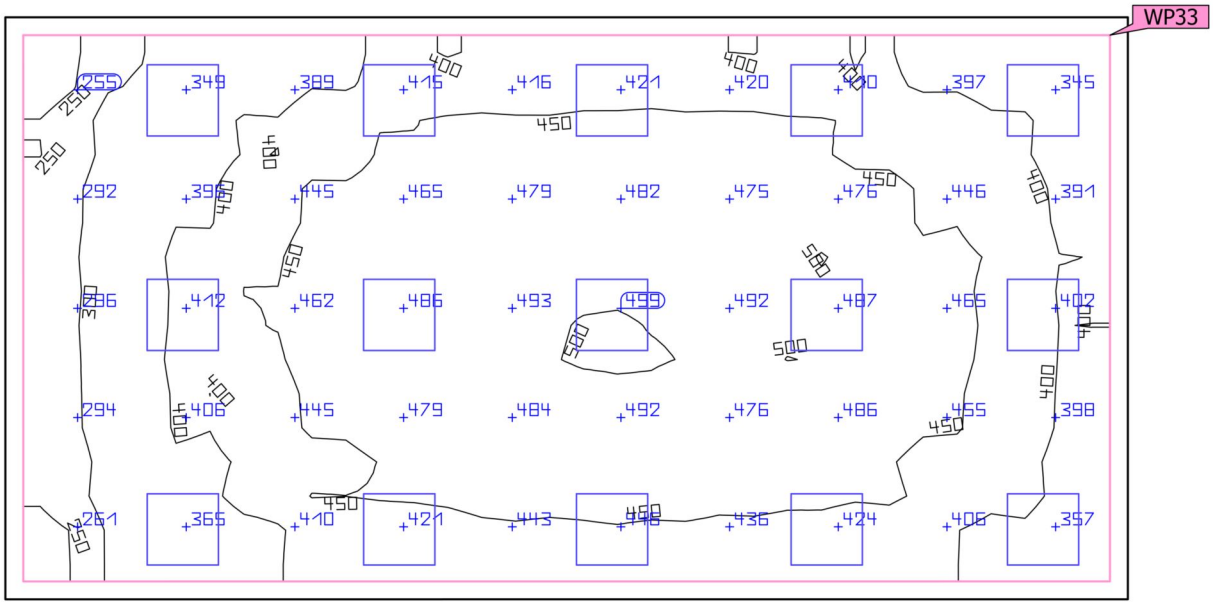

Ground area	45.99 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · CLASSROOM H3 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	423 lx	WP33
	U_o (g_1)	0.53	WP33
	Lighting power density	5.74 W/m²	
		1.36 W/m²/100 lx	
Energy estimation(2)	Consumption	594 kWh/a	
Room	Lighting power density	5.22 W/m²	
		1.23 W/m²/100 lx	

(1) Based on a rectangular space of 4.885 m x 9.415 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
15	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · CLASSROOM H3 (Light scene 1)

Working plane (CLASSROOM H3)

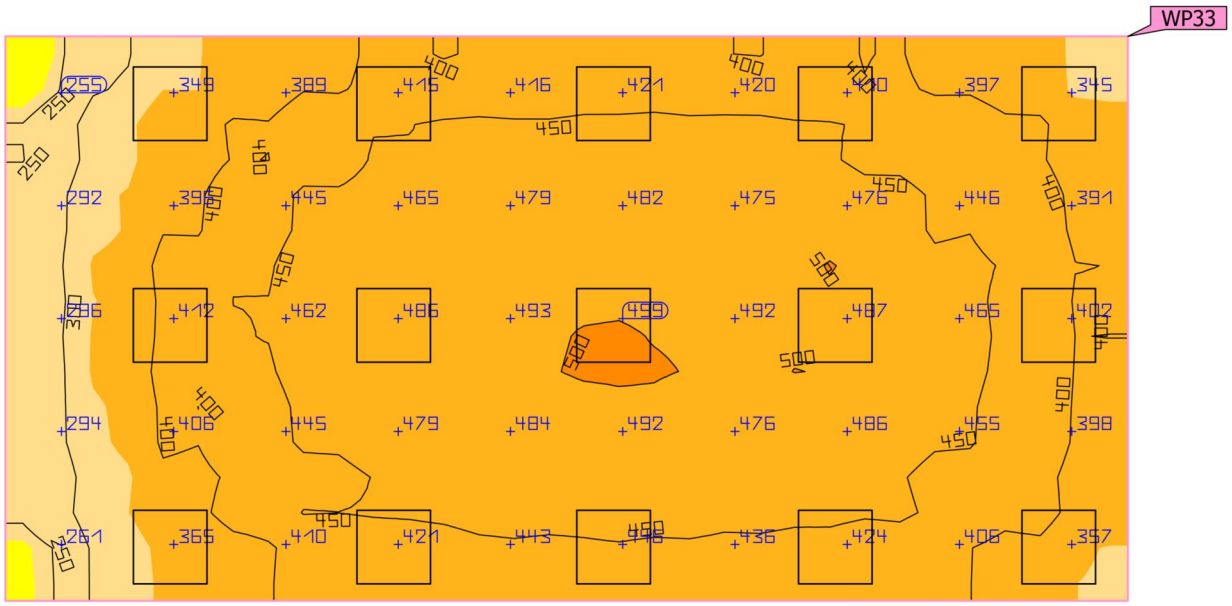

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (CLASSROOM H3) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	423 lx	224 lx	506 lx	0.53	0.44	WP33

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · CLASSROOM H4 (Light scene 1)

Summary

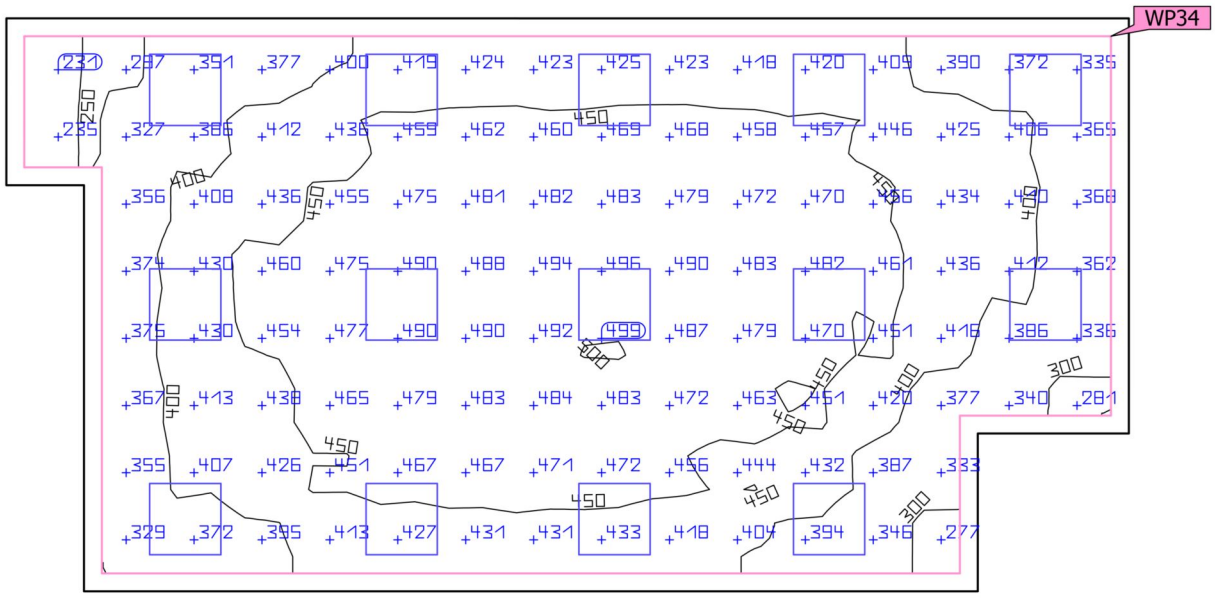

Ground area	41.36 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · CLASSROOM H4 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	426 lx	WP34
	U_o (g_1)	0.52	WP34
	Lighting power density	6.02 W/m²	
		1.41 W/m²/100 lx	
Energy estimation(2)	Consumption	554 kWh/a	
Room	Lighting power density	5.42 W/m²	
		1.27 W/m²/100 lx	

(1) Based on a rectangular space of 9.415 m x 4.806 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
14	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · CLASSROOM H4 (Light scene 1)

Working plane (CLASSROOM H4)

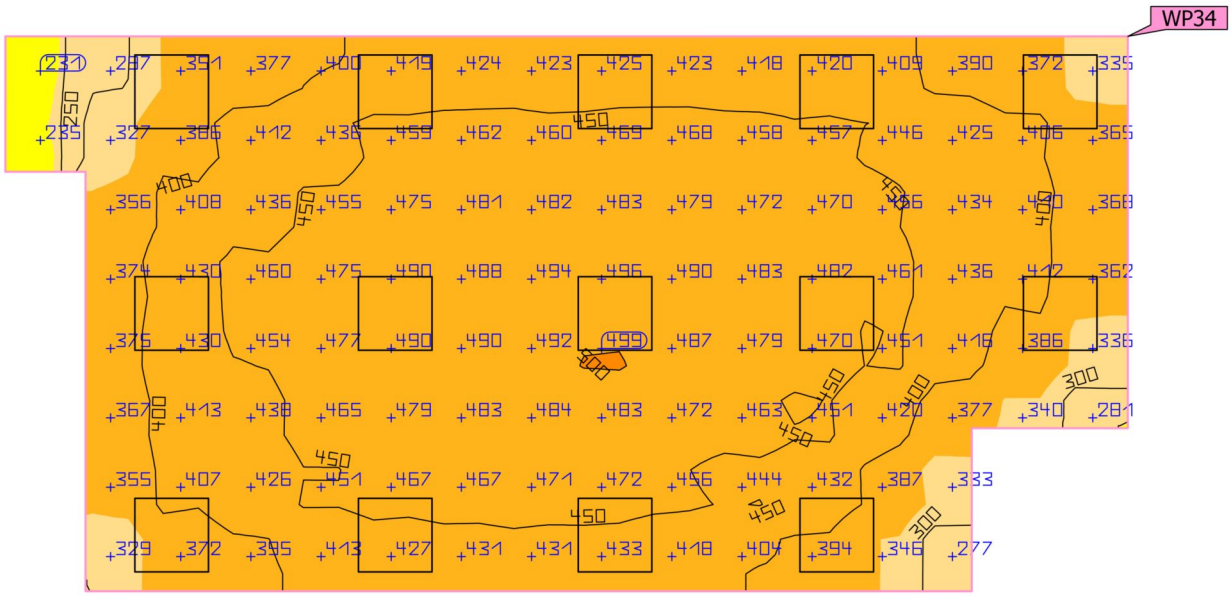

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (CLASSROOM H4) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	426 lx	220 lx	500 lx	0.52	0.44	WP34

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · CLEANING OFFICE (Light scene 1)

Summary

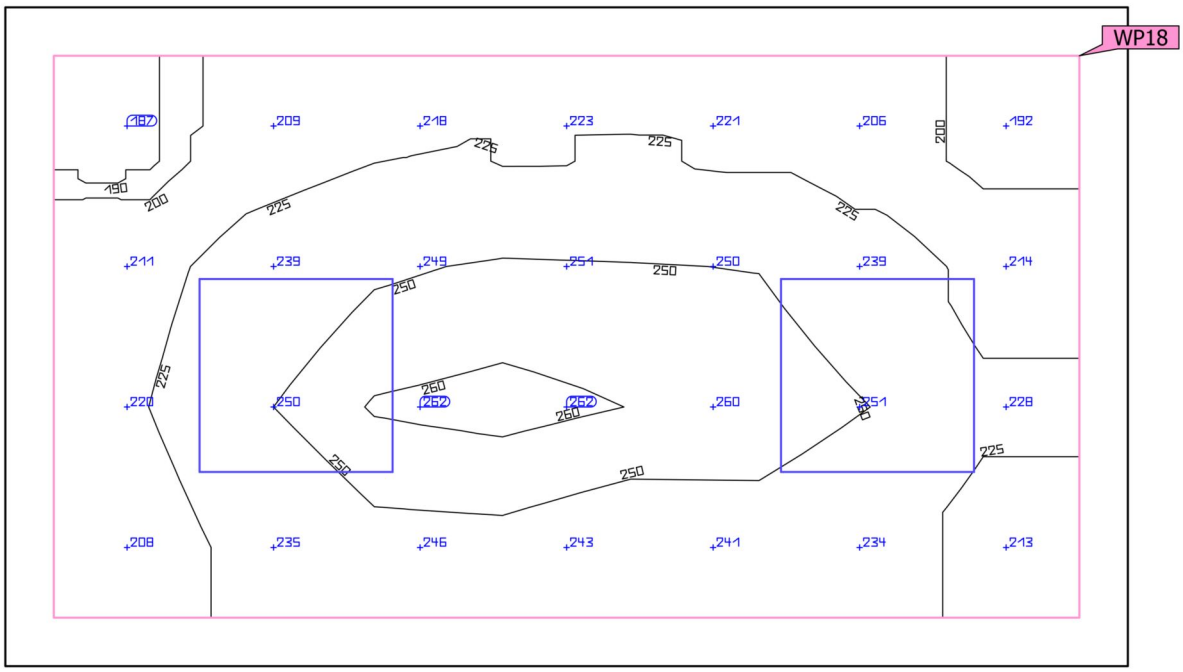

Ground area	7.09 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · CLEANING OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	231 lx	WP18
	U_o (g_1)	0.81	WP18
	Lighting power density	5.79 W/m²	
		2.50 W/m²/100 lx	
Energy estimation(2)	Consumption	79.2 kWh/a	
Room	Lighting power density	4.51 W/m²	
		1.95 W/m²/100 lx	

(1) Based on a rectangular space of 2.040 m x 3.475 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · CLEANING OFFICE (Light scene 1)

Working plane (CLEANING OFFICE)

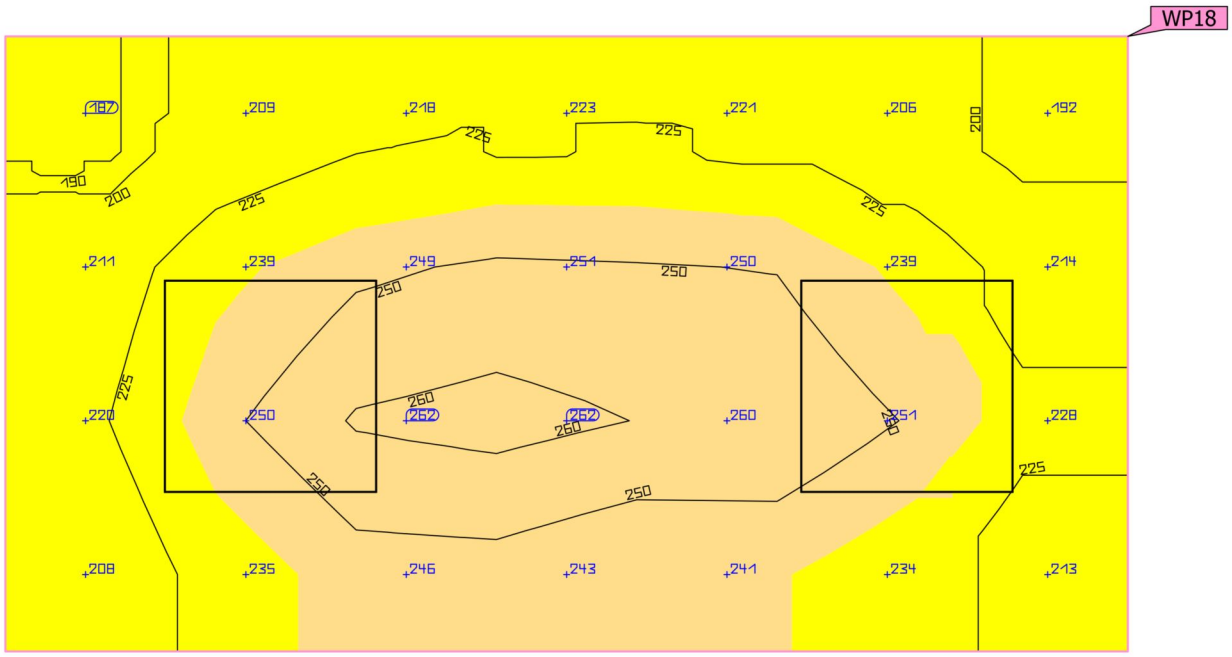

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (CLEANING OFFICE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	231 lx	187 lx	262 lx	0.81	0.71	WP18

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · COLLABORATIVE TRAINING ROOM (Light scene 1)

Summary

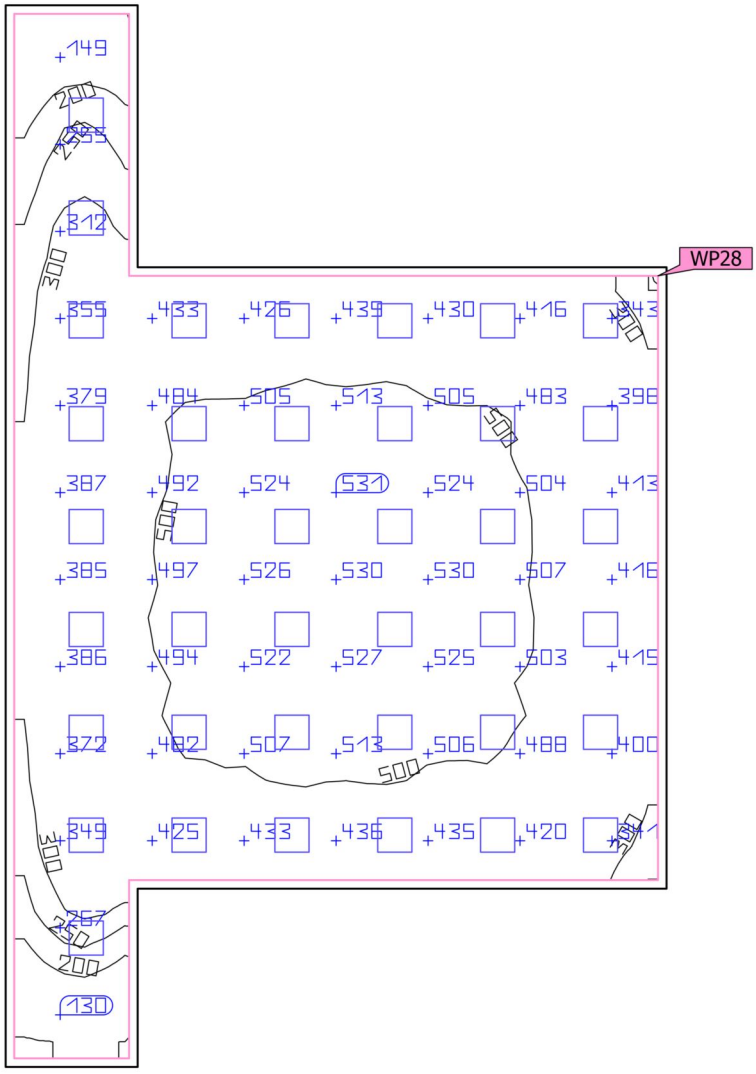

Ground area	143.58 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · COLLABORATIVE TRAINING ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	427 lx	WP28
	U_o (g_1)	0.22	WP28
	Lighting power density	4.64 W/m²	
		1.09 W/m²/100 lx	
Energy estimation(2)	Consumption	1544 kWh/a	
Room	Lighting power density	4.35 W/m²	
		1.02 W/m²/100 lx	

(1) Based on a rectangular space of 18.580 m x 11.566 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
39	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · COLLABORATIVE TRAINING ROOM (Light scene 1)

Working plane (COLLABORATIVE TRAINING ROOM)



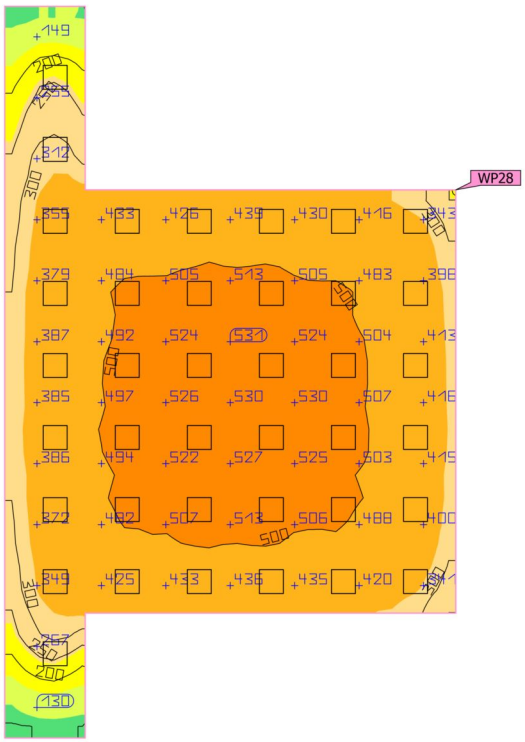

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (COLLABORATIVE TRAINING ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	427 lx	95.4 lx	543 lx	0.22	0.18	WP28

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · COMMON AREA & CORRIDOR (Light scene 1)

Summary

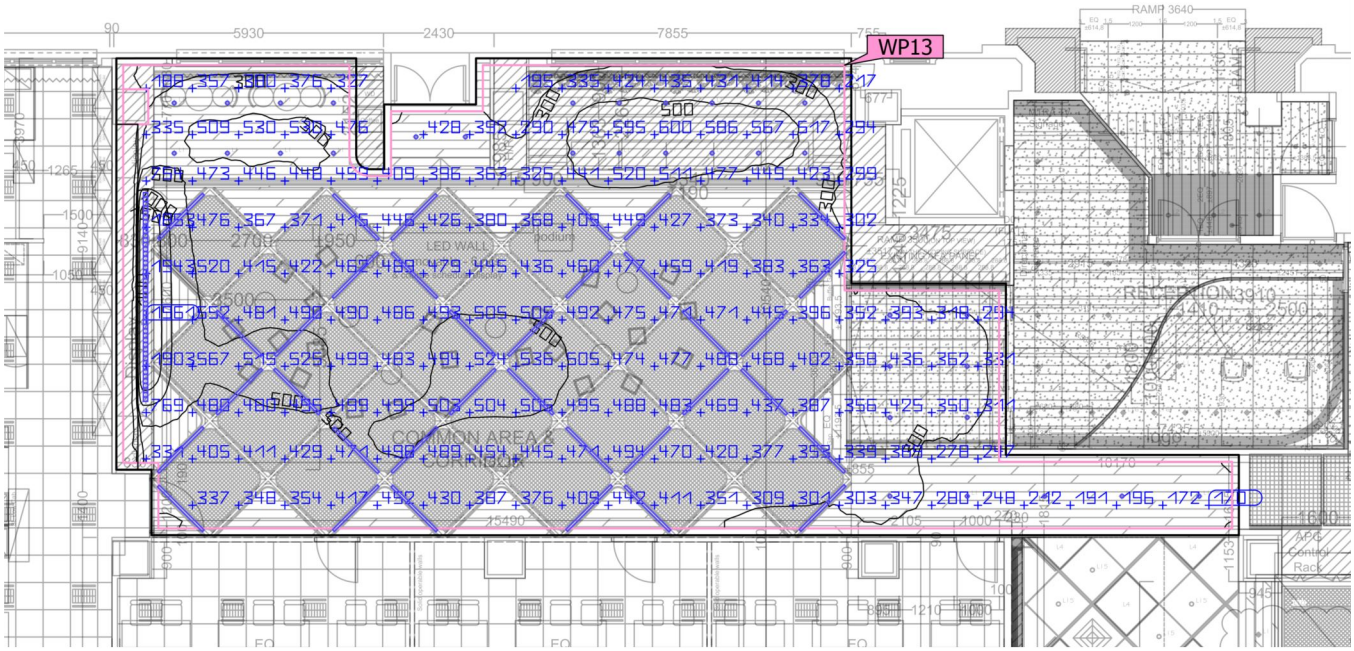

Ground area	192.79 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · COMMON AREA & CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	432 lx	WP13
	U_o (g_1)	0.083	WP13
	Lighting power density	7.46 W/m²	
		1.73 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	28	
Energy estimation(2)	Consumption	3355 kWh/a	
Room	Lighting power density	7.03 W/m²	
		1.63 W/m²/100 lx	

(1) Based on a rectangular space of 10.493 m x 24.682 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
33	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W
46	PROS		L26-PS-KLM-30Wm-4000K-ASYM15D-WH-R90	–	3.0 W	247 lm	82.3 lm/W
35	PROS		L5-PS-LF-FB-L1400-20W-4000K-120D-YL-R90	28	28.0 W	2243 lm	80.1 lm/W

Building 1 · Storey 1 · COMMON AREA & CORRIDOR (Light scene 1)

Working plane (COMMON AREA & CORRIDOR)

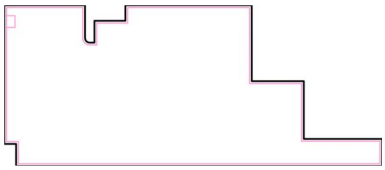



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (COMMON AREA & CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	432 lx	35.8 lx	1942 lx	0.083	0.018	WP13

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · COMMON CORRIDOR 1 (Light scene 1)

Summary

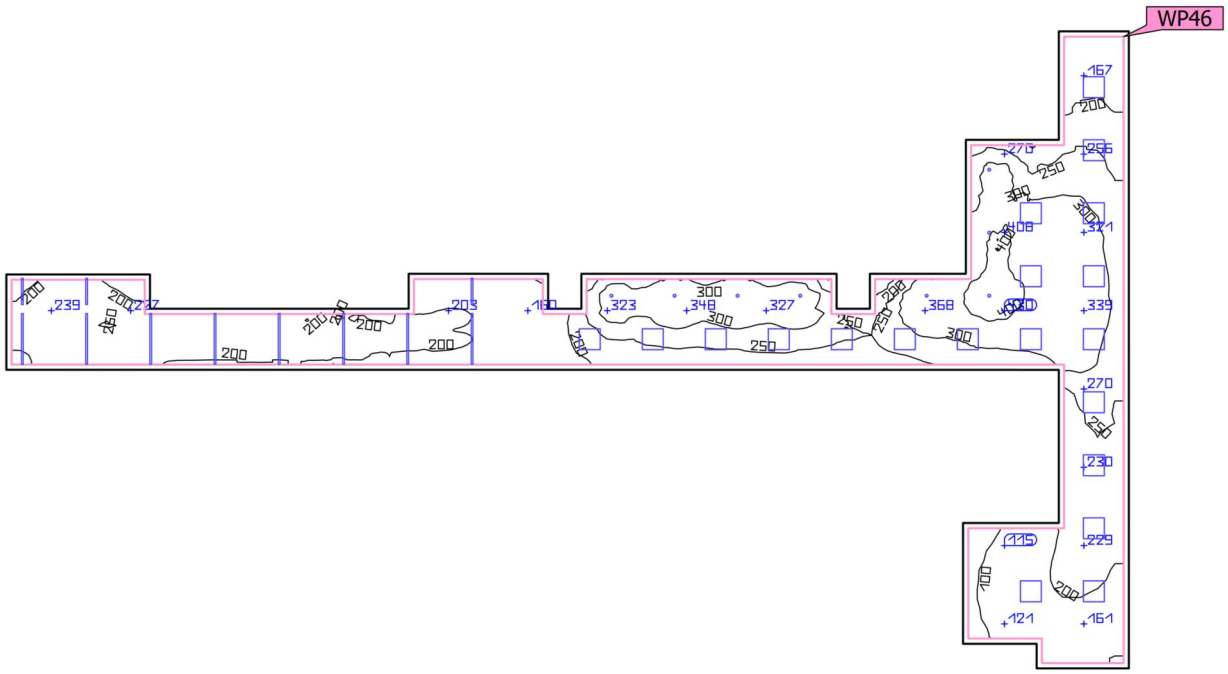

Ground area	129.57 m²	Clearance height	3.300 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · COMMON CORRIDOR 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	247 lx	WP46
	U_o (g_1)	0.33	WP46
	Lighting power density	5.44 W/m²	
		2.20 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	26	
Energy estimation(2)	Consumption	1517 kWh/a	
Room	Lighting power density	4.74 W/m²	
		1.92 W/m²/100 lx	

(1) Based on a rectangular space of 18.195 m x 32.064 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W
20	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W
3	PROS		L7D-PS-EF-AP-D30-L750-17W-4000K-270D-BL-R90	26	12.8 W	1607 lm	126.0 lm/W
8	PROS		L7E-PS-EF-AP-D30-L1450-17W-4000K-270D-BL-R90	26	24.7 W	3106 lm	126.0 lm/W

Building 1 · Storey 1 · COMMON CORRIDOR 1 (Light scene 1)

Working plane (COMMON CORRIDOR 1)

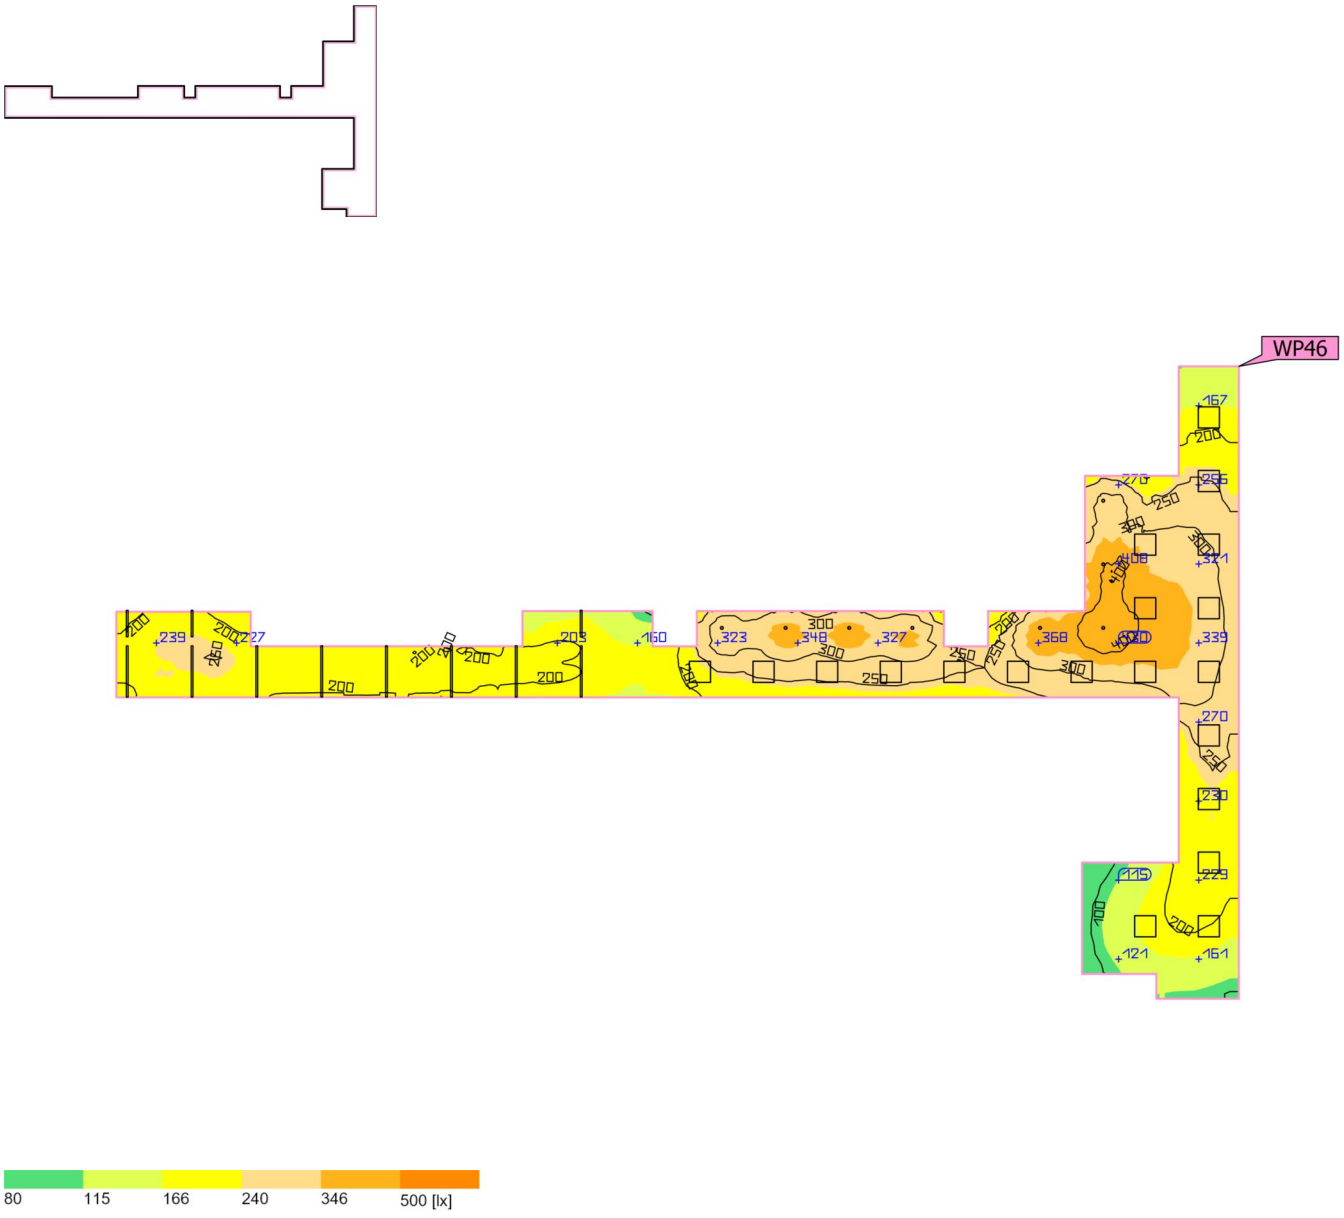

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (COMMON CORRIDOR 1) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	247 lx	80.9 lx	460 lx	0.33	0.18	WP46

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · COMMON CORRIDOR 2 (Light scene 1)

Summary

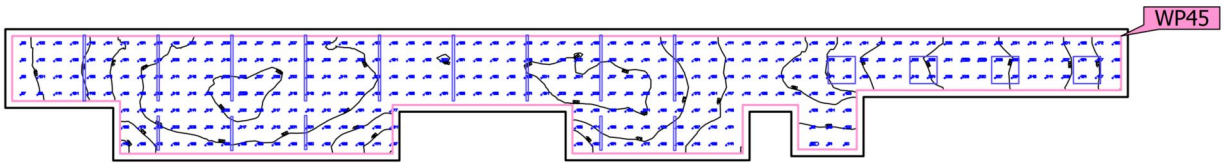

Ground area	55.56 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · COMMON CORRIDOR 2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	185 lx	WP45
	U_o (g_1)	0.41	WP45
	Lighting power density	7.49 W/m²	
		4.06 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	26	
Energy estimation(2)	Consumption	865 kWh/a	
Room	Lighting power density	6.31 W/m²	
		3.42 W/m²/100 lx	

(1) Based on a rectangular space of 24.718 m x 2.895 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W
5	PROS		L7D-PS-EF-AP-D30-L750-17W-4000K-270D-BL-R90	25	12.8 W	1607 lm	126.0 lm/W
9	PROS		L7E-PS-EF-AP-D30-L1450-17W-4000K-270D-BL-R90	26	24.7 W	3106 lm	126.0 lm/W

Building 1 · Storey 1 · COMMON CORRIDOR 2 (Light scene 1)

Working plane (COMMON CORRIDOR 2)



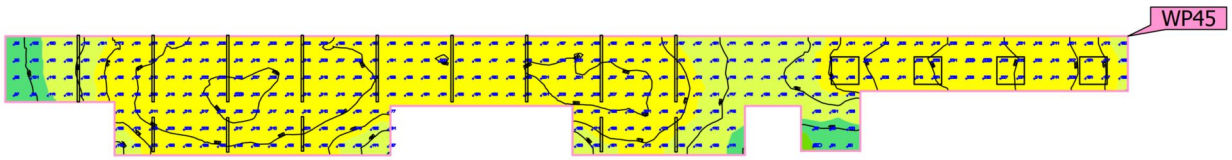

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (COMMON CORRIDOR 2) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	185 lx	75.2 lx	234 lx	0.41	0.32	WP45

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · COMMON CORRIDOR 3 (Light scene 1)

Summary

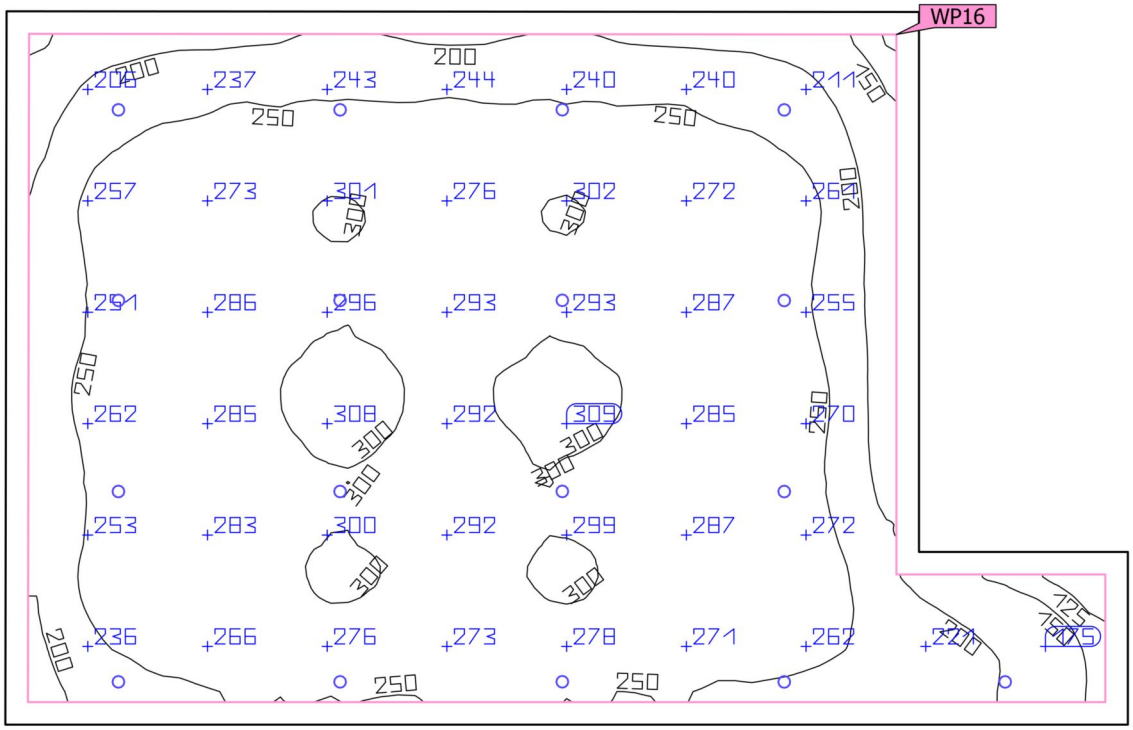

Ground area	30.45 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · COMMON CORRIDOR 3 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	261 lx	WP16
	U_o (g_1)	0.39	WP16
	Lighting power density	4.56 W/m²	
		1.74 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	303 kWh/a	
Room	Lighting power density	4.02 W/m²	
		1.54 W/m²/100 lx	

(1) Based on a rectangular space of 7.470 m x 4.750 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
17	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W

Building 1 · Storey 1 · COMMON CORRIDOR 3 (Light scene 1)

Working plane (COMMON CORRIDOR 3)

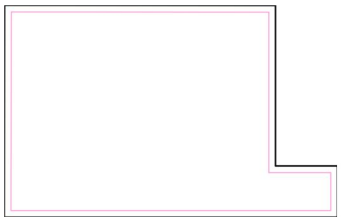

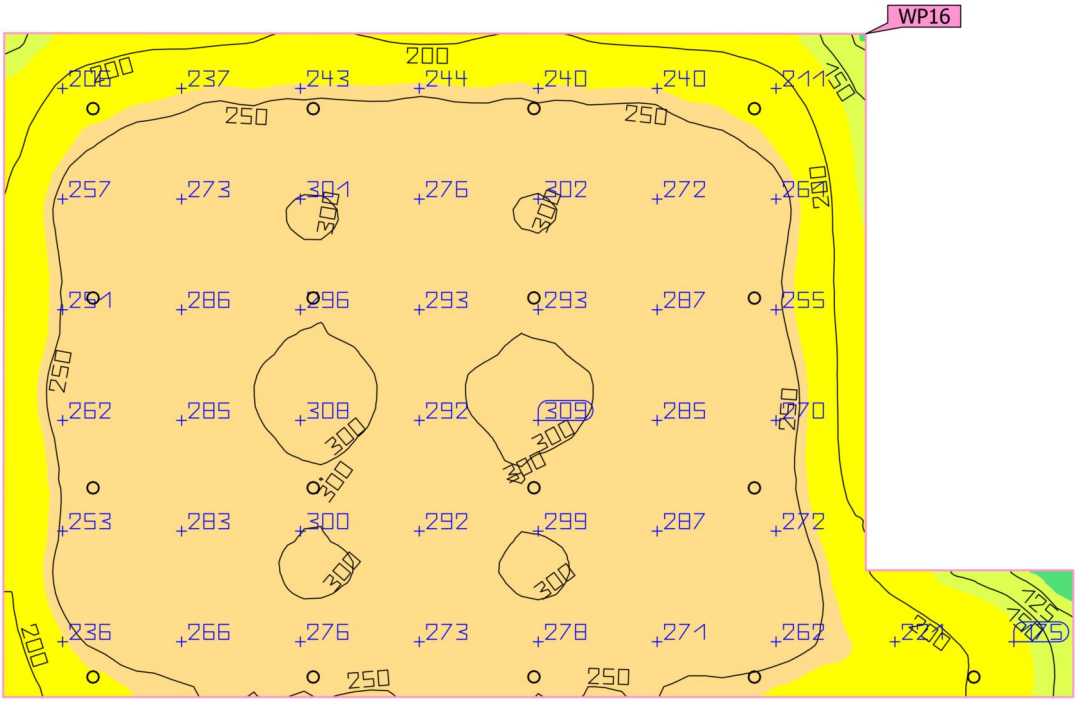

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (COMMON CORRIDOR 3) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	261 lx	101 lx	314 lx	0.39	0.32	WP16

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · COMMON CORRIDOR 4 (Light scene 1)

Summary

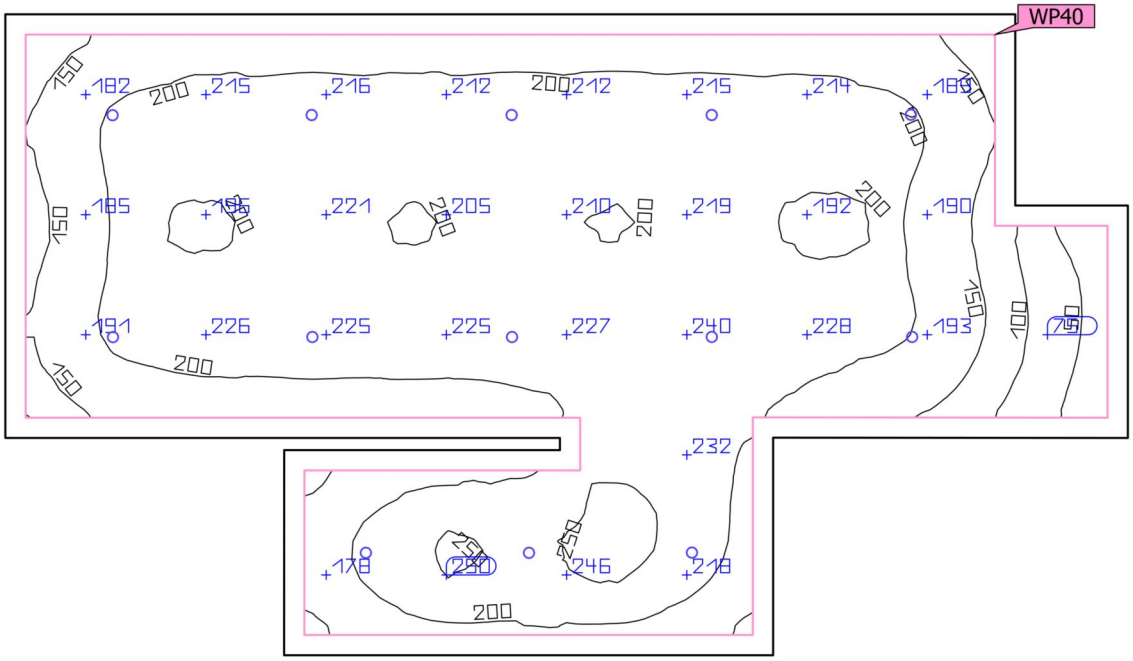

Ground area	30.47 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · COMMON CORRIDOR 4 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	199 lx	WP40
	U_o (g_1)	0.15	WP40
	Lighting power density	3.59 W/m²	
		1.81 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	232 kWh/a	
Room	Lighting power density	3.07 W/m²	
		1.54 W/m²/100 lx	

(1) Based on a rectangular space of 8.301 m x 4.743 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
13	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W

Building 1 · Storey 1 · COMMON CORRIDOR 4 (Light scene 1)

Working plane (COMMON CORRIDOR 4)

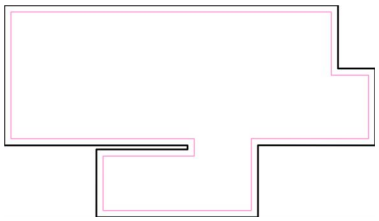

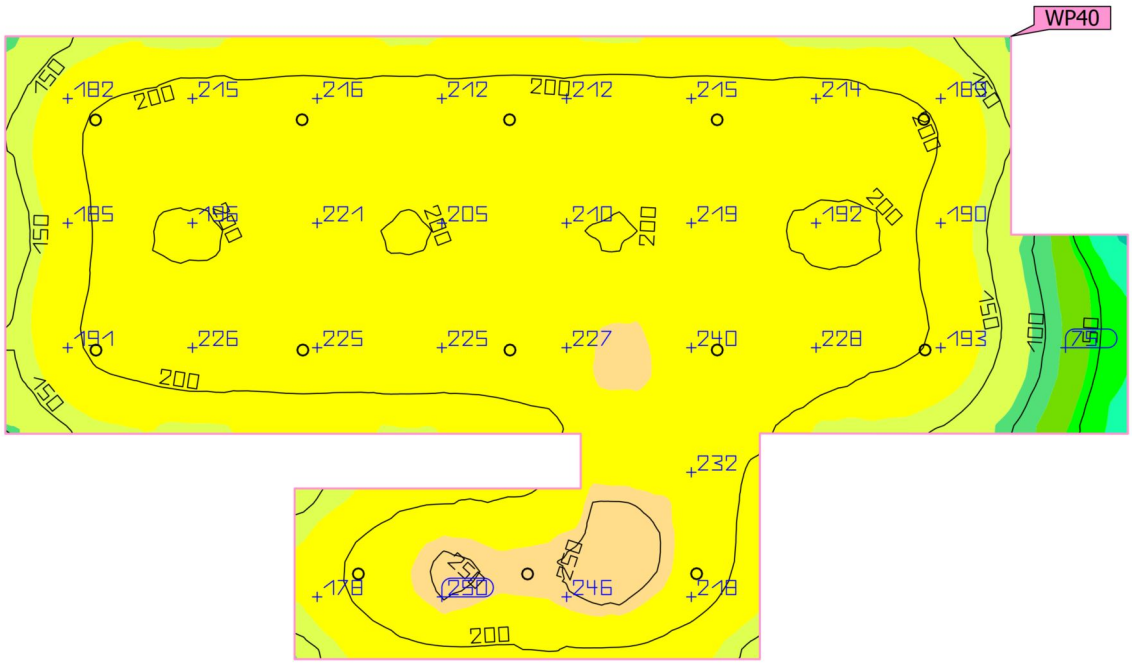

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (COMMON CORRIDOR 4) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	199 lx	29.4 lx	271 lx	0.15	0.11	WP40

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · ENTRANCE (Light scene 1)

Summary

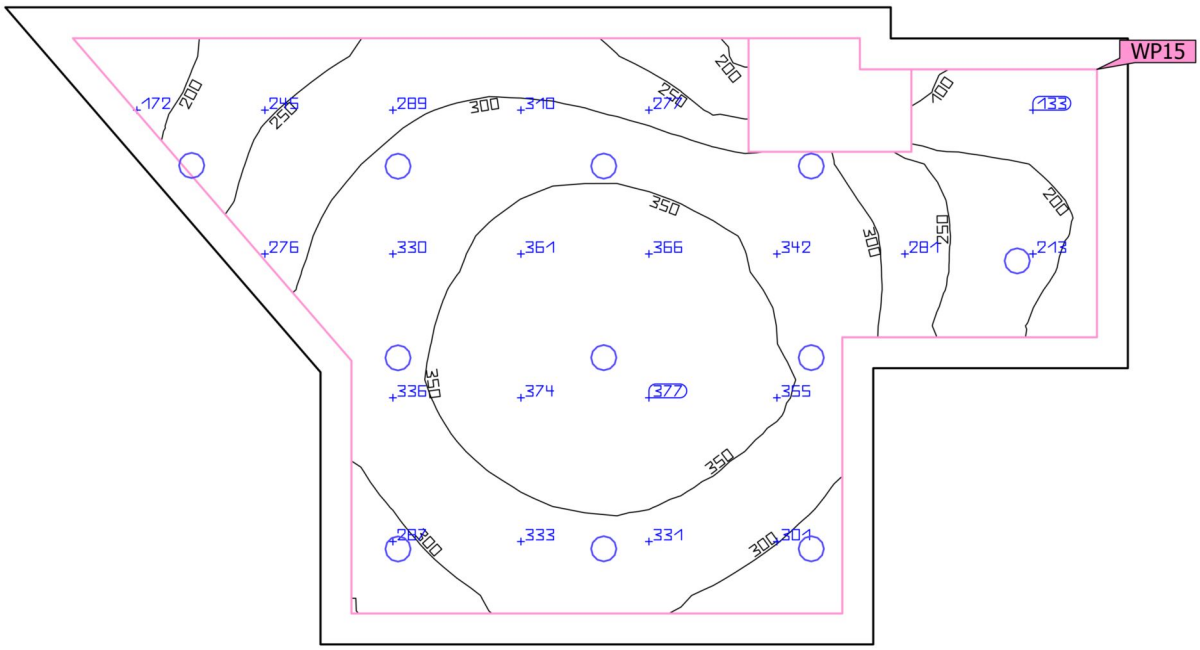

Ground area	11.63 m²	Clearance height	2.800 m – 5.500 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · ENTRANCE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	301 lx	WP15
	U_o (g_1)	0.32	WP15
	Lighting power density	10.62 W/m²	
		3.53 W/m²/100 lx	
Energy estimation(2)	Consumption	245 kWh/a	
Room	Lighting power density	8.51 W/m²	
		2.83 W/m²/100 lx	

(1) Based on a rectangular space of 5.445 m x 3.091 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
11	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	–	9.0 W	855 lm	95.0 lm/W

Building 1 · Storey 1 · ENTRANCE (Light scene 1)

Working plane (ENTRANCE)

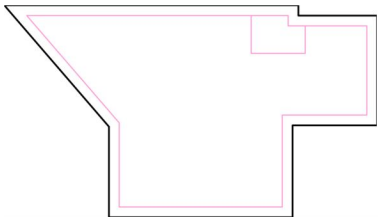

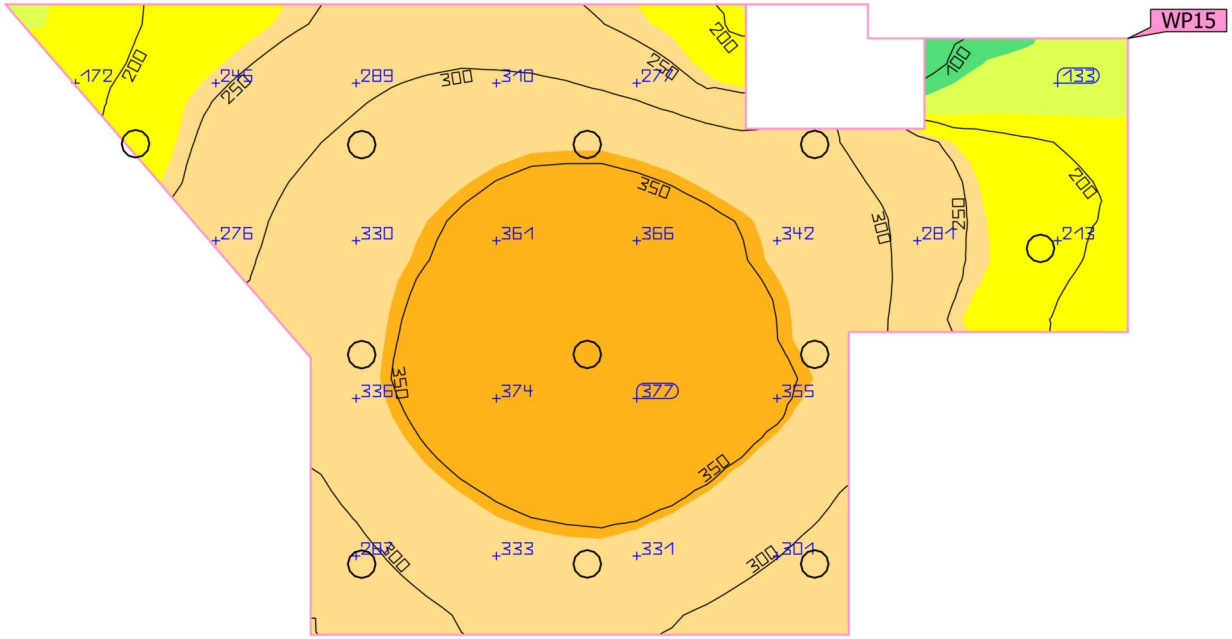



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (ENTRANCE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	301 lx	95.1 lx	381 lx	0.32	0.25	WP15

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · F.LAV (Light scene 1)

Summary

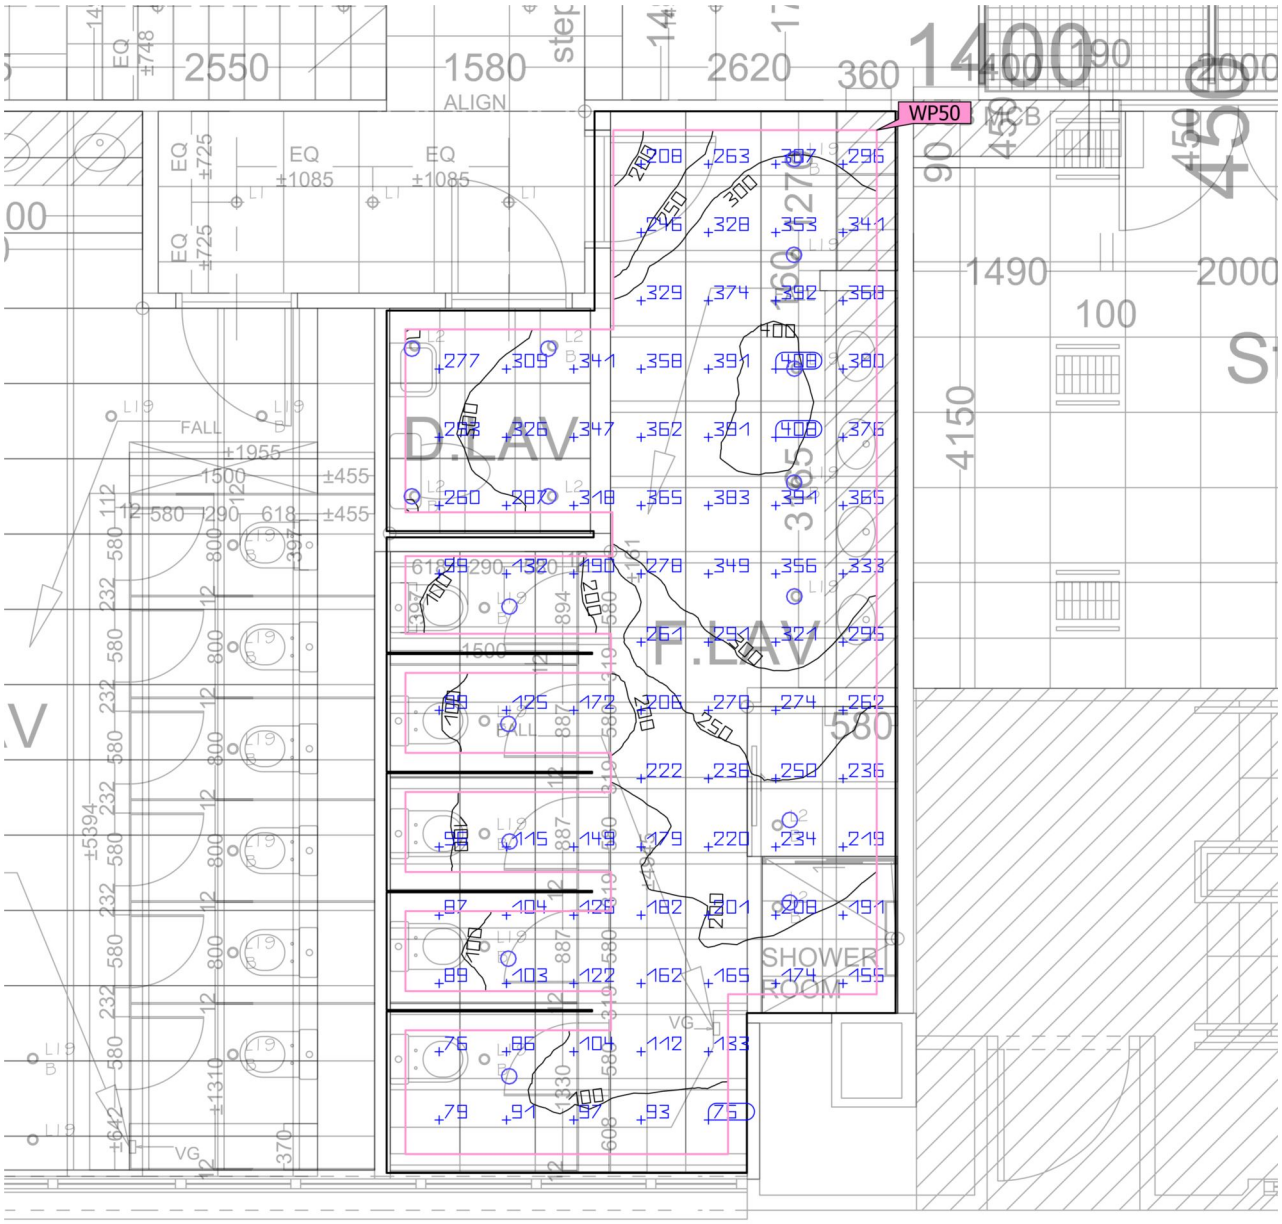

Ground area	30.03 m²	Clearance height	2.400 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.400 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · F.LAV (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	244 lx	WP50
	U_o (g_1)	0.24	WP50
	Lighting power density	7.07 W/m²	
		2.90 W/m²/100 lx	
Energy estimation(2)	Consumption	418 kWh/a	
Room	Lighting power density	5.63 W/m²	
		2.31 W/m²/100 lx	

(1) Based on a rectangular space of 4.057 m x 8.463 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
5	PROS		L19-PS-KS-DL03-WH-14W-4000K-90D-R90	–	14.0 W	1330 lm	95.0 lm/W
5	PROS		L19A-PS-KS-DL03-WH-9W-4000K-90D-R90	–	9.0 W	855 lm	95.0 lm/W
6	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	–	9.0 W	855 lm	95.0 lm/W

Building 1 · Storey 1 · F.LAV (Light scene 1)

Working plane (F.LAV)

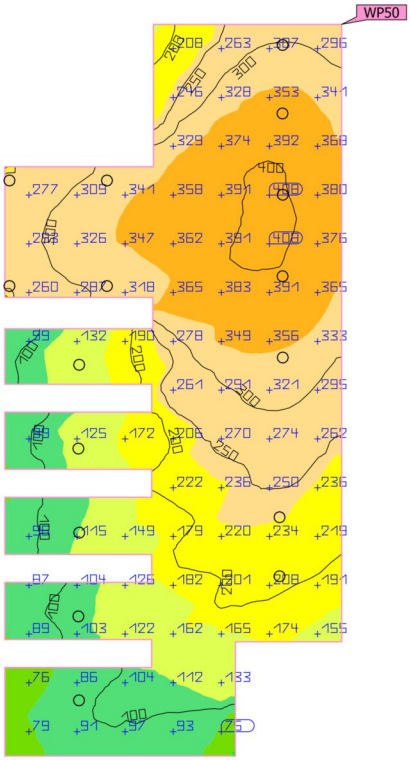

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (F.LAV) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	244 lx	57.7 lx	410 lx	0.24	0.14	WP50

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · FEATURE WALL (Light scene 1)

Summary

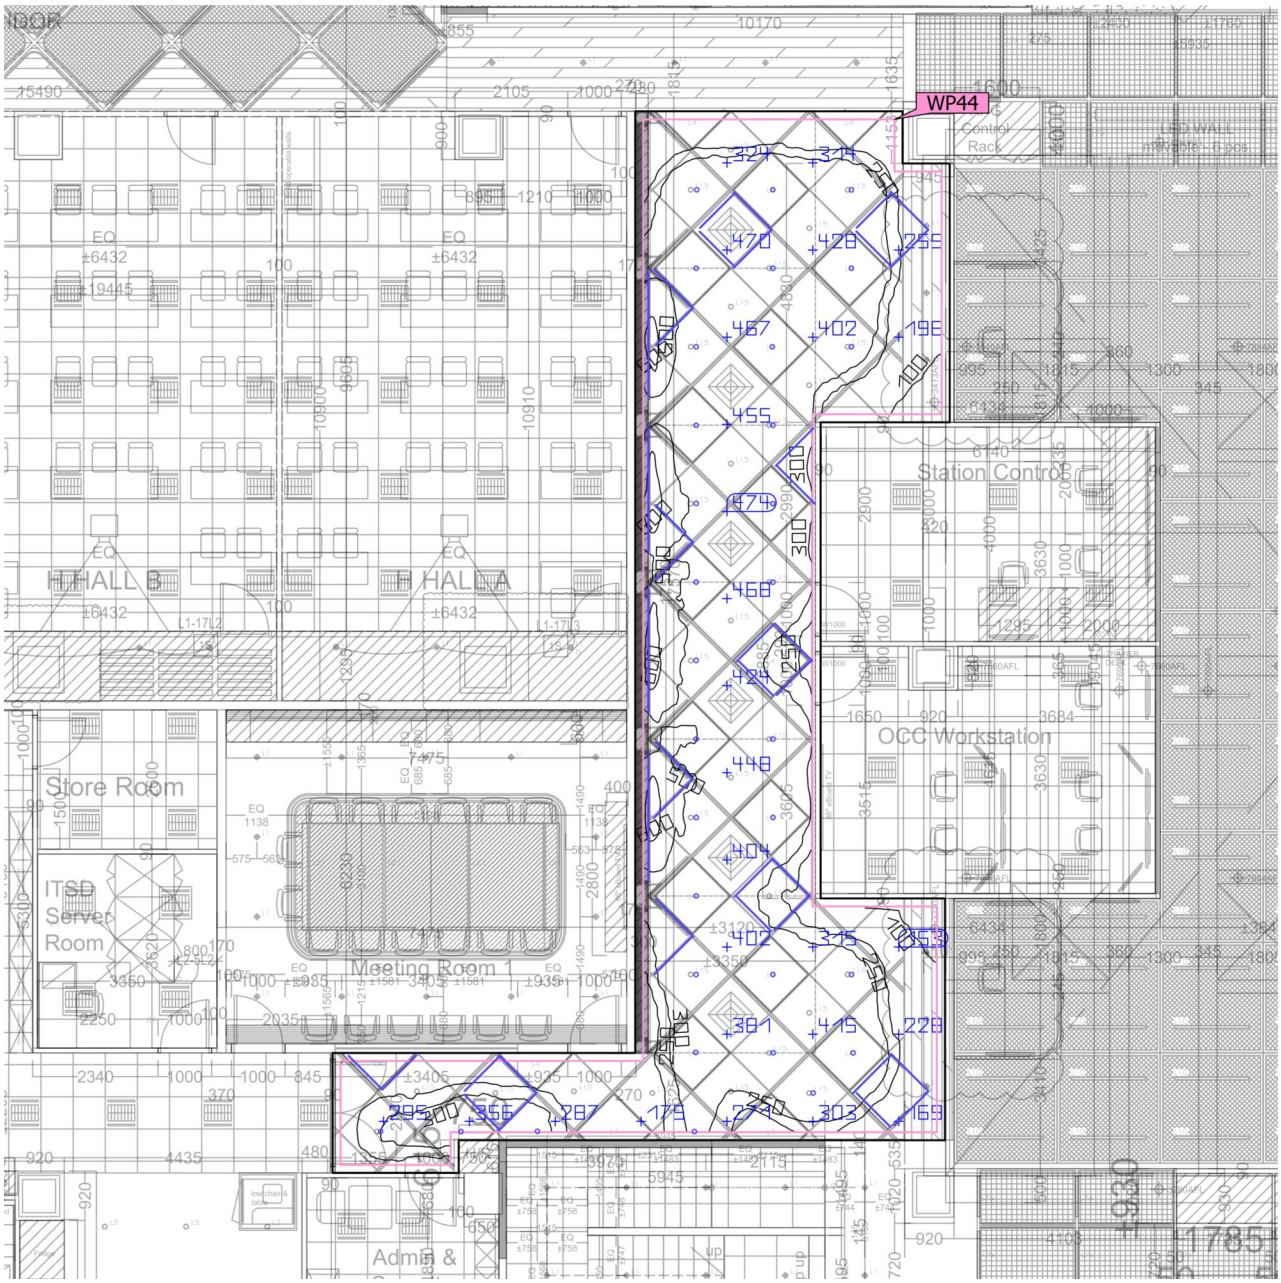

Ground area	100.67 m²	Clearance height	2.800 m – 2.950 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	0.507 m – 2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · FEATURE WALL (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	357 lx	WP44
	U_o (g_1)	0.13	WP44
	Lighting power density	7.69 W/m²	
		2.16 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	31	
Energy estimation(2)	Consumption	1718 kWh/a	
Room	Lighting power density	6.93 W/m²	
		1.94 W/m²/100 lx	

(1) Based on a rectangular space of 11.515 m x 19.812 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
32	PROS		L15-PS-AC10032-BK-6.1W-4000K-36D-R90	12	6.1 W	707 lm	115.9 lm/W
312	PROS		L17-PS-EF-2835-120-L100-4.9W-4000K-105D-AL-R90	26	0.5 W	39 lm	79.7 lm/W
346	PROS		L4-PS-EF-2835-120-L100-10W-4000K-105D-AL-R90	31	1.0 W	140 lm	140.2 lm/W

Building 1 · Storey 1 · FEATURE WALL (Light scene 1)

Working plane (FEATURE WALL)



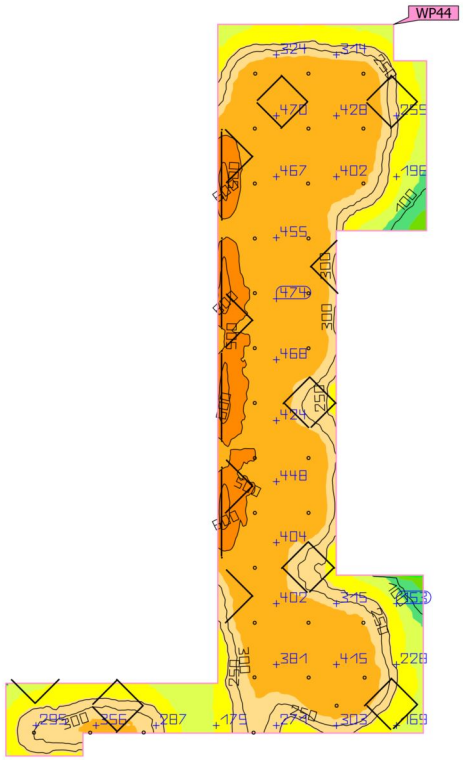



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (FEATURE WALL) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	357 lx	46.6 lx	636 lx	0.13	0.073	WP44

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · H HALL A (Light scene 1)

Summary

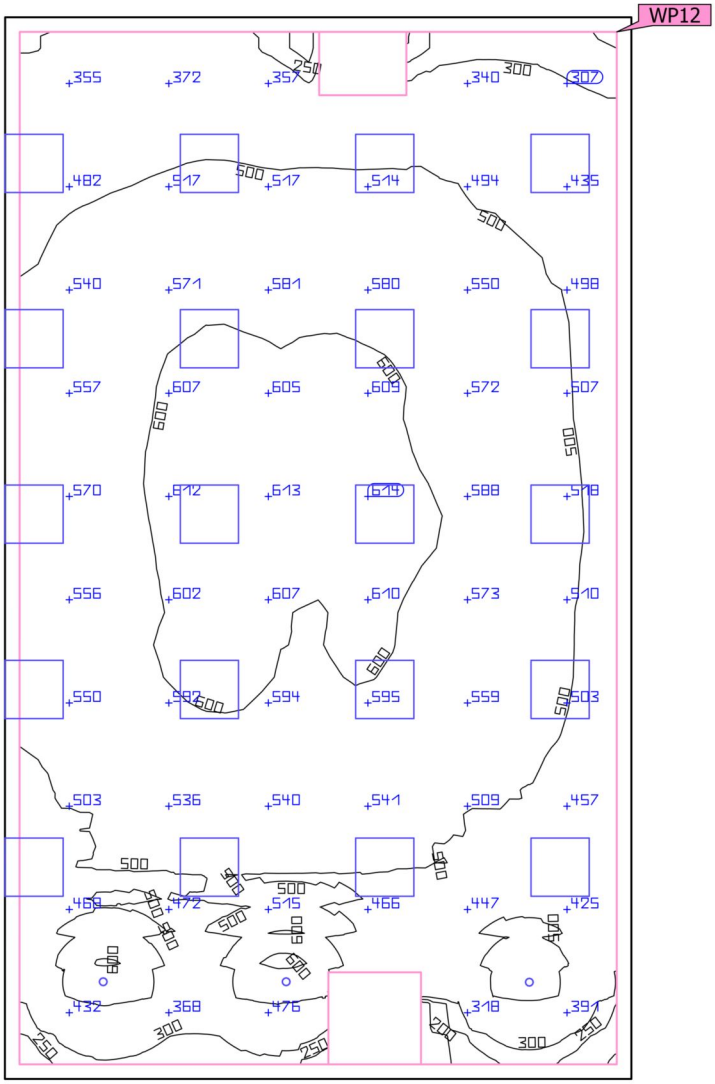

Ground area	70.09 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · H HALL A (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	510 lx	WP12
	U_o (g_1)	0.31	WP12
	Lighting power density	5.44 W/m²	
		1.07 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	875 kWh/a	
Room	Lighting power density	5.05 W/m²	
		0.99 W/m²/100 lx	

(1) Based on a rectangular space of 6.432 m x 10.899 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	12	7.2 W	630 lm	87.5 lm/W
20	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	–	16.6 W	2500 lm	150.6 lm/W

Building 1 · Storey 1 · H HALL A (Light scene 1)

Working plane (H HALL A)



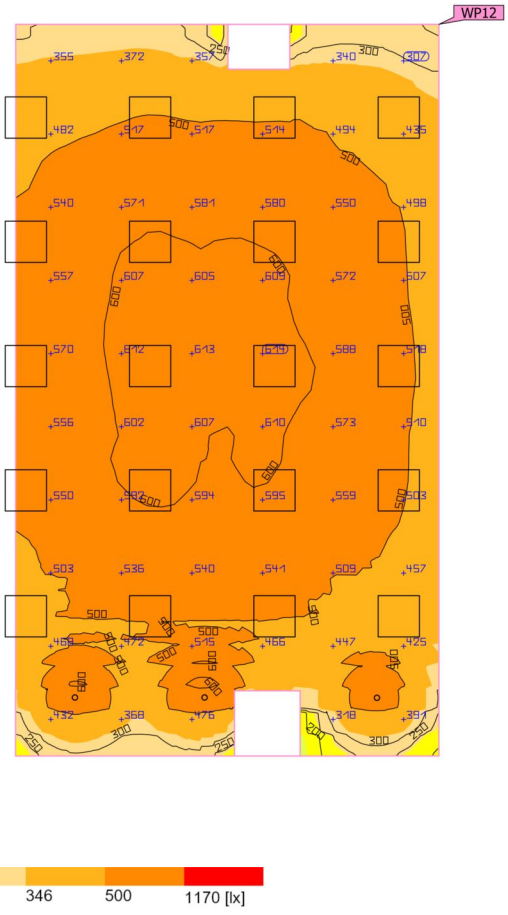

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (H HALL A) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	510 lx	157 lx	623 lx	0.31	0.25	WP12

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · H HALL B (Light scene 1)

Summary

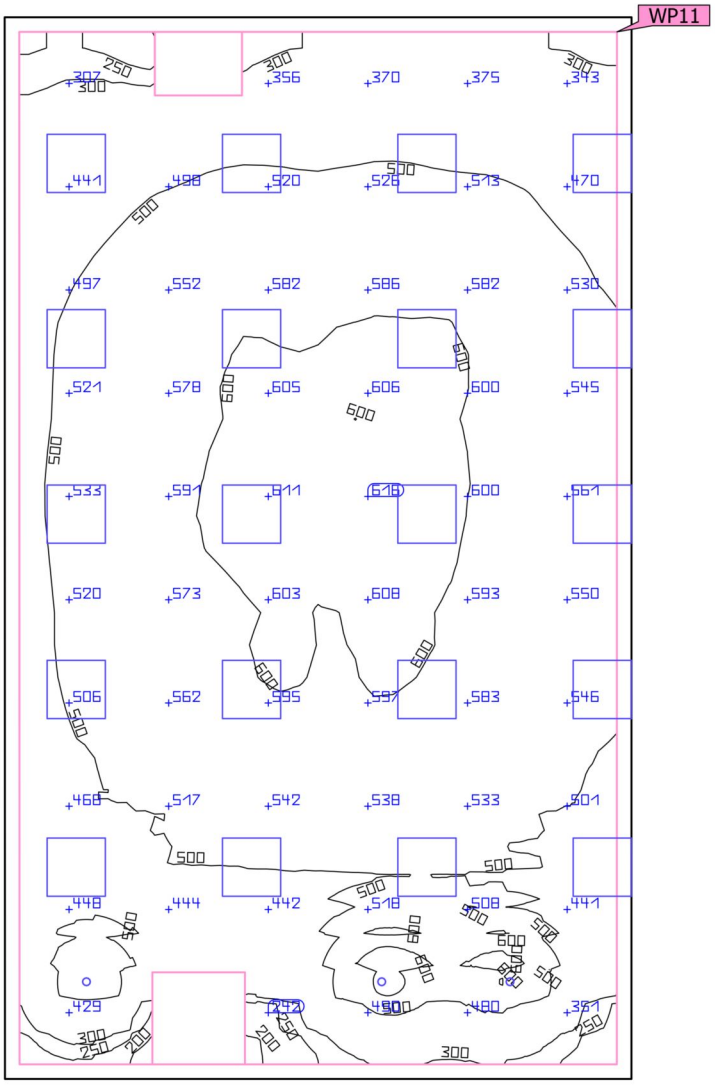

Ground area	70.12 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · H HALL B (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	511 lx	WP11
	U_o (g_1)	0.33	WP11
	Lighting power density	5.44 W/m²	
		1.07 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	875 kWh/a	
Room	Lighting power density	5.04 W/m²	
		0.99 W/m²/100 lx	

(1) Based on a rectangular space of 6.436 m x 10.899 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	12	7.2 W	630 lm	87.5 lm/W
20	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	–	16.6 W	2500 lm	150.6 lm/W

Building 1 · Storey 1 · H HALL B (Light scene 1)

Working plane (H HALL B)



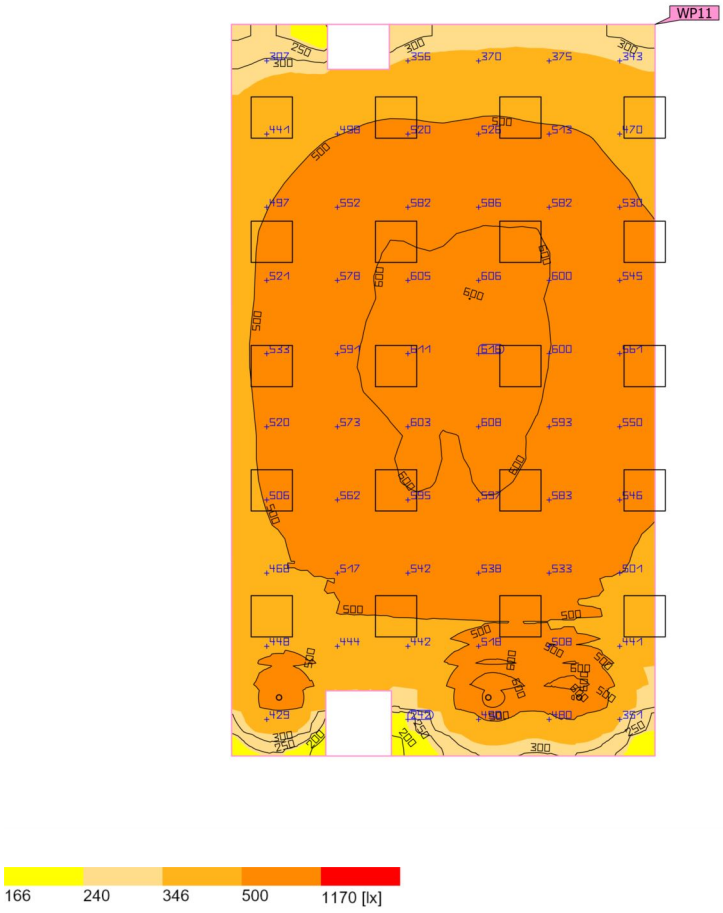

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (H HALL B) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	511 lx	171 lx	637 lx	0.33	0.27	WP11

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · H HALL C (Light scene 1)

Summary

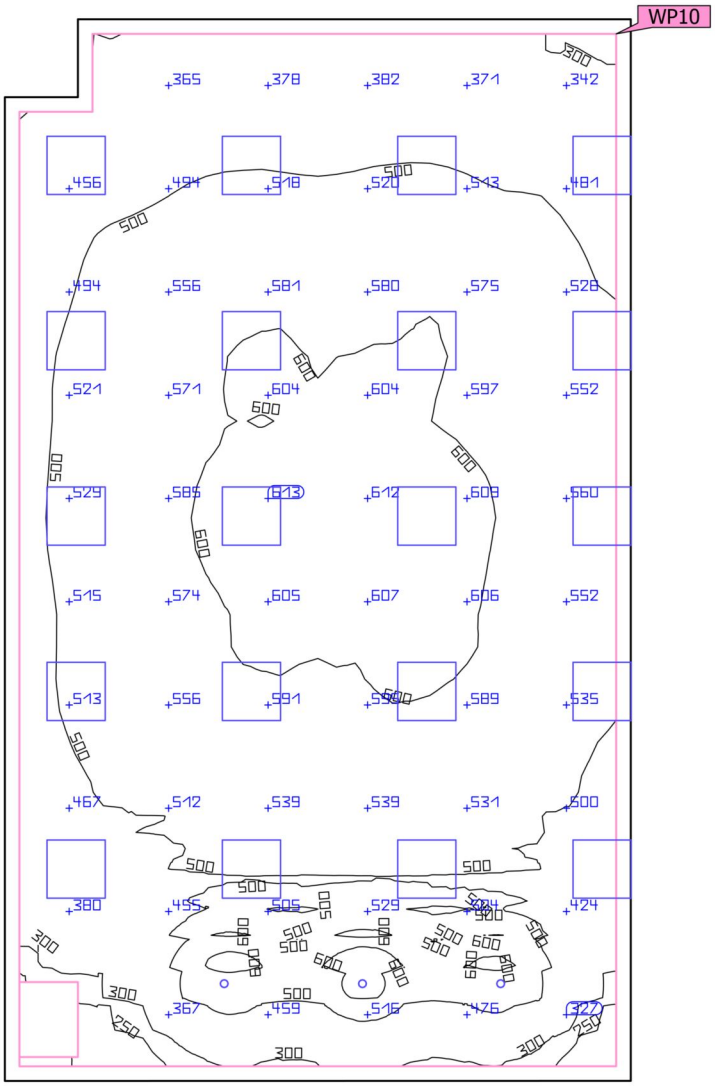

Ground area	69.44 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · H HALL C (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	513 lx	WP10
	U_o (g_1)	0.13	WP10
	Lighting power density	5.50 W/m²	
		1.07 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	875 kWh/a	
Room	Lighting power density	5.09 W/m²	
		0.99 W/m²/100 lx	

(1) Based on a rectangular space of 10.900 m x 6.426 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	PROS		L1-0-10V-PS-YL-2260-WH-7.2W-4000K-36D-R90-010	12	7.2 W	630 lm	87.5 lm/W
20	PROS		L18-0-10V-PS-TROFFER6060-AIRSLOT-2×8.3W-4000K-105D-R90	–	16.6 W	2500 lm	150.6 lm/W

Building 1 · Storey 1 · H HALL C (Light scene 1)

Working plane (H HALL C)



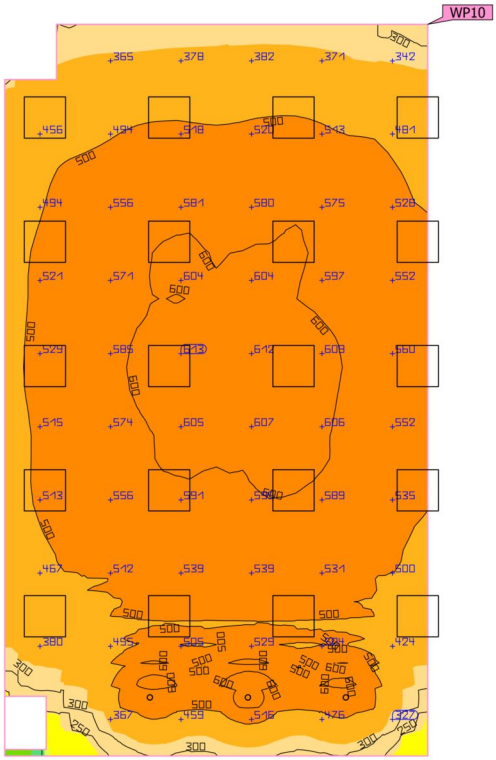



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (H HALL C) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	513 lx	64.6 lx	640 lx	0.13	0.10	WP10

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · ITF AREA (Light scene 1)

Summary

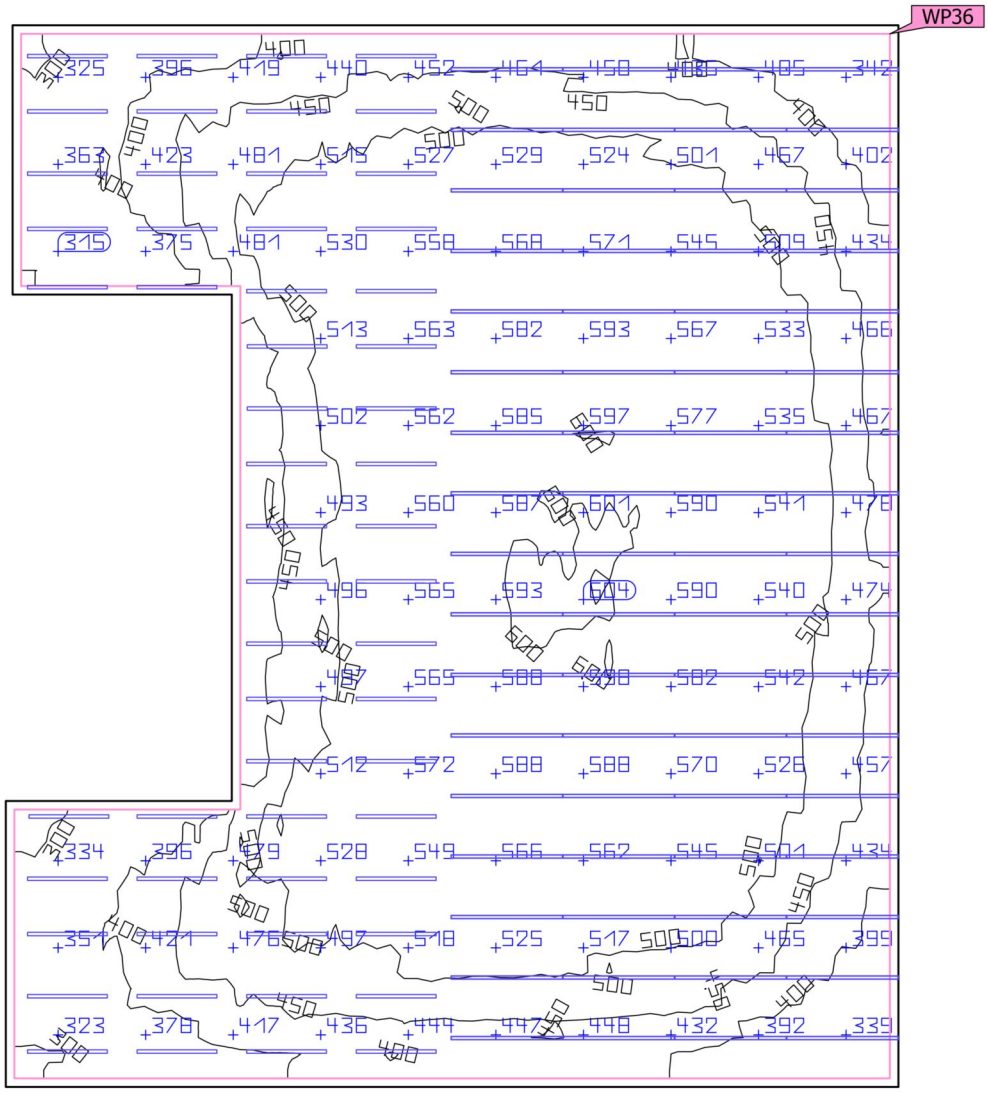

Ground area	255.94 m²	Clearance height	4.400 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	4.400 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · ITF AREA (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	492 lx	WP36
	U_o (g_1)	0.58	WP36
	Lighting power density	11.86 W/m²	
		2.41 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	24	
Energy estimation(2)	Consumption	7179 kWh/a	
Room	Lighting power density	11.33 W/m²	
		2.31 W/m²/100 lx	

(1) Based on a rectangular space of 15.661 m x 18.628 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
56	PROS		L10-PS-EF-AP-D30-L1400-20W-4000K-270D-LB-R90	24	28.0 W	3528 lm	126.0 lm/W
68	PROS		L9-PS-LF-IPLS2.5-S-L1960-10W-4000K-120D-BK-R90	23	19.6 W	1570 lm	80.1 lm/W

Building 1 · Storey 1 · ITF AREA (Light scene 1)

Working plane (ITF AREA)





Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (ITF AREA) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	492 lx	283 lx	607 lx	0.58	0.47	WP36

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · ITF2 (Light scene 1)

Summary

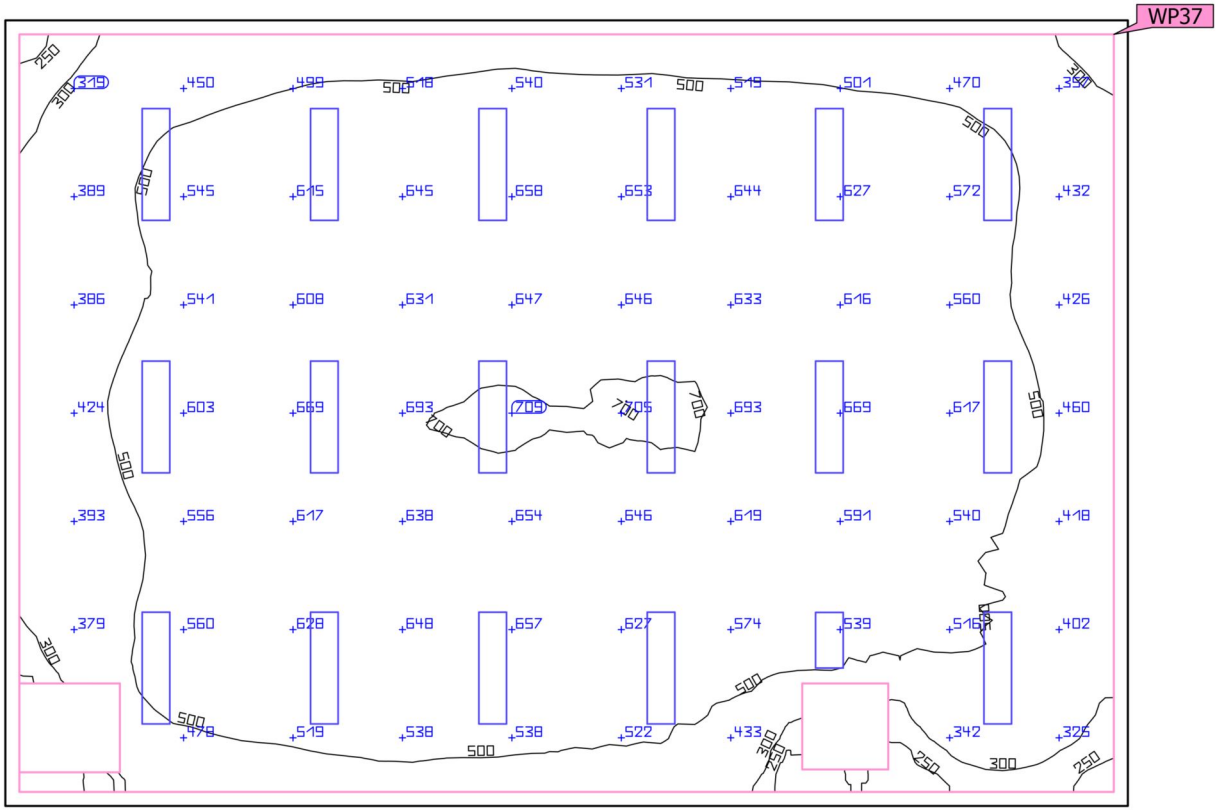

Ground area	100.83 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · ITF2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	542 lx	WP37
	U_o (g_1)	0.072	WP37
	Lighting power density	5.91 W/m²	
		1.09 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	23	
Energy estimation(2)	Consumption	1386 kWh/a	
Room	Lighting power density	5.55 W/m²	
		1.03 W/m²/100 lx	

(1) Based on a rectangular space of 8.401 m x 12.001 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
17	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	23	32.0 W	4205 lm	131.4 lm/W
1	PROS		L22A-PS-PNRC14-T5-2×8W-4000K-120D-WH-R90	23	16.0 W	2102 lm	131.4 lm/W

Building 1 · Storey 1 · ITF2 (Light scene 1)

Working plane (ITF2)

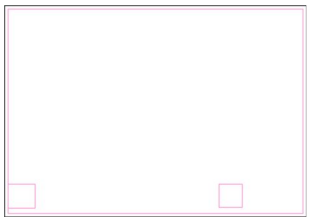

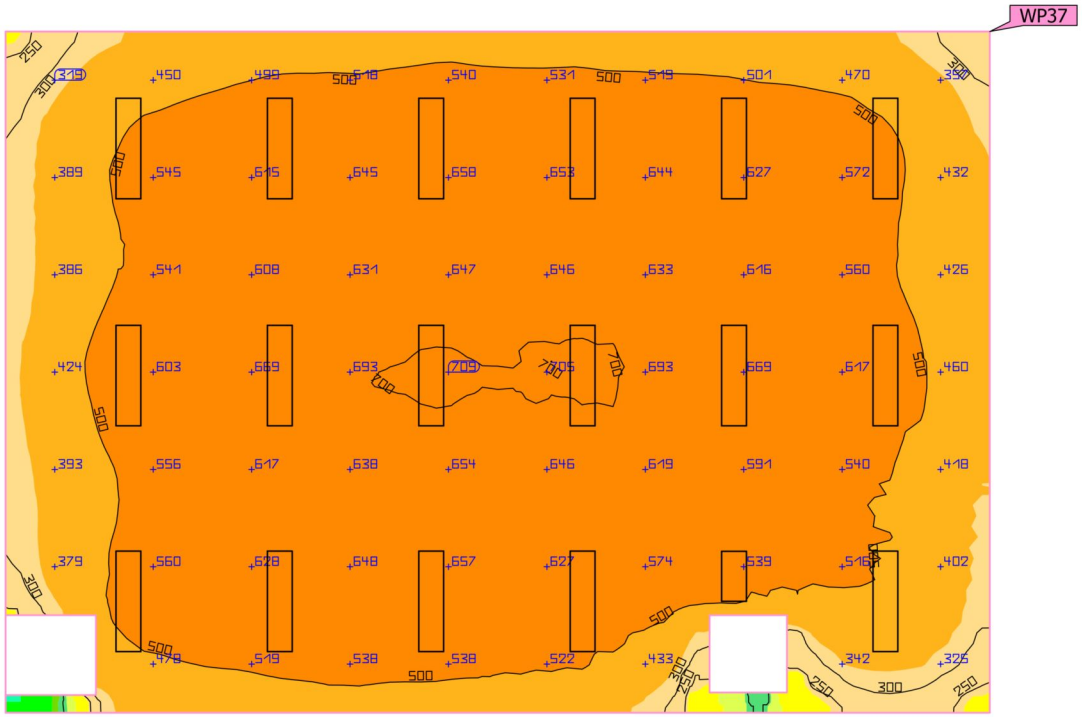

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (ITF2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	542 lx	39.1 lx	712 lx	0.072	0.055	WP37

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · ITSD HUB ROOM (Light scene 1)

Summary

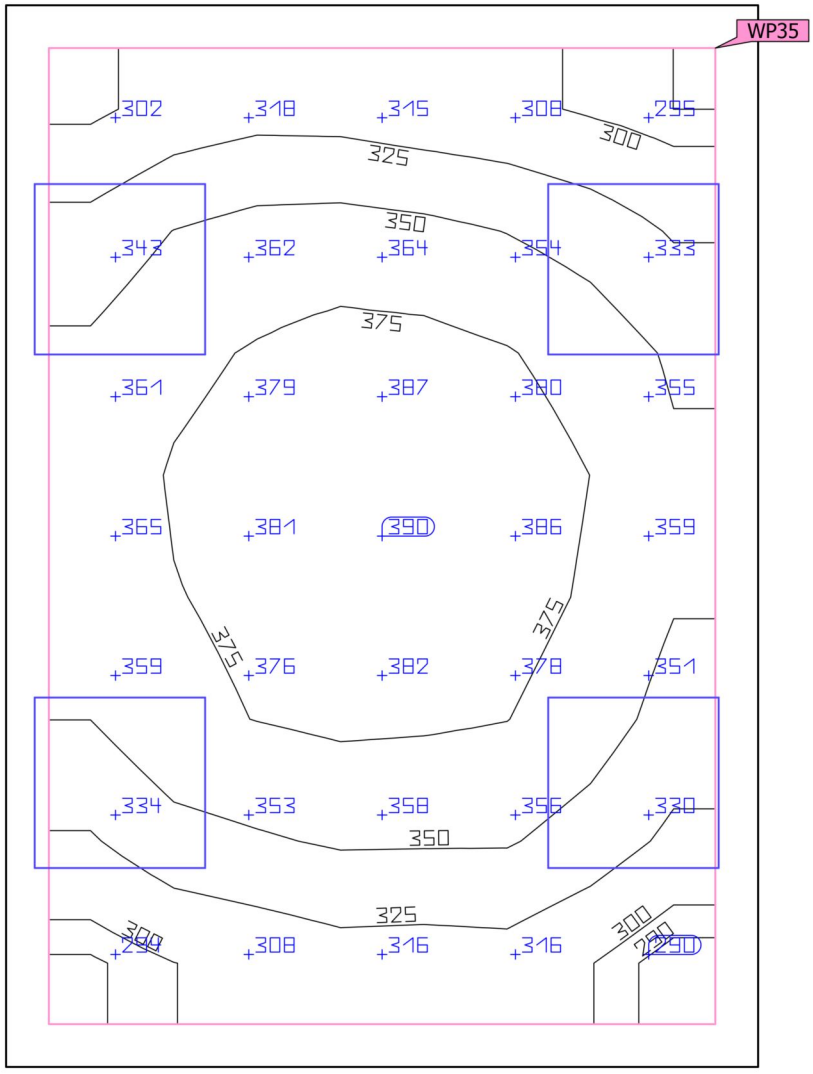

Ground area	9.81 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · ITSD HUB ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	348 lx	WP35
	U_o (g_1)	0.81	WP35
	Lighting power density	8.01 W/m²	
		2.30 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	6.52 W/m²	
		1.88 W/m²/100 lx	

(1) Based on a rectangular space of 2.636 m x 3.722 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · ITSD HUB ROOM (Light scene 1)

Working plane (ITSD HUB ROOM)



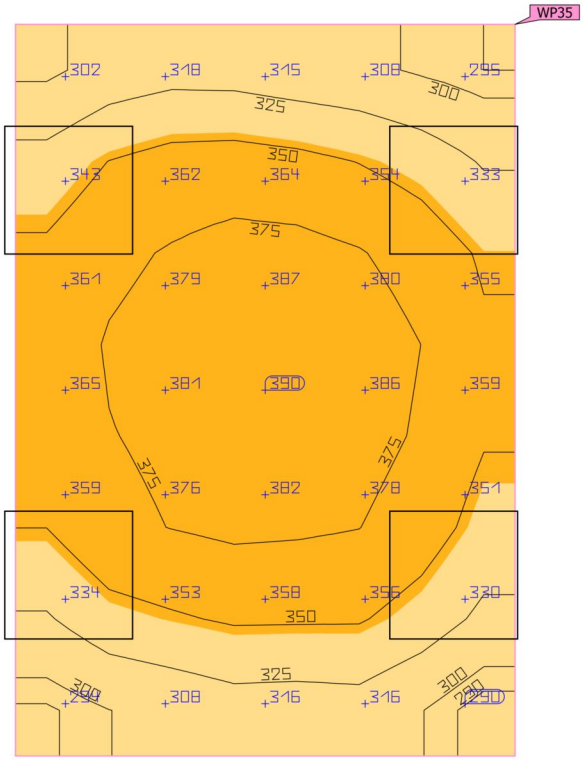

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (ITSD HUB ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	348 lx	283 lx	390 lx	0.81	0.73	WP35

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · ITSD SERVER ROOM (Light scene 1)

Summary

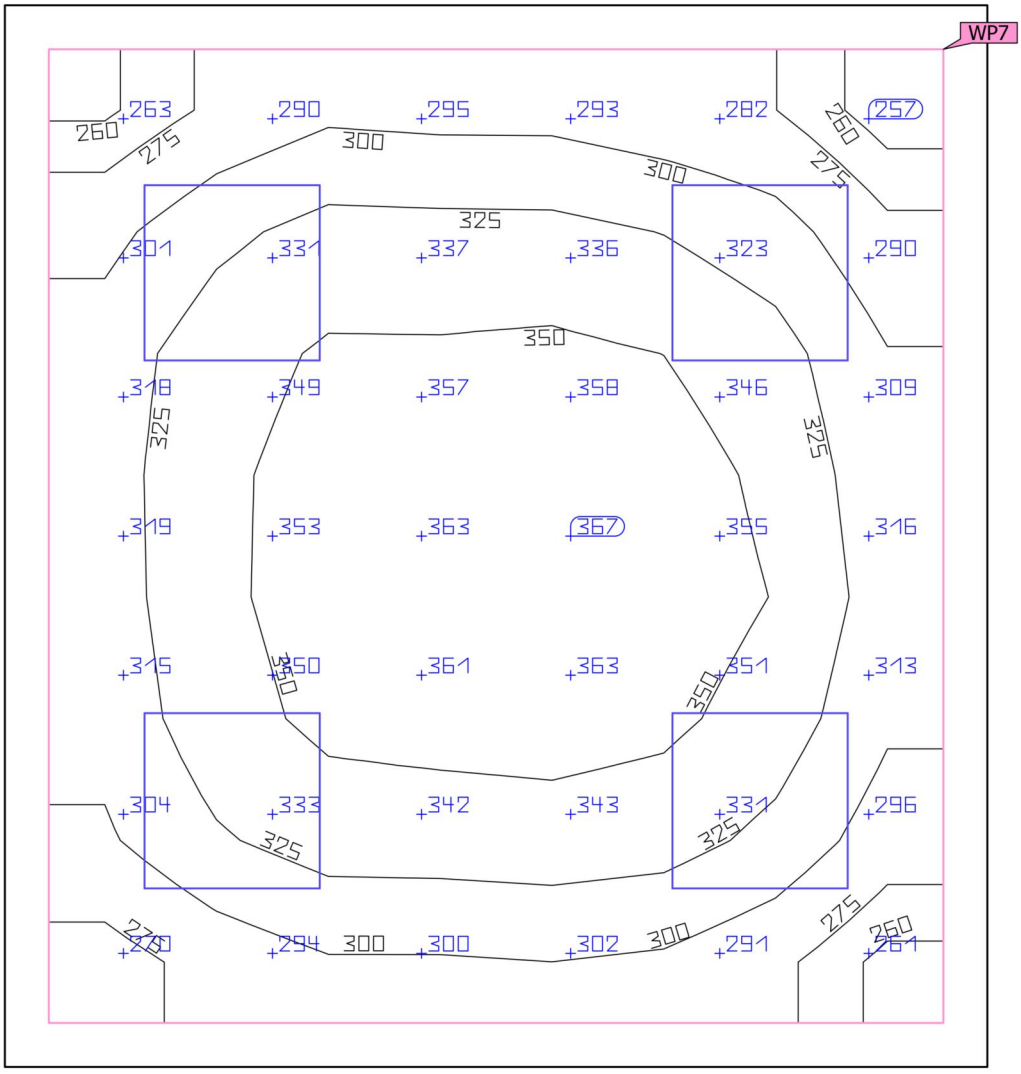

Ground area	12.13 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · ITSD SERVER ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	321 lx	WP7
	U_o (g_1)	0.78	WP7
	Lighting power density	6.32 W/m²	
		1.97 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	5.28 W/m²	
		1.64 W/m²/100 lx	

(1) Based on a rectangular space of 3.620 m x 3.350 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · ITSD SERVER ROOM (Light scene 1)

Working plane (ITSD SERVER ROOM)

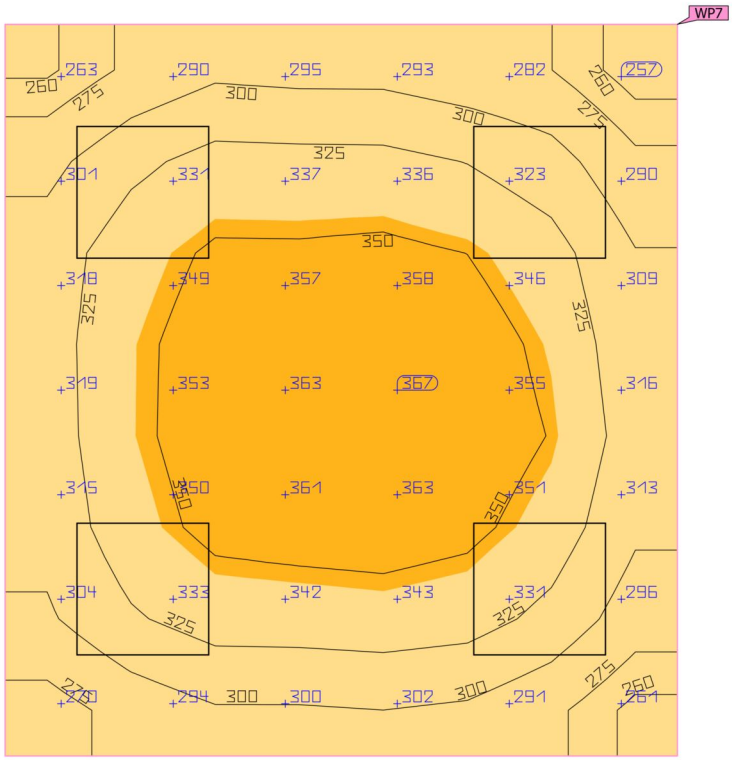

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (ITSD SERVER ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	321 lx	251 lx	367 lx	0.78	0.68	WP7

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · M.LAV (Light scene 1)

Summary

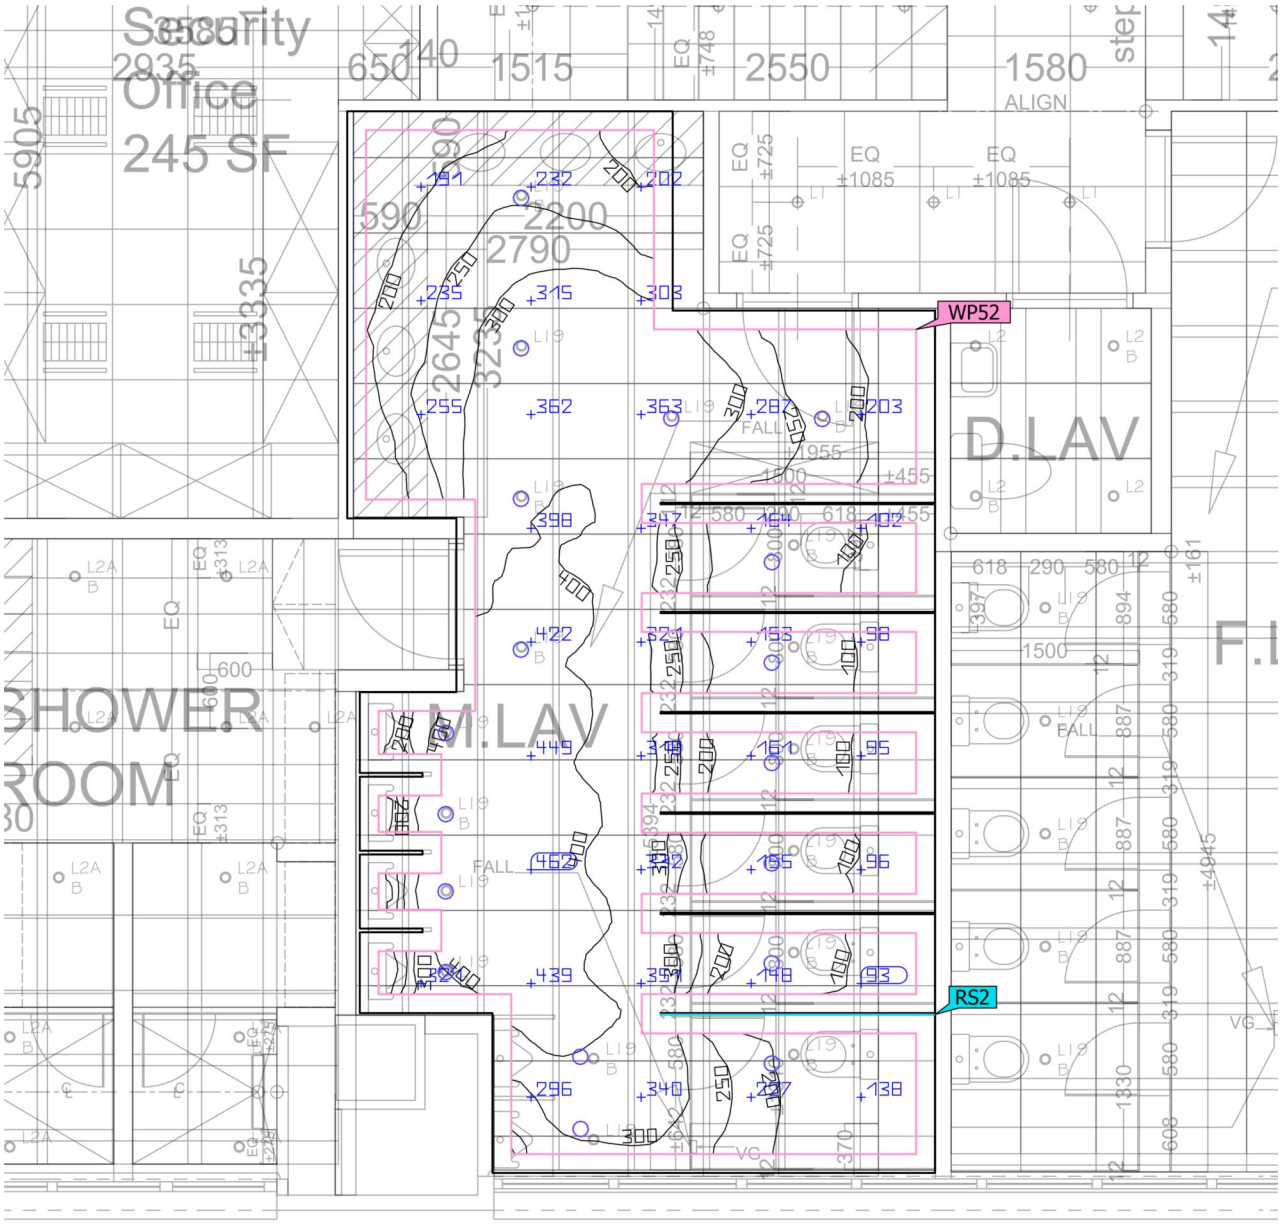

Ground area	33.20 m²	Clearance height	2.400 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.400 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · M.LAV (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	279 lx	WP52
	U_o (g_1)	0.27	WP52
	Lighting power density	8.98 W/m²	
		3.22 W/m²/100 lx	
Energy estimation(2)	Consumption	549 kWh/a	
Room	Lighting power density	6.69 W/m²	
		2.40 W/m²/100 lx	

(1) Based on a rectangular space of 8.463 m x 4.685 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
12	PROS		L19-PS-KS-DL03-WH-14W-4000K-90D-R90	–	14.0 W	1330 lm	95.0 lm/W
6	PROS		L19A-PS-KS-DL03-WH-9W-4000K-90D-R90	–	9.0 W	855 lm	95.0 lm/W

Building 1 · Storey 1 · M.LAV (Light scene 1)

Working plane (M.LAV)



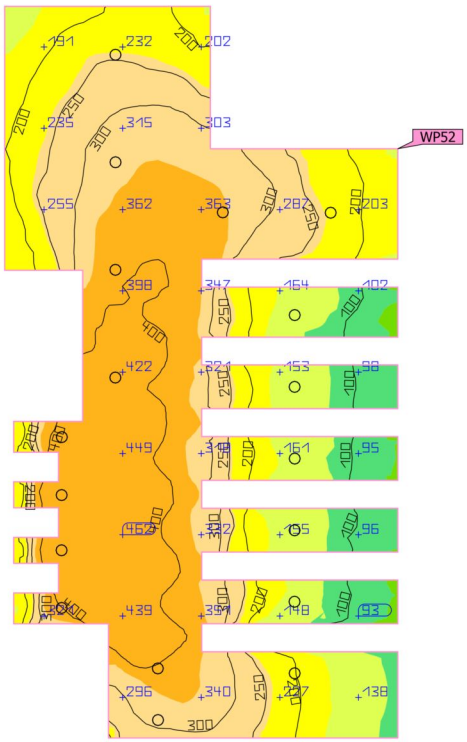



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (M.LAV) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	279 lx	75.0 lx	484 lx	0.27	0.15	WP52

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · MCB RM (Light scene 1)

Summary

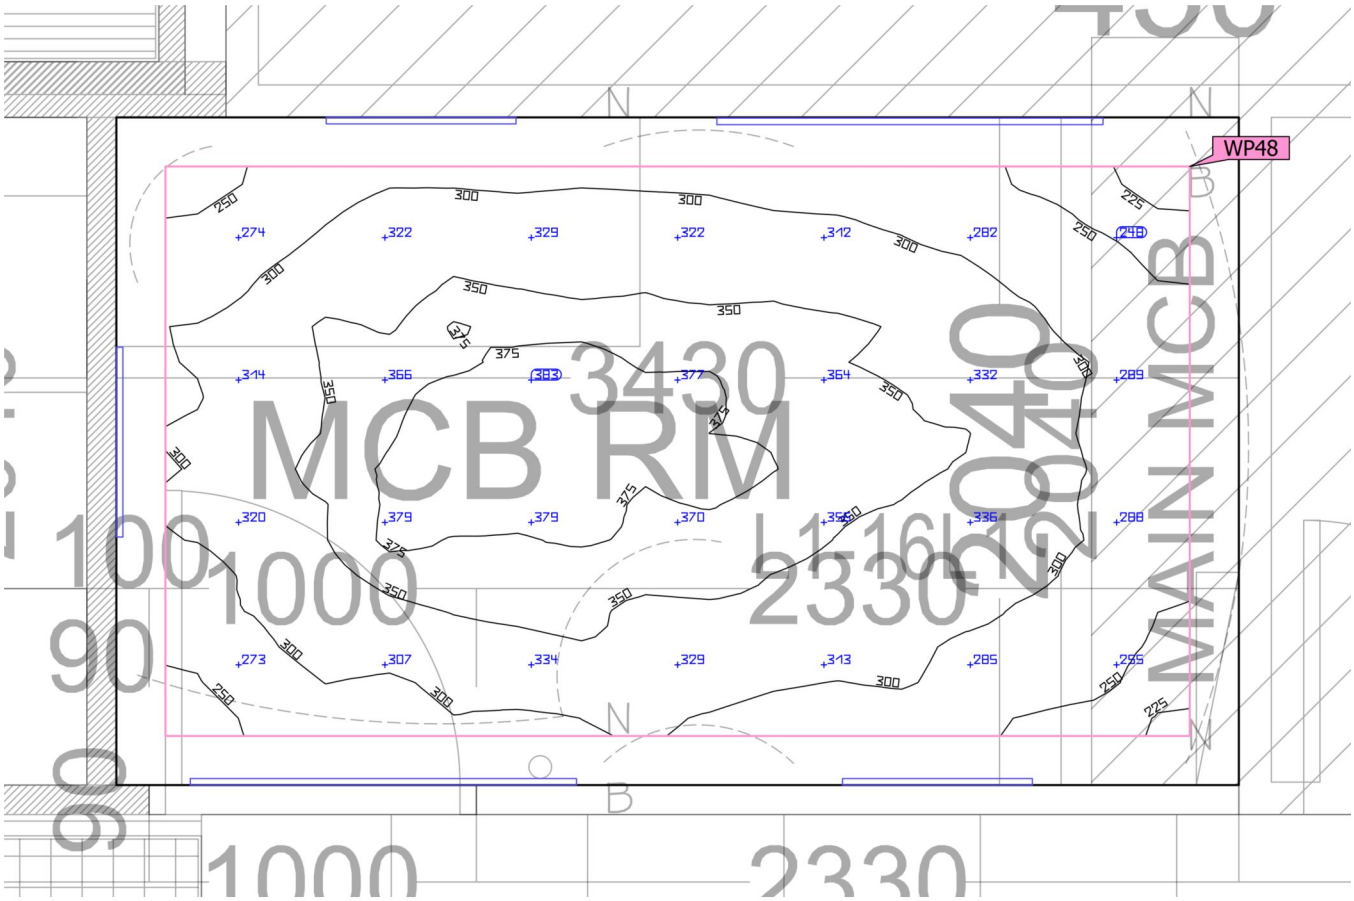

Ground area	7.00 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.500 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · MCB RM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	321 lx	WP48
	U_o (g_1)	0.67	WP48
	Lighting power density	10.47 W/m²	
		3.26 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	24	
Energy estimation(2)	Consumption	141 kWh/a	
Room	Lighting power density	8.15 W/m²	
		2.54 W/m²/100 lx	

(1) Based on a rectangular space of 2.040 m x 3.430 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	PROS		L25-PS-LB-1512B-16.5W-4000K-120D-WH-R90	24	16.5 W	2503 lm	151.7 lm/W
3	PROS		L25A-PS-LB-1512B-8W-4000K-120D-WH-R90	23	8.0 W	1051 lm	131.4 lm/W

Building 1 · Storey 1 · MCB RM (Light scene 1)

Working plane (MCB RM)

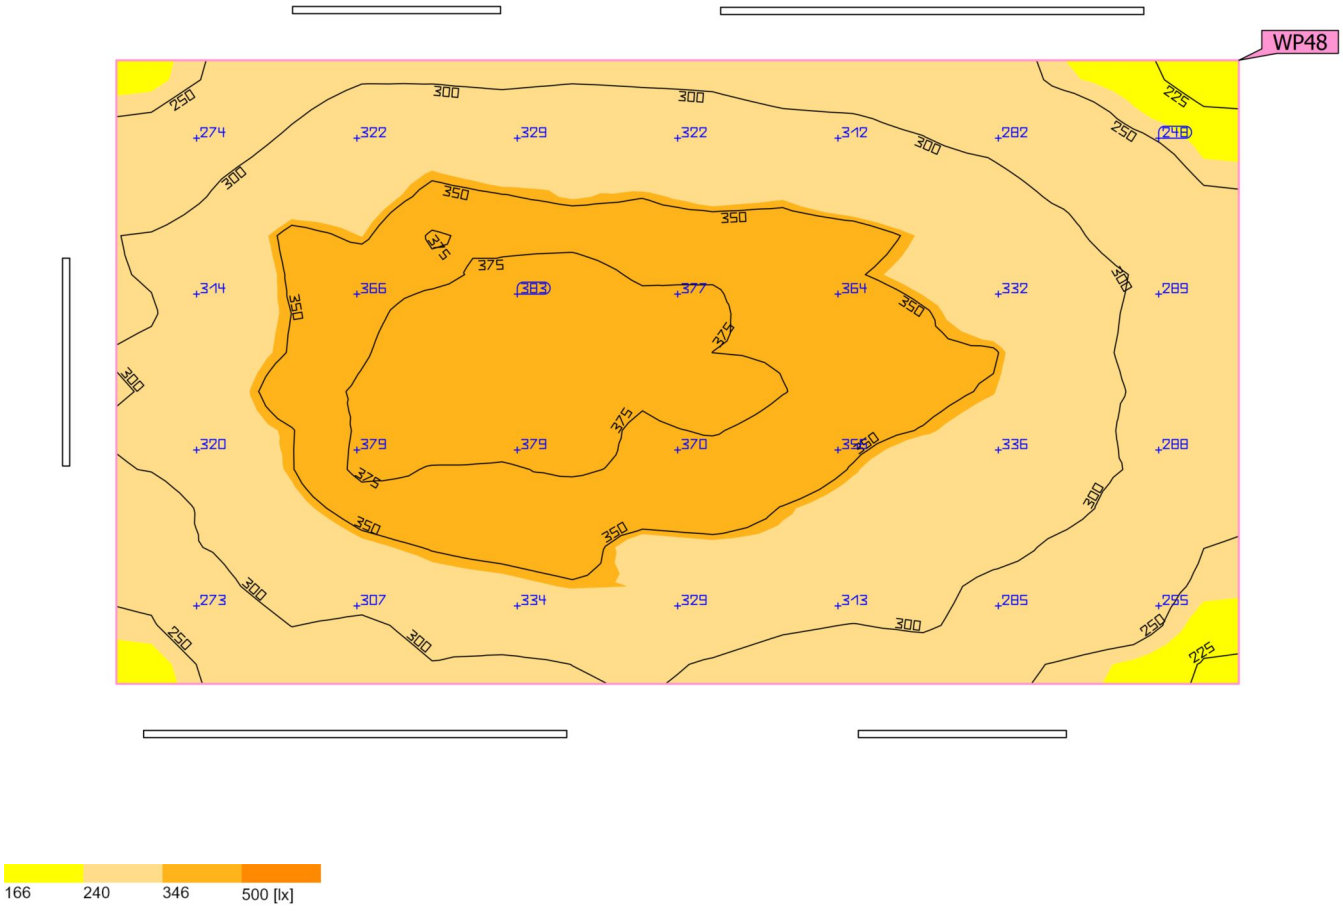

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (MCB RM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	321 lx	216 lx	392 lx	0.67	0.55	WP48

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · MEETING ROOM 1 (Light scene 1)

Summary

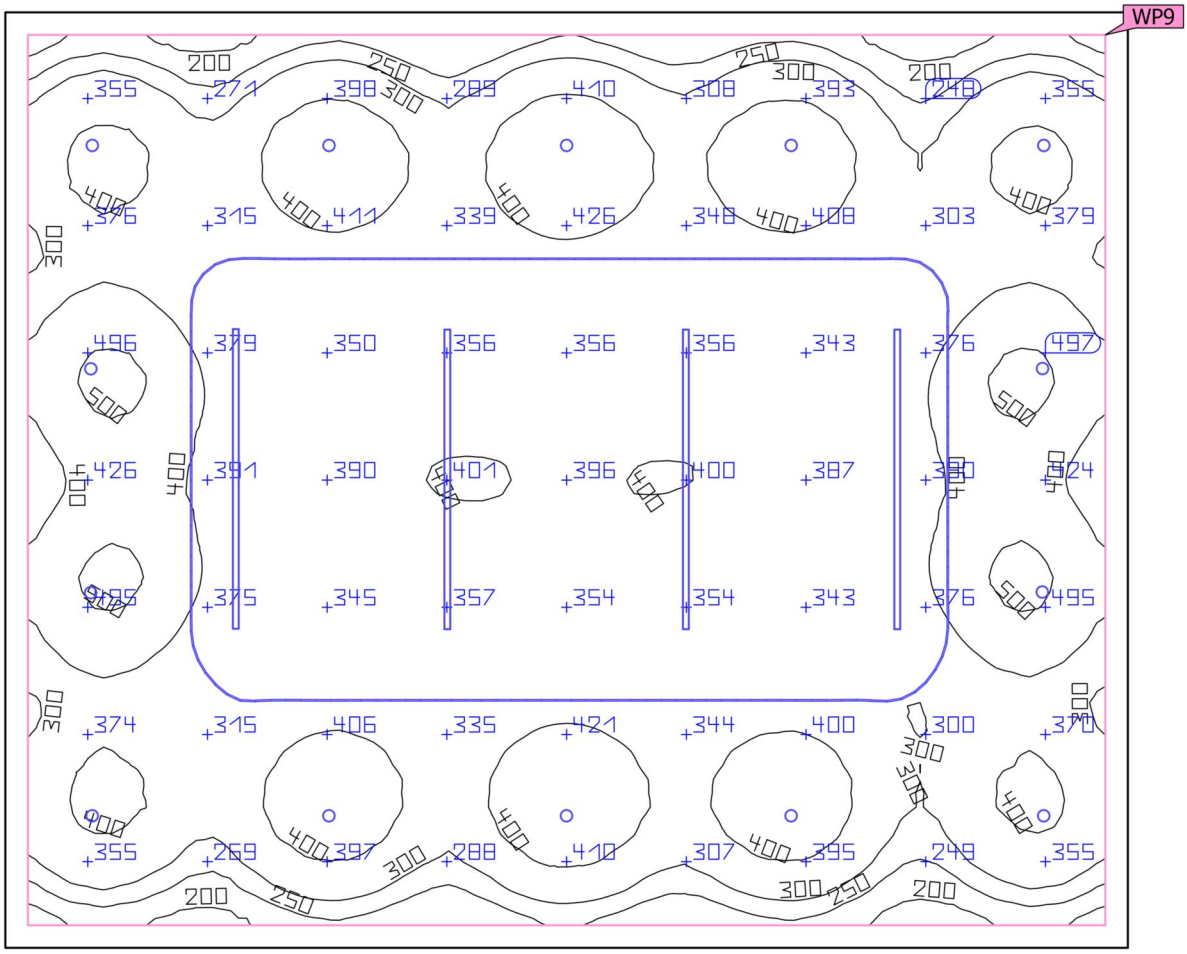

Ground area	46.56 m²	Clearance height	2.800 m – 5.500 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m – 2.830 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · MEETING ROOM 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	365 lx	WP9
	U_o (g_1)	0.47	WP9
	Lighting power density	9.73 W/m²	
		2.67 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	31	
Energy estimation(2)	Consumption	1024 kWh/a	
Room	Lighting power density	8.89 W/m²	
		2.44 W/m²/100 lx	

(1) Based on a rectangular space of 7.475 m x 6.229 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
14	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W
153	PROS		L13-PS-EF-2835-L100-10W-4000K-120D-R90	31	1.0 W	175 lm	175.2 lm/W
4	PROS		L21-PS-LPLR1.5FT-L2000-20W-4000K-120D-R90	26	40.0 W	3204 lm	80.1 lm/W

Building 1 · Storey 1 · MEETING ROOM 1 (Light scene 1)

Working plane (MEETING ROOM 1)



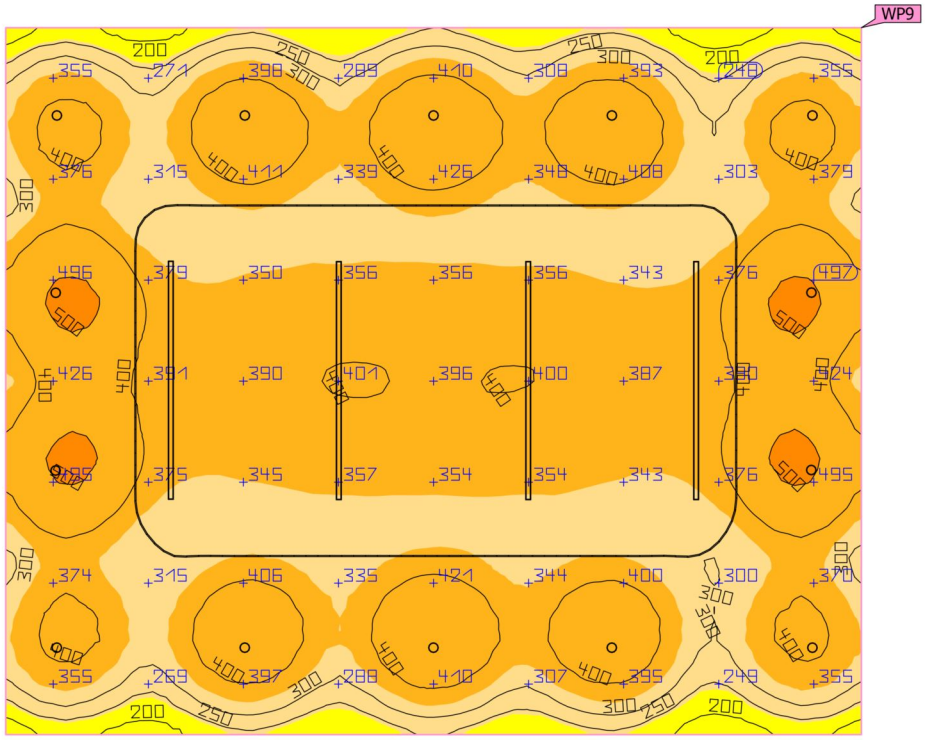

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (MEETING ROOM 1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	365 lx	173 lx	516 lx	0.47	0.34	WP9

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · MEETING ROOM 2 (Light scene 1)

Summary

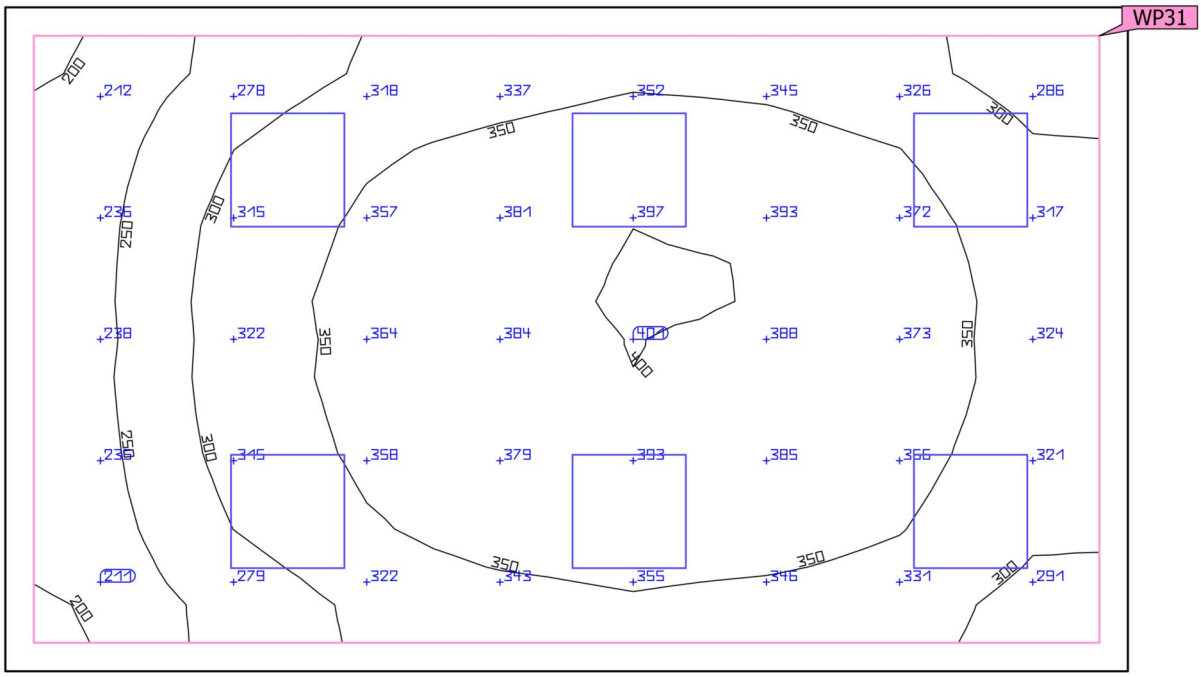

Ground area	20.71 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · MEETING ROOM 2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	331 lx	WP31
	U_o (g_1)	0.60	WP31
	Lighting power density	5.34 W/m²	
		1.61 W/m²/100 lx	
Energy estimation(2)	Consumption	238 kWh/a	
Room	Lighting power density	4.64 W/m²	
		1.40 W/m²/100 lx	

(1) Based on a rectangular space of 5.917 m x 3.500 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · MEETING ROOM 2 (Light scene 1)

Working plane (MEETING ROOM 2)

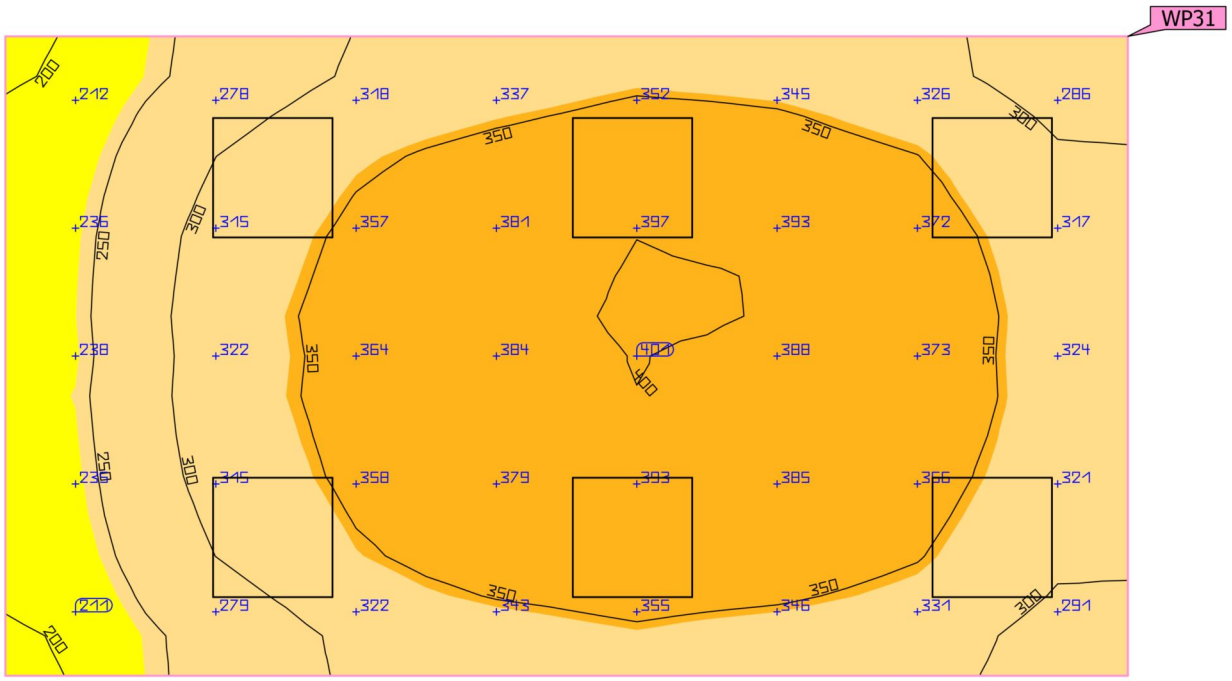

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (MEETING ROOM 2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	331 lx	197 lx	403 lx	0.60	0.49	WP31

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · OCC WORKSTATION (Light scene 1)

Summary

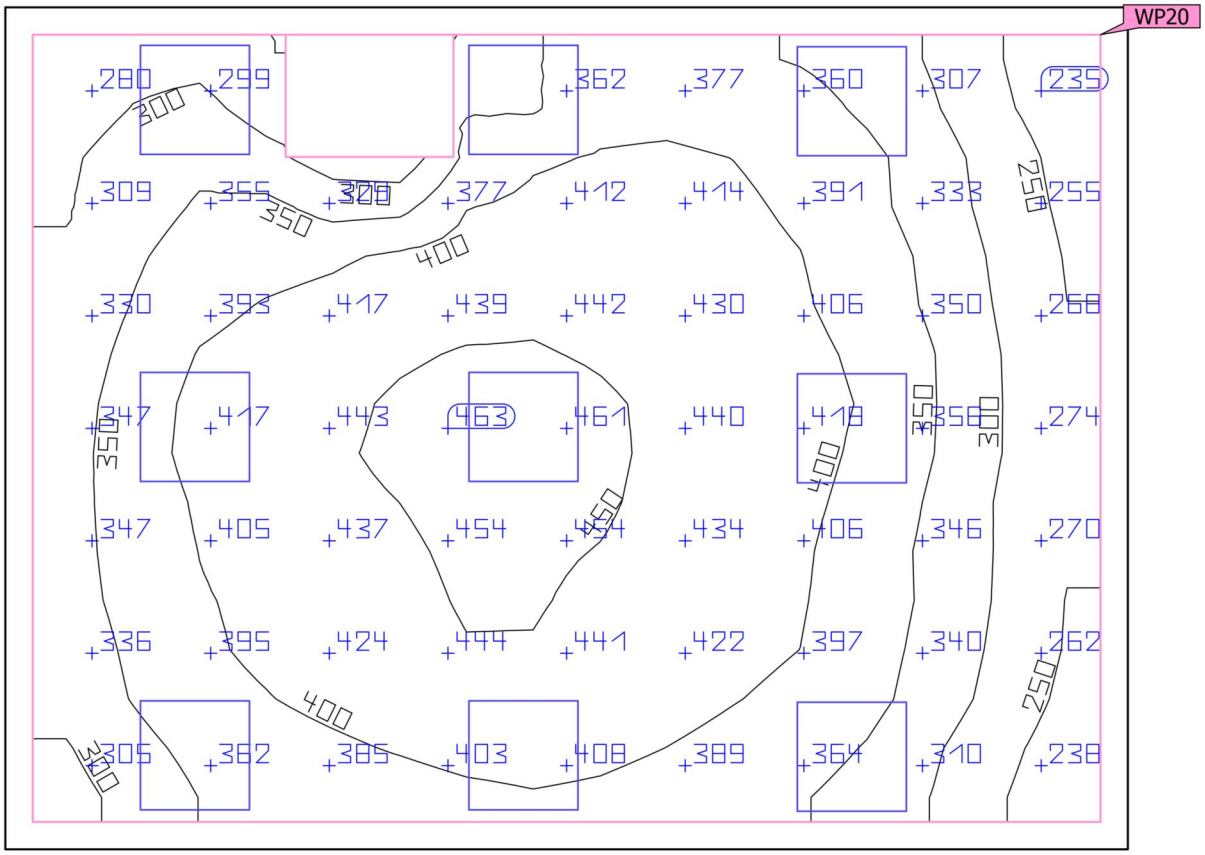

Ground area	28.39 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · OCC WORKSTATION (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	371 lx	WP20
	U_o (g_1)	0.58	WP20
	Lighting power density	5.70 W/m²	
		1.54 W/m²/100 lx	
Energy estimation(2)	Consumption	356 kWh/a	
Room	Lighting power density	5.07 W/m²	
		1.37 W/m²/100 lx	

(1) Based on a rectangular space of 6.153 m x 4.615 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
9	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · OCC WORKSTATION (Light scene 1)

Working plane (OCC WORKSTATION)



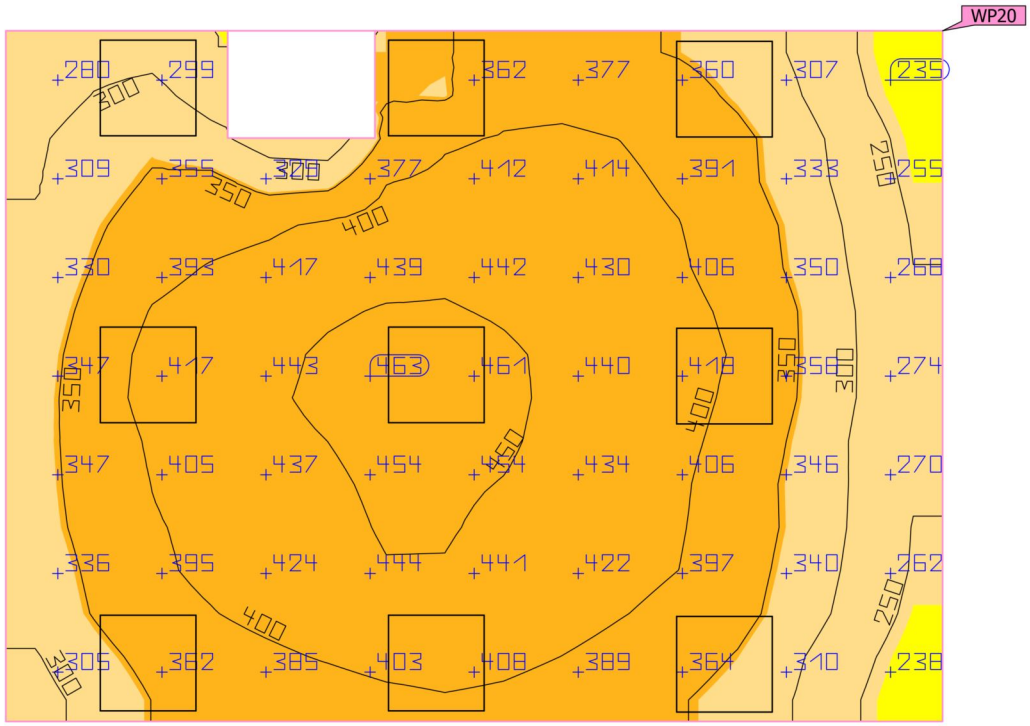

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (OCC WORKSTATION) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	371 lx	216 lx	468 lx	0.58	0.46	WP20

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · OFFICE 1 (Light scene 1)

Summary

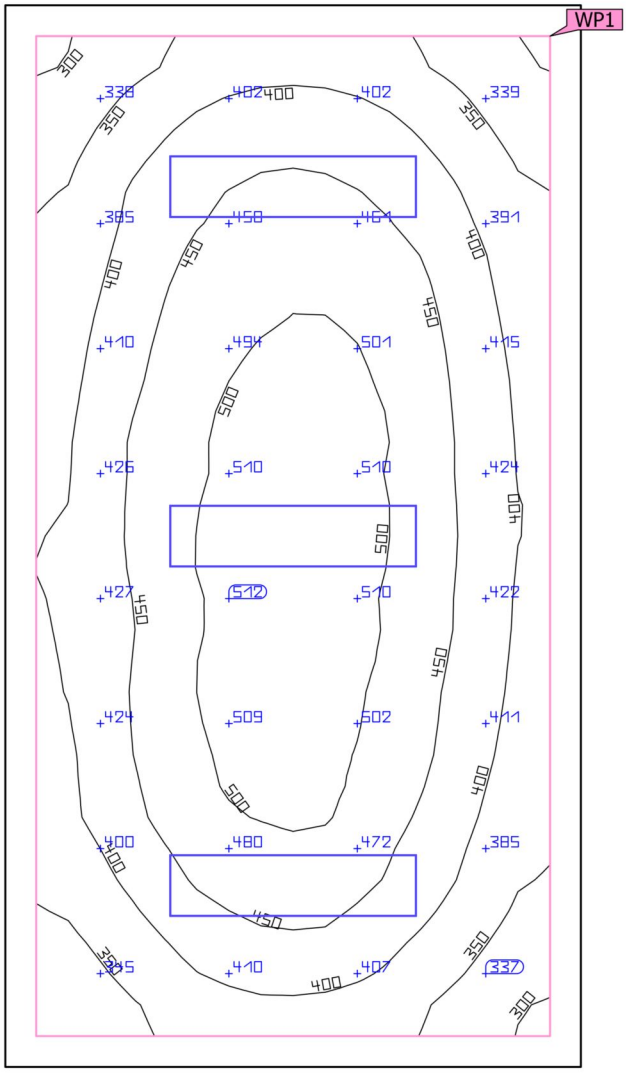

Ground area	14.46 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · OFFICE 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	431 lx	WP1
	U_o (g_1)	0.69	WP1
	Lighting power density	7.89 W/m²	
		1.83 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	19	
Energy estimation(2)	Consumption	238 kWh/a	
Room	Lighting power density	6.64 W/m²	
		1.54 W/m²/100 lx	

(1) Based on a rectangular space of 5.165 m x 2.800 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	19	32.0 W	4205 lm	131.4 lm/W

Building 1 · Storey 1 · OFFICE 1 (Light scene 1)

Working plane (OFFICE 1)



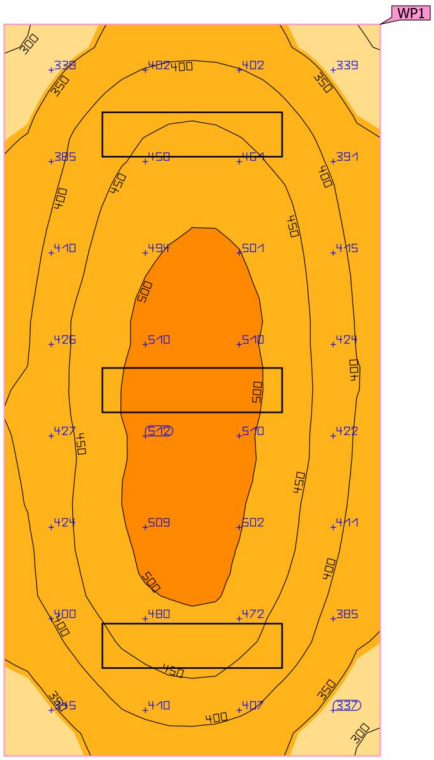



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (OFFICE 1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	431 lx	296 lx	528 lx	0.69	0.56	WP1

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · OFFICE 2 (Light scene 1)

Summary

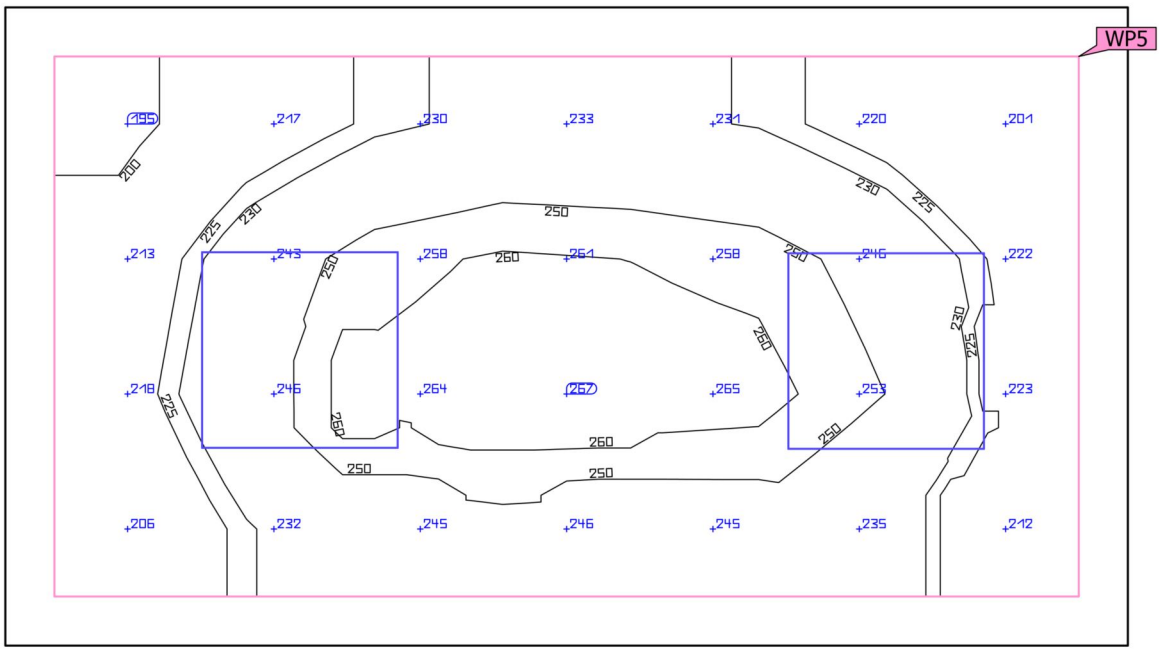

Ground area	6.69 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · OFFICE 2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	236 lx	WP5
	U_o (g_1)	0.82	WP5
	Lighting power density	6.20 W/m²	
		2.63 W/m²/100 lx	
Energy estimation(2)	Consumption	79.2 kWh/a	
Room	Lighting power density	4.78 W/m²	
		2.03 W/m²/100 lx	

(1) Based on a rectangular space of 1.950 m x 3.430 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · OFFICE 2 (Light scene 1)

Working plane (OFFICE 2)

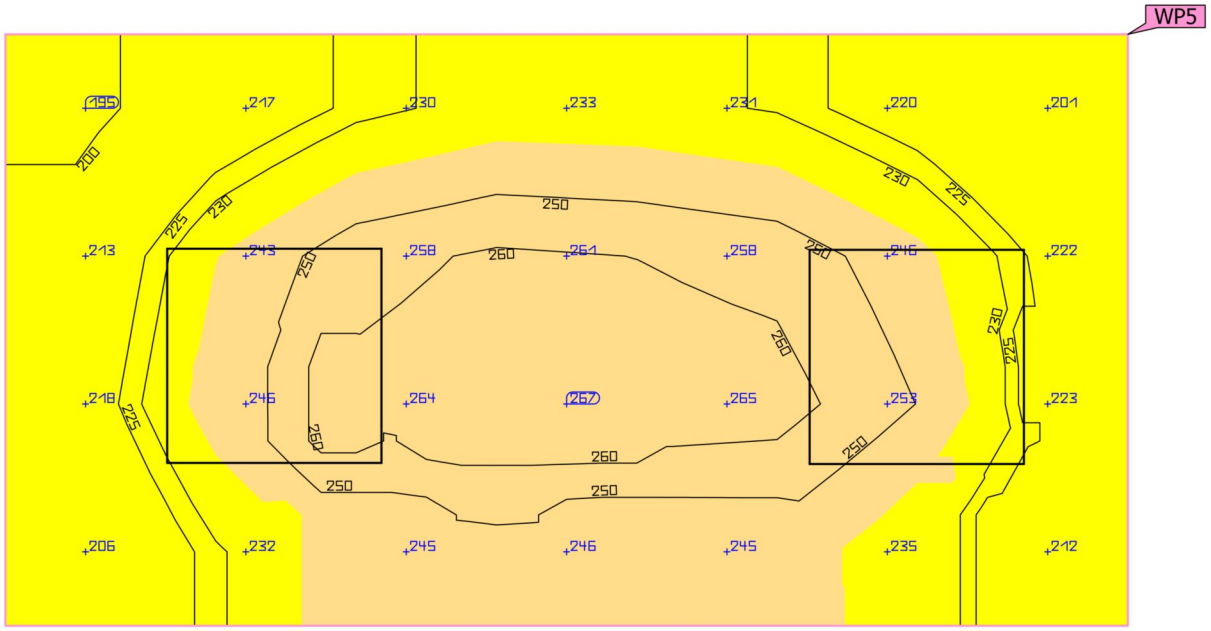

166 240 346 [lx]

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (OFFICE 2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	236 lx	193 lx	266 lx	0.82	0.73	WP5

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · OFFICE 3 (Light scene 1)

Summary

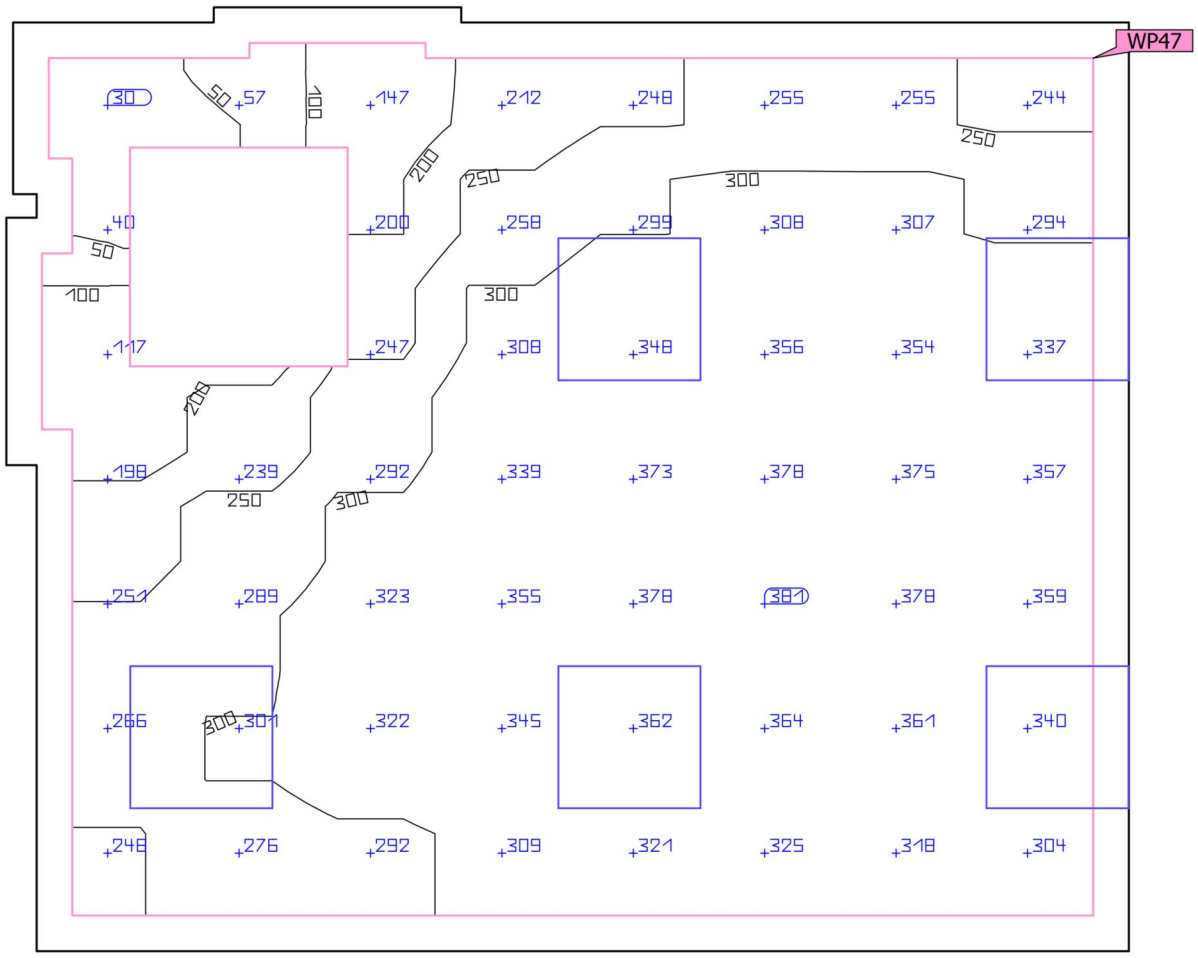

Ground area	18.21 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · OFFICE 3 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	298 lx	WP47
	U_o (g_1)	0.10	WP47
	Lighting power density	5.11 W/m²	
		1.71 W/m²/100 lx	
Energy estimation(2)	Consumption	198 kWh/a	
Room	Lighting power density	4.39 W/m²	
		1.47 W/m²/100 lx	

(1) Based on a rectangular space of 3.970 m x 4.720 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
5	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · OFFICE 3 (Light scene 1)

Working plane (OFFICE 3)



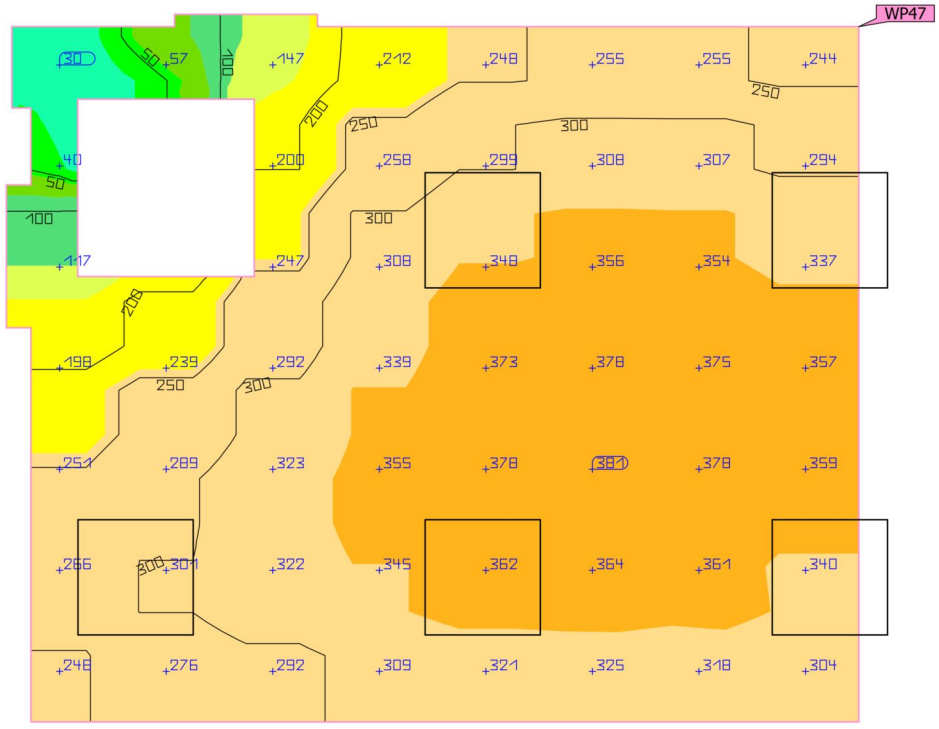

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (OFFICE 3) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	298 lx	30.1 lx	383 lx	0.10	0.079	WP47

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · PANTRY BREAKOUT FOR STAFF (Light scene 1)

Summary

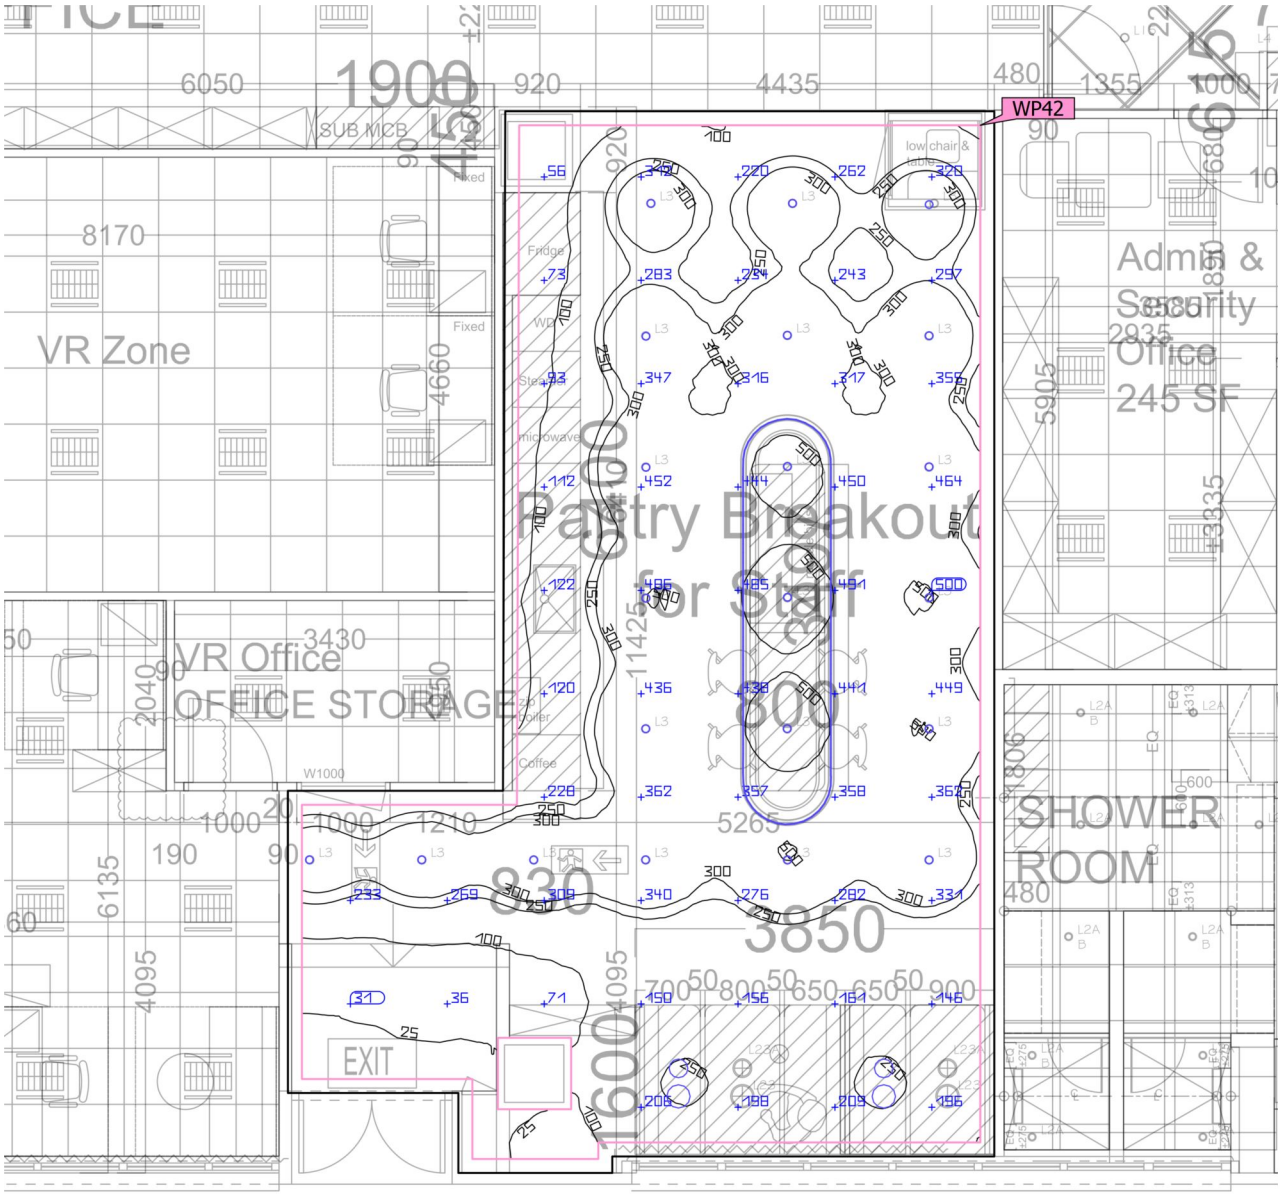

Ground area	66.96 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.200 m – 2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · PANTRY BREAKOUT FOR STAFF (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	279 lx	WP42
	U_o (g_1)	0.042	WP42
	Lighting power density	3.76 W/m²	
		1.35 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	30	
Energy estimation(2)	Consumption	570 kWh/a	
Room	Lighting power density	3.44 W/m²	
		1.23 W/m²/100 lx	

(1) Based on a rectangular space of 7.570 m x 11.377 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
98	PROS		L14-PS-A2835-120-S-L100-5W-3500K-120D-BK-R90	30	0.5 W	70 lm	140.2 lm/W
2	PROS		L23-PS-BJD7052-300-WH-6W-4000K-90D-GD-R90	–	6.0 W	550 lm	91.7 lm/W
2	PROS		L23A-PS-BJD7052-200-WH-6W-4000K-90D-GD-R90	–	6.0 W	550 lm	91.7 lm/W
21	PROS		L3-PS-KN-SL1001-WH-7.5W-4000K-36D-R90	11	7.5 W	630 lm	84.0 lm/W

Building 1 · Storey 1 · PANTRY BREAKOUT FOR STAFF (Light scene 1)

Working plane (PANTRY BREAKOUT FOR STAFF)



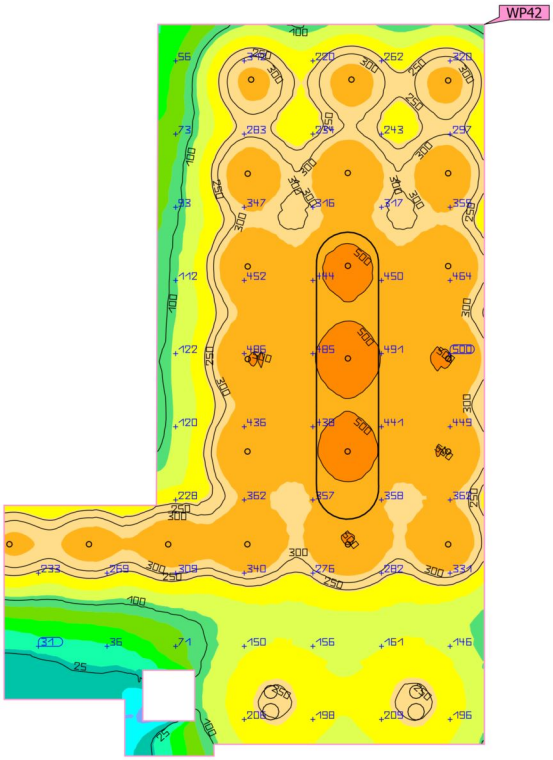



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (PANTRY BREAKOUT FOR STAFF) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	279 lx	11.7 lx	606 lx	0.042	0.019	WP42

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · PANTRY BREAKOUT FOR TRAINEE (Light scene 1)

Summary

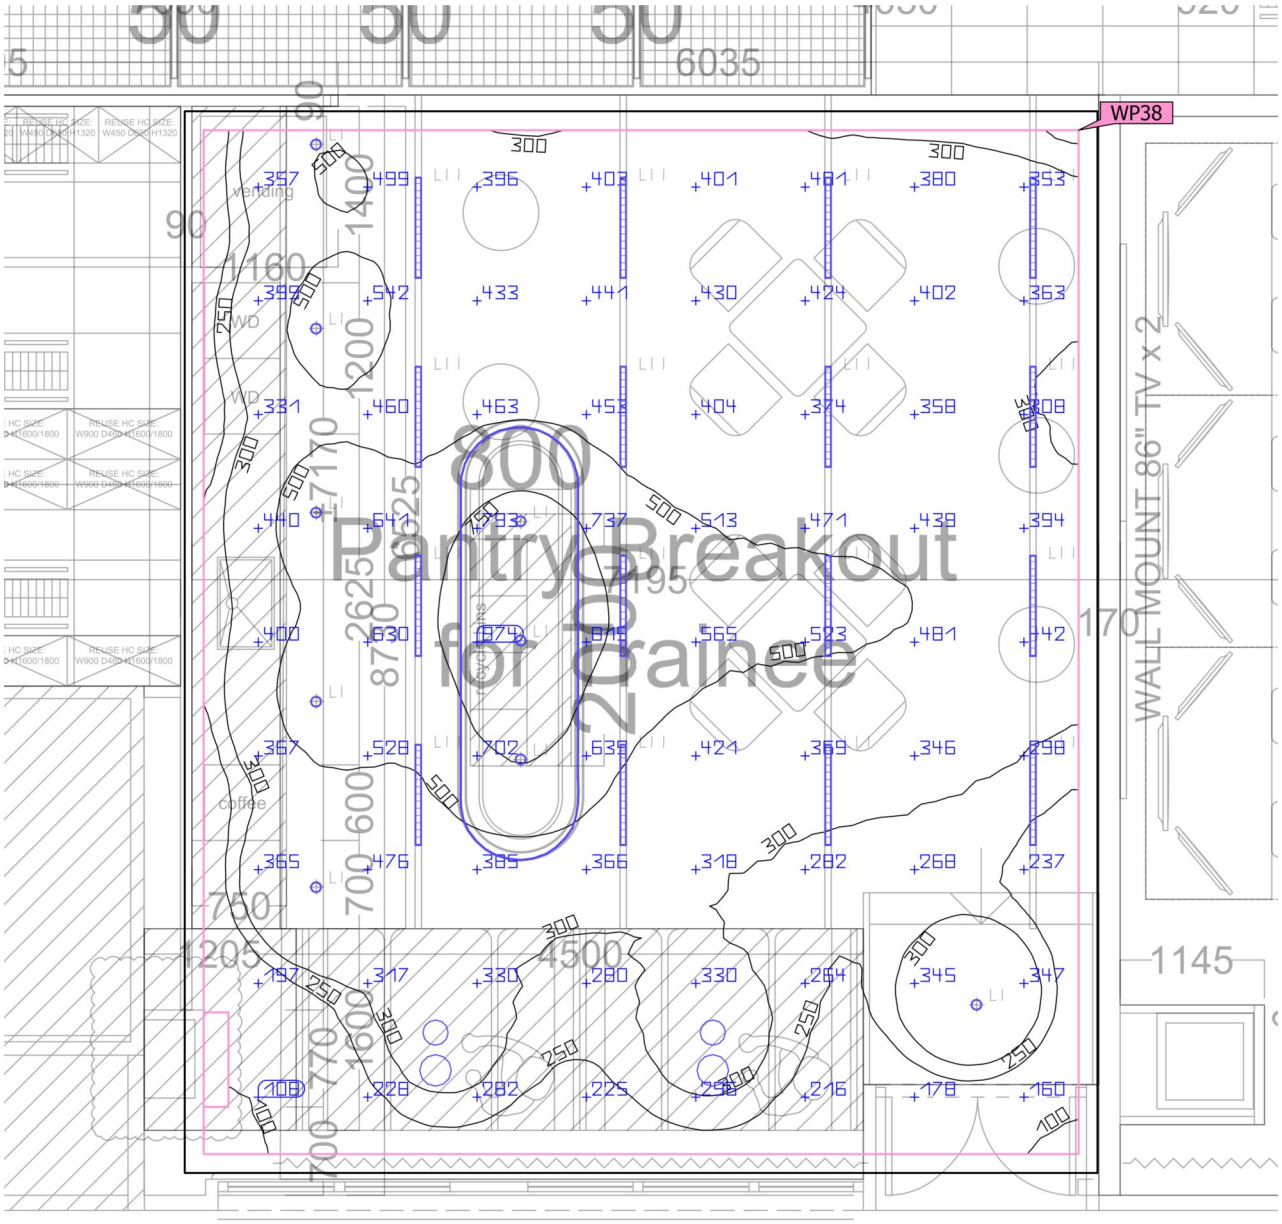

Ground area	61.01 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.200 m – 2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · PANTRY BREAKOUT FOR TRAINEE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	405 lx	WP38
	U_o (g_1)	0.16	WP38
	Lighting power density	5.83 W/m²	
		1.44 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	27	
Energy estimation(2)	Consumption	804 kWh/a	
Room	Lighting power density	5.39 W/m²	
		1.33 W/m²/100 lx	

(1) Based on a rectangular space of 8.424 m x 7.242 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
9	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W
8	PROS		L11-PS-KC-07-022A06000-15W-4000K-110D-BK-R90	–	15.0 W	1392 lm	92.8 lm/W
8	PROS		L12-PS-KC-07-021A12000-12W-4000K-35D-BK-R90	–	12.0 W	1188 lm	99.0 lm/W
80	PROS		L14A-PS-A2835-120-S-L100-2.5W-3500K-120D-BK-R90	27	0.3 W	35 lm	140.2 lm/W
2	PROS		L23-PS-BJD7052-300-WH-6W-4000K-90D-GD-R90	–	6.0 W	550 lm	91.7 lm/W
2	PROS		L23A-PS-BJD7052-200-WH-6W-4000K-90D-GD-R90	–	6.0 W	550 lm	91.7 lm/W

Building 1 · Storey 1 · PANTRY BREAKOUT FOR TRAINEE (Light scene 1)

Working plane (PANTRY BREAKOUT FOR TRAINEE)

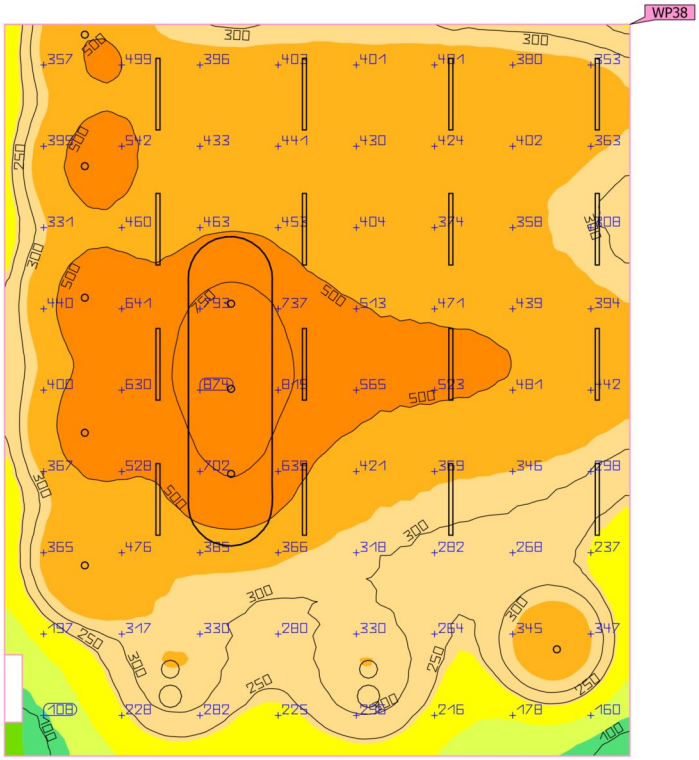

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (PANTRY BREAKOUT FOR TRAINEE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	405 lx	65.0 lx	975 lx	0.16	0.067	WP38

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · PRINTING AREA (Light scene 1)

Summary

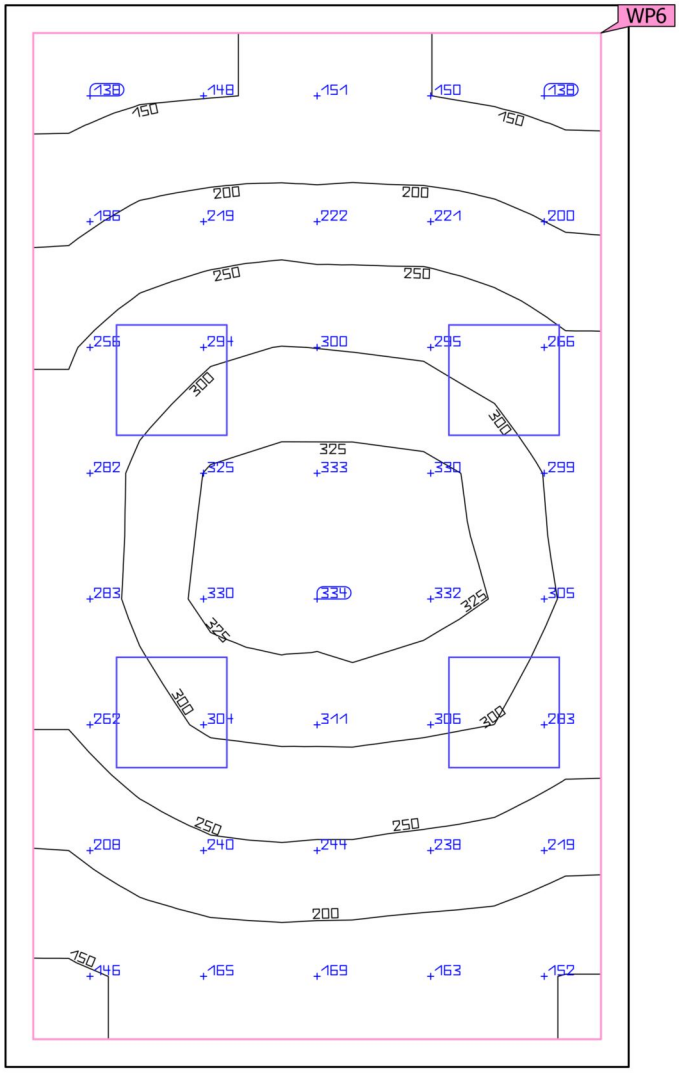

Ground area	19.41 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · PRINTING AREA (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	244 lx	WP6
	U_o (g_1)	0.55	WP6
	Lighting power density	3.82 W/m²	
		1.56 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	3.30 W/m²	
		1.35 W/m²/100 lx	

(1) Based on a rectangular space of 3.375 m x 5.750 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · PRINTING AREA (Light scene 1)

Working plane (PRINTING AREA)

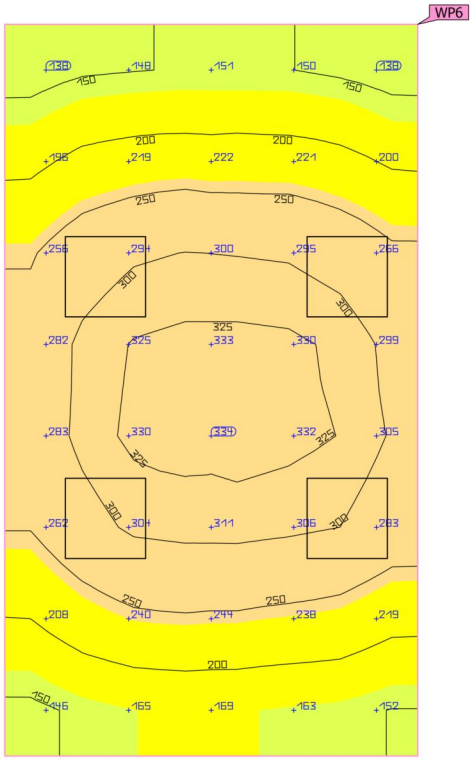



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (PRINTING AREA) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	244 lx	135 lx	335 lx	0.55	0.40	WP6

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · RECEPTION (Light scene 1)

Summary

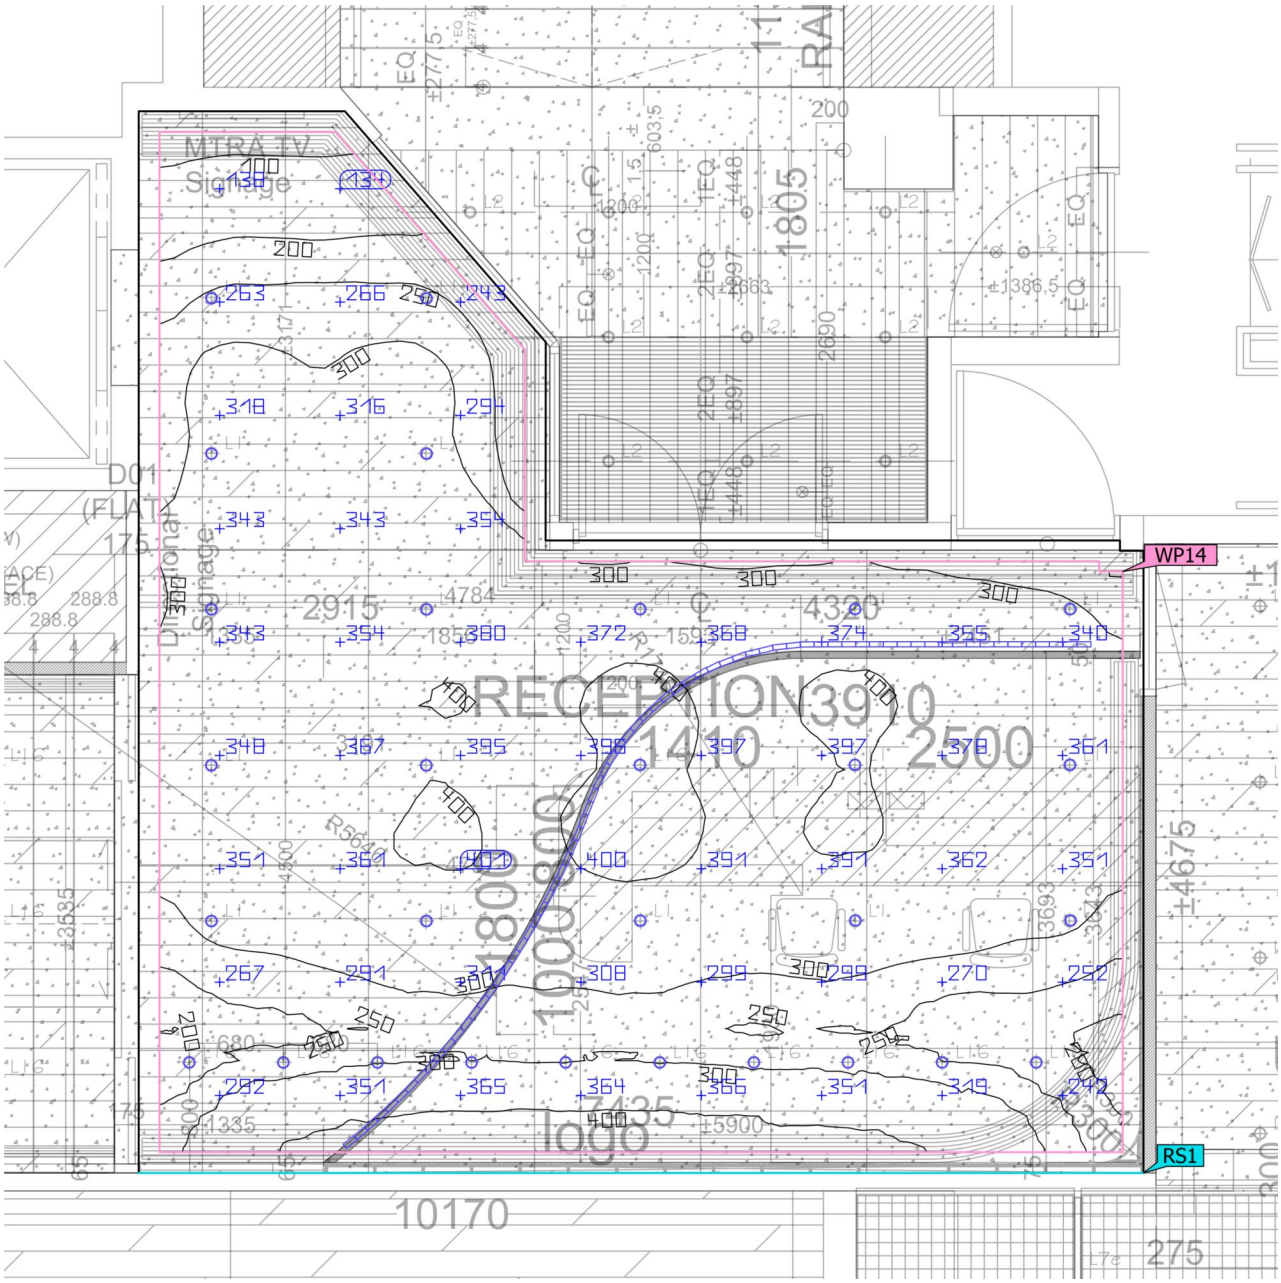

Ground area	41.07 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · RECEPTION (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	329 lx	WP14
	U_o (g_1)	0.24	WP14
	Lighting power density	8.93 W/m²	
		2.72 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	20	
Energy estimation(2)	Consumption	814 kWh/a	
Room	Lighting power density	8.00 W/m²	
		2.43 W/m²/100 lx	

(1) Based on a rectangular space of 7.260 m x 7.671 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
19	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W
10	PROS		L16-PS-AS-AC10937-WH-12W-4000K-WW-R90	–	12.0 W	869 lm	72.4 lm/W
72	PROS		L6-PS-EF-NA1826ST-L100-10W-4000K-120D-R90	20	1.0 W	35 lm	35.0 lm/W

Building 1 · Storey 1 · RECEPTION (Light scene 1)

Working plane (RECEPTION)



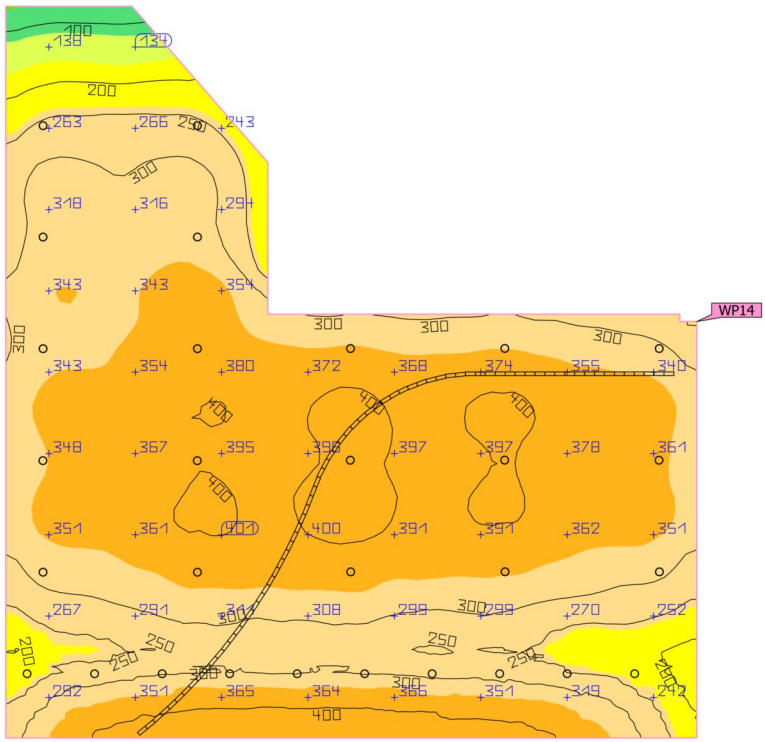

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (RECEPTION) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	329 lx	78.7 lx	454 lx	0.24	0.17	WP14

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · SAFETY EXPERIENTIAL CENTRE (Light scene 1)

Summary

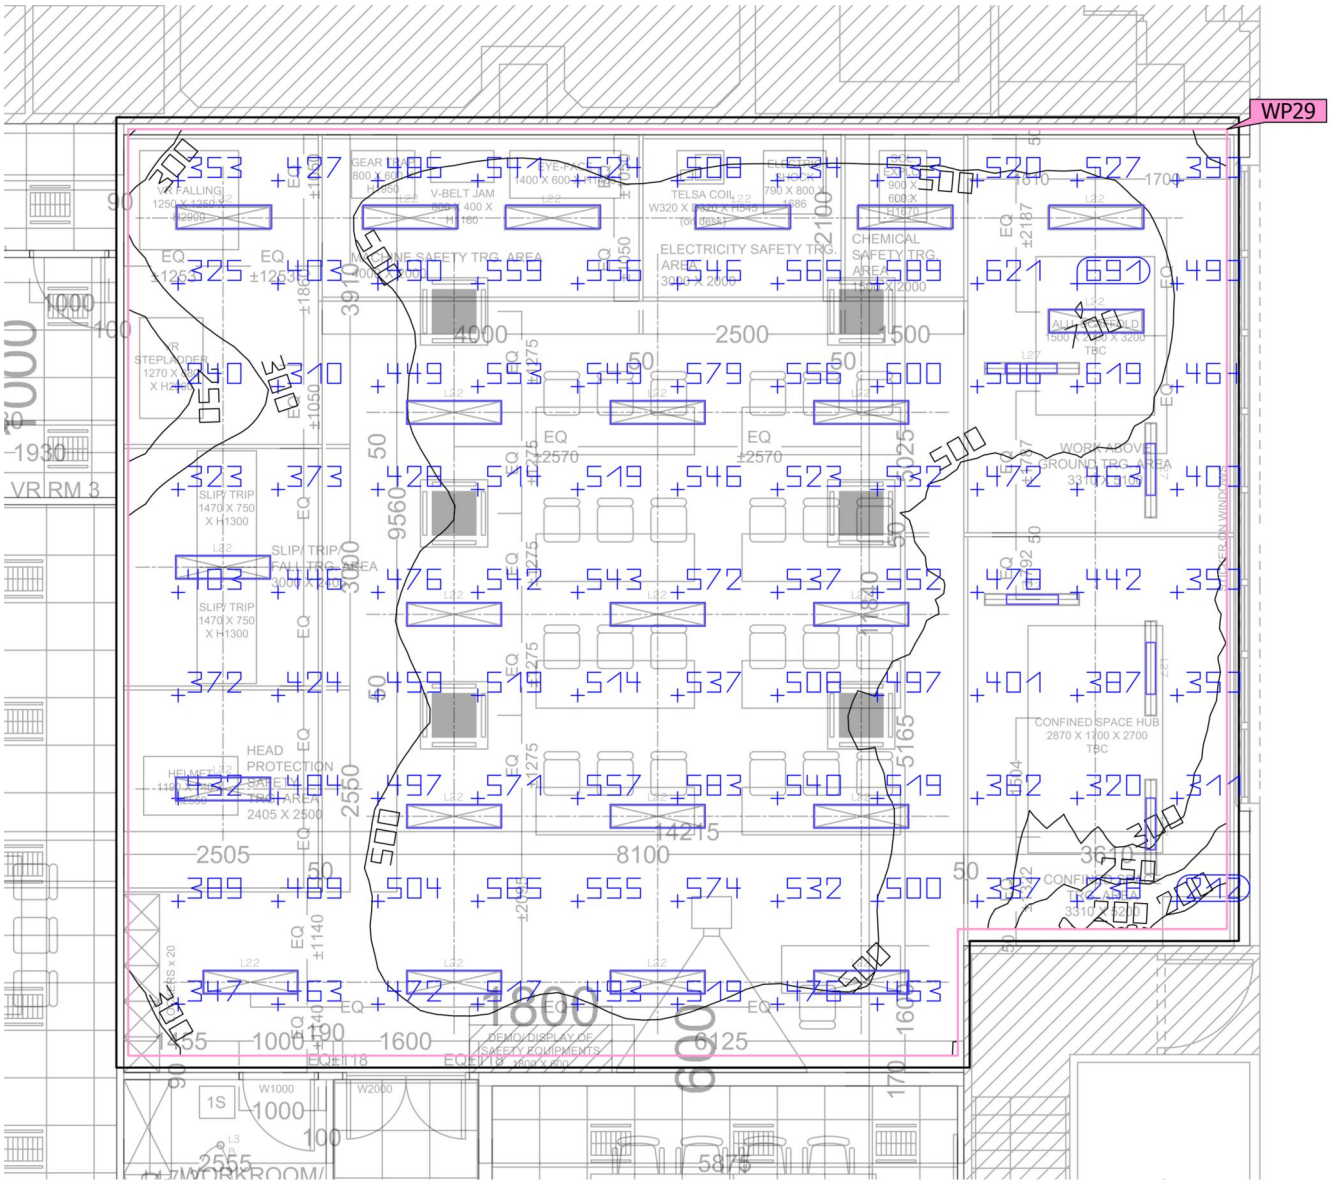

Ground area	164.60 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · SAFETY EXPERIENTIAL CENTRE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	476 lx	WP29
	U_o (g_1)	0.36	WP29
	Lighting power density	5.00 W/m²	
		1.05 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	26	
Energy estimation(2)	Consumption	1940 kWh/a	
Room	Lighting power density	4.76 W/m²	
		1.00 W/m²/100 lx	

(1) Based on a rectangular space of 14.171 m x 11.999 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
22	PROS		L22-PS-PNRC14-T5-32W-4000K-120D-WH-R90	24	32.0 W	4205 lm	131.4 lm/W
5	PROS		L27-PS-SY6118-LED-9-2×8W-4000K-120D-WH-R90	26	16.0 W	2102 lm	131.4 lm/W

Building 1 · Storey 1 · SAFETY EXPERIENTIAL CENTRE (Light scene 1)

Working plane (SAFETY EXPERIENTIAL CENTRE)



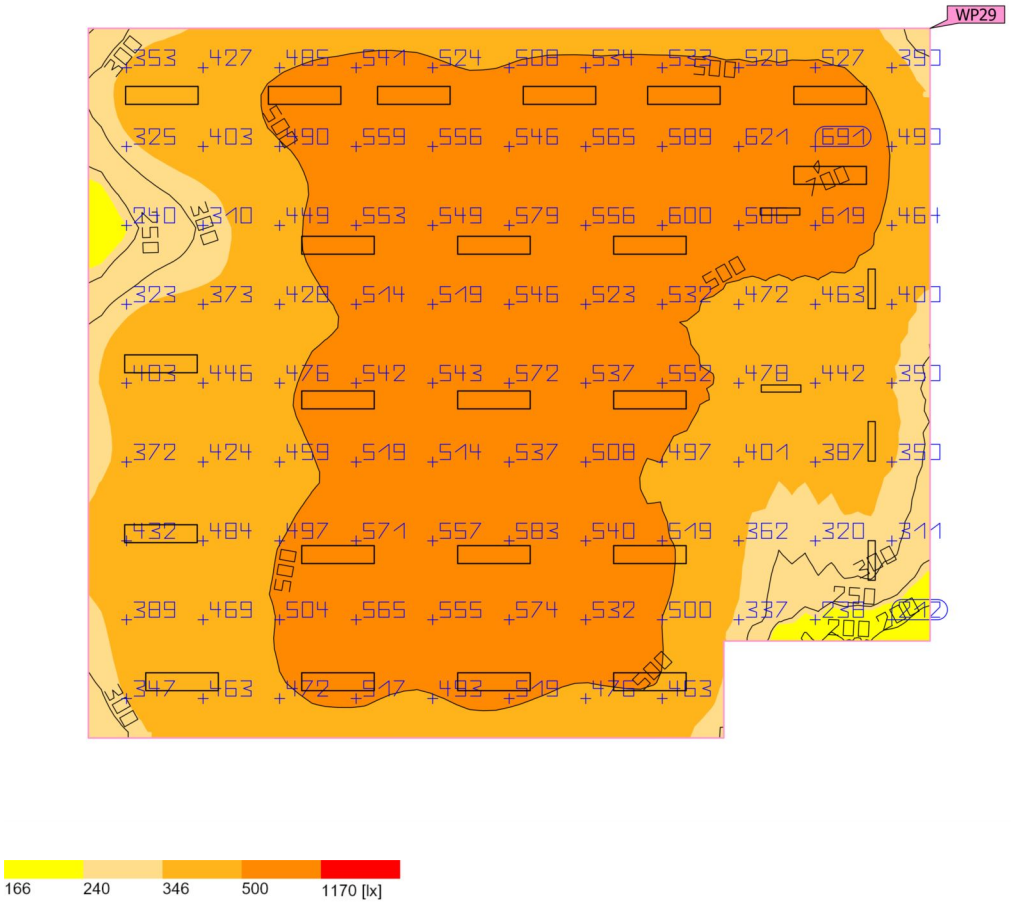

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (SAFETY EXPERIENTIAL CENTRE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	476 lx	170 lx	702 lx	0.36	0.24	WP29

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · SERVER (Light scene 1)

Summary

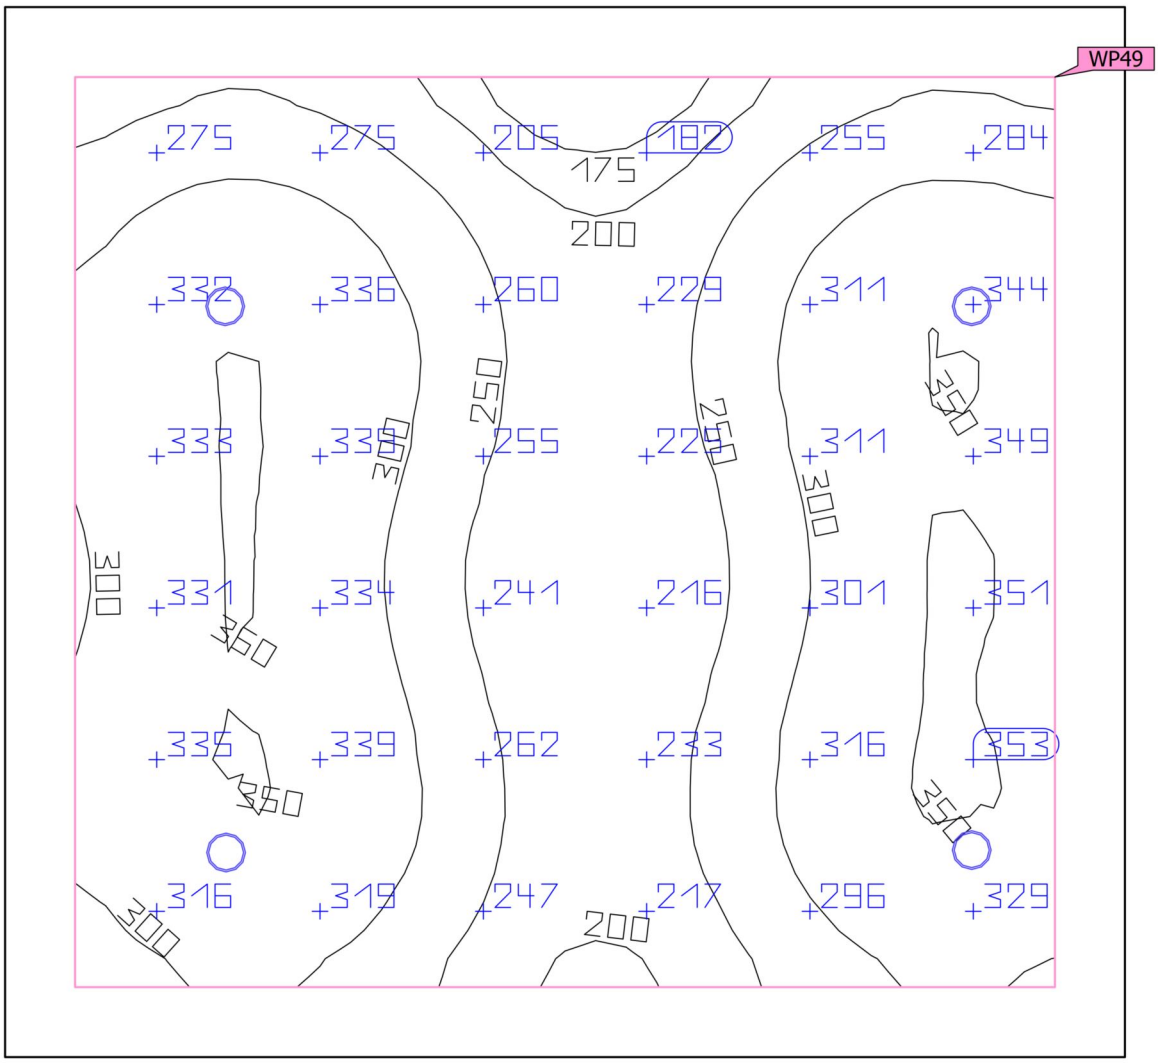

Ground area	5.40 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · SERVER (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	288 lx	WP49
	U_o (g_1)	0.54	WP49
	Lighting power density	7.03 W/m²	
		2.44 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	71.3 kWh/a	
Room	Lighting power density	5.33 W/m²	
		1.85 W/m²/100 lx	

(1) Based on a rectangular space of 2.400 m x 2.250 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L1-PS-YL-2260-WH-7.2W-4000K-36D-R90	12	7.2 W	630 lm	87.5 lm/W

Building 1 · Storey 1 · SERVER (Light scene 1)

Working plane (SERVER)



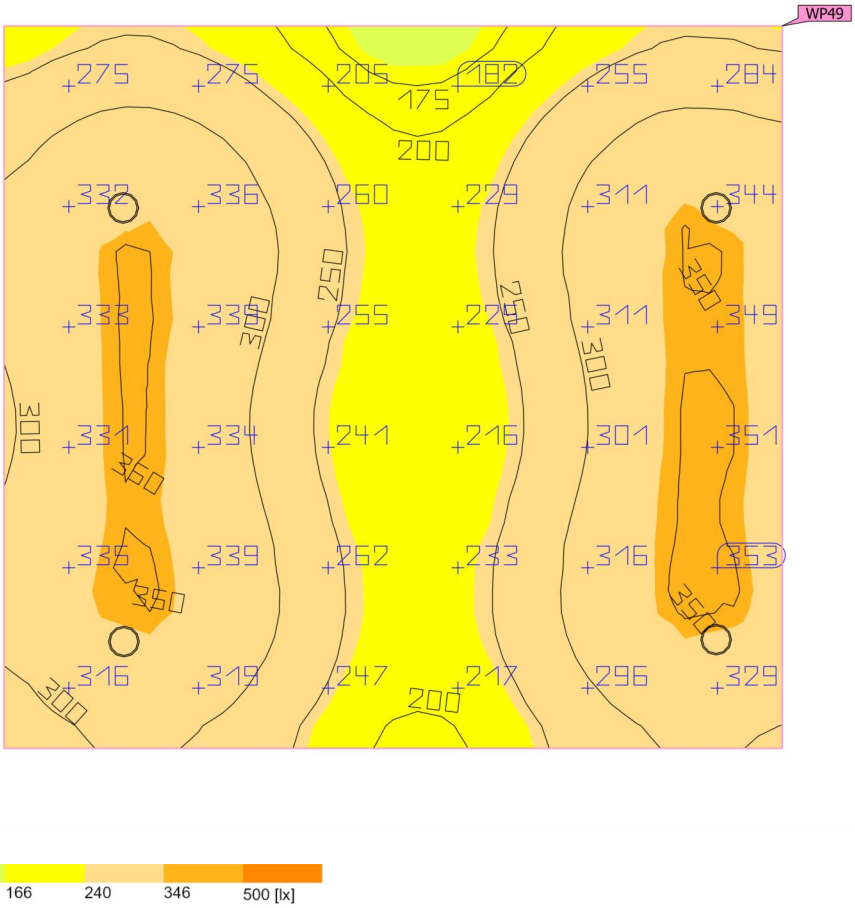

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (SERVER) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	288 lx	155 lx	354 lx	0.54	0.44	WP49

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · SHOWER ROOM (Light scene 1)

Summary

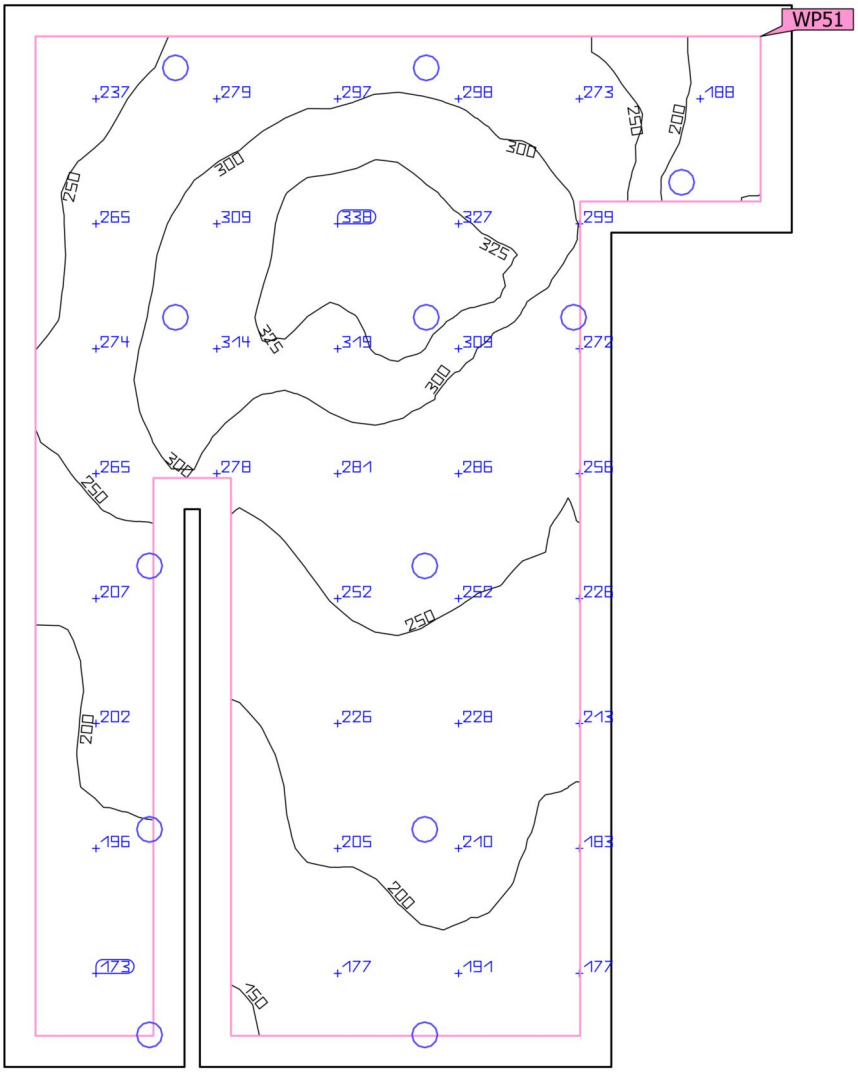

Ground area	15.73 m²	Clearance height	2.400 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.400 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · SHOWER ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	250 lx	WP51
	U_o (g_1)	0.58	WP51
	Lighting power density	8.75 W/m²	
		3.51 W/m²/100 lx	
Energy estimation(2)	Consumption	267 kWh/a	
Room	Lighting power density	6.87 W/m²	
		2.75 W/m²/100 lx	

(1) Based on a rectangular space of 5.118 m x 3.796 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
12	PROS		L2A-PS-KS-DL03-WH-9W-4000K-90D-R90	–	9.0 W	855 lm	95.0 lm/W

Building 1 · Storey 1 · SHOWER ROOM (Light scene 1)

Working plane (SHOWER ROOM)



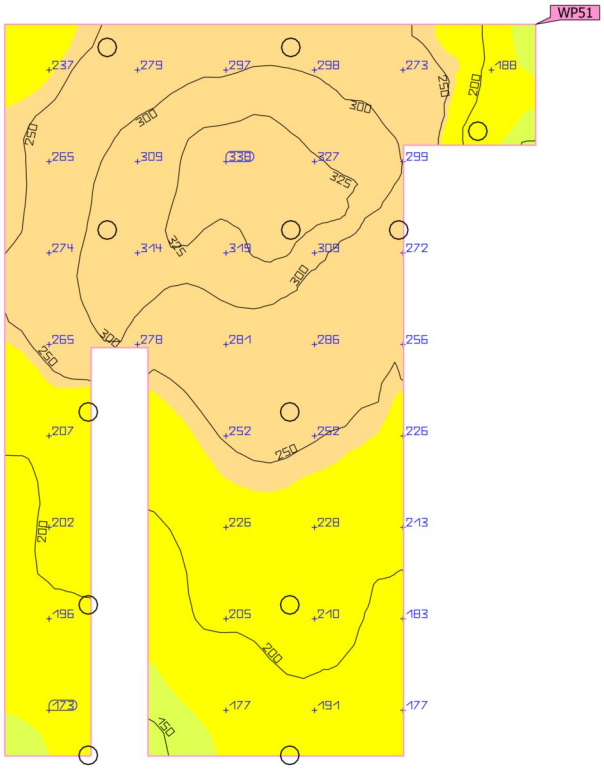

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (SHOWER ROOM) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	250 lx	144 lx	338 lx	0.58	0.43	WP51

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · STAFF OFFICE (Light scene 1)

Summary

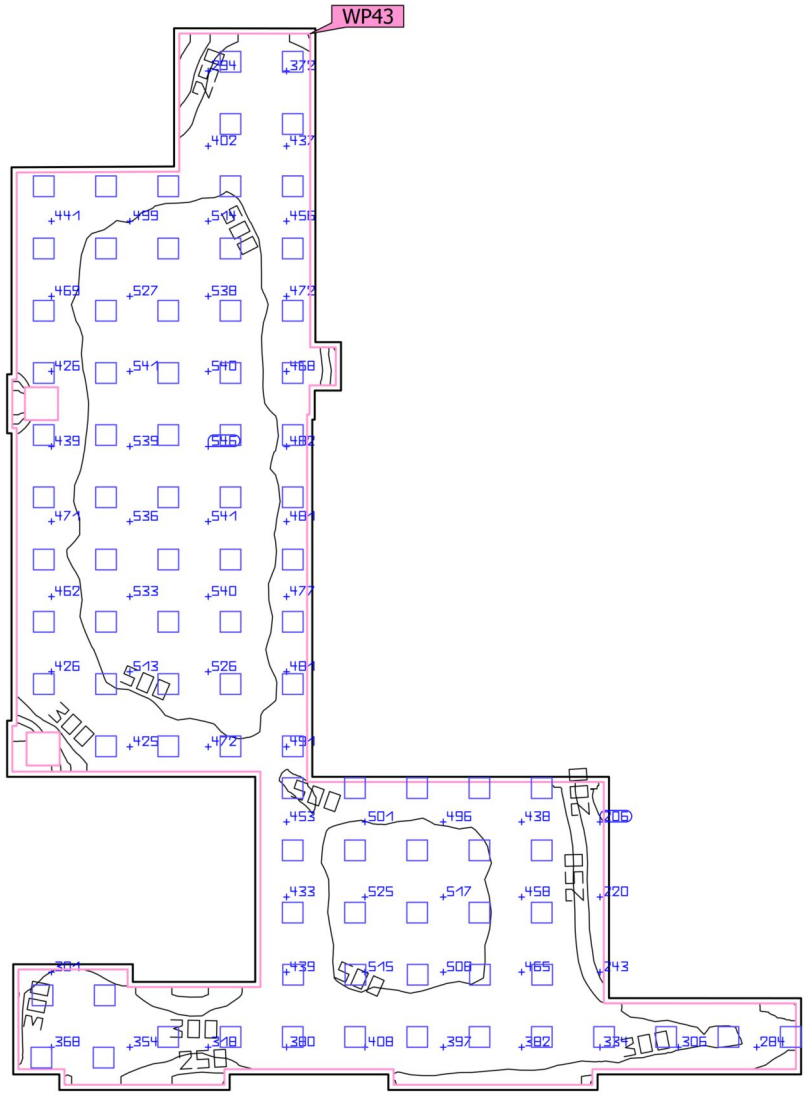

Ground area	297.57 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · STAFF OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	445 lx	WP43
	U_o (g_1)	0.065	WP43
	Lighting power density	5.05 W/m²	
		1.13 W/m²/100 lx	
Energy estimation(2)	Consumption	3485 kWh/a	
Room	Lighting power density	4.73 W/m²	
		1.06 W/m²/100 lx	

(1) Based on a rectangular space of 22.960 m x 30.701 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
88	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · STAFF OFFICE (Light scene 1)

Working plane (STAFF OFFICE)



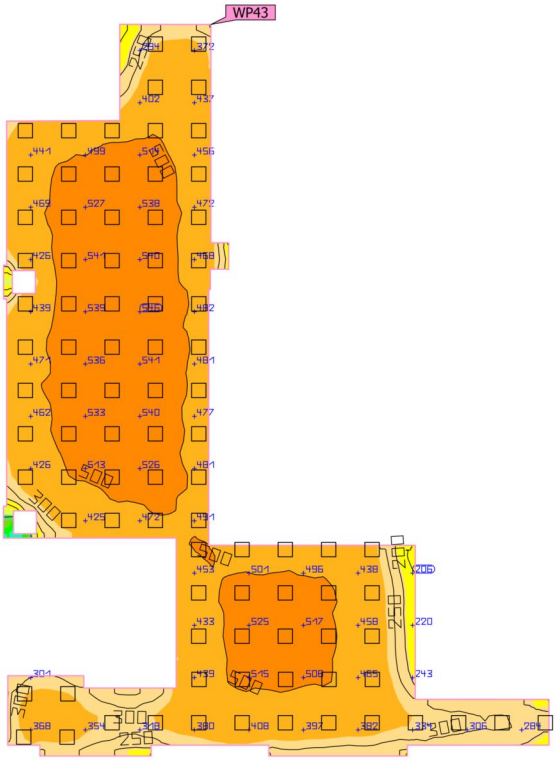



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (STAFF OFFICE) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	445 lx	29.1 lx	559 lx	0.065	0.052	WP43

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · STATION CONTROL ROOM (Light scene 1)

Summary

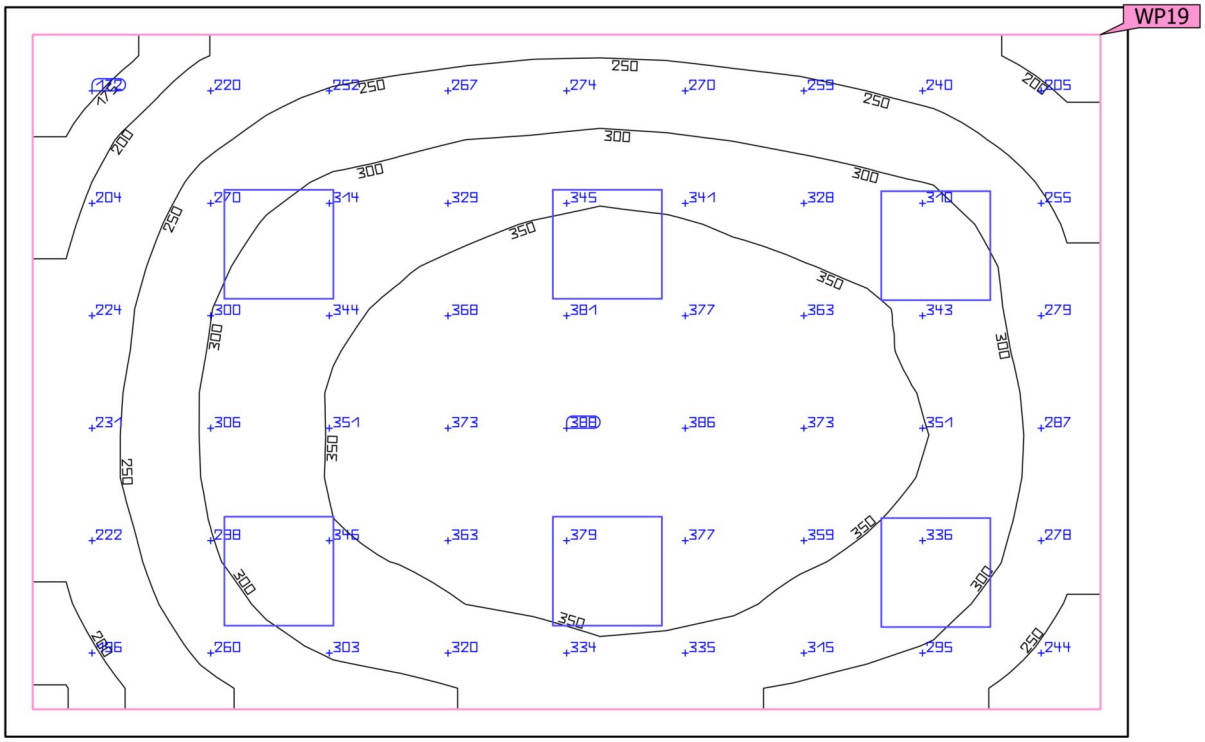

Ground area	24.61 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · STATION CONTROL ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	304 lx	WP19
	U_o (g_1)	0.50	WP19
	Lighting power density	4.43 W/m²	
		1.46 W/m²/100 lx	
Energy estimation(2)	Consumption	238 kWh/a	
Room	Lighting power density	3.90 W/m²	
		1.28 W/m²/100 lx	

(1) Based on a rectangular space of 6.153 m x 4.000 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · STATION CONTROL ROOM (Light scene 1)

Working plane (STATION CONTROL ROOM)

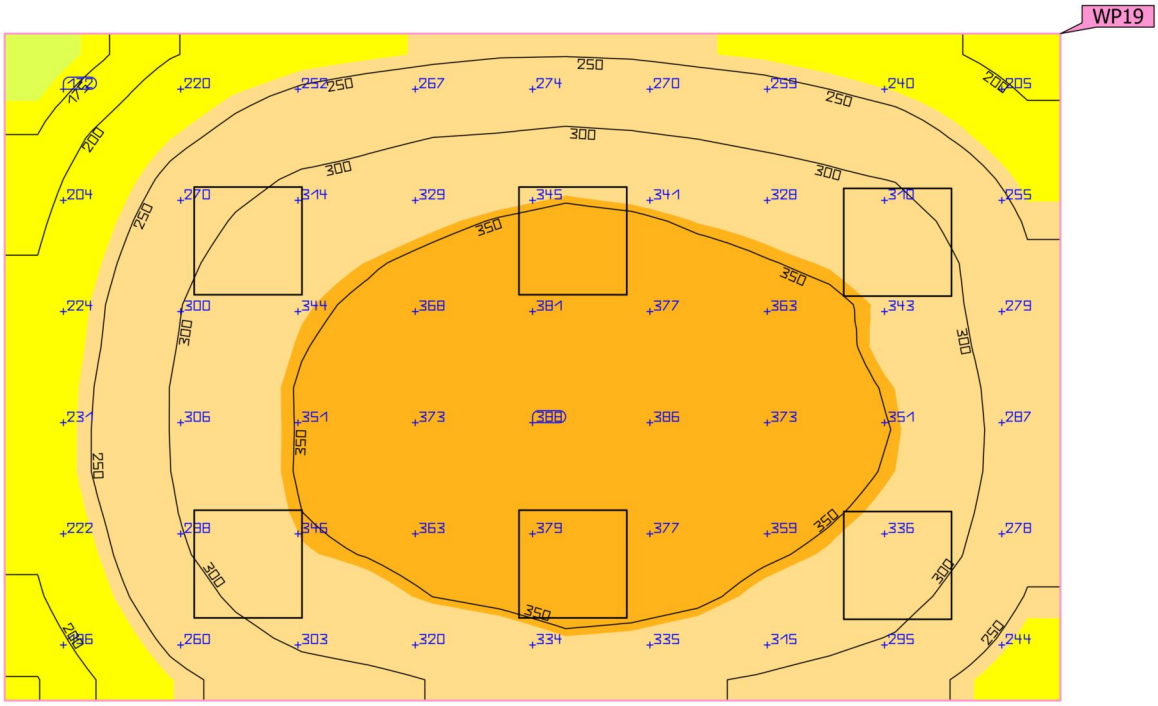

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (STATION CONTROL ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	304 lx	153 lx	390 lx	0.50	0.39	WP19

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · STORAGE & EQUIPMENT ROOM (Light scene 1)

Summary

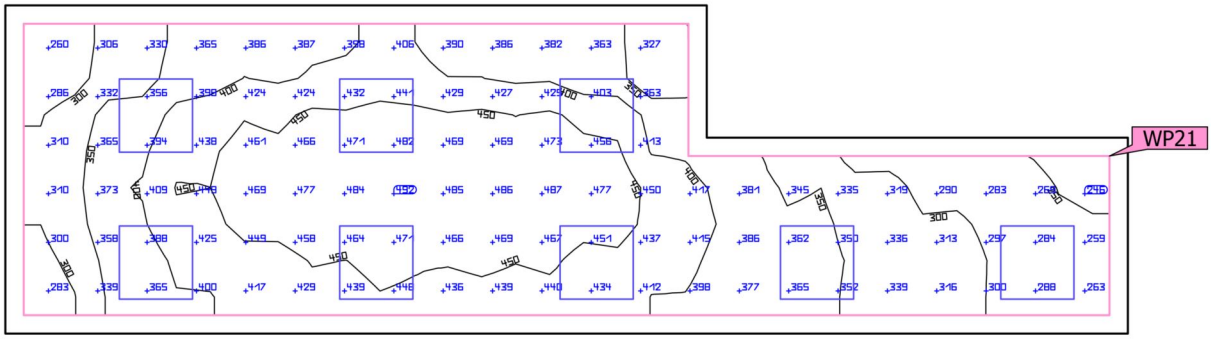

Ground area	20.86 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · STORAGE & EQUIPMENT ROOM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	388 lx	WP21
	U_o (g_1)	0.60	WP21
	Lighting power density	7.36 W/m²	
		1.90 W/m²/100 lx	
Energy estimation(2)	Consumption	317 kWh/a	
Room	Lighting power density	6.14 W/m²	
		1.58 W/m²/100 lx	

(1) Based on a rectangular space of 9.170 m x 2.680 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · STORAGE & EQUIPMENT ROOM (Light scene 1)

Working plane (STORAGE & EQUIPMENT ROOM)

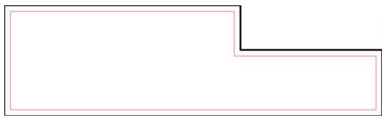

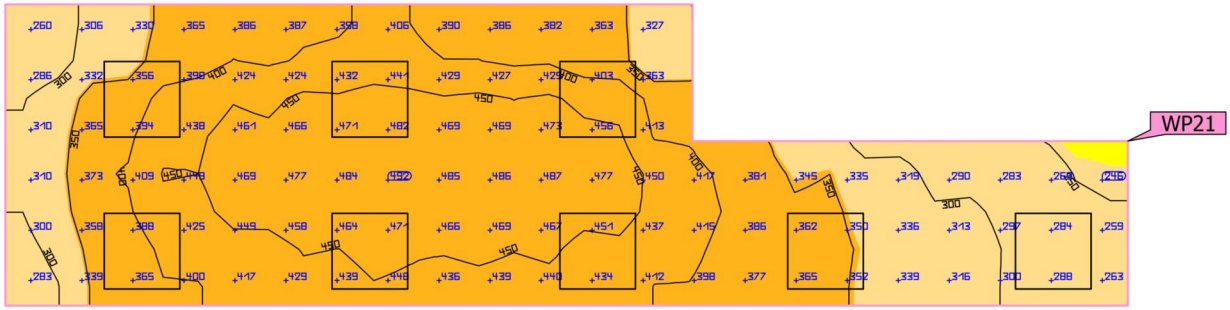



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (STORAGE & EQUIPMENT ROOM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	388 lx	232 lx	492 lx	0.60	0.47	WP21

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · STORE ROOM 1 (Light scene 1)

Summary

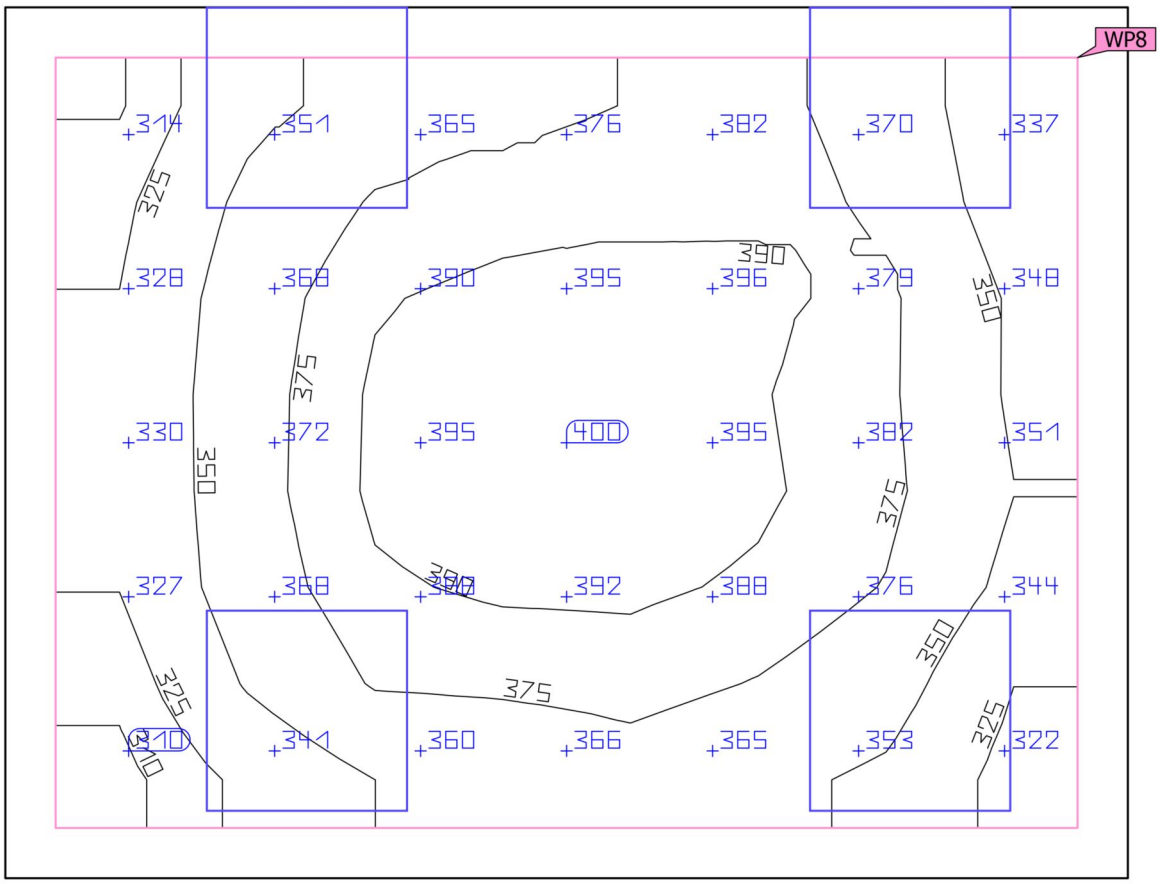

Ground area	8.71 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · STORE ROOM 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	364 lx	WP8
	U_o (g_1)	0.83	WP8
	Lighting power density	9.12 W/m²	
		2.50 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	7.35 W/m²	
		2.02 W/m²/100 lx	

(1) Based on a rectangular space of 3.350 m x 2.600 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · STORE ROOM 1 (Light scene 1)

Working plane (STORE ROOM 1)



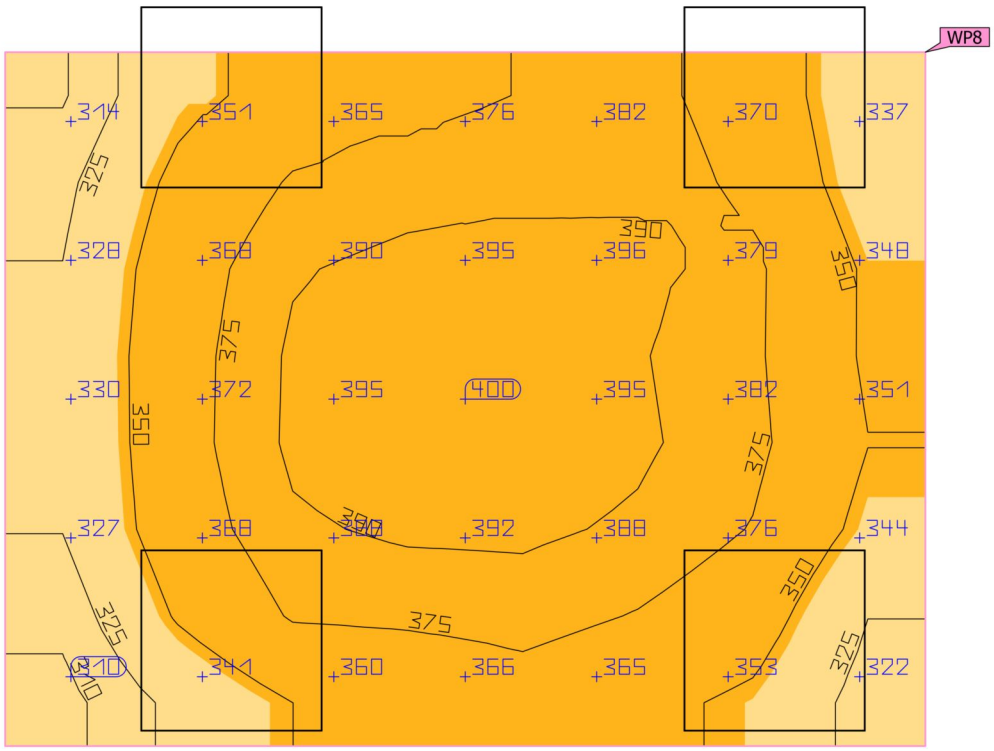

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (STORE ROOM 1) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	364 lx	303 lx	400 lx	0.83	0.76	WP8

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · STORE ROOM 2 (Light scene 1)

Summary

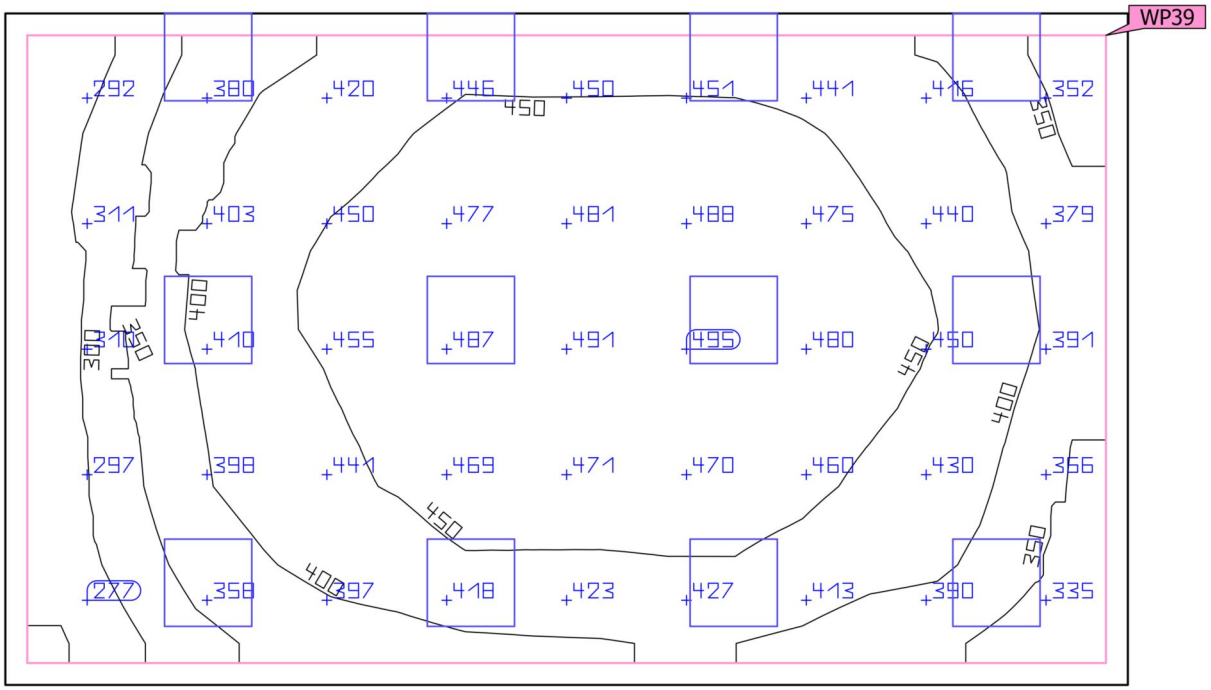

Ground area	35.37 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · STORE ROOM 2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	416 lx	WP39
	U_o (g_1)	0.59	WP39
	Lighting power density	6.04 W/m²	
		1.45 W/m²/100 lx	
Energy estimation(2)	Consumption	475 kWh/a	
Room	Lighting power density	5.43 W/m²	
		1.31 W/m²/100 lx	

(1) Based on a rectangular space of 4.600 m x 7.690 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
12	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · STORE ROOM 2 (Light scene 1)

Working plane (STORE ROOM 2)

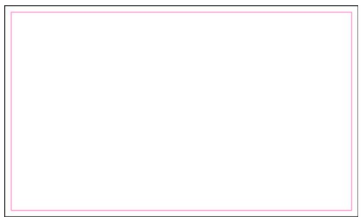

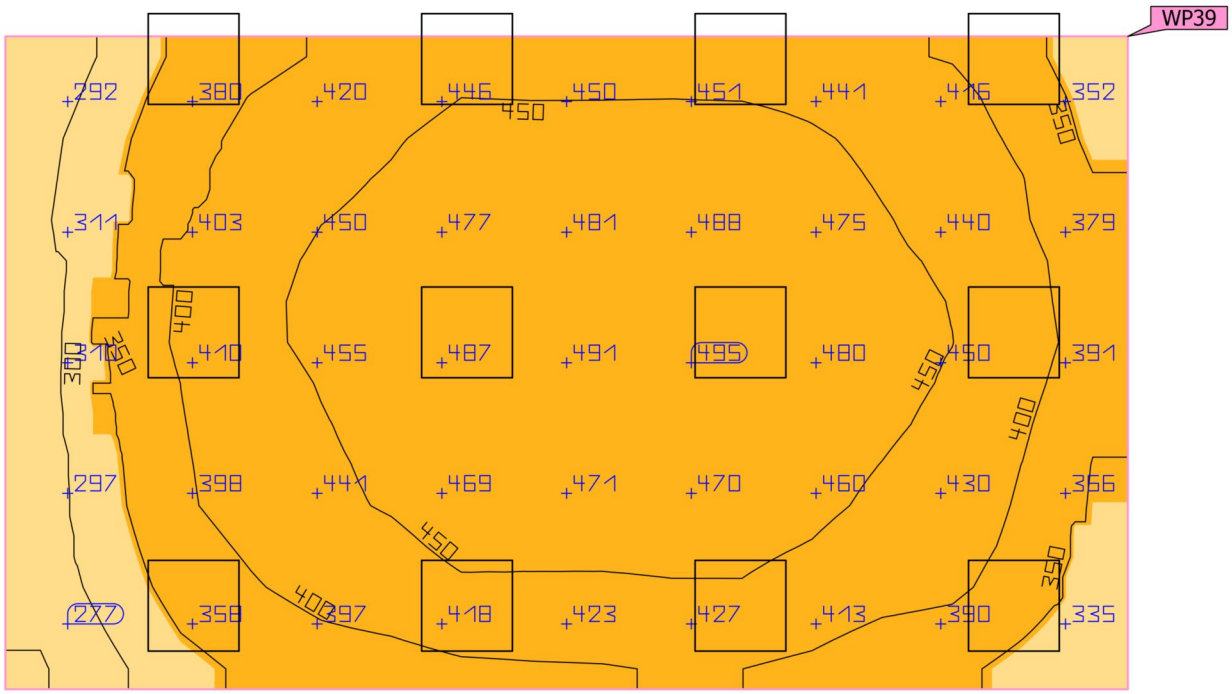

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (STORE ROOM 2) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	416 lx	244 lx	496 lx	0.59	0.49	WP39

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR RM 1 (Light scene 1)

Summary

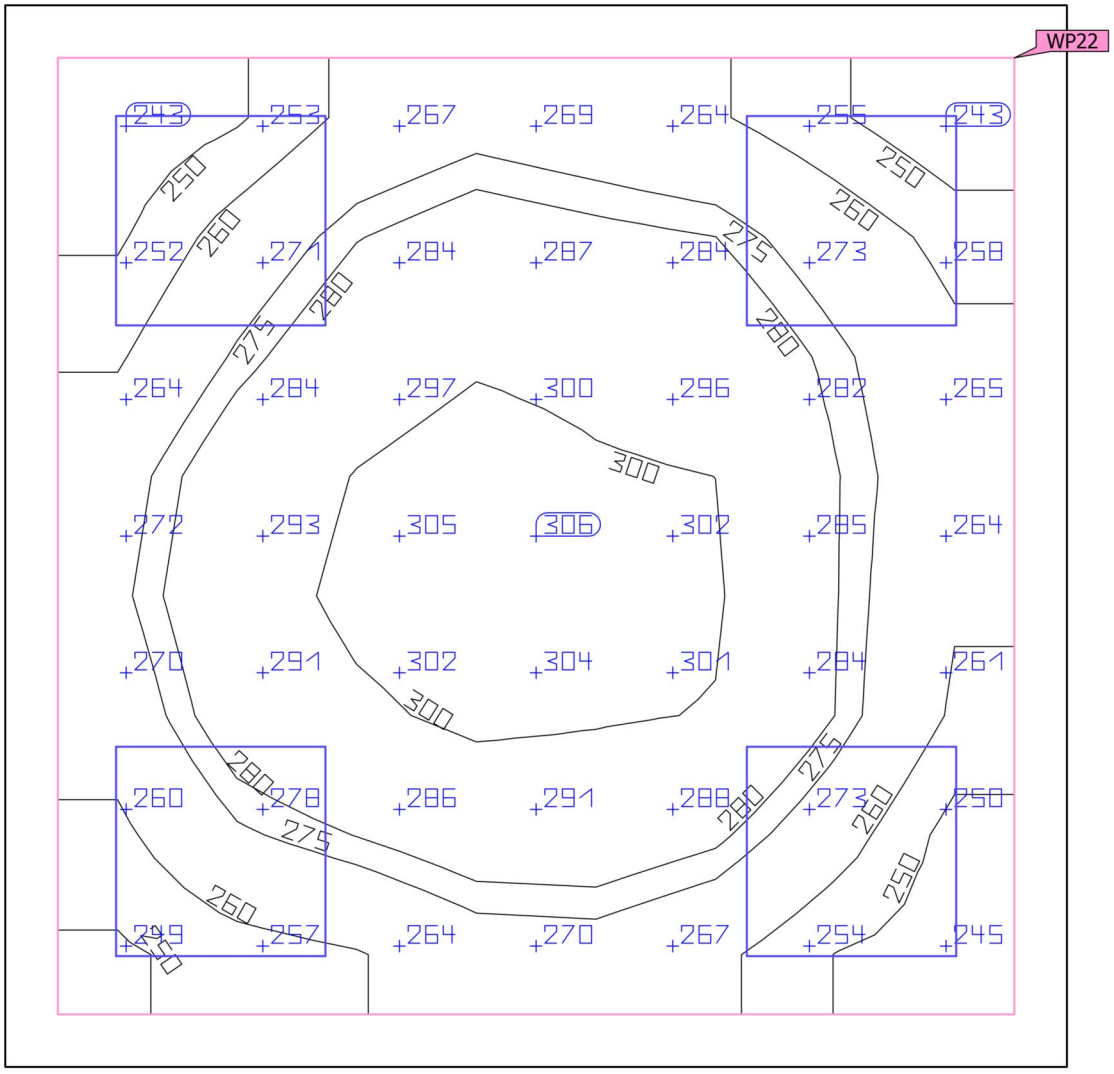

Ground area	9.18 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR RM 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	276 lx	WP22
	U_o (g_1)	0.87	WP22
	Lighting power density	8.59 W/m²	
		3.12 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	6.97 W/m²	
		2.53 W/m²/100 lx	

(1) Based on a rectangular space of 3.030 m x 3.030 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR RM 1 (Light scene 1)

Working plane (VR RM 1)



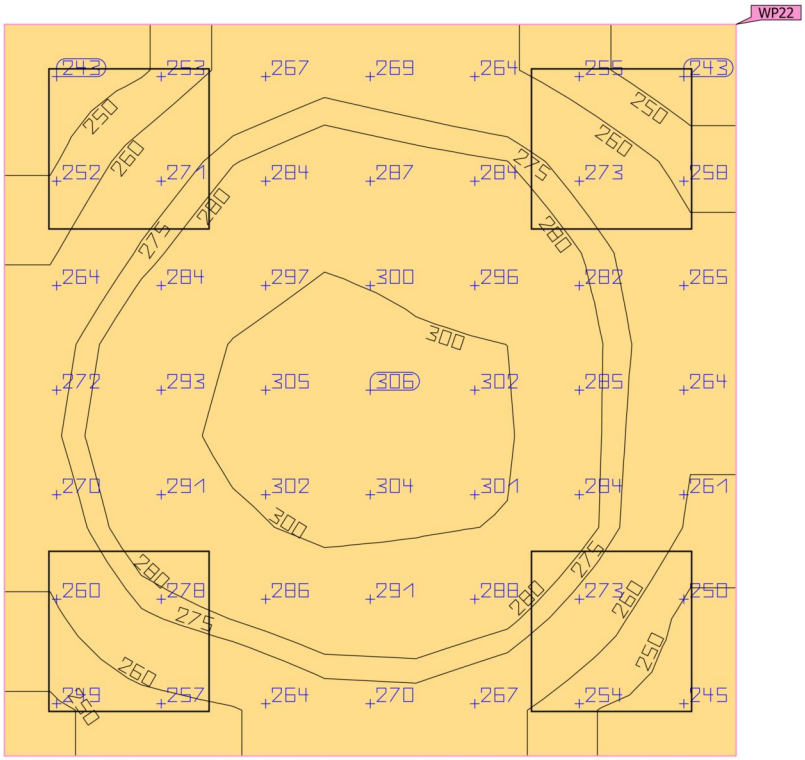

240 346 [lx]

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR RM 1) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	276 lx	241 lx	307 lx	0.87	0.79	WP22

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR RM 2 (Light scene 1)

Summary

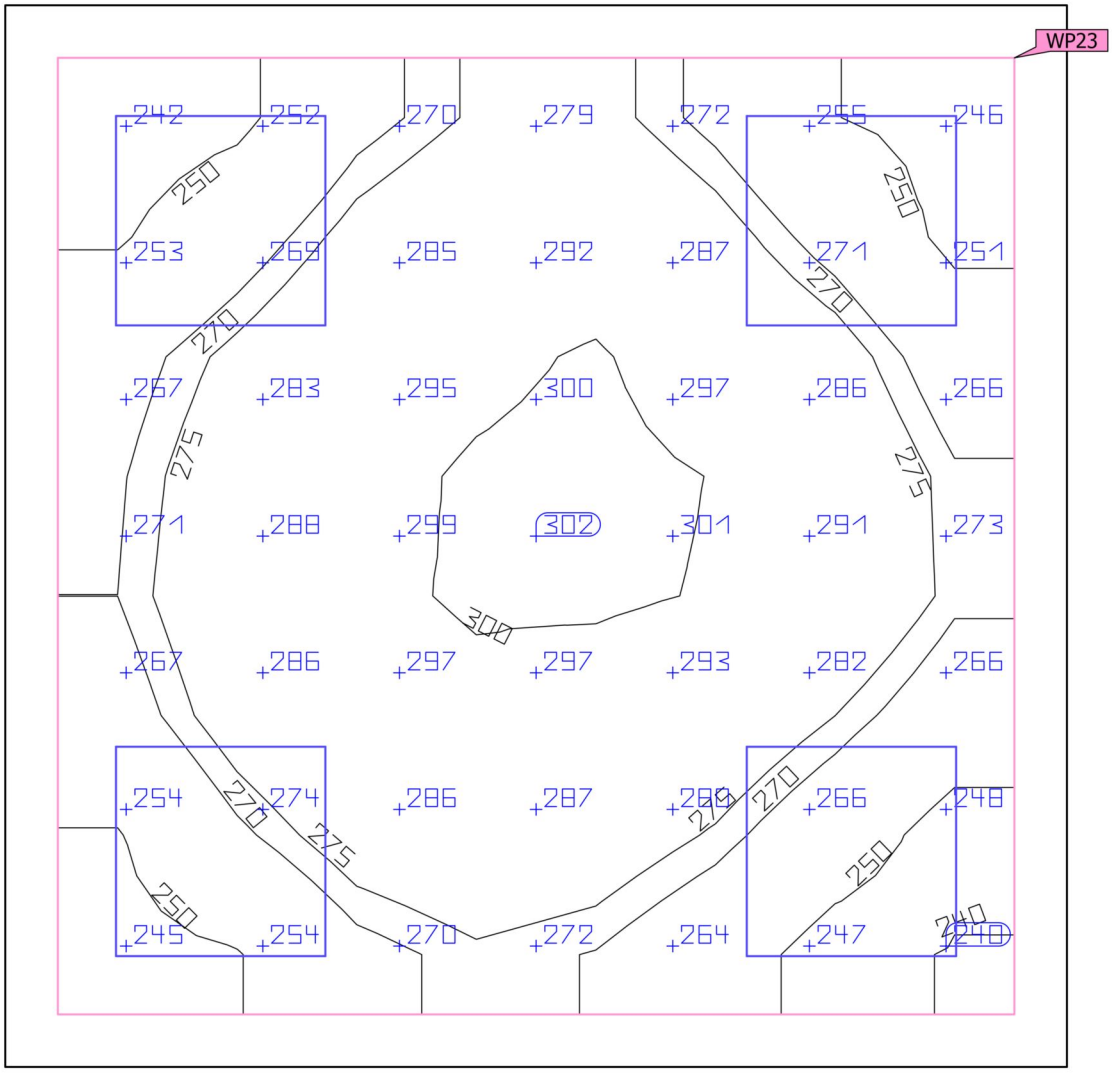

Ground area	9.18 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR RM 2 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	275 lx	WP23
	U_o (g_1)	0.87	WP23
	Lighting power density	8.59 W/m²	
		3.13 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	6.97 W/m²	
		2.54 W/m²/100 lx	

(1) Based on a rectangular space of 3.030 m x 3.030 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR RM 2 (Light scene 1)

Working plane (VR RM 2)



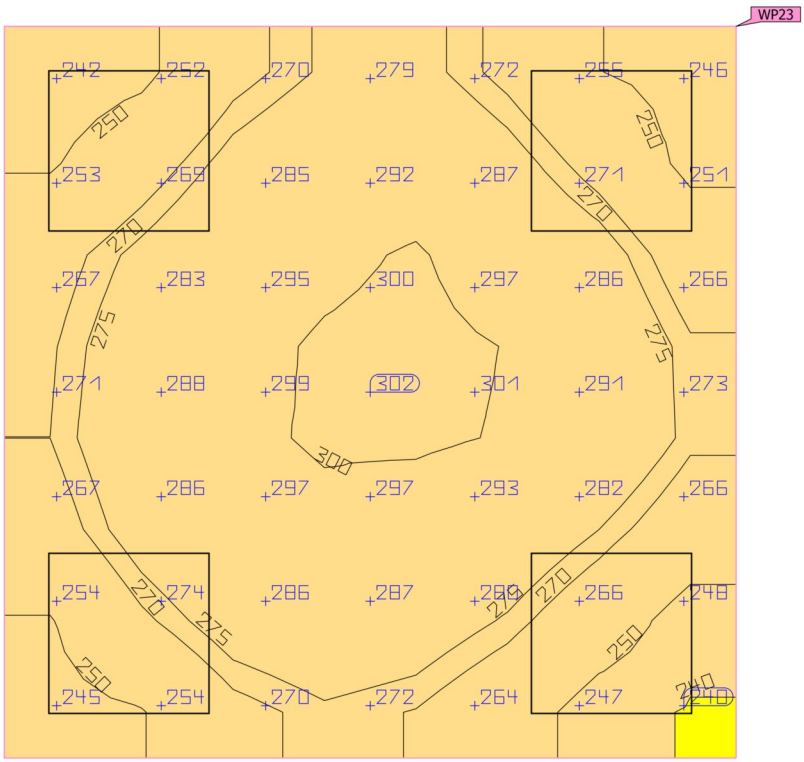

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR RM 2) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	275 lx	238 lx	303 lx	0.87	0.79	WP23

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR RM 3 (Light scene 1)

Summary

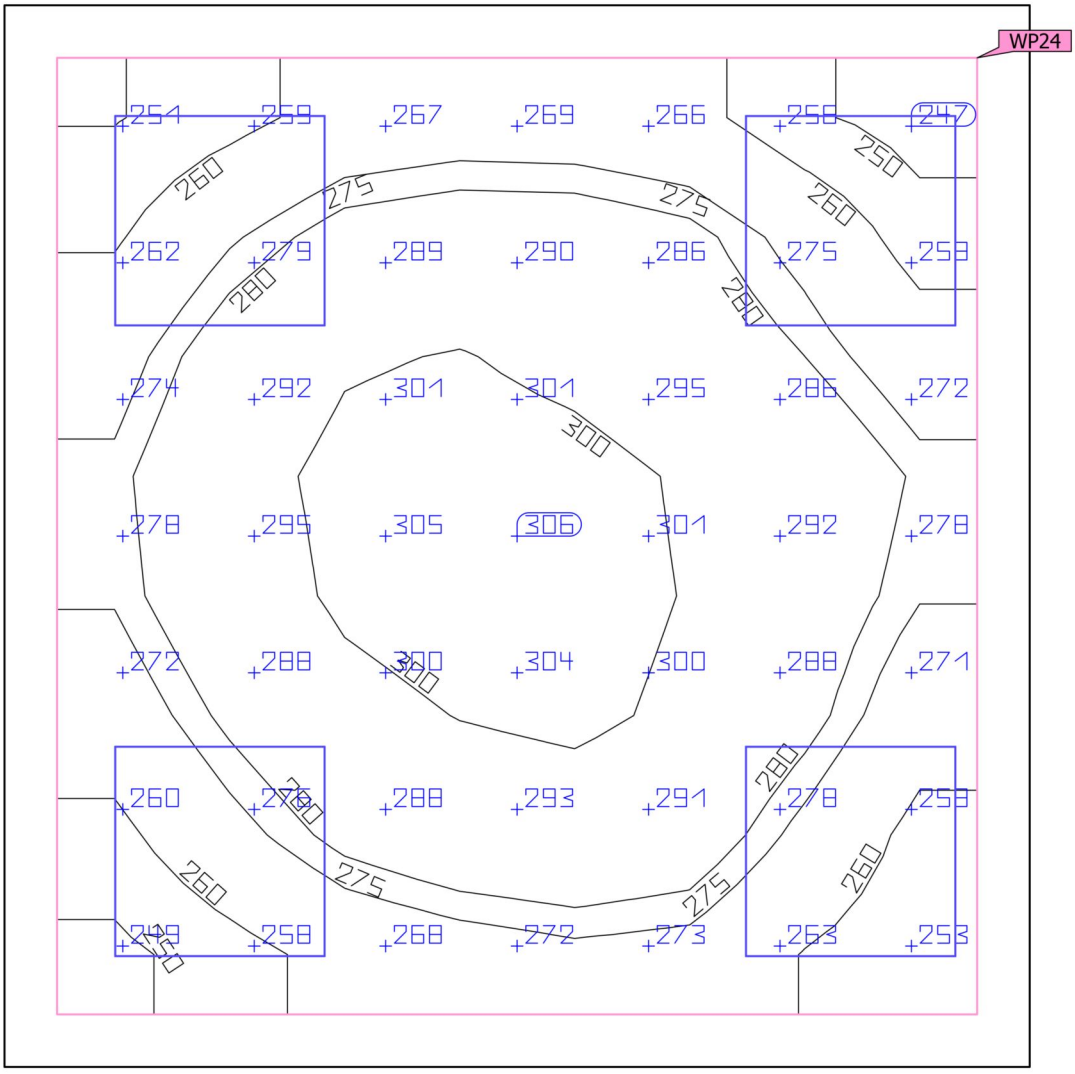

Ground area	8.87 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR RM 3 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	279 lx	WP24
	U_o (g_1)	0.88	WP24
	Lighting power density	8.93 W/m²	
		3.20 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	7.22 W/m²	
		2.59 W/m²/100 lx	

(1) Based on a rectangular space of 2.926 m x 3.030 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR RM 3 (Light scene 1)

Working plane (VR RM 3)



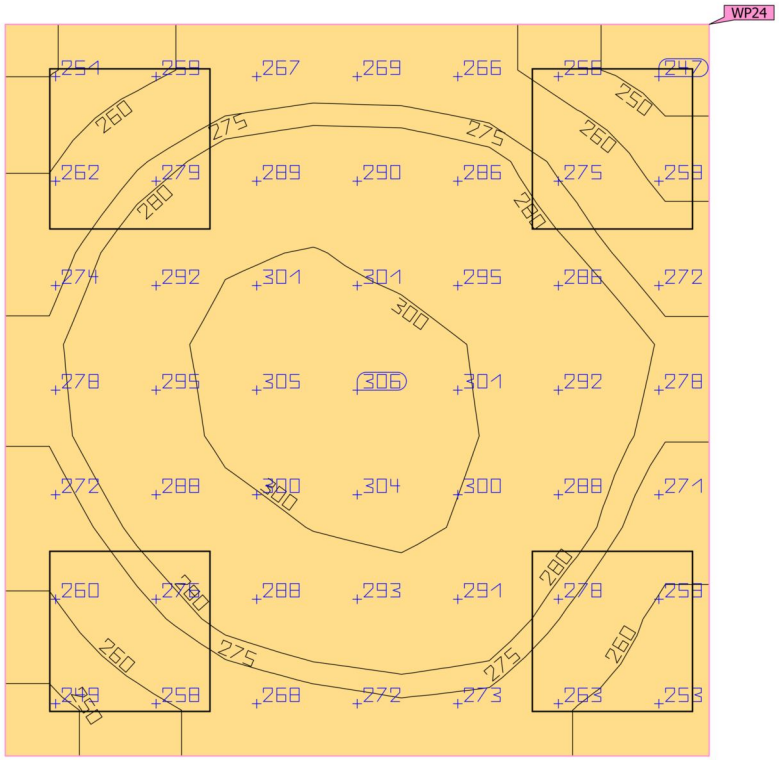



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR RM 3) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	279 lx	245 lx	307 lx	0.88	0.80	WP24

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR RM 4 (Light scene 1)

Summary

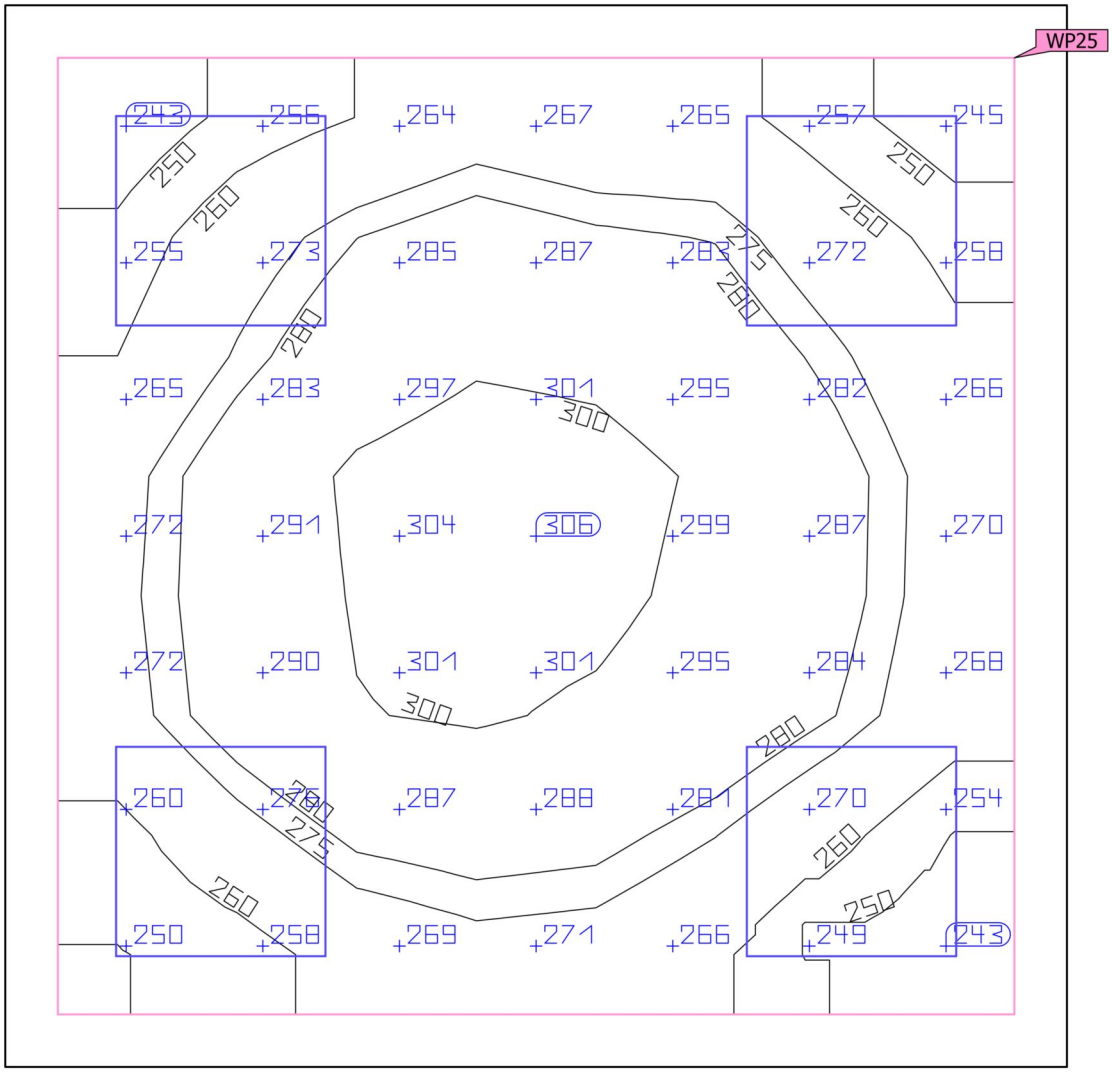

Ground area	9.18 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR RM 4 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	276 lx	WP25
	U_o (g_1)	0.87	WP25
	Lighting power density	8.59 W/m²	
		3.12 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	6.97 W/m²	
		2.53 W/m²/100 lx	

(1) Based on a rectangular space of 3.030 m x 3.030 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR RM 4 (Light scene 1)

Working plane (VR RM 4)



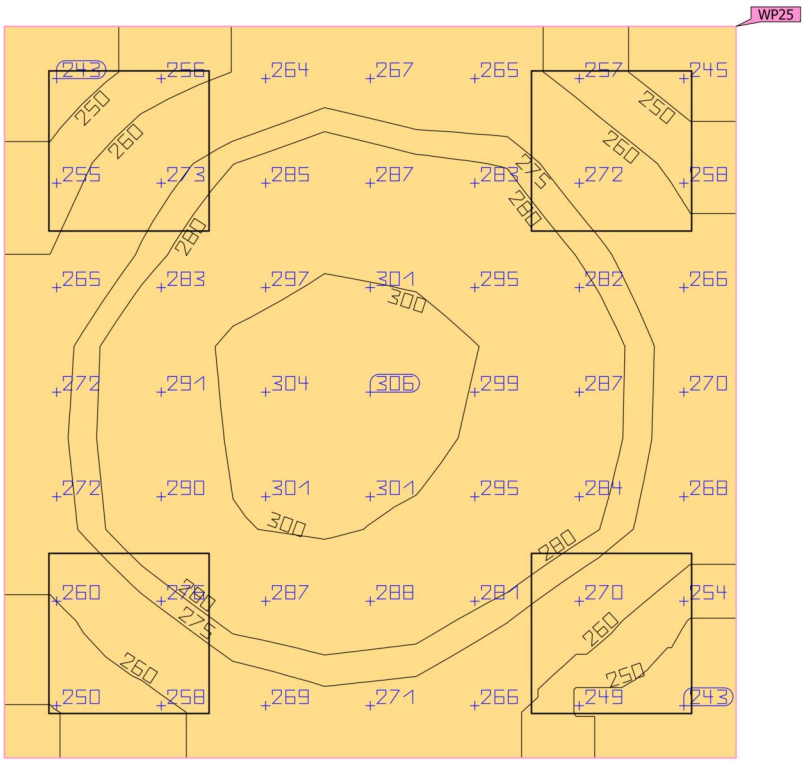



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR RM 4) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	276 lx	240 lx	306 lx	0.87	0.78	WP25

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR RM 5 (Light scene 1)

Summary

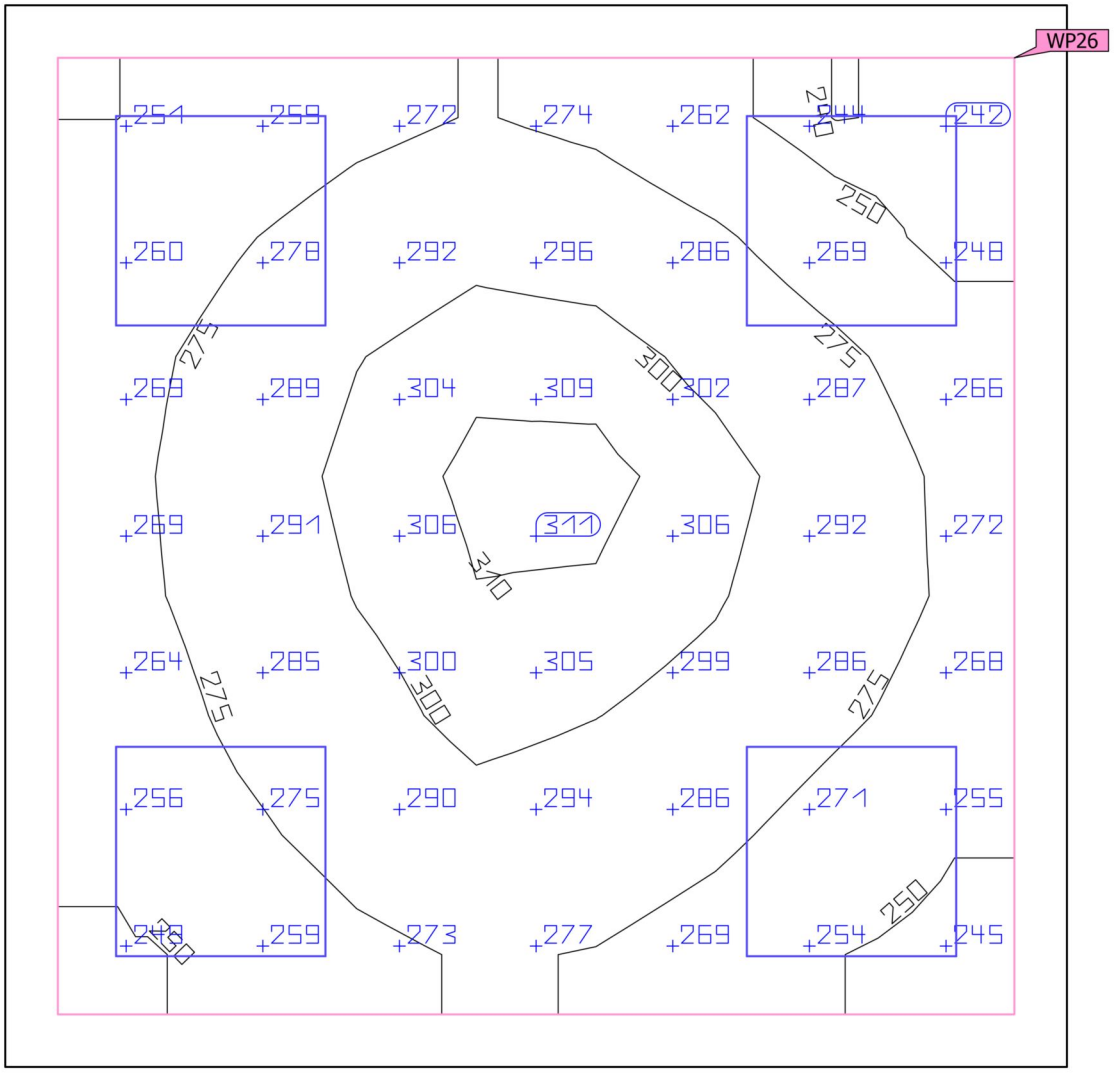

Ground area	9.18 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR RM 5 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	278 lx	WP26
	U_o (g_1)	0.86	WP26
	Lighting power density	8.59 W/m²	
		3.09 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	6.97 W/m²	
		2.51 W/m²/100 lx	

(1) Based on a rectangular space of 3.030 m x 3.030 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR RM 5 (Light scene 1)

Working plane (VR RM 5)



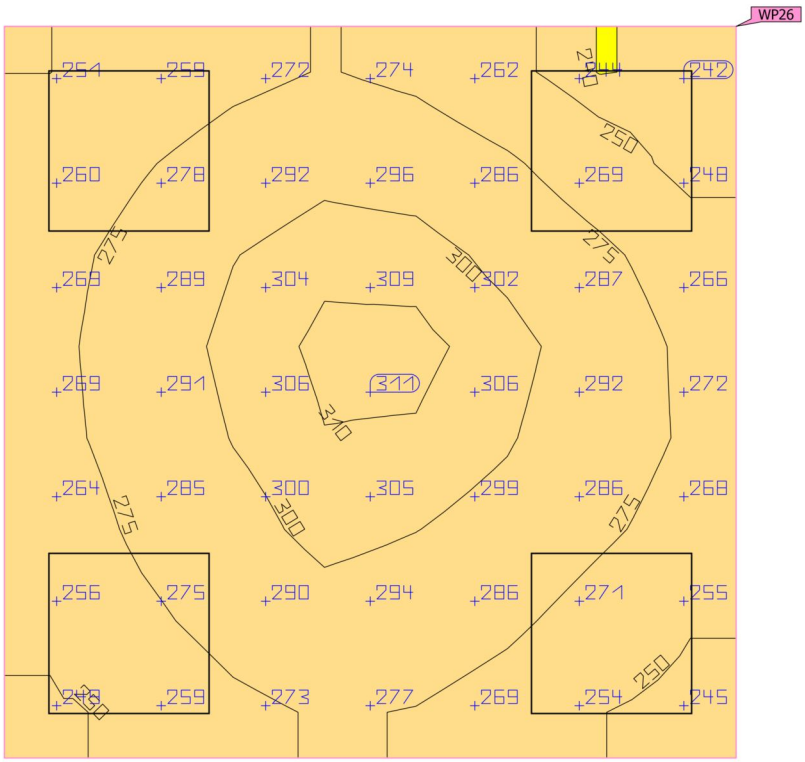



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR RM 5) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	278 lx	239 lx	311 lx	0.86	0.77	WP26

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR RM 6 (Light scene 1)

Summary

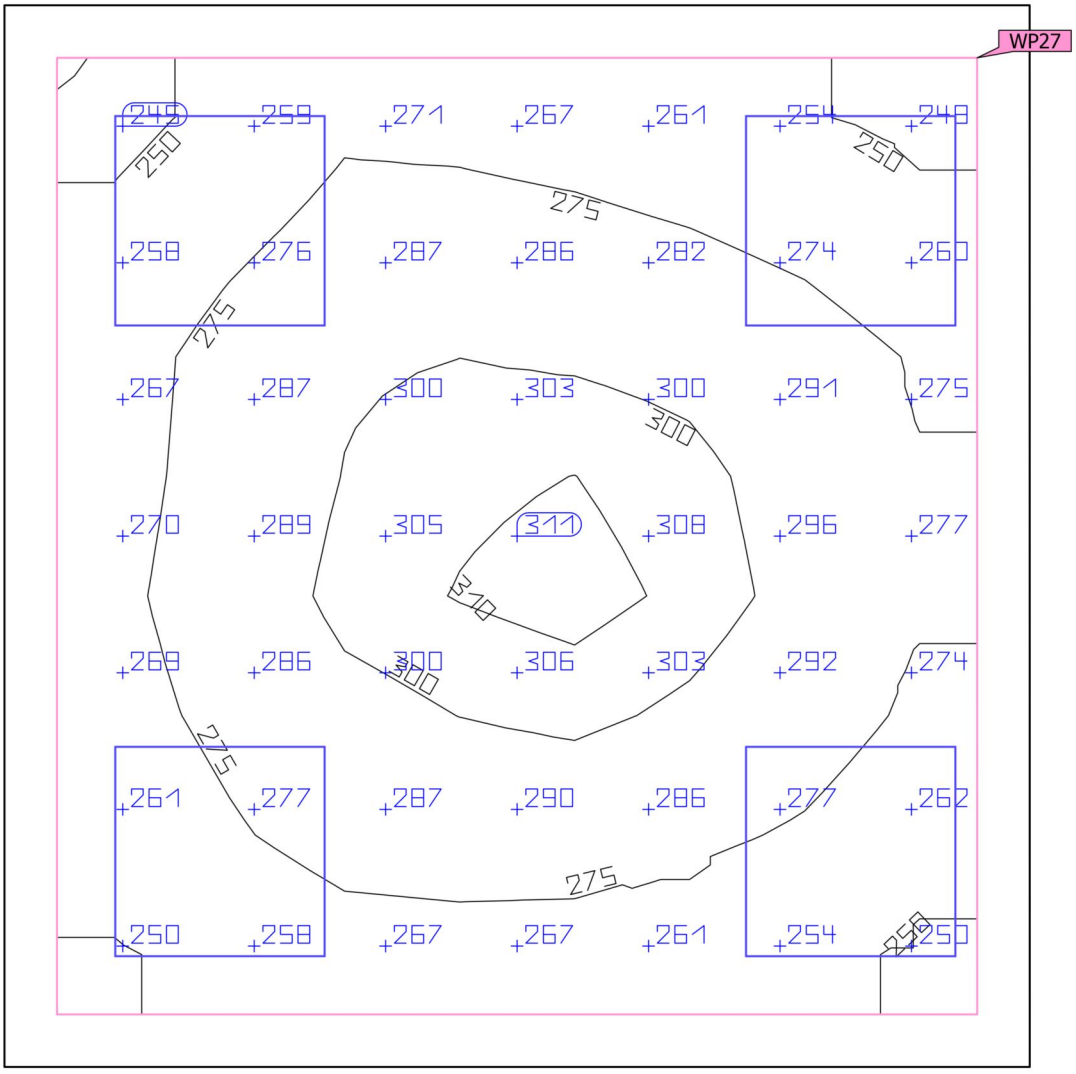

Ground area	8.87 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR RM 6 (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	278 lx	WP27
	U_o (g_1)	0.86	WP27
	Lighting power density	8.93 W/m²	
		3.21 W/m²/100 lx	
Energy estimation(2)	Consumption	158 kWh/a	
Room	Lighting power density	7.22 W/m²	
		2.60 W/m²/100 lx	

(1) Based on a rectangular space of 2.926 m x 3.030 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR RM 6 (Light scene 1)

Working plane (VR RM 6)



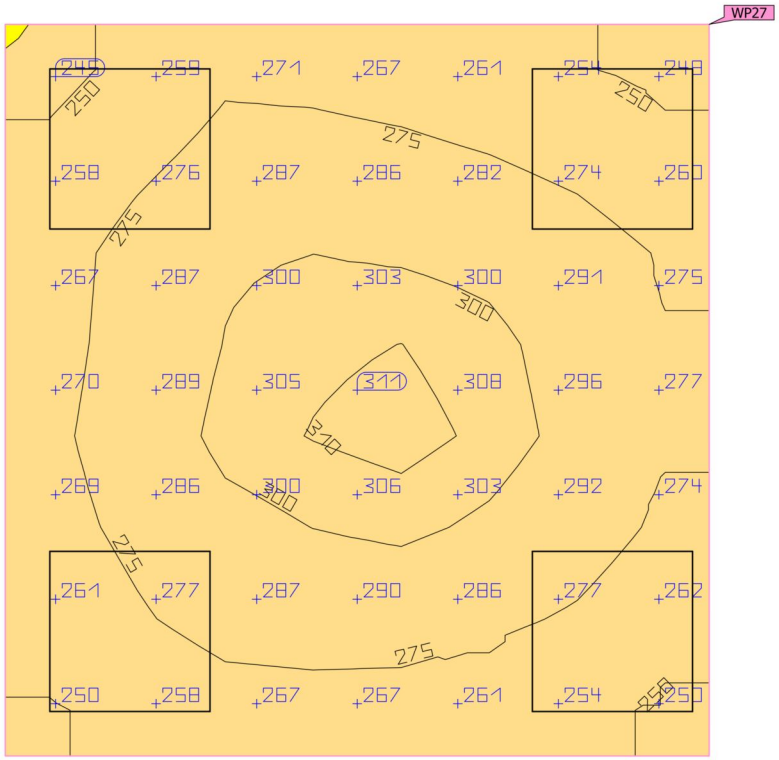



Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR RM 6) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	278 lx	239 lx	311 lx	0.86	0.77	WP27

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · VR ZONE (Light scene 1)

Summary

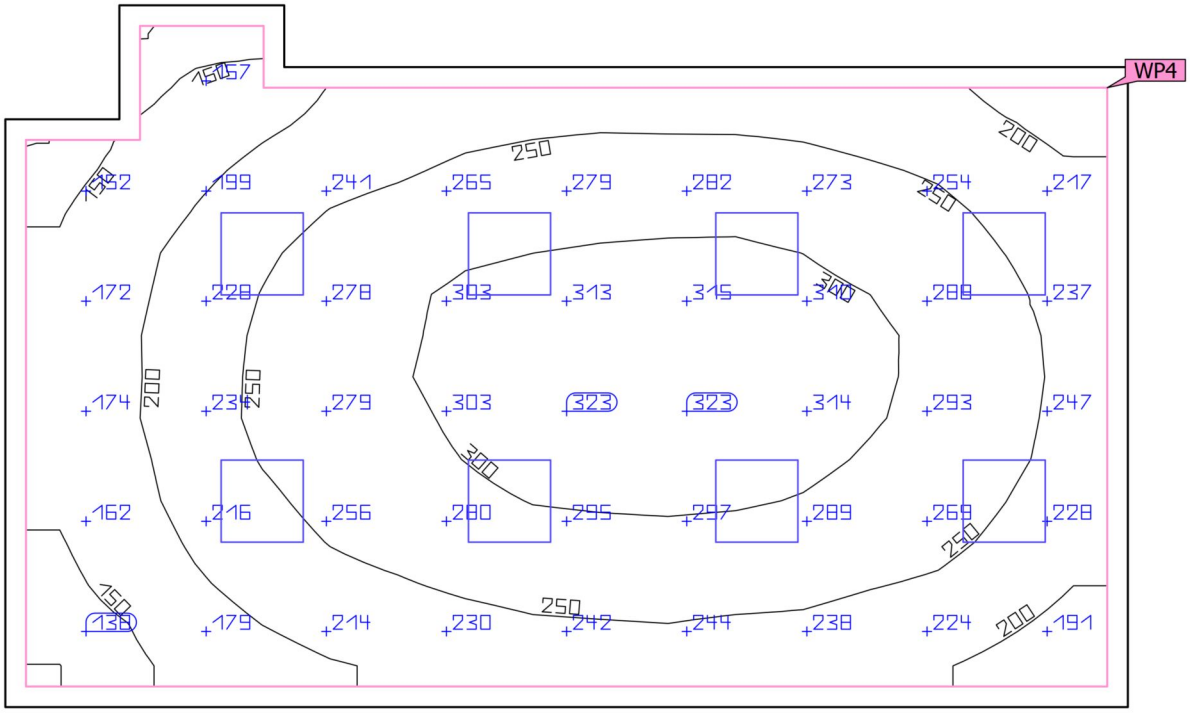

Ground area	38.30 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.000 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · VR ZONE (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	246 lx	WP4
	U_o (g_1)	0.51	WP4
	Lighting power density	3.72 W/m²	
		1.51 W/m²/100 lx	
Energy estimation(2)	Consumption	317 kWh/a	
Room	Lighting power density	3.34 W/m²	
		1.36 W/m²/100 lx	

(1) Based on a rectangular space of 5.110 m x 8.170 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
8	PROS		L18-PS-TROFFER6060-AIRSLOT-2×8W-4000K-105D-R90	–	16.0 W	2100 lm	131.3 lm/W

Building 1 · Storey 1 · VR ZONE (Light scene 1)

Working plane (VR ZONE)

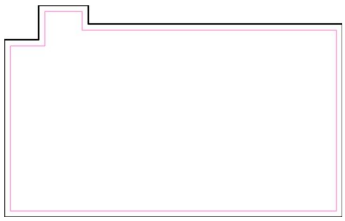

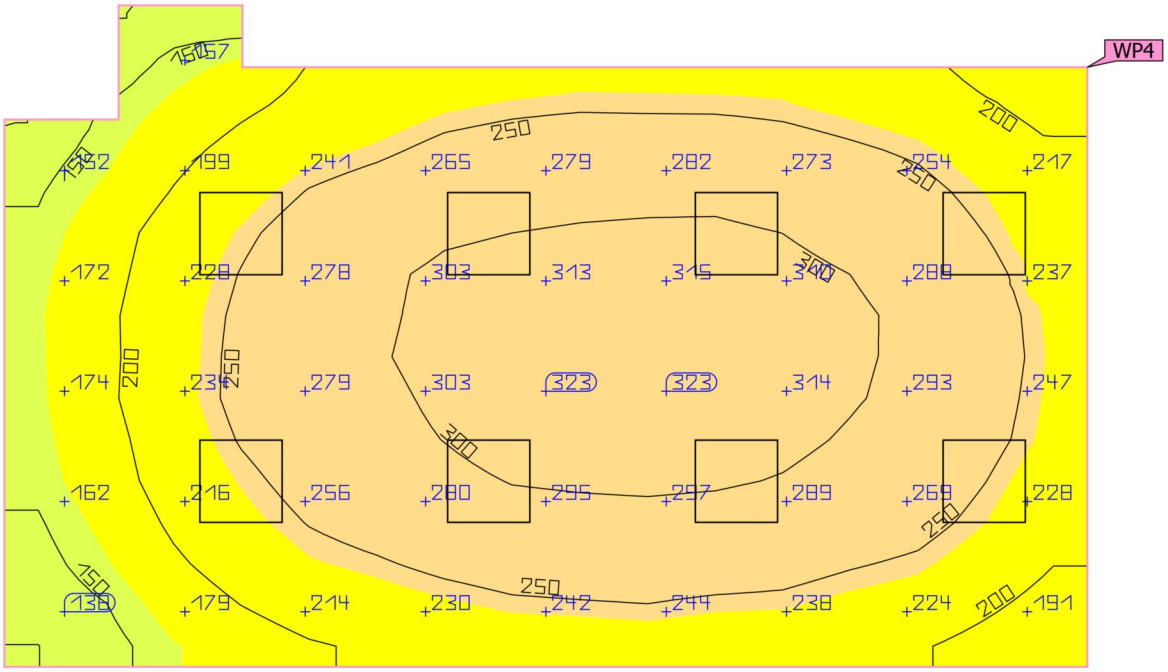

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (VR ZONE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.150 m	246 lx	125 lx	324 lx	0.51	0.39	WP4

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building 1 · Storey 1 · WORKROOM / EQUIP RM (Light scene 1)

Summary

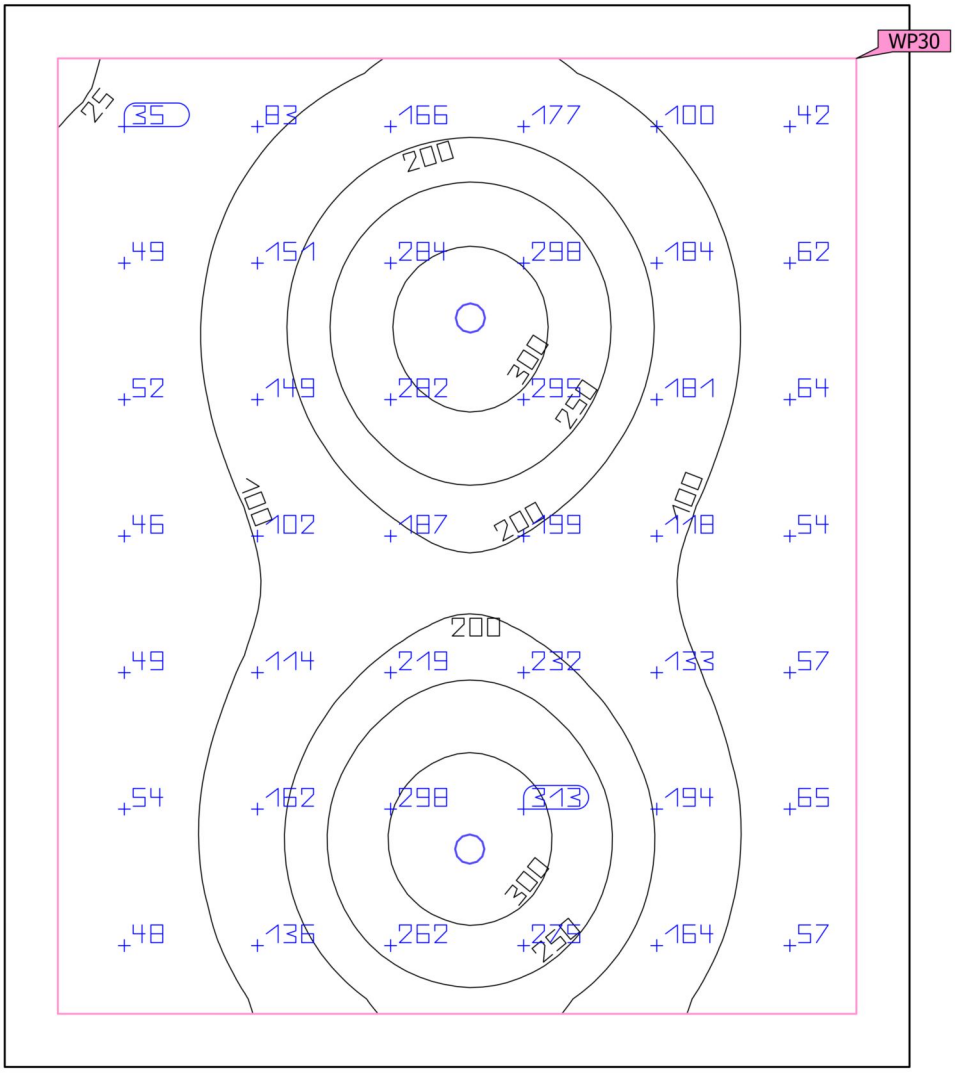

Ground area	7.66 m²	Clearance height	2.800 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.800 m
		Height Working plane	0.750 m
Maintenance factor	0.80 (fixed)	Wall zone Working plane	0.150 m

Building 1 · Storey 1 · WORKROOM / EQUIP RM (Light scene 1)

Summary

Results

	Symbol	Calculated	Index
Working plane	$\bar{E}_{perpendicular}$	146 lx	WP30
	U_o (g_1)	0.15	WP30
	Lighting power density	2.46 W/m²	
		1.68 W/m²/100 lx	
Glare valuation(1)	$R_{UG, max}$	12	
Energy estimation(2)	Consumption	37.1 kWh/a	
Room	Lighting power density	1.96 W/m²	
		1.34 W/m²/100 lx	

(1) Based on a rectangular space of 2.999 m x 2.556 m and SHR of 0.25.
(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	PROS		L3-PS-KN-SL1001-WH-7.5W-4000K-36D-R90	12	7.5 W	630 lm	84.0 lm/W

Building 1 · Storey 1 · WORKROOM / EQUIP RM (Light scene 1)

Working plane (WORKROOM / EQUIP RM)



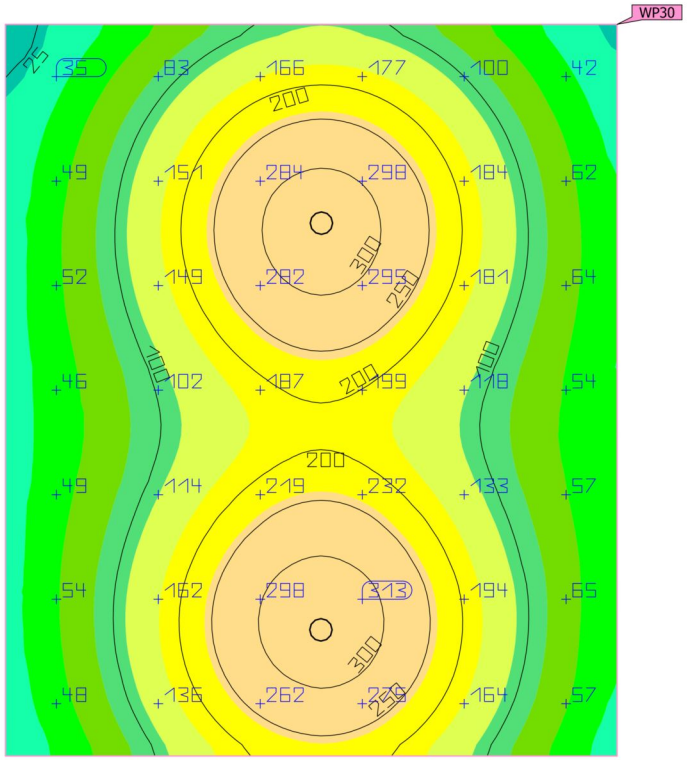

Properties	Ē	E_{min}	E_{max}	U_o (g_1)	g_2	Index
Working plane (WORKROOM / EQUIP RM) Perpendicular illuminance (adaptive) Height: 0.750 m, Wall zone: 0.150 m	146 lx	21.7 lx	330 lx	0.15	0.066	WP30

Utilisation profile: DIALux presetting (34.2 Standard (office))