



Ain Shams University – Faculty of Engineering I-CHEP
CSE356: Internet of Things

Project Report

Smart Mosque Management System

14-May-2026

Submitted to Prof. Islam Tharwat
Eng. Hamdy Osama

Submitted by 23P0184 – Sara Ahmed
23P0360 – El-Sharqawy Wael
23P0386 – Esraa Mustafa
23P0272 – Nada Medhat

Contents

1	Purpose & Requirements	3
1.1	Purpose of the IoT System	3
1.2	Functional Requirements	3
1.3	Non-Functional Requirements	4
1.4	Constraints and Assumptions	5
2	Process Specification	5
2.1	Overview	5
2.2	Core System Processes	5
2.2.1	Occupancy Detection Process	5
2.2.2	Energy Management Process	6
2.2.3	Wudu Water Monitoring Process	6
2.2.4	Air Quality Monitoring Process	6
2.2.5	Central Monitoring and Control Process	6
2.3	Integrated System Flowchart	7
2.4	Process Interaction Notes	7
3	Domain Model Specification	7
3.1	Entities	7
3.2	Attributes for each Entity	8
3.3	Relationships	9
3.4	UML Diagram	10
4	Information Model Specification	10
4.1	Types of Data in System	10
4.1.1	Sensor Data (Raw Data)	10
4.1.2	Processed Data	11
4.1.3	System Data (Stored)	11
4.1.4	Control Data (from Admin)	11
4.2	Data Flow	11
4.2.1	Main Flow	11
4.2.2	Control Flow	12
5	Service Specifications	12
5.1	Overview	12
5.2	Service List	12
5.3	Service Descriptions	13
6	IoT Level Specification	14
6.1	Level 1 – Perception Layer	14
6.2	Level 2 – Network Layer	15
6.3	Level 3 – Edge Processing Layer	15
6.4	Level 4 – Data Accumulation Layer	15
6.5	Level 5 – Application Layer	16
6.6	Level Interaction Summary	16
7	Functional View Specification	16
7.1	Overview	16
7.2	Functional Block Descriptions	16
7.3	Inter-Block Data Flow Summary	18

8	Operational View Specification	18
8.1	System Performance	18
8.1.1	Response Time	18
8.1.2	Data Update Frequency	19
8.1.3	Throughput	19
8.1.4	Efficiency	19
8.2	System Reliability	19
8.2.1	Sensor Failure Handling	19
8.2.2	Network Failure	20
8.2.3	Power Failure	20
8.3	System Scalability	20
8.3.1	More Sensors	20
8.3.2	Spreading to Other Mosques	20
8.3.3	Modular Architecture	20
8.4	System Security	20
8.4.1	Network Protection	20
8.4.2	Access Control	20
8.4.3	Data Encryption	20
8.4.4	Device Filtering	21
8.4.5	Privacy Protection	21
8.5	Energy Efficiency	21
8.5.1	Prayer Time Control	21
8.5.2	Occupancy-Based Activation	21
8.5.3	Automatic Shutdown	21
8.6	Safety Considerations	21
8.6.1	Device Overheating	21
8.6.2	Water Valve Reliability	21
9	Device and Component Integration	21
9.1	Input Devices (Sensors)	21
9.1.1	Motion Sensor (PIR)	21
9.1.2	Air Quality Sensor (IAQ)	23
9.1.3	Water Flow Sensor	24
9.2	Output Devices (Actuators)	25
9.2.1	Smart Lights	25
9.2.2	Fans (AC Simulation)	25
9.2.3	Solenoid Valve	25
9.3	Processing Unit	25
9.4	Communication Layer	25
9.5	Integration Workflow	26
9.6	System Diagram	26
10	Application Development	26
10.1	Application Overview and Platform	26
10.2	User Role	26
10.3	Core Features	27
10.4	User Interface Design	27
	List of Figures	28
	References	29

1. Purpose & Requirements

1.1 Purpose of the IoT System

The purpose of the Smart Mosque Management System is to design an intelligent IoT-based solution that enhances the operational efficiency of mosques by:

- Optimizing energy consumption (lighting and air conditioning)
- Conserving water usage in wudu (ablution) areas
- Monitoring and managing crowd occupancy
- Improving indoor air quality and comfort

The system leverages real-time sensor data, automated control mechanisms, and a centralized monitoring dashboard to ensure efficient resource utilization, especially during high-attendance periods such as Friday prayers and Ramadan.

1.2 Functional Requirements

These define what the system must do.

A. Energy Management

- Automatically turn ON/OFF lights and fans/AC based on:
 - Prayer times (via API)
 - Occupancy detection (motion sensors)
- Adjust energy usage dynamically depending on crowd density.

B. Occupancy Detection

- Count number of people entering/exiting using IR sensors.
- Provide real-time hall capacity status.
- Trigger alerts if capacity exceeds safe limits.

C. Water Monitoring (Wudu Area)

- Measure water flow using flow sensors.
- Detect abnormal usage (leaks or taps left open).
- Automatically close water supply using water valves.

D. Air Quality Monitoring

- Measure air quality (e.g., CO₂, humidity, temperature).
- Trigger ventilation (fans) when thresholds are exceeded.

E. Central Dashboard

- Display:
 - Current occupancy
 - Energy consumption
 - Water usage
 - Air quality readings
- Allow manual override control for administrators.

F. Notifications & Alerts

- Send alerts for overcrowding, water leakage, poor air quality, and system faults.

1.3 Non-Functional Requirements

These define how well the system should perform.

A. Performance

- Real-time response (low latency in sensor-actuator loop)
- Efficient handling of multiple sensors simultaneously

B. Scalability

- System should support small to large mosques
- Easy addition of new sensors/devices

C. Reliability

- Continuous operation with minimal downtime
- Fault-tolerant communication between devices

D. Security

- Encrypted communication using WPA2-PSK for wireless sensor-to-gateway connections
- Dashboard access control with username/password authentication
- MAC filtering to allow only authorized IoT nodes

E. Usability

- Simple and intuitive dashboard interface
- Minimal training required for mosque staff

F. Maintainability

- Easy software/hardware updates

- Modular design for replacing faulty components

G. Cost Efficiency

- Use affordable IoT components suitable for local deployment in Egypt

1.4 Constraints and Assumptions

Constraints

- Limited budget; use cost-effective sensors
- Implementation in Cisco Packet Tracer simulation
- Dependence on internet for prayer-time API

Assumptions

- Stable local network exists in mosque
- Power supply is reliable
- Admin has basic technical knowledge

The system aligns with Egypt's sustainability goals by reducing unnecessary consumption of water and electricity in high-usage public religious spaces.

2. Process Specification

2.1 Overview

The Smart Mosque Management System operates through coordinated processes that continuously collect sensor data, analyze conditions, and trigger automated actions. These processes ensure efficient energy usage, water conservation, and safe occupancy management. The system follows a Sense → Process → Act → Monitor pipeline.

2.2 Core System Processes

2.2.1 Occupancy Detection Process

Objective: Monitor the number of people inside the mosque.

Workflow:

1. IR sensors at entrances detect entry/exit events.
2. System increments/decrements occupancy count.
3. Data is sent to the central controller.
4. If occupancy exceeds threshold, trigger alert on dashboard.
5. Occupancy data is used by other processes (energy control).

2.2.2 Energy Management Process

Objective: Optimize electricity usage based on prayer times and occupancy.

Workflow:

1. System retrieves prayer times from API.
2. Motion sensors detect presence in prayer hall.
3. Decision logic:
 - IF (Within Prayer Window OR Motion Detected), then turn ON lights and AC/fans.
 - ELSE, turn OFF devices.
4. Optionally adjust intensity based on crowd density.

2.2.3 Wudu Water Monitoring Process

Objective: Prevent water waste in ablution areas.

Workflow:

1. Flow sensors measure water usage.
2. System checks for continuous flow without interruption.
3. If abnormal usage is detected:
 - Assume tap left open or leak.
 - Activate water valve to shut water.
4. Log water consumption data.

2.2.4 Air Quality Monitoring Process

Objective: Maintain comfortable and safe air conditions.

Workflow:

1. Sensors read CO₂, humidity, and temperature.
2. Compare readings with predefined thresholds.
3. If air quality is poor, activate ventilation.
4. Update dashboard with real-time values.

2.2.5 Central Monitoring and Control Process

Objective: Provide full system visibility and control.

Workflow:

1. Collect data from all subsystems.
2. Display occupancy, energy usage, water consumption, and air quality on web dashboard.
3. Allow admin override and manual ON/OFF operations.

4. Optionally store historical data.

2.3 Integrated System Flowchart

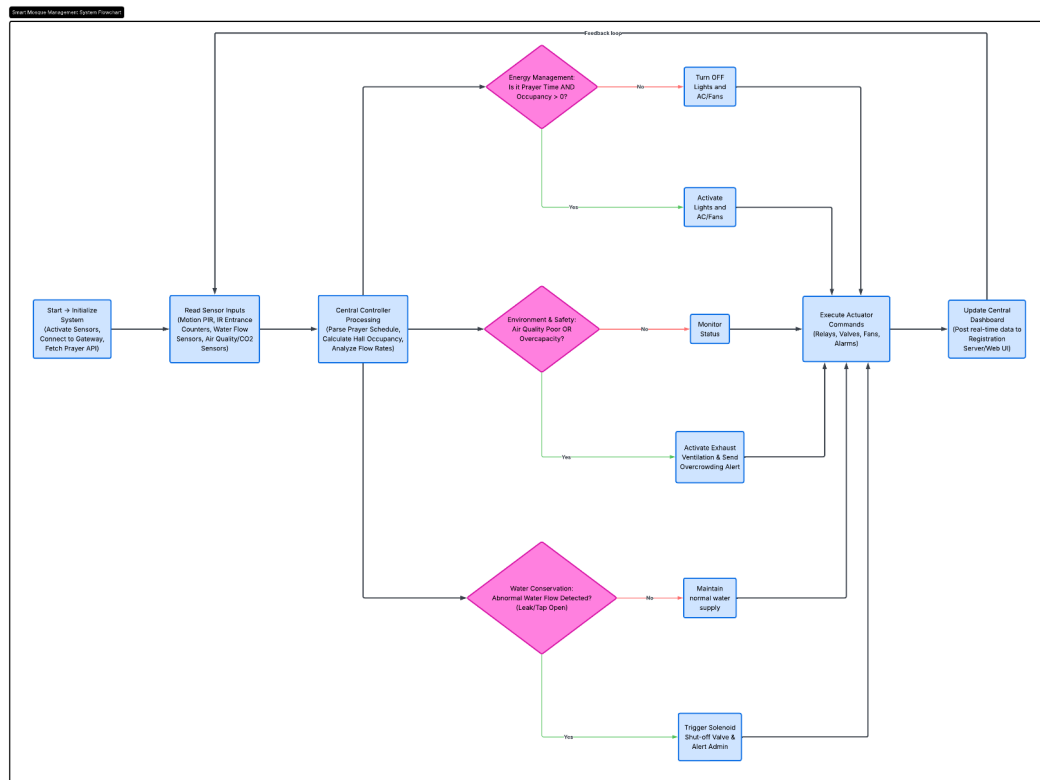


Figure 1: Integrated system flowchart

2.4 Process Interaction Notes

- Occupancy data affects energy decisions.
- Air quality can override energy logic (force ventilation ON).
- Water system is independent but logged centrally.
- All processes communicate via a central controller (MCU/SBC).

The system processes are designed as loosely coupled modules to ensure scalability, maintainability, and real-time responsiveness.

3. Domain Model Specification

3.1 Entities

Core System Entities:

- Mosque
- Zone (Prayer Hall / Wudu Area)

Sensors:

- Motion Sensor
- IR Counter Sensor
- Air Quality Sensor
- Water Flow Sensor

Actuators:

- Light
- Fan / AC
- Water Valve

System Components:

- Controller (MCU/SBC)
- IoT Server
- Dashboard (Web App)
- Admin

3.2 Attributes for each Entity

Mosque

- mosqueID
- name
- location

Zone

- zoneID
- type (Prayer Hall / Wudu Area)
- capacity

Sensor

- sensorID
- type (motion, IR, air, water)
- status (active/inactive)
- value (reading)

Actuator

- actuatorID
- type (light, fan, valve)

- status (ON/OFF)

Controller

- controllerID
- processingLogic
- status

IoT Server

- serverID
- database
- connectionStatus

Dashboard

- dashboardID
- displayData
- controlOptions

Admin

- adminID
- username
- password

3.3 Relationships

- Mosque contains Zones
- Zone contains Sensors
- Zone contains Actuators
- Sensors send data to Controller
- Controller controls Actuators
- Controller communicates with IoT Server
- IoT Server updates Dashboard
- Admin interacts with Dashboard
- Dashboard sends commands to Controller

3.4 UML Diagram

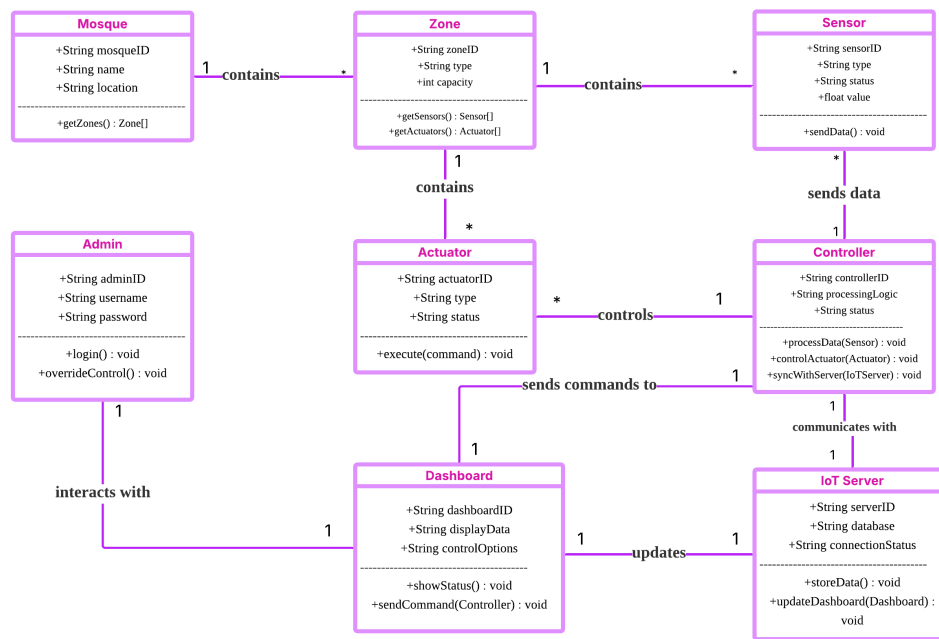


Figure 2: UML domain model diagram

4. Information Model Specification

4.1 Types of Data in System

4.1.1 Sensor Data (Raw Data)

Occupancy Data

- peopleCount (int)
- entry/exit events

Motion Data

- motionDetected (boolean)

Air Quality Data

- CO₂Level (ppm)
- temperature (°C)
- humidity (%)

Water Data

- flowRate (L/min)
- usageDuration (seconds)

4.1.2 Processed Data

- occupancyStatus (normal / full / overcrowded)
- airQualityStatus (good / moderate / poor)
- waterUsageStatus (normal / leak detected)
- energyState (ON / OFF)

4.1.3 System Data (Stored)

- historical water usage
- energy consumption logs
- occupancy logs
- alerts history

4.1.4 Control Data (from Admin)

- manual override commands
- turn ON/OFF devices

4.2 Data Flow

4.2.1 Main Flow

Sensors → Controller → IoT Server → Dashboard

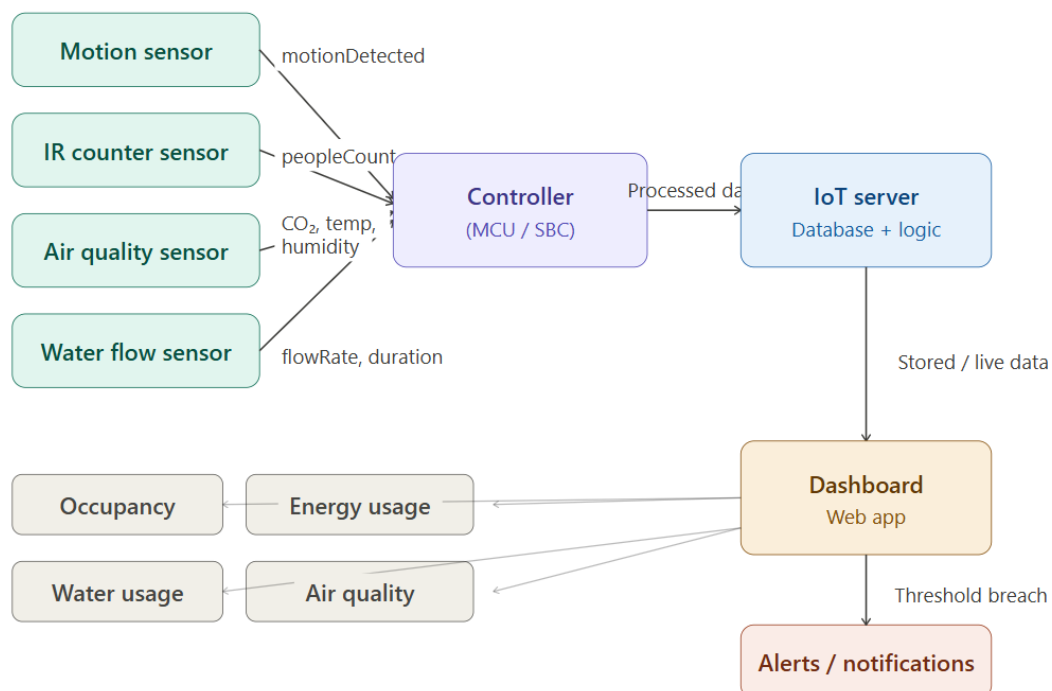


Figure 3: Main data flow



Figure 4: Main flow legend

4.2.2 Control Flow

Admin → Dashboard → Controller → Actuators

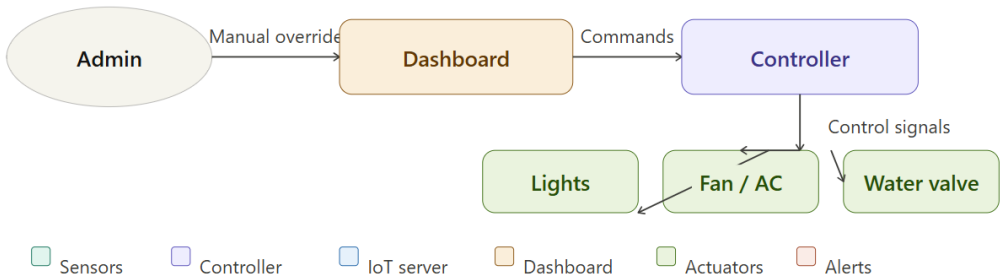


Figure 5: Control flow

5. Service Specifications

5.1 Overview

The Smart Mosque Management System exposes seven core services. Each service is a defined unit of functionality with clear inputs, outputs, triggers, and interfaces. Services are implemented on the ESP32 controller and exposed to the dashboard via the local network.

5.2 Service List

Service ID	Service Name	Type	Trigger
SVC-01	Prayer Time Sync	Data Acquisition	Scheduled – once daily
SVC-02	Occupancy Tracking	Sensing	Continuous (event-driven)
SVC-03	Energy Control	Actuation	Event-driven
SVC-04	Water Monitoring & Control	Sensing + Actuation	Continuous
SVC-05	Air Quality Monitoring	Sensing + Actuation	Periodic (every 60s)
SVC-06	Alert & Notification	Notification	Threshold-triggered
SVC-07	Dashboard Monitoring & Override	Application + Control	On-demand

Table 1: Core service list

5.3 Service Descriptions

SVC-01 – Prayer Time Sync Service

- Purpose: Retrieves accurate daily prayer times to anchor energy automation logic.
- Interface: Daily HTTP GET request to prayer-time API.
- Output: Five daily timestamps (Fajr, Dhuhr, Asr, Maghrib, Isha) stored locally.
- Fallback: Use previous day's cached schedule when API is unreachable.

SVC-02 – Occupancy Tracking Service

- Purpose: Counts people in prayer hall in real time.
- Interface: PIR events → ESP32 counter logic → dashboard polling every 30s.
- Operations: `increment_count()`, `decrement_count()`, `get_current_count()`.
- Output fields: `occupancy_count`, `capacity_percent`, `status` (NORMAL / HIGH / FULL).

SVC-03 – Energy Control Service

- Purpose: Automates lights and fans/AC per zone based on prayer windows and occupancy.
- Interface: ESP32 reads SVC-01 and SVC-02 state, then controls relay GPIOs.
- Decision logic:

```
IF in_prayer_window AND occupancy > 0:
    activate(lights, fans)
ELSE:
    deactivate(lights, fans)
IF override_active:
    apply manual override
```
- Air quality from SVC-05 can independently force fan activation.

SVC-04 – Water Monitoring and Control Service

- Purpose: Detect leaks/taps-left-open and control solenoid valve.
- Interface: Flow sensor pulse output → ESP32 pulse counter → valve GPIO.
- Key operations: `monitor_flow()`, `detect_anomaly()`, `close_valve()`, `open_valve()`.
- Failsafe: If flow sensor goes offline, valve defaults to closed and admin is notified.

SVC-05 – Air Quality Monitoring Service

- Purpose: Monitor CO₂, temperature, humidity and auto-activate ventilation.
- Polling interval: Every 60 seconds.

SVC-06 – Alert and Notification Service

- Purpose: Detect threshold breaches and push real-time alerts.

Parameter	Normal	Action Threshold	Action
CO ₂	< 1000 ppm	> 1000 ppm	Activate fans
Temperature	18–26 °C	> 28 °C	Activate fans
Humidity	30–60%	> 65%	Activate fans

Table 2: Air quality thresholds

- Interface: Internal event bus, dashboard polls alert queue.
- Deduplication: Same alert type per device/zone can fire once per 5 minutes.

SVC-07 – Dashboard Monitoring and Manual Override Service

- Purpose: Unified monitoring and manual override control.
- Interface: Dashboard polls ESP32 REST endpoints every 30 seconds; override uses HTTP POST.
- Override operations: `override_on()`, `override_off()`, `clear_override()`.
- Safety: Override expires automatically after configured duration.

6. IoT Level Specification

The Smart Mosque Management System is structured across five IoT levels, following a standard layered architecture. Each layer has a defined responsibility and communicates with adjacent layers.

6.1 Level 1 – Perception Layer

Role: Direct interaction with the physical environment.

Sensors

Device	Placement	Measurement
PIR Motion Sensor	Main entrance, exit, hall zone	Entry/exit events, zone presence
Water Flow Sensor	Wudu tap inlet pipe	Flow rate (L/min), pulse output
PIR Motion Sensor (Wudu)	Ablution area	Presence near taps
IAQ Sensor	Prayer hall near ventilation	CO ₂ , temperature, humidity

Table 3: Perception layer sensors

Actuators

Device	Placement	Controlled Action
Smart Relay (Lights)	Per hall zone	ON/OFF lighting
Smart Relay (Fans/AC)	Per hall zone, wudu area	ON/OFF ventilation
Solenoid Valve	Wudu tap supply line	Open/close water flow

Table 4: Perception layer actuators

6.2 Level 2 – Network Layer

Role: Local connectivity and data transport.

- Hardware: Local Wi-Fi access point for ESP32 nodes and local server
- Protocol: IEEE 802.11 Wi-Fi with WPA2-PSK
- Topology: Star
- Segmentation: IoT network isolated from guest/user devices

Key decision: Core control loops are local and do not depend on internet connectivity.

6.3 Level 3 – Edge Processing Layer

Role: Real-time control and decision-making.

Hardware: ESP32 microcontrollers per functional zone.

Function	Description
Sensor polling	Reads PIR, IAQ, and flow sensor inputs at configured intervals
Occupancy counting	Increments/decrements people count based on entry/exit events
Prayer window evaluation	Compares current time against cached prayer schedule
Energy control logic	Combines occupancy and prayer window state for relays
Water control logic	Detects anomalies and closes valve when required
Air quality control	Polls IAQ every 60s and activates fans on threshold breach
Alert generation	Publishes threshold breach events to data layer

Table 5: Edge processing responsibilities

Failsafe: If server connectivity is lost, edge controllers continue autonomous operation.

6.4 Level 4 – Data Accumulation Layer

Role: Aggregate processed data, store logs, and serve dashboard queries.

- CPT simulation backend: Registration Server
- Real deployment option: local server (e.g., lightweight REST + database)

- Retention: rolling 30-day window with optional archival

6.5 Level 5 – Application Layer

Role: Human-facing dashboard for monitoring and control.

- Web dashboard on local network
- Single admin role
- Functions: live monitoring, alert display, schedule view, manual override

6.6 Level Interaction Summary

```
[Sensors / Actuators] (Level 1)
  | GPIO / I2C / UART
  v
[ESP32 Edge Controller] (Level 2+3) <--- [Prayer Time API]
  | Wi-Fi (WPA2-PSK)
  v
[Local Server / Registration Server] (Level 4)
  | Local LAN
  v
[Admin Web Dashboard] (Level 5)
```

7. Functional View Specification

7.1 Overview

The functional view breaks the system into independent blocks by behavior. Each block has defined inputs, outputs, and responsibilities, with clear data flows for modularity and maintainability.

7.2 Functional Block Descriptions

Block 1 – Sensing Block

Collects raw data from the mosque environment.

Failure behavior: Offline sensors are flagged to processing, then safe defaults are applied.

Block 2 – Processing Block

Decision core running on ESP32.

- Occupancy counter with floor at zero.
- Prayer window evaluator from cached schedule.
- Energy decision engine for lights/fans.
- Air quality decision engine independent from prayer window.
- Water anomaly detection and valve control.

Sub-function	Sensor	Interval	Output
Entry/exit detection	PIR (entrance)	Event-based	Increment/decrement event
Zone presence detection	PIR (hall zones)	Every 5s	Presence flag per zone
Water flow measurement	Flow sensor	Every 1s	Flow rate (L/min)
Tap-area presence	PIR (wudu)	Event-based	Presence flag
Air quality reading	IAQ sensor	Every 60s	CO ₂ , temperature, humidity

Table 6: Sensing block functions

- State manager as single source of truth.

Block 3 – Actuation Block

Executes commands on relays and valve, with confirmation and retries.

Device	Command Type	Confirmation
Smart relay (lights)	ON/OFF per zone	GPIO acknowledgment
Smart relay (fans/AC)	ON/OFF per zone	GPIO acknowledgment
Solenoid valve	OPEN/CLOSE per tap	GPIO acknowledgment

Table 7: Actuation block control and feedback

Block 4 – Data and Storage Block

Persists time-series data for dashboard and analytics.

Data Type	Logging Frequency	Retention
Occupancy count	Every 30s	30-day rolling
Water usage per tap	Per session + hourly total	30-day rolling
Device state changes	On every transition	30-day rolling
Air quality readings	Every 60s	30-day rolling
Alert records	On every alert event	30-day rolling

Table 8: Stored operational data

Block 5 – Alert Block

Evaluates alert conditions, deduplicates repeated alerts, and pushes active alerts to dashboard.

Block 6 – Dashboard Block

Provides monitoring panels and manual override controls for admin users.

Block 7 – External API Block

Fetches daily prayer times and caches them for resilience.

7.3 Inter-Block Data Flow Summary

From	To	Data
Sensing Block	Processing Block	Raw events, flow rates, IAQ readings
External API Block	Processing Block	Daily prayer schedule
Processing Block	Actuation Block	Device commands
Actuation Block	Processing Block	Confirmations, fault flags
Processing Block	Data and Storage Block	State snapshots, logs, transitions
Processing Block	Alert Block	Threshold breach events
Data and Storage Block	Dashboard Block	Current and historical readings
Alert Block	Dashboard Block	Active alert queue
Dashboard Block	Processing Block	Manual override commands

Table 9: Functional block data flows

8. Operational View Specification

8.1 System Performance

8.1.1 Response Time

The system operates in near real-time. Motion events trigger lighting and ventilation in approximately 1–2 seconds. In the wudu area, abnormal continuous flow triggers valve closure in approximately 2–3 seconds to reduce waste while limiting false positives.

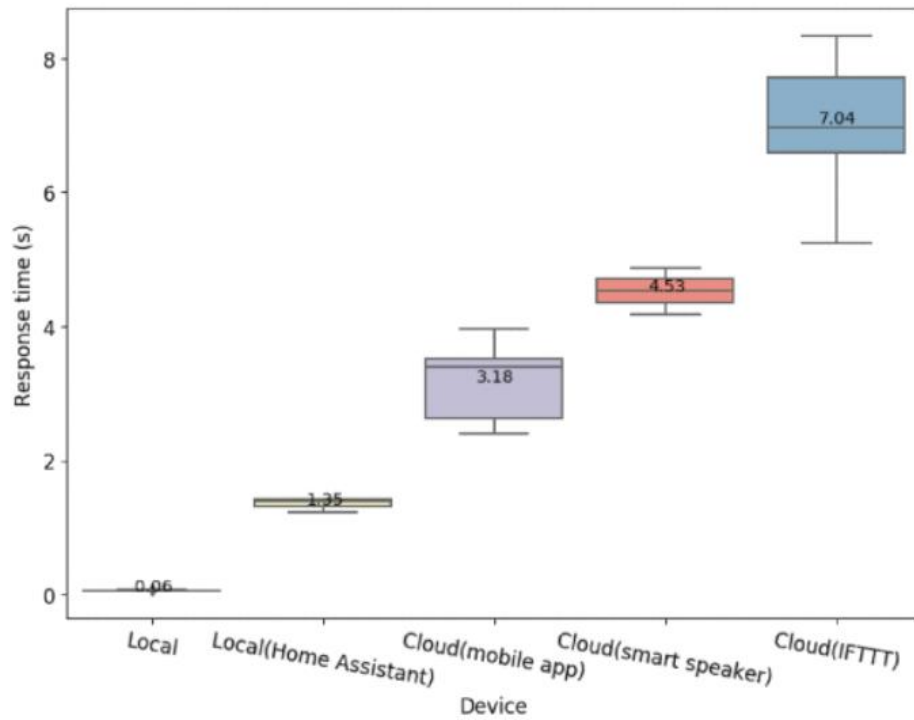


Figure 6: Operational response-time trend

Air quality is monitored periodically and ventilation is adjusted when thresholds are exceeded. Temperature and humidity are also tracked to maintain comfort. The system handles simultaneous sensor inputs during peak times without noticeable degradation.

8.1.2 Data Update Frequency

- Occupancy: real-time update per entry/exit event.
- Air quality: every 1 minute (balanced responsiveness and stability).
- Water usage: continuously monitored in real time.

8.1.3 Throughput

The system processes motion, water-flow, and air-quality streams in parallel, enabling simultaneous monitoring and decision-making during high-demand periods such as Friday prayer and Ramadan.

8.1.4 Efficiency

Lights and fans operate only when needed based on occupancy and schedule, and water control logic closes supply during leak-like behavior to reduce waste.

8.2 System Reliability

8.2.1 Sensor Failure Handling

Fallback mechanisms keep operation safe during sensor faults.

- Motion sensor failure: admin manual override controls lighting and fans.
- Flow sensor failure: manual valve override + admin alert.

- Air-quality sensor failure: ventilation follows safe default schedule.

8.2.2 Network Failure

Core control continues locally if network/server connectivity is lost. Dashboard synchronization resumes automatically after restoration.

8.2.3 Power Failure

On recovery, the system returns to predefined safe startup states. Critical monitoring may be maintained through optional backup power.

8.3 System Scalability

8.3.1 More Sensors

Additional occupancy, flow, and IAQ sensors can be integrated with the same controller logic.

8.3.2 Spreading to Other Mosques

The architecture can be replicated across multiple mosques, each with local operation and data separation.

8.3.3 Modular Architecture

Occupancy, water, air-quality, and dashboard modules can evolve independently, reducing maintenance risk and easing upgrades.

8.4 System Security

8.4.1 Network Protection

- Segmented network for IoT devices
- Restricted dashboard/control access
- Firewall/gateway policy enforcement
- Monitoring for suspicious behavior and repeated login attempts

8.4.2 Access Control

Role-based permissions, authenticated overrides, and action logging are applied for accountability.

Authentication flow:

User → Login Page → Authentication Check → Access Granted → Dashboard

8.4.3 Data Encryption

WPA2-PSK secures Wi-Fi communication between sensors, controllers, and dashboard. AES encryption protects traffic confidentiality and integrity.

8.4.4 Device Filtering

MAC allow-list filtering blocks unknown devices from joining. It is used together with WPA2-PSK and access control (not standalone security).

8.4.5 Privacy Protection

The system stores aggregate occupancy counts only and avoids personal identification. PIR-based sensing does not capture images.

8.5 Energy Efficiency

8.5.1 Prayer Time Control

Prayer-time-aware control avoids continuous operation outside worship periods.

8.5.2 Occupancy-Based Activation

Devices activate only when people are present, reducing unnecessary consumption.

8.5.3 Automatic Shutdown

Lights and fans turn off after inactivity timeout, minimizing waste.

8.6 Safety Considerations

8.6.1 Device Overheating

Thermal-safe operation requires ventilation, safe power design, and alerts/shutdown under abnormal heating.

8.6.2 Water Valve Reliability

Valve closure is validated over a short window to avoid false shutdown during normal use interruptions.

9. Device and Component Integration ---

9.1 Input Devices (Sensors)

9.1.1 Motion Sensor (PIR)

A Passive Infrared (PIR) sensor detects changes in infrared radiation emitted by warm bodies. It is compact, low-cost, and energy-efficient.

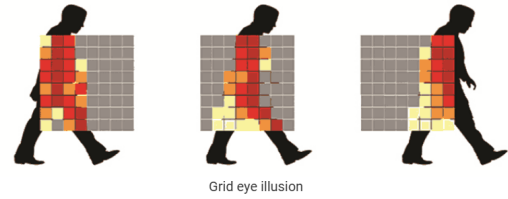


Figure 7: PIR motion sensor (left) and PIR sensing grid illustration (right)

Sensor details:

- Detection range: up to 7 meters
- Detection angle: 110 degrees
- Operating voltage: DC 4.5V–12V
- Output signal: 3.3V digital output
- Delay time: 0.3 seconds to 5 minutes (adjustable)
- Operating temperature: -15°C to $+70^{\circ}\text{C}$
- Sensitivity: adjustable

Working principle summary:

- 1. Infrared detection:** The PIR sensing element continuously detects infrared radiation from the environment. When a warm object crosses the field of view, the detected radiation level changes from one zone to another, producing a measurable differential signal. This transition is the key trigger used by the sensor to recognize motion.
- 2. Sensor structure:** Uses dual sensing zones and lens focusing.

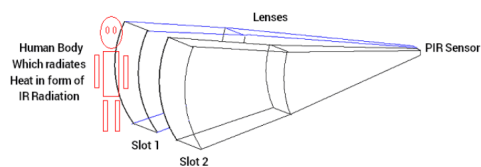
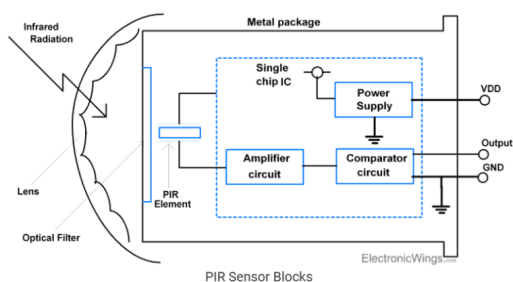


Figure 8: Infrared detection concept (left) and PIR sensor structure (right)

- 3. Idle state:** Balanced sensing zones keep the output stable.
- 4. Motion detection:** As a person moves across the sensing area, one PIR segment receives higher infrared energy than the other. The sensor circuit amplifies this difference and interprets it as movement.
- 5. Output generation:** After threshold comparison, the sensor produces a digital output pulse. This output is forwarded to the controller to trigger occupancy and automation logic in real time.

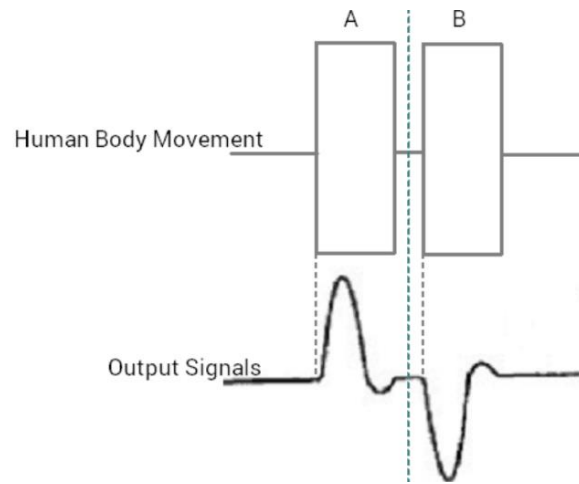


Figure 9: Motion detection behavior

PIR should be installed away from Wi-Fi antennas to reduce electromagnetic interference risk.

9.1.2 Air Quality Sensor (IAQ)



Figure 10: Indoor air quality sensor module

IAQ sensing supports ventilation control by monitoring gases and climate parameters.

Key IAQ factors:

- Chemical pollutants (CO_2 , VOCs, NO_2)
- Biological contaminants (mold, bacteria, allergens)
- Particulate matter (PM_{2.5}, PM₁₀)
- Environmental conditions (humidity, temperature, pressure)

Common pollutants and impact:

Pollutant	Description	Health Effects
CO ₂	Ventilation indicator	Fatigue, headache, lower productivity
VOCs	Emitted by paints/cleaners/plastics	Irritation, dizziness, long-term risk
PM2.5/PM10	Fine dust and smoke particles	Respiratory and cardiovascular burden
CO	Incomplete combustion product	Severe toxicity at high concentration
Formaldehyde	Emitted by furniture/insulation	Carcinogenic, irritation
NO ₂ /O ₃	Combustion and outdoor sources	Respiratory distress
Humidity	Moisture level	Mold growth, discomfort
Temperature	Thermal condition	Fatigue, reduced comfort

Table 10: IAQ factors and effects

IAQ sensors require periodic calibration (typically every 6–12 months).

9.1.3 Water Flow Sensor



Figure 11: Water flow sensor

Water flow sensors measure instantaneous flow rate and cumulative usage, producing pulse output suitable for MCU integration. This allows the controller to detect abnormal continuous flow and apply water-saving actions when needed.

Working principle summary:

- Water drives an internal rotor.
- Hall-effect sensing converts rotor speed to pulse signal.
- Pulse frequency maps to flow rate.
- Controller computes usage and triggers control logic.

9.2 Output Devices (Actuators)

9.2.1 Smart Lights

Activated by combined prayer-window and occupancy conditions to balance comfort and energy savings.

9.2.2 Fans (AC Simulation)

Activated by IAQ conditions and occupancy demand; reduced when conditions normalize.

9.2.3 Solenoid Valve

Automatically closes water supply during abnormal flow patterns and can reopen via logic/manual reset.

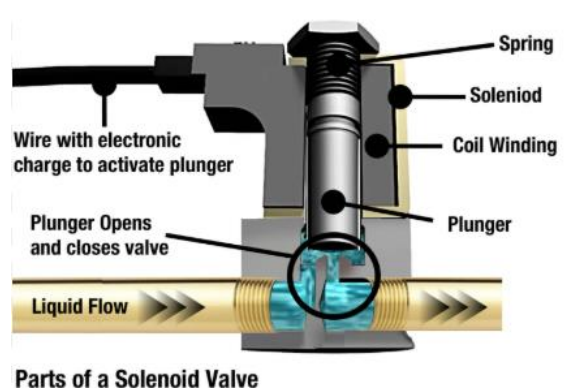


Figure 12: Solenoid valve components

9.3 Processing Unit

The ESP32 is selected for integrated Wi-Fi/Bluetooth, sufficient GPIO and peripheral interfaces (I2C/UART/SPI/PWM), low power operation, and capability to run concurrent IoT control tasks.

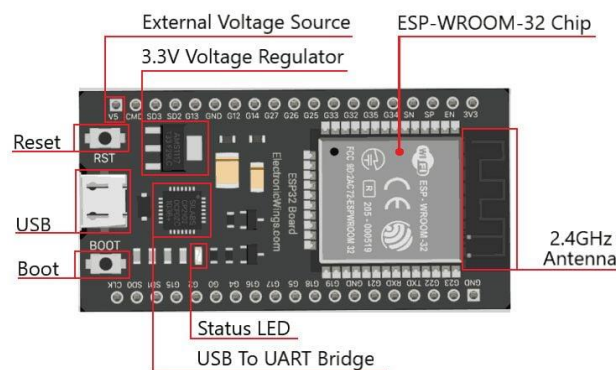


Figure 13: ESP32 processing unit

9.4 Communication Layer

- Local Wi-Fi AP for ESP32-to-server connectivity
- IEEE 802.11 with WPA2-PSK security

- Star topology
- IoT network segmentation from general user devices
- CPT representation: LAN linking MCU units to Registration Server

9.5 Integration Workflow

1. Sensing stage
2. Data transmission stage
3. Processing and decision stage
4. Actuation stage
5. Monitoring and feedback stage

This workflow is consistent with Step 2 process design.

9.6 System Diagram

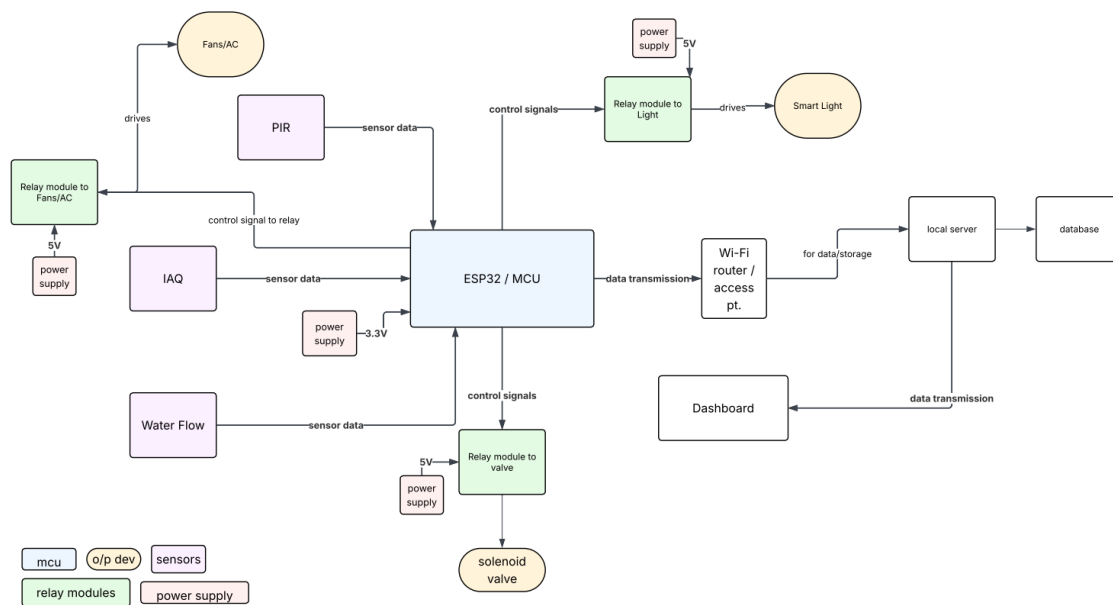


Figure 14: System integration diagram

10. Application Development

10.1 Application Overview and Platform

The application layer is a web-based dashboard acting as the primary interface between users and the IoT system. It centralizes real-time data visualization and device control in one operational view.

10.2 User Role

The system is designed for an admin role with full access to monitoring, alert handling, and override control to maintain system performance and safety.

10.3 Core Features

- Real-time monitoring (CO₂, temperature, humidity, occupancy)
- Live status display of connected devices
- Alert and notification handling for abnormal conditions
- Actuator control (e.g., ventilation)
- Historical data overview and basic trend visualization

Application-system interaction:

- Retrieves real-time sensor data via backend APIs
- Displays continuously updated system status
- Sends control commands to actuators
- Supports bidirectional monitoring/control communication
- Maintains low-latency updates for operational responsiveness

10.4 User Interface Design

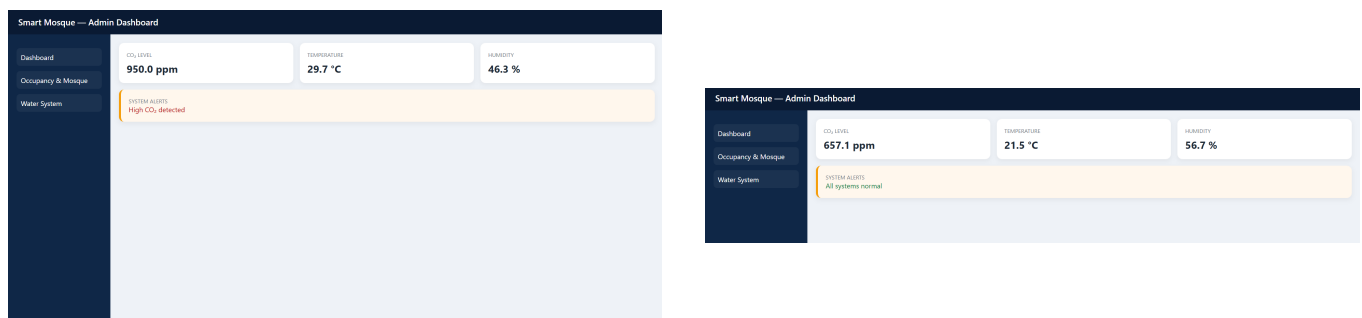


Figure 15: Dashboard UI design - views 1 and 2

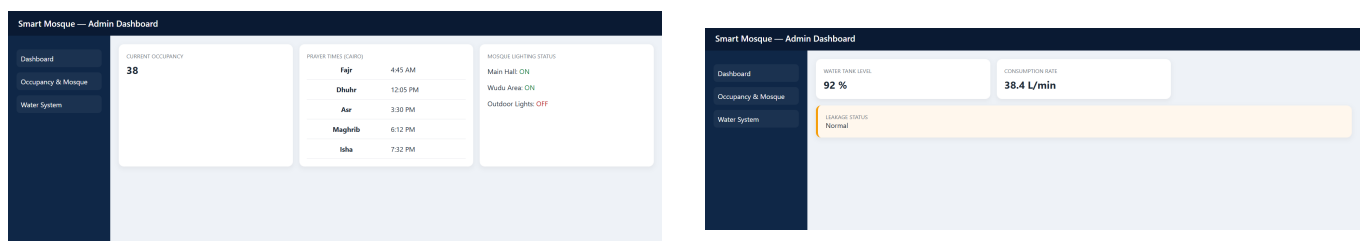


Figure 16: Dashboard UI design - views 3 and 4

List of Figures

1	Integrated system flowchart	7
2	UML domain model diagram	10
3	Main data flow	11
4	Main flow legend	12
5	Control flow	12
6	Operational response-time trend	19
7	PIR motion sensor (left) and PIR sensing grid illustration (right)	22
8	Infrared detection concept (left) and PIR sensor structure (right)	22
9	Motion detection behavior	23
10	Indoor air quality sensor module	23
11	Water flow sensor	24
12	Solenoid valve components	25
13	ESP32 processing unit	25
14	System integration diagram	26
15	Dashboard UI design - views 1 and 2	27
16	Dashboard UI design - views 3 and 4	27

References

- PIR Motion Sensor: <https://www.electronicwings.com/sensors-modules/pir-sensor>
- IAQ Sensor: <https://www.winsen-sensor.com/knowledge/iaq-sensor.html>
- Water Flow Sensor: <https://www.elprocus.com/a-memoir-on-water-flow-sensor/>
- ESP32 Processing Unit: <https://www.espressif.com/en/products/socs/esp32>
- IoT Response Time: <https://ieeexplore.ieee.org/document/9043102>
- Carbon Dioxide Levels: <https://www.co2meter.com/blogs/news/carbon-dioxide-indoor-levels-cha>
- IR Motion Detection Rate: <https://www.ti.com/lit/an/slaaef6/slaaef6.pdf>
- Air Quality Monitoring: <https://www.sciencedirect.com/science/article/pii/S0360132325008686>
- Water Flow Monitoring: <https://new.abb.com/products/measurement-products/measurement-produ>
[water-flowmeters-for-enhanced-leakage-detection](https://new.abb.com/products/measurement-products/measurement-produ)
- IoT Security: <https://www.digi.com/blog/post/iot-security>
- Access Control: <https://thingsboard.io/docs/pe/user-guide/rbac/>
- Data Encryption: <https://www.buildings.com/safety-security/cybersecurity/article/33017912/trust-no-one-3-steps-to-secure-iot-devices-and-building-it-and-ot-networks>
- WPA2-PSK Background: <https://superops.com/tech-hub/what-is-wpa2-psk>
- Device Filtering: <https://www.portnox.com/cybersecurity-101/network-security/what-is-a-mac>
- MAC Filtering: <https://blog.scalefusion.com/what-is-mac-filtering/>