




1

MONTHLY SUMMARY

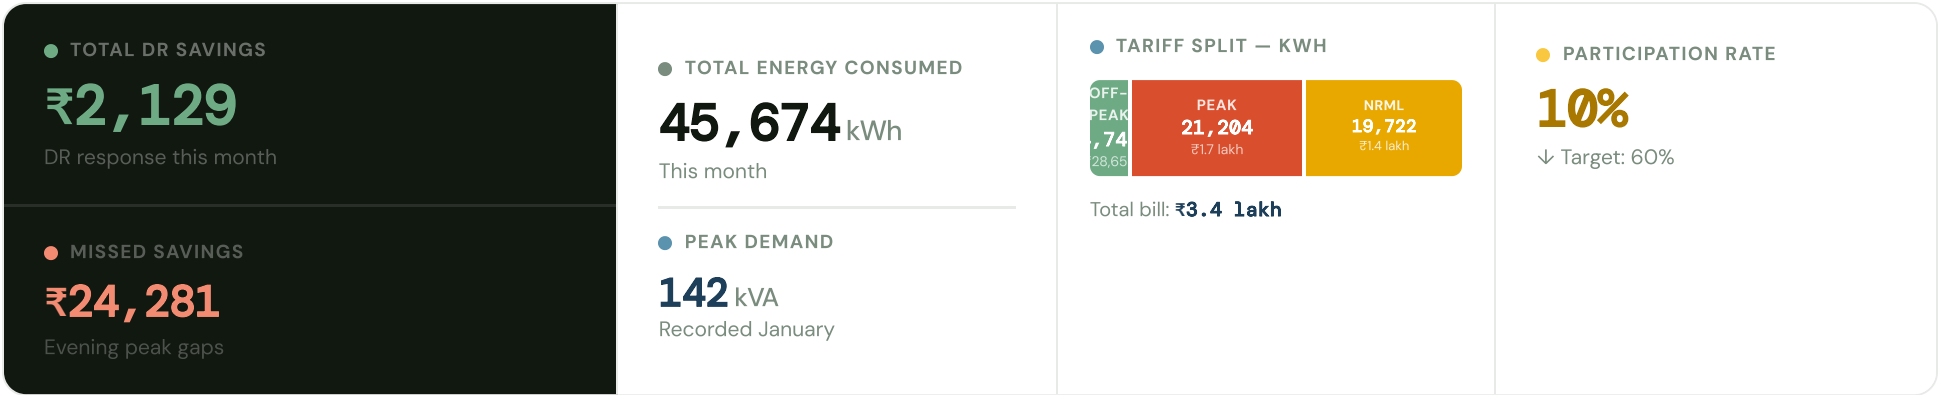


2

LOAD ANALYSIS

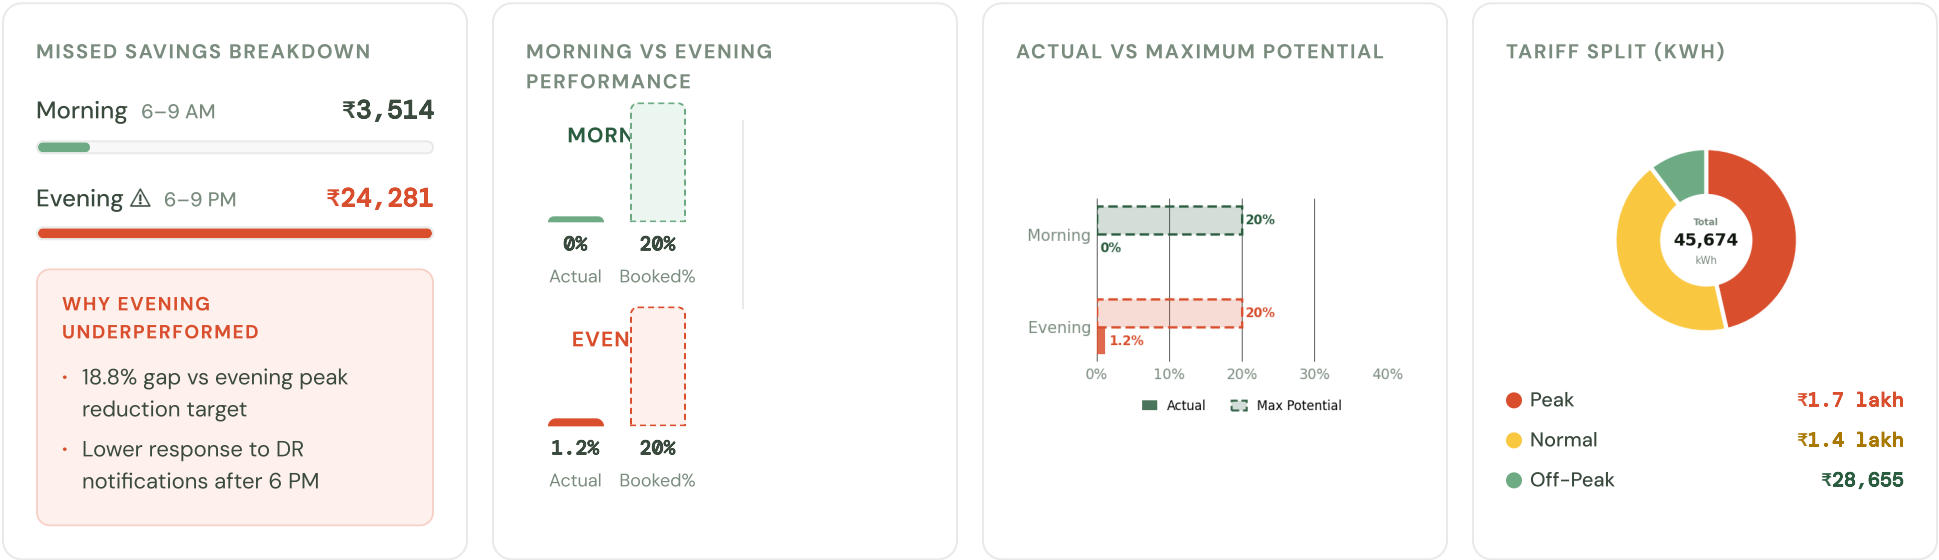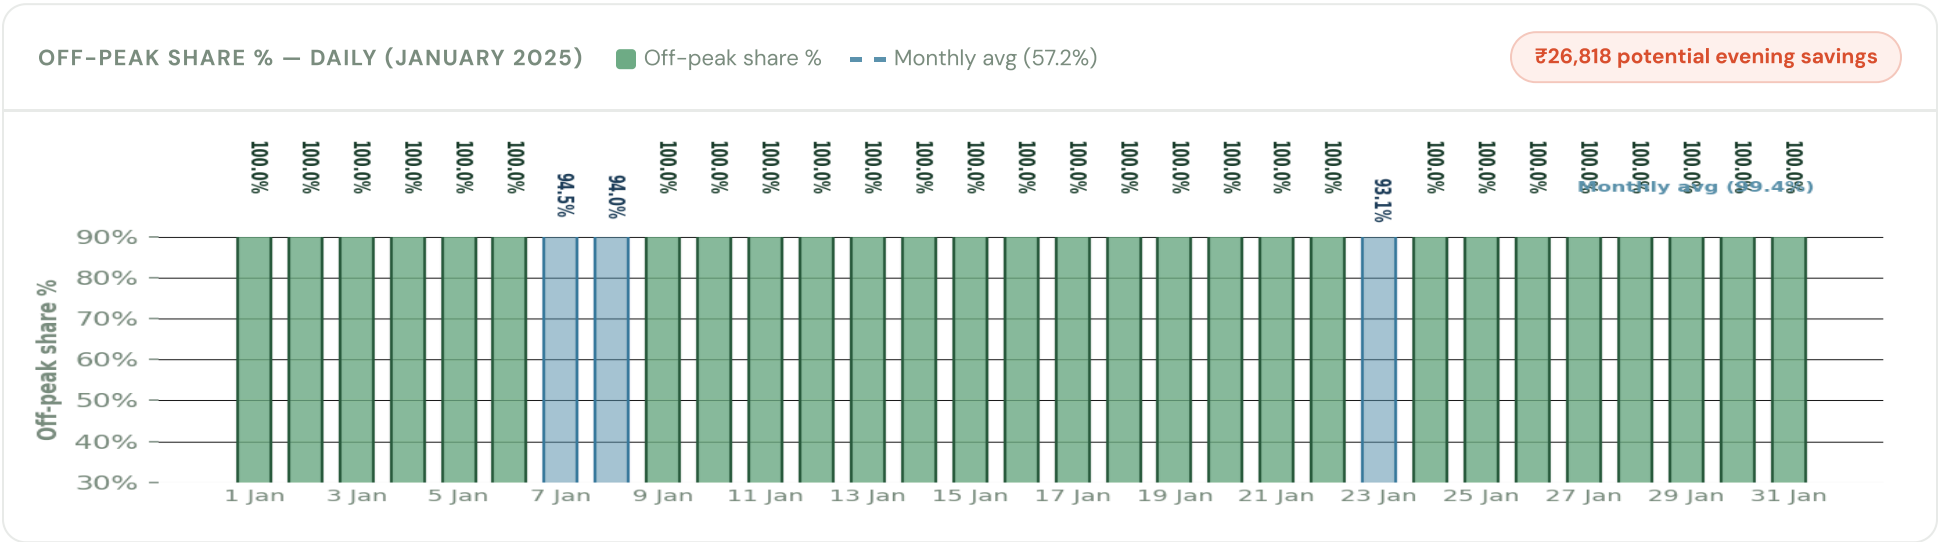

3

DAILY ENERGY

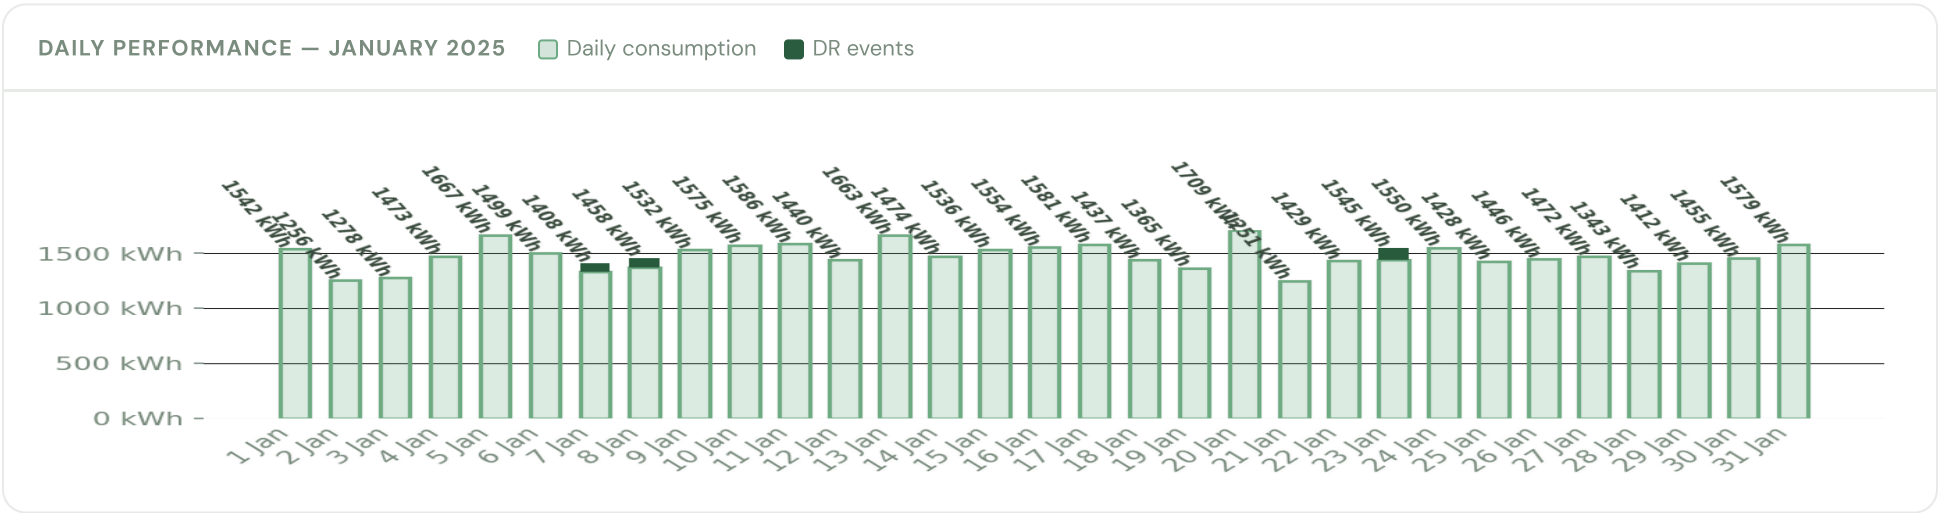

4

EVENT-LEVEL SUMMARY

DATE	DAY	WINDOW	TARGET REDUCTION	ACTUAL REDUCTION	KWH SHIFTED	SAVINGS (₹)	RESULT
Jan 5	Sunday	6 PM–9 PM	20%	0%	0 kWh	₹0	Missed
Jan 9	Thursday	6 PM–9 PM	15%	0%	0 kWh	₹0	Achieved
Jan 16	Thursday	6 PM–9 PM	15%	0%	0 kWh	₹0	Achieved
Jan 23	Thursday	6 PM–9 PM	15%	14%	85 kWh	₹664	Achieved

TOTAL EVENTS

4

This month

ACHIEVED

3

75% success rate

MISSED

1

All evening events

TOTAL KWH SHIFTED

85

kWh across all events

Pattern observed: All 1 missed event(s) occurred during 6–9 PM windows. Focusing improvement efforts on evening response will directly close the participation gap.

5

ACTION PLAN — NEXT MONTH

RECOMMENDATIONS

3 things to act on this month

1

Most missed savings occurred during evening peak (6–9 PM) due to reduced response to DR alerts. Improving evening response alone could unlock ₹2.5 lakh–₹3.4 lakh annually for this site.

2

Shift non-critical loads (HVAC pre-cooling, water pumps) before 6 PM

3

Target minimum 15% reduction during 6–9 PM DR events