

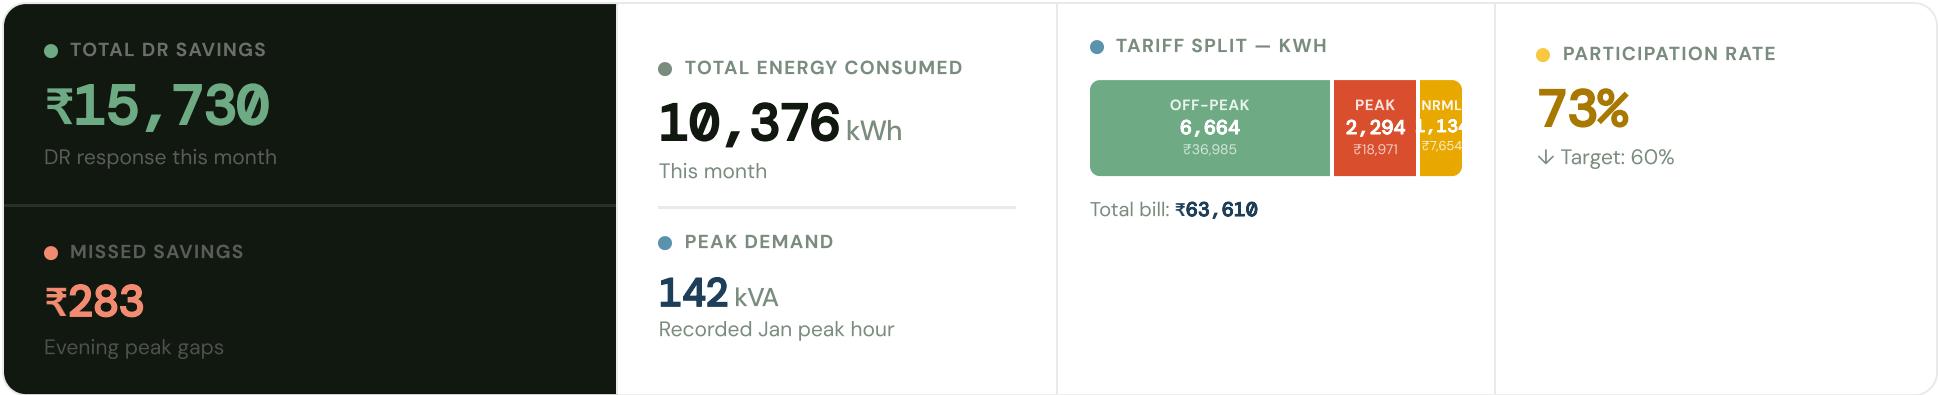



1MONTHLY SUMMARY

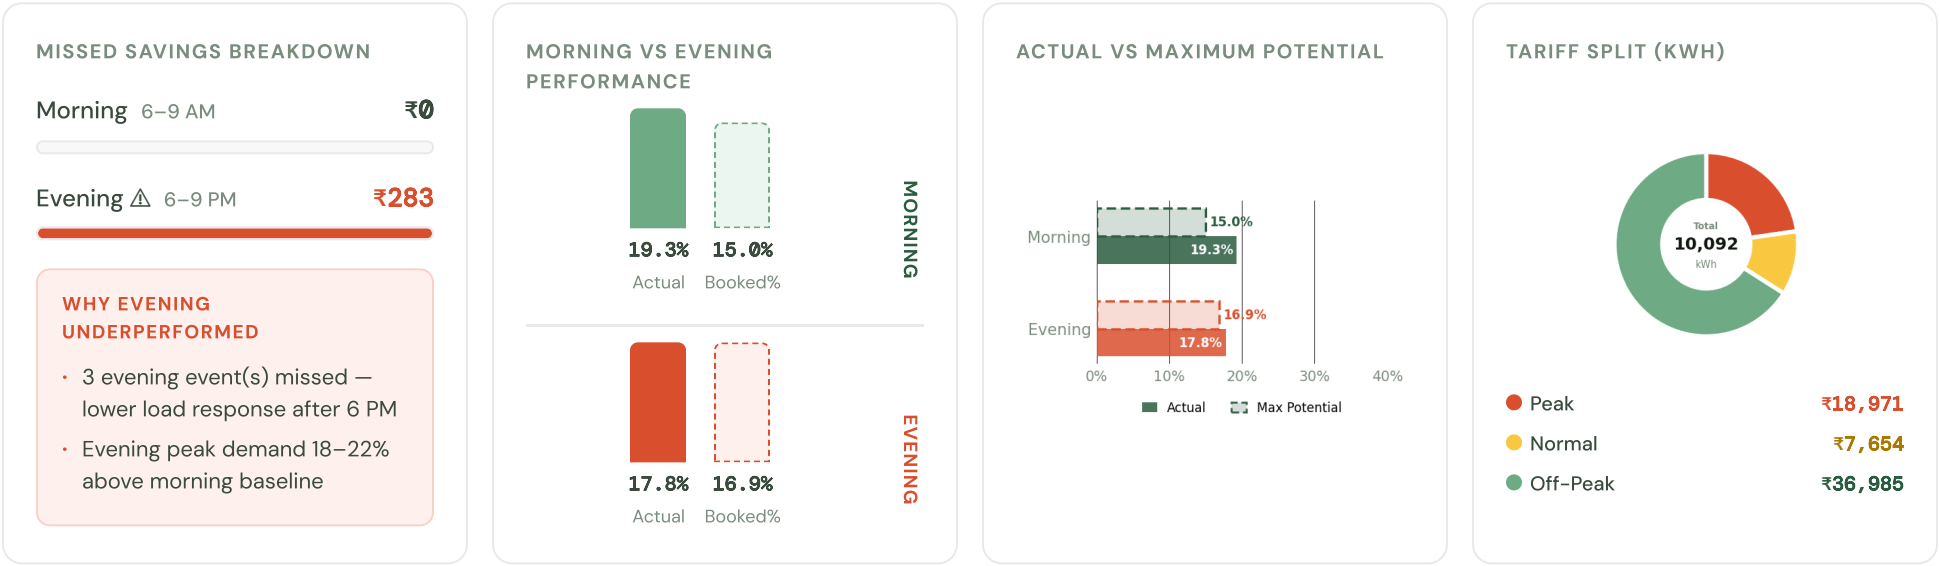

2LOAD ANALYSIS

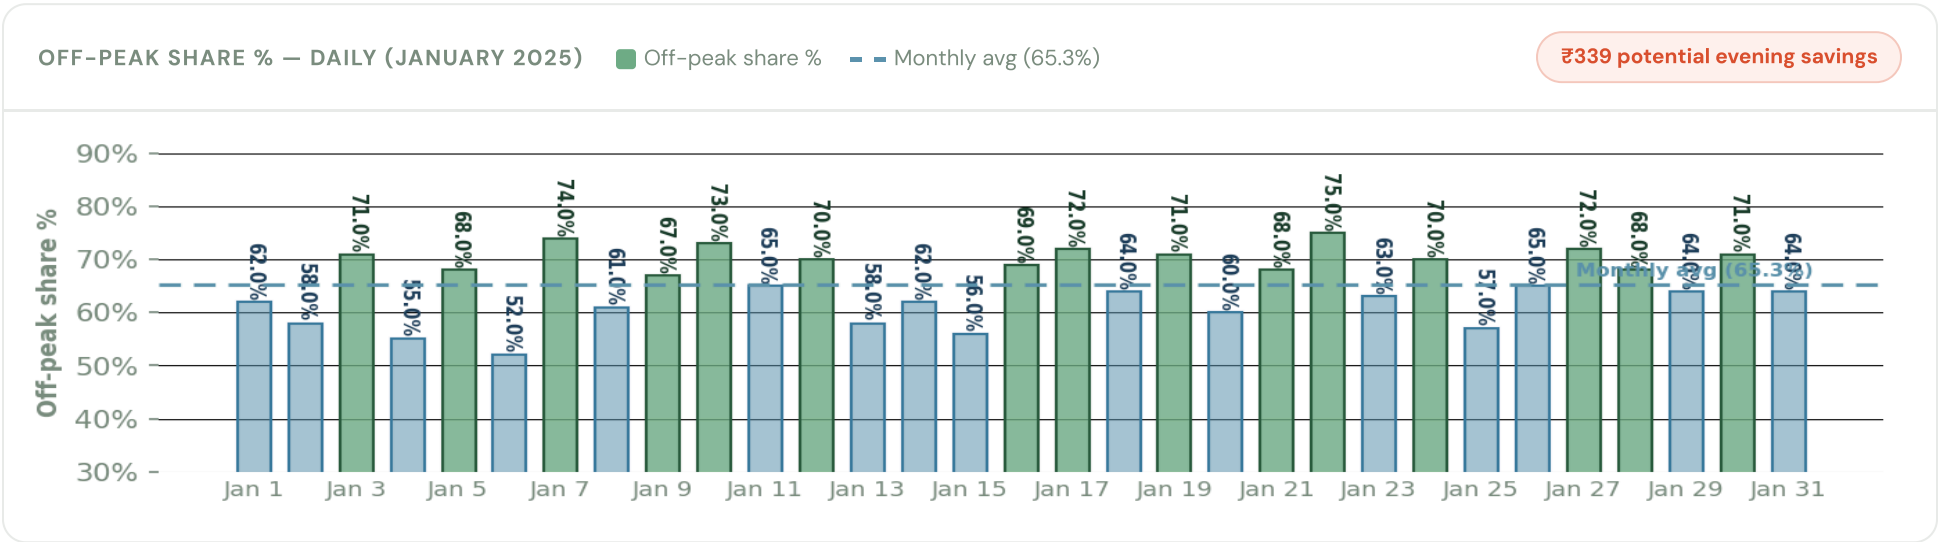

3DAILY ENERGY

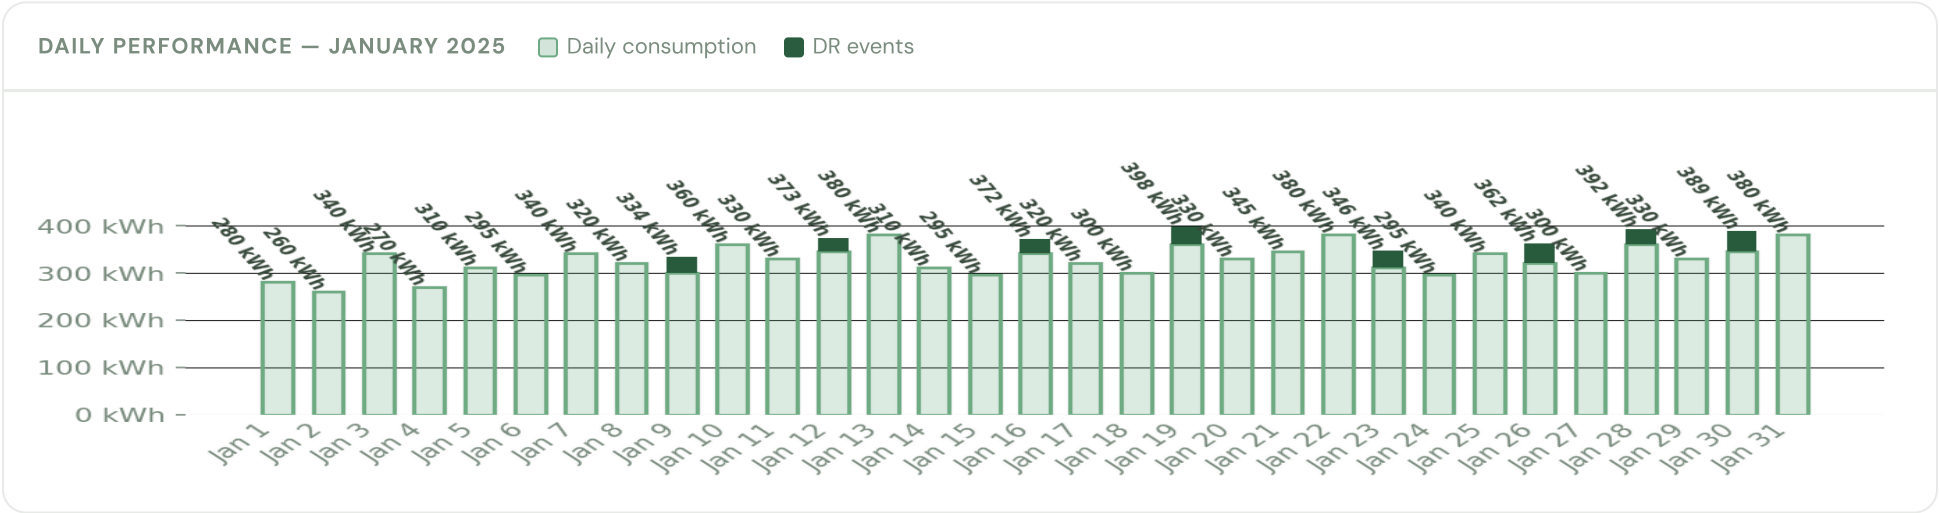

4EVENT-LEVEL SUMMARY

DATE	DAY	WINDOW	TARGET REDUCTION	ACTUAL REDUCTION	KWH SHIFTED	SAVINGS (₹)	RESULT
2025-01-05	Sunday	6–9 PM	20%	6%	12 kWh	₹660	Missed
2025-01-09	Thursday	6–9 PM	15%	17%	34 kWh	₹1,870	Achieved
2025-01-12	Sunday	6–9 AM	15%	18%	28 kWh	₹1,540	Achieved
2025-01-14	Tuesday	6–9 PM	20%	9%	18 kWh	₹990	Missed
2025-01-16	Thursday	6–9 PM	15%	16%	32 kWh	₹1,760	Achieved
2025-01-19	Sunday	6–9 AM	15%	19%	38 kWh	₹2,090	Achieved
2025-01-21	Tuesday	6–9 PM	15%	14%	28 kWh	₹1,540	Missed
2025-01-23	Thursday	6–9 PM	15%	18%	36 kWh	₹1,980	Achieved
2025-01-26	Sunday	6–9 AM	15%	21%	42 kWh	₹2,310	Achieved
2025-01-28	Tuesday	6–9 PM	15%	16%	32 kWh	₹1,760	Achieved
2025-01-30	Thursday	6–9 PM	20%	22%	44 kWh	₹2,420	Achieved

TOTAL EVENTS

11

This month

ACHIEVED

8

73% success rate

MISSED

3

All evening events

TOTAL KWH SHIFTED

344

kWh across all events

Pattern observed: All 3 missed event(s) occurred during 6–9 PM windows. Morning DR events (6–9 AM) achieved 100% success with an average overperformance of +4.3%. Focusing improvement efforts on evening response will directly close the participation gap.

5ACTION PLAN — NEXT MONTH

RECOMMENDATIONS3 things to act on this month

- 1

Most missed savings occurred during evening peak (6–9 PM) due to reduced response to DR alerts. Improving evening response alone could unlock ₹2,830–₹3,962 annually for this site.
- 2

Pre-cool HVAC and shift water-pump loads before 6 PM to reduce evening peak draw.
- 3

Enable automated DR alerts on the building management system for faster response.

Event data represents verified DR responses. kWh shifted calculated against baseline day consumption profiles.