

Development of an IoT-Based Smart Sub-Metering System for Room-Level Electricity Monitoring, Carbon Emission Estimation, and Fair Electricity Cost Allocation

Farzana Yeasmin Keya, Shimul Kumar, Shormin Fiza, Ibna Jiam, Rashedul Amin Tuhin

Department of Computer Science and Engineering

East West University

Dhaka, Bangladesh

{2023-3-60-245, 2023-3-60-157, 2023-3-60-243, 2023-3-60-166}@std.ewubd.edu

mcctuhin@ewubd.edu

Abstract—Shared electricity billing in residential environments often divides costs equally among occupants, even when their actual electricity consumption differs. This study investigated how an IoT-based smart sub-metering system could support room-level electricity monitoring, carbon emission estimation, and fairer electricity cost allocation. A quantitative observational approach was used to collect electricity data from two rooms occupied by individuals with different economic positions. Two Tuya-compatible smart meters were monitored through a local Wi-Fi network using the TinyTuya Python API, with measurements collected every 10 seconds over a 15-day period. Voltage, current, power, cumulative energy consumption, device status, switch status, fault status, and timestamps were stored in a SQLite database and analyzed using Python, Pandas, and NumPy through a Flask-based web platform. Room K consumed 65.83 kWh, compared with 40.61 kWh for Room F, resulting in estimated emissions of 41.93 kg CO₂ and 25.87 kg CO₂, respectively. Consumption-based billing produced estimated costs of BDT 494.60 for Room K and BDT 305.40 for Room F, compared with BDT 400 each under equal allocation. The findings demonstrate that IoT sub-metering can provide transparent room-level electricity, carbon, and cost information and can support more consumption-sensitive electricity allocation. However, the small sample and 15-day monitoring period limit generalization.

Index Terms—IoT, smart metering, sub-metering, electricity monitoring, carbon emission, fair billing, shared residence, energy management

I. INTRODUCTION

Shared residential spaces often rely on a common electricity meter and divide costs equally among occupants, even when their actual electricity consumption differs. Occupants may use different appliances, follow different daily routines, and have different economic circumstances. As a result, equal bill sharing may not accurately reflect individual electricity use or the financial burden of electricity consumption.

IoT-based smart sub-metering provides a practical approach for measuring electricity consumption at the individual room level. Previous studies have shown substantial differences in dormitory electricity consumption due to occupant behavior,

room characteristics, and occupancy patterns [1], [3], [5]. IoT-based systems have also demonstrated the feasibility of continuous, high-resolution electricity monitoring and real-time visualization [2], [6], [8]. However, existing studies have generally focused on electricity monitoring, energy management, or system development separately, with less attention to combining room-level consumption measurement with carbon-emission estimation and electricity-cost allocation.

This study develops an IoT-based smart sub-metering system integrated with a web-based monitoring platform to address this gap. The system measures room-level electricity consumption and uses these measurements to estimate carbon emissions and electricity costs. In addition, economic position is considered as an additional factor when evaluating electricity-cost fairness. The study involves two working occupants with different economic positions: a journalist residing in Room K and a medicine company representative residing in Room F with a comparatively lower economic position.

The study therefore examines differences in electricity consumption, carbon emissions, and electricity cost burden between the two occupants and considers how these differences relate to their economic circumstances. The developed web-based platform provides a practical interface for monitoring, visualizing, and analyzing the collected electricity data.

The main contributions of this study are:

- Development of an IoT-based room-level electricity monitoring system integrated with a web-based platform.
- Estimation of individual carbon emissions from measured electricity consumption.
- Comparison of conventional equal-bill and consumption-based electricity cost allocation.
- Inclusion of economic position as an additional factor when evaluating electricity-cost fairness.
- Practical evaluation using 15 days of real electricity measurements from two working occupants with different economic positions.

A. Background

Electricity consumption in shared residential environments varies between occupants because of differences in appliance use, daily routines, and occupancy patterns. Previous dormitory studies have found substantial differences in room-level electricity consumption and identified factors such as appliance use, room location, and academic schedules as important influences [1], [3], [5]. These findings support the need for more detailed monitoring than a single shared electricity meter can provide.

IoT-based smart metering can address this problem by providing continuous electricity measurements at the room or equipment level. Studies have demonstrated the feasibility of collecting high-resolution electricity data and using IoT systems for real-time monitoring and energy management [2], [6], [8]. Smart monitoring platforms have also been shown to improve energy awareness and support energy-management decisions [4], [7].

However, conventional shared billing generally records only the total electricity consumption of a residence. It does not show how much electricity each occupant used, the carbon emissions associated with that use, or whether each occupant's share of the bill reflects their actual consumption. Room-level monitoring can address these issues by linking individual electricity use with cost and environmental impact.

Fairness may also depend on economic circumstances. Two occupants paying the same amount may experience different financial burdens if their economic positions differ. Therefore, considering economic position alongside measured electricity consumption provides an additional perspective when evaluating electricity-cost fairness.

This study applies IoT-based sub-metering to two working occupants with different economic positions and uses a web-based platform to monitor their electricity use. The system measures consumption, estimates carbon emissions, and compares equal-bill with consumption-based cost allocation. In this way, the study extends previous work on electricity monitoring by combining consumption, environmental impact, and cost allocation at the room level.

B. Research Objectives

The aim of this study is to develop and evaluate an IoT-based smart sub-metering system for individual electricity monitoring, carbon emission estimation, and fair electricity cost allocation while considering occupants' economic positions. The specific objectives are:

- 1) To develop an IoT-based smart sub-metering system for room-level electricity monitoring.
- 2) To measure and analyze individual electricity consumption using the developed system.
- 3) To estimate individual carbon emissions from measured electricity consumption.
- 4) To compare equal-bill and consumption-based electricity cost allocation.

- 5) To examine the relationship between economic position, electricity consumption, carbon emissions, and cost burden.

C. Research Questions

The main research question addressed in this study is: how can an IoT-based smart sub-metering system support individual electricity monitoring, carbon emission estimation, and fair electricity cost allocation while considering occupants' economic positions? This is examined through the following sub-questions:

- 1) **RQ1:** How does electricity consumption differ between the two occupants based on room-level measurements?
- 2) **RQ2:** What are the corresponding carbon emissions from each occupant's electricity consumption?
- 3) **RQ3:** How does consumption-based electricity allocation differ from equal-bill allocation?
- 4) **RQ4:** How do differences in economic position relate to electricity cost burden?
- 5) **RQ5:** How can the developed web-based system support monitoring and visualization of electricity consumption, carbon emissions, and costs?

D. Limitations of the Study

This study is limited to two occupants and a 15-day monitoring period, so the findings cannot be generalized to other shared residential environments or economic groups. The economic-position comparison is limited to these occupants and indicates an association rather than a causal relationship with electricity consumption. The study also considers only electricity-related carbon emissions and does not include emissions from other household activities or sources.

II. METHODOLOGY

This study used a quantitative, IoT-based observational approach to measure room-level electricity consumption, carbon emissions, and electricity costs. Quantitative observation was appropriate because the study relied on numerical measurements collected systematically over time. Manual meter readings and questionnaire-based approaches were considered, but manual readings provide fewer observations and require repeated human intervention, while questionnaires depend on participants' ability to accurately report their electricity use. Automated IoT sub-metering was therefore selected because it provided direct, repeated measurements and was better suited to comparing electricity consumption between individual rooms.

A. Data Collection Methods

Electricity data were collected from Room F and Room K over a 15-day period using two Tuya-compatible smart meters. The meters communicated with the monitoring system through the local Wi-Fi network using the TinyTuya Python API, without relying on Tuya Cloud.

The monitoring system recorded measurements at a fixed interval of 10 seconds. For each successful reading, the following parameters were recorded:

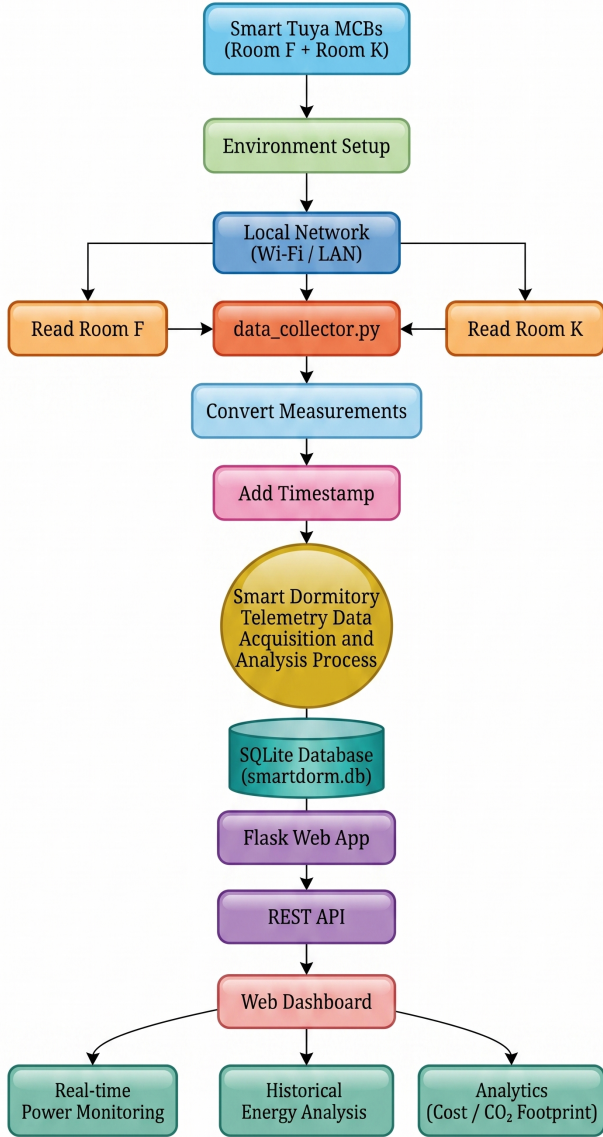


Fig. 1. Architecture of the proposed IoT-based smart sub-metering system.

- Voltage (V)
- Current (A)
- Instantaneous power (W)
- Cumulative energy consumption (kWh)
- Device status
- Switch status
- Fault status
- Timestamp

The readings were stored in a local SQLite database for analysis. Automated measurement was preferred because it provided actual high-frequency electricity data rather than relying on estimated or self-reported consumption. This approach is consistent with previous IoT energy-monitoring studies that used automated sensing to provide continuous

electricity measurements [2], [6], [8]. However, the system was locally hosted and depended on a computer and network connection remaining available. Power outages or network interruptions could therefore interrupt data collection and require the system to be restarted.

The developed web-based system, built using Flask, Pandas, NumPy, SQLite, and TinyTuya, was used to monitor the devices and visualize the collected data. It provided live monitoring, historical consumption trends, room comparisons, electricity-cost analysis, and carbon-emission estimates.

The instantaneous electrical power measured at each reading can be represented as:

$$P = V \times I \quad (1)$$

where P represents electrical power in watts, V represents voltage in volts, and I represents current in amperes.

B. Participants and Sampling

The study used purposive sampling to select two suitable rooms, Room F and Room K, occupied by two working individuals with different economic positions. The rooms were selected based on their suitability for installing and operating the smart-metering system. Room K was occupied by a journalist, while Room F was occupied by a medicine company representative with a comparatively lower economic position.

Purposive sampling was appropriate because the study aimed to obtain detailed measurements from specific rooms rather than produce a statistically representative sample of all residential occupants. The resulting study was therefore treated as a small 15-day case study. This allowed detailed comparison between the two rooms but limited the generalizability of the findings to other dormitories and economic groups.

C. Data Analysis Method

The collected 15-day data were analyzed quantitatively using Python, Pandas, NumPy, and SQLite. The measurements were grouped by room and time period to examine energy consumption, average power, peak power, voltage, and electricity-use patterns. Descriptive aggregation was used to summarize the measured data and identify differences in consumption and power demand between the two rooms. The results were presented using graphs and the developed web-based dashboard.

For a measurement interval of Δt hours, the energy consumption associated with an individual reading can be estimated as:

$$E = P \times \Delta t \quad (2)$$

where E is energy consumption in kWh and P is power in kW.

Electricity costs were calculated using the measured energy consumption and an electricity rate of BDT 7.5/kWh. Each room's consumption-based cost was determined from its proportion of the total measured consumption and compared

TABLE I
SUMMARY OF ELECTRICITY CONSUMPTION OVER THE 15-DAY
OBSERVATION PERIOD

Room	Energy (kWh)	Peak Power (W)	Carbon (kg CO ₂ e)
Room F	40.61	≈ moderate	25.87
Room K	65.83	≈ 470	41.93

with an equal division of the total bill. Carbon emissions were estimated by multiplying each room's measured energy consumption by the Bangladesh grid emission factor of 0.637 kg CO₂/kWh, following:

$$C = E \times EF \quad (3)$$

where C represents carbon emissions, E represents electricity consumption in kWh, and EF represents the electricity-grid emission factor in kg CO₂e/kWh. These calculations provided the basis for comparing electricity consumption, power patterns, carbon emissions, and cost allocation.

D. Research Ethics

The study primarily collected technical electricity data rather than sensitive personal information. Room identifiers were used instead of personal names in the analysis. Access credentials, such as device keys, were kept private and were not included in the research outputs.

Because electricity patterns may indirectly reveal occupant behavior, the collected data were treated as research data and presented without unnecessary personally identifying information. The remote switching function was used as a system feature and operated with care to avoid unintended interruption of electricity supply.

E. Data Collection and Analysis

Electricity data were collected from Room F and Room K over a 15-day observation period using the developed IoT sub-metering system. Each smart meter was queried at 10-second intervals, and valid measurements were stored in a SQLite database. The collected variables included voltage, current, instantaneous power, cumulative energy consumption, device status, switch status, fault status, and timestamp.

The collected data were processed using Python, Pandas, and NumPy. Room-level measurements were aggregated to compare electricity consumption and power demand over time. Carbon emissions were calculated using the Bangladesh grid emission factor of 0.637 kg CO₂/kWh, while electricity costs were calculated using a rate of BDT 7.5/kWh. The analysis compared equal-bill and consumption-based allocation, with the results visualized through the developed web-based dashboard.

III. RESULTS

A. Data Collection and Analysis

Overall electricity consumption differed substantially between the two monitored rooms. During the 15-day observation period, Room K consumed 65.83 kWh, while Room

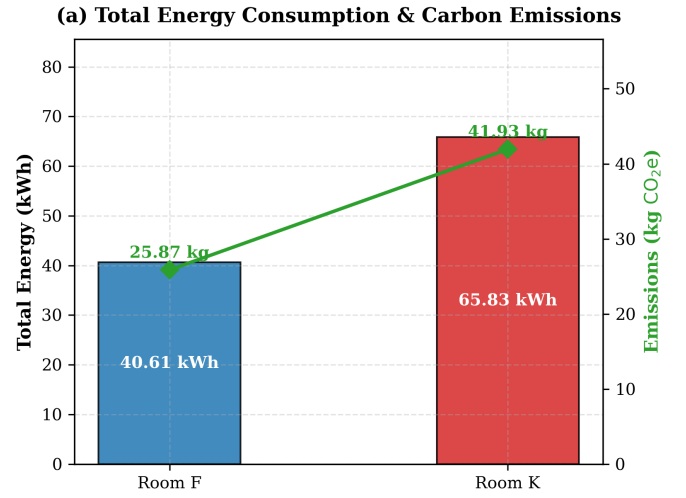


Fig. 2. Comparison of total electricity consumption and estimated carbon emissions for Room K and Room F.

F consumed 40.61 kWh, giving a difference of 25.22 kWh. Thus, Room K's measured electricity consumption was approximately 62% higher than Room F's. These differences indicate variations in appliance usage, occupancy behavior, and daily electricity demand between the two occupants.

The hourly power profile shows that the difference between the rooms was not uniform throughout the day. Room K generally exhibited higher power demand than Room F, with the largest differences occurring during the evening. On weekdays, Room K's average power increased sharply after approximately 17:00, reaching around 360 W at 23:00, while Room F remained comparatively low for most of the same period. During weekends and holidays, Room K also showed substantially higher demand, reaching approximately 470 W at 18:00. Room F showed a smaller increase during these periods, with its highest weekend/holiday values occurring around the evening.

These patterns indicate that the higher total consumption observed for Room K was accompanied by periods of substantially greater instantaneous power demand, particularly during evening and non-working-day periods.

B. Energy Consumption Analysis

The measured electricity consumption and corresponding environmental impact are summarized in Fig. 2. Room K recorded higher total electricity consumption than Room F throughout the observation period. The figure provides a comparative view of the total energy consumption and associated carbon emissions for the two rooms.

C. Carbon Footprint Estimation

The corresponding estimated carbon emissions followed the same pattern as measured energy consumption. Room K was associated with 41.93 kg CO₂, compared with 25.87 kg CO₂ for Room F. This represents an estimated difference of

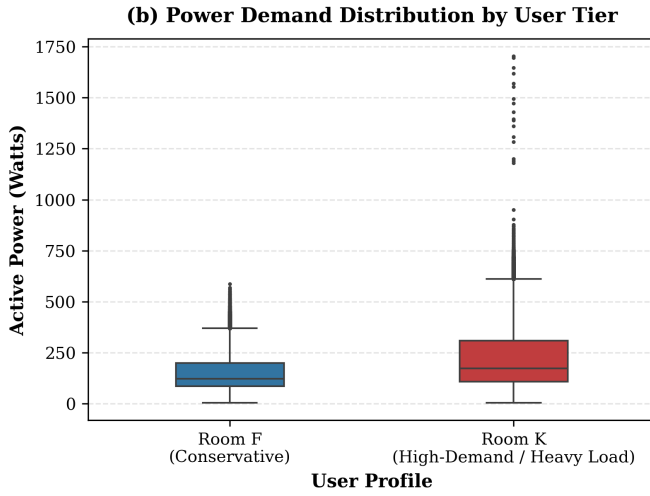


Fig. 3. Distribution of measured power demand for Room K and Room F during the observation period.

16.06 kg CO₂ over the observation period, driven directly by the higher electricity consumption recorded for Room K.

The distribution of measured power demand is illustrated in Fig. 3. The results show that Room K experienced a wider and generally higher range of power demand compared with Room F.

D. Energy Consumption and Economic Position

Electricity consumption was compared across the two occupants according to their economic position. Room K, occupied by a journalist with a comparatively higher economic position, recorded both higher electricity consumption and a higher evening power demand than Room F, occupied by a medicine company representative with a comparatively lower economic position. This pattern is treated as an observed association within this two-occupant case study rather than evidence of a causal relationship.

E. Weekly and Holiday Consumption Pattern

The collected data were grouped according to the day of the week and categorized into weekday and weekend/holiday periods. Both rooms showed elevated power demand during weekend/holiday evenings relative to weekdays, but the increase was substantially larger for Room K, whose weekend/holiday peak power (≈ 470 W) exceeded its own weekday peak (≈ 360 W) as well as Room F's demand during the same periods.

The hourly variation in electricity demand across the observation period is presented in Fig. 4. The figure highlights the differences between weekday and weekend/holiday power profiles.

F. Fair Billing Analysis

In conventional shared-housing environments in Bangladesh, electricity costs are often divided equally among occupants, irrespective of differences in individual

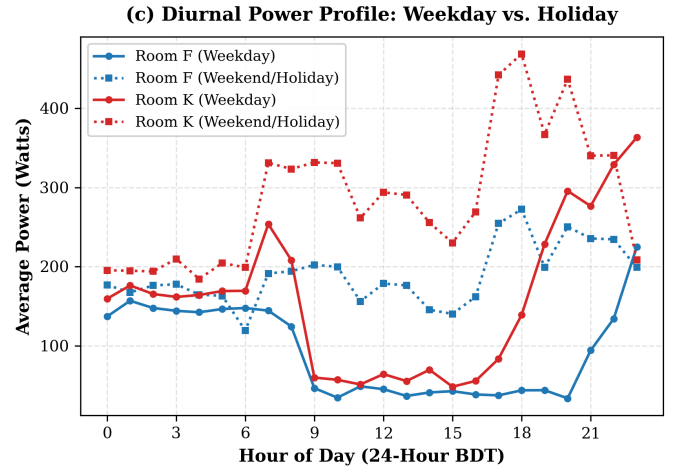


Fig. 4. Hourly power demand profiles for Room K and Room F during weekday and weekend/holiday periods.

consumption. This flat-split billing approach can create cross-subsidization, where low-consumption occupants effectively bear part of the electricity cost generated by high-consumption occupants.

Under conventional billing, the total electricity cost is divided equally among occupants:

$$Cost_i^{conv} = \frac{C_{total}}{N} \quad (4)$$

where C_{total} is the total electricity cost and N is the number of occupants.

In contrast, the proposed approach allocates costs according to measured electricity consumption:

$$Cost_i^{fair} = \frac{E_i}{E_{total}} C_{total} \quad (5)$$

where E_i is the electricity consumption of occupant i and E_{total} is the total measured consumption.

To quantify this billing inequity, a representative billing cycle with a total electricity cost of BDT 800.00 is considered. During the 14-day monitoring period, the two sub-metered units, Room K and Room F, recorded the energy consumption values reported above. The aggregate electricity consumption is therefore

$$E_{total} = E_K + E_F = 65.83 + 40.61 = 106.44 \text{ kWh.} \quad (6)$$

Applying the proportional-allocation model, the cost assigned to Room K is

$$C_K = \left(\frac{65.83}{106.44} \right) \times 800.00 \approx \text{BDT } 494.78, \quad (7)$$

and the cost assigned to Room F is

$$C_F = \left(\frac{40.61}{106.44} \right) \times 800.00 \approx \text{BDT } 305.22. \quad (8)$$

TABLE II
CONVENTIONAL AND IOT-BASED BILLING COMPARISON

Method	Room K	Room F	Total
50/50 Split	BDT 400.00	BDT 400.00	BDT 800.00
IoT Proportional	BDT 494.78	BDT 305.22	BDT 800.00
Difference	+BDT 94.78	-BDT 94.78	BDT 0.00

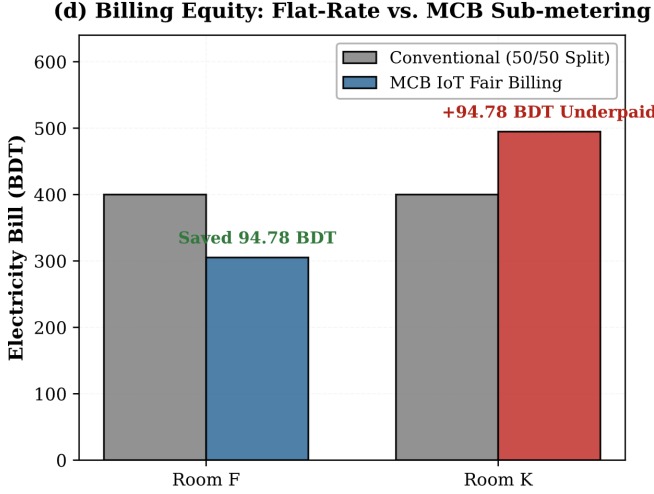


Fig. 5. Comparison of conventional equal-sharing and IoT-based proportional electricity billing for Room K and Room F.

Under the conventional 50/50 billing method, each occupant would instead pay

$$C_{\text{flat}} = \frac{800.00}{2} = \text{BDT } 400.00. \quad (9)$$

The resulting differences between conventional and consumption-based billing are $\Delta C_K = 494.78 - 400.00 = +\text{BDT } 94.78$ for Room K and $\Delta C_F = 305.22 - 400.00 = -\text{BDT } 94.78$ for Room F, summarized in Table II.

““latex ““

The billing comparison is visually presented in Fig. 5. The consumption-based approach assigns a larger share of the total cost to Room K because of its higher measured electricity consumption, while Room F receives a lower allocation.

The results demonstrate that the conventional flat-split method creates a cross-subsidy of BDT 94.78 from the lower-consuming occupant to the higher-consuming occupant. For Room F, this difference represents approximately

$$\frac{94.78}{400} \times 100 \approx 23.70\% \quad (10)$$

of its conventional bill. In contrast, IoT-enabled sub-metering aligns financial responsibility with actual measured consumption, thereby improving billing fairness, transparency, and accountability. ““

IV. DISCUSSION

The results show that room-level IoT monitoring provided substantially different electricity-use and cost profiles between

the two occupants. Over the 15-day observation period, Room K consumed 65.83 kWh, compared with 40.61 kWh for Room F. This higher consumption was also associated with higher estimated carbon emissions and a higher consumption-based electricity cost.

A. Answer to RQ1: Electricity Consumption Patterns

Electricity consumption differed considerably between the two occupants. Room K consumed 65.83 kWh, while Room F consumed 40.61 kWh, a difference of 25.22 kWh. The hourly analysis also showed that the difference was particularly noticeable during evening periods. This finding is consistent with previous dormitory studies showing that electricity consumption varies between rooms because of differences in appliance use, occupant behavior, room characteristics, and occupancy patterns [1], [3], [5]. The present study extends these findings by linking room-level consumption directly to carbon emissions and electricity-cost allocation.

B. Answer to RQ2: Economic Position and Energy Use

The occupant with the comparatively higher economic position also recorded higher electricity consumption and cost during the observation period. However, this should be interpreted only as an observed association, not a causal relationship. With only two occupants, factors such as appliance use, daily routines, and occupancy patterns may also explain the observed difference.

C. Answer to RQ3: Weekly and Holiday Patterns

The comparison between weekday and weekend/holiday periods demonstrates clear temporal variation in electricity demand, particularly for Room K, whose evening power demand rose substantially on non-working days. Changes in occupancy and daily routines may explain these differences in electricity consumption across different days.

D. Answer to RQ4: Fairness of Electricity Billing

The results showed a clear difference between equal and consumption-based billing. Under equal allocation, both occupants would pay BDT 400. Based on measured consumption, Room F would pay approximately BDT 305.40, while Room K would pay approximately BDT 494.60. Therefore, equal billing did not reflect the measured difference in electricity use, whereas consumption-based allocation directly connected payment with recorded consumption, removing the cross-subsidy of roughly BDT 94.78 (about 23.70% of Room F’s conventional share).

E. Answer to RQ5: Carbon Emission and Energy Awareness

The developed web-based system combined live measurements, historical trends, carbon estimates, and billing analysis in one interface. Room K was associated with 41.93 kg CO₂, compared with 25.87 kg CO₂ for Room F, demonstrating that room-level electricity measurements can be used not only to identify consumption differences but also to estimate the associated environmental impact. This made room-level differences easier to monitor and compare and demonstrated

the practical usefulness of integrating IoT measurement with web-based visualization.

F. Interpretation of Findings

The results suggest that smart sub-metering can provide information that is unavailable under conventional shared electricity billing. Instead of treating all occupants as identical consumers, the proposed approach captures differences in actual electricity demand and translates them into consumption, environmental, and financial terms.

G. Comparison with Existing Literature

The findings are broadly consistent with previous research on dormitory electricity consumption, which has shown that electricity use varies substantially across rooms and is influenced by occupant behavior, appliance use, room characteristics, and occupancy patterns [1], [3], [5]. The results also support previous IoT-based studies demonstrating that smart-metering systems can provide continuous electricity measurements and improve visibility of energy use [2], [6], [8].

However, the contribution of this study is not simply another demonstration of electricity monitoring. Previous work has commonly focused on consumption measurement, energy management, or centralized monitoring [4], [7]. This study combines room-level measurement with carbon-emission estimation and consumption-based electricity-cost allocation, while also considering economic position as an additional dimension of fairness.

H. Implications

The findings have several practical implications.

- **Occupants:** Individuals can monitor their own electricity consumption and better understand their energy behavior.
- **Property/Dormitory Management:** Management can obtain room-level consumption information rather than relying only on aggregate electricity bills.
- **Fair Billing:** Consumption-based allocation can reduce inequities associated with equal cost sharing.
- **Energy Efficiency:** Continuous monitoring can identify unusual or excessive electricity consumption.
- **Environmental Management:** Estimated carbon emissions can provide an additional indicator for evaluating energy-related environmental impacts.

I. Future Research

Future research should extend the monitoring period and include a larger number of rooms and occupants with different economic backgrounds. A larger dataset would allow the relationship between economic position, electricity consumption, carbon emissions, and cost burden to be examined more reliably and would improve the generalizability of the findings.

The system could also be improved to operate more independently of local infrastructure through automatic recovery after power or network interruptions, more reliable remote hosting, and automated data synchronization. With longer and

larger datasets, future studies could investigate appliance-level consumption and develop more detailed electricity-allocation approaches that consider both measured consumption and economic circumstances, as well as machine-learning-based consumption prediction and anomaly detection.

J. Conclusion

This study developed and evaluated an IoT-based smart sub-metering system for room-level electricity monitoring, carbon-emission estimation, and electricity-cost allocation. Over 15 days, Room K consumed 65.83 kWh, compared with 40.61 kWh for Room F, resulting in corresponding differences in carbon emissions (41.93 kg CO₂ versus 25.87 kg CO₂) and consumption-based electricity costs (approximately BDT 494.60 versus BDT 305.40).

The findings demonstrate that room-level sub-metering can provide more transparent and consumption-sensitive information than equal bill sharing. The study also shows that economic position can provide an additional perspective when considering electricity-cost fairness, although the small sample does not support causal conclusions. Overall, the developed system demonstrates the practical potential of combining IoT monitoring, carbon estimation, and consumption-based billing to support more transparent and environmentally informed electricity management in shared residential environments.

REFERENCES

- [1] Y. Deng, Z. Gou, X. Gui, and B. Cheng, "Energy consumption characteristics and influential use behaviors in university dormitory buildings in China's hot summer-cold winter climate region," *Journal of Building Engineering*, vol. 33, p. 101870, 2021.
- [2] M. Li, Z. Wang, Y. Qu, K. M. Chui, and M. Leung-Shea, "A multi-year campus-level smart meter database," *Scientific Data*, vol. 11, p. 1284, 2024.
- [3] Y. Yang, J. Yuan, Z. Xiao, H. Yi, C. Zhang, W. Gang, and H. Hu, "Energy consumption characteristics and adaptive electricity pricing strategies for college dormitories based on historical monitored data," *Energy & Buildings*, vol. 245, p. 111041, 2021.
- [4] Y. Zhang, B. Zhang, and J. Hou, "Simulation study on student residential energy use behaviors: A case study of university dormitories in Sichuan, China," *Buildings*, vol. 14, no. 5, p. 1484, 2024.
- [5] Y. Zhou, L. Sun, X. Hu, and L. Ma, "Clustering and statistical analyses of electricity consumption for university dormitories: A case study from China," *Energy & Buildings*, vol. 245, p. 110862, 2021.
- [6] E. Ruslan, S. M. Rozali, E. C. Mid, D. A. Hadi, and S. H. Johari, "IoT-based cost-effective energy meter monitoring system for smart home applications: Design, implementation, and analysis," *International Journal of Academic Research in Business and Social Sciences*, vol. 14, no. 12, pp. 4121–4138, 2024.
- [7] F. Akbar, A. W. Pratama, H. P. Putra, and Syafii, "Web-based campus energy monitoring system for ISO 50001 energy management implementation," in *Proc. Int. Conf. Information Technology and Electrical Engineering (ICITEE)*, 2023.
- [8] S. Kandru, A. Kumar, B. K. Teja, P. S. Reddy, and D. Kumar, "IoT smart meter using ESP32 and Blynk for real-time energy monitoring and load control," *International Journal of Innovative Research in Engineering and Technology*, 2024.

“latex

APPENDIX A

GLOSSARY OF TERMS AND ABBREVIATIONS

““

TABLE III
GLOSSARY OF TERMS AND ABBREVIATIONS

Term / Abbreviation	Description
IoT	Internet of Things; network-connected physical devices that collect and exchange data.
Smart Meter	An electronic device that measures electricity consumption and communicates the collected data.
Sub-Metering	Separate measurement of electricity consumption for individual rooms, units, or appliances.
Room-Level Monitoring	Separate monitoring of electricity consumption for individual rooms.
Tuya-Compatible	Smart devices compatible with the Tuya ecosystem and its communication protocols.
TinyTuya	A Python library for local communication with compatible Tuya-based smart devices.
Python	Programming language used for data collection, processing, analysis, and system development.
Flask	Lightweight Python web framework used to develop the monitoring platform.
SQLite	Lightweight file-based relational database used to store electricity measurements.
Pandas	Python library used for data manipulation and analysis.
NumPy	Python library used for numerical calculations and data processing.
API	Application Programming Interface; rules and functions enabling software systems or devices to communicate.
Wi-Fi	Wireless networking technology used to connect the smart meters with the monitoring system.
kWh	Kilowatt-hour; unit of electrical energy consumption.
W	Watt; unit of electrical power.
V	Volt; unit of electrical voltage.
A	Ampere; unit of electric current.
CO₂	Carbon dioxide; greenhouse gas used to express estimated electricity-related emissions.
Grid Emission Factor	Carbon dioxide equivalent associated with one unit of grid electricity; 0.637 kg CO ₂ /kWh in this study.
Carbon Emission Estimation	Estimation of electricity-related emissions using electricity consumption and the grid emission factor.
Purposive Sampling	Selection of participants or study locations based on predefined study requirements.
Quantitative Observational Study	A study based on numerical measurements collected through systematic observation without experimental manipulation.
Consumption-Based Billing	Electricity-cost allocation according to each occupant's measured consumption.
Equal-Bill Allocation	Division of the total electricity cost equally among occupants, regardless of individual consumption.
Cross-Subsidization	A situation where a lower-consuming occupant effectively pays part of the cost associated with another occupant's higher consumption.
Economic Position	Comparative financial circumstances considered when evaluating the burden and fairness of shared electricity costs.
Instantaneous Power	Electrical power being consumed at a particular point in time, measured in watts (W).
Cumulative Consumption	Total electrical energy consumed over a period, measured in kWh.
Local Hosting	Running the monitoring and data-processing system on a local computer rather than relying entirely on a cloud server.
Real-Time Monitoring	Continuous observation and display of newly collected measurements.

APPENDIX B DATA COLLECTION PROTOCOL

The electricity data collection protocol used in this study is provided below.

A. Study Locations

Electricity measurements were collected from **Room F** and **Room K**, each monitored using a separate Tuya-compatible smart meter.

B. Monitoring Period

The monitoring period covered **15 days**.

C. Measurement Frequency

Each smart meter was queried at **10-second intervals**.

D. Data Recorded

For each valid measurement, the system recorded:

- Timestamp
- Voltage (V)
- Current (A)
- Instantaneous power (W)
- Cumulative energy consumption (kWh)
- Device status

- Switch status
- Fault status

E. Data Transmission and Storage

The smart meters communicated with the monitoring system through a local Wi-Fi network using the **TinyTuya Python API**. The collected measurements were stored in a **SQLite database**.

APPENDIX C SUPPLEMENTARY ELECTRICITY DATA

The complete electricity dataset collected during the 15-day monitoring period may be included here as a supplementary table or electronic attachment.

The dataset contains the recorded measurements for Room F and Room K, including timestamps, voltage, current, instantaneous power, cumulative energy consumption, device status, switch status, and fault status.

Because the dataset contains a large number of measurements collected at 10-second intervals, the complete dataset is better provided as a separate spreadsheet or digital attachment rather than reproduced in full within the main report.

APPENDIX D

SUPPLEMENTARY RESULTS AND FIGURES

- 1) Room F and Room K electricity-consumption comparison.
- 2) Carbon-emission comparison.
- 3) Hourly average power profile.
- 4) Equal-bill versus consumption-based billing comparison.
- 5) Screenshots of the developed web-based monitoring platform.
- 6) Additional statistical summaries or tables generated from the collected dataset.

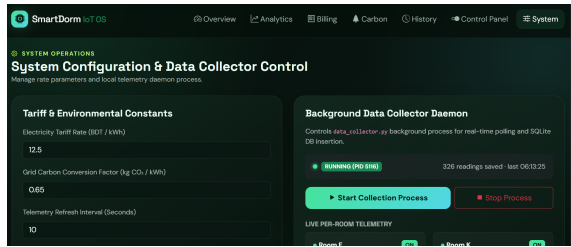


Fig. 6. Web-based monitoring platform showing the electricity data measurement interface.

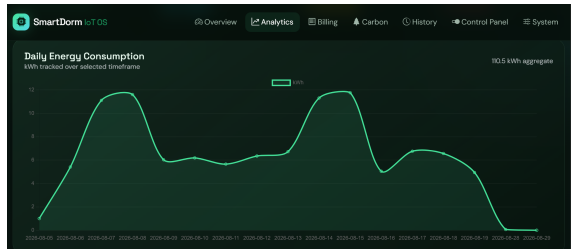


Fig. 7. Web-based monitoring platform showing electricity monitoring and measurement information.

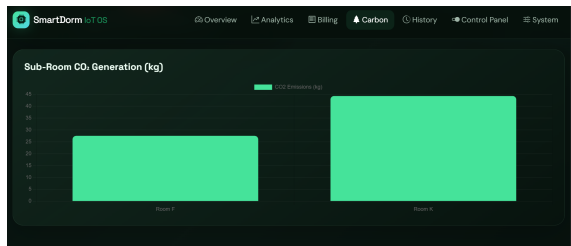


Fig. 8. Web-based monitoring platform showing supplementary electricity monitoring results.