



■ ● Training
 ■ ■ Calibration
 ■ ▲ Test or held out
 ■ ● Removed
 ○ Drawn sample

(a) Random (sample unit)

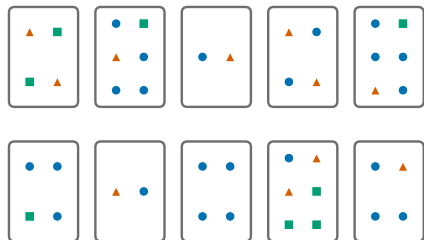


Water bodies span roles (optimistic reference)

(b) Water body (primary)

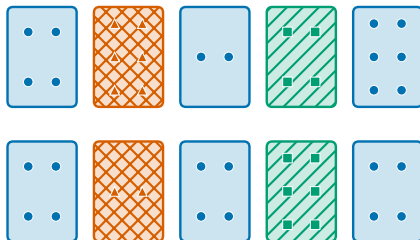


60/20/20 of water bodies, 20 repeats

(c) Contributor (dataset folds)

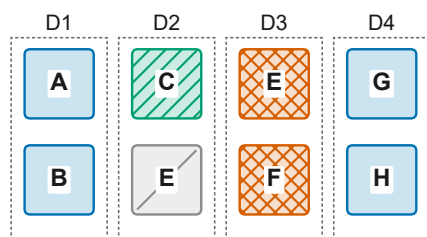


Water body E is in test fold D3:
its rows in D2 are removed

(d) Region (leave one out)

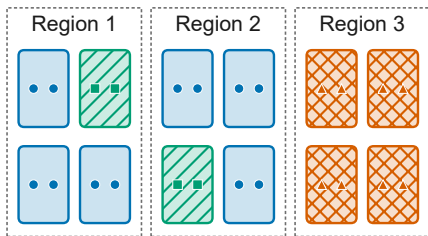


Calibration water bodies from non-test regions

(e) Single subsampling (calibration)

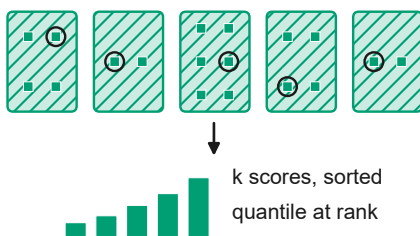

k scores, sorted
 quantile at rank
 $\text{rank} = \text{ceil}((1 - \alpha)(k + 1))$; infinite if $> k$

(f) Group CV+ (equal folds)

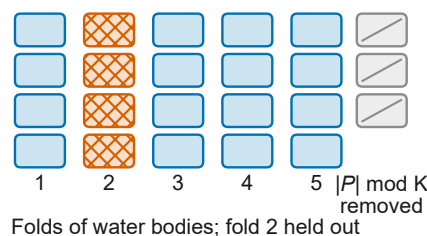

Folds of water bodies; fold 2 held out
 $K = 5$ drawn; $K = 10$ used