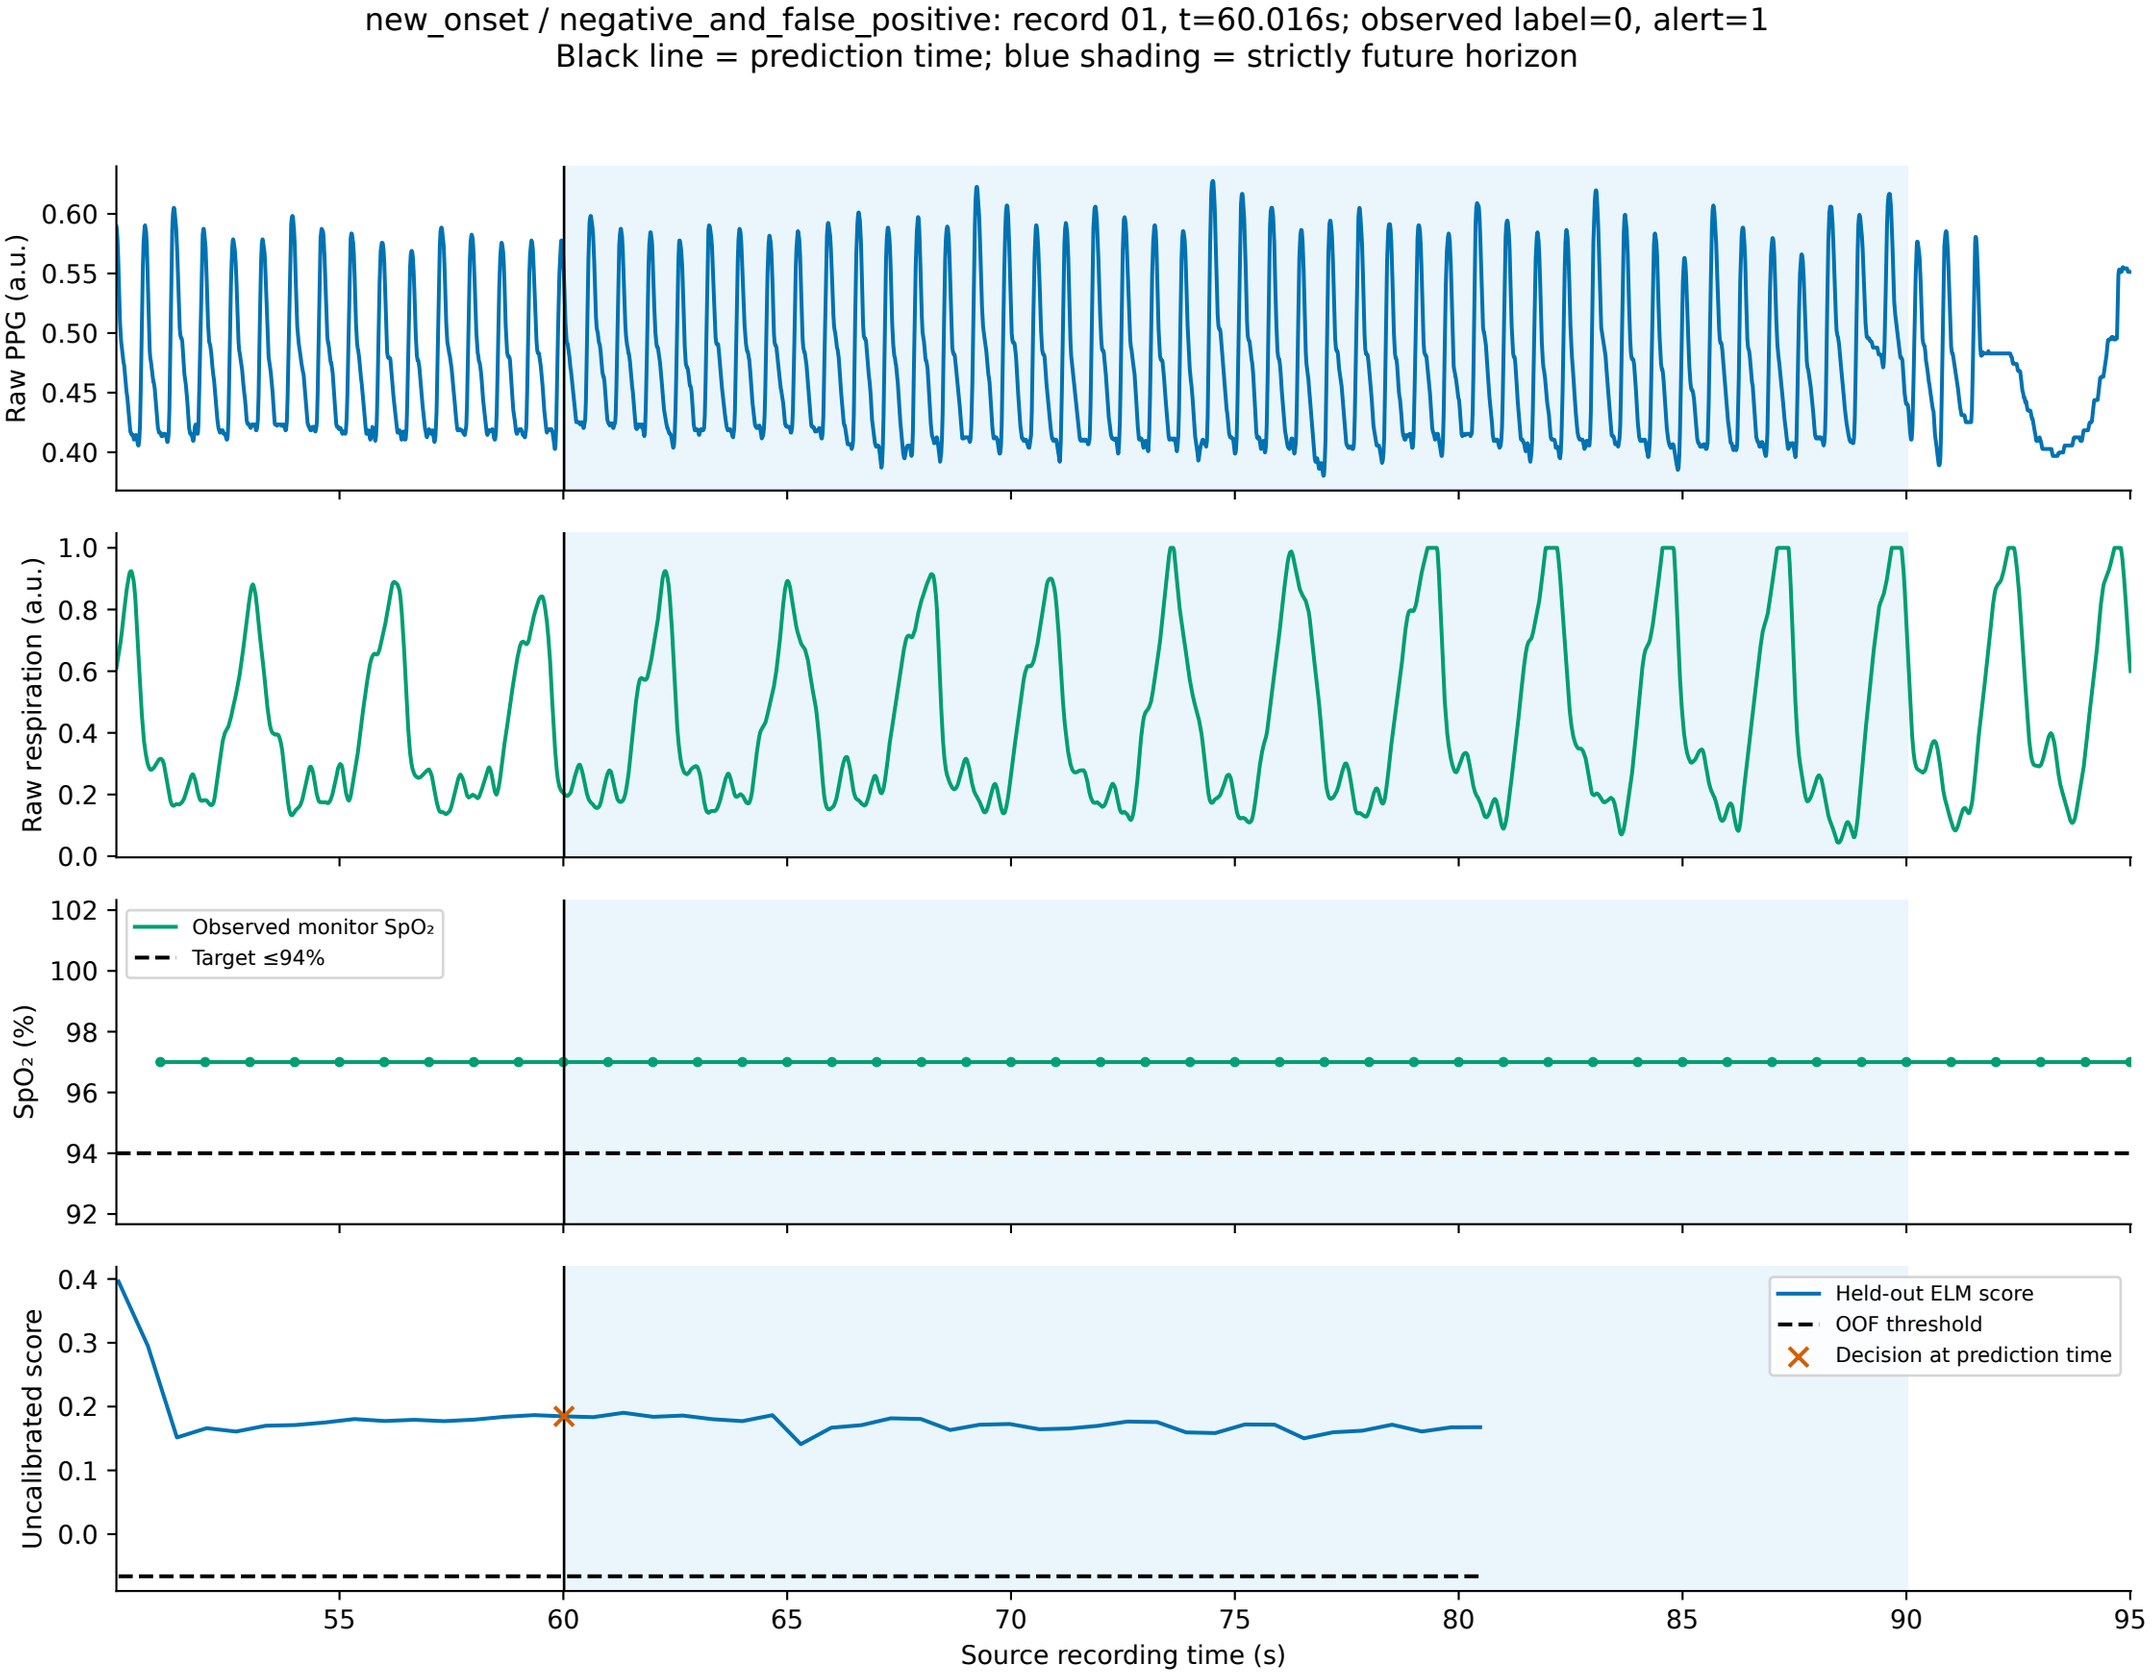
new_onset / negative_and_false_positive: record 01, t=60.016s; observed label=0, alert=1
Black line = prediction time; blue shading = strictly future horizon
Raw PPG (a.u.)
Raw respiration (a.u.)
SpO₂ (%)
Observed monitor SpO₂
Target ≤94%
Uncalibrated score
Held-out ELM score
OOF threshold
Decision at prediction time
Source recording time (s)