

Main [OB1]

Main Properties

General	
1	General
2	General
3	General
4	General
5	General
6	General
7	General
8	General
9	General
10	General
11	General
12	General
13	General
14	General
15	General
16	General
17	General
18	General
19	General
20	General
21	General
22	General
23	General
24	General
25	General
26	General
27	General
28	General
29	General
30	General
31	General
32	General
33	General
34	General
35	General
36	General
37	General
38	General
39	General
40	General
41	General
42	General
43	General
44	General
45	General
46	General
47	General
48	General
49	General
50	General
51	General
52	General
53	General
54	General
55	General
56	General
57	General
58	General
59	General
60	General
61	General
62	General
63	General
64	General
65	General
66	General
67	General
68	General
69	General
70	General
71	General
72	General
73	General
74	General
75	General
76	General
77	General
78	General
79	General
80	General
81	General
82	General
83	General
84	General
85	General
86	General
87	General
88	General
89	General
90	General
91	General
92	General
93	General
94	General
95	General
96	General
97	General
98	General
99	General
100	General


Name	Main	Number	1	Type	OB
Language	LAD	Numbering	Automatic		

Information

Title	Starter Control	Author		Comment	I-1 – Start I-2 – Stop Q-1 – Main Contactor Q-2 – Rotor resistance (High) Q-3 – Rotor resistance (Medium), Q-4 – Rotor resistance (Low) Q-5 – Motor ON/ OFF indication. When Start button is pressed, Q1, Q2 & Q5 should become ON. After 5 seconds, Q2 should become OFF and Q3 should become ON. After next 5 seconds, Q3 should become OFF and Q4 should become ON. Hence we reduce the Rotor resistance step-by-step, Till we attain the rated Speed of the Motor. If I-2 i.e. Stop button is pressed at any stage of the cycle, the entire cycle should Stop.
Family		Version	0.1	User-defined ID	


Name	Data type	Default value	Comment
▼ Input			
Initial_Call	Bool		Initial call of this OB
Remanence	Bool		=True, if remanent data are available
Temp			
Constant			

Network 1: I-1 – Start I-2 – Stop

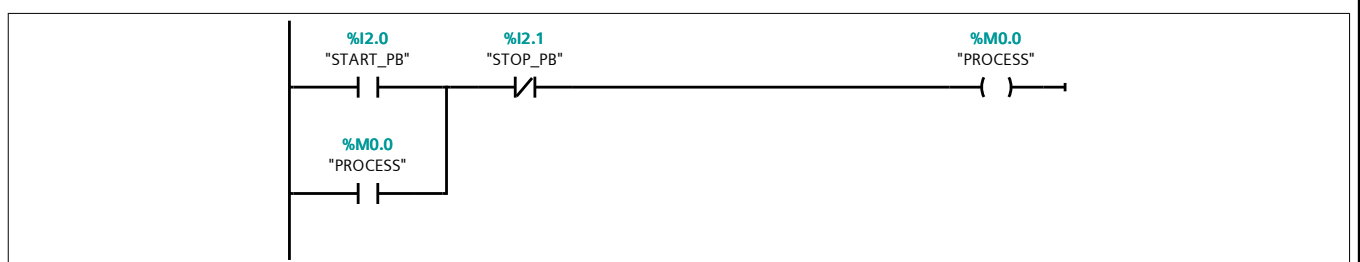


Network 2: When Start button is pressed

When Start button is pressed, Q1, Q2 & Q5 should become ON

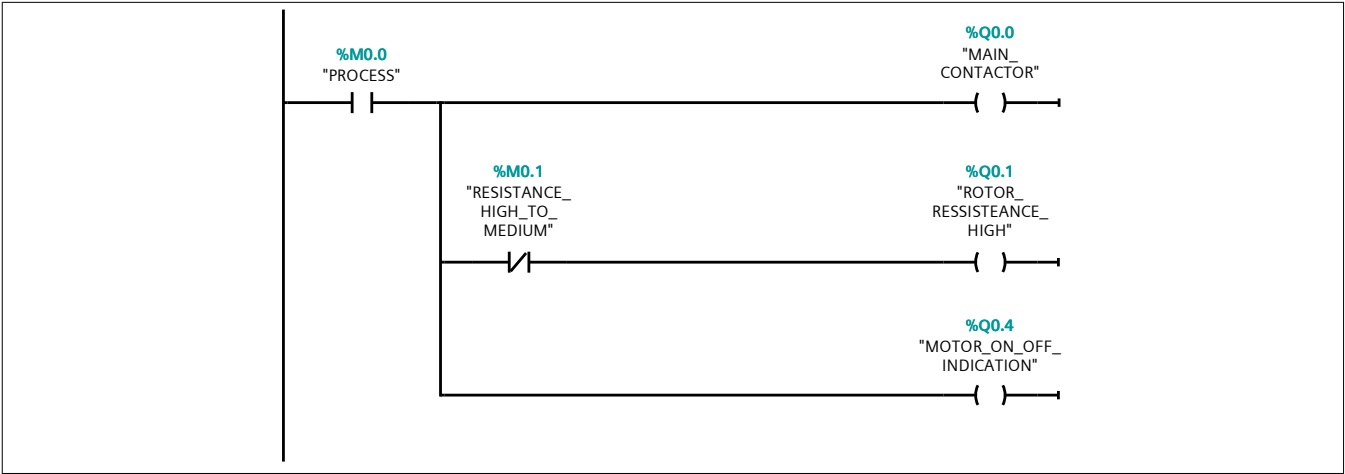


Network 3: RESISTANCE_HIGH_TO_MEDIUM

.After 5 seconds, Q2 should become OFF and Q3 should become ON.

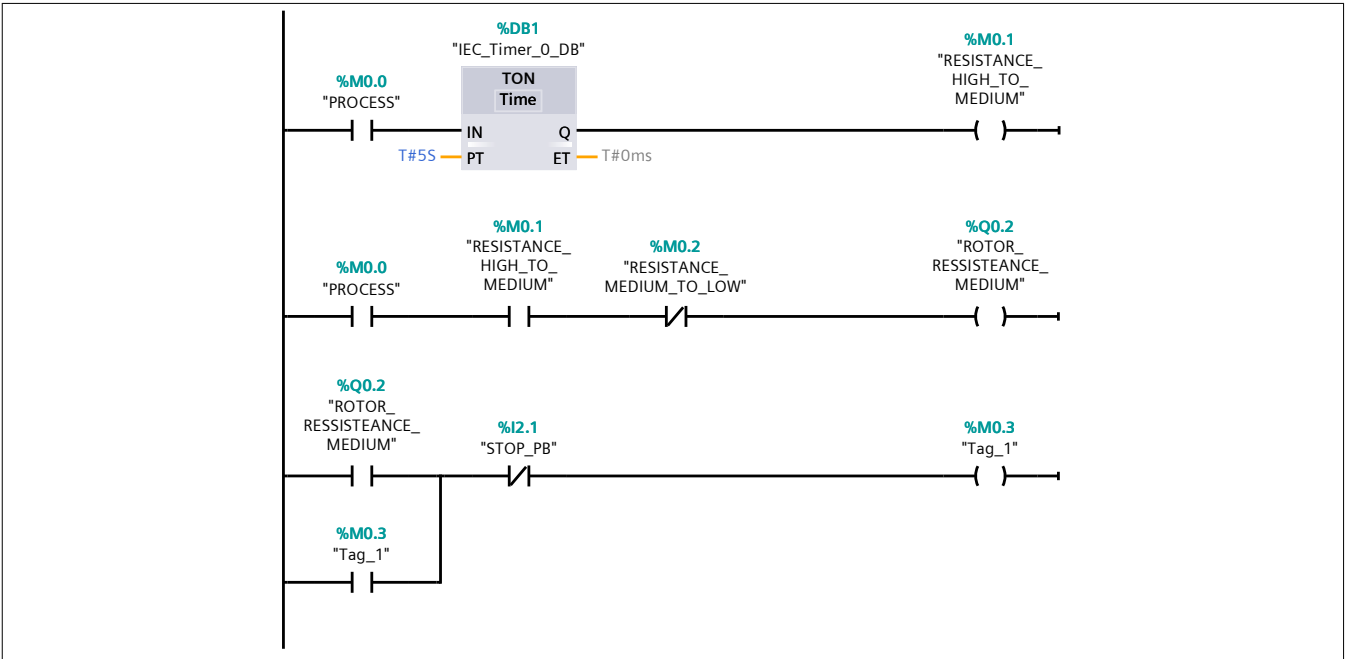

Network 4:

After next 5 seconds, Q3 should become OFF and Q4 should become ON.

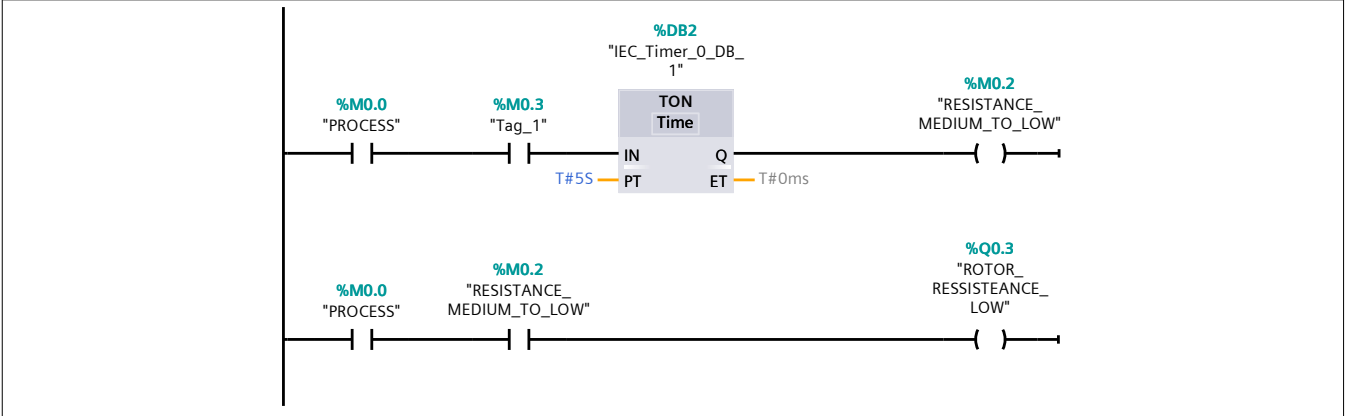

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_1 [DB2]

IEC_Timer_0_DB_1 Properties								
General								
Name	IEC_Timer_0_DB_1		Number	2		Type	DB	
Language	DB		Numbering	Automatic				
Information								
Title			Author	Simatic		Comment		
Family	IEC		Version	1.0		User-defined ID	IEC_TMR	

Name	Data type	Start value	Retain	Accessible from HMI/O PC UA/Web API	Writable from HM I/O PC UA/Web API	Visible in HMI engineering	Set-point	Supervision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_1 [DB2]

IEC_Timer_0_DB_1 Properties

General

Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		

Information

Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble fro m HM I/O PC UA/ Web API	Visible in HMI engi-neer-ing	Set-point	Super-vision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble from HMI I/O PC UA/ Web API	Visible in HMI engi- neering	Set- point	Super- vision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		