

Program blocks


Main [OB1]

Main Properties					
General					
Name	Main	Number	1	Type	OB
Language	LAD	Numbering	Automatic		
Information					
Title	"Main Program Sweep (Cycle)"	Author	SHREYASH_GHADGE	Comment	When Switch is on Pump1 ON for 10 seconds, then Pump 2 ON for 8 seconds, then Pump3 ON for 7 seconds repeat this sequence 3 times then switch OFF all.
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
▼ Input			
Initial_Call	Bool		Initial call of this OB
Remanence	Bool		=True, if remanent data are available
Temp			
Constant			


Network 1: PUMP_1

Pump1 ON for 10 seconds

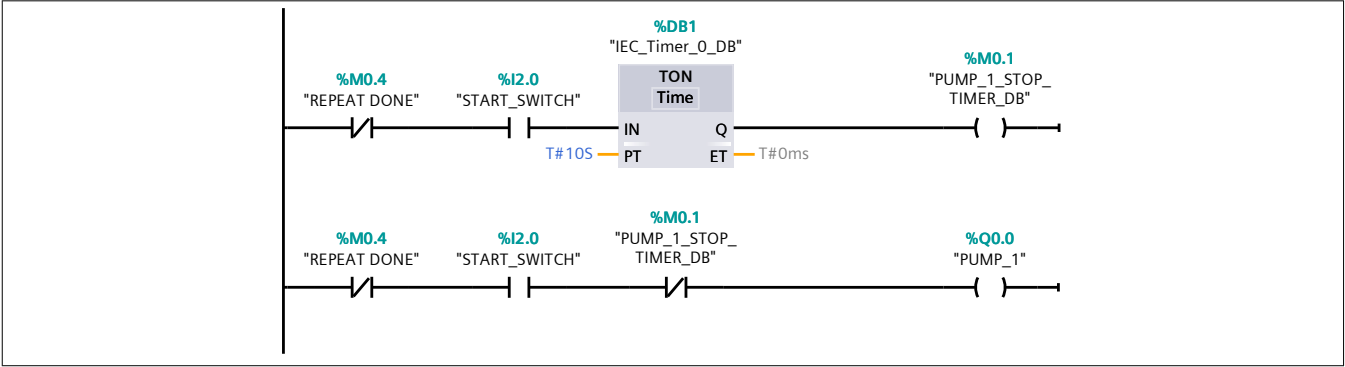


Network 2: PUMP_2

Pump 2 ON for 8 seconds

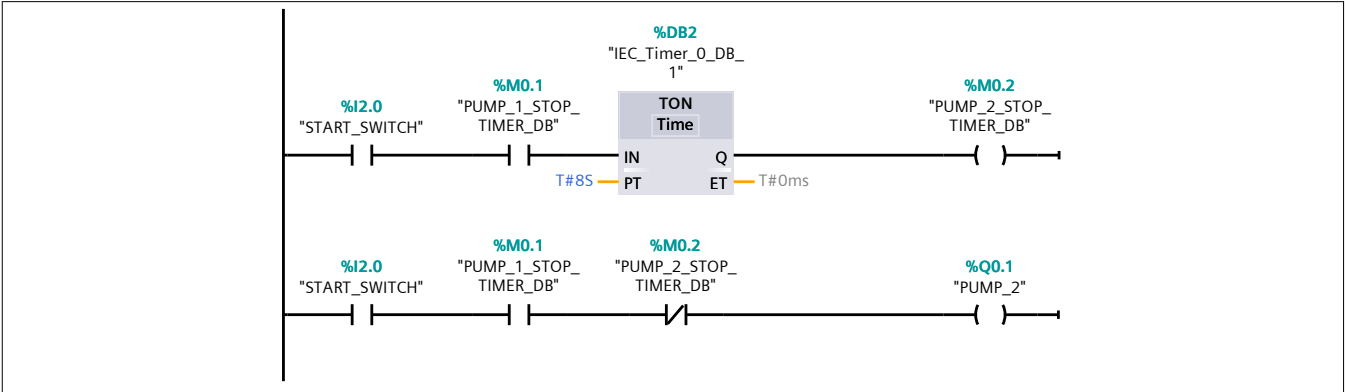


Network 3: PUMP_3

Pump3 ON for 7 seconds

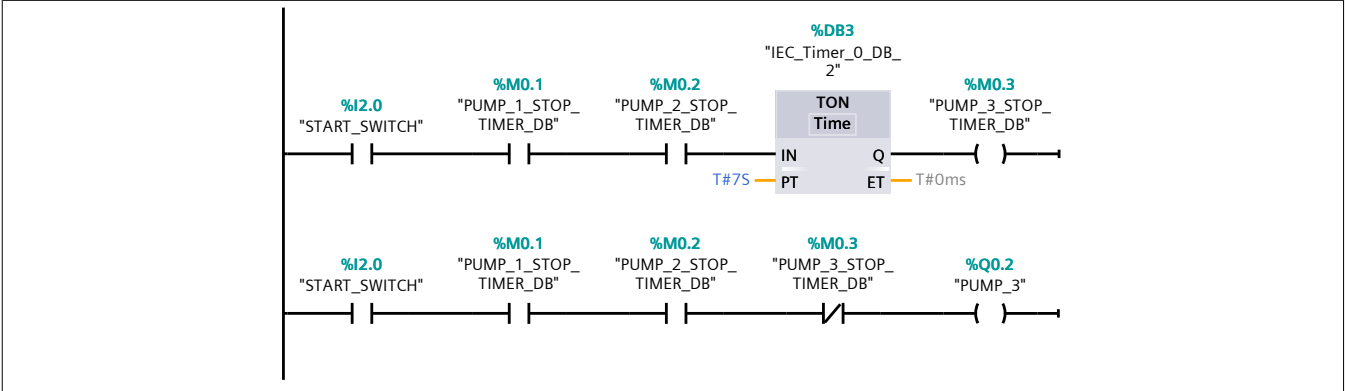


Network 4: COUNTER_LOGIC

repeat this sequence 3 times then switch OFF all.

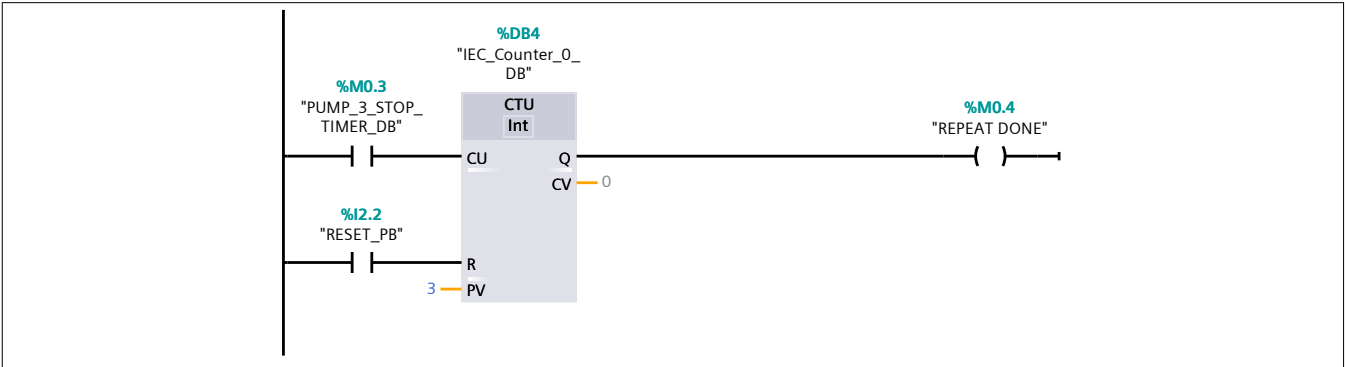

Network 5: RESET_LOGIC

repeat this sequence

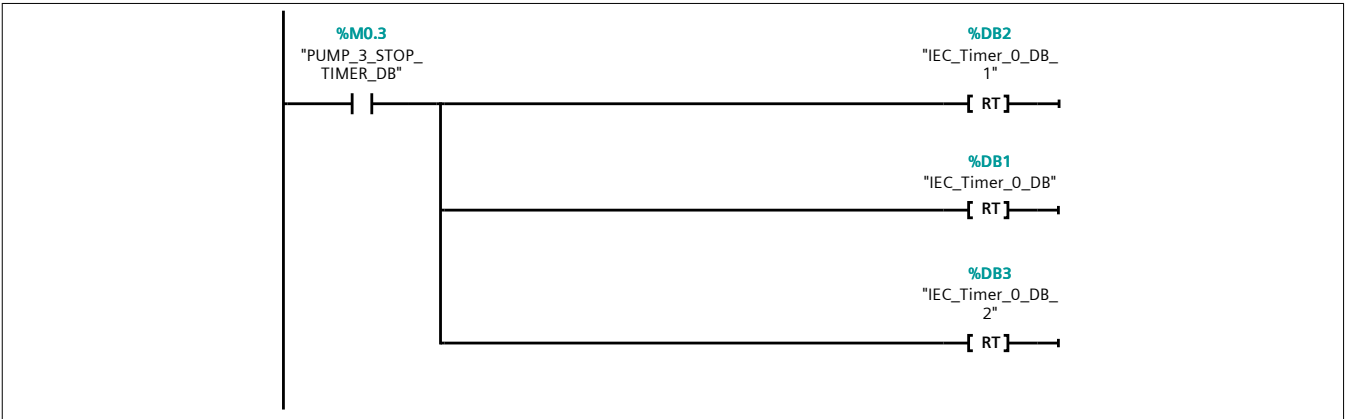

Totally Integrated Automation Portal												
Program blocks / System blocks / Program resources												
IEC_Timer_0_DB [DB1]												
IEC_Timer_0_DB Properties												
General												
Name		IEC_Timer_0_DB		Number		1		Type		DB		
Language		DB		Numbering		Automatic						
Information												
Title						Author		Simatic		Comment		
Family			IEC		Version		1.0		User-defined ID		IEC_TMR	
Name		Data type	Start value		Retain	Access- sible from HMI/O PC UA/We b API	Wri- ta- ble fro m eng- neer- ing	Set- point	Super- vision	Comment		
▼ Static												
PT		Time	T#0ms		False	True	True	True	False			
ET		Time	T#0ms		False	True	False	True	False			
IN		Bool	false		False	True	True	True	False			
Q		Bool	false		False	True	False	True	False			

Program blocks / System blocks / Program resources											
IEC_Timer_0_DB_1 [DB2]											
IEC_Timer_0_DB_1 Properties											
General											
Name	IEC_Timer_0_DB_1		Number	2			Type	DB			
Language	DB		Numbering	Automatic							
Information											
Title			Author	Simatic			Comment				
Family	IEC		Version	1.0			User-defined ID	IEC_TMR			
Name	Data type	Start value	Retain	Accessible from HMI/O PC UA/Web API	Writable from HM I/O PC UA/Web API	Visible in HMI engineering	Set-point	Supervision	Comment		
▼ Static											
PT	Time	T#0ms	False	True	True	True	False				
ET	Time	T#0ms	False	True	False	True	False				
IN	Bool	false	False	True	True	True	False				
Q	Bool	false	False	True	False	True	False				

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_1 [DB2]

IEC_Timer_0_DB_1 Properties

General

Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		

Information

Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Accessible from HMI/O PC UA/Web API	Writable from HM I/O PC UA/Web API	Visible in HMI engineering	Set-point	Supervision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

IEC_Timer_0_DB_1 Properties					
General					
Name	IEC_Timer_0_DB_1	Number	2	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble fro m HM I/O PC UA/ We b API	Visible in HMI engi- neering	Set- point	Super- vision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_2 [DB3]

IEC_Timer_0_DB_2 Properties

General

Name	IEC_Timer_0_DB_2	Number	3	Type	DB
Language	DB	Numbering	Automatic		

Information

Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble fro m HM I/O PC UA/ Web API	Visible in HMI engi- neer- ing	Set-point	Super-vision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

Program blocks / System blocks / Program resources											
IEC_Timer_0_DB_2 [DB3]											
IEC_Timer_0_DB_2 Properties											
General											
Name	IEC_Timer_0_DB_2		Number	3			Type	DB			
Language	DB		Numbering	Automatic							
Information											
Title			Author	Simatic			Comment				
Family	IEC		Version	1.0			User-defined ID	IEC_TMR			
Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble fro m HM I/O PC UA/ Web API	Visible in HMI engi- neer- ing	Set- point	Super- vision	Comment		
▼ Static											
PT	Time	T#0ms	False	True	True	True	False				
ET	Time	T#0ms	False	True	False	True	False				
IN	Bool	false	False	True	True	True	False				
Q	Bool	false	False	True	False	True	False				

Program blocks / System blocks / Program resources											
IEC_Timer_0_DB_2 [DB3]											
IEC_Timer_0_DB_2 Properties											
General											
Name	IEC_Timer_0_DB_2		Number	3			Type	DB			
Language	DB		Numbering	Automatic							
Information											
Title			Author	Simatic			Comment				
Family	IEC		Version	1.0			User-defined ID	IEC_TMR			
Name	Data type	Start value	Retain	Accessible from HMI/O PC UA/Web API	Writable from HM I/O PC UA/Web API	Visible in HMI engineering	Set-point	Supervision	Comment		
▼ Static											
PT	Time	T#0ms	False	True	True	True	False				
ET	Time	T#0ms	False	True	False	True	False				
IN	Bool	false	False	True	True	True	False				
Q	Bool	false	False	True	False	True	False				

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_2 [DB3]

IEC_Timer_0_DB_2 Properties

General

Name	IEC_Timer_0_DB_2	Number	3	Type	DB
Language	DB	Numbering	Automatic		

Information

Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Accessible from HMI/O PC UA/Web API	Writable from HM I/O PC UA/Web API	Visible in HMI engineering	Set-point	Supervision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

[illegible]

Program blocks / System blocks / Program resources											
IEC_Timer_0_DB_2 [DB3]											
IEC_Timer_0_DB_2 Properties											
General											
Name	IEC_Timer_0_DB_2		Number	3			Type	DB			
Language	DB		Numbering	Automatic							
Information											
Title			Author	Simatic			Comment				
Family	IEC		Version	1.0			User-defined ID	IEC_TMR			
Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble fro m HM I/O PC UA/ Web API	Visible in HMI engi- neer- ing	Set- point	Super- vision	Comment		
▼ Static											
PT	Time	T#0ms	False	True	True	True	False				
ET	Time	T#0ms	False	True	False	True	False				
IN	Bool	false	False	True	True	True	False				
Q	Bool	false	False	True	False	True	False				

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_2 [DB3]

IEC_Timer_0_DB_2 Properties									
General									
Name	IEC_Timer_0_DB_2		Number	3			Type	DB	
Language	DB		Numbering	Automatic					
Information									
Title			Author	Simatic			Comment		
Family	IEC		Version	1.0			User-defined ID	IEC_TMR	

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/We b API	Wri- ta- ble fro m HM I/O PC UA/ We b API	Visible in HMI engi- neer- ing	Set- point	Super- vision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

Program blocks / System blocks / Program resources

IEC_Timer_0_DB_2 [DB3]

IEC_Timer_0_DB_2 Properties

General

Name	IEC_Timer_0_DB_2	Number	3	Type	DB
Language	DB	Numbering	Automatic		

Information

Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	IEC_TMR

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/Web API	Wri- ta- ble fro m HM I/O PC UA/ We b API	Visible in HMI engi- neer- ing	Set- point	Super- vision	Comment
▼ Static									
PT	Time	T#0ms	False	True	True	True	False		
ET	Time	T#0ms	False	True	False	True	False		
IN	Bool	false	False	True	True	True	False		
Q	Bool	false	False	True	False	True	False		

Program blocks / System blocks / Program resources

IEC_Counter_0_DB [DB4]

IEC_Counter_0_DB Properties					
General					
Name	IEC_Counter_0_DB	Number	4	Type	DB
Language	DB	Numbering	Automatic		
Information					
Title		Author	Simatic	Comment	
Family	IEC	Version	1.0	User-defined ID	CNTR

Name	Data type	Start value	Retain	Access- ible from HMI/O PC UA/We b API	Wri- ta- ble fro m en- gineer- ing	Visible in HMI	Set- point	Super- vision	Comment
▼ Static									
CU	Bool	false	True	True	True	True	False		
CD	Bool	false	True	True	True	True	False		
R	Bool	false	True	True	True	True	False		
LD	Bool	false	True	True	True	True	False		
QU	Bool	false	True	True	True	True	False		
QD	Bool	false	True	True	True	True	False		
PV	Int	0	True	True	True	True	False		
CV	Int	0	True	True	True	True	False		