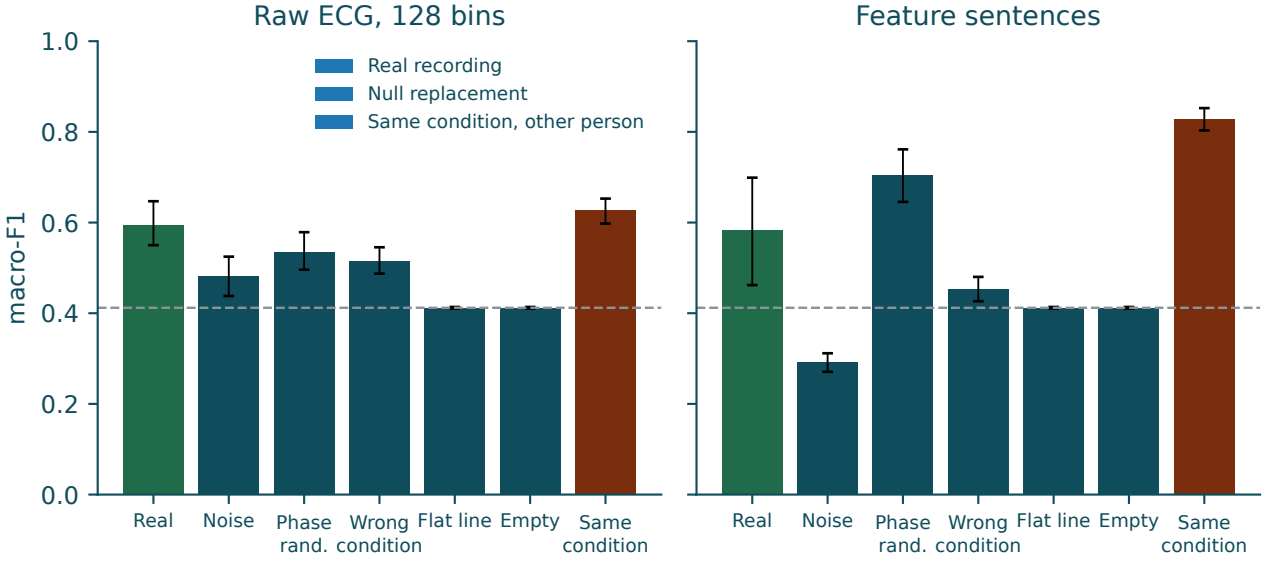
Raw ECG, 128 bins
Feature sentences
macro-F1
1.0
0.8
0.6
0.4
0.2
0.0
Real recording
Null replacement
Same condition, other person
Real
Noise
Phase rand.
Wrong condition
Flat line
Empty
Same condition