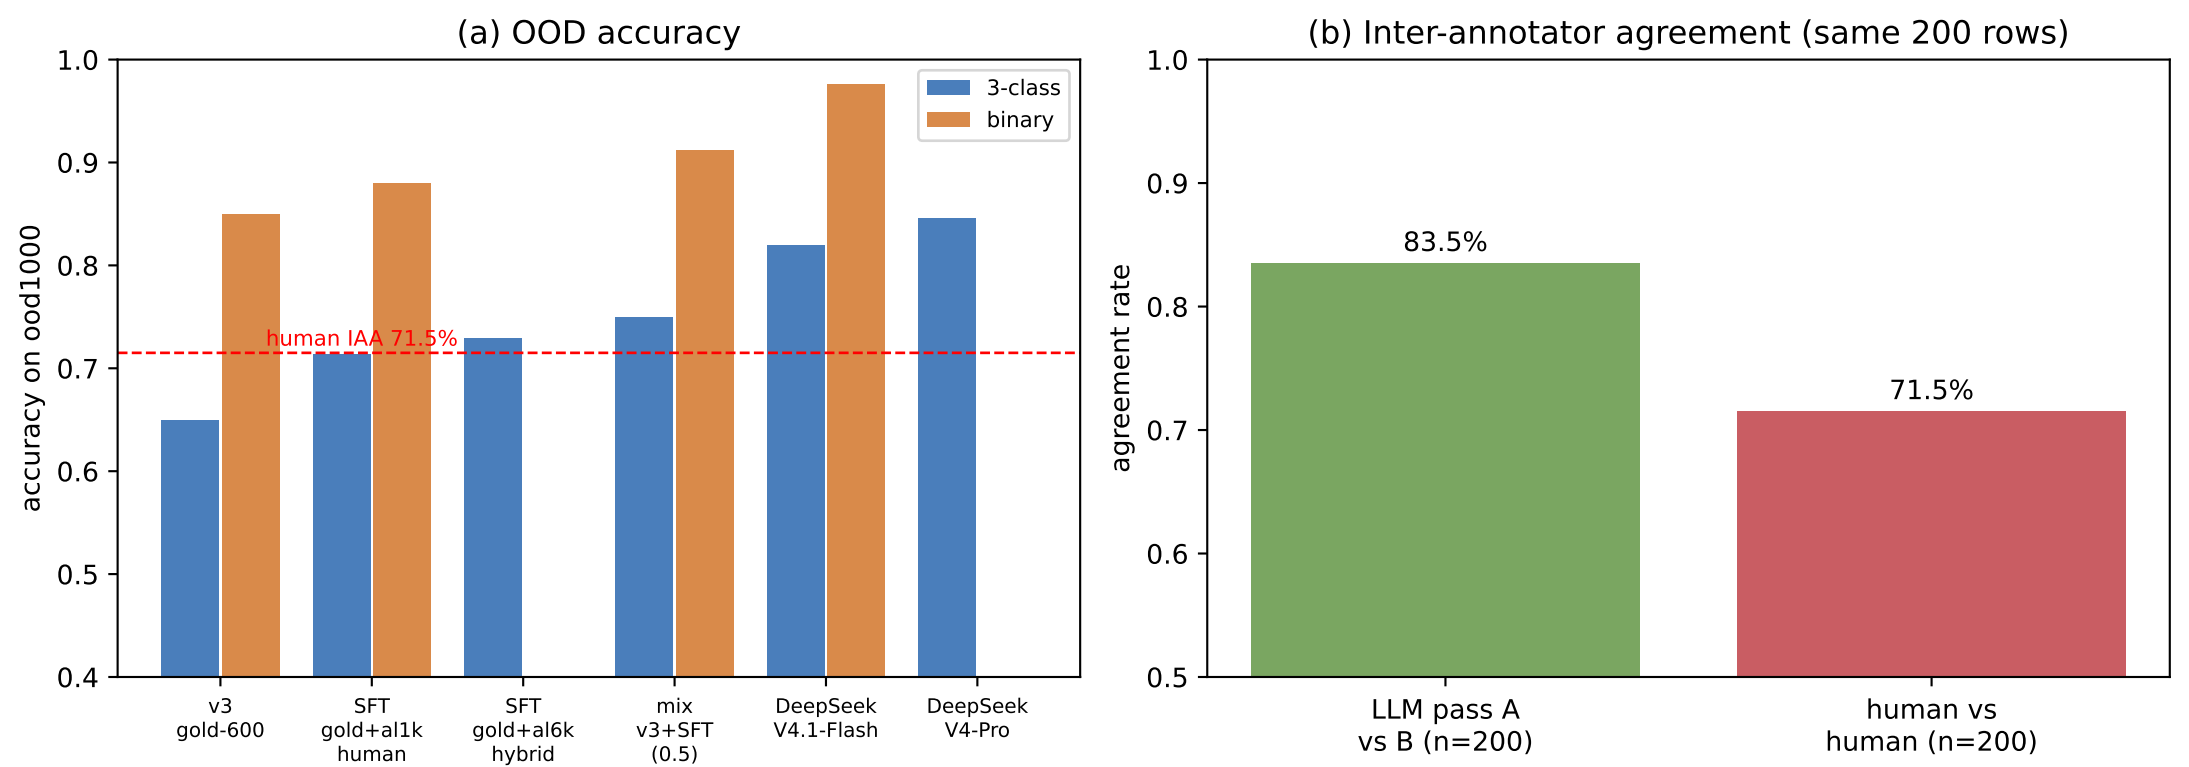
(a) OOD accuracy
accuracy on ood1000
1.0
0.9
0.8
0.7
0.6
0.5
0.4
3-class
binary
human IAA 71.5%
v3
gold-600
SFT
gold+al1k
human
SFT
gold+al6k
hybrid
mix
v3+SFT
(0.5)
DeepSeek
V4.1-Flash
DeepSeek
V4-Pro
(b) Inter-annotator agreement (same 200 rows)
agreement rate
1.0
0.9
0.8
0.7
0.6
0.5
83.5%
71.5%
LLM pass A
vs B (n=200)
human vs
human (n=200)