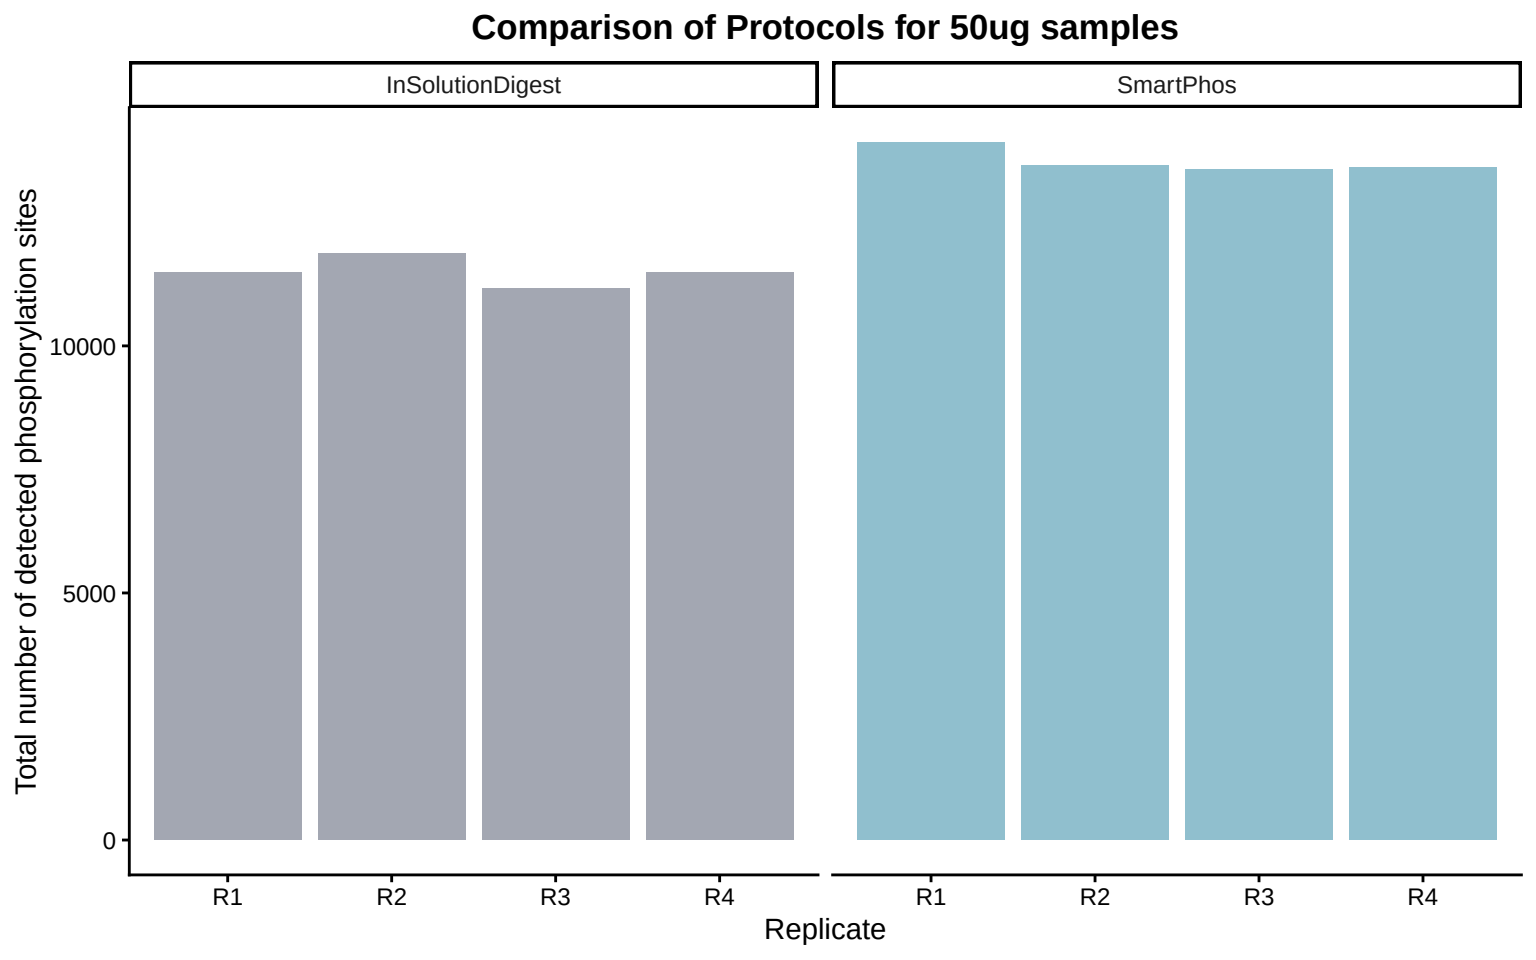
Comparison of Protocols for 50ug samples
InSolutionDigest
SmartPhos
Total number of detected phosphorylation sites
10000
5000
0
R1
R2
R3
R4
R1
R2
R3
R4
Replicate