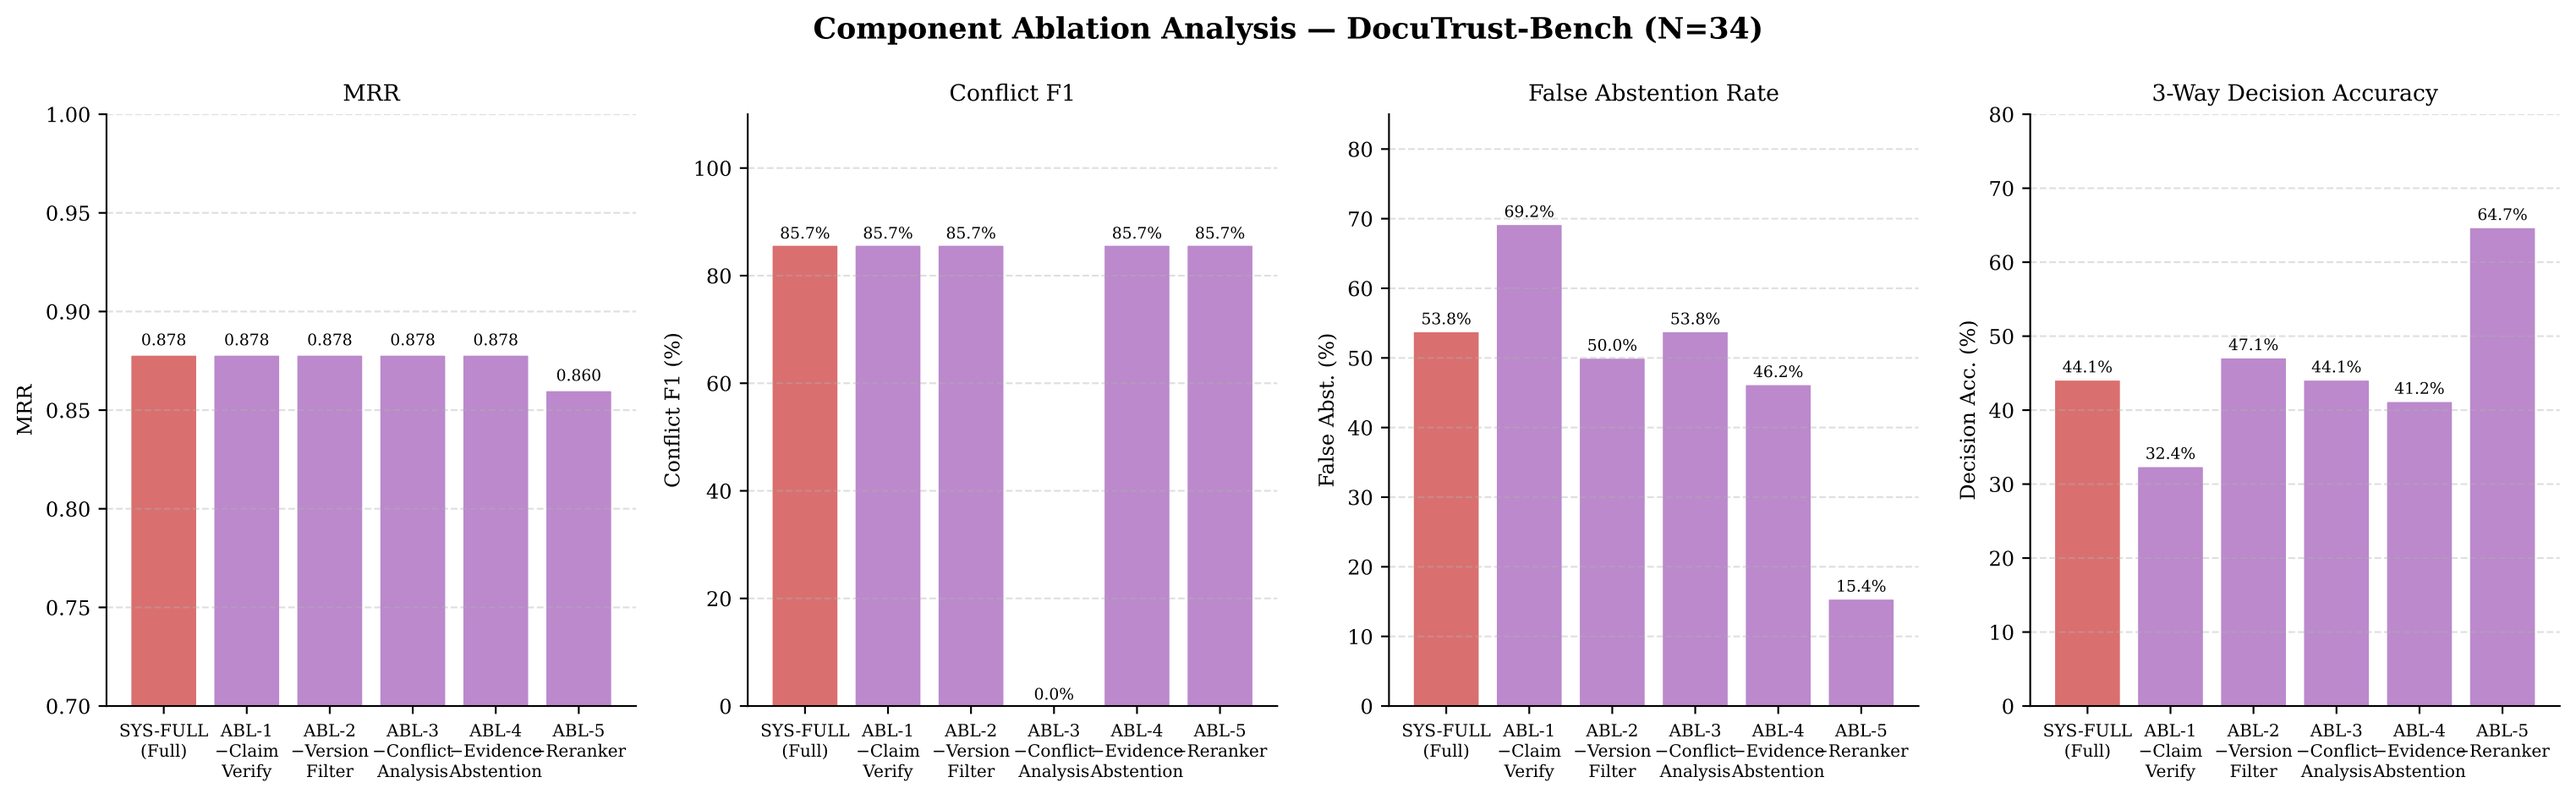
Component Ablation Analysis — DocuTrust-Bench (N=34)
MRR
MRR
1.00
0.95
0.90
0.85
0.80
0.75
0.70
0.878
0.878
0.878
0.878
0.878
0.860
SYS-FULL (Full)
ABL-1 −Claim Verify
ABL-2 −Version Filter
ABL-3 −Conflict Analysis
ABL-4 −Evidence Abstention
ABL-5 −Reranker
Conflict F1
Conflict F1 (%)
100
80
60
40
20
0
85.7%
85.7%
85.7%
0.0%
85.7%
85.7%
SYS-FULL (Full)
ABL-1 −Claim Verify
ABL-2 −Version Filter
ABL-3 −Conflict Analysis
ABL-4 −Evidence Abstention
ABL-5 −Reranker
False Abstention Rate
False Abst. (%)
80
70
60
50
40
30
20
10
0
53.8%
69.2%
50.0%
53.8%
46.2%
15.4%
SYS-FULL (Full)
ABL-1 −Claim Verify
ABL-2 −Version Filter
ABL-3 −Conflict Analysis
ABL-4 −Evidence Abstention
ABL-5 −Reranker
3-Way Decision Accuracy
Decision Acc. (%)
80
70
60
50
40
30
20
10
0
44.1%
32.4%
47.1%
44.1%
41.2%
64.7%
SYS-FULL (Full)
ABL-1 −Claim Verify
ABL-2 −Version Filter
ABL-3 −Conflict Analysis
ABL-4 −Evidence Abstention
ABL-5 −Reranker