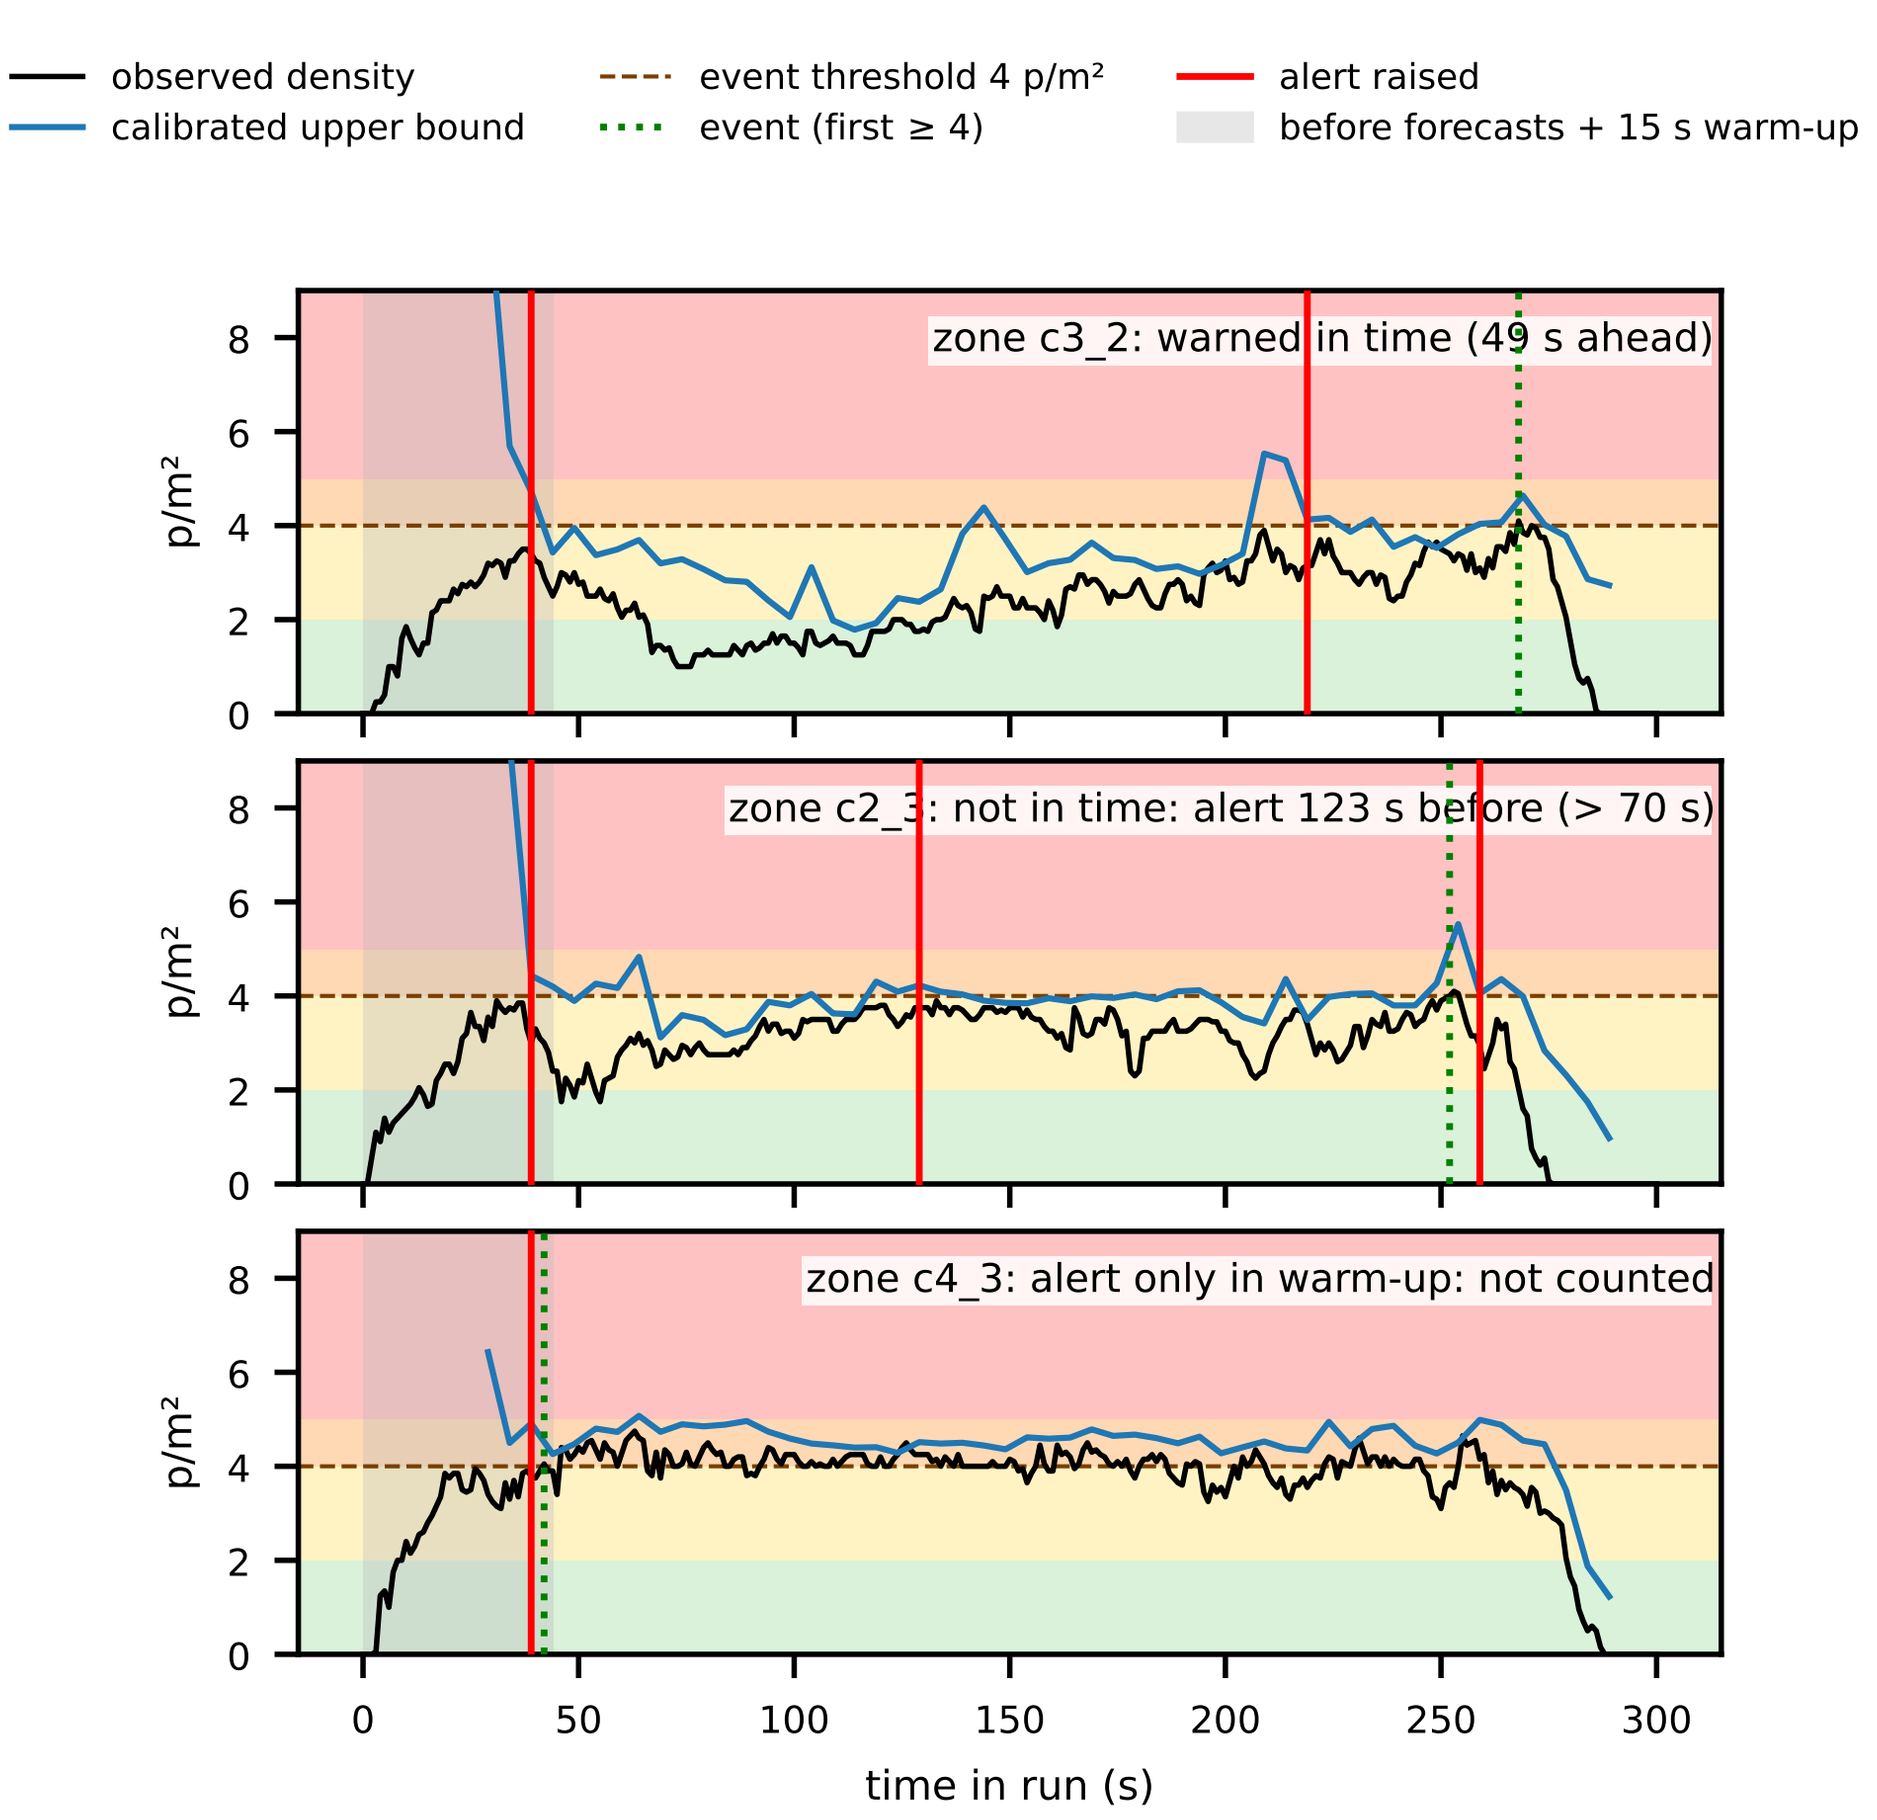
observed density
calibrated upper bound
event threshold 4 p/m²
event (first ≥ 4)
alert raised
before forecasts + 15 s warm-up
zone c3_2: warned in time (49 s ahead)
zone c2_3: not in time: alert 123 s before (> 70 s)
zone c4_3: alert only in warm-up: not counted
p/m²
0
2
4
6
8
0
50
100
150
200
250
300
time in run (s)