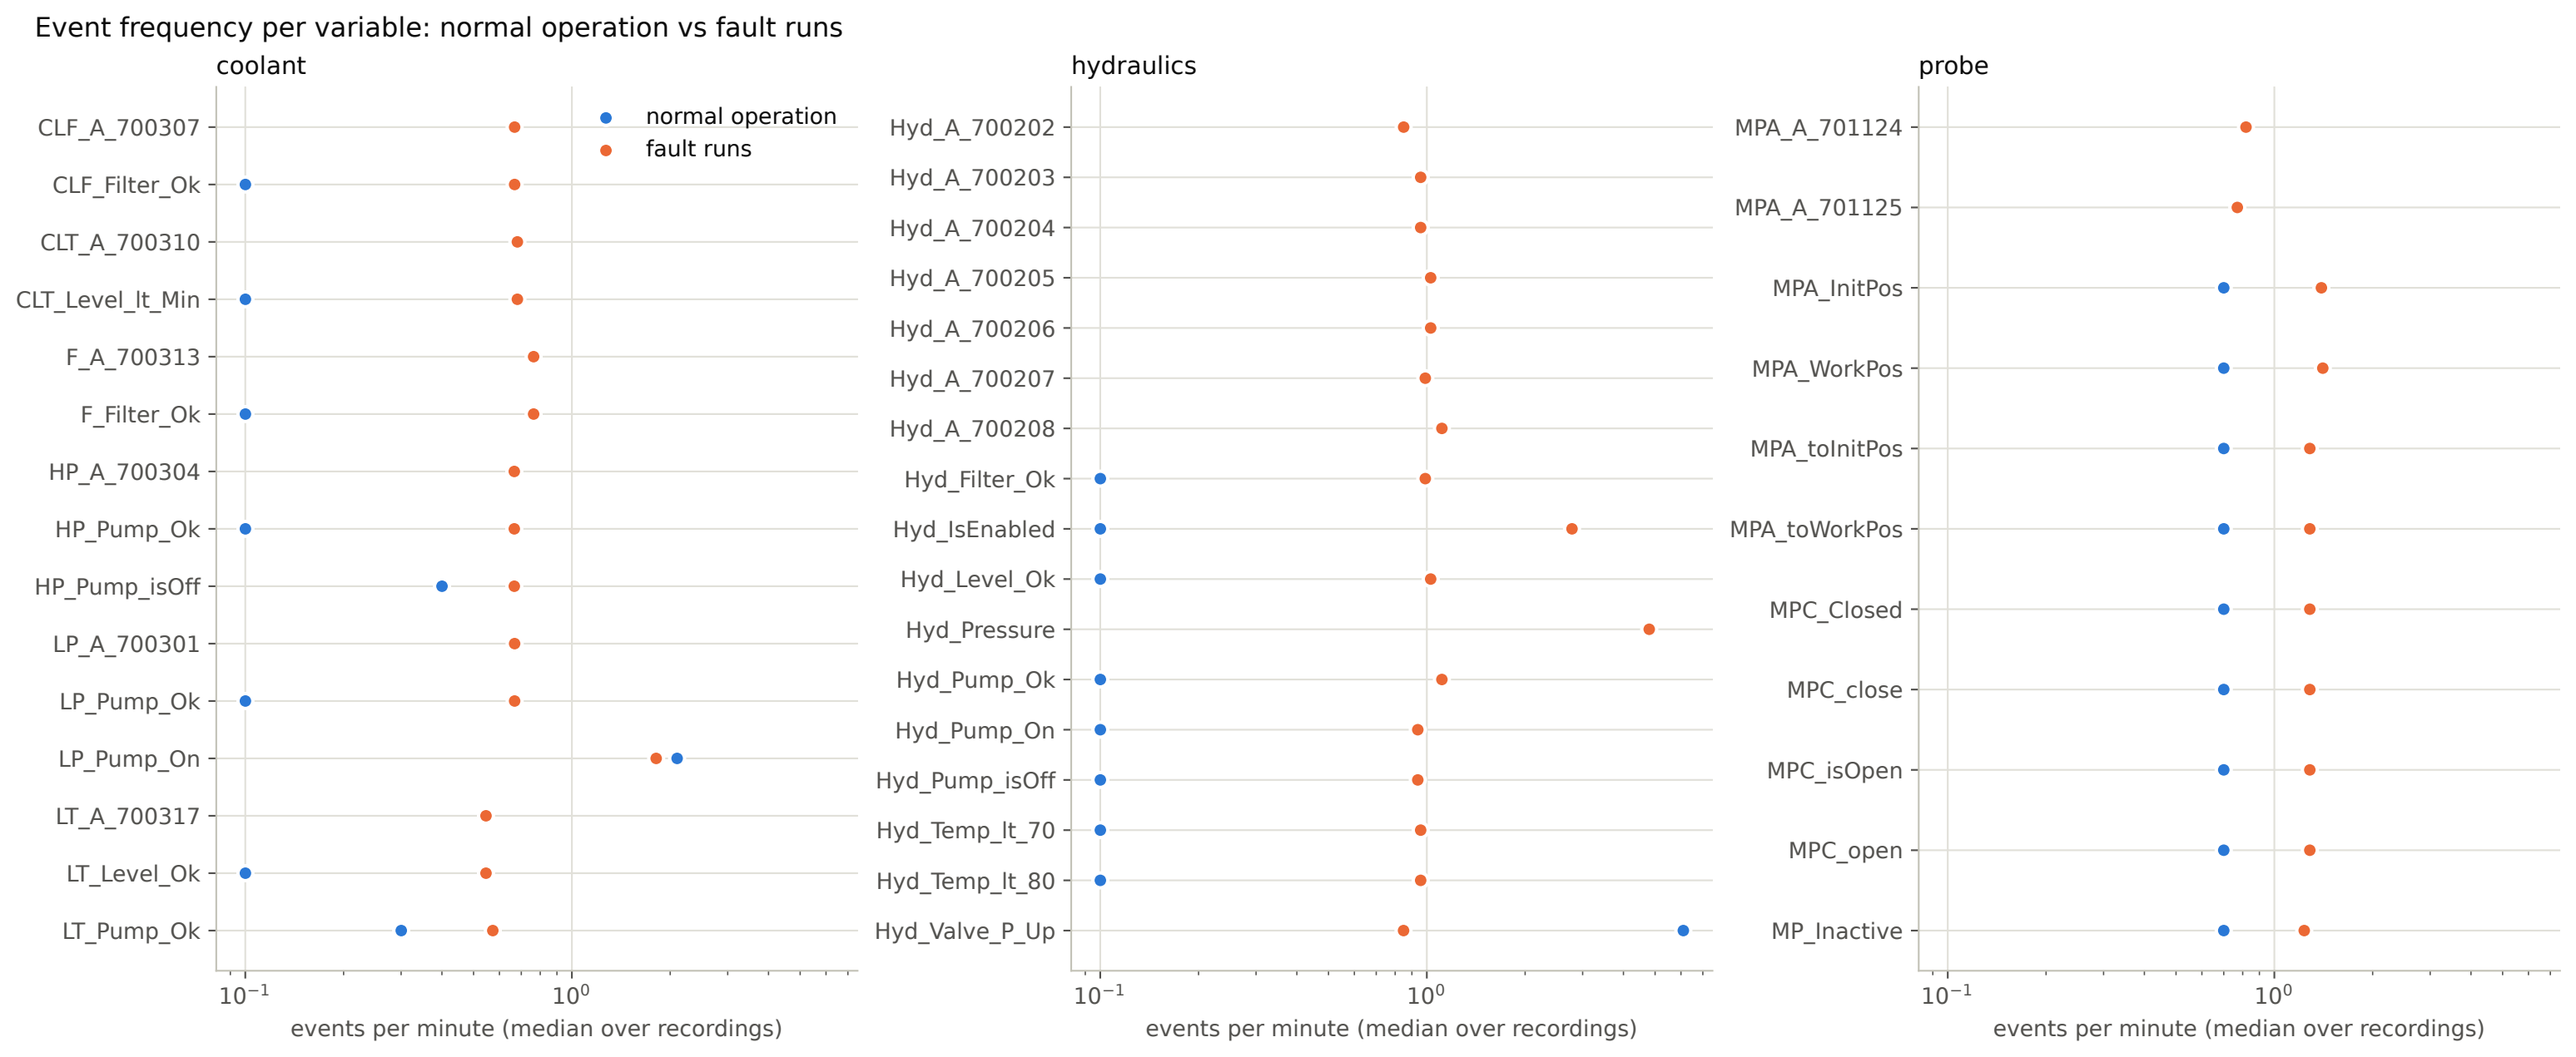
Event frequency per variable: normal operation vs fault runs
coolant
hydraulics
probe
normal operation
fault runs
CLF_A_700307
CLF_Filter_Ok
CLT_A_700310
CLT_Level_lt_Min
F_A_700313
F_Filter_Ok
HP_A_700304
HP_Pump_Ok
HP_Pump_isOff
LP_A_700301
LP_Pump_Ok
LP_Pump_On
LT_A_700317
LT_Level_Ok
LT_Pump_Ok
Hyd_A_700202
Hyd_A_700203
Hyd_A_700204
Hyd_A_700205
Hyd_A_700206
Hyd_A_700207
Hyd_A_700208
Hyd_Filter_Ok
Hyd_IsEnabled
Hyd_Level_Ok
Hyd_Pressure
Hyd_Pump_Ok
Hyd_Pump_On
Hyd_Pump_isOff
Hyd_Temp_lt_70
Hyd_Temp_lt_80
Hyd_Valve_P_Up
MPA_A_701124
MPA_A_701125
MPA_InitPos
MPA_WorkPos
MPA_toInitPos
MPA_toWorkPos
MPC_Closed
MPC_close
MPC_isOpen
MPC_open
MP_Inactive
10^{-1}
10^{0}
events per minute (median over recordings)