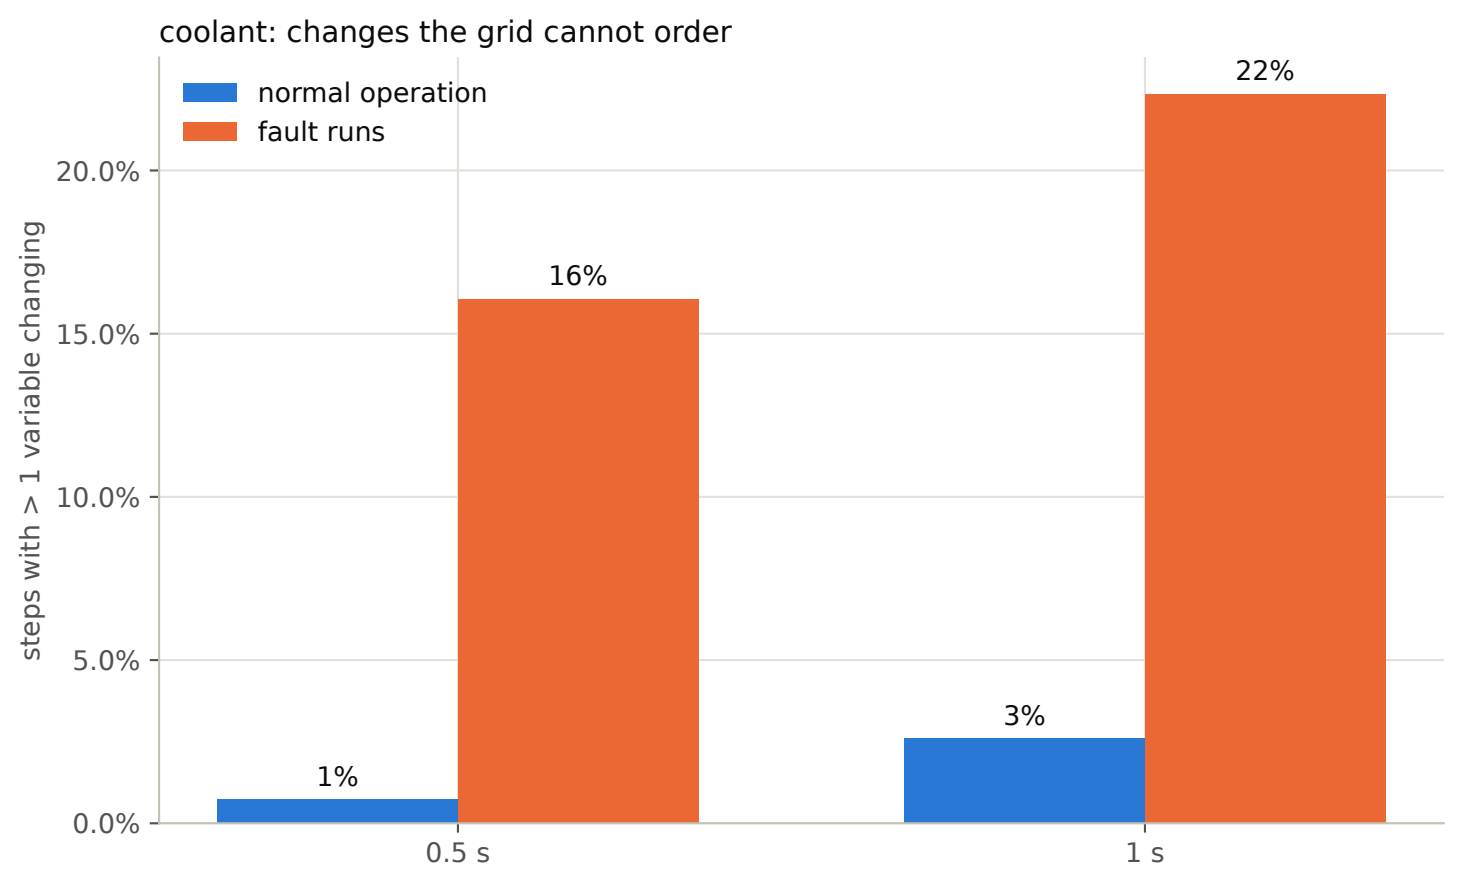
coolant: changes the grid cannot order
normal operation
fault runs
steps with > 1 variable changing
20.0%
15.0%
10.0%
5.0%
0.0%
1%
16%
3%
22%
0.5 s
1 s