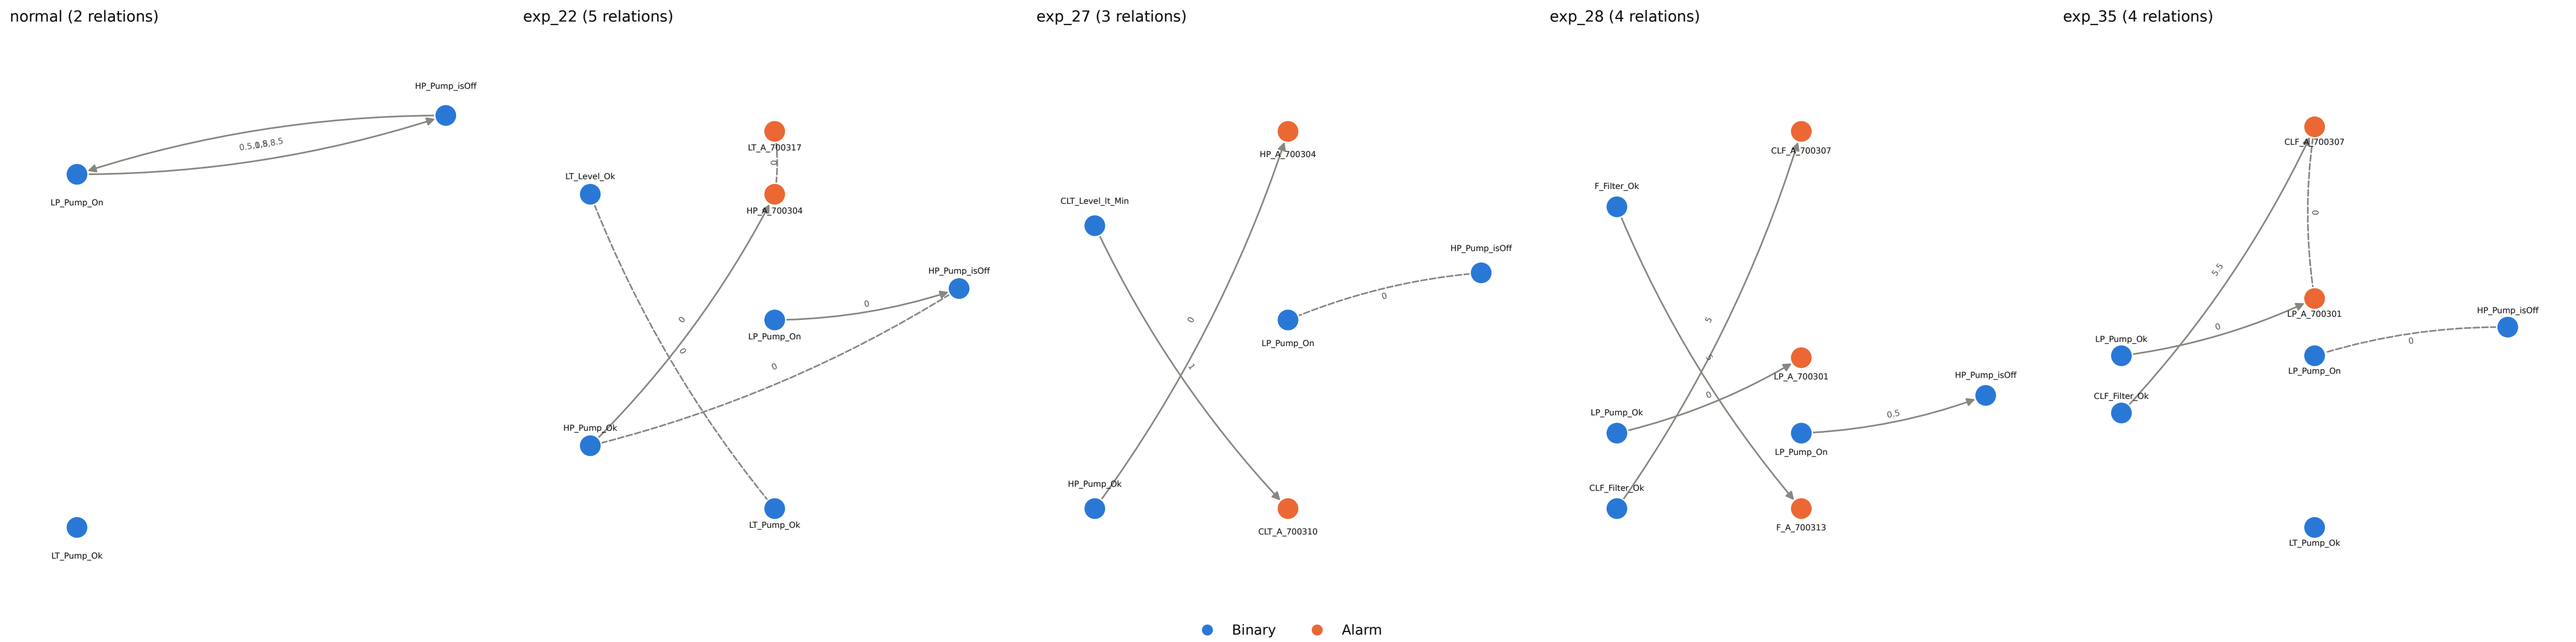
normal (2 relations)
HP_Pump_isOff
LP_Pump_On
0.5
0.5
8.5
8.5
LT_Pump_Ok
exp_22 (5 relations)
LT_A_700317
0
HP_A_700304
LT_Level_Ok
HP_Pump_isOff
0
0
LP_Pump_On
0
0
HP_Pump_Ok
LT_Pump_Ok
exp_27 (3 relations)
HP_A_700304
CLT_Level_It_Min
HP_Pump_isOff
0
0
LP_Pump_On
1
HP_Pump_Ok
CLT_A_700310
exp_28 (4 relations)
CLF_A_700307
F_Filter_Ok
5
5
LP_A_700301
0
HP_Pump_isOff
LP_Pump_Ok
0.5
LP_Pump_On
CLF_Filter_Ok
F_A_700313
exp_35 (4 relations)
CLF_A_700307
0
5.5
LP_A_700301
HP_Pump_isOff
LP_Pump_Ok
0
0
LP_Pump_On
CLF_Filter_Ok
LT_Pump_Ok
Binary
Alarm