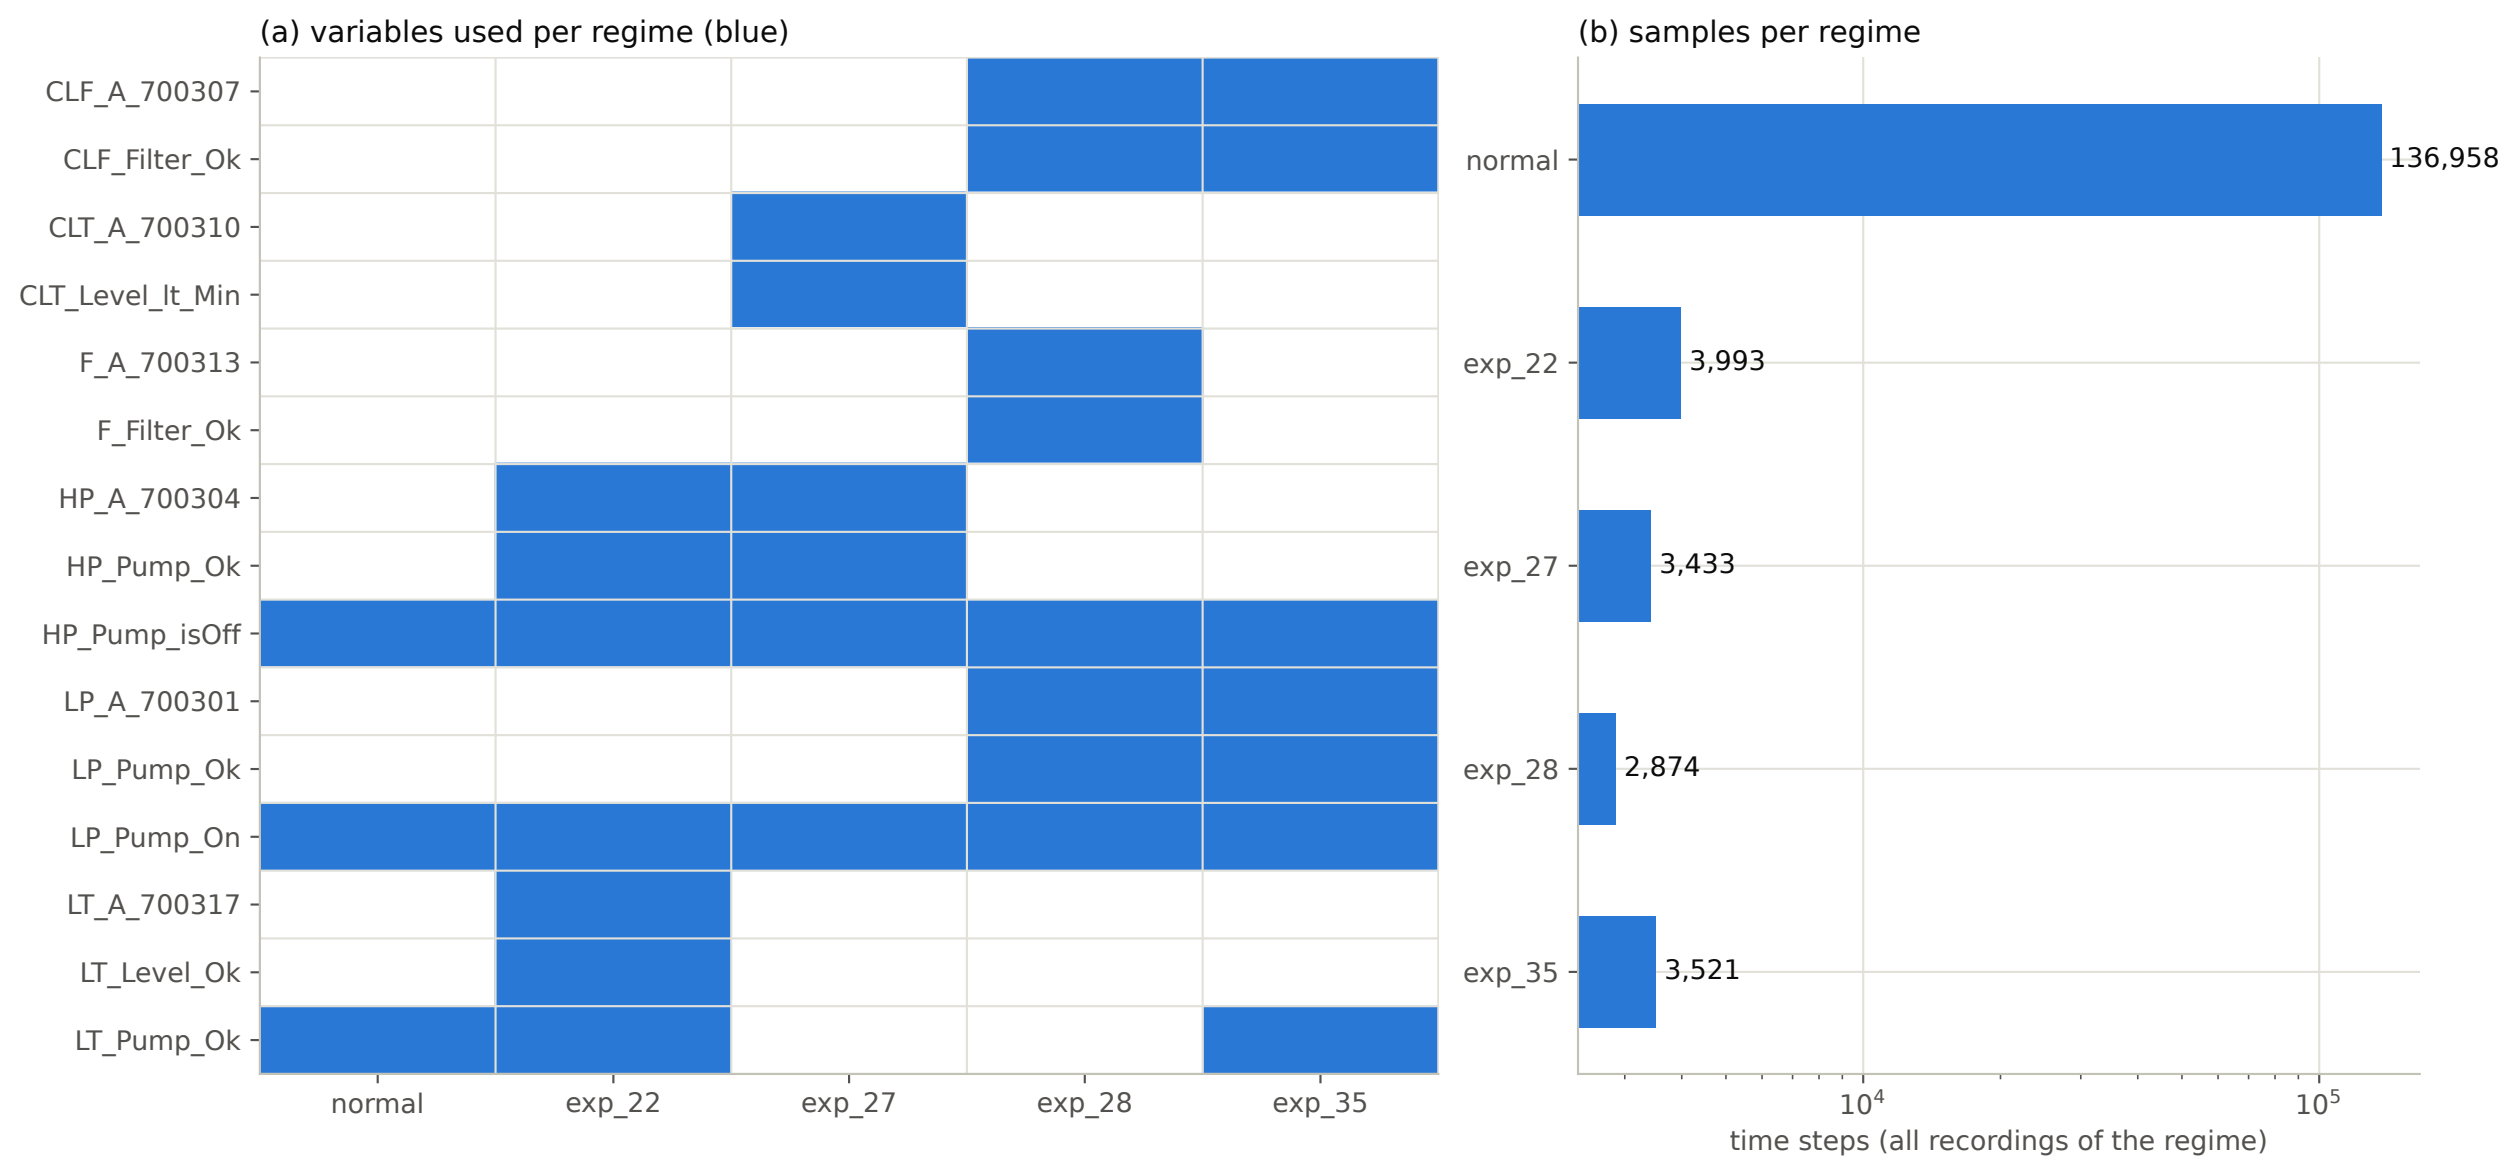
(a) variables used per regime (blue)
CLF_A_700307
CLF_Filter_Ok
CLT_A_700310
CLT_Level_lt_Min
F_A_700313
F_Filter_Ok
HP_A_700304
HP_Pump_Ok
HP_Pump_isOff
LP_A_700301
LP_Pump_Ok
LP_Pump_On
LT_A_700317
LT_Level_Ok
LT_Pump_Ok
normal
exp_22
exp_27
exp_28
exp_35
(b) samples per regime
normal
exp_22
exp_27
exp_28
exp_35
136,958
3,993
3,433
2,874
3,521
10^4
10^5
time steps (all recordings of the regime)