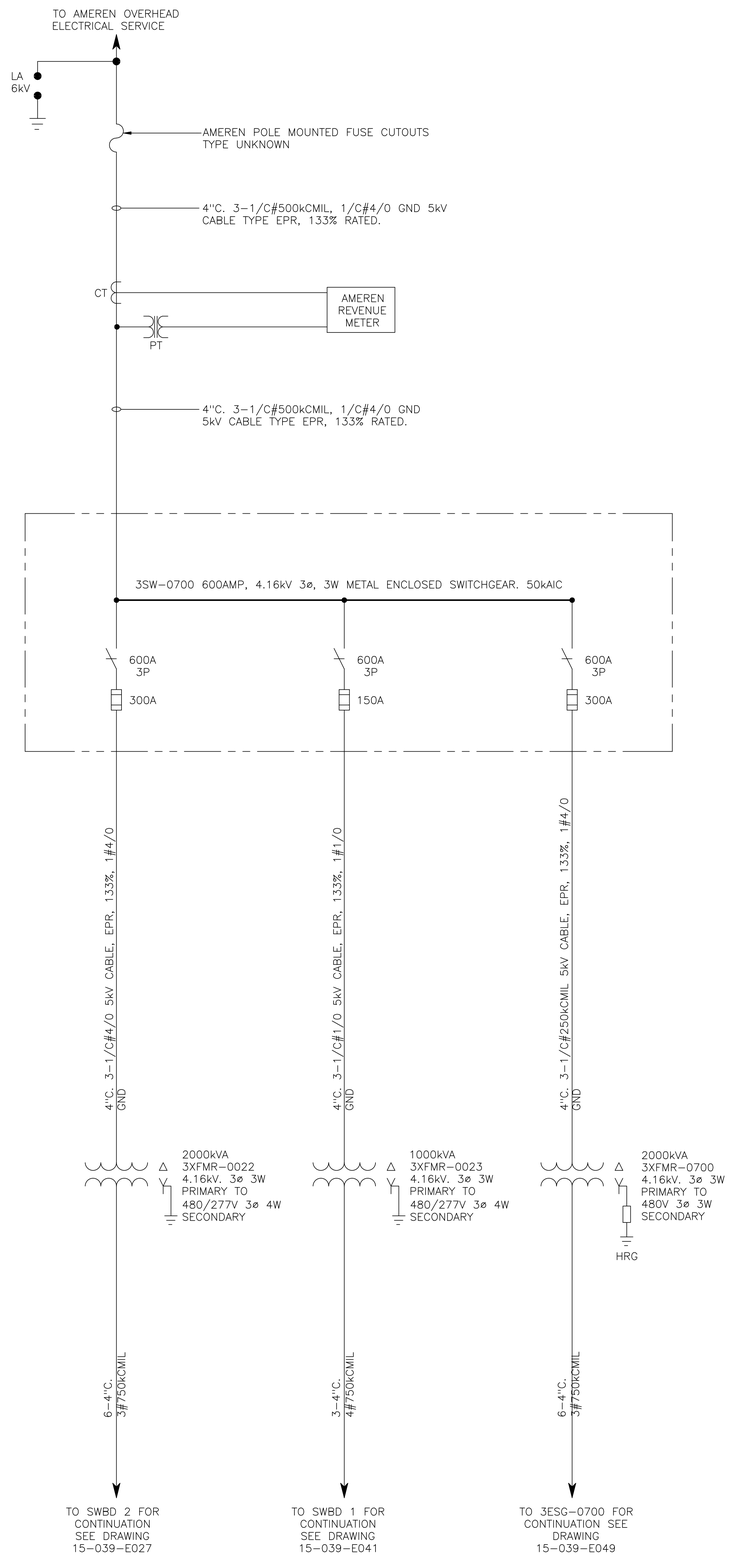

3SW-0700 ONE LINE DIAGRAM

NOT TO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE SITE ONE LINE DIAGRAMS	CK	05-31-15

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE:
CHEROKEE ELECRICAL OVERHEAD SERVICES
3SW-0700 ONE LINE DIAGRAM
BUILDING N MV ELECTRICAL SERVICE

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN:	RCE	SCALE:	NONE	DATE:	04-30-15	**15-039-E025**
CHECKED:	CK	APPROVED:	CK	DATE:	05-XX-15	

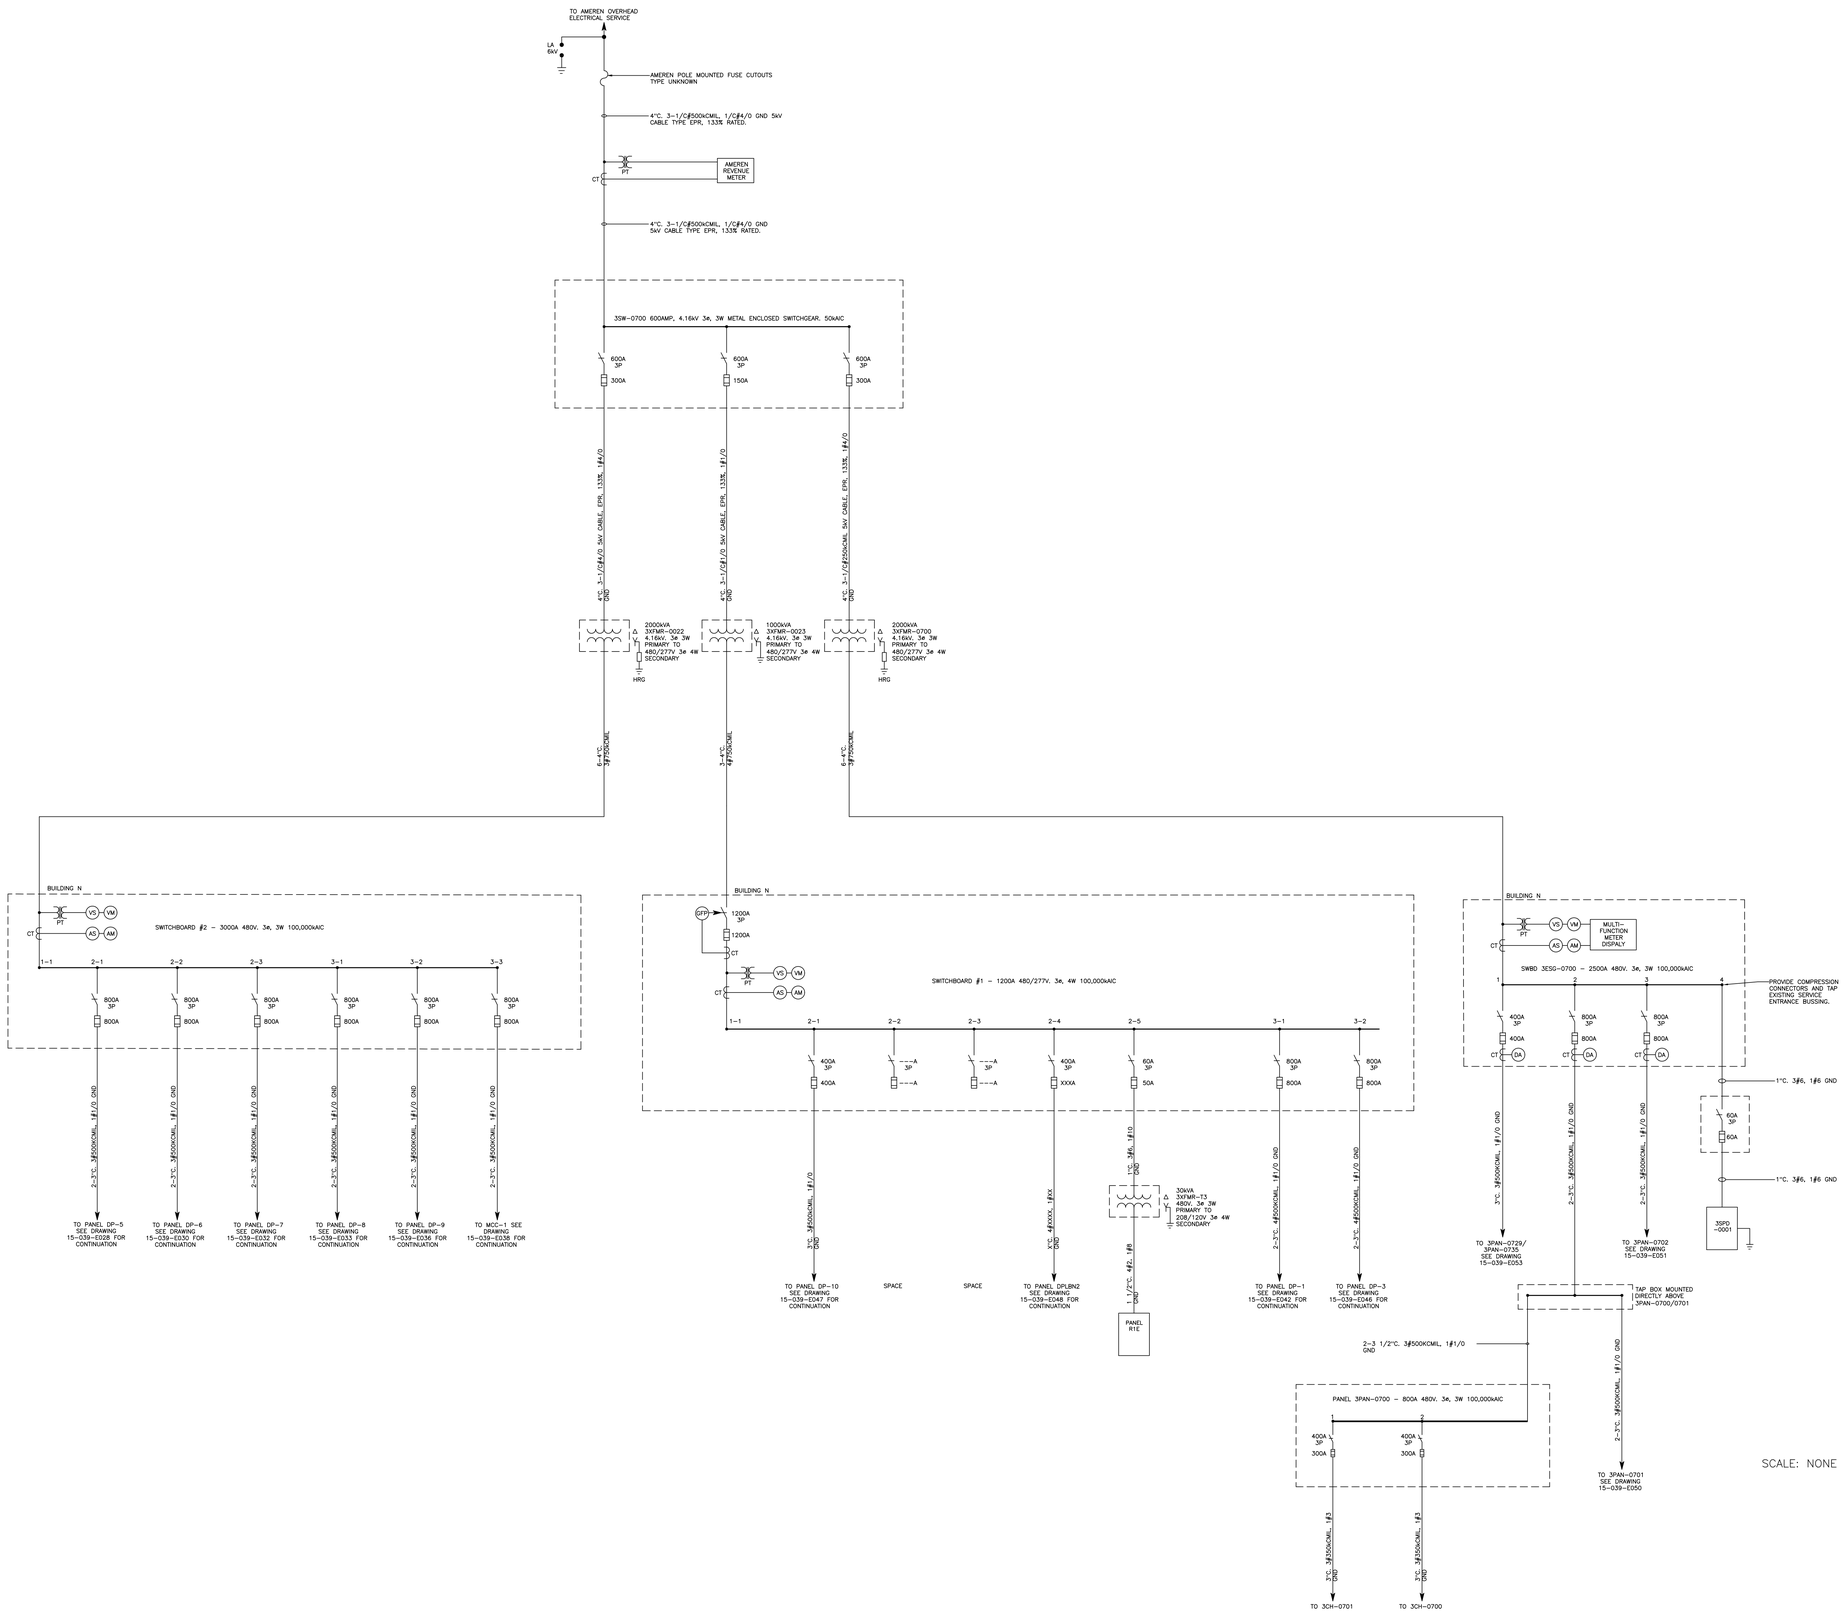

SCALE: NONE

1 BUILDING N ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT BLDG N OVERALL ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E

DRAWN: RCE DATE: 04-30-15

APPROVED: CK DATE: 05-31-15

DWG NO: 15-039-E026

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\N\Elec\15-039-E026 BLDG N OVERALL.dwg
Plotted at 2:26pm on Oct 13, 2023 by S118688

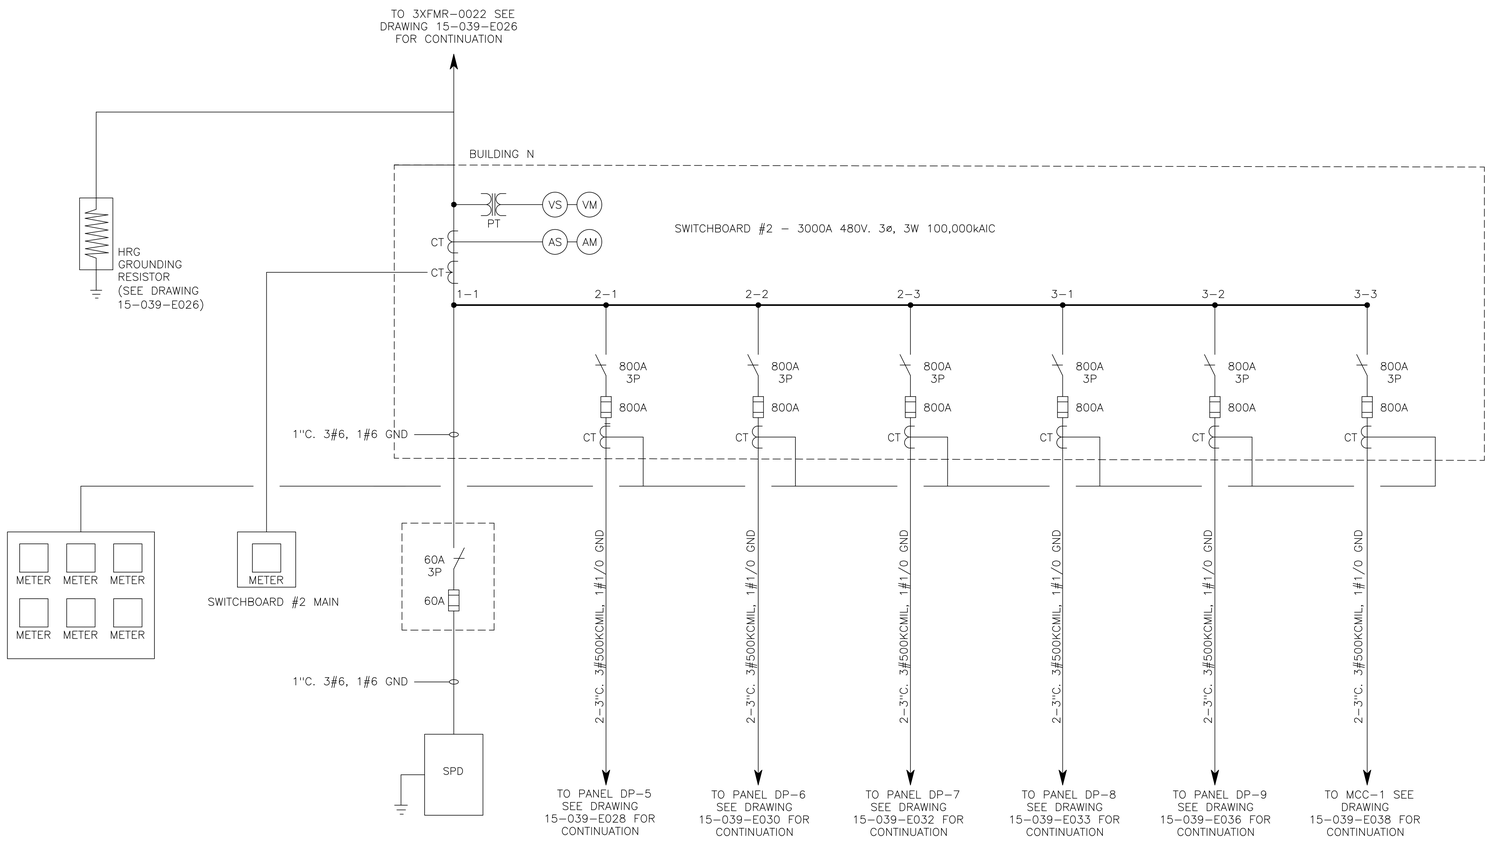

1 SWBD #2 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-01-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
SWBD #2 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E027

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E027 3XFMR-0022.dwg
Plotted at 10:07am on Dec 05, 2022 by S118688

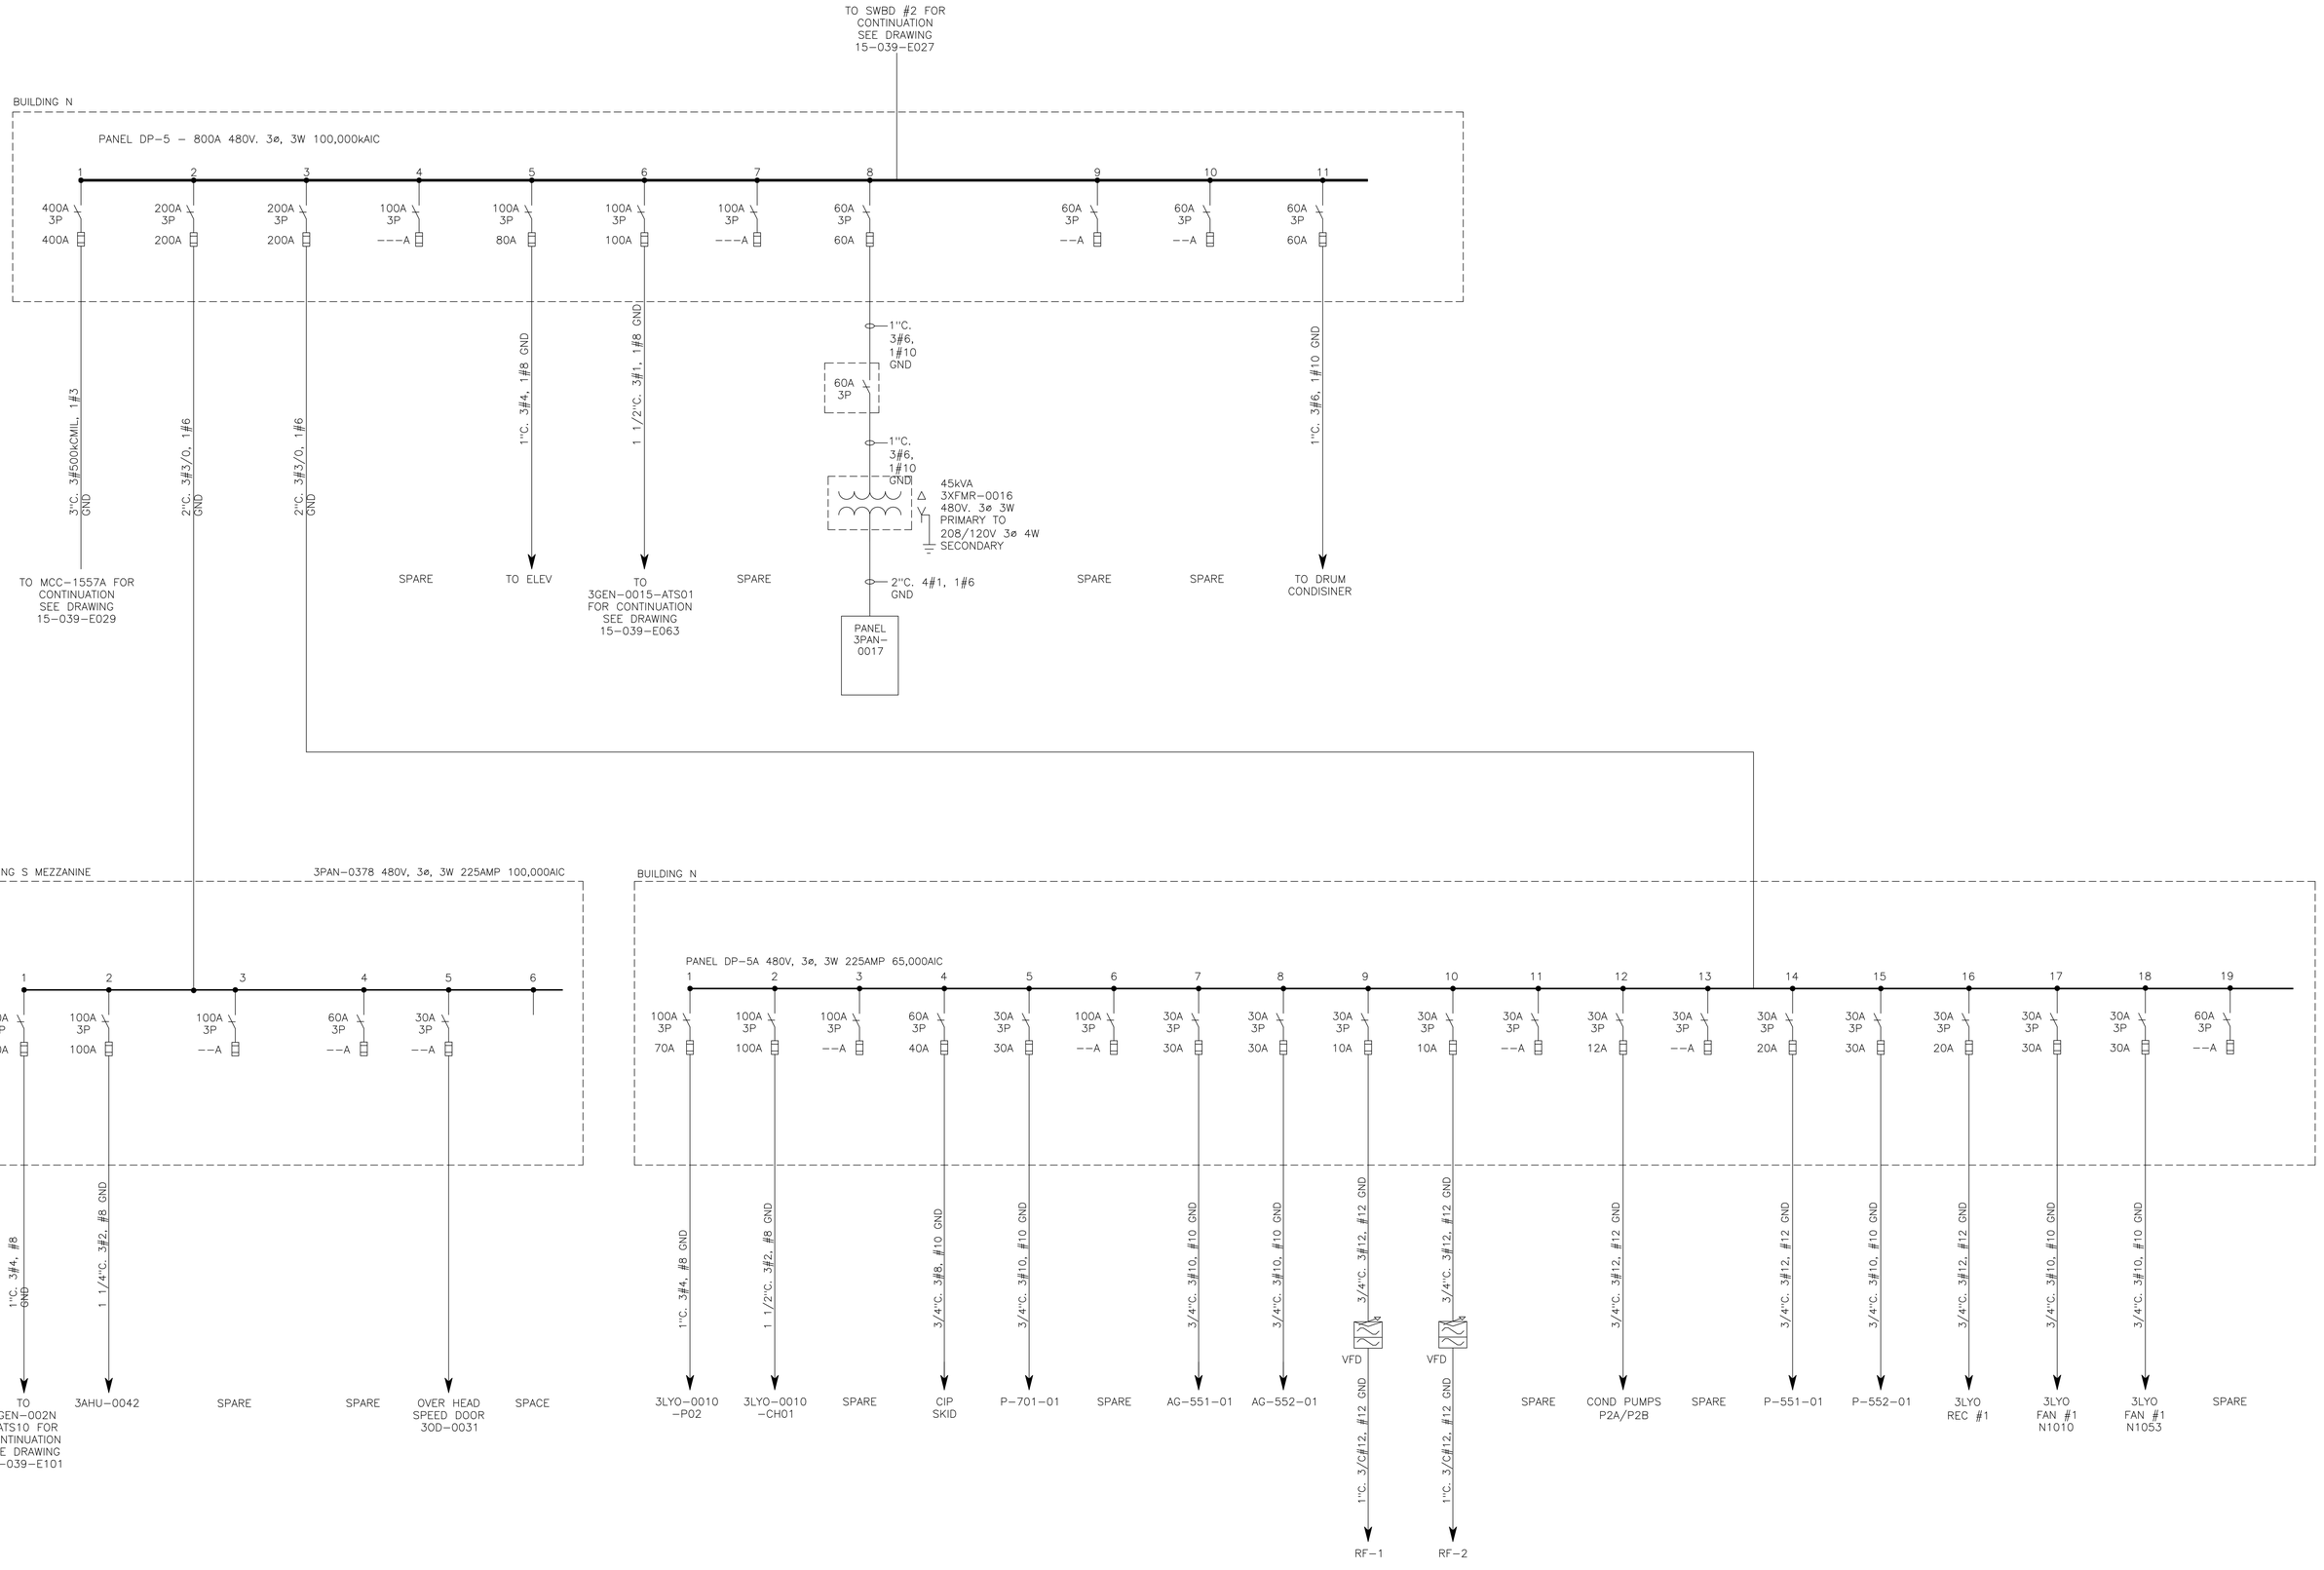

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E028 DP5.dwg
Plotted at 1:35pm on Dec 06, 2024 by S118688

1 DP-5 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATED VIA FIELD OBSERVATION	SN	11-15-22
1	ISSUED FOR CONSTRUCTION PROJECT 19-2019 - PHASE C	CK	05-04-20
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
DP-5 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E028
	APPROVED: CK	DATE: 05-31-15	

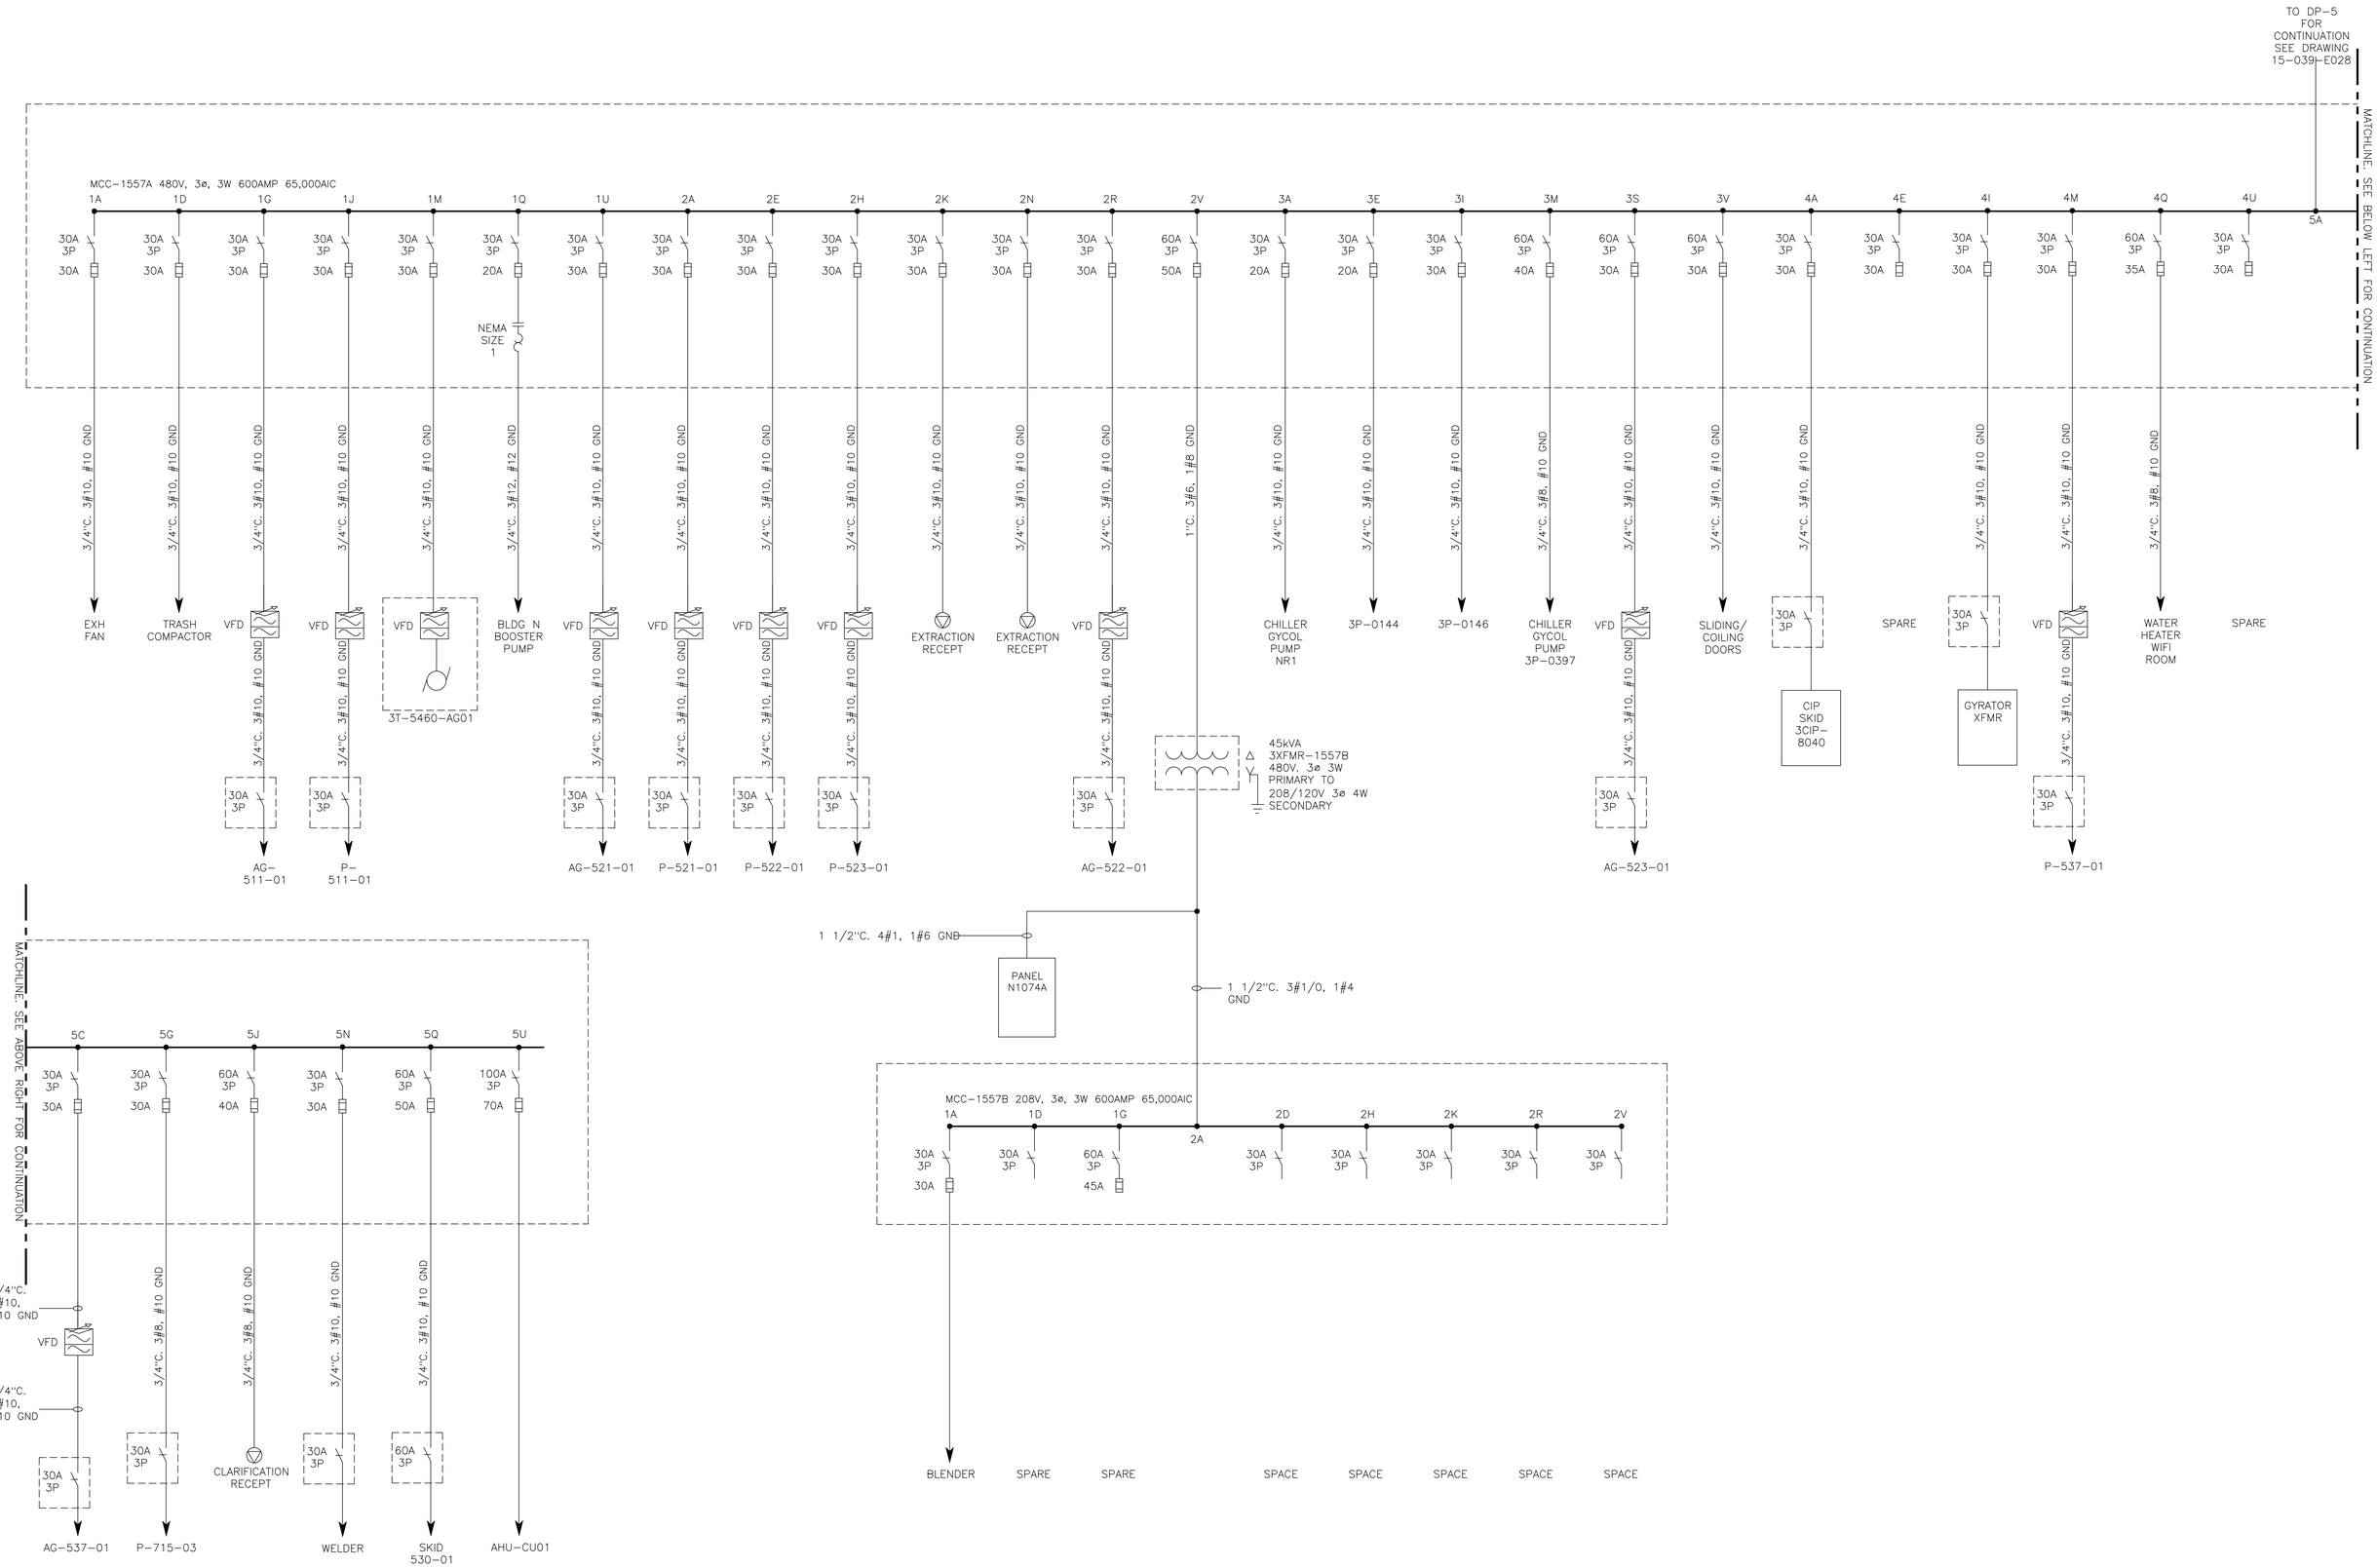

1 MCC-1557A ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-15-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
MCC-1557A ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E029

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E029 MCC1557A.dwg
Plotted at 10:13am on Dec 05, 2022 by S118688

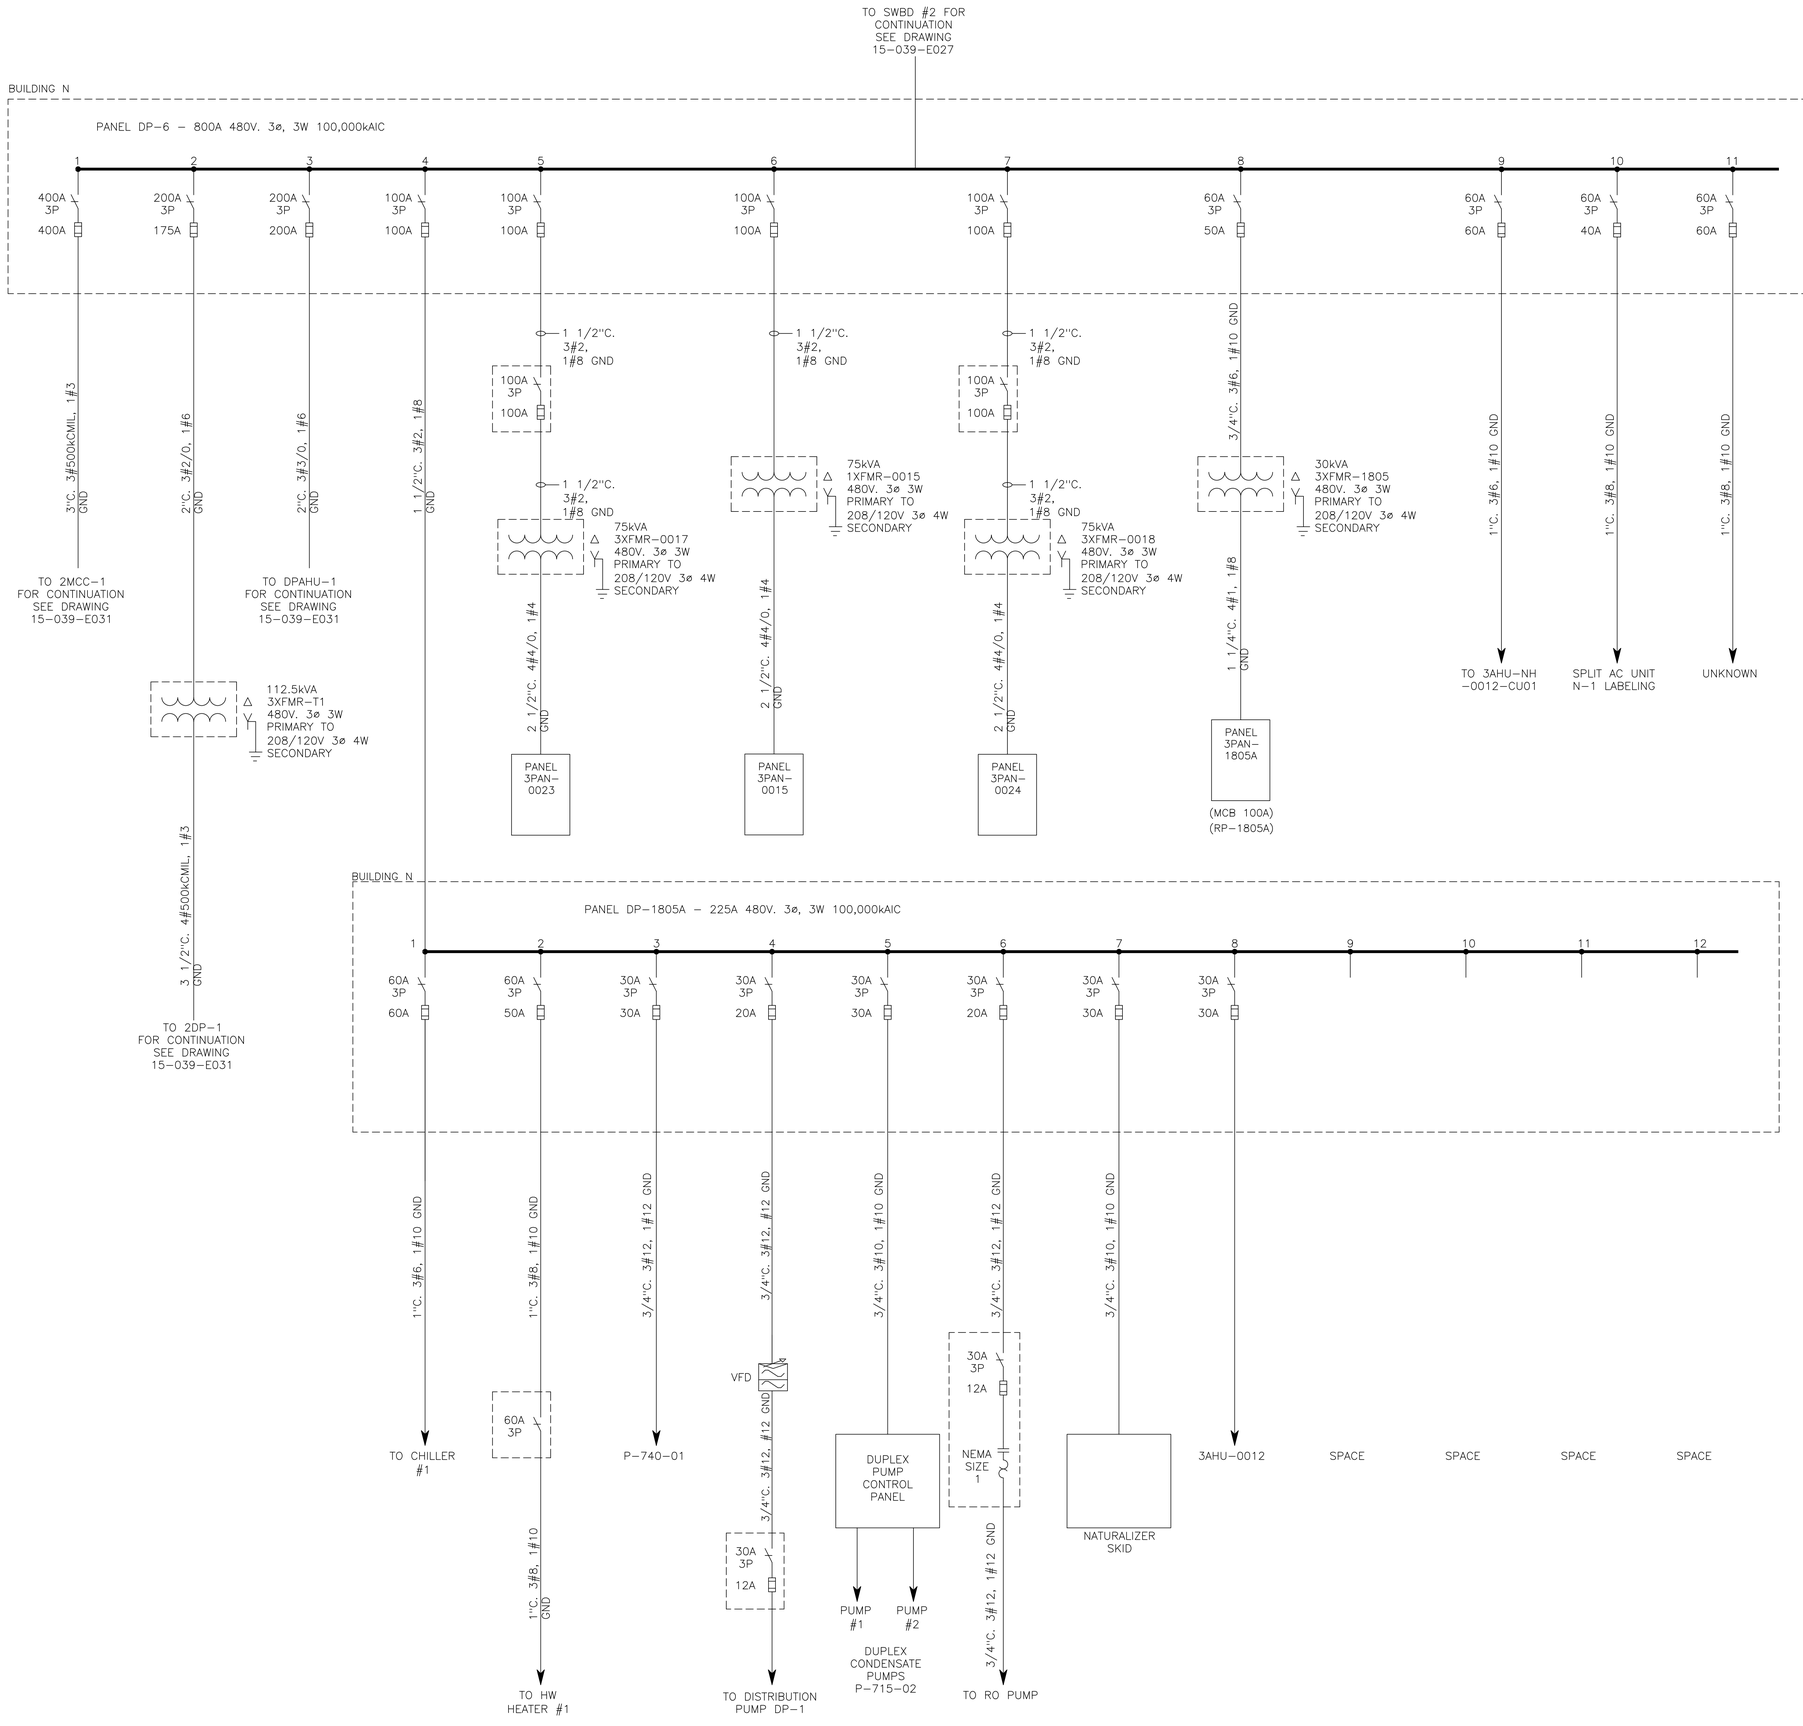

1 DP-6 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
DP-6 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E030

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E030 DP6.dwg
Plotted at 10:14am on Dec 05, 2022 by S118688

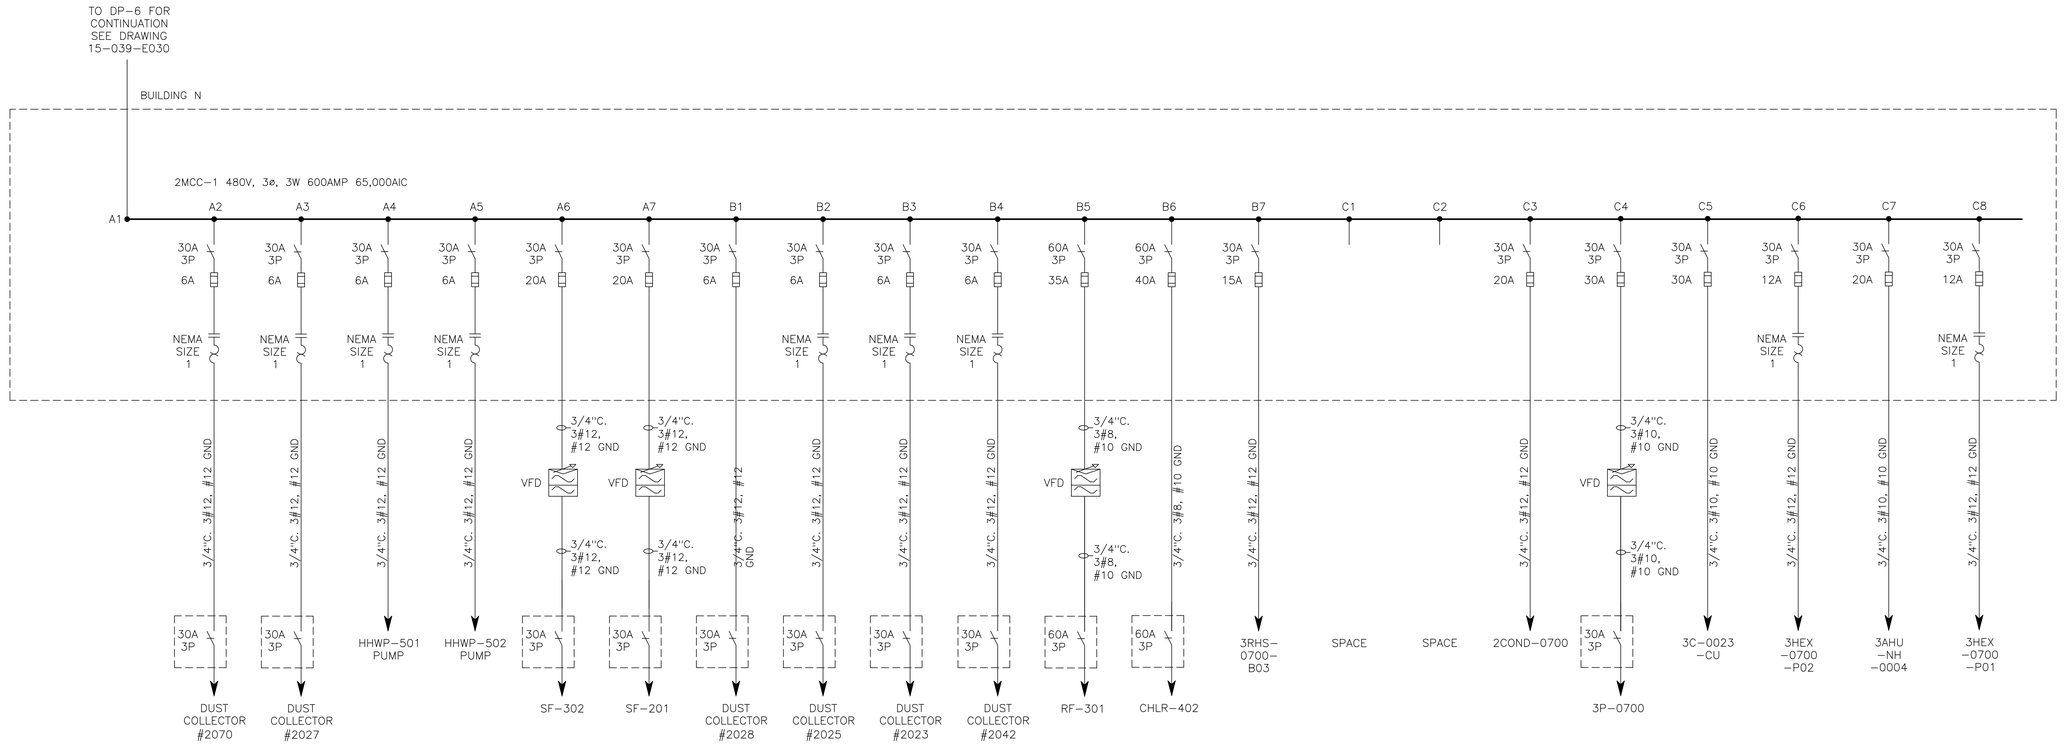

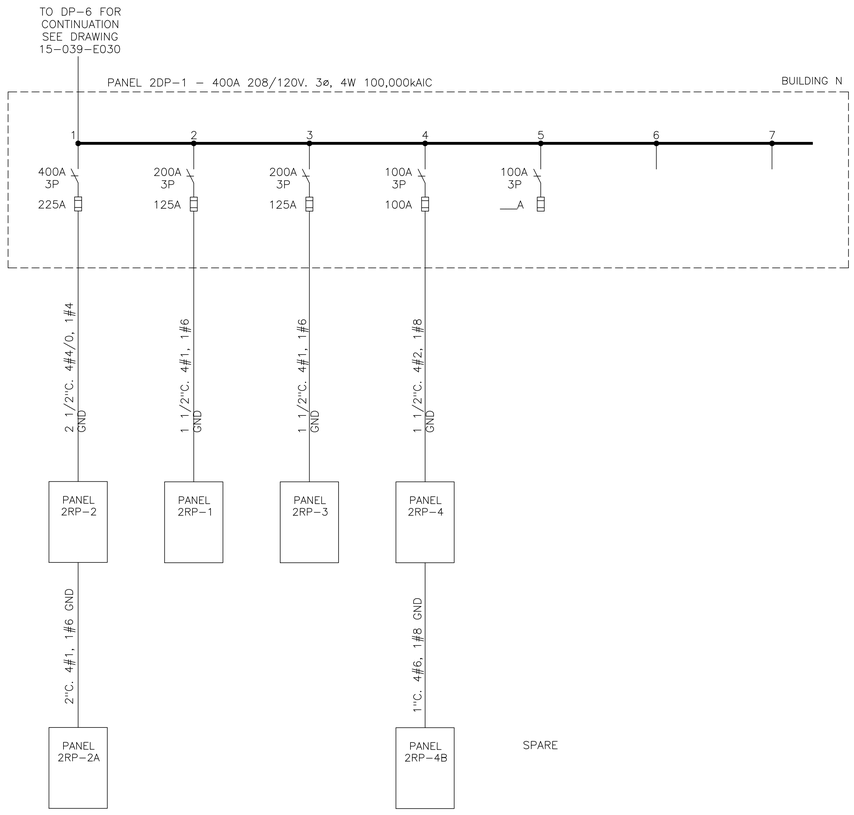

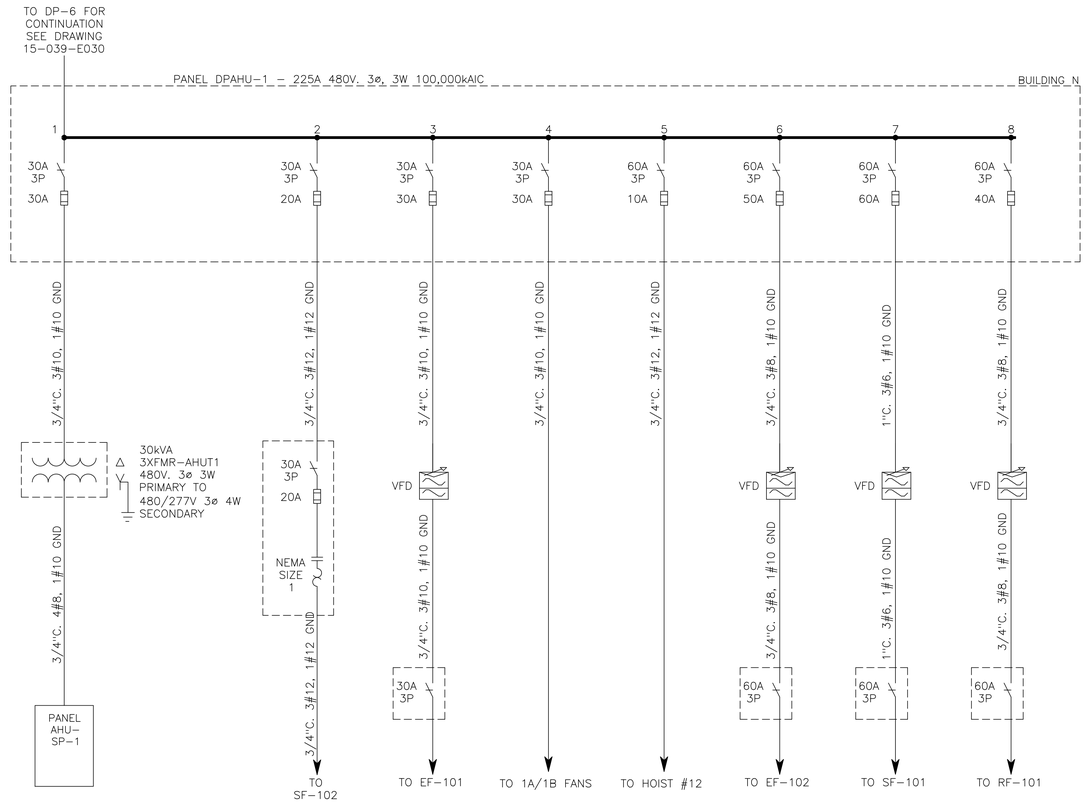

1 2MCC-1/2DP-1/DPAHU-1 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS–BUILT OR AS–RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
1	REMOVED UP-01 FROM 2DP-1	CK	09-17-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
2MCC-1/2DP-1/DPAHU-1 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E031
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E031 2MCC1-2DP1-DPAHU1.dwg
Plotted at 3:00pm on Feb 11, 2026 by S118688

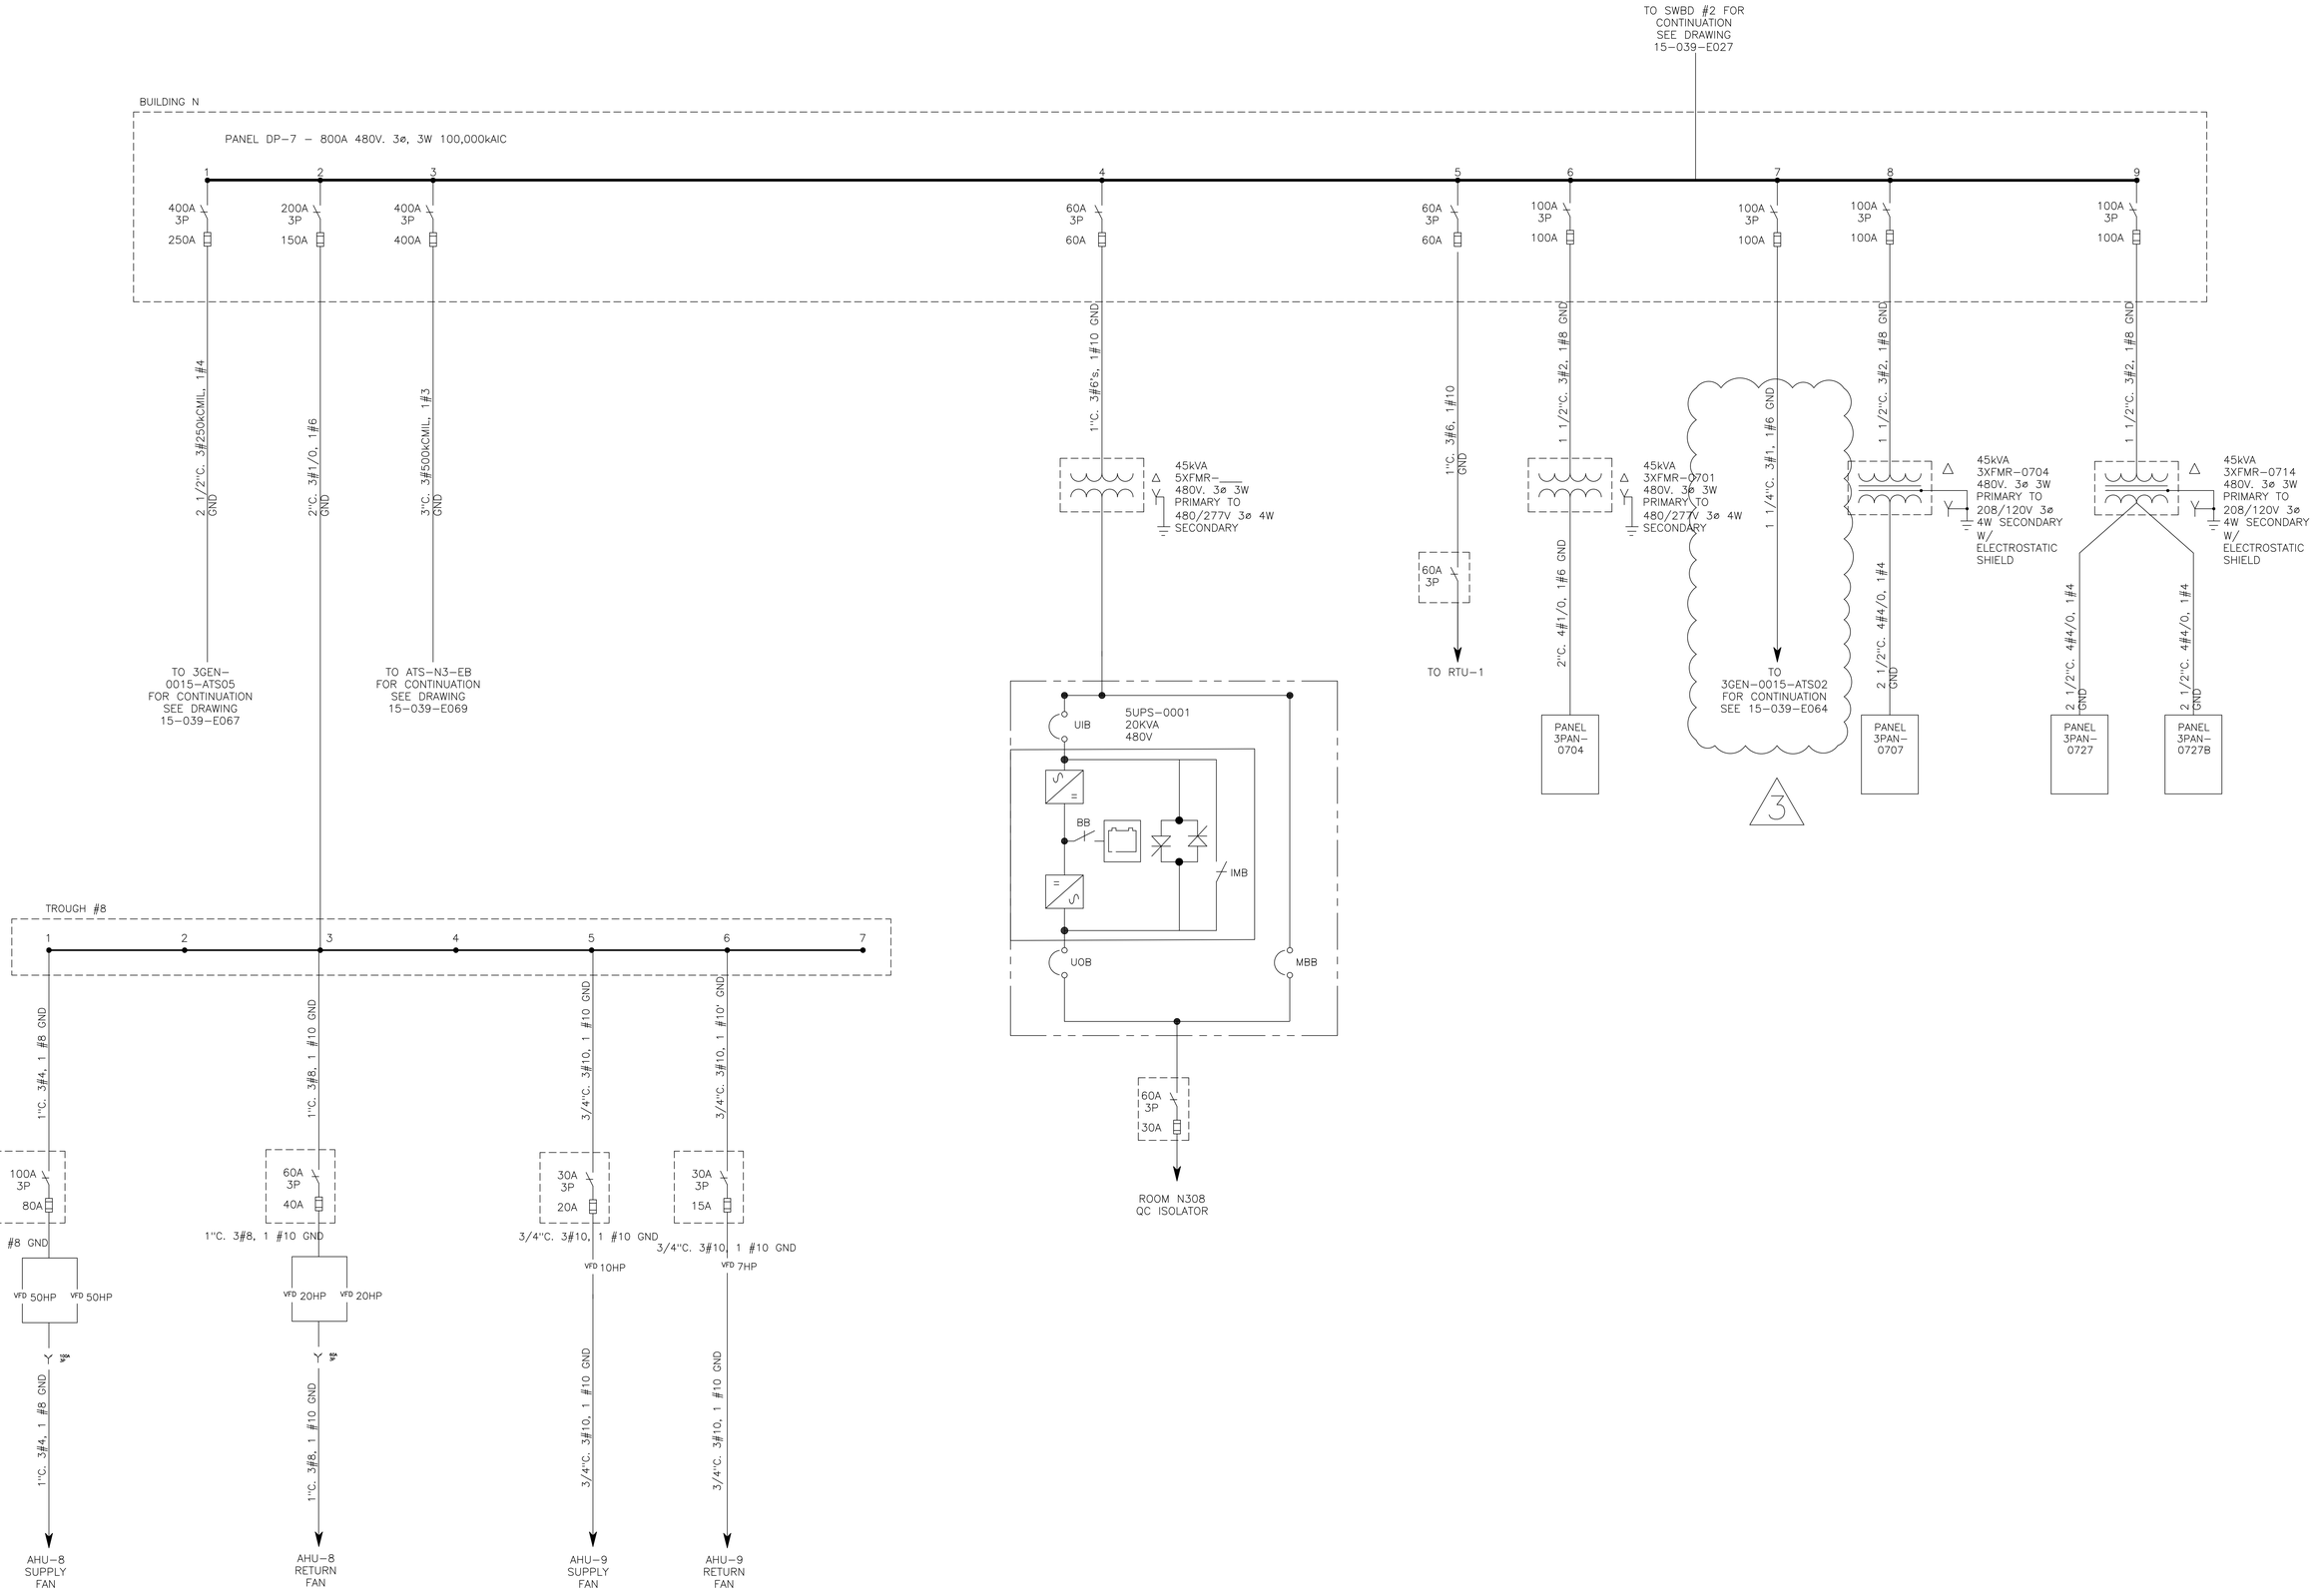

1 DP-7 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS–BUILT OR AS–RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	CC 5080021	JPE	28AUG2025
2	UPDATE VIA PROJECT 22-2281	SN	10-11-23
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
DP-7 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E032

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002.D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E032 DP7.dwg
Plotted at 12:17pm on Jan 05, 2026 by S118688

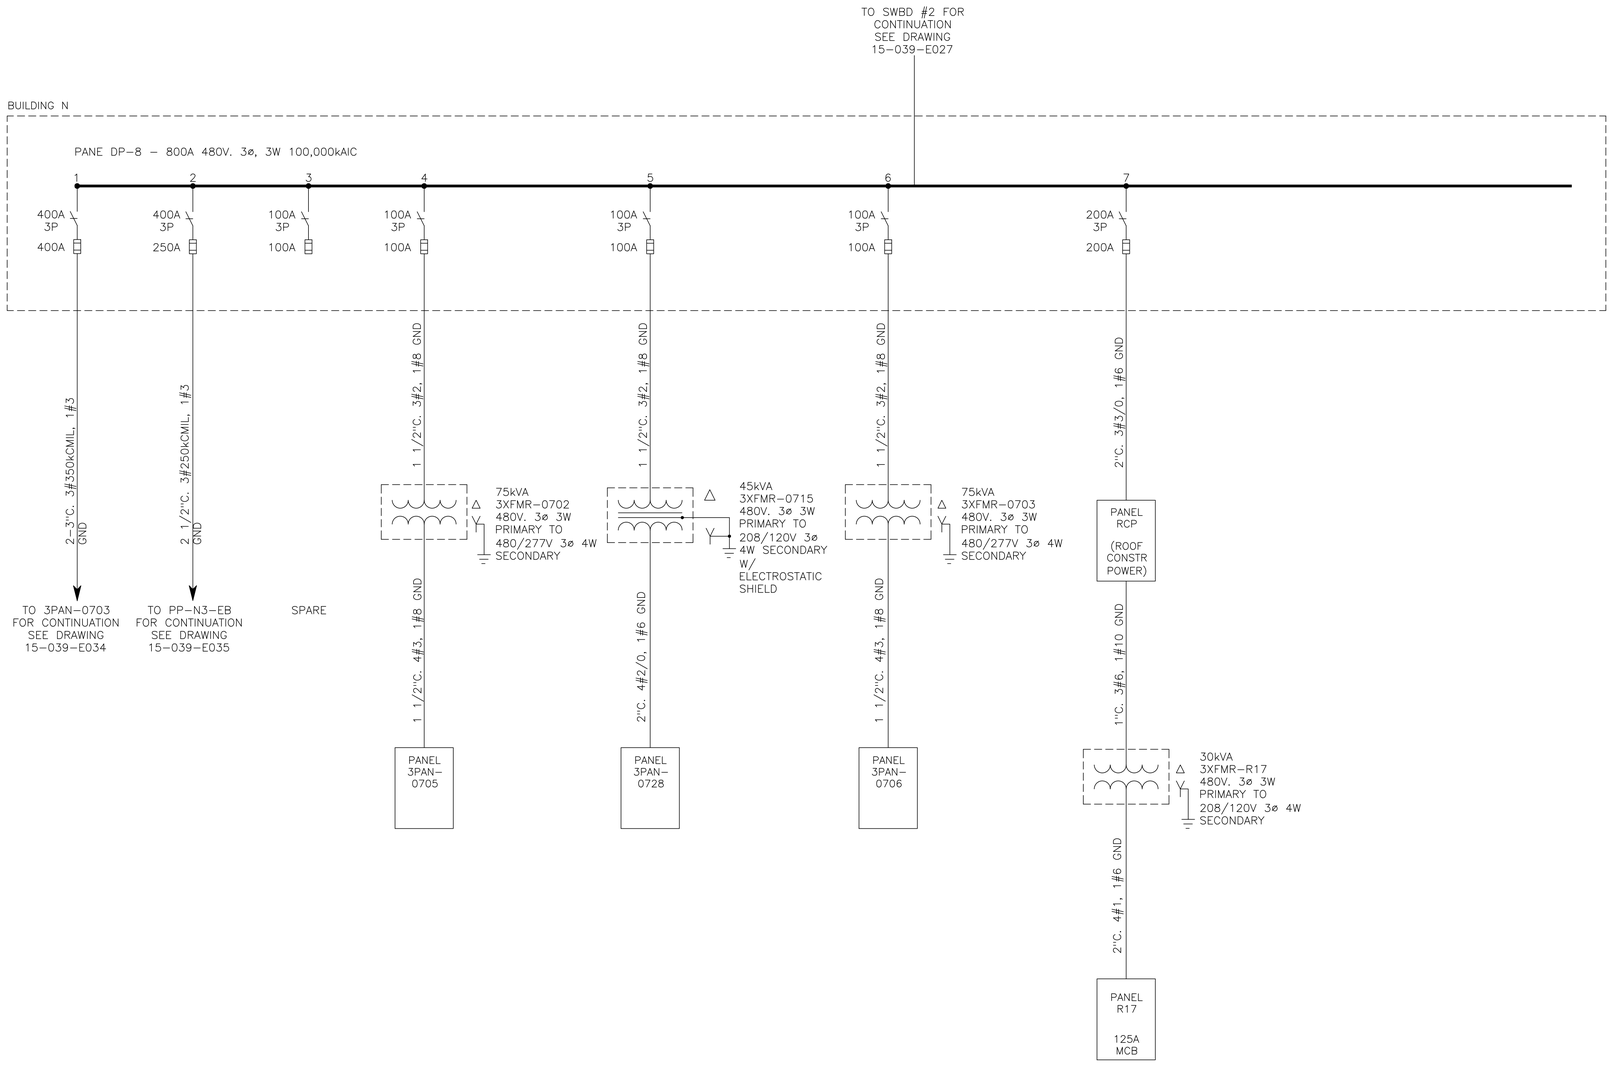

1 DP-8 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
DP-8 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E033
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E033 DP8.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

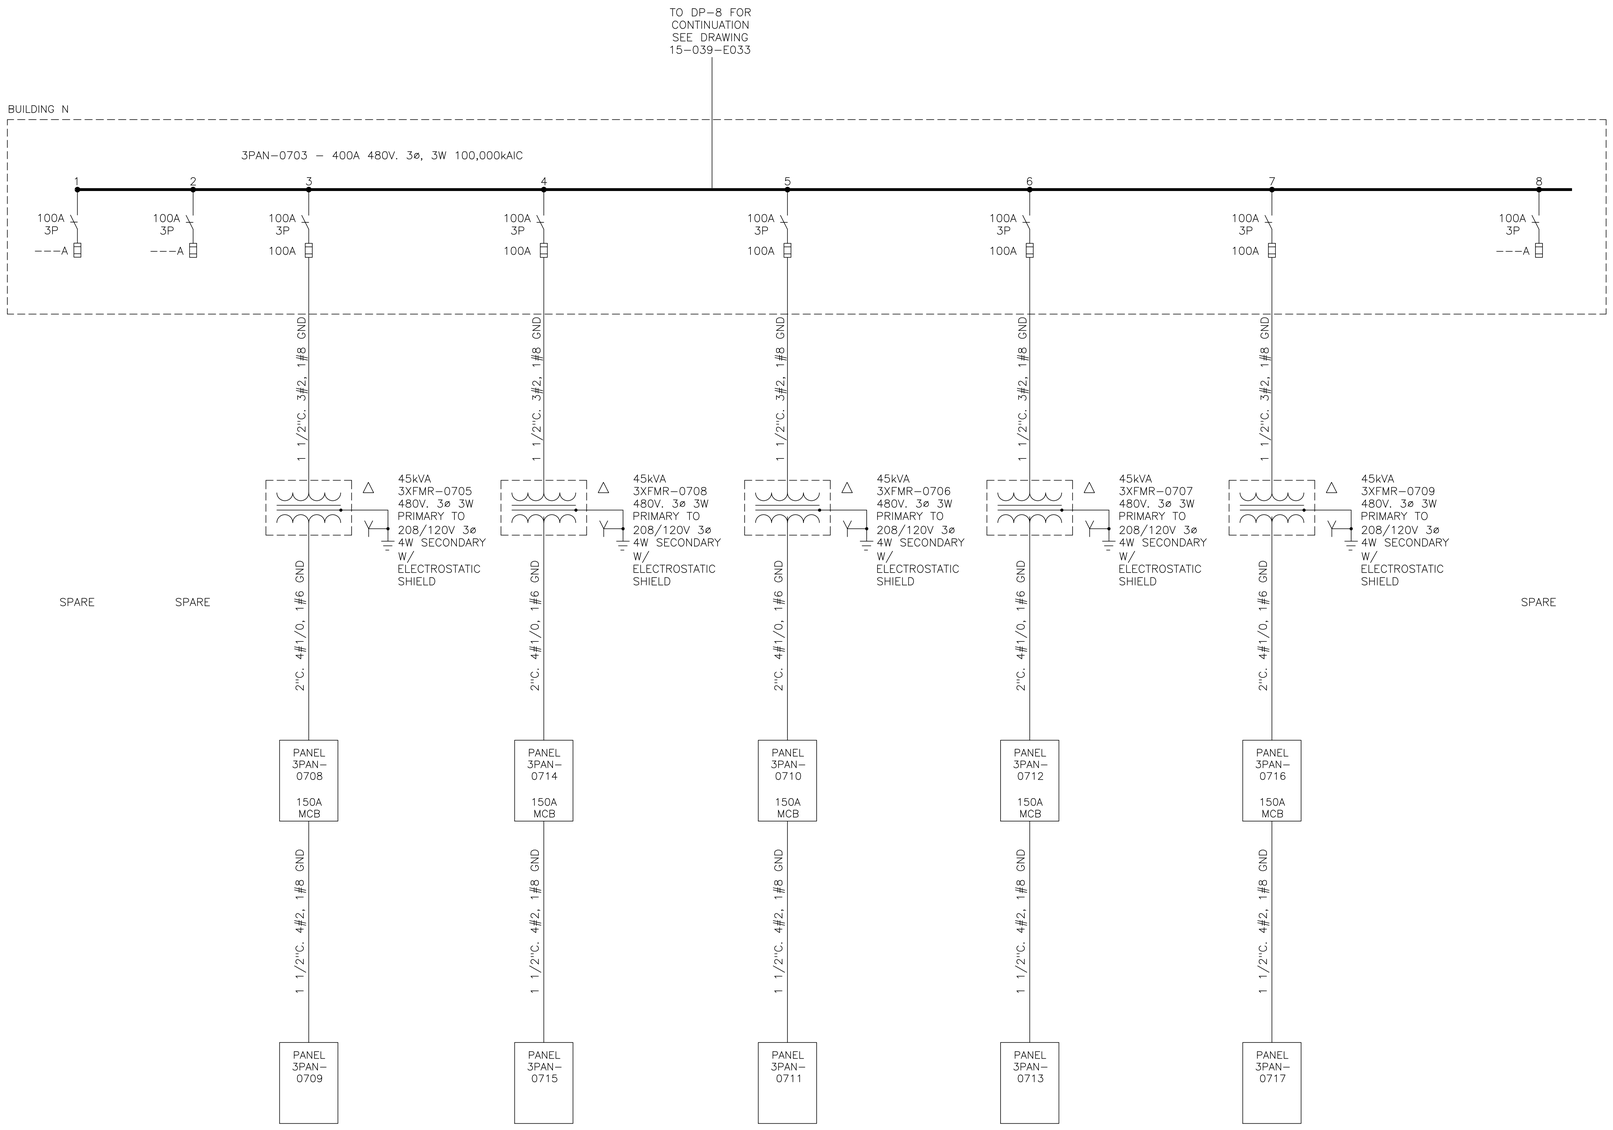

1 3PAN-0703 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
3PAN-0703 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E034
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E034 3PAN-703.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

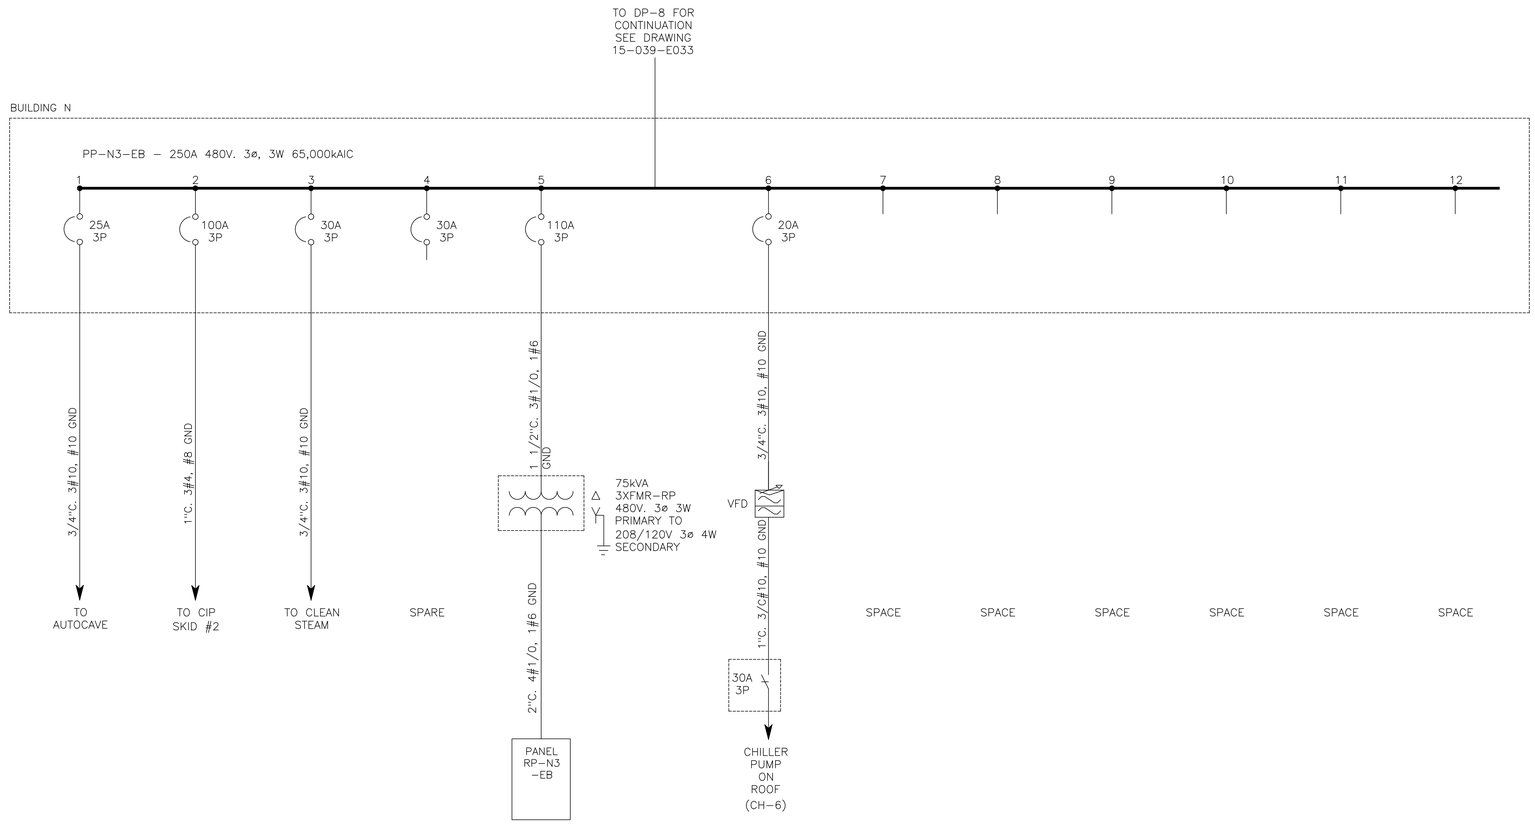

1 PP-N3-EB ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
PP-N3-EB ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E035
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E035 PPN3EB.dwg
Plotted at 10:21am on Dec 05, 2022 by S118688

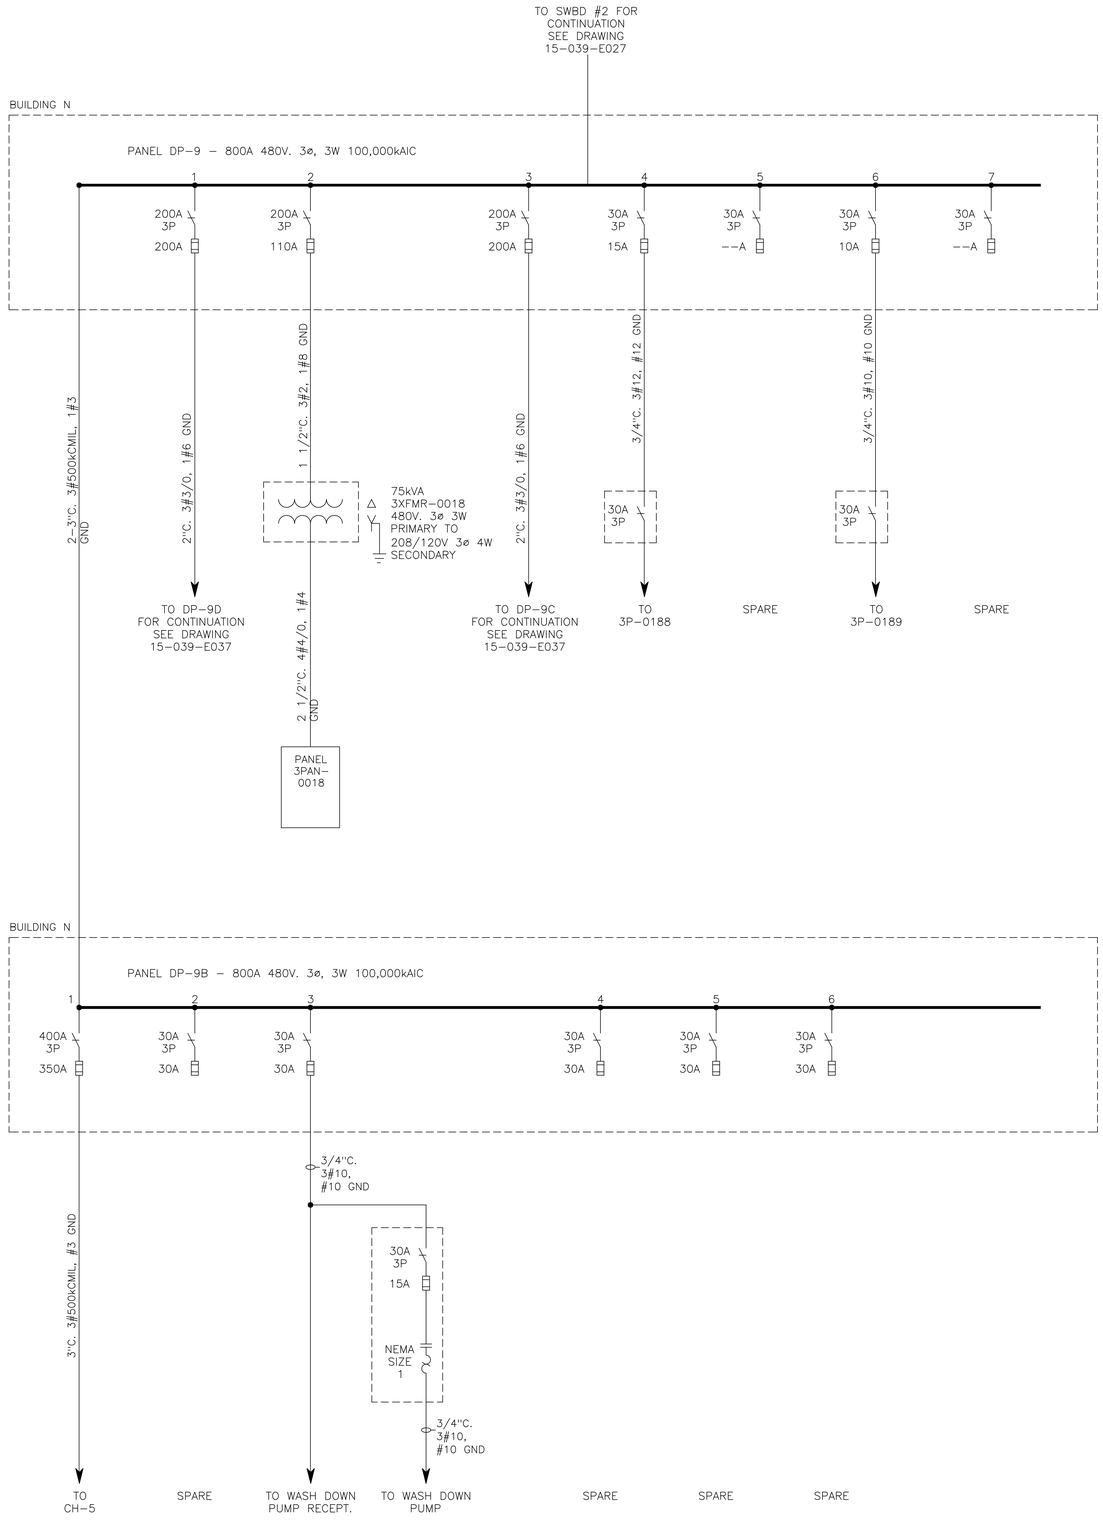

1 DP-9/9B ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-15-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
DP-9/9B ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E036
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E036 DP9-DP9B.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

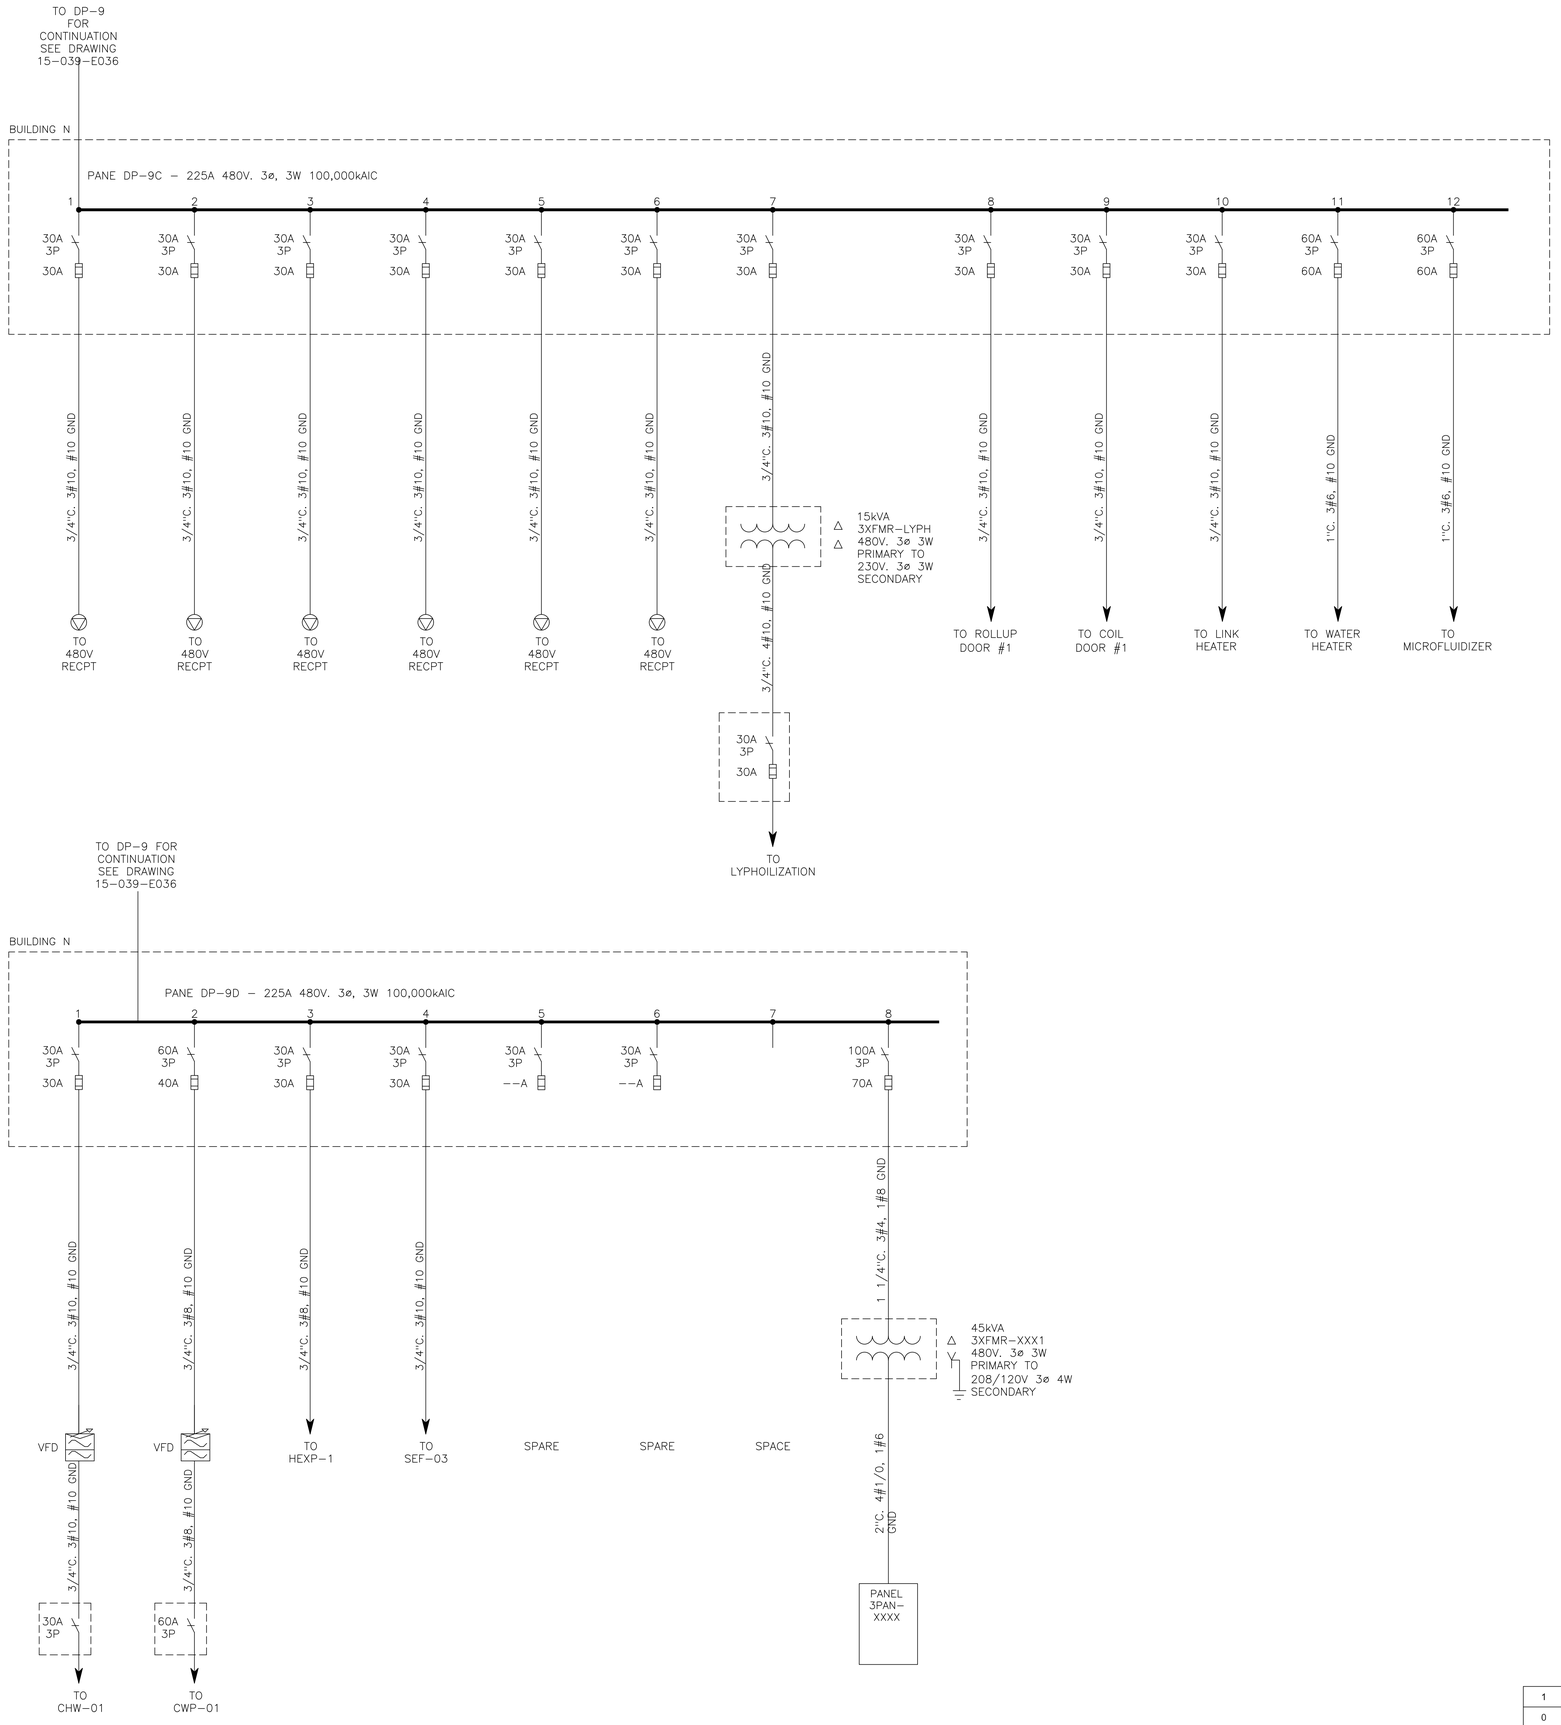

1 DP-9C/9D ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
DP-9C/9D ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E037
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E037 DP9C-DP9D.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

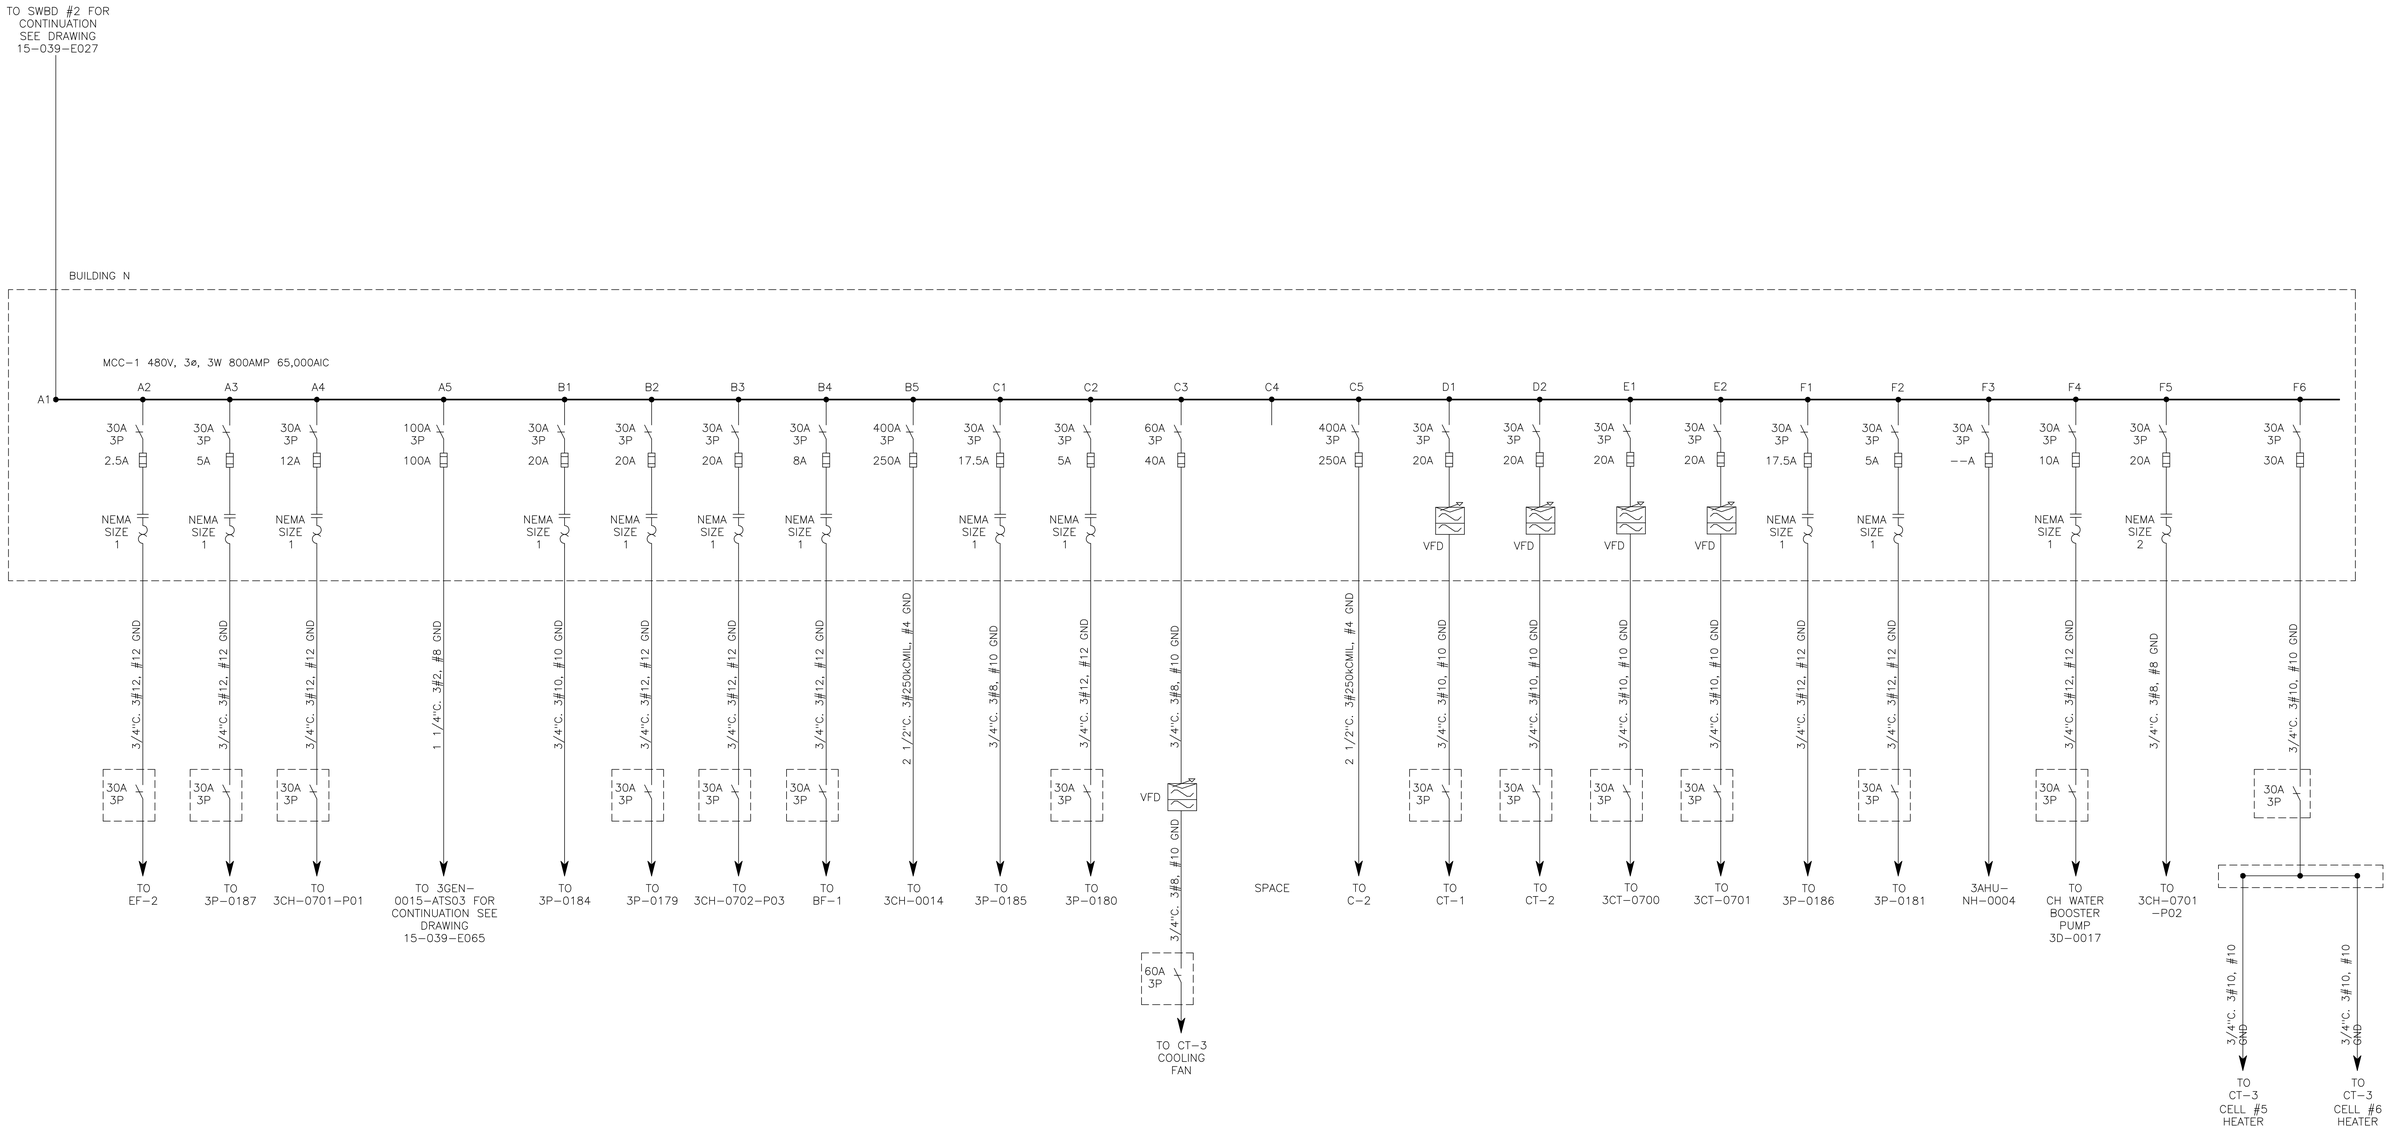

1 MCC-1 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
MCC-1 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E038

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002.D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E038 MCC1.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E039
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E039 FUTURE.dwg
Plotted at 10:21am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0022
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E040
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E040 FUTURE.dwg
Plotted at 10:21am on Dec 05, 2022 by S118688

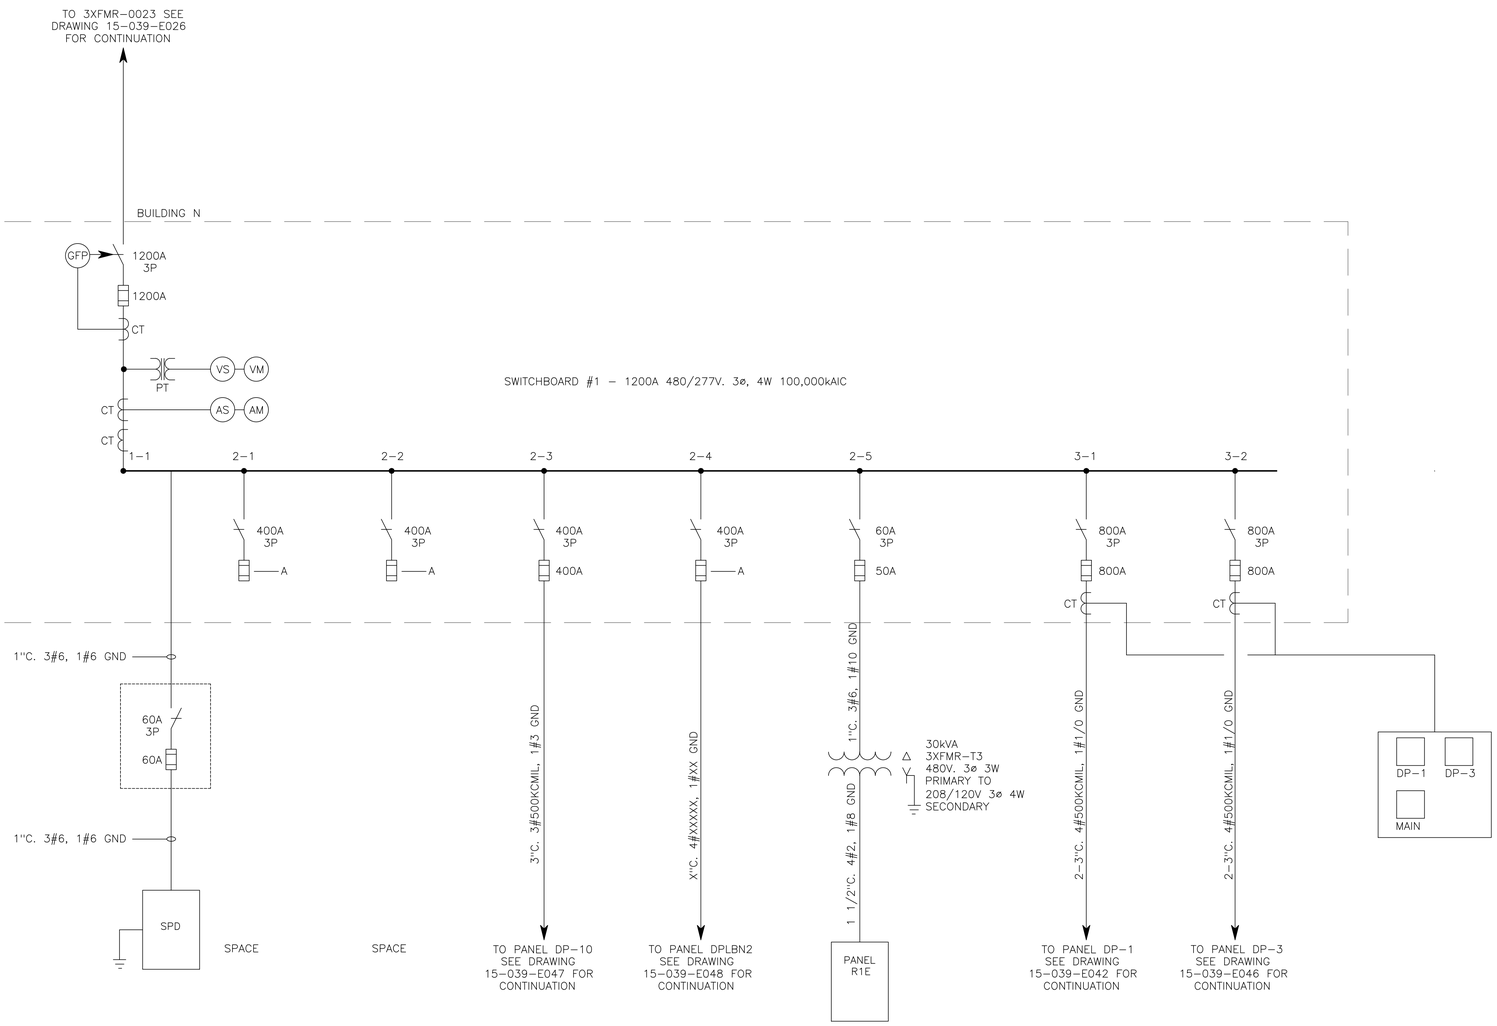

SWBD #2 ONE LINE DIAGRAM

NOT TO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATE VIA FIELD OBSERVATION	SN	11-01-22
1	ISSUED FOR ELM 5-7592	CK	12-17-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

DEPARTMENT FOR REVIEW	DESIGN APPROVALS INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: **CHEROKEE OVERHEAD ELECTRICAL SERVICES**
SERVICE TRANSFORMER 3XFMR-0023
3XFMR-0023 ONE LINE DIAGRAM

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN: RCE SCALE: NOTED DATE: 04-30-15

CHECKED: CK APPROVED: CK DATE: 05-XX-15

15-039-E041

TO SWBD #1
SEE DRAWING
15-039-E041 FOR
CONTINUATION

BUILDING N

PANEL DP-1 480/277V, 3ø, 4W 800AMP 100,000AIC

MATCHLINE SEE BELOW
LEFT FOR CONTINUATION

1	2	3	4	5	6	7	8	9	10	11	12	14	13	15	16	17
600A 3P 450A	400A 3P 400A	100A 3P 100A	100A 3P 100A	100A 3P 100A	100A 3P 100A	100A 3P 80A	60A 3P 40A	60A 3P 40A	60A 3P 40A	60A 3P 60A	30A 3P 9A	30A 3P 9A	30A 3P 9A	30A 3P 25A	30A 3P 9A	30A 3P 9A
2-2"C. 3#4/0, 1#2 GND	3 1/2"C. 4#500kCMIL, 1#3 GND	1 1/4"C. 4#2, 1#8 GND	2-1 1/4"C. 4#2, 1#8 GND	1 1/2"C. 4#2, 1#8 GND	1 1/2"C. 4#2, 1#8 GND	1"C. 3#4, 1#8 GND	3/4"C. 3#8, 1#10 GND	3/4"C. 3#8, 1#10 GND		1"C. 3#6, #10 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#10, #10 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND
300kVA 3XFMR-0002 480V. 3ø 3W PRIMARY TO 208/120V 3ø 4W SECONDARY				PANEL L1A	PANEL L2A	ELEVATOR CENTER	60A 3P CONT	60A 3P CONT		60A 3P NEMA SIZE 2	30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1
3-3"C. 4#300kCMIL, 1#1/0 GND							3/4"C. 3#6, 1#10 GND	3/4"C. 3#6, 1#10 GND		1"C. 3#6, #10 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND				
TO PANEL DP-2 SEE DRAWING 15-039-E043 FOR CONTINUATION	TO PANEL GSL-1 SEE DRAWING 15-039-E044 FOR CONTINUATION	TO PANEL PP-1 SEE DRAWING 15-039-E045 FOR CONTINUATION	TO PANEL PP-2 SEE DRAWING 15-039-E045 FOR CONTINUATION				DH-1	DH-2	SPARE	MOTOR #1 / MOTOR #2 / MOTOR #3 / MOTOR #4 / MOTOR #5 / MOTOR #6 AHE-1	MOTOR #1 / MOTOR #2 AHU-1	MOTOR #1 / MOTOR #2 AHU-2	MOTOR #1 / MOTOR #2 AHU-3	MOTOR #1 / MOTOR #2 / MOTOR #3 AHU-4	MOTOR #1 / MOTOR #2 AHU-5	MOTOR #1 / MOTOR #2 AHU-6

MATCHLINE SEE ABOVE
RIGHT FOR CONTINUATION

18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34
30A 3P 9A	30A 3P 9A	30A 3P 9A	30A 3P 9A	30A 3P 9A	30A 3P 25A	30A 3P --A	30A 3P --A	30A 3P 20A	30A 3P 30A	30A 3P --A	30A 3P --A	30A 3P --A	30A 3P --A	60A 3P 60A	200A 3P 125A	30A 3P --A
3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND						3/4"C. 3#12, #12 GND	3/4"C. 3#10, #10 GND					45kVA 3XFMR-____ 480V. 3ø 3W PRIMARY TO 208/120V 3ø 4W SECONDARY	1 1/2"C. 3#1, 1#8 GND	
30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1	30A 3P NEMA SIZE 1						30A 3P 20A NEMA SIZE 1	30A 3P NEMA SIZE 2					1"C. 3#6, 1#10 GND		
3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND	3/4"C. 3#12, #12 GND						3/4"C. 3#12, #12 GND	3/4"C. 3#10, #10 GND					200A 3P 150A		
														2"C. 4#1/0, 1#6 GND		
														PANEL 3PAN-0053		
MOTOR #1 / MOTOR #2 AHU-7	MOTOR #1 / MOTOR #2 AHU-11	MOTOR #1 / MOTOR #2 AHU-12	SPARE	SPARE	SPARE	SPARE	SPARE	DF-1	MOTOR #1 / MOTOR #2 CLC-2	HEATER	SPARE	SPARE	SPARE	SPARE	TO 3GEN-0015-ATS02 FOR CONTINUATION SEE DRAWING 15-039-E064	SPARE

1 DP-1 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATED CONNECTION TO 3PAN-0053	SN	10-06-23
1	UPDATE VIA FIELD OBSERVATION	SN	11-09-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
DP-1 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E042
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss1w0002.D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E042 DP1.dwg
Plotted at 9:43am on Oct 06, 2023 by S118688

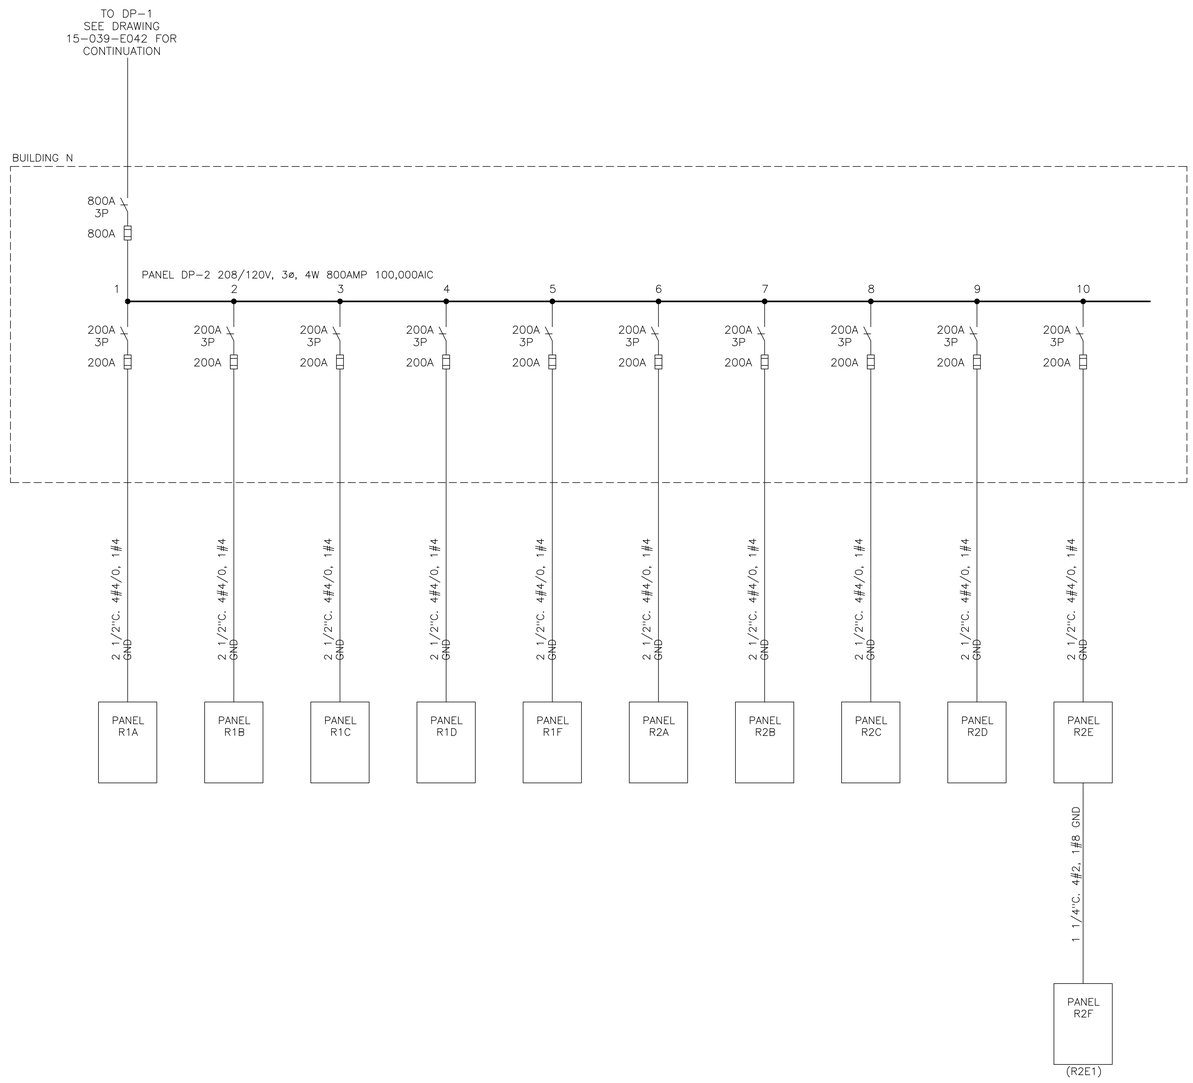

1 DP-2 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
DP-2 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E043
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E043 DP2.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

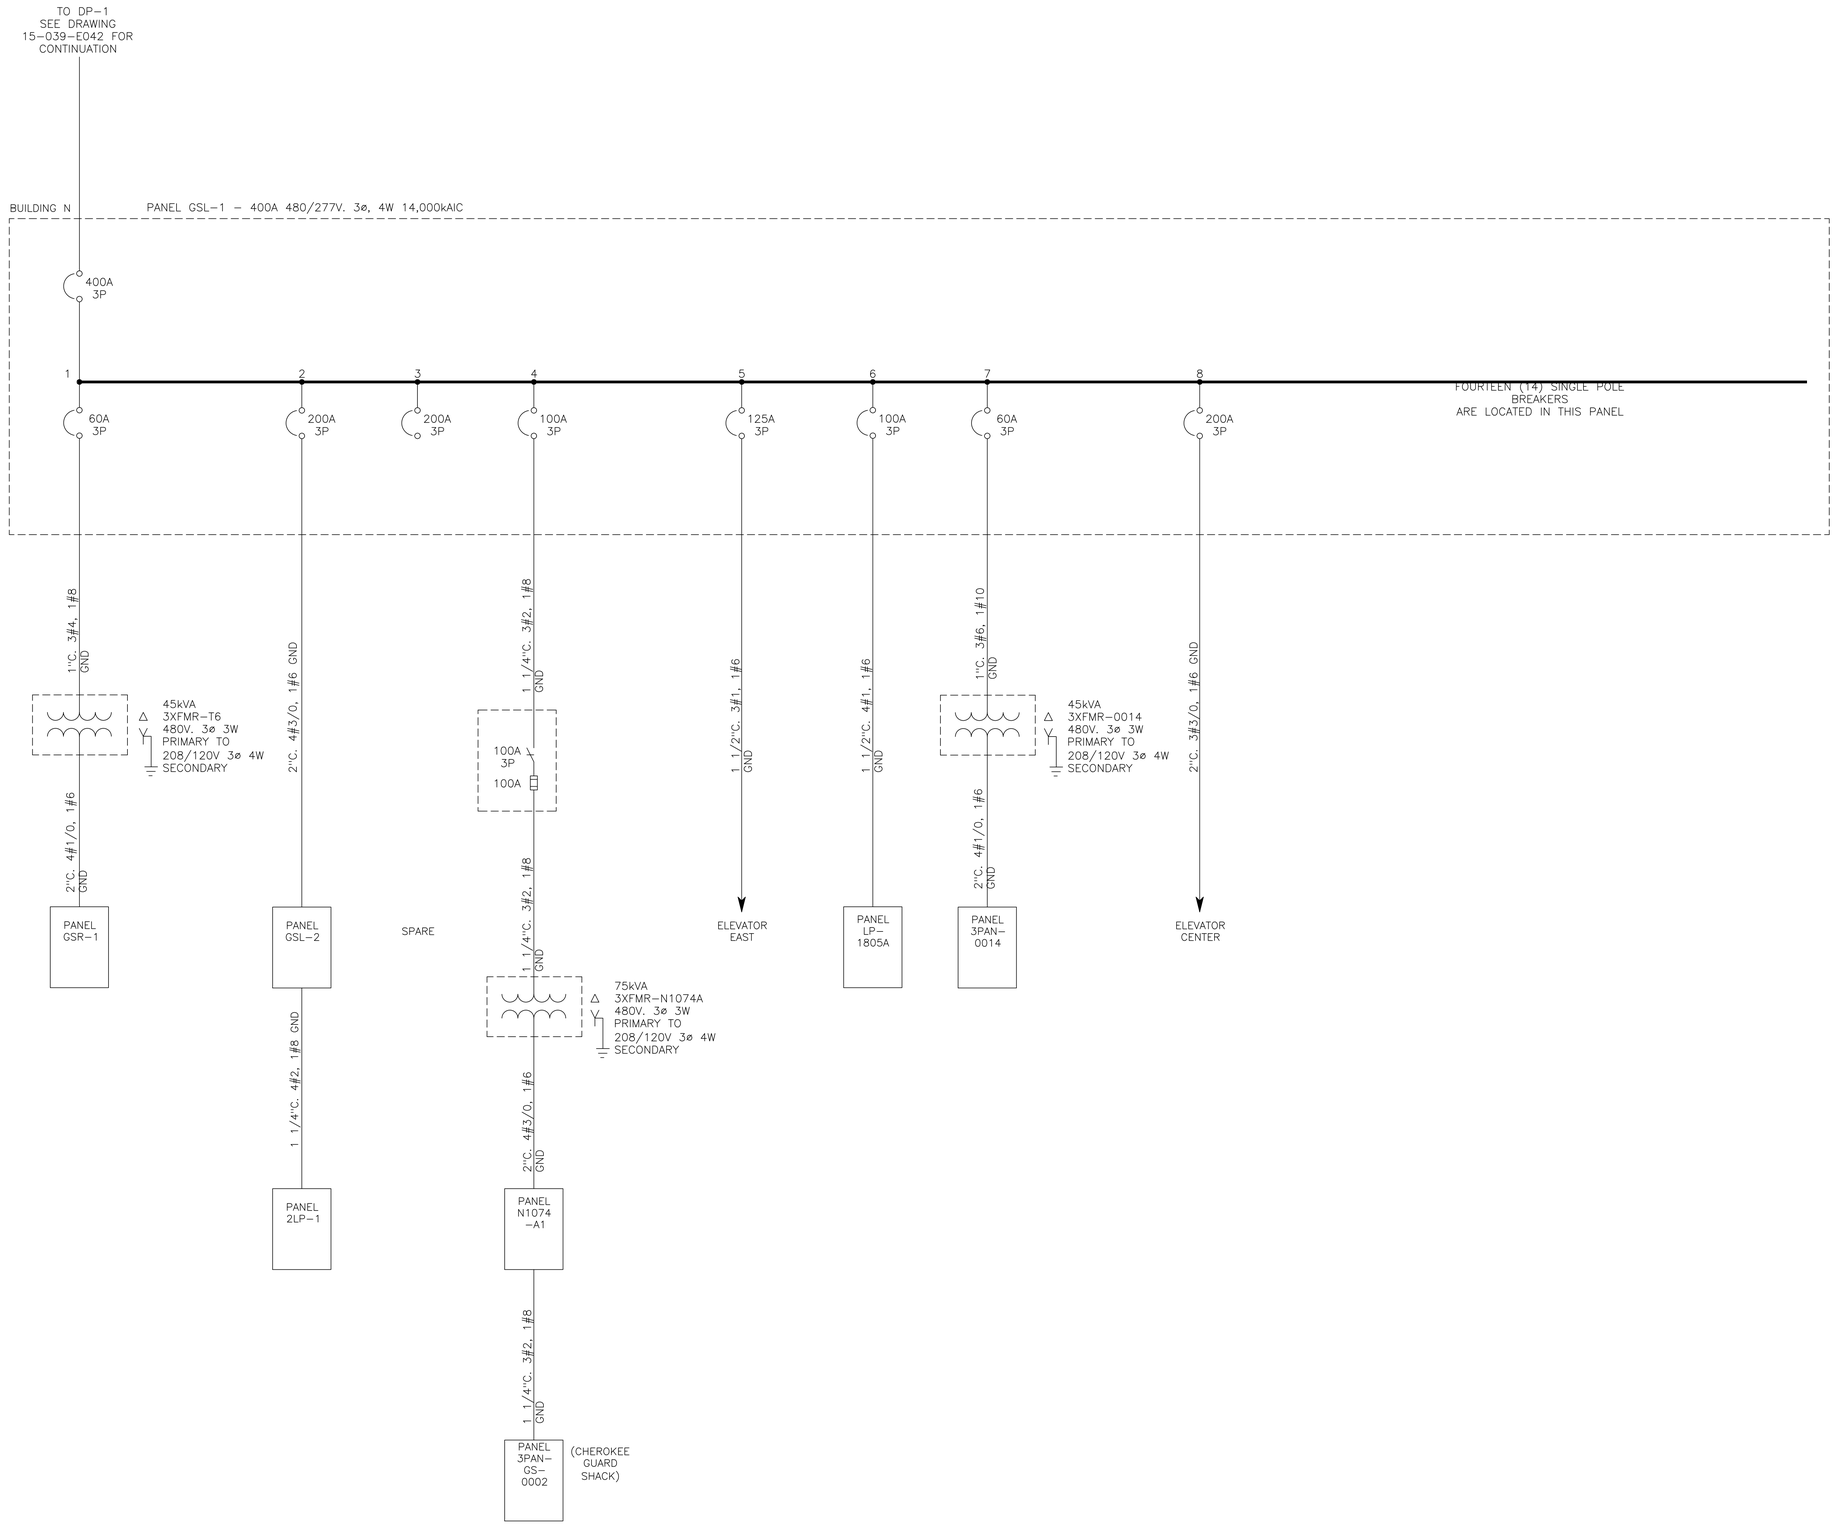

1 GSL-1 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
GSL-1 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN:	RCE	DATE: 04-30-15	DWG NO: 15-039-E044
	APPROVED:	CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E044 GSL1.dwg
Plotted at 10:21am on Dec 05, 2022 by S118688

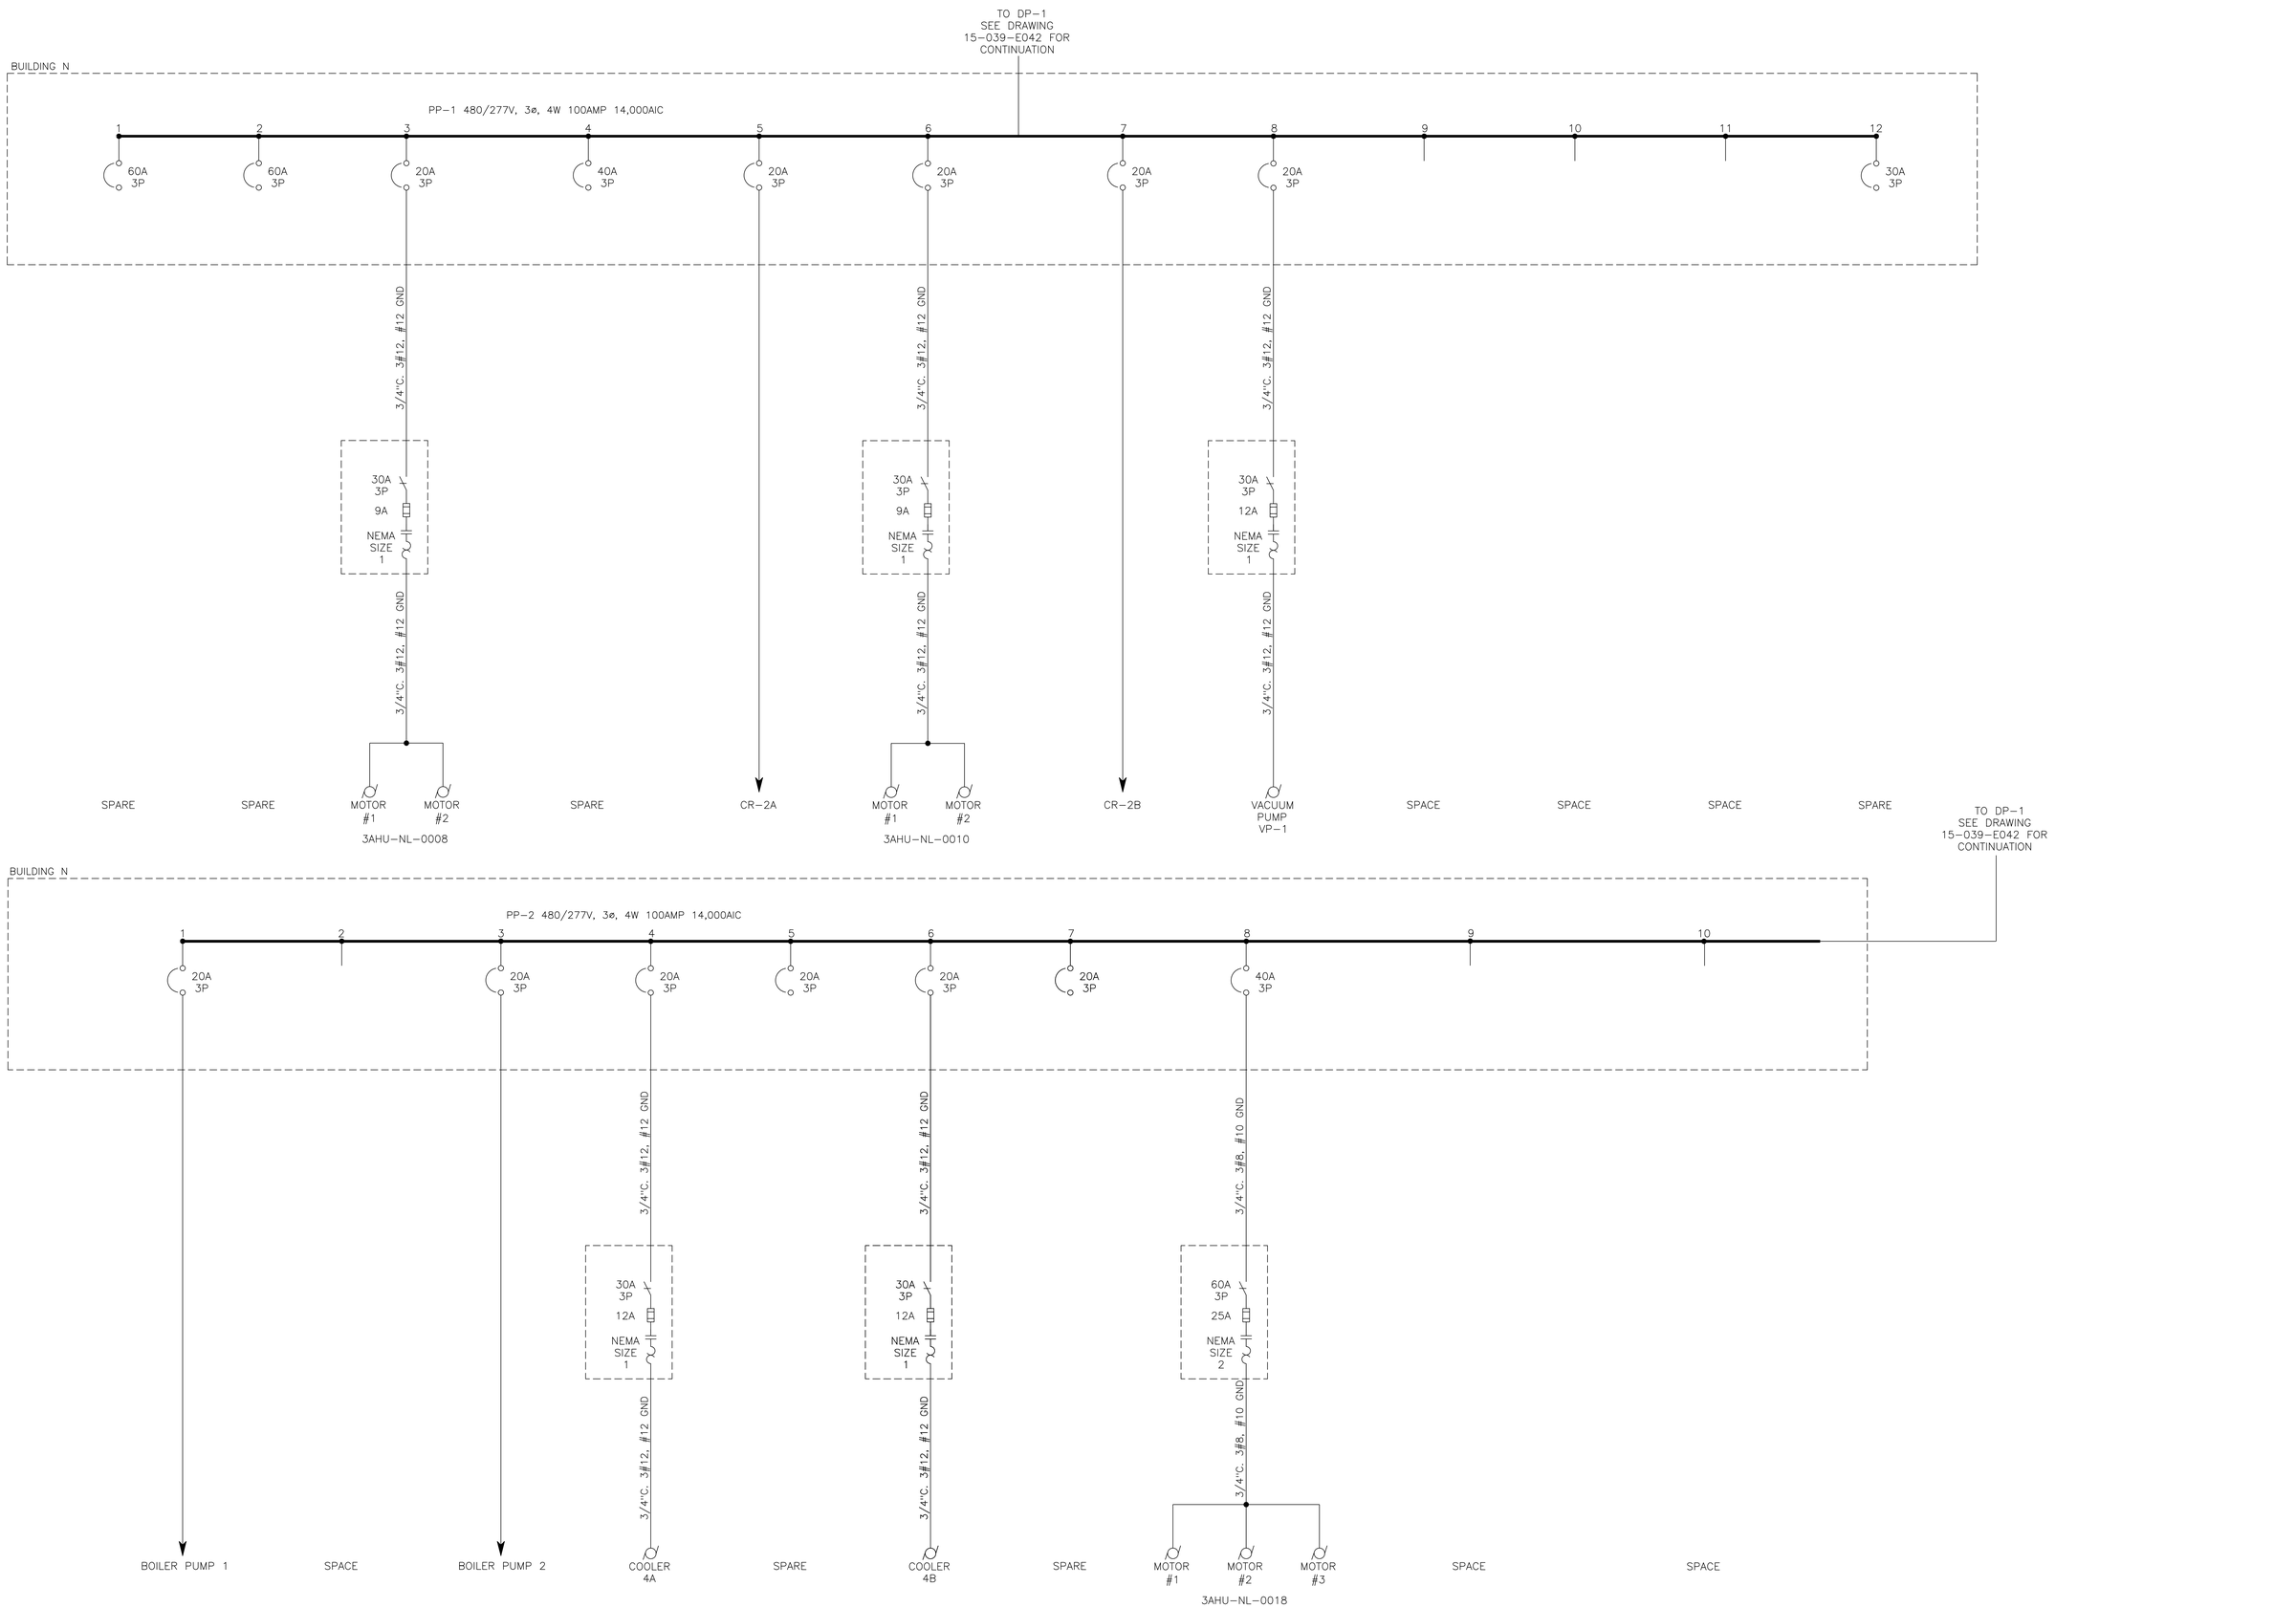

1 PP-1/PP-2 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
PP-1/PP-2 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E045

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E045 PP1-PP2.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

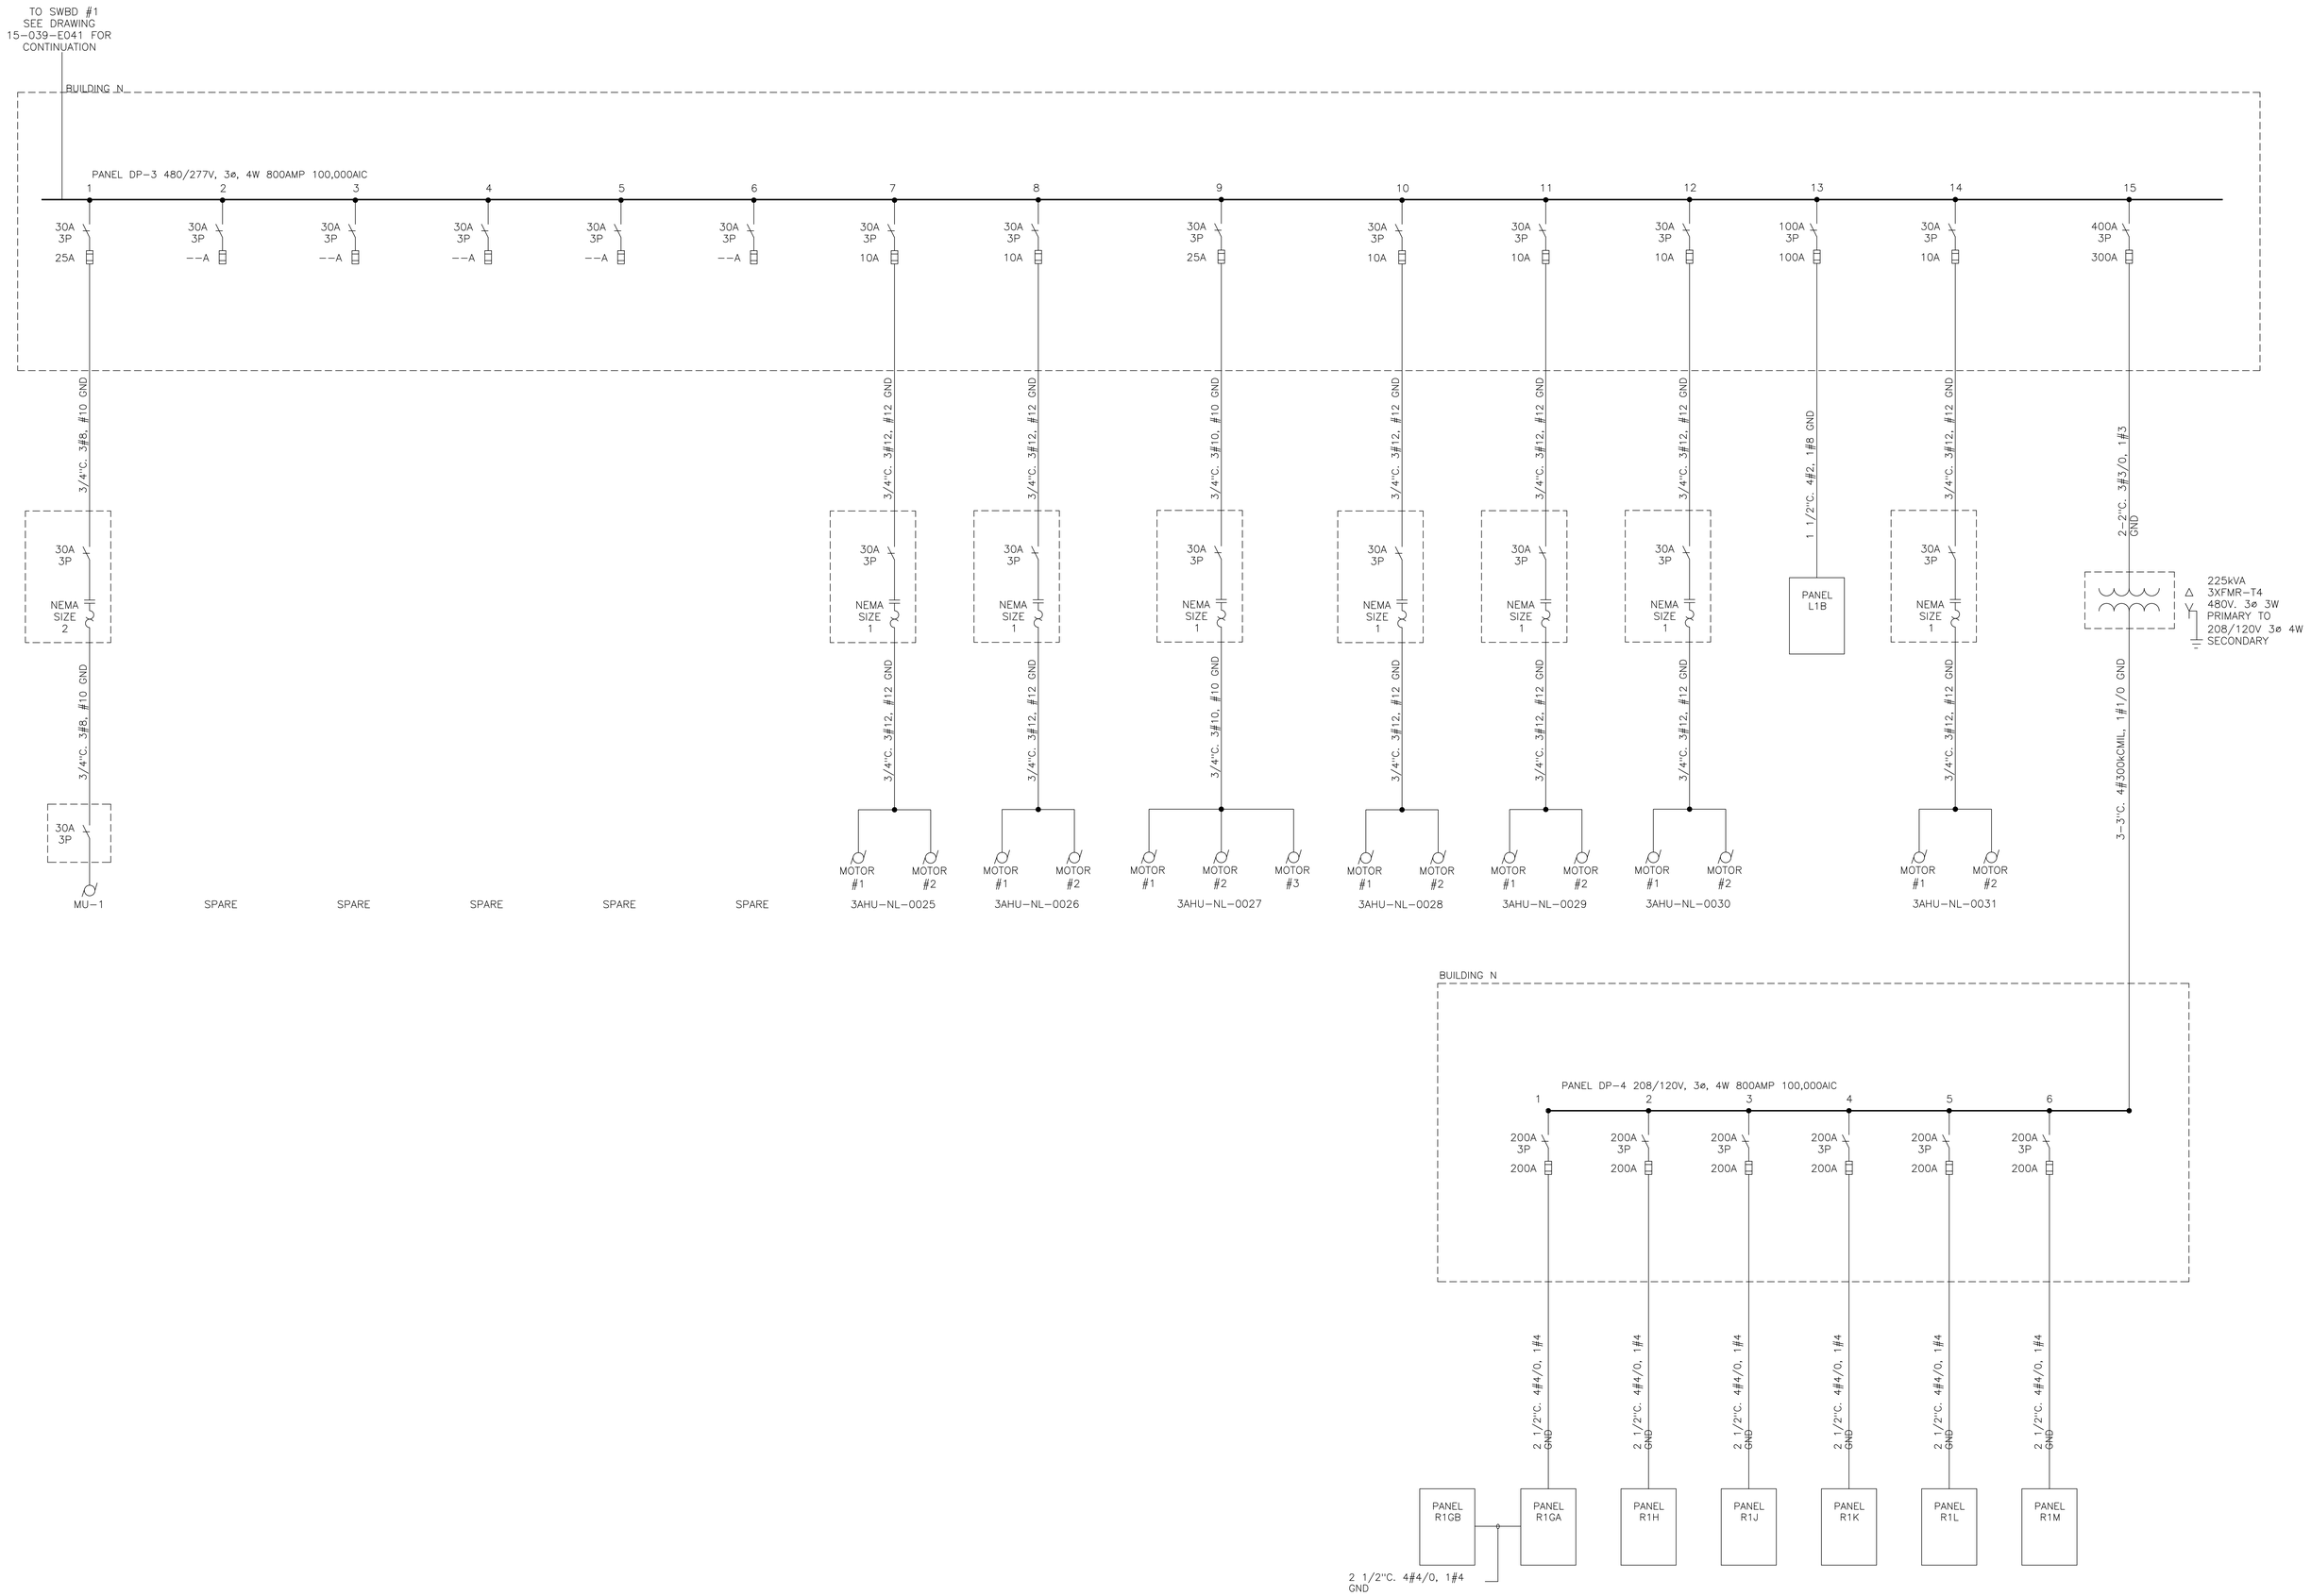

1 DP-3/DP-4 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
DP-3/DP-4 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE:	DRAWN:	RCE	DATE:	04-30-15	DWG NO:
1/8"=1'0" WHEN PLOTTED ANSI E	APPROVED:	CK	DATE:	05-31-15	15-039-E046

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E046 DP3-DP4.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

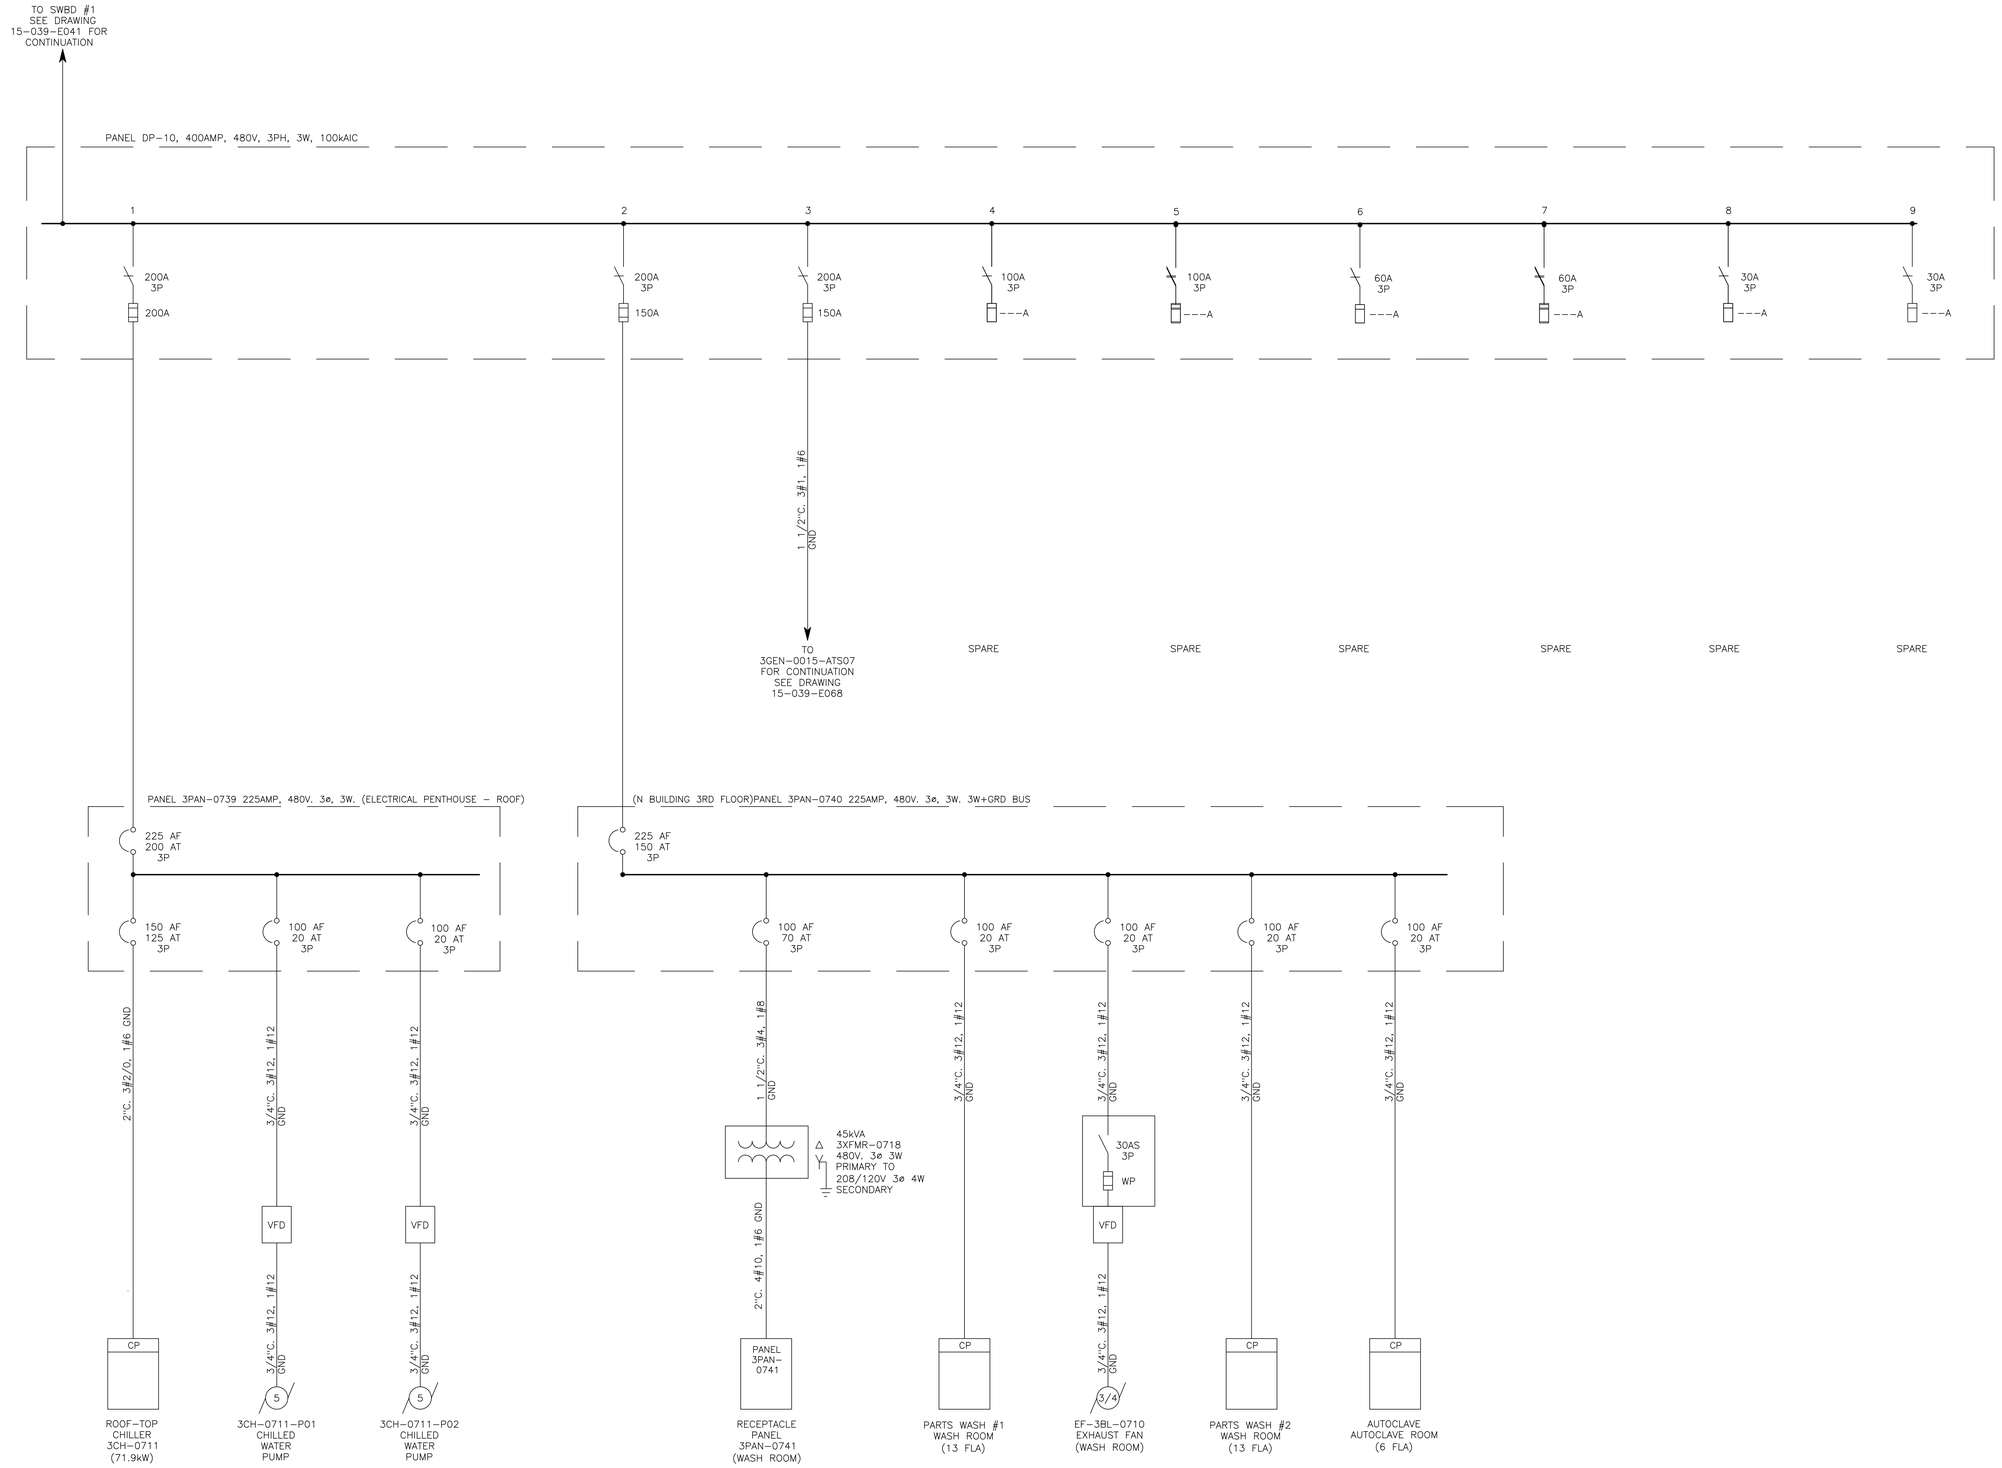

1 DP-10 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	UPDATE VIA FIELD OBSERVATION	SN	11-09-22
2	PER ECM 2386669	BB	06-05-20
1	ISSUED FOR BIDDING PROJECT 19-XXXX	CK	10-28-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
DP-10 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: NONE WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E047

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E047 DP-10.dwg
Plotted at 10:22am on Dec 05, 2022 by S118688

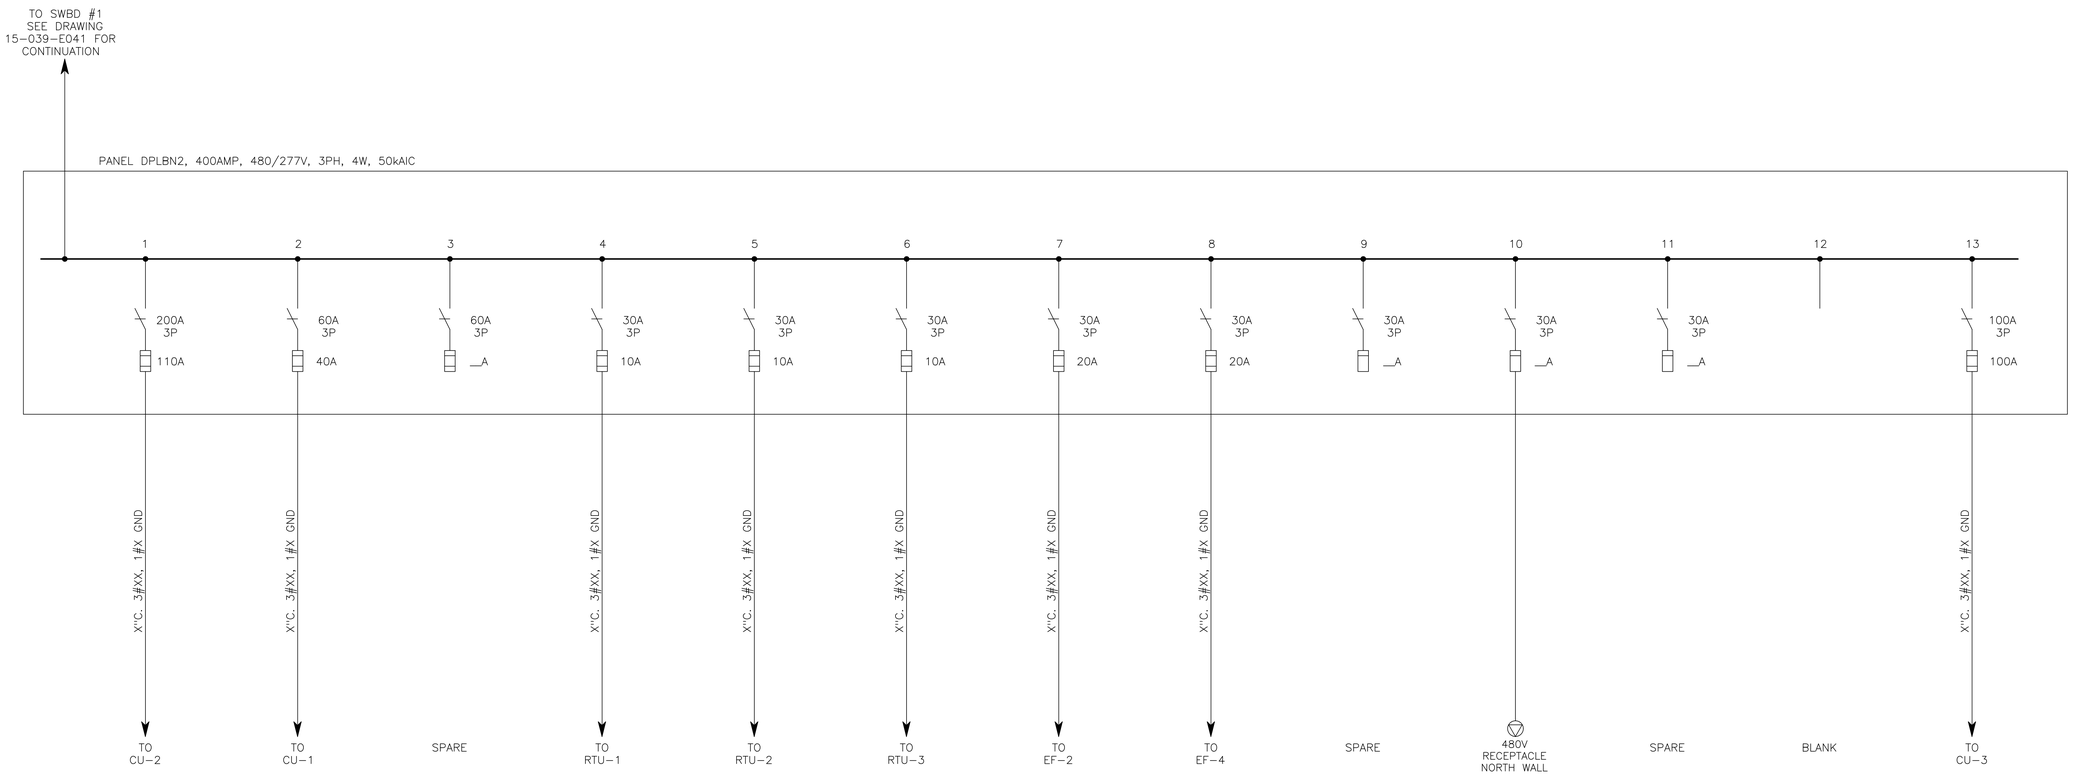

1 DPLBN2 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	12-16-19

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
DPLBN2 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 12-16-19	DWG NO: 15-039-E048
	APPROVED: CK	DATE: 12-16-19	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E048 DP-LBN2.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E049
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E049_FUTURE.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0023
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E050
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E050 FUTURE.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

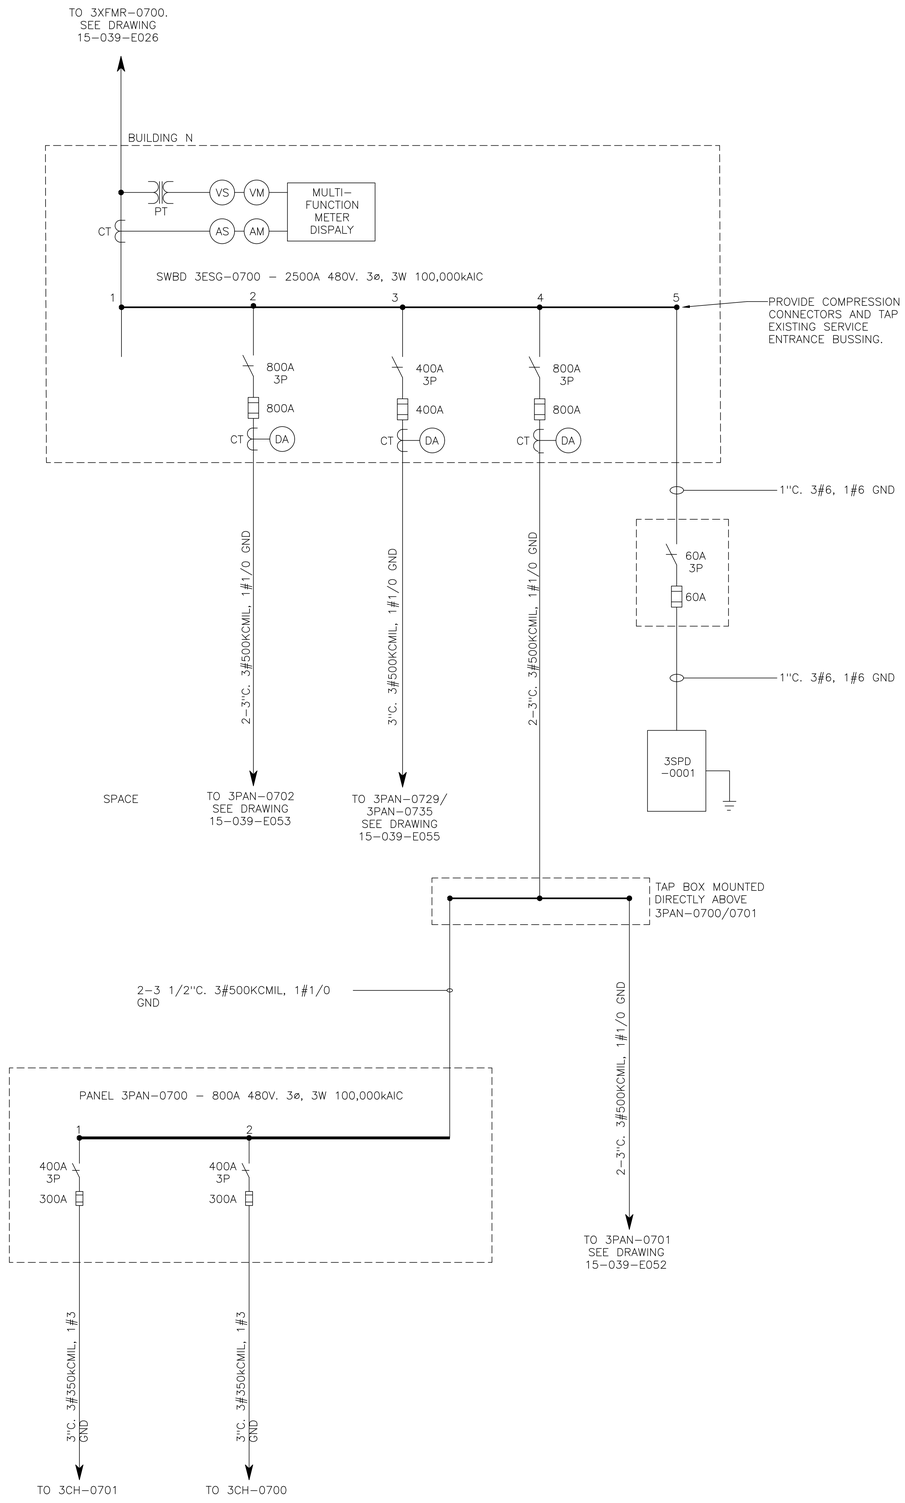

1 3ESG-0700 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATE VIA FIELD OBSERVATION	SN	11-01-22
1	ADD SURGE SUPRESSION AT 3ESG-0700	CK	06-28-18
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
3ESG-0700 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E051
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E051 3ESG-0700.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

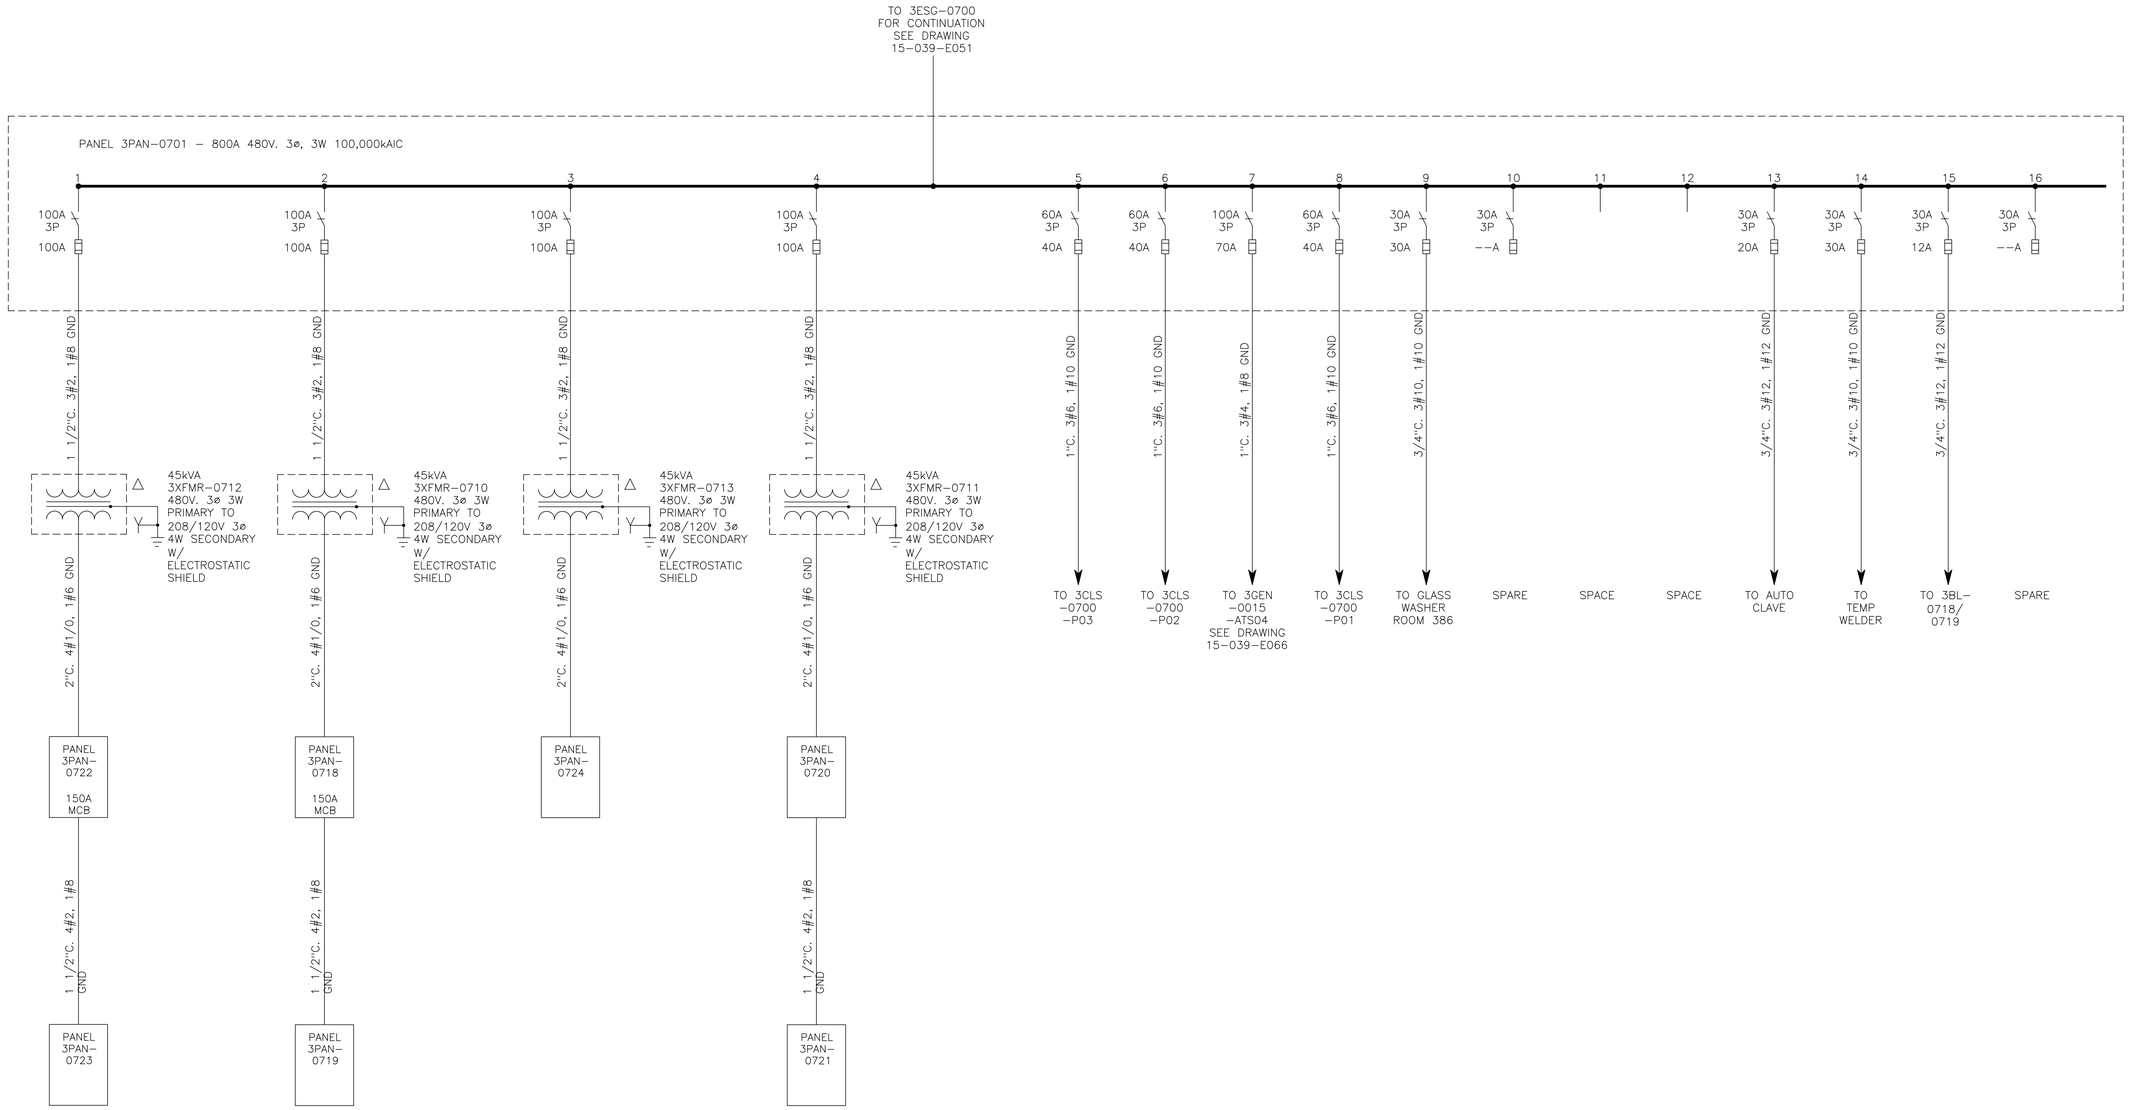

1 3PAN-0701 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATED VIA FIELD OBSERVATION	SN	11-15-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
3PAN-0701 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E052

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E052 3PAN-0701.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

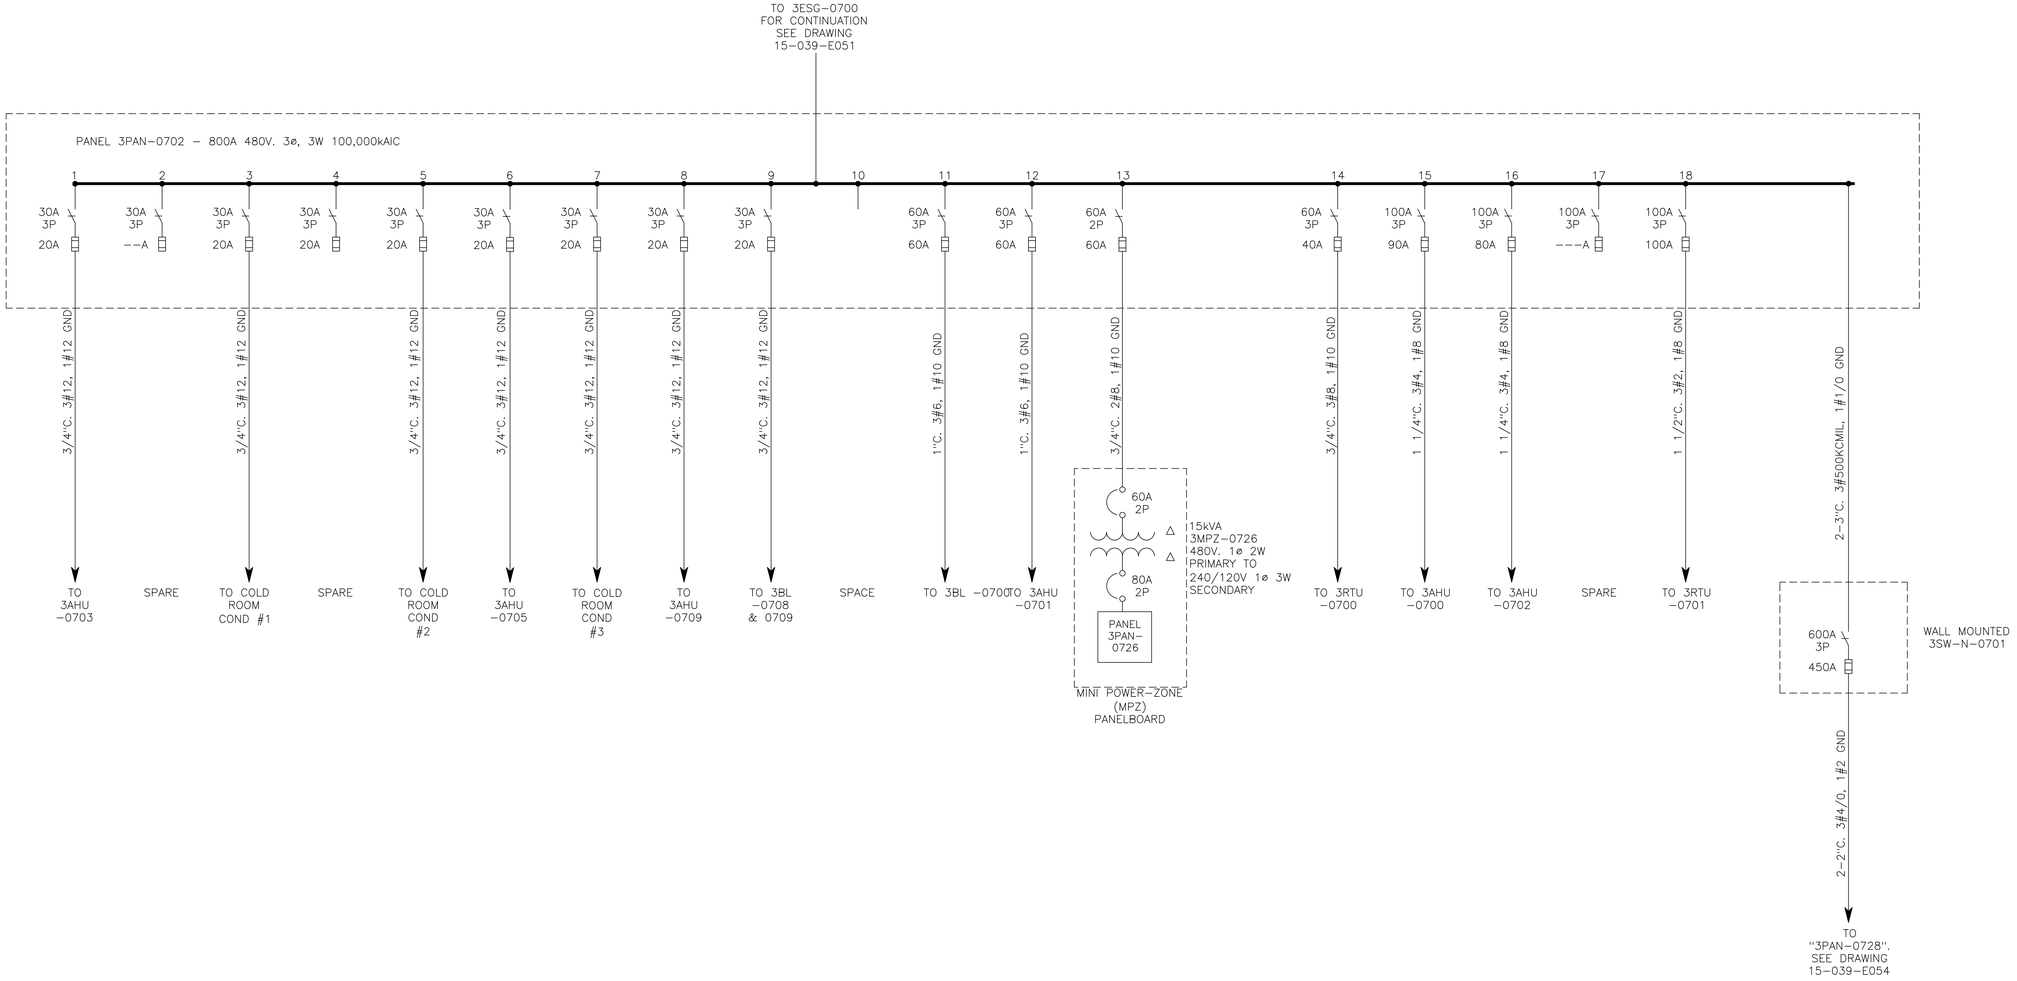

1 3PAN-0702 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
3PAN-0702 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E053
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E053 3PAN-0702.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

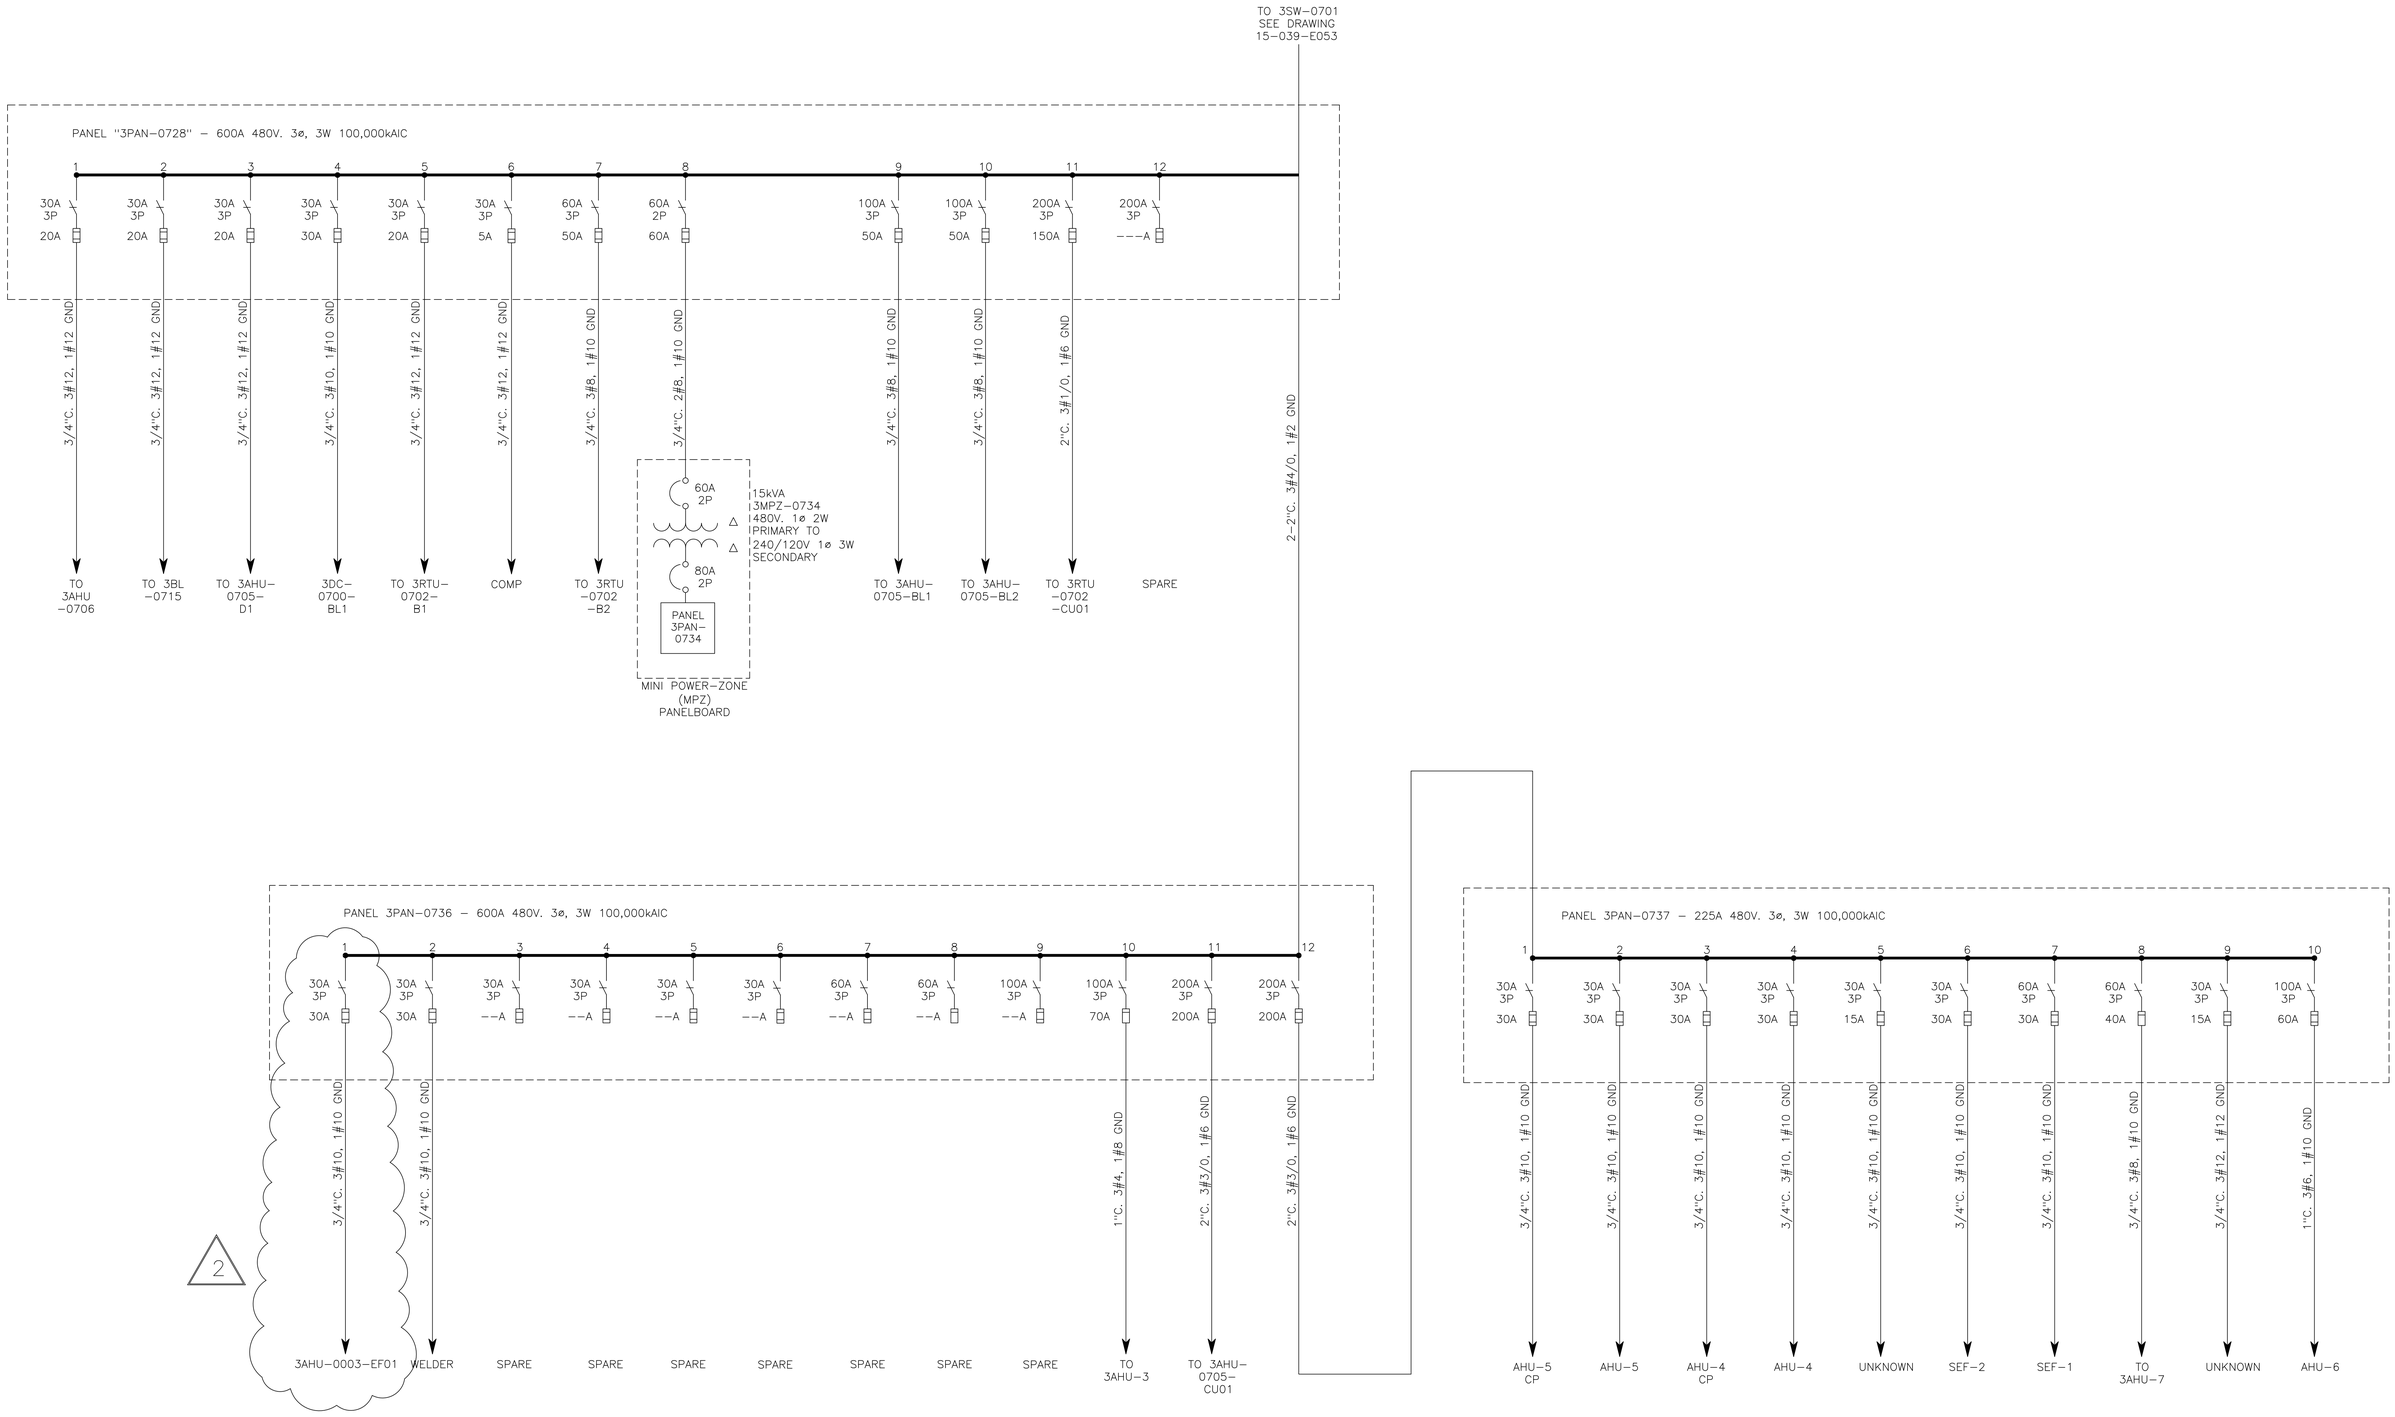

1 **3PAN-0728/0736/0737 ONE LINE DIAGRAM**

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATED VIA CC 4255507	JL	08-27-25
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
3PAN-0728/0736/0737 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E054
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E054 3PAN-0728.dwg
Plotted at 10:29am on Aug 27, 2025 by S118688

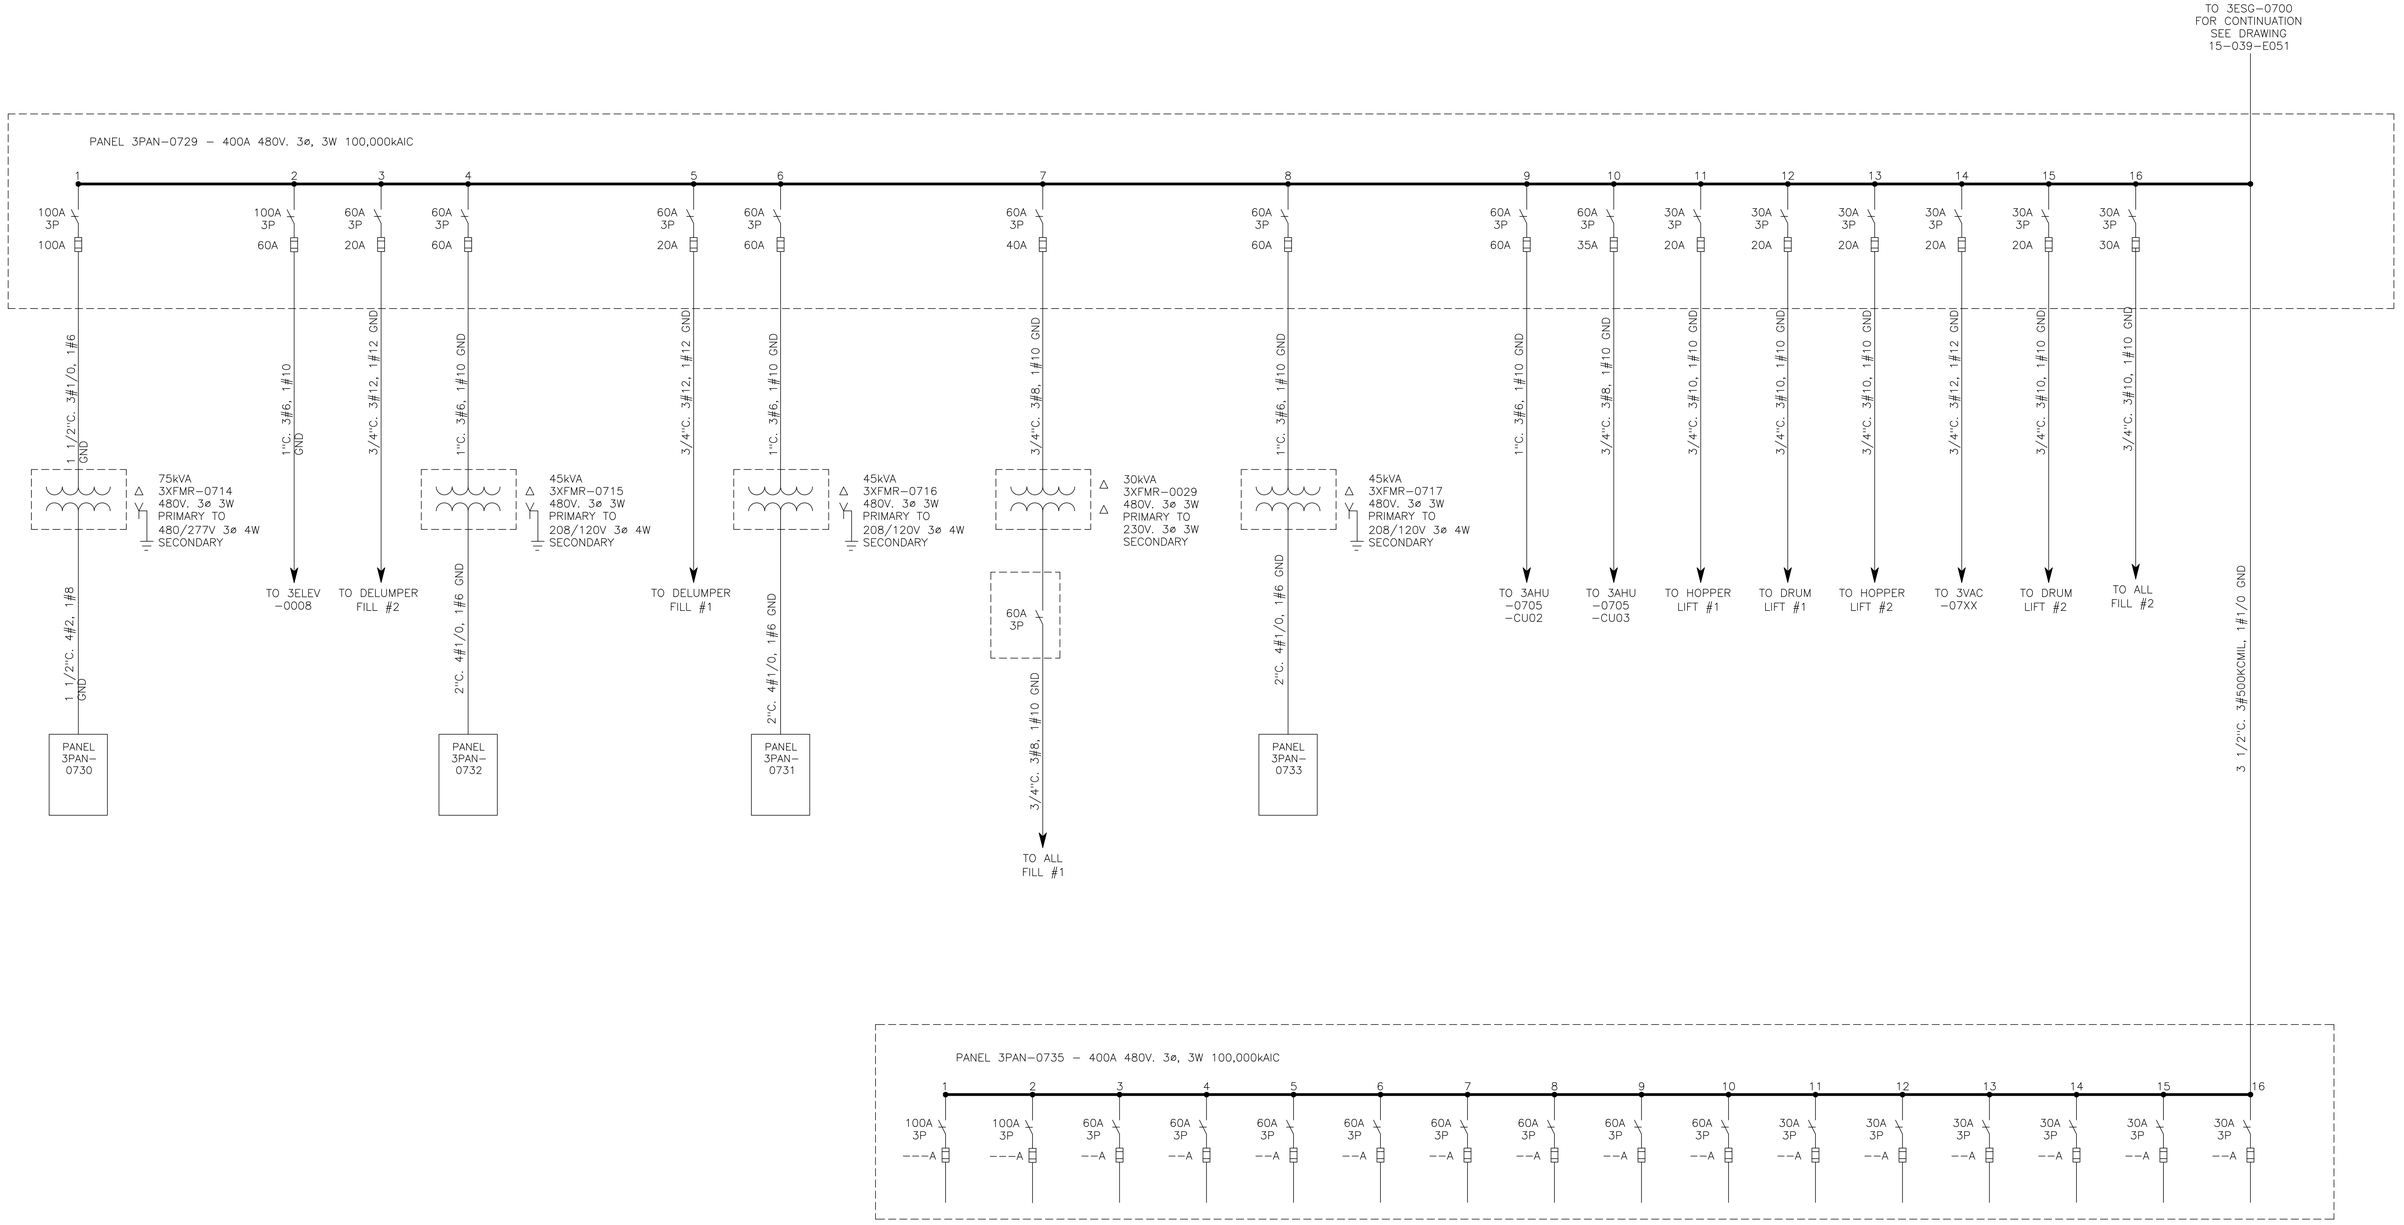

1 3PAN-0729/0735 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
3PAN-0729/0735 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E055
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E055 3PAN-0729.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E056
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E056 FUTURE.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0700
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E057
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E057 FUTURE.dwg
Plotted at 11:23am on Dec 05, 2022 by S118688

REFER TO 15-039-E107 FOR 3SWBD-0008 DETAILS

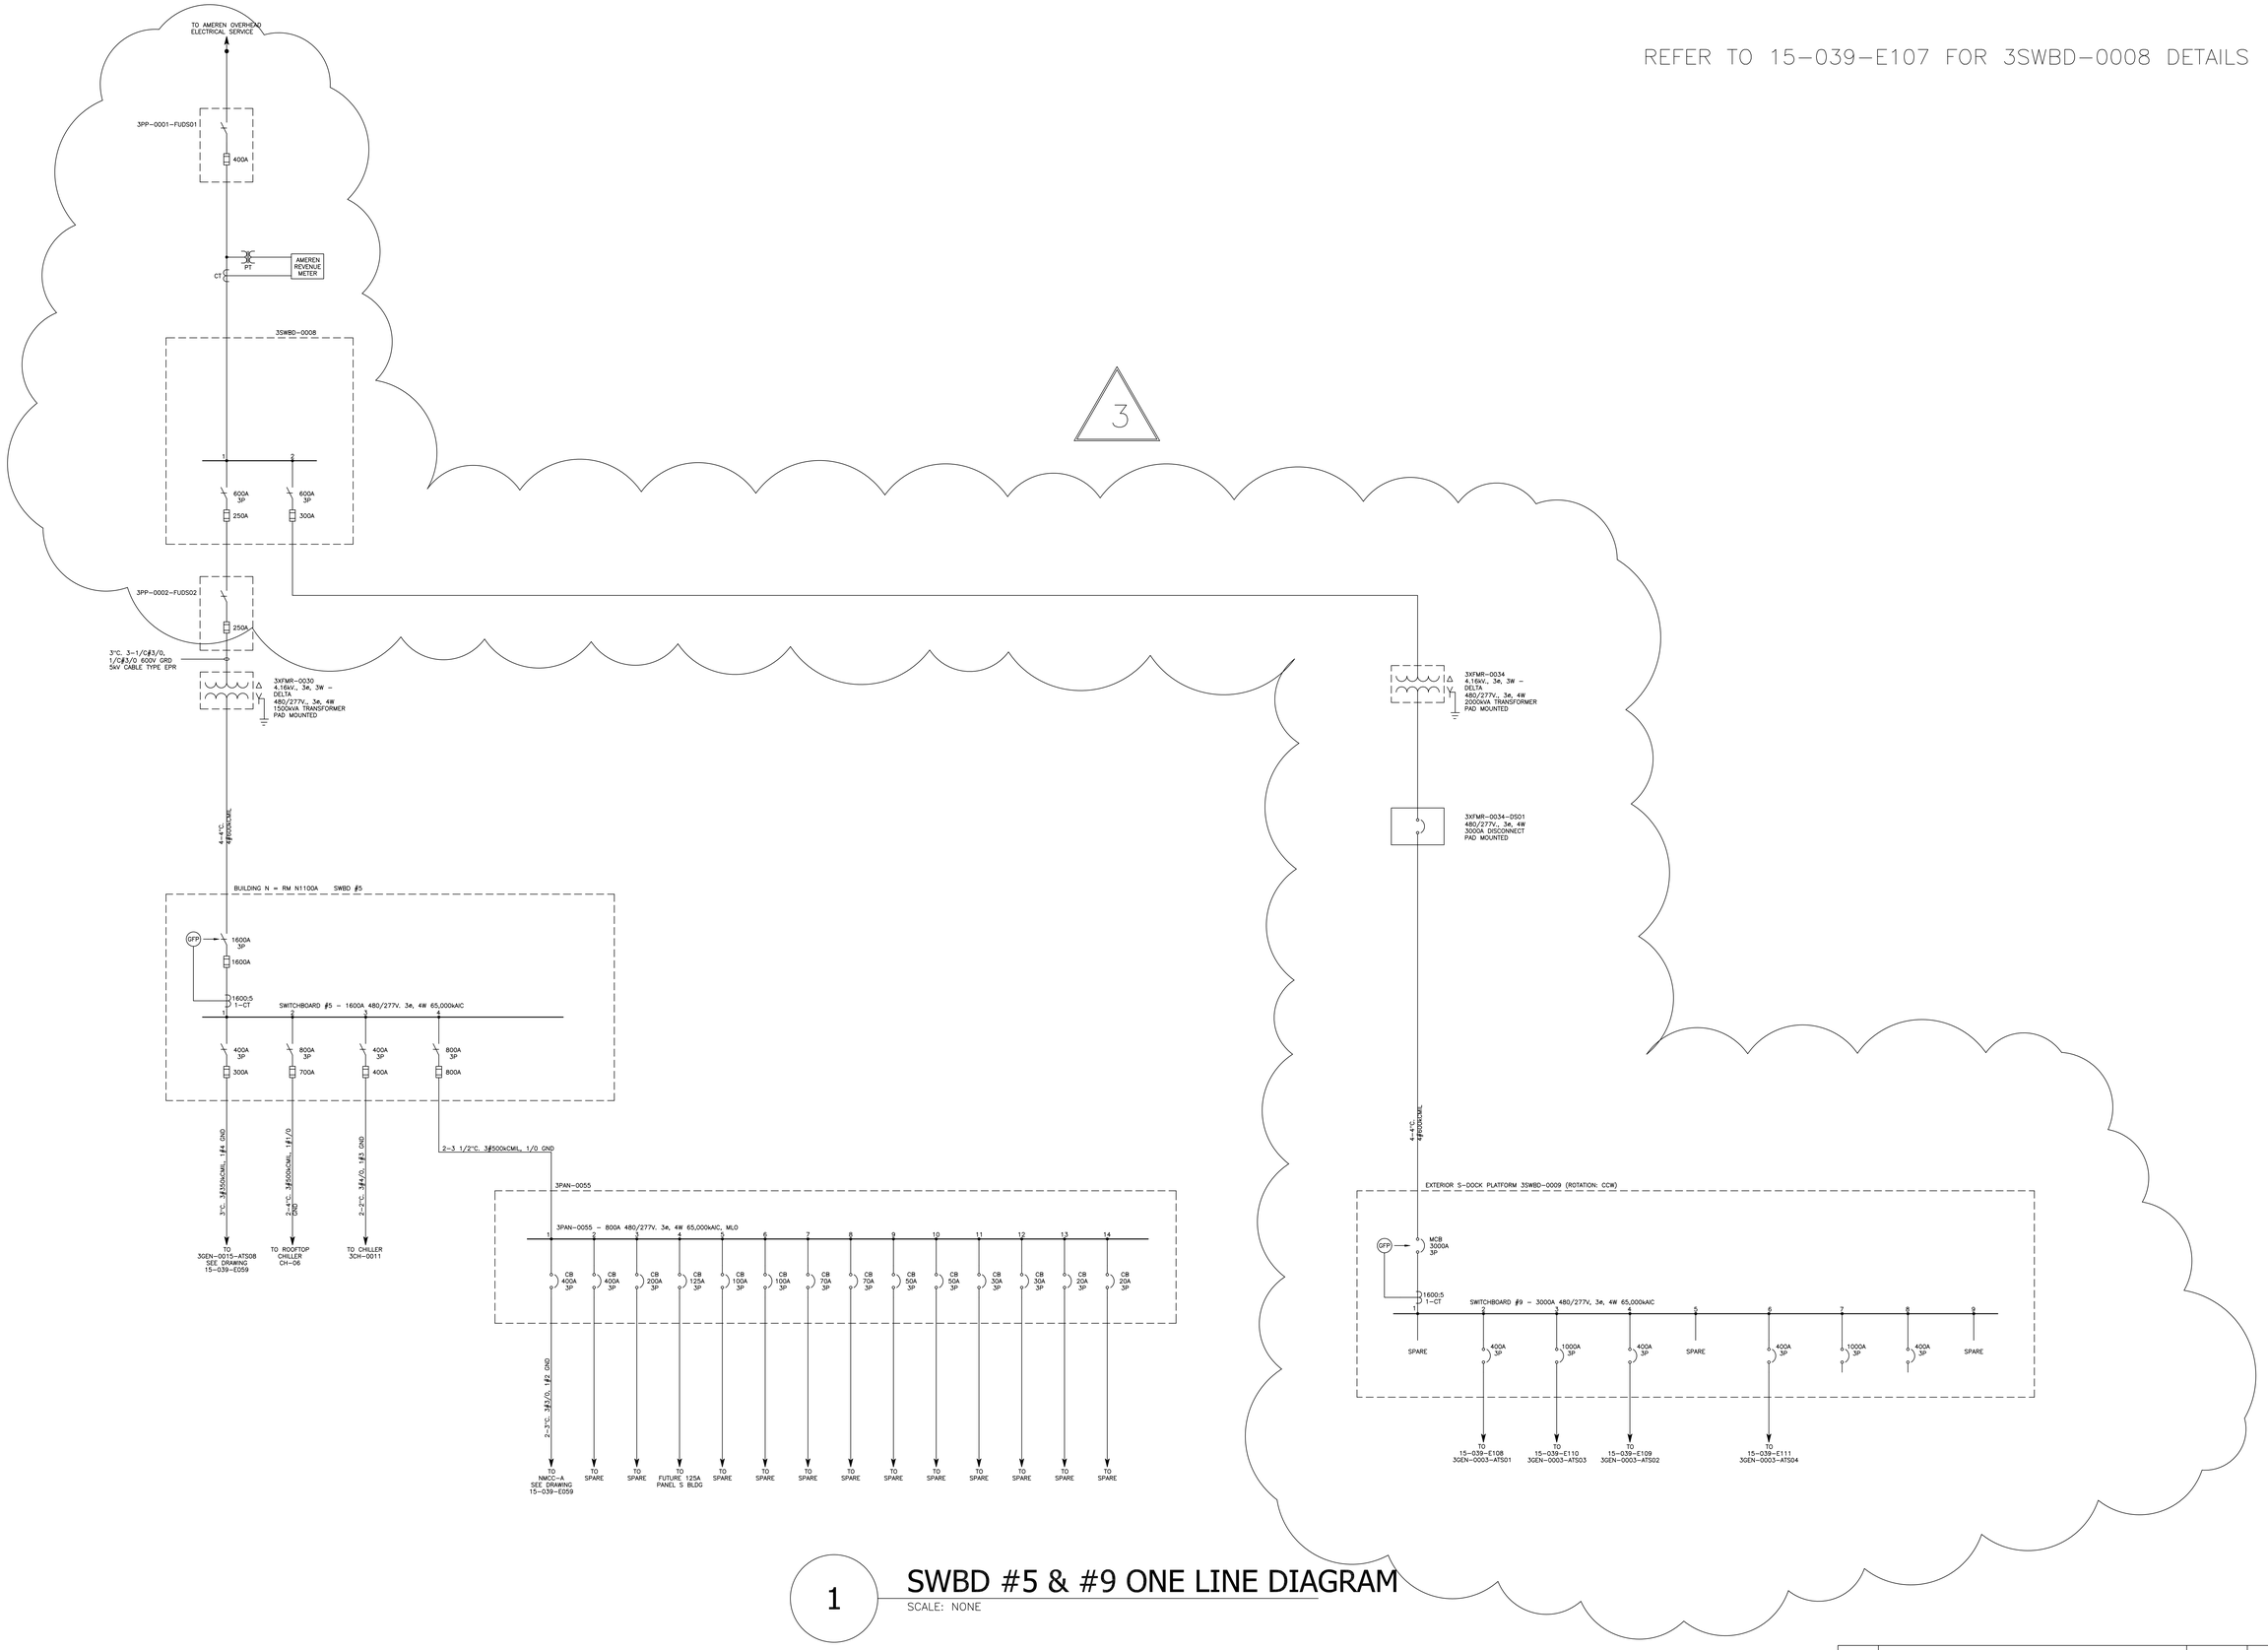

3

1 SWBD #5 & #9 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	UPDATED PER CC 4944226	BS	10-16-25
2	ADDED 3PAN-0055	CAB	12-12-24
1	UPDATE VIA FIELD OBSERVATION	SN	06-07-23
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0030
SWBD #5 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E058

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E058 3XFMR-0030.dwg
Plotted at 8:21am on Dec 02, 2025 by S118688

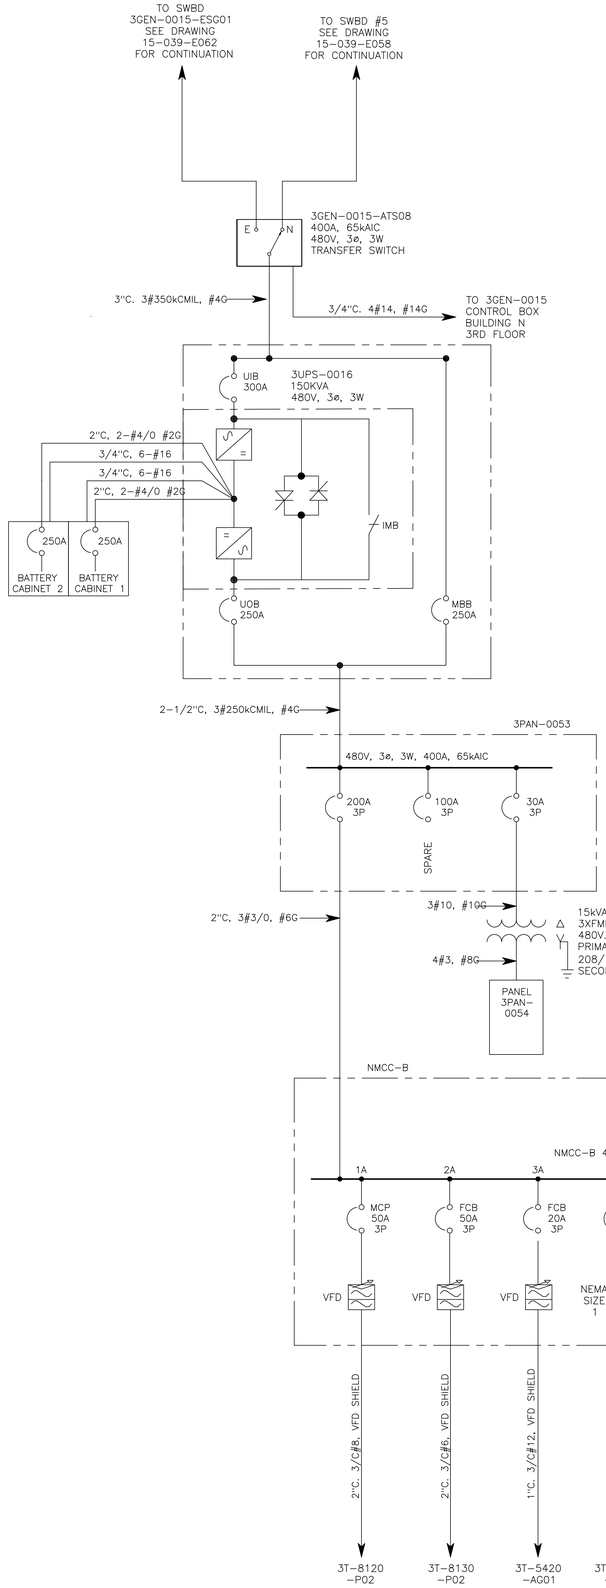

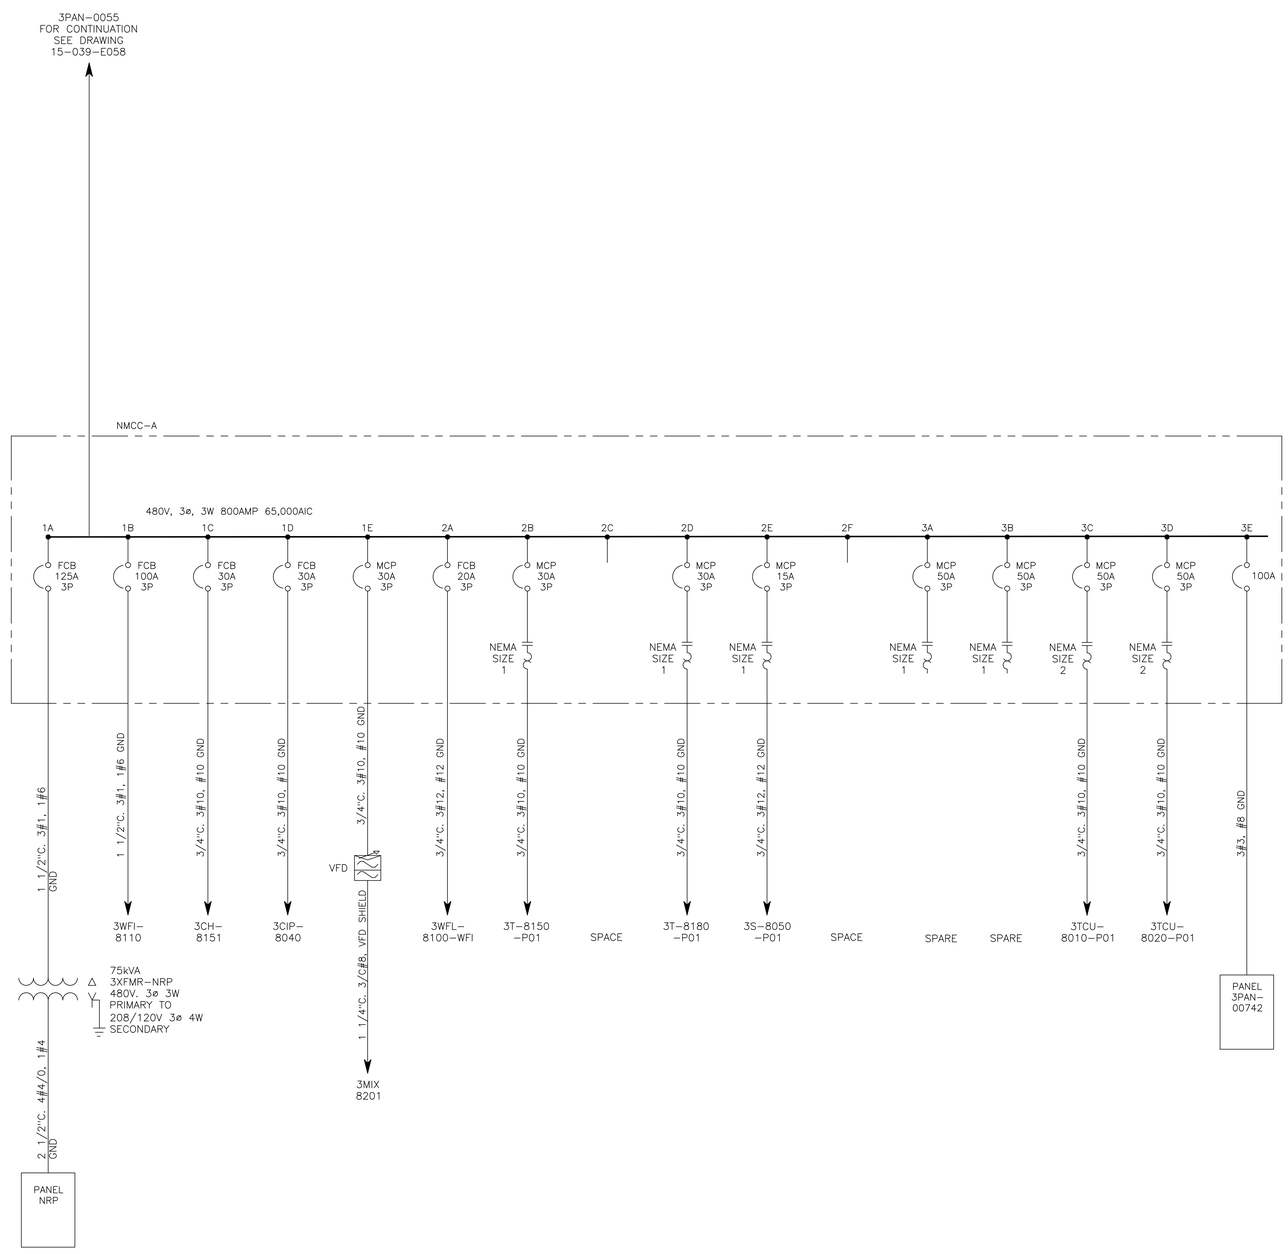

NMCC ONE LINE DIAGRAM

NOT TO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS–BUILT OR AS–RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
4	UPDATED NMCC–A SUPPLY INFORMATION	CAB	12–12–24
3	AS–BUILTS	JLW	06–09–23
2	ISSUED FOR CONSTRUCTION	GWG	12–20–22
B	ADDED PNL–3NUPS–1	GWG	08–10–22
A	N1 EAST UPS BACK–UP TO NMCC–B	GWG	08–05–22
1	PER CC 2651020	CK	11–16–20
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05–31–15

DEPARTMENT FOR REVIEW	DESIGN APPROVALS INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

SIGMA-ALDRICH CORPORATION

TITLE:
CHEROKEE ELECRICAL OVERHEAD SERVICES
BUILDING N SERVICE TRANSFORMER 3XFMR–0030
NMCC ONE LINE DIAGRAM

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN: RCE SCALE: NOTED DATE: 04–30–15

CHECKED: CK APPROVED: CK DATE: 05–XX–15

15-039-E059

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0030
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E060
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E060 FUTURE.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0030
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E061
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E061 FUTURE.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

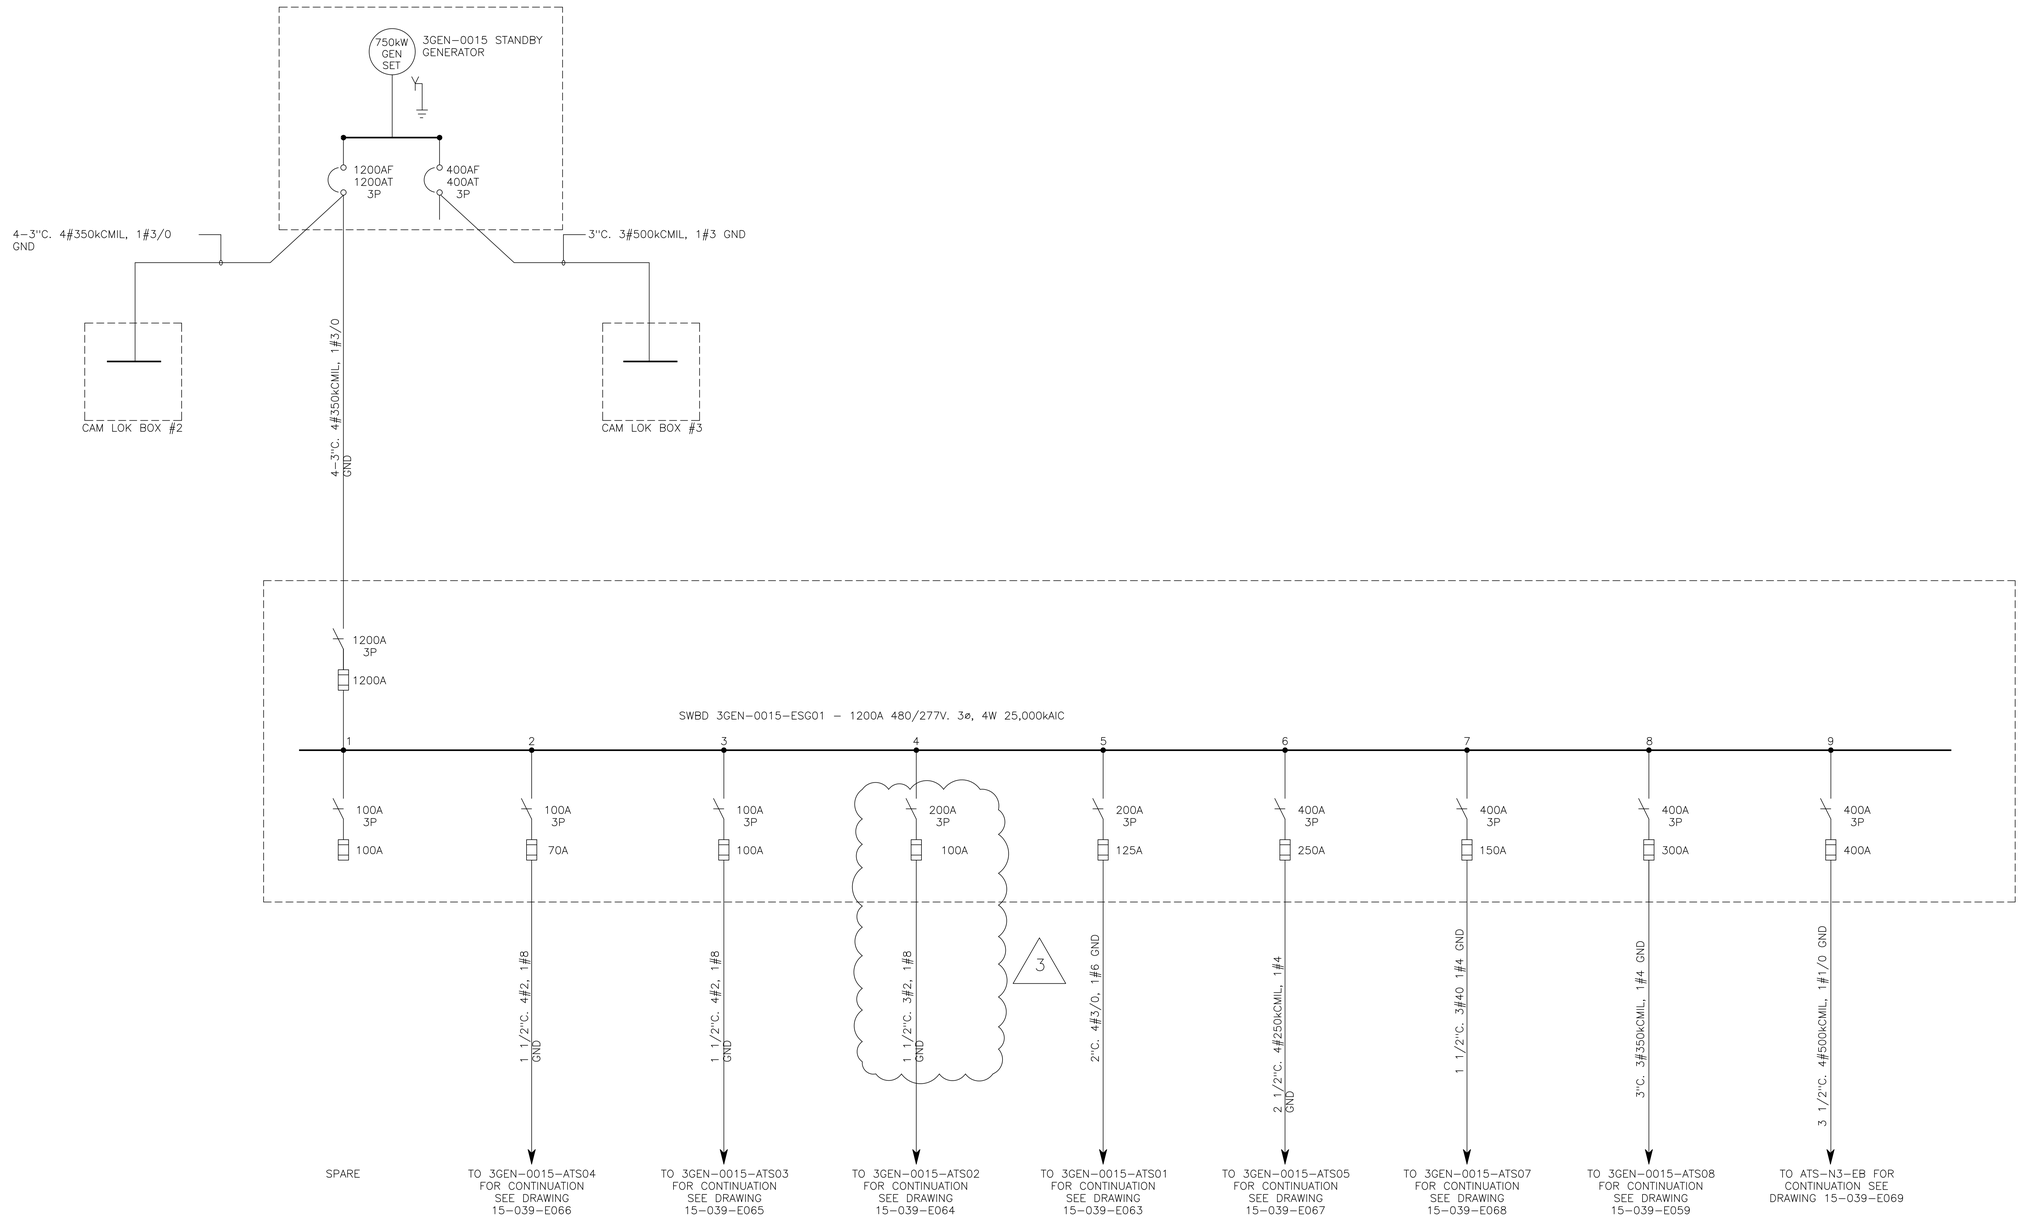

1 3GEN-0015-ESG01 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	Change Control 5080021	JPE	22AUG2025
2	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
1	ISSUED FOR CONSTRUCTION PROJECT 19-2019	CK	08-26-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
3GEN-0015-ESG01 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E062
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E062 3GEN-0015.dwg
Plotted at 12:18pm on Jan 05, 2026 by S118688

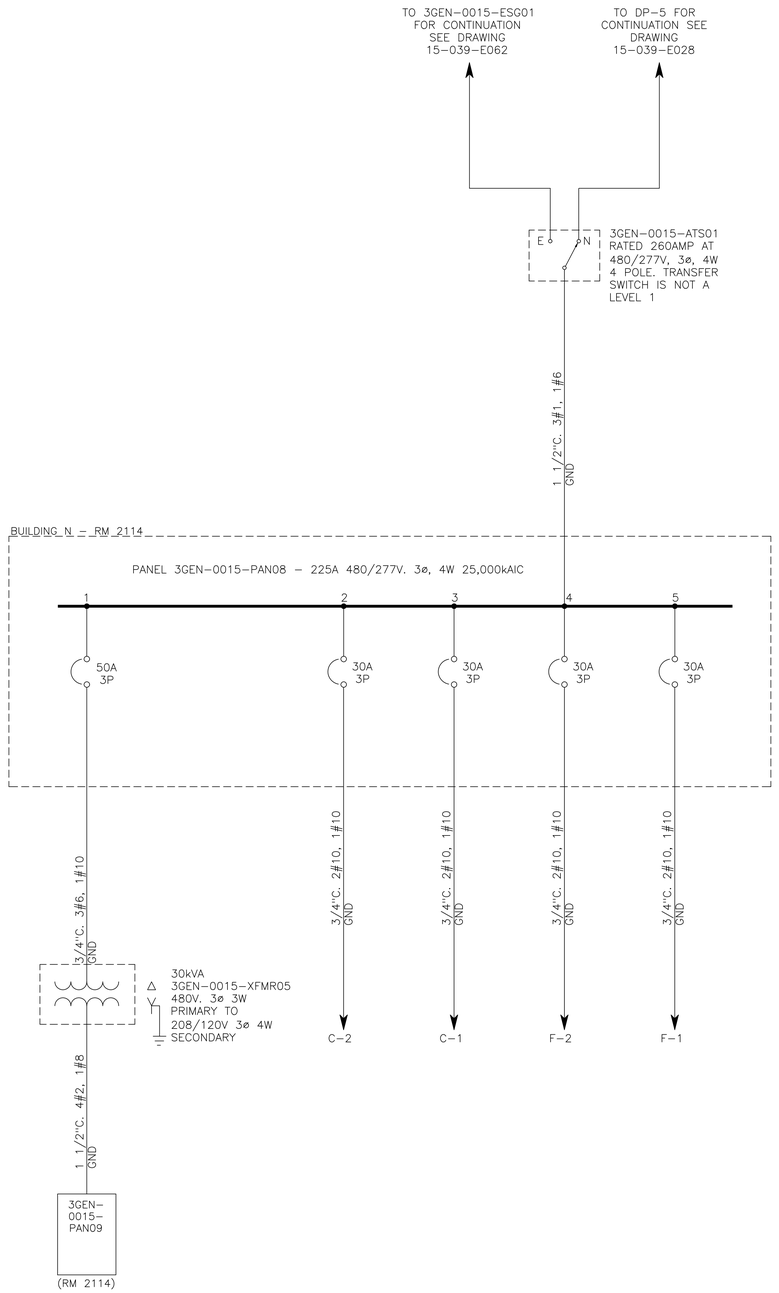

1 3GEN-0015-ATS01 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
3GEN-0015-ATS01 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E063
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E063 ATS01.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

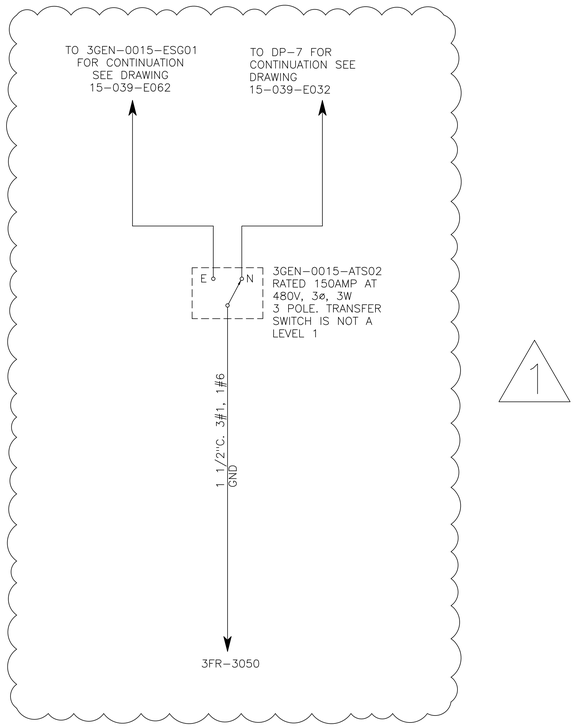

1

1 3GEN-0015-ATS02 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	Change Control 5080021	JPE	22AUG2025

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
3GEN-0015-ATS02 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E064
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E064 ATS02.dwg
Plotted at 12:18pm on Jan 05, 2026 by S118688

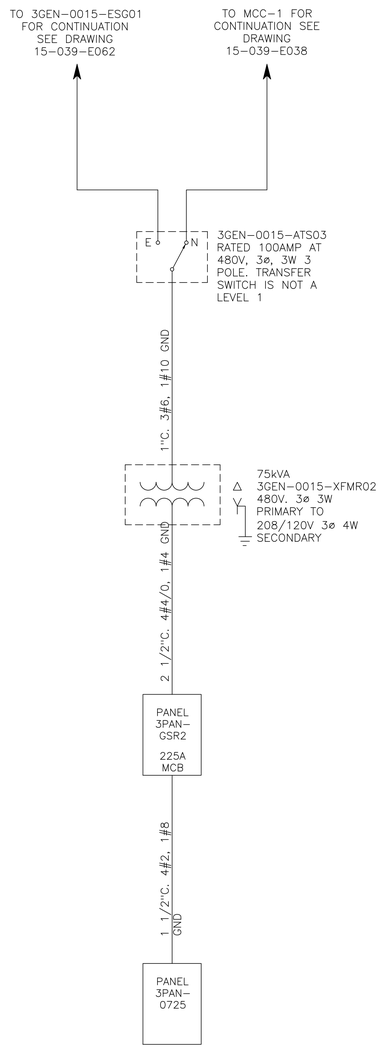

1 3GEN-0015-ATS03 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
3GEN-0015-ATS03 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE:	DRAWN: RCE	DATE: 04-30-15	DWG NO:
1/8"=1'0" WHEN PLOTTED ANSI E	APPROVED: CK	DATE: 05-31-15	15-039-E065

Drawing File = F:\BC-WorkSpace\S118688\M-Ussi1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E065 ATS03.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

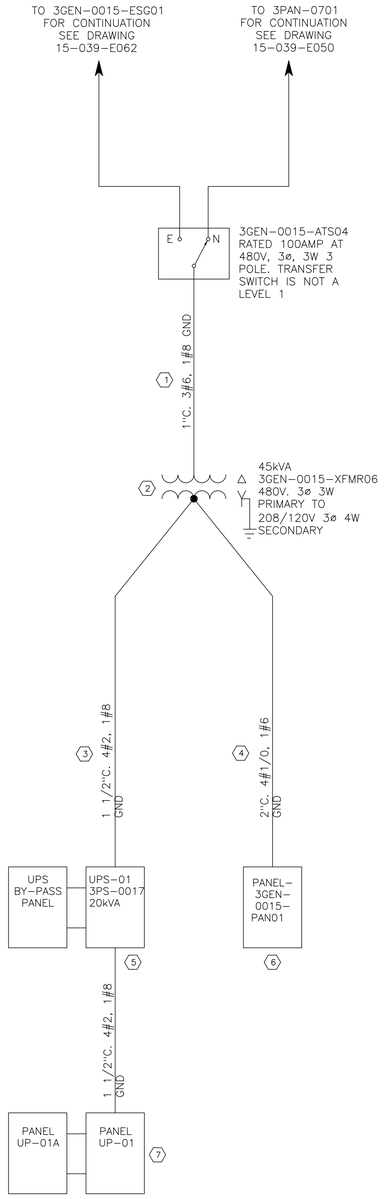

GENERAL CONSTRUCTION NOTES:

A. REFER TO DRAWING 19-XXXX-E000 FOR "ELECTRICAL INSTALLATION GENERAL NOTES".

B. E.C. SHALL COORDINATE SHUTDOWN REQUIREMENTS FOR EACH PIECE OF EQUIPMENT WITH MILLIPORESIGMA FIELD ENGINEER PRIOR TO DE-ENERGIZING THE EQUIPMENT. PROVIDE ONE WEEK ADVANCED NOTICE.

LOCATION PLAN KEYED NOTES:

1. PROVIDE AND INSTALL NEW FEEDER, SIZE AS INDICATED, TO TRANSFORMER AND CONNECT AS REQUIRED.
2. INSTALL EXISTING TRANSFORMER & RENAME 3GEN-0015-XFMR06, SIZE AS INDICATED. PROVIDE NEC GROUND NEUTRAL TO GROUND BOND CONNECTION AND GROUNDING ELECTRODE.
3. PROVIDE NEW SECONDARY FEEDER, SIZE AS INDICATED, AND CONNECT AS REQUIRED TO EXISTING UPS SYSTEM. FIELD VERIFY IF NEUTRAL CONDUCTOR IS REQUIRED BEOFRE INSTALLING FEEDER.
4. PROVIDE NEW SECONDARY FEEDER, SIZE AS INDICATED, AND CONNECT AS REQUIRED TO EXISTING PANEL.
5. EXISTING UPS SYSTEM TO REMAIN. CONNECT NEW FEEDER TO EXISTING MAIN CIRCUIT BREAKER
6. EXISTING PANEL TO BE RENAMED 3GEN-0015-PAN11 AND CONNECTED AS SHOWN. FIELD VERIFY MAIN CIRCUIT BREAKER, IF NONE EXISTING PROVIDE FUSED DISCONNECT SWITCH WITH 150 AMP LPS FUSES AHEAD OF PANEL.
7. EXISTING PANEL TO REMAIN CONNECTED AS IS.

1

3GEN-0015-ATS04 ONE LINE DIAGRAM

SCALE: NONE

2 ADDED TAG NUMBER (3PS-0017) TO THE UP-01 PANEL

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	ADDED PANEL UP-01A	SN	03-06-23
2	LABEL UPDATE	AS	02-06-20
1	ISSUED FOR ECM 5-7340	CK	09-17-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
3GEN-0015-ATS04 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN:	RCE	DATE: 04-30-15	DWG NO: 15-039-E066
	APPROVED:	CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E066 ATS04.dwg
Plotted at 8:30am on Jan 12, 2024 by S118688

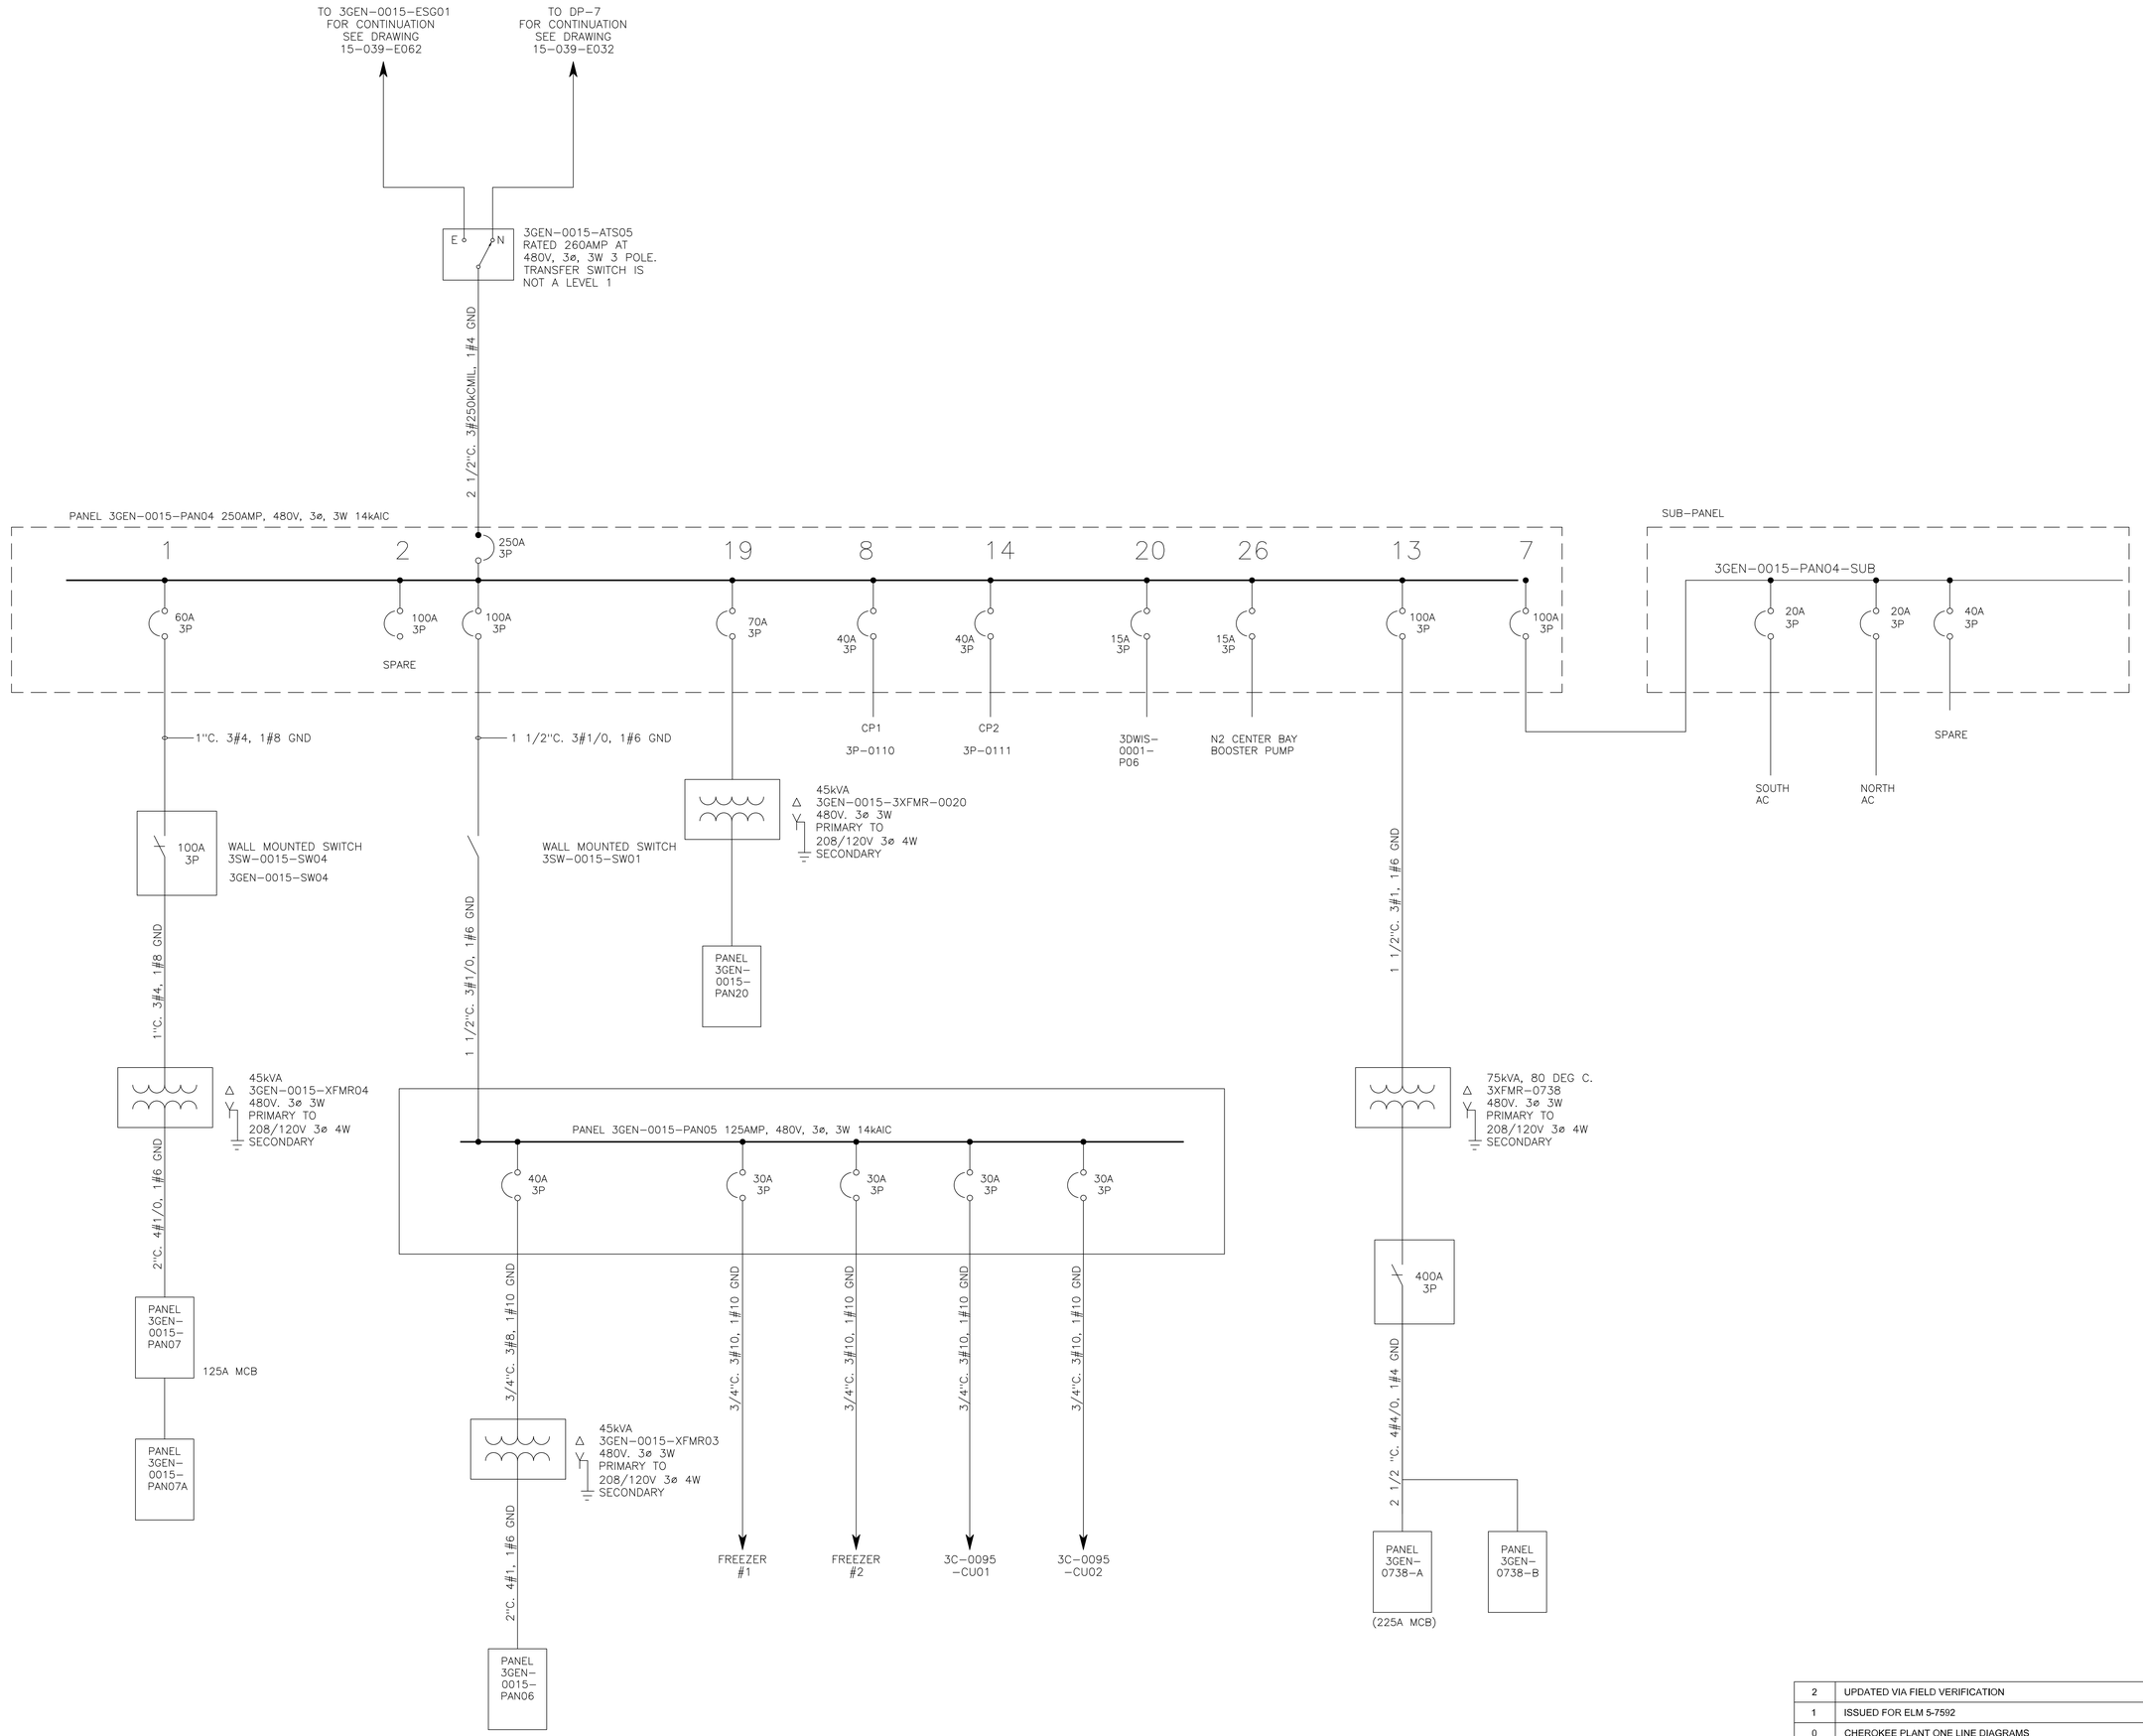

1 3GEN-0015-ATS05 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATED VIA FIELD VERIFICATION		06-15-22
1	ISSUED FOR ELM 5-7592	CK	12-17-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
3GEN-0015-ATS05 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E

DRAWN: RCE DATE: 04-30-15

APPROVED: CK DATE: 05-31-15

DWG NO: 15-039-E067

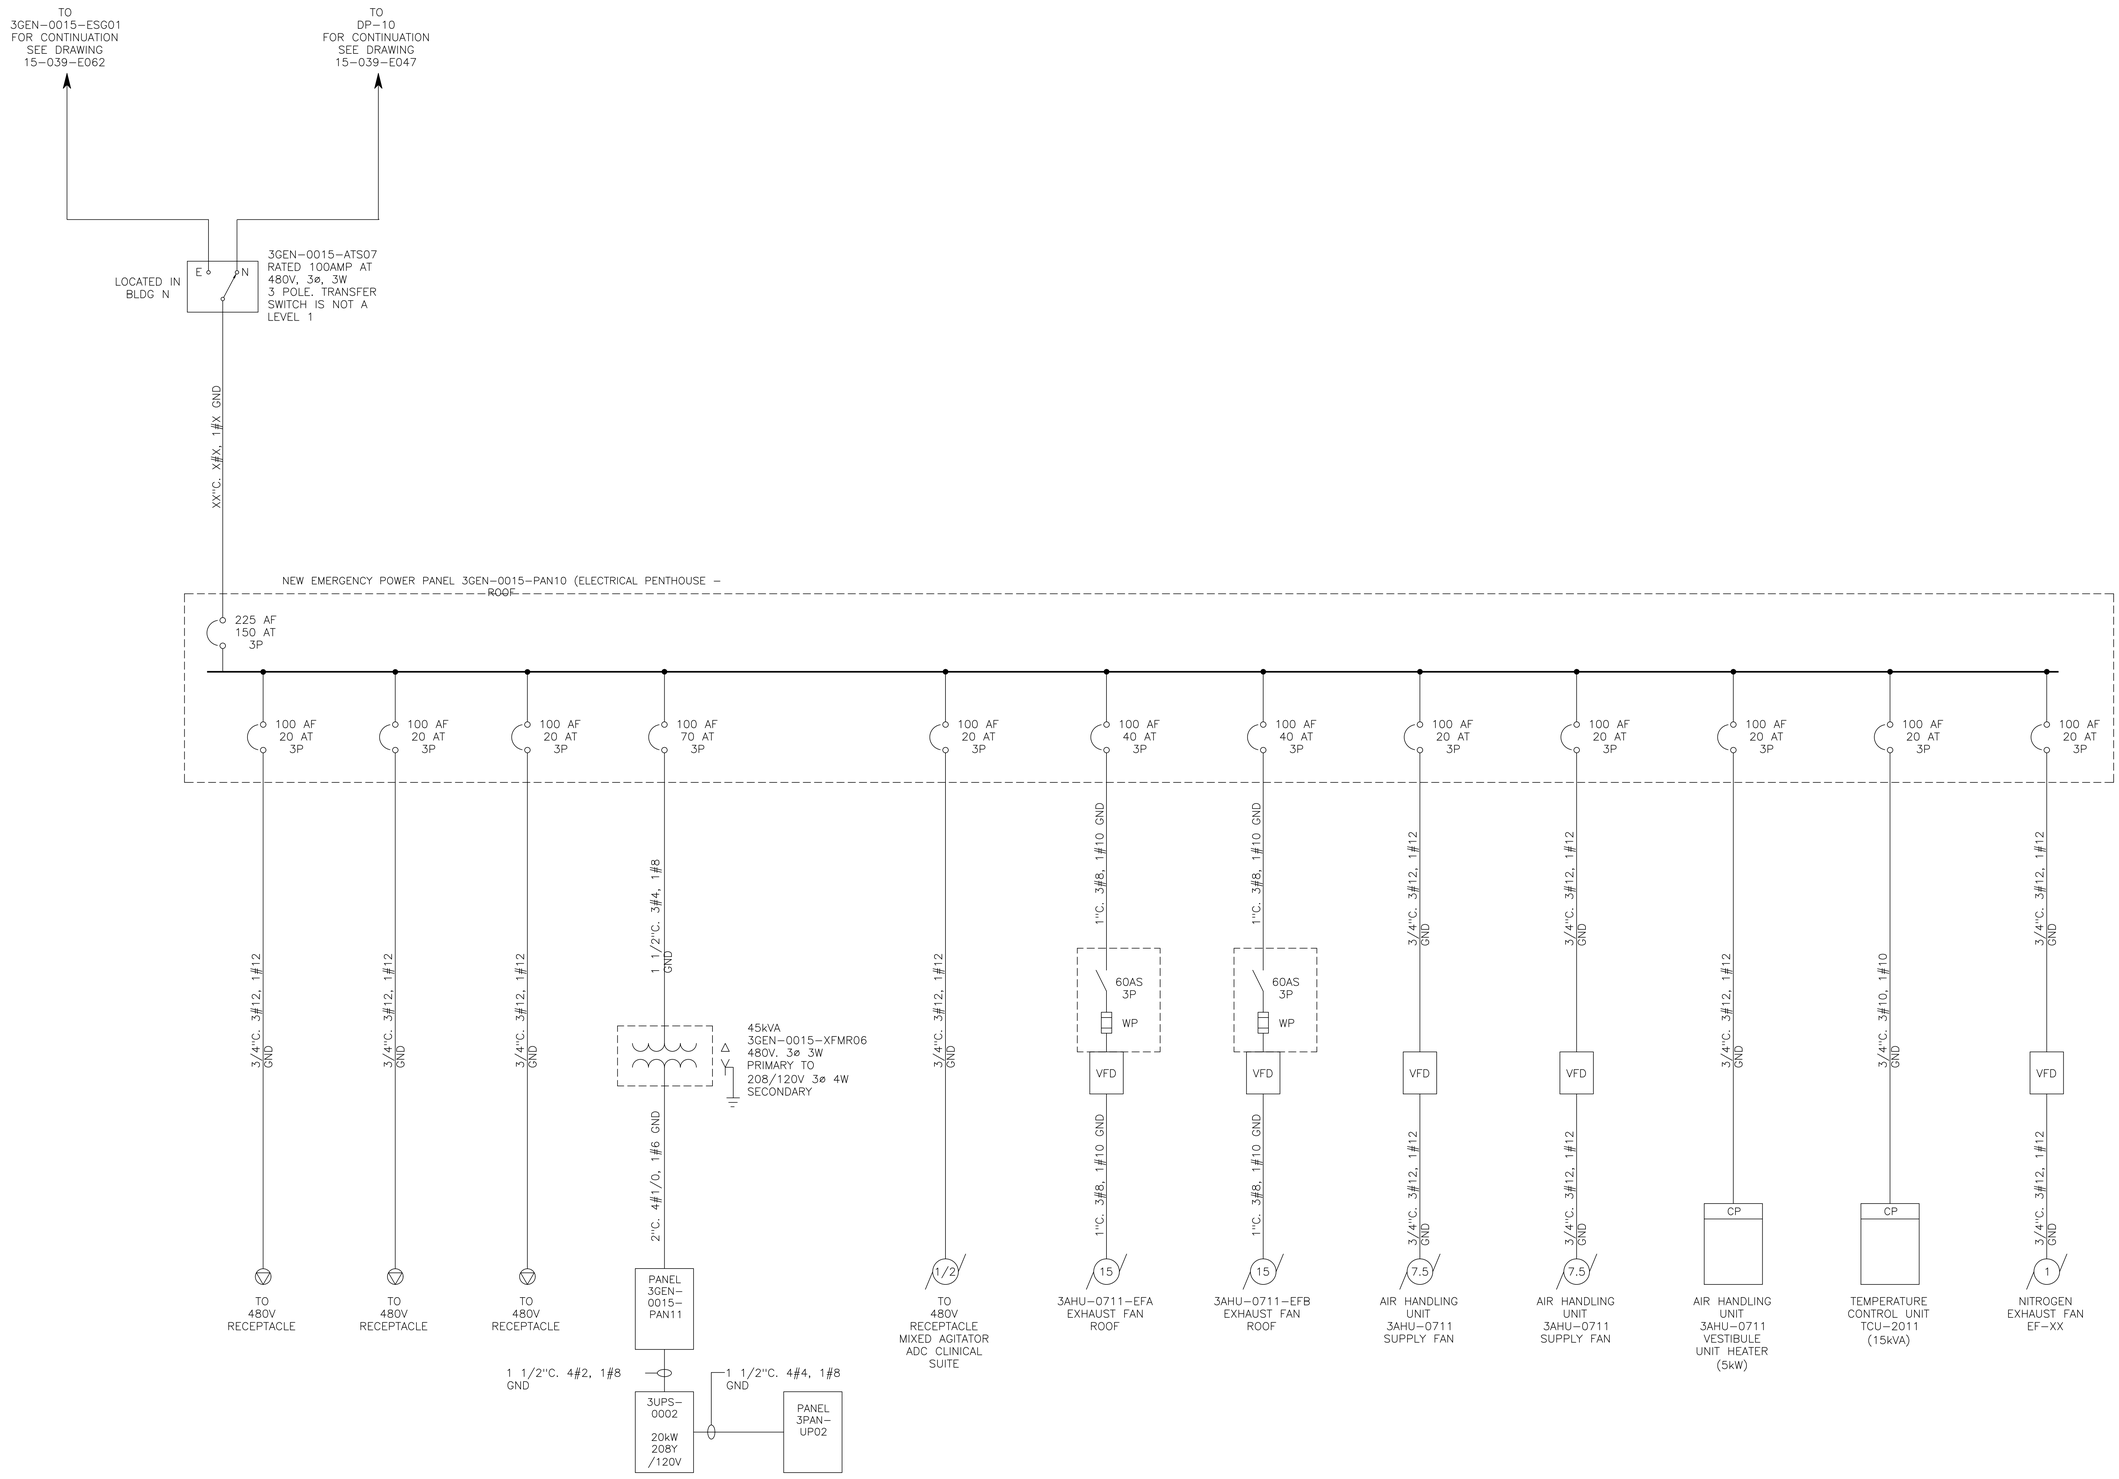

1 3GEN-0015-ATS07 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E068
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E068 ATS07.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

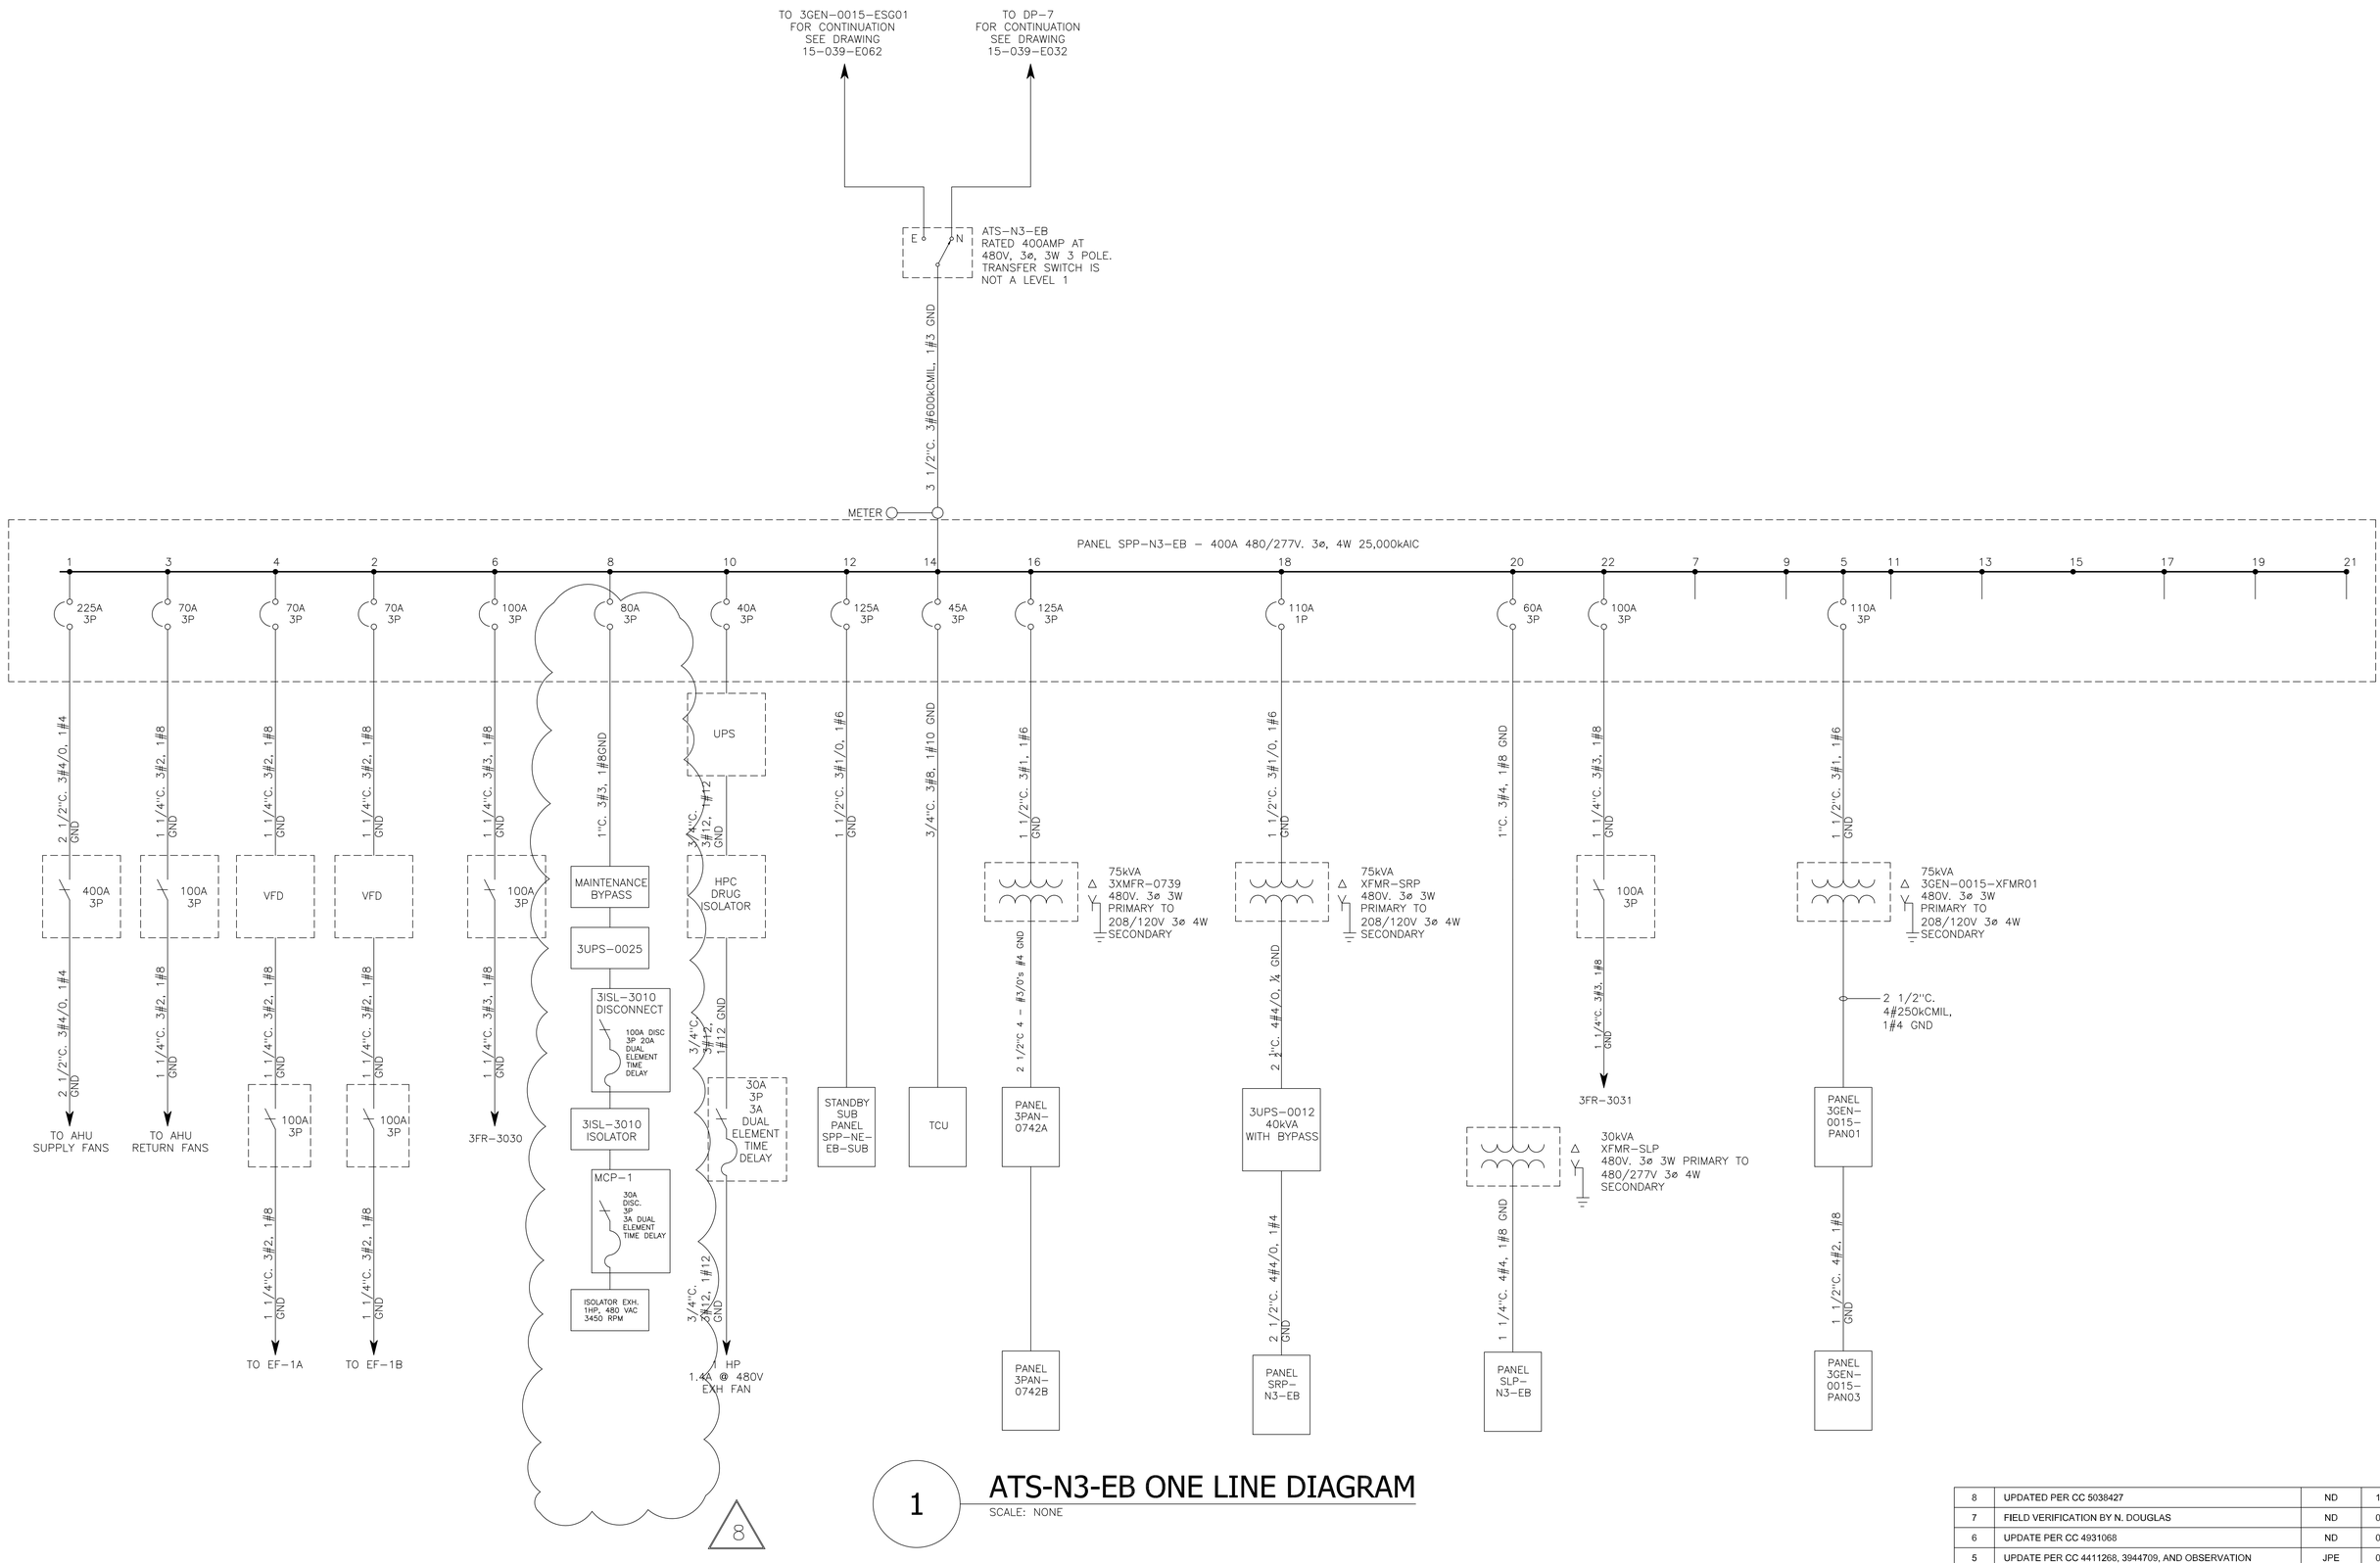

1 ATS-N3-EB ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
8	UPDATED PER CC 5038427	ND	10-02-25
7	FIELD VERIFICATION BY N. DOUGLAS	ND	07-08-25
6	UPDATE PER CC 4931068	ND	05-01-25
5	UPDATE PER CC 4411268, 3944709, AND OBSERVATION	JPE	06-04-24
4	UPDATE VIA PROJECT E.300156	SN	07-15-23
3	UPDATE VIA FIELD OBSERVATION	SN	11-15-22
2	ADDED 3UPS-0012 FOR ECM 2594825	CK	09-17-20
1	ADDED NEW PNL 3GEN-0015-PAN01	CK	09-17-19
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
ATS-N3-EB ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E

DRAWN: RCE DATE: 04-30-15

APPROVED: CK DATE: 05-31-15

DWG NO: 15-039-E069

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002.D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E069 ATS-N3-EB.dwg
Plotted at 7:05am on Oct 07, 2025 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E070
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E070 FUTURE.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E071
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E071 FUTURE.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
STAND-BY GENERATOR 3GEN-0015
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E072
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E072 FUTURE.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

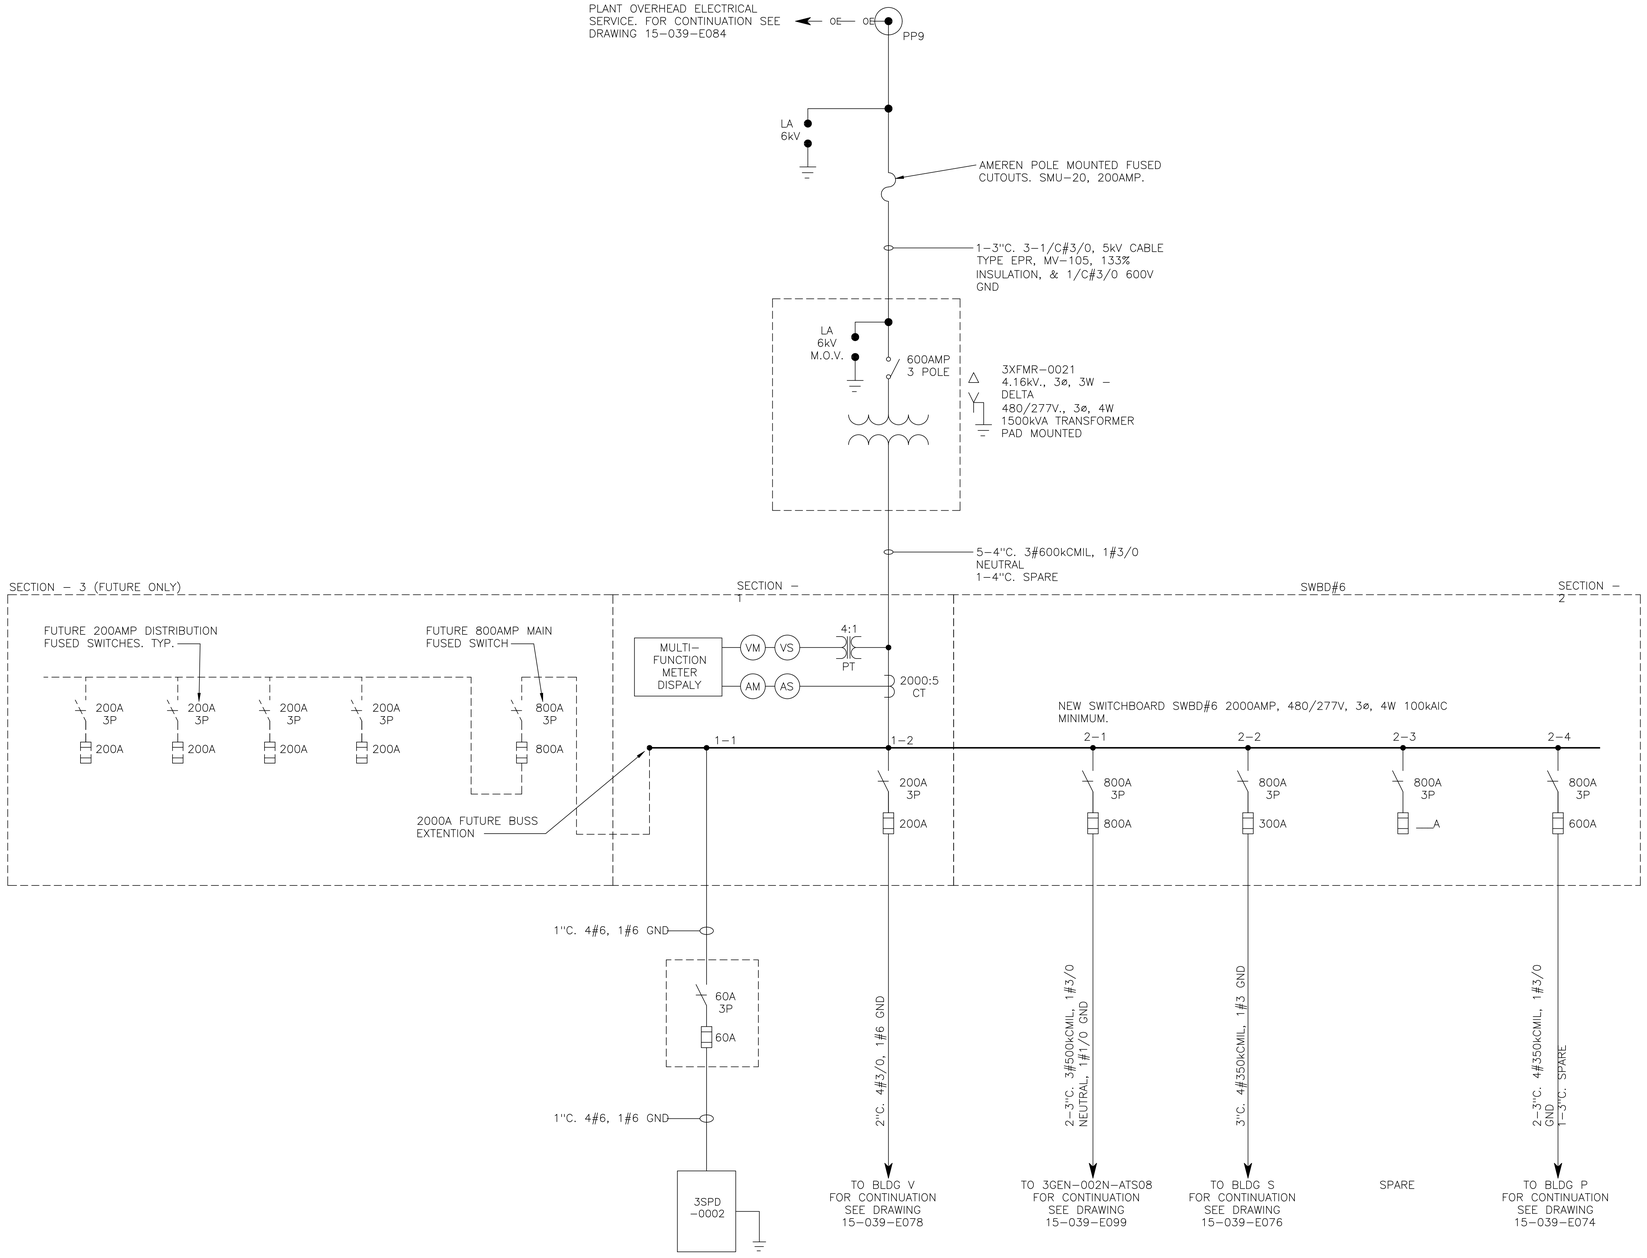

1 3XFMR-0021 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. FIELD VERIFY ALL EXACT CONDITIONS.

2. CONDUIT SIZE, CONDUCTOR INSULATION, AND GROUND CONDUCTOR SIZES WHERE NOT VERIFIED. PRIOR TO ANY NEW ADDITIONS OR MODIFICATIONS TO THE EXISTING SYSTEM FIELD VERIFY ACTUAL SITE CONDITIONS.

3. MOTOR HP, CONDUCTORS, AND CONDUIT SIZES WERE NOT VERIFIED. PRIOR TO ANY NEW MOTOR ADDITIONS OR MODIFICATIONS FIELD VERIFY ACTUAL SITE CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	ISSUED FOR CONSTRUCTION PROJECT 19-2019	CK	08-26-19
0	ORIGINAL DRAWING CREATION	CK	04-06-18

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0021
ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 12-04-18
APPROVED: CK DATE: 12-19-18
DWG NO: 15-039-E073

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E073 3XFMR-0021.dwg
Plotted at 10:30am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. FIELD VERIFY ALL EXACT CONDITIONS.

2. CONDUIT SIZE, CONDUCTOR INSULATION, AND GROUND CONDUCTOR SIZES WHERE NOT VERIFIED. PRIOR TO ANY NEW ADDITIONS OR MODIFICATIONS TO THE EXISTING SYSTEM FIELD VERIFY ACTUAL SITE CONDITIONS.

3. MOTOR HP, CONDUCTORS, AND CONDUIT SIZES WERE NOT VERIFIED. PRIOR TO ANY NEW MOTOR ADDITIONS OR MODIFICATIONS FIELD VERIFY ACTUAL SITE CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	ORIGINAL DRAWING CREATION	CK	08-26-19

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0021

SITE: CHEROKEE BLDG: -- FLOOR: --

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E

DRAWN: RCE DATE: 08-26-19

APPROVED: CK DATE: 08-26-19

DWG NO: 15-039-E075

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E075 FUTURE.dwg
Plotted at 11:10am on Dec 05, 2022 by S118688

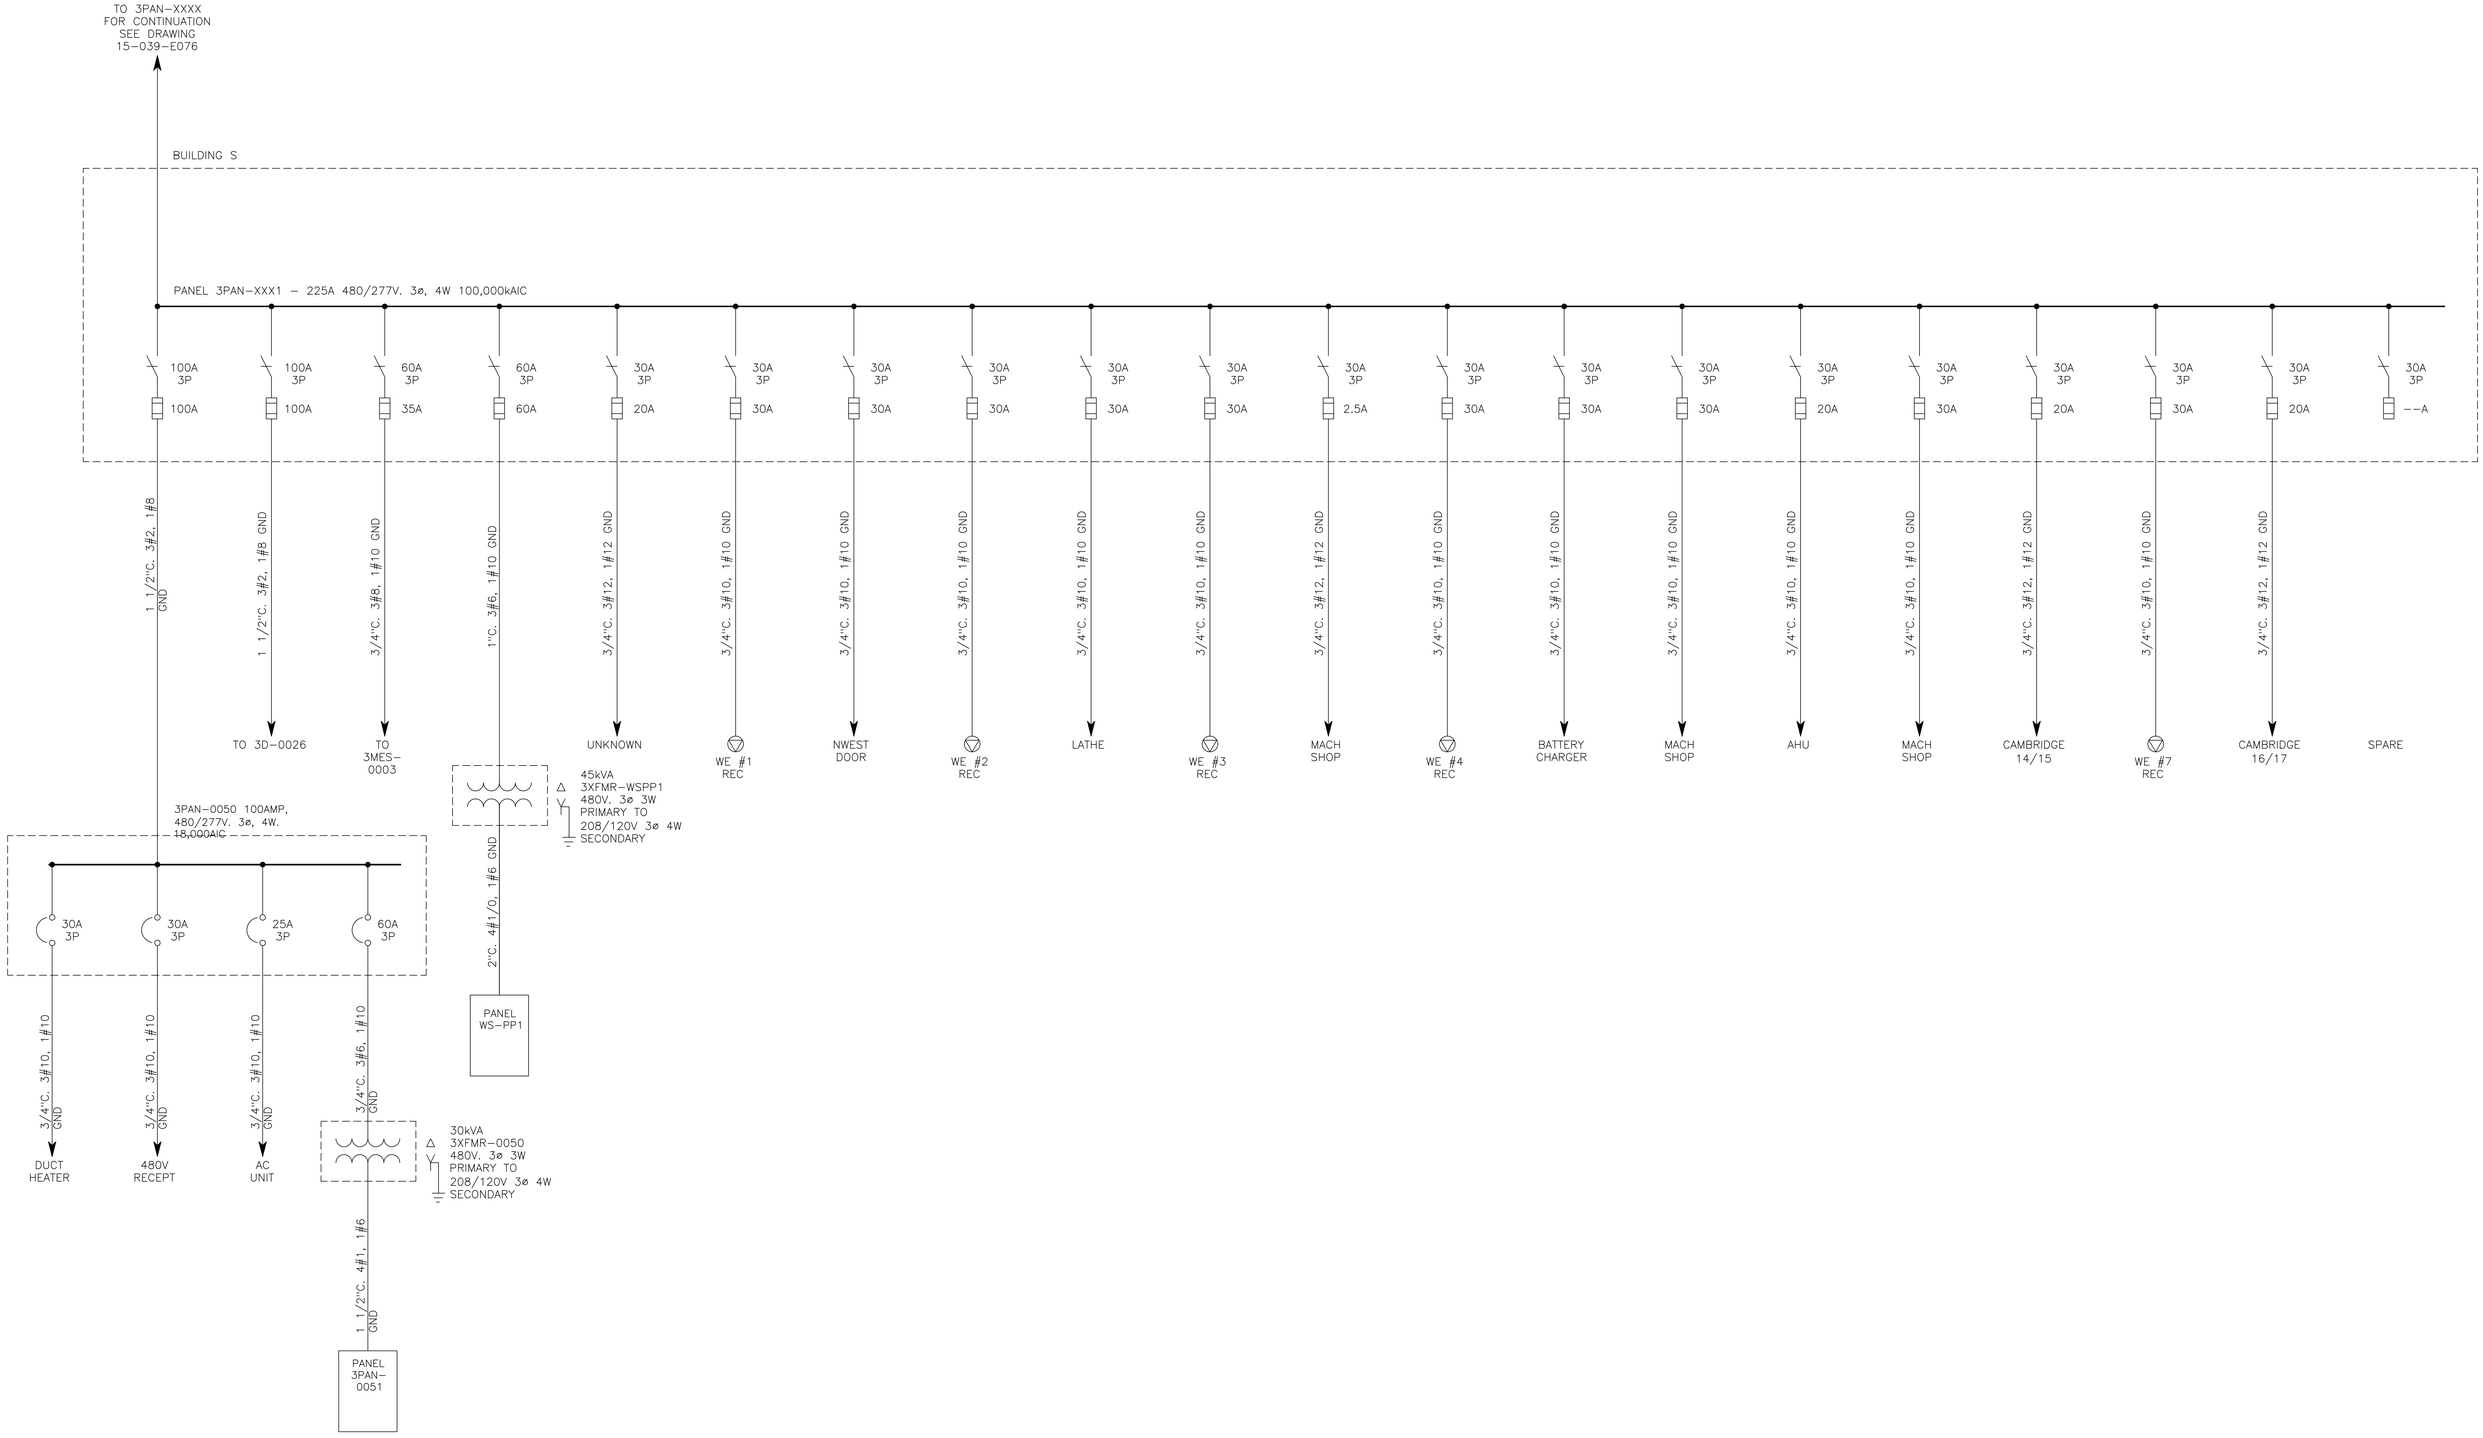

1 3PAN-XXX1 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0021
3PAN-XXX1 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: S FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E077

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002.D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E077 3PAN-XXX1.dwg
Plotted at 11:10am on Dec 05, 2022 by S118688

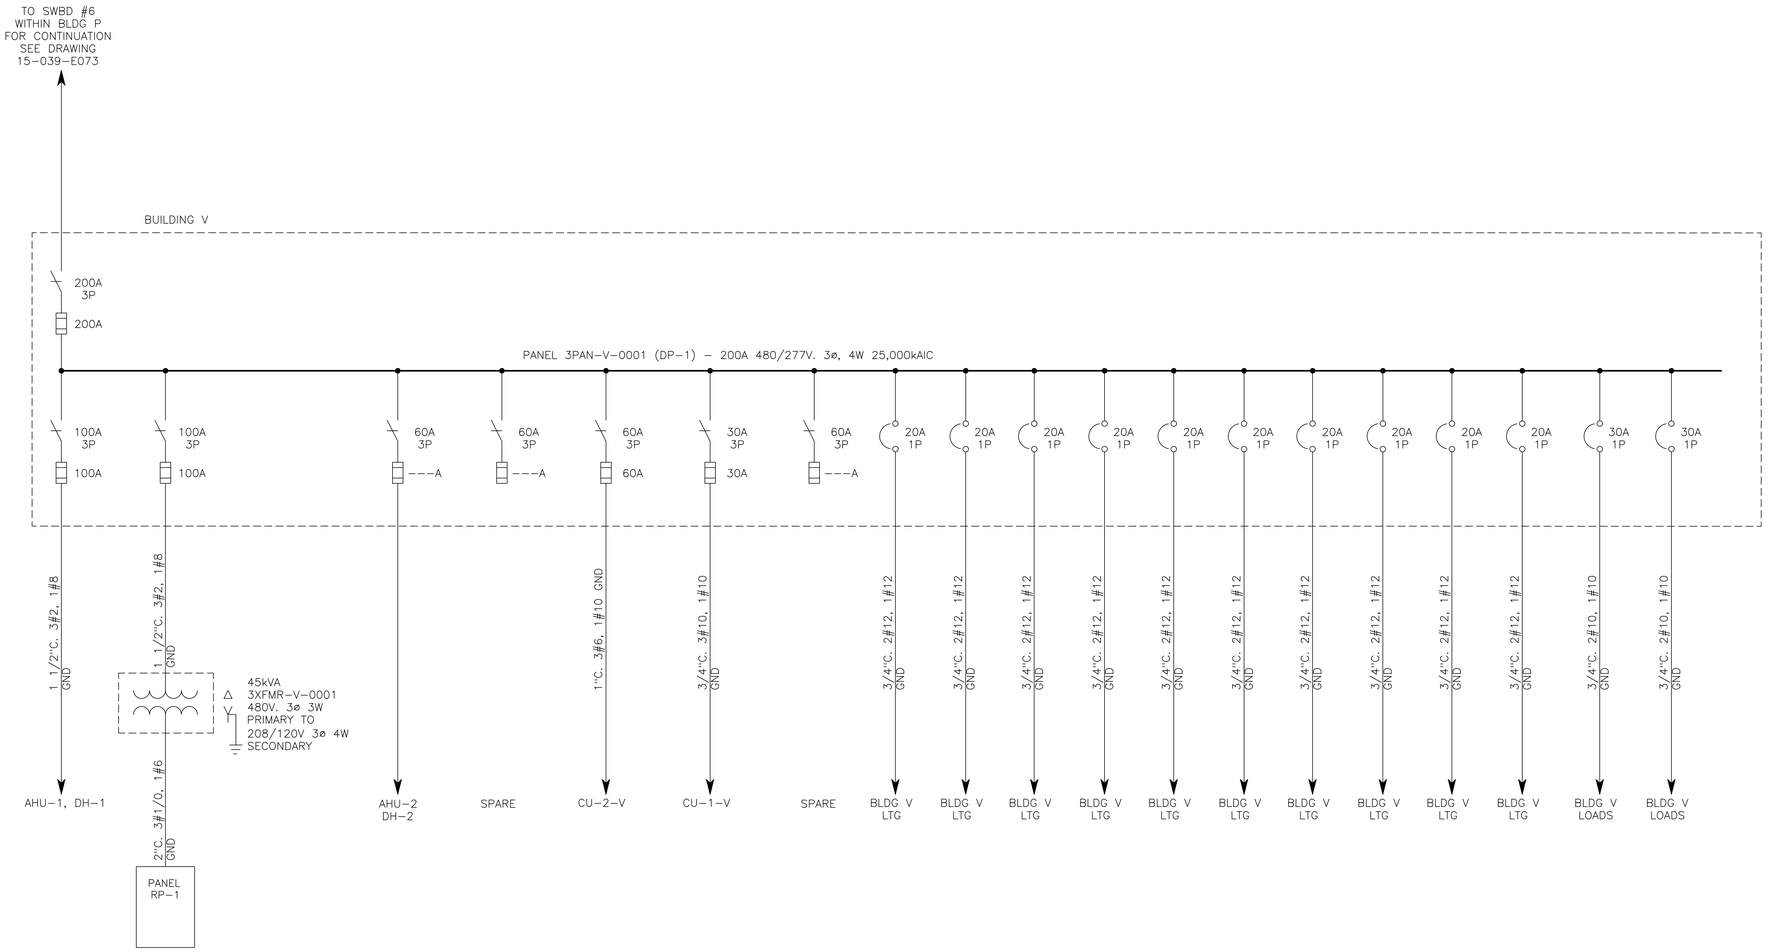

1 BLDG V ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS–BUILT OR AS–RECORDED. FIELD VERIFY ALL EXACT CONDITIONS.

2. CONDUIT SIZE, CONDUCTOR INSULATION, AND GROUND CONDUCTOR SIZES WHERE NOT VERIFIED. PRIOR TO ANY NEW ADDITIONS OR MODIFICATIONS TO THE EXISTING SYSTEM FIELD VERIFY ACTUAL SITE CONDITIONS.

3. MOTOR HP, CONDUCTORS, AND CONDUIT SIZES WERE NOT VERIFIED. PRIOR TO ANY NEW MOTOR ADDITIONS OR MODIFICATIONS FIELD VERIFY ACTUAL SITE CONDITIONS.

NO	REVISIONS	APPROVED	DATE
2	UPDATE VIA FIELD OBSERVATION	SN	11-07-22
1	ISSUED FOR CONSTRUCTION PROJECT 19-2019	CK	08-26-19
0	ORIGINAL DRAWING CREATION	CK	5-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
BLDG V ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: V FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 12-07-18
APPROVED: CK DATE: 12-19-31
DWG NO: 15-039-E078

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E078 BLDG V.dwg
Plotted at 11:05am on Dec 05, 2022 by S118688

Services Provided By:
SIGMA CHEMICAL COMPANY, ENGINEERING DEPARTMENT

PAGE LEFT BLANK INTENTIONALLY

XXXX
NOT TO SCALE

NO	REVISIONS	APPROVED	DATE
0	XX	XX	XX-XX-XX

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

SIGMA-ALDRICH CORPORATION

TITLE: **CHEROKEE ELECTRICAL OVERHEAD SERVICES FUTURE DRAWING**

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN: XXX	SCALE: NOTED	DATE: XX-XX-XX	**15-039-E079**
CHECKED: XX	APPROVED: XX	DATE: XX-XX-XX	

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0031
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: X/Y FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E082
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E082 FUTURE.dwg
Plotted at 10:51am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0031
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: X/Y FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E083
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E083 FUTURE.dwg
Plotted at 10:51am on Dec 05, 2022 by S118688

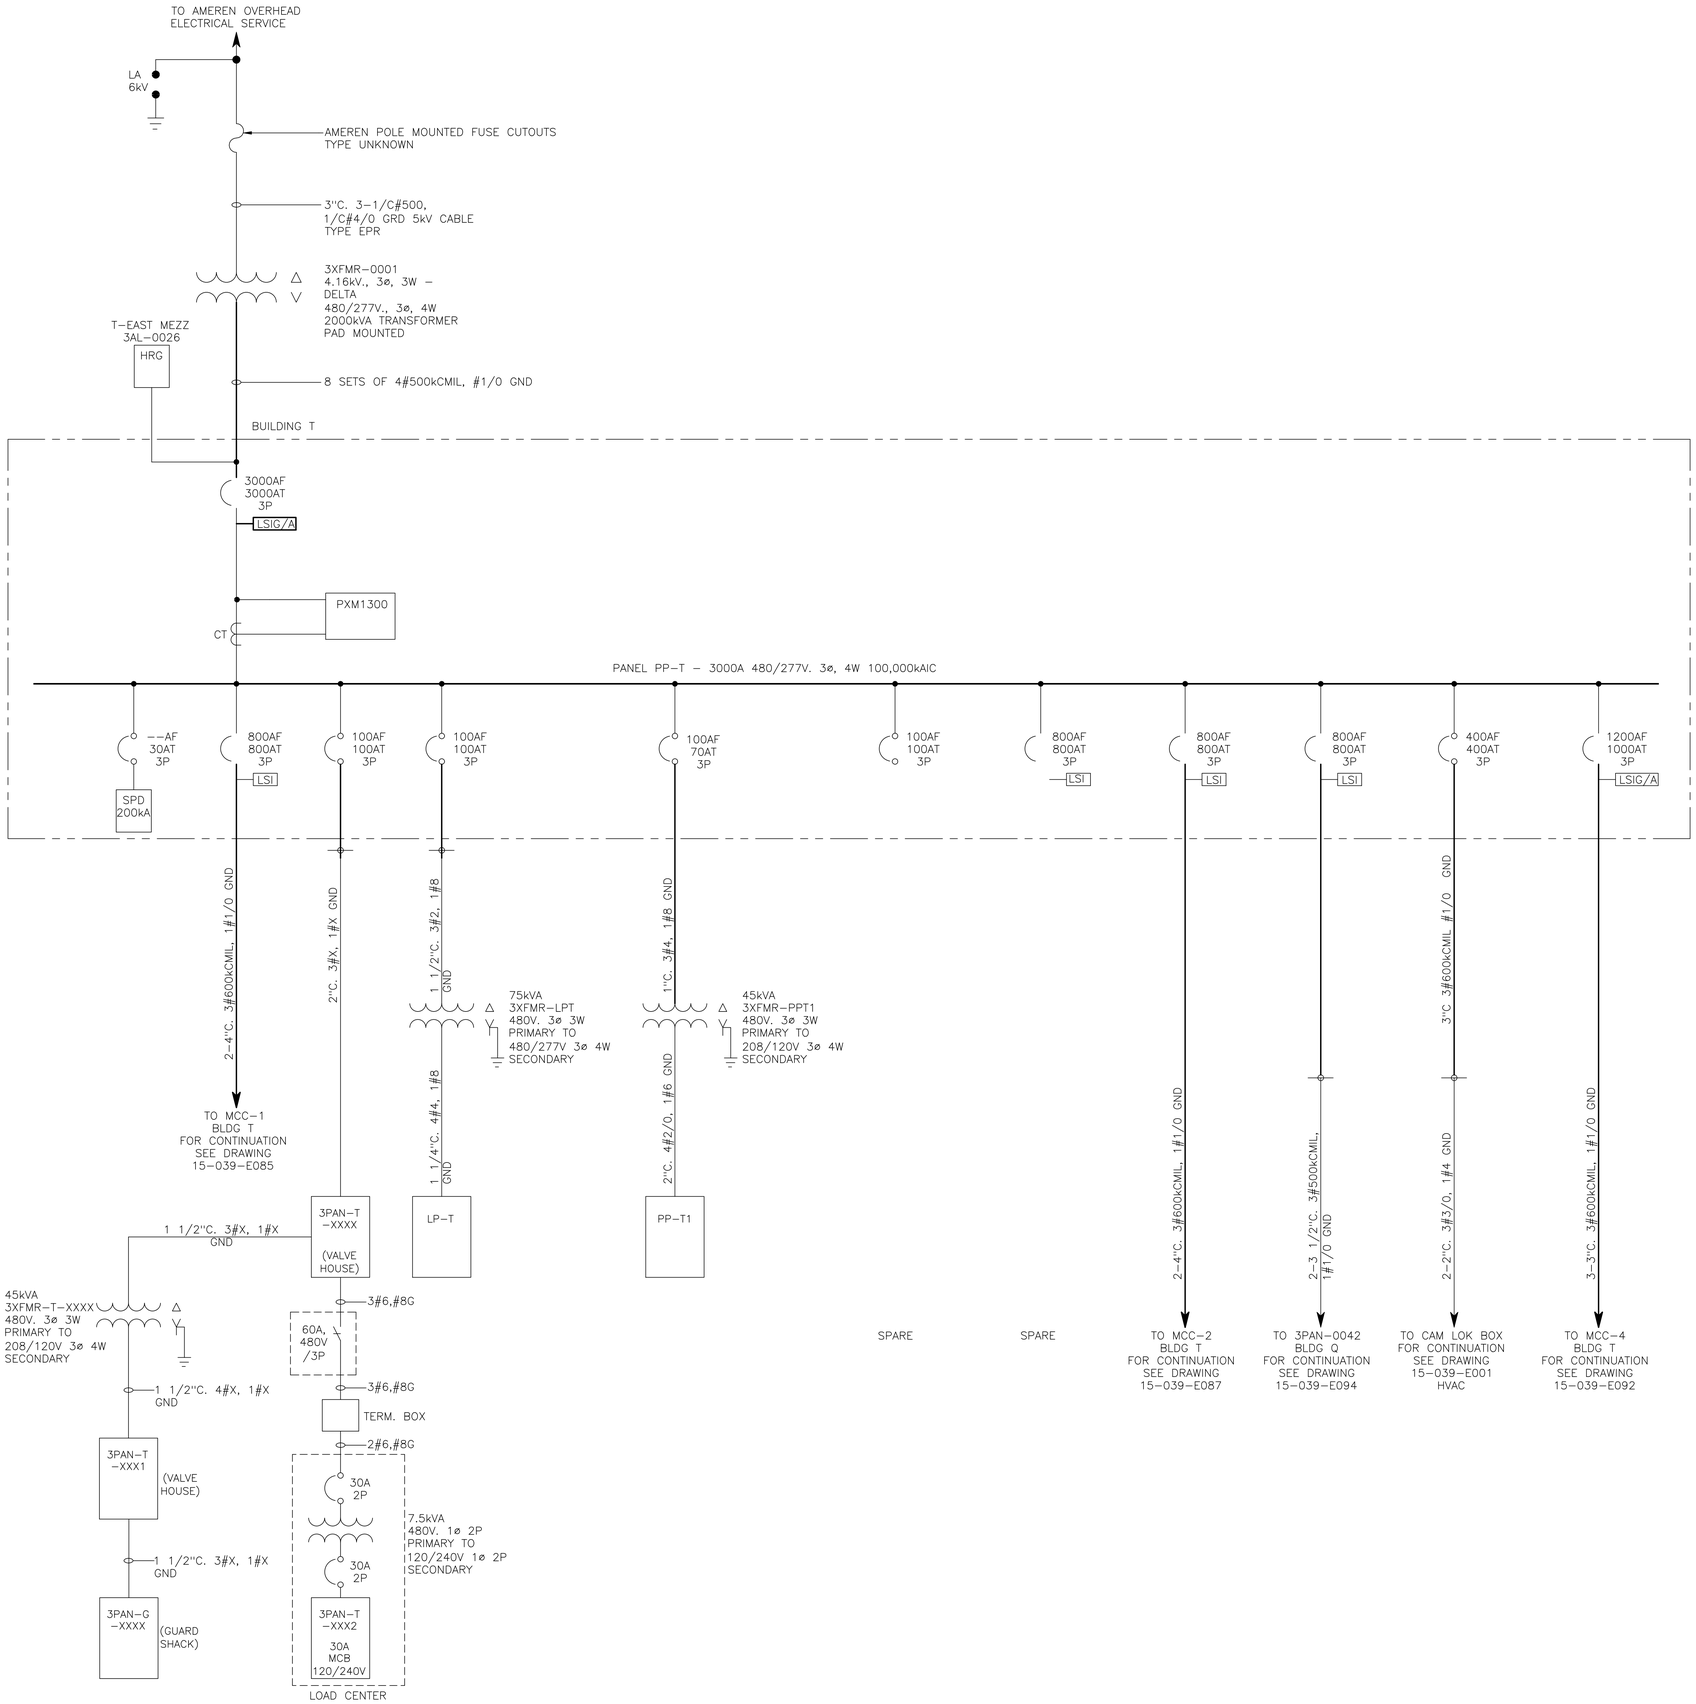

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

1 3XFMR-0001 ONE LINE DIAGRAM

SCALE: NONE

NO	REVISIONS	APPROVED	DATE
6	UPDATED VIA FIELD VERIFICATION	SN	05-03-23
5	LOAD CENTER FOR 3PAN-T-XXX2 ADDED	SN	04-17-23
4	ISSUED FOR BID PROJECT 21-2026	SN	08-19-22
3	ISSUED FOR CONSTRUCTION PROJECT 19-2019 - PHASE C	CK	05-04-20
2	AS-RECORDED POST COMMISSIONING	KJK	12-07-18
1	IFC, LYOPHILIZER PROJECT	KJK	05-17-17
0	CHEROKEE PLANT ONELINE DIAGRAMS	CK	05-31-15

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE ELECTRICAL OVERHEAD SERVICES SERVICE TRANSFORMER 3XFMR-0001 AND SWBD PP-T ONELINE DIAGRAMS

SITE: CHEROKEE BLDG: T FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E

DRAWN: RCE DATE: 04-30-15

APPROVED: CK DATE: 05-XX-15

DWG NO: 15-039-E084

Drawing File = F:\BC-WorkSpace\S118688\M-Usl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E084 3XFMR-0001.dwg
Plotted at 2:25pm on May 03, 2023 by S118688

Services Provided By:
SIGMA CHEMICAL COMPANY, ENGINEERING DEPARTMENT

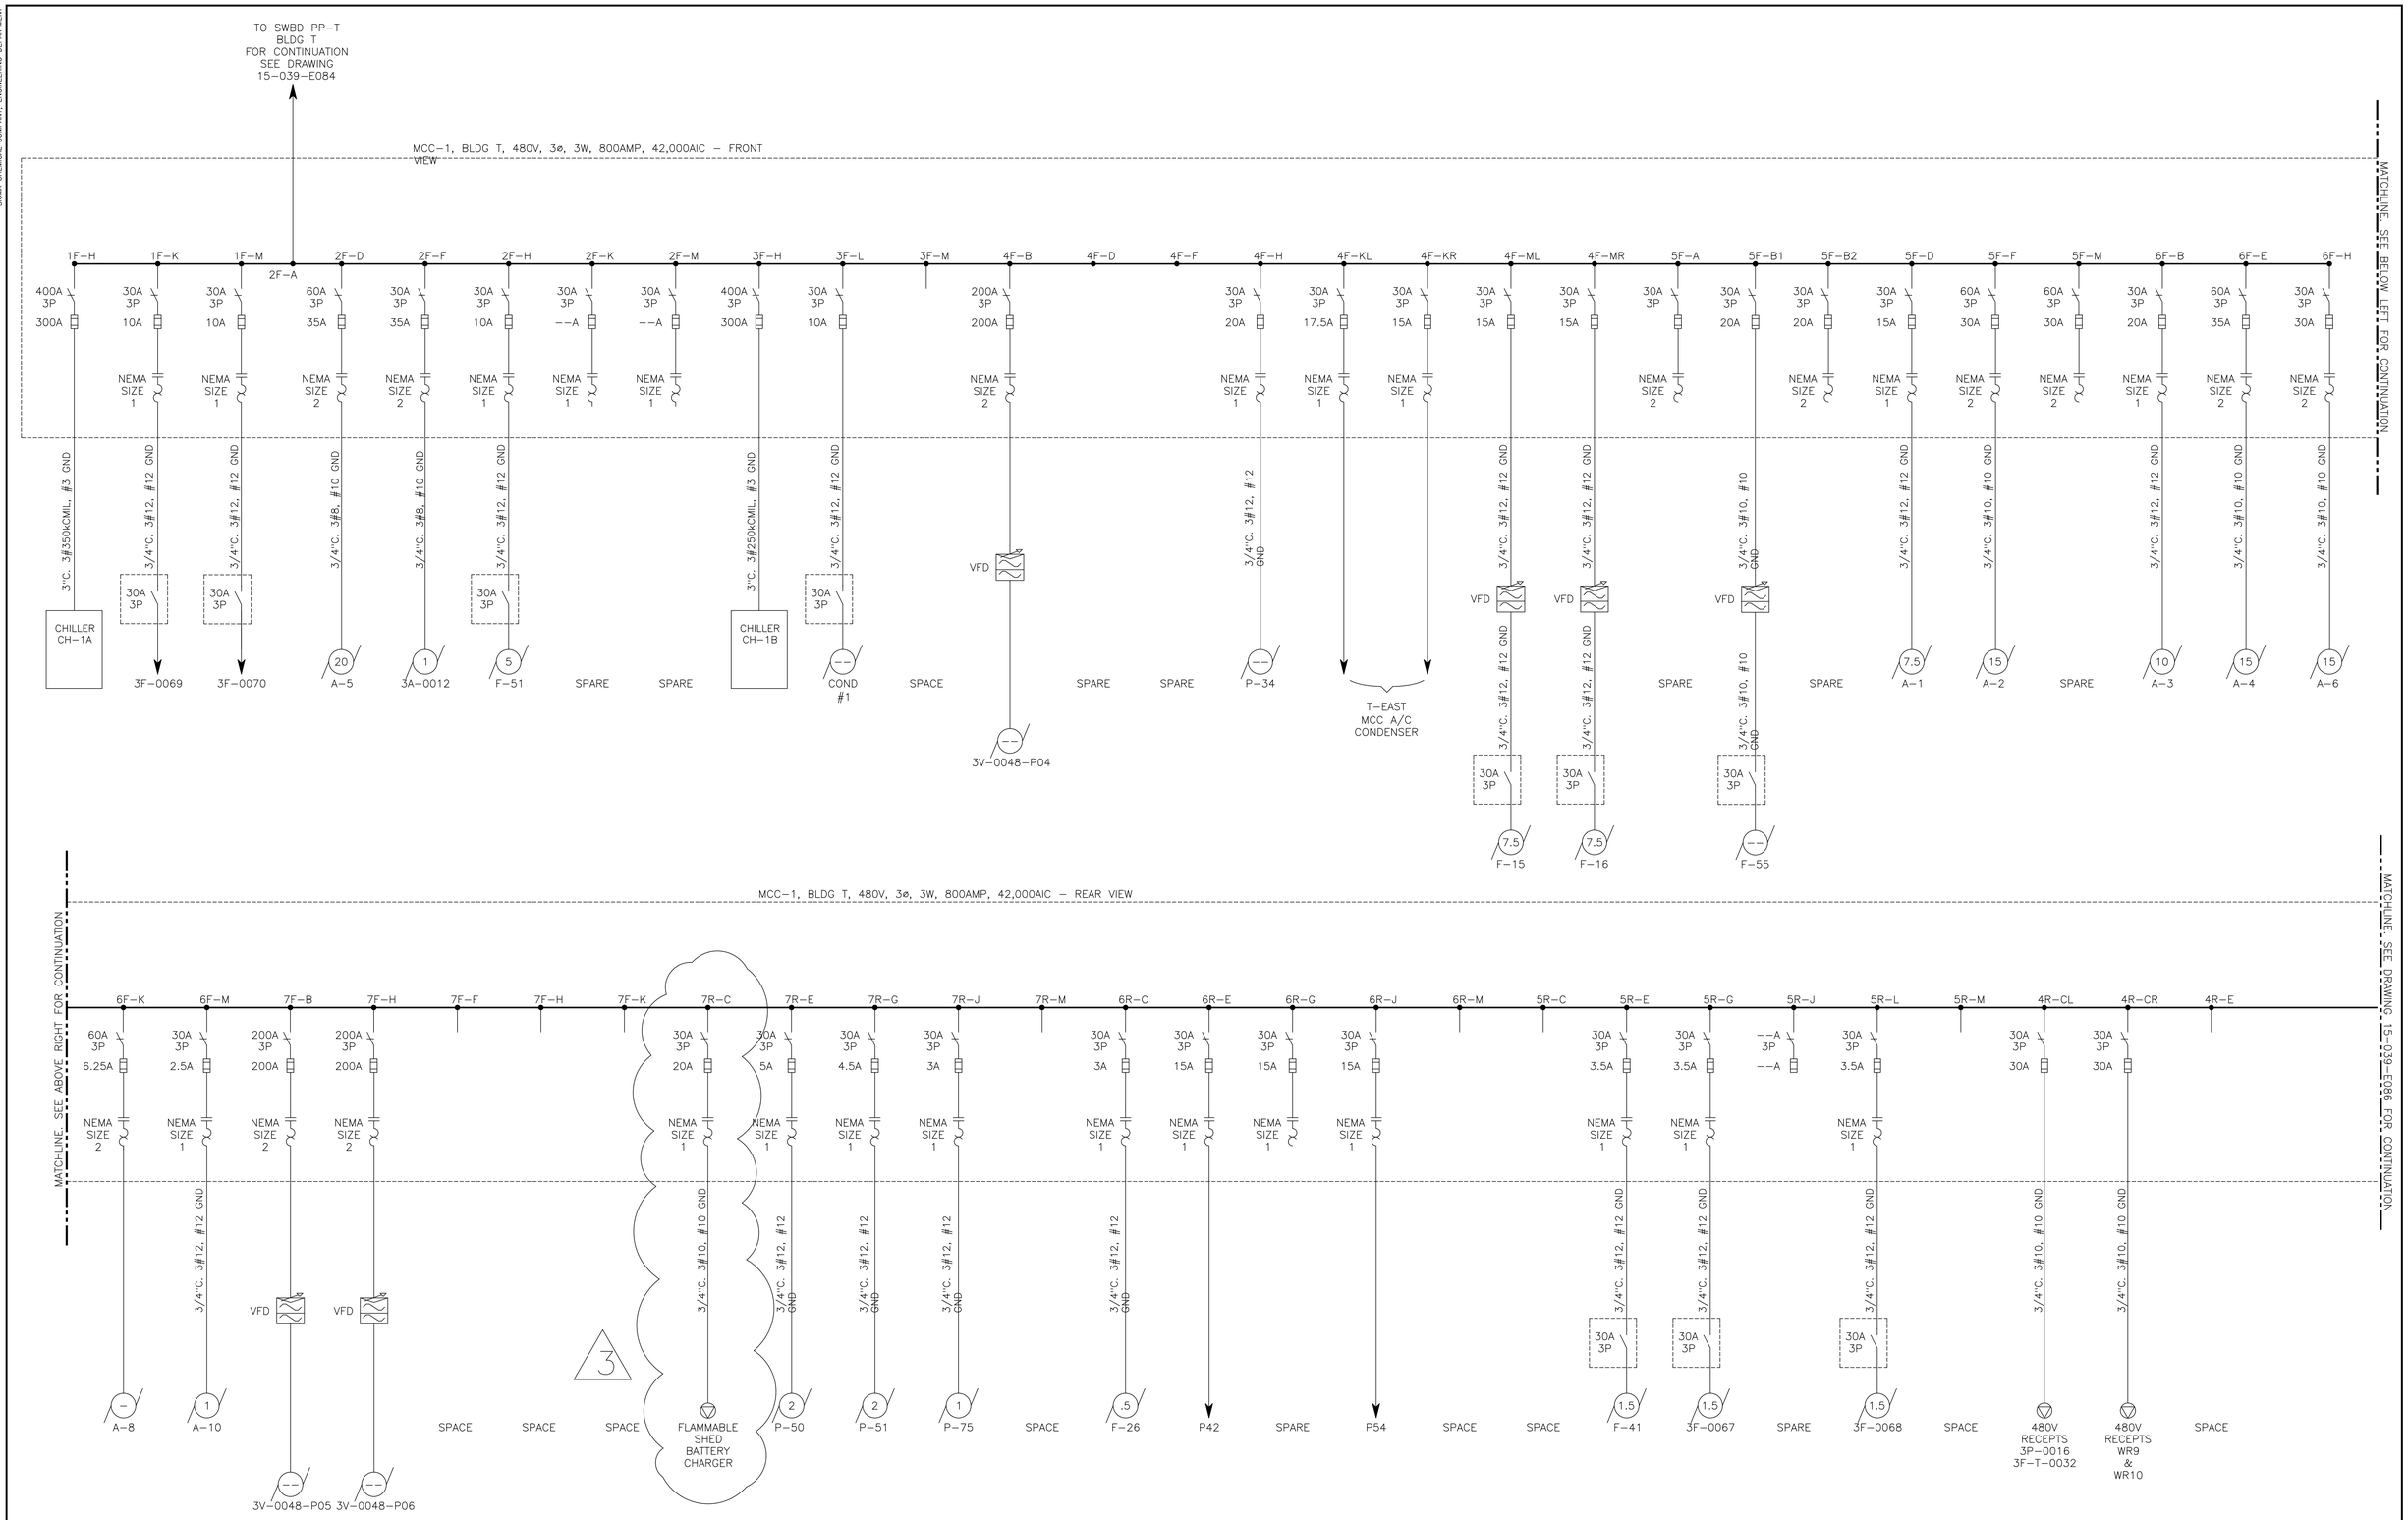

MCC-1 BLDG T ONE LINE DIAGRAM

NOT TO SCALE

3 FLAMMABLE SHED BATTERY CHARGER ADDED, DUE TO FIELD VERIFICATION FOR PROJECT E.300132. PROJECT DID NOT ORIGINALLY INSTALL.

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

NO	REVISIONS	APPROVED	DATE
3	FIELD VERIFICATION UPDATE FROM E.300132	EJW	03-04-24
2	UPDATED PER CC 3670657	EW	07-31-23
1	UPDATE VIA FIELD OBSERVATION	SN	10-12-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: **CHEROKEE ELECRICAL OVERHEAD SERVICES**
SERVICE TRANSFORMER 3XFMR-0001
MCC-1 BLDG T ONE LINE DIAGRAM

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN: RCE SCALE: NOTED DATE: 04-30-15

CHECKED: CK APPROVED: CK DATE: 05-XX-15

15-039-E085

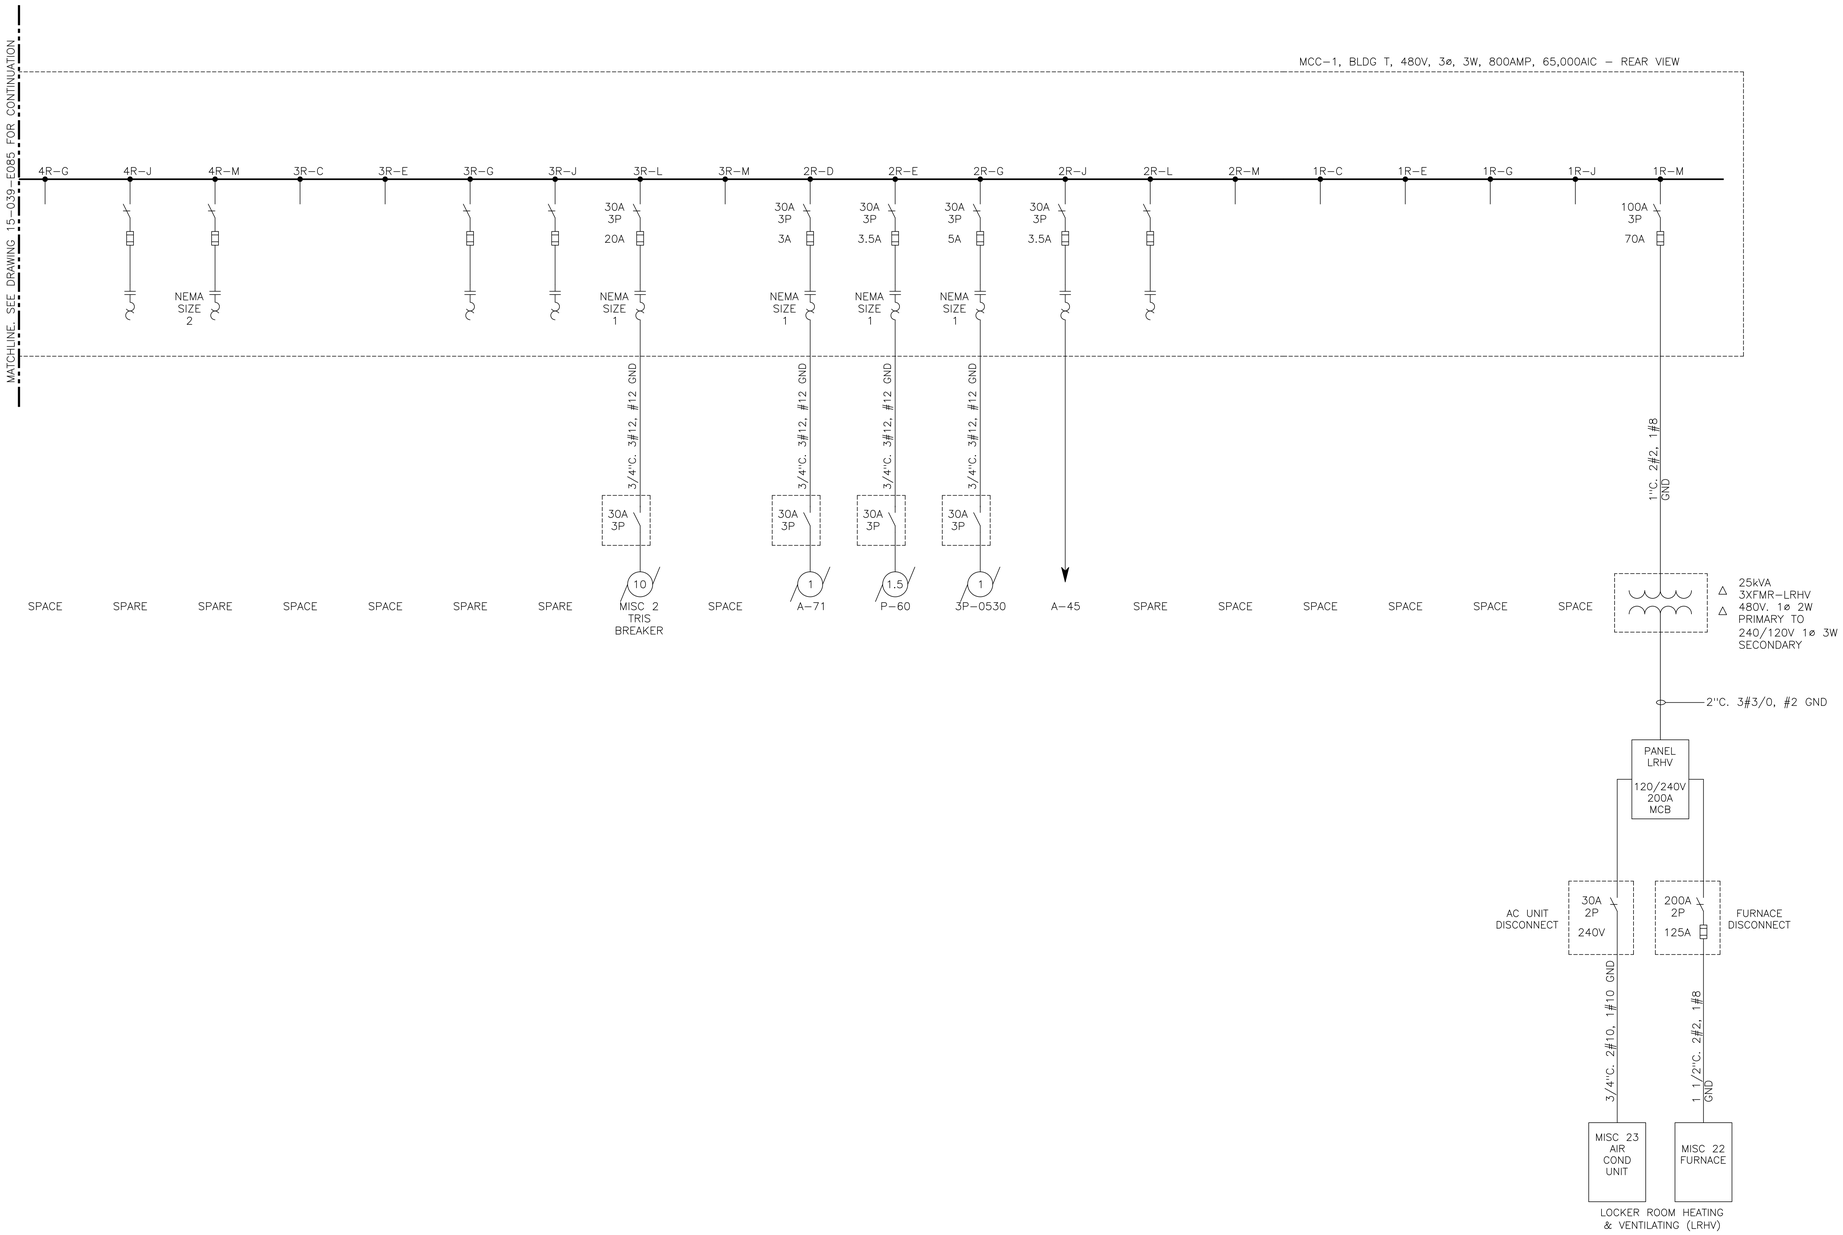

MCC-1 BLDG T ONE LINE DIAGRAM CONTINUED

NOT TO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

ONE LINE DIAGRAM NOTES:

1. ARC FLASH STUDY DID NOT INVESTIGATE FURTHER THAN THE MCC LINE SIDE. ANY AND ALL MOTORS SHALL BE FIELD VERIFIED PRIOR TO ANY MODIFICATIONS OR ADDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	05-23-23
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: **CHEROKEE ELECRICAL OVERHEAD SERVICES SERVICE TRANSFORMER 3XFMR-0001 MCC-1 BLDG T ONE LINE DIAGRAM CONTINUED**

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN: RCE SCALE: NOTED DATE: 04-30-15

CHECKED: CK APPROVED: CK DATE: 05-XX-15

15-039-E086

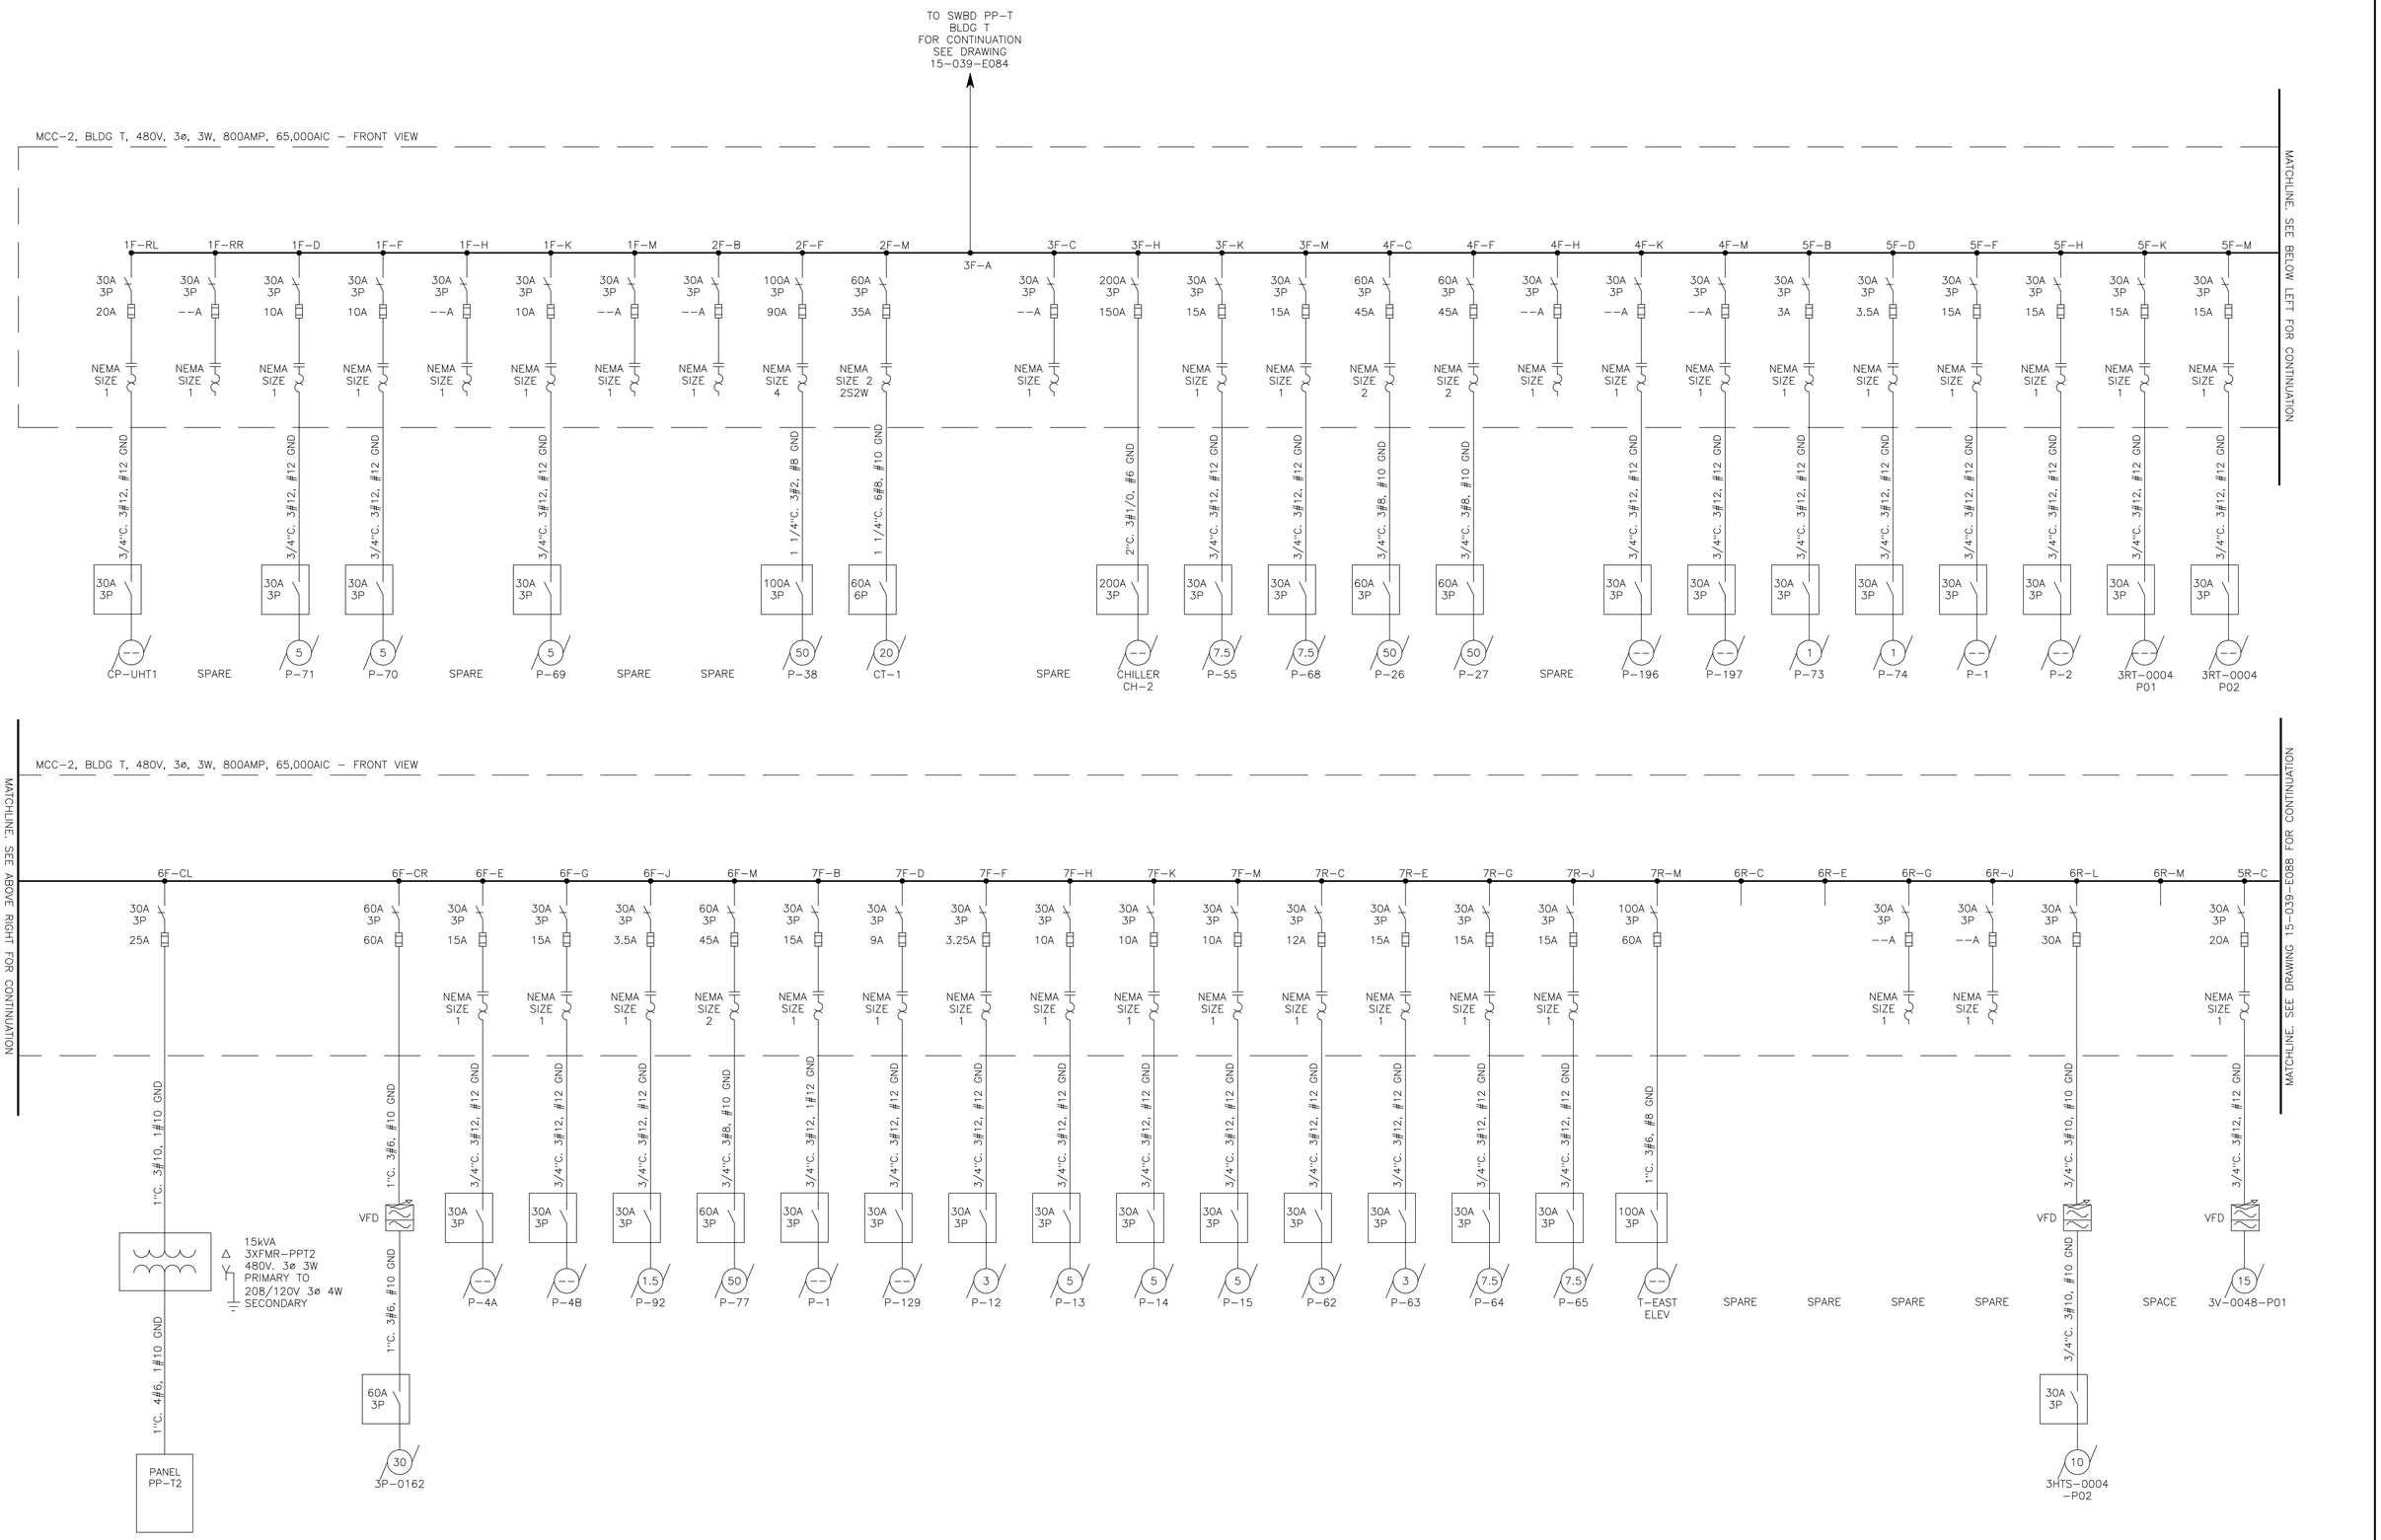

MCC–2 BLDG T ONE LINE DIAGRAM

NOT TO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS–BUILT OR AS–RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

NO	REVISIONS	APPROVED	DATE
3	UPDATED PER AMMONIA PROJECT 22–2412	BR	05–28–25
2	UPDATED PER CC 2670657	EW	07–31–23
1	UPDATE VIA FIELD OBSERVATION	SN	11–01–22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05–31–15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE:
CHEROKEE ELECRICAL OVERHEAD SERVICES
SERVICE TRANSFORMER 3XFMR–0001
MCC–2 BLDG T ONE LINE DIAGRAM

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN:	RCE	SCALE:	NOTED	DATE:	04–30–15	15-039-E087
CHECKED:	CK	APPROVED:	CK	DATE:	05–XX–15	

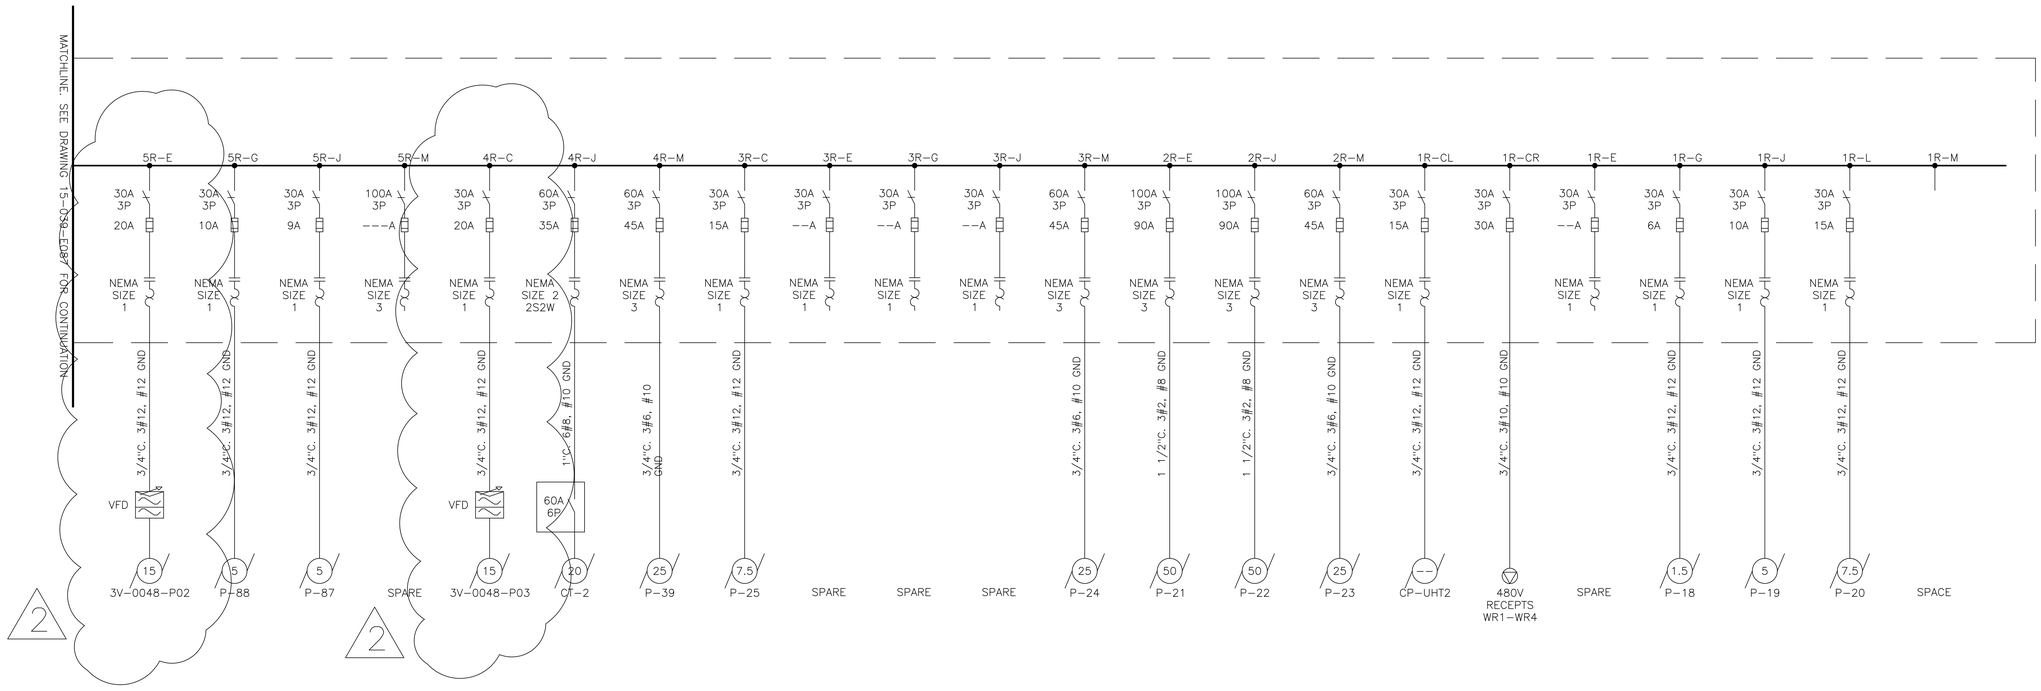

MCC-2 BLDG T ONE LINE DIAGRAM CONTINUED

NOT TO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

NO	REVISIONS	APPROVED	DATE
2	UPDATED PER CC 2670657	EW	07-31-23
1	UPDATE VIA FIELD OBSERVATION	SN	11-01-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE:
CHEROKEE ELECRICAL OVERHEAD SERVICES
SERVICE TRANSFORMER 3XFMR-0001
MCC-2 BLDG T ONE LINE DIAGRAM CONTINUED

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN:	SCALE:	DATE:	
RCE	NOTED	04-30-15	**15-039-E088**
CHECKED: CK	APPROVED: CK	DATE: 05-XX-15	

1 MCC-3Q PART 2 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-15-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0001
MCC-3Q PART 2 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: T FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E090

Drawing File = F:\BC-WorkSpace\S118688\M-Uss11w0002.D-SigmaArch\Masters\Broadway\Broadway\Elec\15-039-E090 MCC-3Q.dwg
Plotted at 10:51am on Dec 05, 2022 by S118688

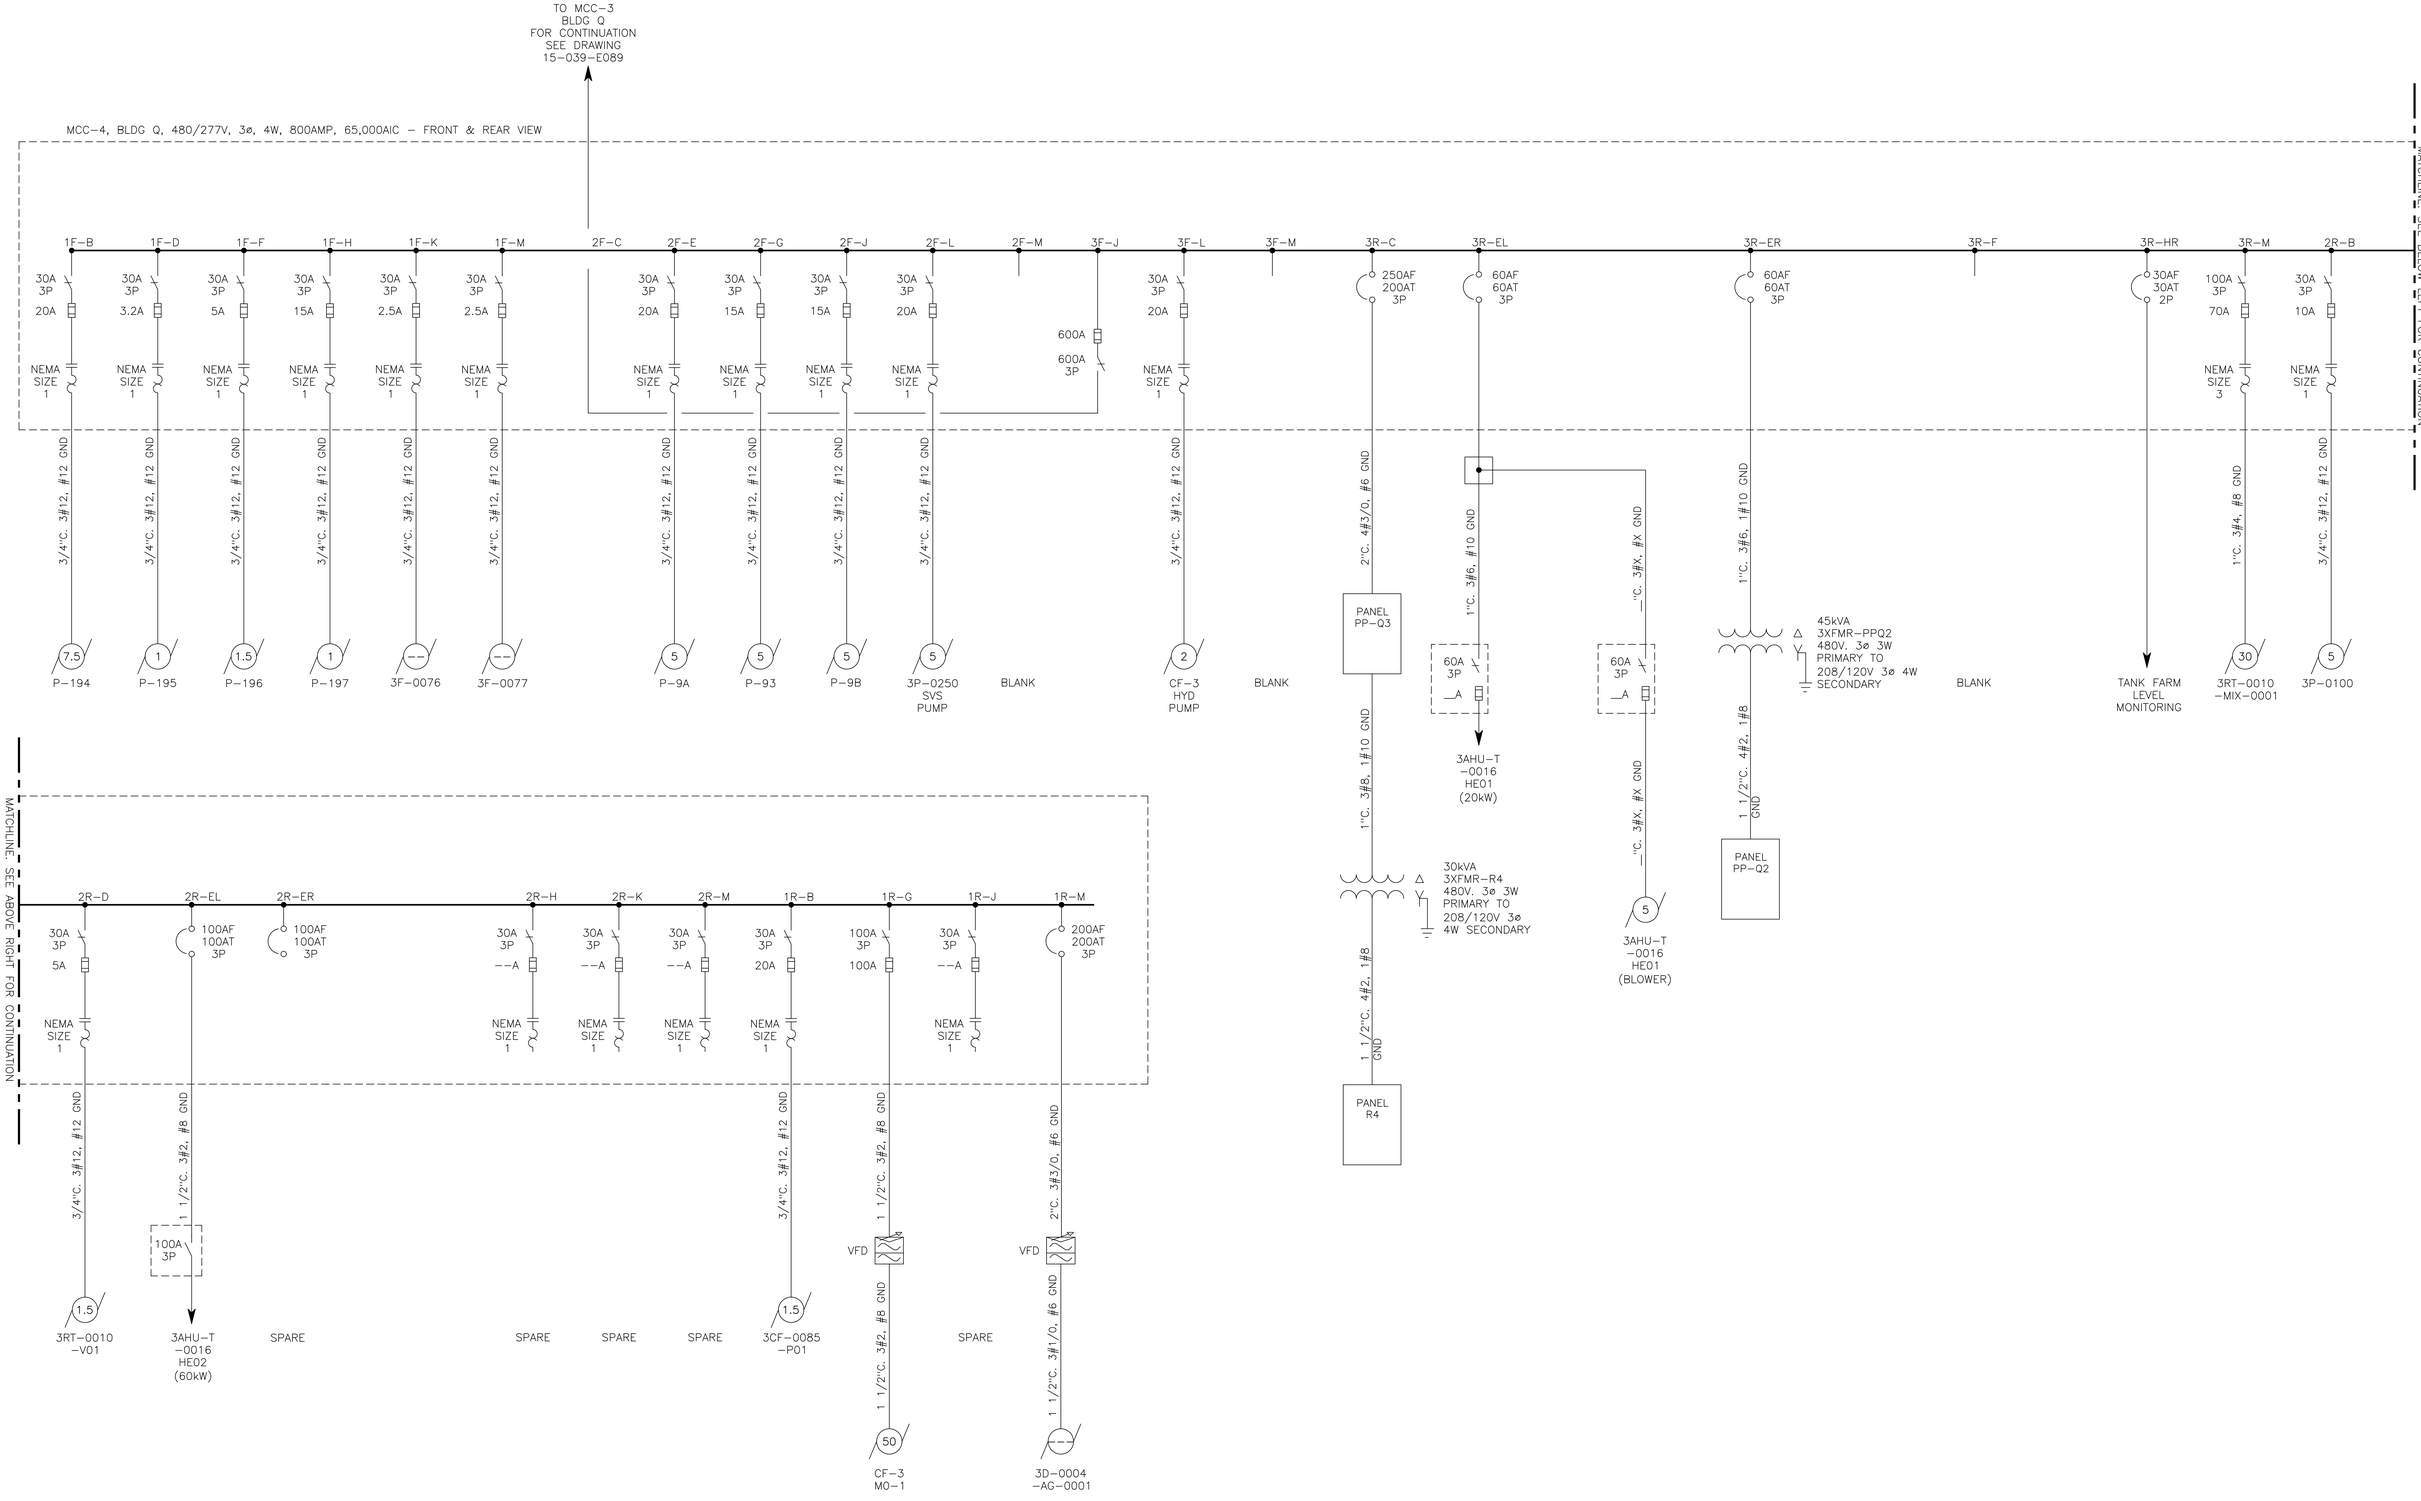

1 MCC-4Q ONE LINE DIAGRAM

NO SCALE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	UPDATE VIA FIELD OBSERVATION	SN	10-12-22
2	ISSUED FOR CONSTRUCTION PROJECT 19-2019 - PHASE C	CK	05-04-20
1	ISSUED FOR CONSTRUCTION PROJECT 17-2010	CK	09-01-17
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-17

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0001
MCC-4Q ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: Q FLOOR: N/A

SCALE: NONE WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E091

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E091 MCC-4Q.dwg
Plotted at 10:51am on Dec 05, 2022 by S118688

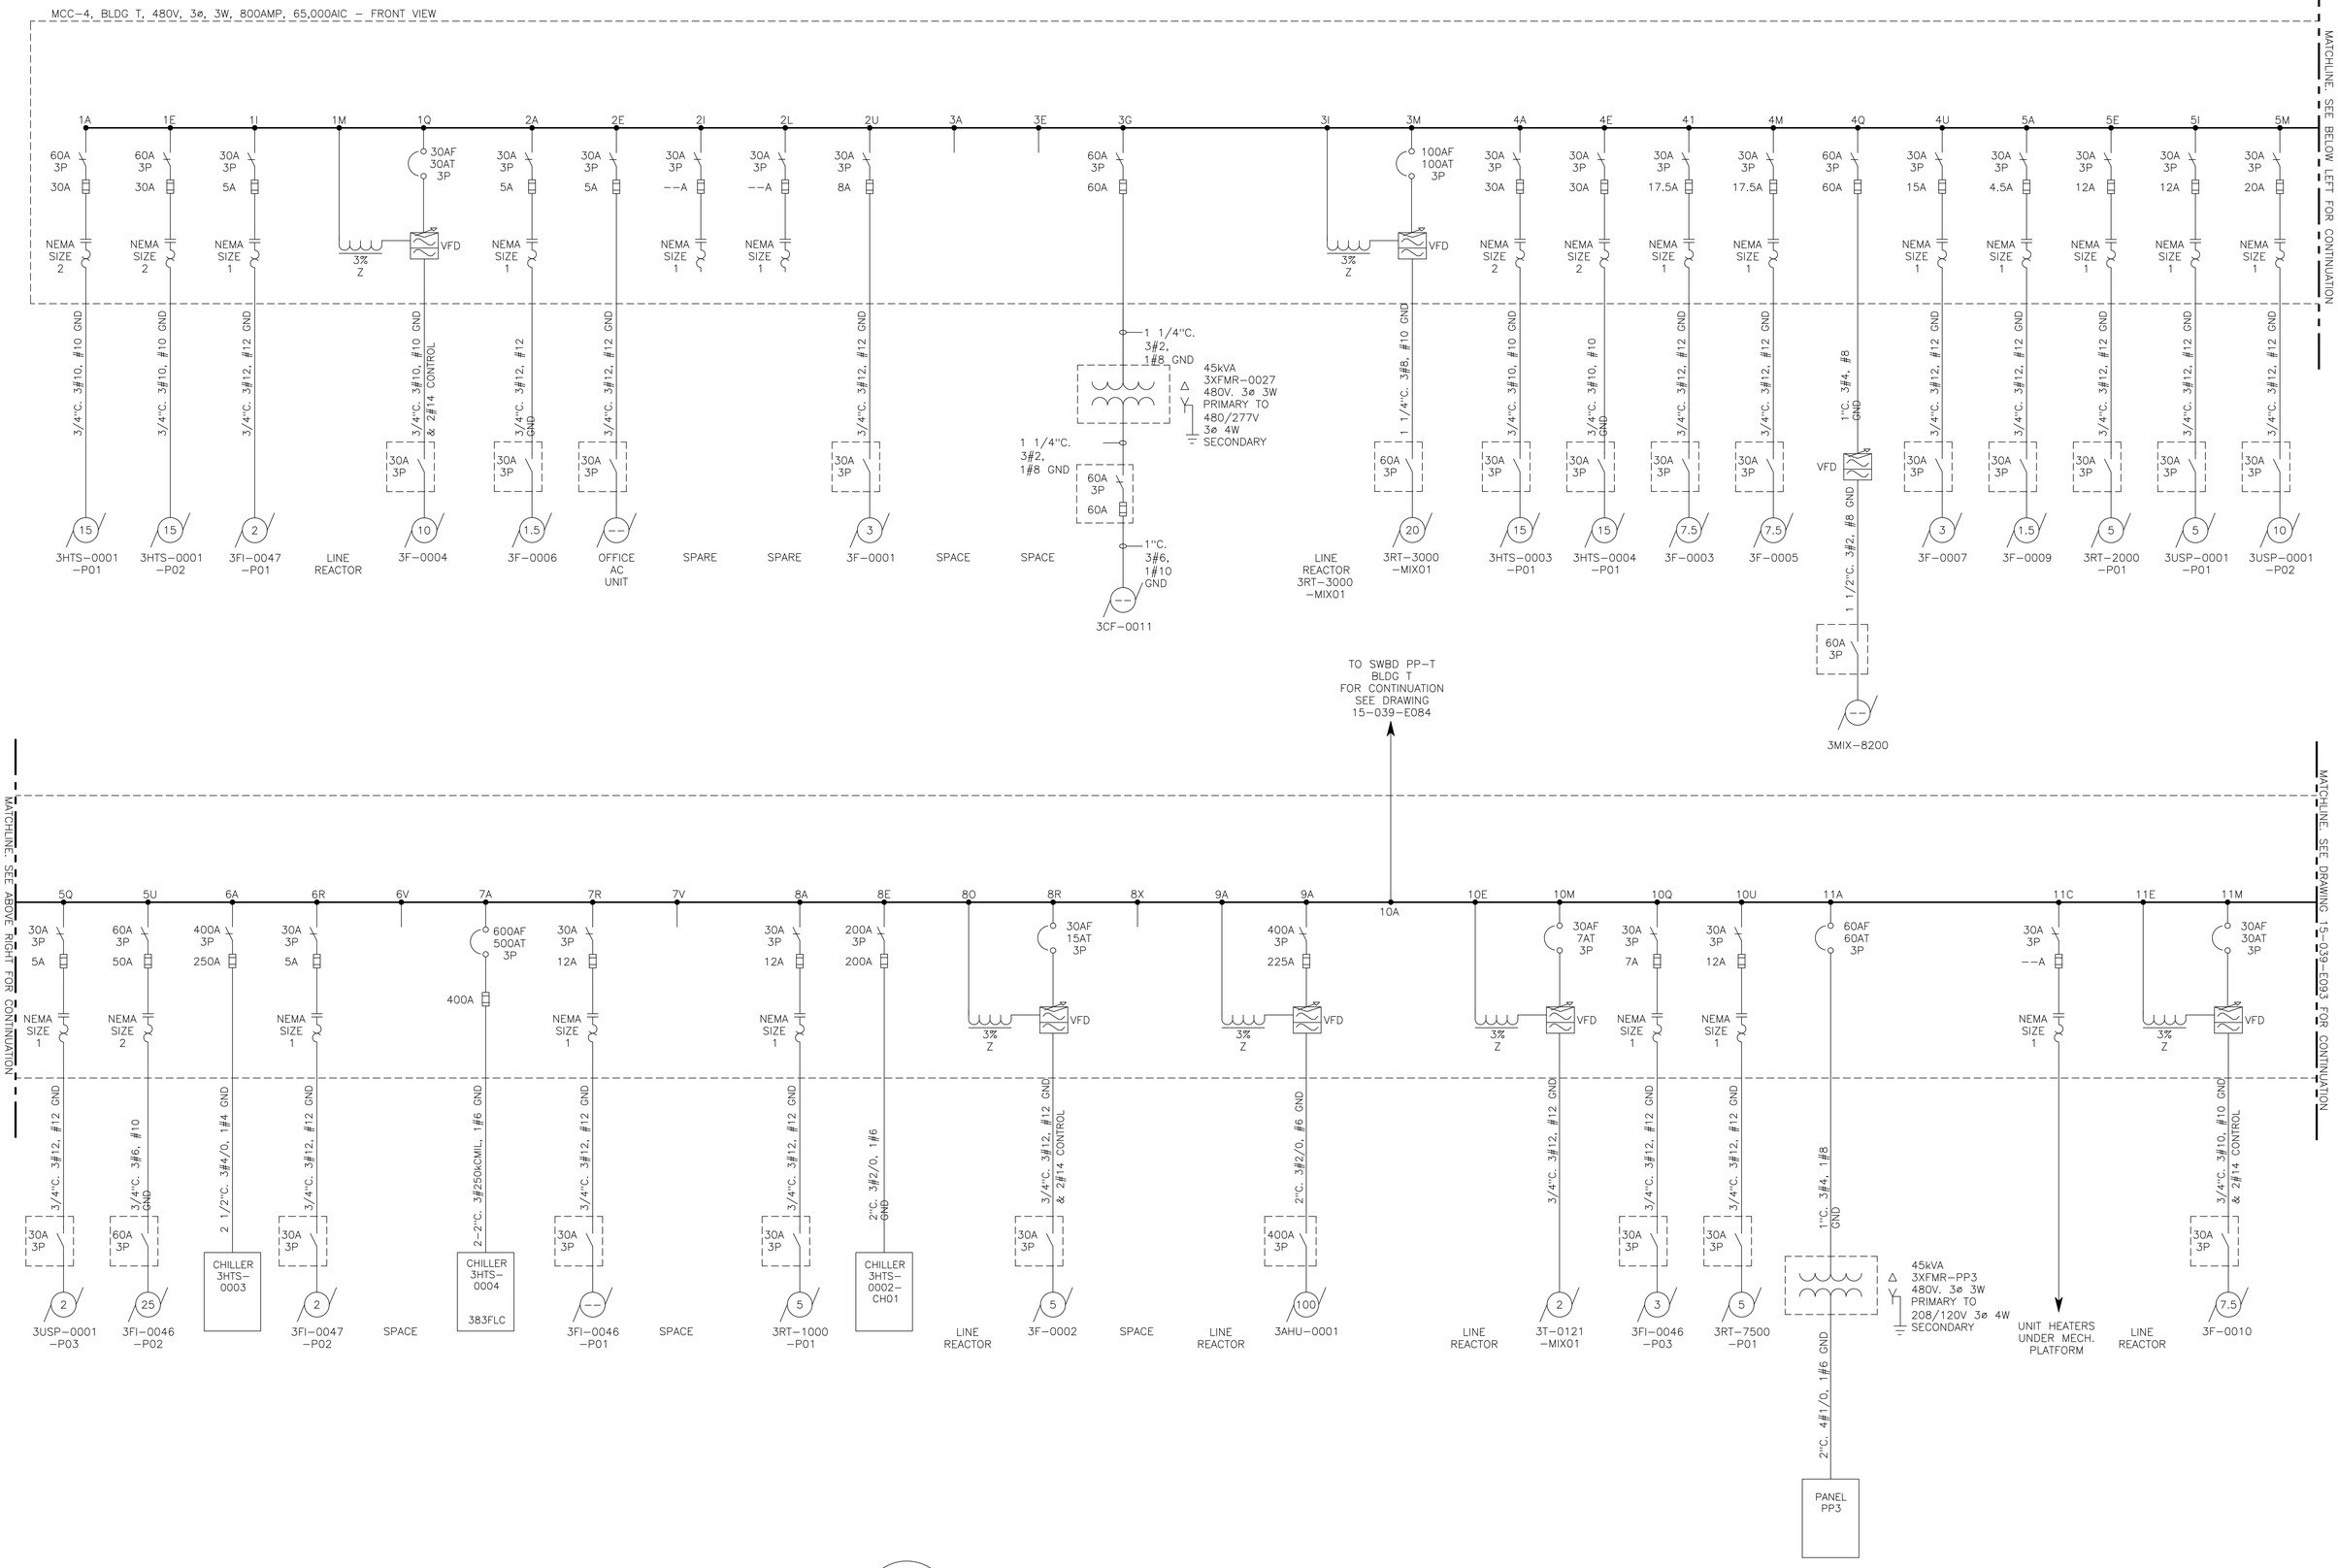

1 MCC-4T PART 1 ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
1	UPDATE VIA FIELD OBSERVATION	SN	11-01-22
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0001
MCC-4T PART 1 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: T FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E
DRAWN: RCE DATE: 04-30-15
APPROVED: CK DATE: 05-31-15
DWG NO: 15-039-E092

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E092 MCC-4T.dwg
Plotted at 8:16am on Jun 19, 2024 by S118688

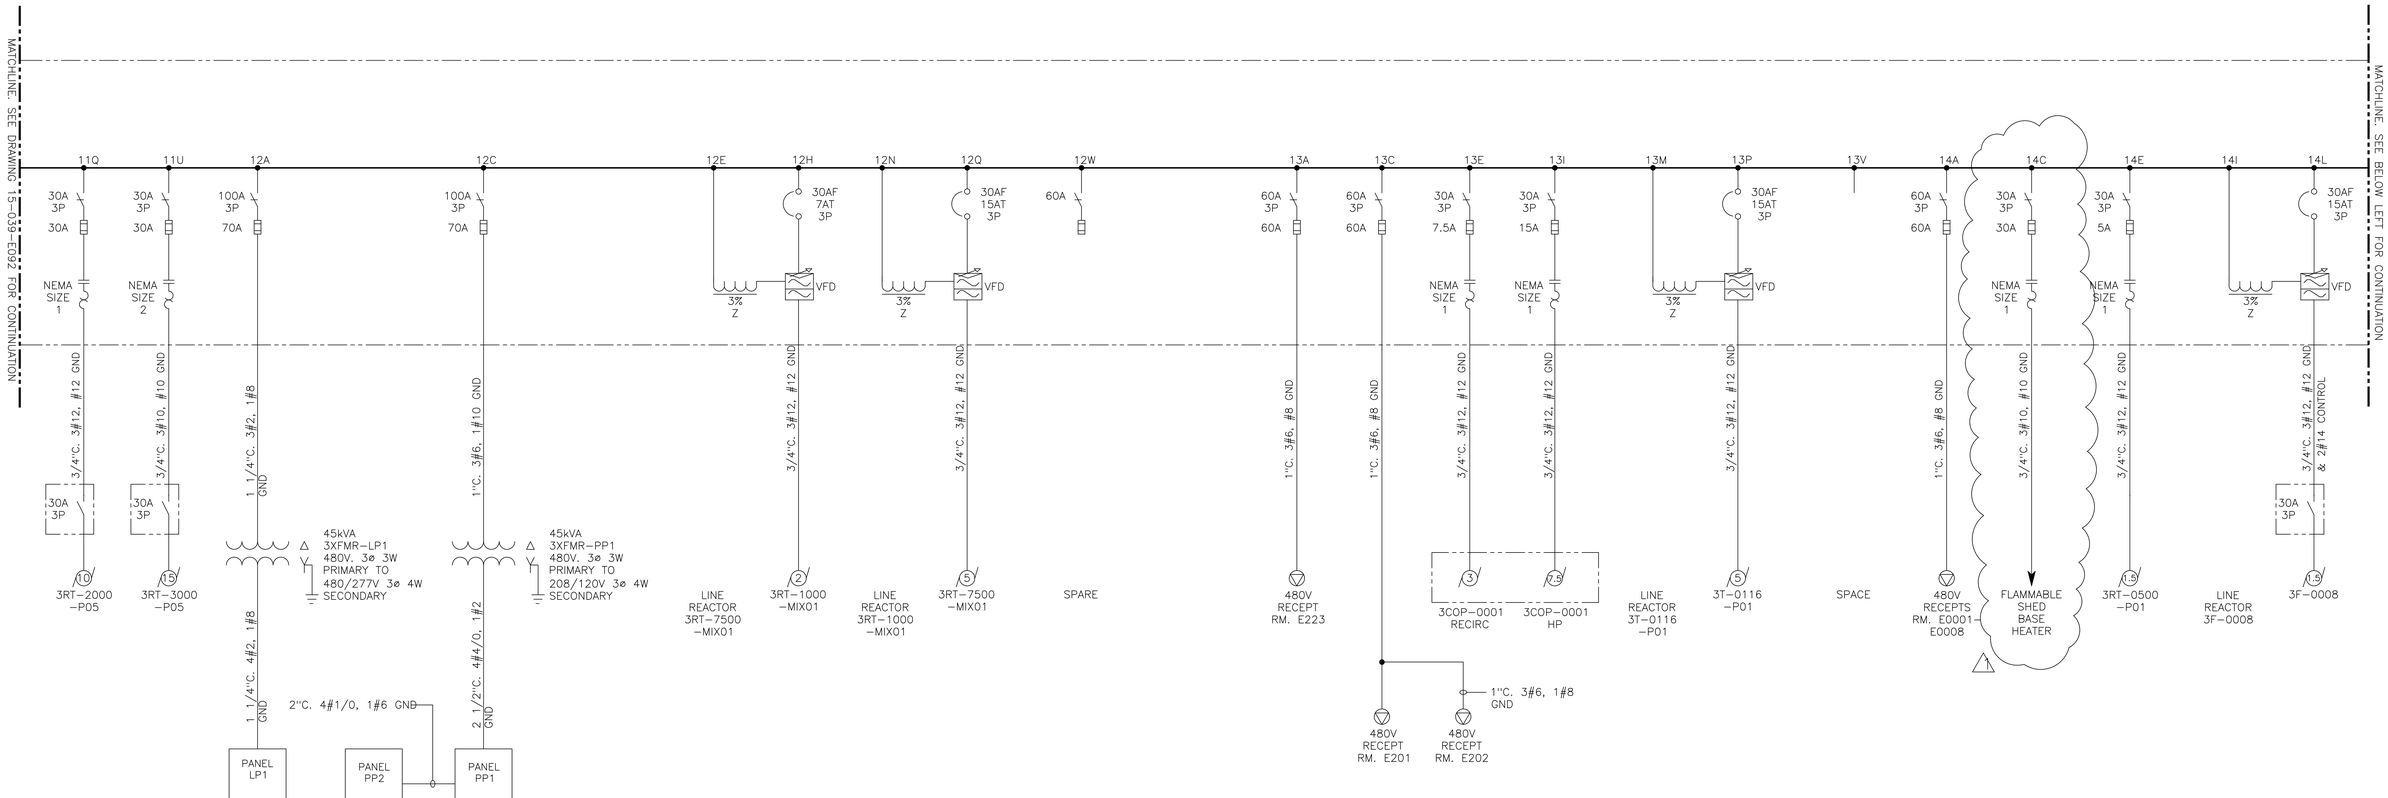

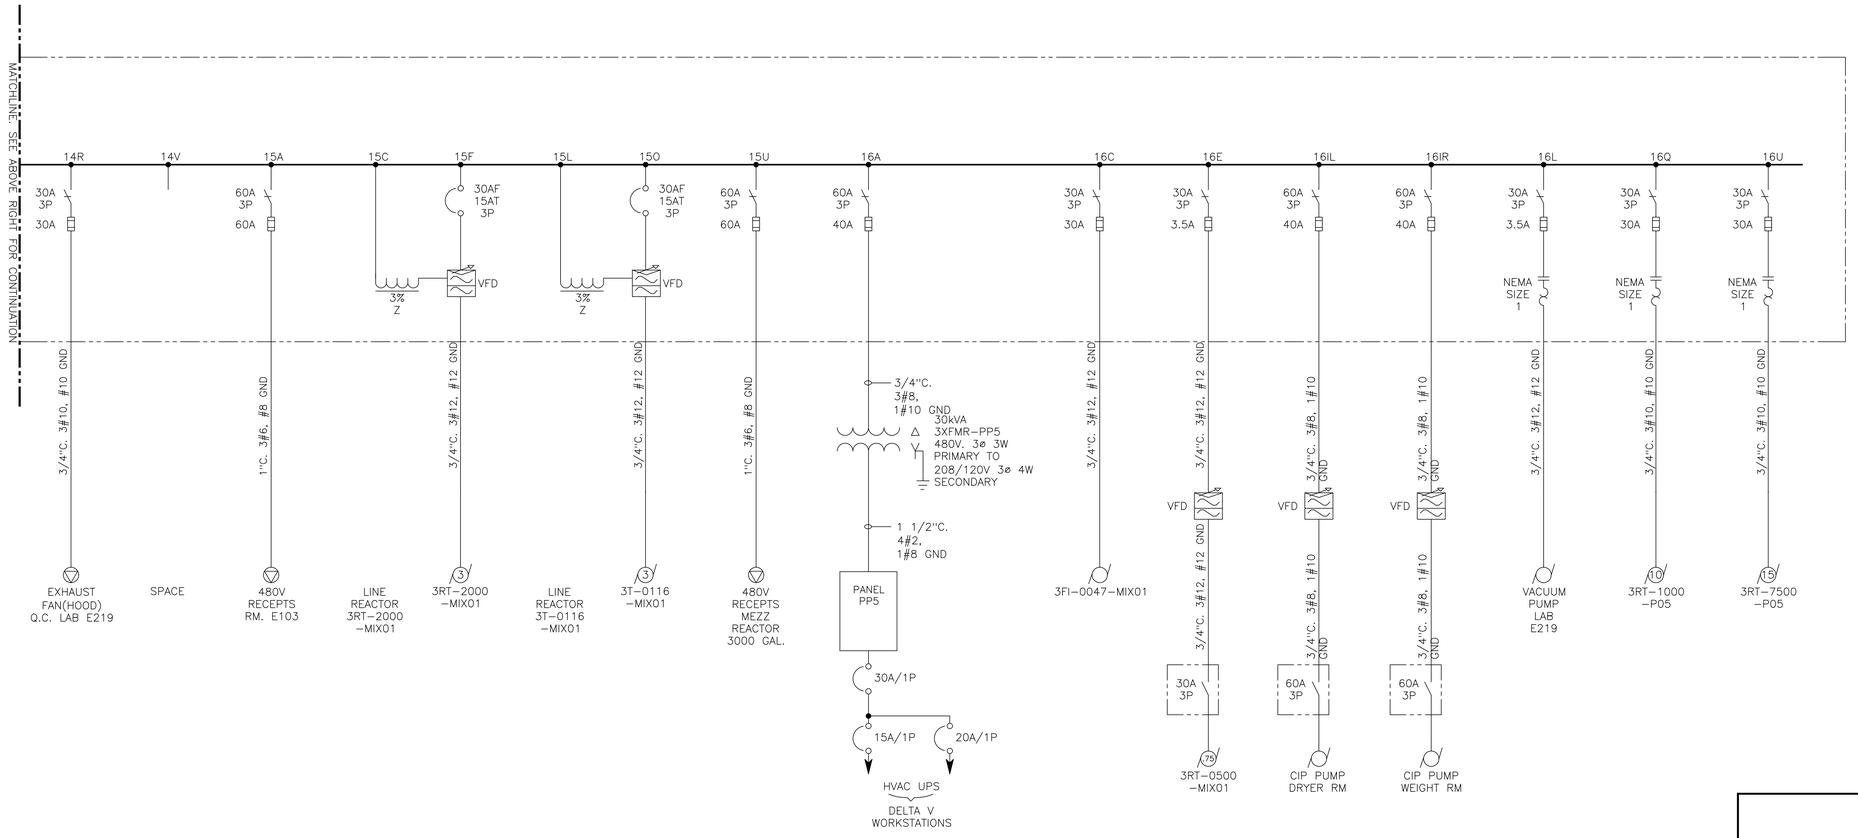

⚠1 FLAMMABLE SHED BASE HEATER INSTALLED

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

MCC-4 BLDG T ONE LINE DIAGRAM CONTINUED

NOT TO SCALE

NO	REVISIONS	APPROVED	DATE
1	UPDATED VIA PROJECT E.300132	EJW	03-04-24
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

DEPARTMENT FOR REVIEW	DESIGN APPROVALS INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: **CHEROKEE ELECRICAL OVERHEAD SERVICES SERVICE TRANSFORMER 3XFMR-0001 MCC-4 BLDG T ONE LINE DIAGRAM CONTINUED**

PLANT: CHEROKEE BLDG: N/A FLOOR: N/A

DRAWN: RCE SCALE: NOTED DATE: 04-30-15

CHECKED: CK APPROVED: CK DATE: 05-XX-15

15-039-E093

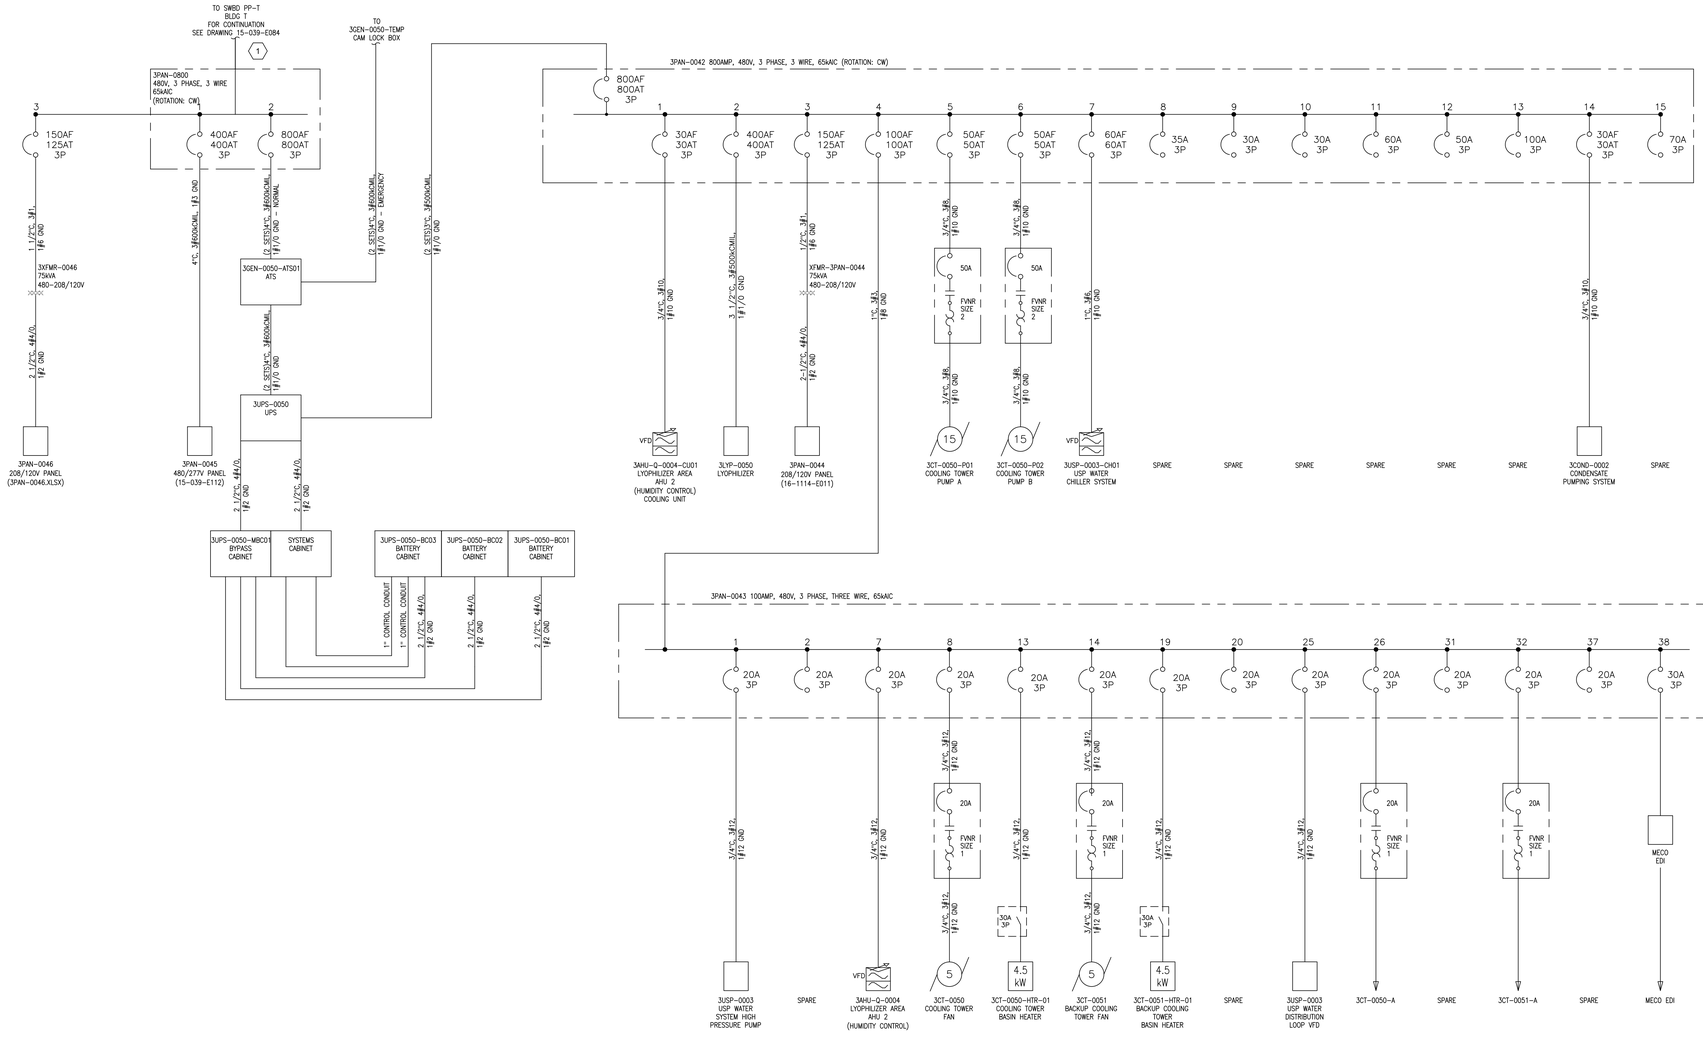

LEGEND:

——— NEW WORK

——— EXISTING TO REMAIN

SHEET KEY NOTES:

1. INTERCEPT EXISTING FEED TO 3PAN–0042 AND EXTEND TO FEED NEW 800A PANEL.

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS–BUILT OR AS–RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
6	AS BUILTS PER CC 4792677	BS	10-24-25
5	UPDATE PER CC 4792677	RU	10-06-25
4	400 LYO BACK-UP POWER PROJECT	JW	09-19-24
3	UPDATED VIA CC 4260083	BS	09-10-24
2	UPDATED VIA CC 3018473	BS	10-27-23
1	UPDATE VIA FIELD OBSERVATION	SN	11-01-22

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE SITE
ONE LINE DIAGRAM
3PAN-0042 , 3PAN-0043

SITE: CHEROKEE BLDG: Q FLOOR:

SCALE:	DRAWN:	DATE:	DWG NO:
NTS PLOTTED ARCH D	BCR	08-31-22	15-039-E094
	APPROVED:	DATE:	

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-0001
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: T FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E095
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E095 FUTURE.dwg
Plotted at 10:51am on Dec 05, 2022 by S118688

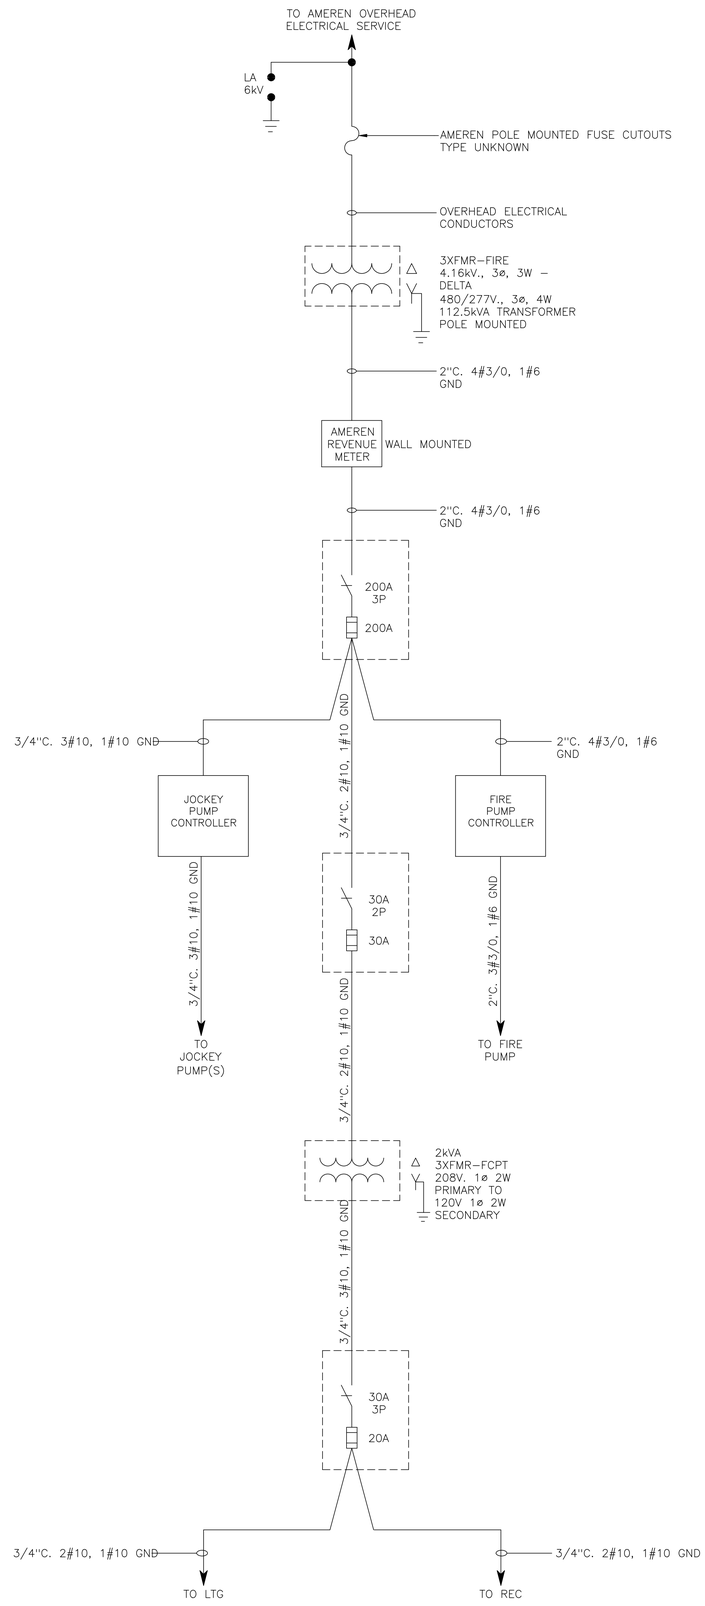

1 FIRE HOUSE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XFMR-FIRE
FIRE HOUSE LINE DIAGRAM

SITE: CHEROKEE BLDG: T FLOOR: N/A

SCALE:	DRAWN:	RCE	DATE:	04-30-15	DWG NO:
1/8"=1'0" WHEN PLOTTED ANSI E	APPROVED:	CK	DATE:	05-31-15	15-039-E096

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E096 3XFMR-FIRE.dwg
Plotted at 10:51am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
GENERATOR 3GEN-002N
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: X/Y FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E102
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E102 FUTURE.dwg
Plotted at 10:55am on Dec 05, 2022 by S118688

PAGE LEFT BLANK INTENTIONALLY

1 FUTURE ONE LINE DIAGRAM

SCALE: NONE

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

0	CHEROKEE PLANT ONE LINE DIAGRAMS	CK	05-31-15
NO	REVISIONS	APPROVED	DATE

MilliporeSigma
A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
GENERATOR 3GEN-002N
FUTURE ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: X/Y FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 04-30-15	DWG NO: 15-039-E103
	APPROVED: CK	DATE: 05-31-15	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E103_FUTURE.dwg
Plotted at 10:56am on Dec 05, 2022 by S118688

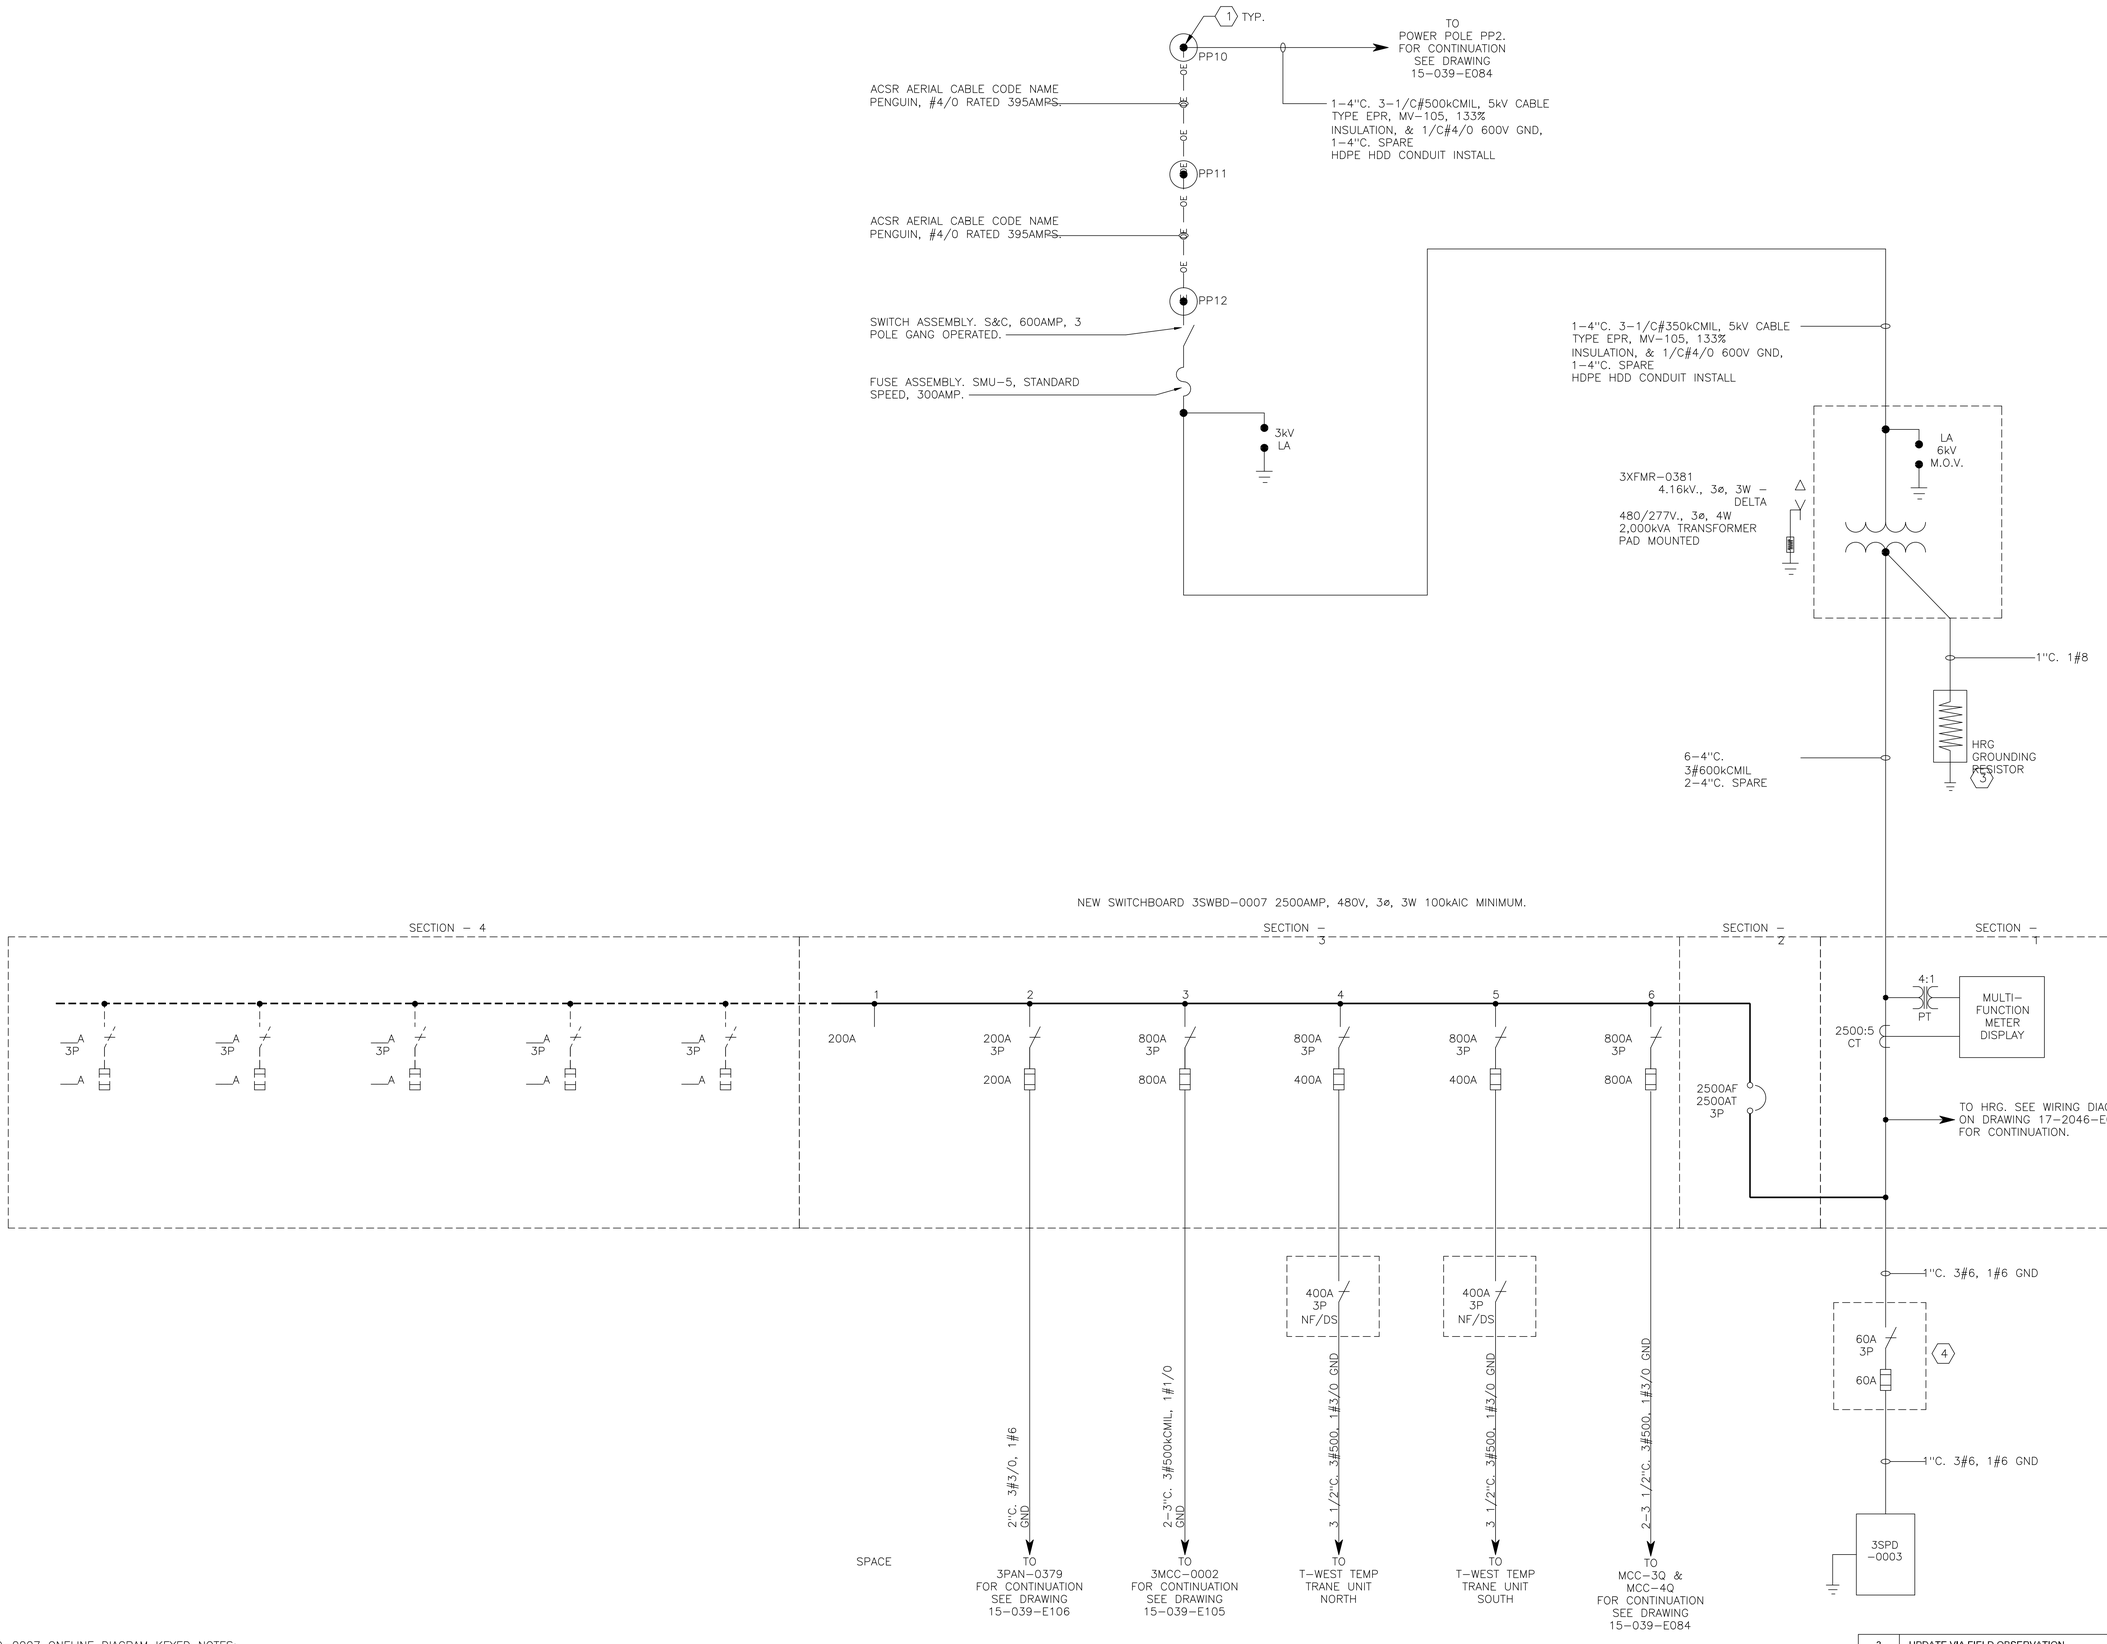

3SWBD-0007 ONELINE DIAGRAM KEYED NOTES:

1. NEW POWER POLES PER NOTES ON ELECTRICAL SITE PLAN DRAWING 15-039-E001.
2. NOT USED.
3. PROVIDE AND INSTALL NEW HRG CABINET. REFER TO DRAWING 17-2046-E001 FOR LOCATION AND DRAWING 17-2046-E008 FOR WIRING REQUIREMENTS.
4. PROVIDE SEPARATE NEMA 1 FUSED DISCONNECT CONNECTION ONLY IF NO INTEGRAL DISCONNECT SWITCH IS PROVIDED WITH SPD.

1 3XFMR-0381 ONE LINE DIAGRAM

SCALE: NONE

2 3XFMR-0002 RELABELED TO 3XFMR-0381

GENERAL NOTES:

1. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS-BUILT OR AS-RECORDED. ANY MODIFICATIONS TO THE EXISTING ELECTRICAL SYSTEM MUST BE FIELD VERIFIED.
2. ALL CONDUIT SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
3. ALL GROUND CONDUCTOR SIZES SHOWN ARE ESTIMATED ONLY AND NOT FIELD VERIFIED.
4. ALL MOTOR HORSEPOWER, STARTER SIZES, OVERLOADS, AND DRIVES ARE SHOWN ESTIMATED ONLY. FIELD VERIFY ALL EXACT CONDITIONS.

NO	REVISIONS	APPROVED	DATE
3	UPDATE VIA FIELD OBSERVATION	SN	10-12-22
2	UPDATE PER CC 2530998	LK	03-23-21
1	ISSUED FOR CONSTRUCTION PROJECT 17-2046 - POWER	CK	10-07-20
0	ISSUED FOR BIDDING PROJECT 17-2046 - POWER	CK	06-08-20

MilliporeSigma

A business of Merck KGaA, Darmstadt, Germany

TITLE: CHEROKEE PLANT
SERVICE TRANSFORMER 3XMFR-0002
3XMFR-0002 ONE LINE DIAGRAM

SITE: CHEROKEE BLDG: N/A FLOOR: N/A

SCALE: 1/8"=1'0" WHEN PLOTTED ANSI E	DRAWN: RCE	DATE: 10-24-19	DWG NO: 15-039-E104
	APPROVED: CK	DATE: 06-08-20	

Drawing File = F:\BC-WorkSpace\S118688\M-Ussl1w0002,D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E104.dwg
Plotted at 3:57pm on Aug 27, 2024 by S118688

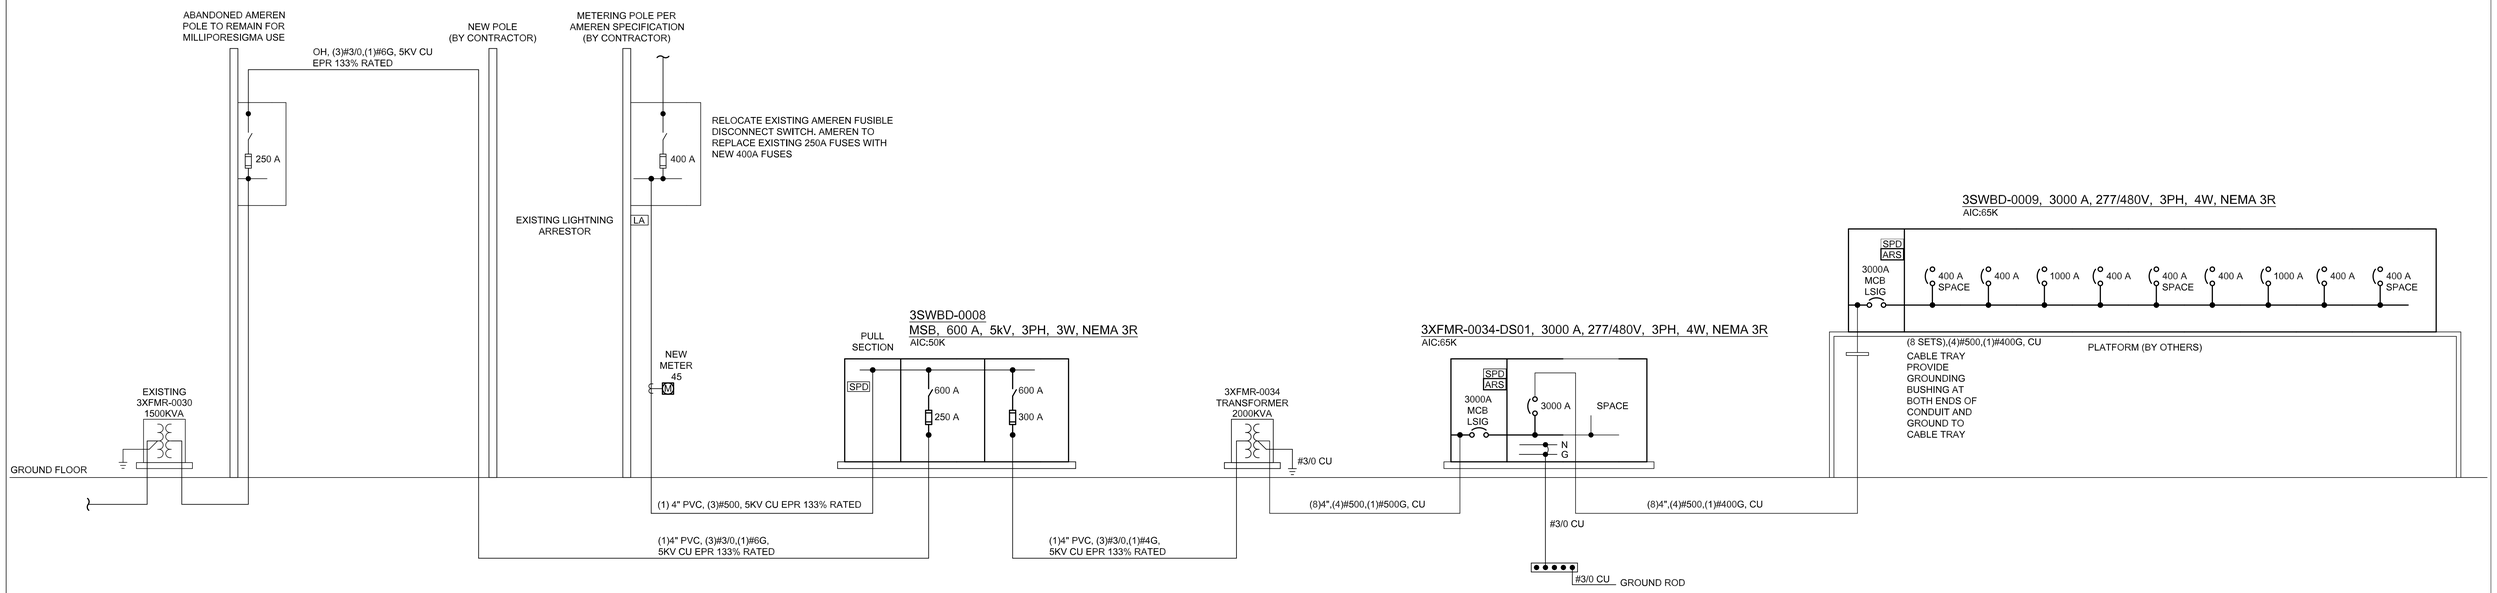

1

3SWBD-0008 ONE-LINE DIAGRAM

SCALE: NONE

0	DRAWING CREATED	EJW	10/02/2025
NO	REVISIONS	APPROVED	DATE

DEPARTMENT FOR	DESIGN APPROVALS	
REVIEW	INITIAL	DATE
COMPLIANCE		
DEPARTMENTS		
ENGINEERING		
MAINTENANCE		
SAFETY		

SIGMA-ALDRICH

TITLE: SWBD-0008
AMEREN METER 69 FEED

PLANT: CHEROKEE BLDG: N/A FLOOR: 1

DRAWN:	SCALE: NTS	DATE:	15-039-E107
CHECKED:	APPROVED:	DATE:	

Drawing File = F:\BC-WorkSpace\S118688\M-Uss1w0002.D-SigmaArch\Masters\Cherokee\NA\Elec\15-039-E107.dwg
Plotted at 8:22am on Nov 24, 2025 by S118688