Dry-installed Volute Casing Pump

Sewatec / Sewabloc

60 Hz
ASME / NEMA motors

Type Series Booklet

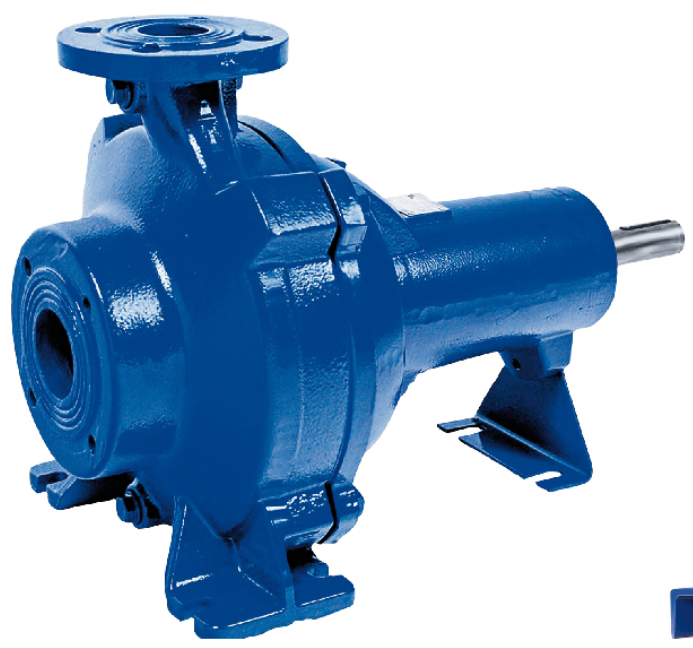

Sewatec

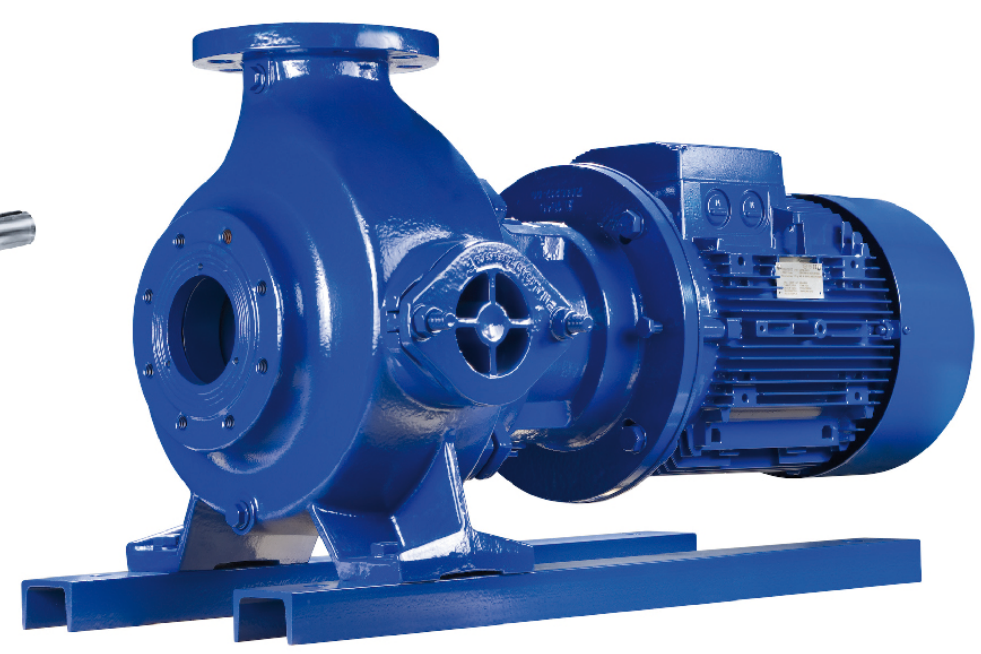

Sewabloc

Legal information/Copyright

Type Series Booklet Sewatec / Sewabloc

Contents

Waste Water 4
Dry-installed Volute Casing Pump 4
Sewatec / Sewabloc 4
Main applications 4
Fluids handled 4
Operating data 4
Designation 4
Design details 4
Materials 5
Product benefits 5
Acceptance tests / guarantees 5
Design and selection information 6
Selection aid for materials and hydraulic systems per fluid 6
Shaft seal 7
Impellers per material variant, 60 Hz 8
Maximum diameter of K and D impellers per bearing bracket and speed 10
Maximum diameter of F and E impellers per bearing bracket and speed 12
Motor frames per pump 14
Product overview 16
Material variants 17
Technical data 18
K impeller 18
D impeller 21
F impeller 23
E impeller 25
Selection charts 26
Sewatec/Sewabloc, n = 1750/1160/875 rpm, K impeller, nominal diameter of the discharge nozzle DN 50, 65, 80, 100, 125 (diameter selection chart) 26
Sewatec/Sewabloc, n = 1750/1160/875 rpm, K impeller, nominal diameter of the discharge nozzle DN 150, 200 (diameter selection chart) 27
Sewatec/Sewabloc, n = 1160/875/700 rpm, K impeller, nominal diameter of the discharge nozzle DN 250, 300 (diameter selection chart) 28
Sewatec/Sewabloc, n = 875/700/585/500 rpm, K impeller, nominal diameter of the discharge nozzle DN 350, 400, 500, 600, 700 (diameter selection chart) 29
Sewatec/Sewabloc, n = 1750/1160/875 rpm, D impeller (diameter selection chart) 30
Sewatec/Sewabloc, n = 1750 rpm, F-max impeller (speed selection chart) 31
Sewatec/Sewabloc, n = 1750/1160/875 rpm, F impeller (diameter selection chart) 32
Sewatec/Sewabloc, n = 1160/875/700/585 rpm, E impeller (diameter selection chart) 33
Installation types 34
Installation types per bearing bracket and impeller type 36
Recommended spare parts stock for 2 years' operation to DIN 24296 40
Scope of supply 40
General assembly drawings with list of components 41
General assembly drawing: Sewatec with bearing brackets S01, S02, S03, S04 41
General assembly drawing: Sewatec with bearing brackets S05, S06, S07, S08 43
General assembly drawing: Sewabloc 49

Waste Water

Dry-installed Volute Casing Pump

Sewatec / Sewabloc


Sewatec

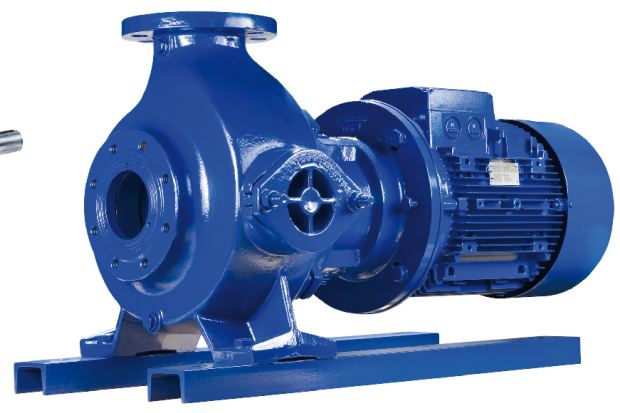
Sewabloc

Main applications

- Waste water transport
- Waste water disposal
- Waste water management
- Transport of contaminated surface water
- Sludge processing

Fluids handled

- Waste water
- Solids-laden river water
- Contaminated surface water
- Sewage containing feces
- Industrial waste water
- Fluids containing gas
- Activated sludge
- Digested sludge
- Raw sludge

Operating data

Operating properties

Characteristic		Impeller type			
		D	E	F	K
Flow rate	Q [US.gpm]	≤ 5500	≤ 1833	≤ 2500	≤ 15000
	Q [l/s]	≤ 350	≤ 139	≤ 189	≤ 900
Head	H [ft]	≤ 130	≤ 62	≤ 130	≤ 377
	H [m]	≤ 40	≤ 19	≤ 40	≤ 115
Fluid temperature	T [°F]	≤ 158	≤ 158	≤ 158	≤ 158
	T [°C]	≤ 70	≤ 70	≤ 70	≤ 70
Operating pressure	p [psi]	≤ 145	≤ 145	≤ 145	≤ 145
	p [bar]	≤ 10	≤ 10	≤ 10	≤ 10

Designation

Example: Sewatec F100-251 / G V

Designation key

Code	Description	
Sewatec	Type series	
	Sewatec	
	Sewabloc	
F	Impeller type (⇨ Page 4)	
	K	Closed multi-channel impeller
	D	Open, diagonal single-vane impeller
	F	Free-flow impeller
	E	Closed single-channel impeller
100	Nominal discharge nozzle diameter [mm]	
251	Nominal impeller diameter [mm]	
G	Material variant (⇨ Page 17)	
	G	Standard design, wetted components made of gray cast iron
	G1	Like G with impeller made of duplex stainless steel
	G2	Like G with impeller made of white cast iron
	GH	Like G with impeller and intermediate casing made of white cast iron
	GC	Like G with impeller and discharge cover made of duplex stainless steel
V	Type of installation (⇨ Page 34)	
	Sewabloc:	
	BLOC	
	BLOC-VF	
	Sewatec:	
	Fig.0	
	3EN	
	3ENH	
	V	
	VU	
	VGW	

Design details

Design

Sewatec:

- Volute casing pump
- Back pull-out design
- Single-stage
- Various, application-oriented installation types

Sewabloc:

- Volute casing pump
- Close-coupled pump with shaft seal
- Various, application-oriented installation types

Shaft seal

Sewatec (bearing brackets S01, S02, S03, S04), Sewabloc:

- Two bi-directional mechanical seals in tandem arrangement, with liquid reservoir

Sewatec (bearing brackets S05, S06, S07, S08):

- Two bi-directional mechanical seals in tandem arrangement, with liquid reservoir
- Gland packing

Impeller type

K impeller:

	Closed multi-channel impeller (impeller type K)	**For use with the following fluids:** Contaminated, solids-laden, non-gaseous fluids without stringy material

K impellers are suitable for handling the following fluids:

- Activated sludge
- Landfill waste water
- Industrial waste water
- Industrial effluent
- Mechanically treated waste water
- Pre-screened waste water
- Contaminated surface water

D impeller:

	Open, diagonal single-vane impeller (D impeller)	**For use with the following fluids:** Fluids containing solid substances and long fibers

E impeller:

	Closed single-channel impeller (impeller type E)	**For use with the following fluids:** Fluids containing solid substances and stringy material

F impeller/F-max impeller:

	Free-flow impeller (F impeller /F-max impeller)	**Suitable for the following fluids:** fluids containing solid substances and long fibers as well as fluids with entrapped air or gas

D, E and F/Fmax impellers are suitable for handling the following fluids:

- Activated sludge
- Digested sludge
- Heating sludge
- Mixed water
- Raw waste water
- Raw sludge
- Recirculated sludge

Bearings

Sewatec (bearing brackets S01, S02, S03, S04):

- Grease-packed, zero-maintenance deep groove ball bearings (sealed for life) on pump and drive end

Sewatec (bearing brackets S05, S06, S07, S08):

- Grease-packed rolling element bearings with re-lubrication system on pump and drive end

Sewabloc:

- Grease-packed, zero-maintenance deep groove ball bearing (sealed for life) on pump end

Materials

Overview of available materials

Description	Material
Pump casing	Gray cast iron (A 48 Class 35 B)
Wear plate	Gray cast iron (A 48 Class 35 B) / duplex stainless steel / wear-resistant white cast iron
Impeller	Gray cast iron (A 48 Class 35 B) / duplex stainless steel / wear-resistant white cast iron
Shaft	Stainless steel 420 / FXM-19
Casing wear ring	Gray cast iron (A 48 Class 35 B) / stainless steel (AISI 329)
Impeller wear ring	Stainless steel (optional)
Mechanical seal	SiC/SiC

Product benefits

- Variety of hydraulic systems
  The right impeller for each fluid to be handled, with optimum efficiencies and high operating reliability thanks to large free passages
- Double mechanical seal in tandem arrangement with liquid supply chamber makes for high operating reliability.
- Low maintenance thanks to grease-packed rolling element bearings sealed for life
- Standardized components are interchangeable within the Sewatec/Sewabloc and Amarex KRT series, so spare parts inventories can be optimized and costs reduced.

Acceptance tests / guarantees

Functional test

- Every pump undergoes functional testing to KSB standard ZN 56535.
- Operating data is guaranteed to DIN EN ISO 9906/2/2B or Hydraulic Institute Level A/B.

Acceptance tests

- Acceptance tests to ISO/DIN or a comparable standard are available against a surcharge.
- Acceptance tests to Hydraulic Institute available on request.

Quality assurance

- Quality is assured by means of an audited and certified quality assurance system to DIN EN ISO 9001.

Design and selection information

Selection aid for materials and hydraulic systems per fluid

The table below for your guidance is based on KSB's long-standing experience. The data are standard values and are not to be considered as generally binding recommendations. More detailed advice is available from our specialist department in Halle. Make use of our laboratory's experience when selecting materials.

Selection aid for materials and hydraulic systems per fluid

Fluid handled[1]	Recommended material	Recommended impeller type[2]	Comments, further recommendations
Gray water	Gray cast iron	K, D, E, F	-
Solids-laden river water	Gray cast iron	K, D, E, F	Free passage > any solids contained, possibly pre-screened
Contaminated surface water	Gray cast iron	K, D, E, F	Free passage > any solids contained, possibly pre-screened
Waste water			
- Untreated municipal waste water	Gray cast iron	F, D, E, (K)[3]	ATV recommends a free passage of 4" [100 mm]; min. free passage of 3" [75 mm]; multi-channel impellers can be used depending on the system conditions and free passage.
- Waste water containing air or gas	Gray cast iron	F	Up to 8 %, contact KSB for fluids with high outgassing rates
Sludge			
- Raw sludge	Gray cast iron	F, E, D, K	Pumpable up to a dry substance content of: 13 % (D), 8 % (F), 6 % (E), 5 % (K)
- Digested sludge	Gray cast iron	F, E, D	Pumpable up to a dry substance content of: 13 % (D), 8 % (F), 6 % (E)
- Activated sludge	Gray cast iron	K	Pumpable up to a dry substance content of: 5 % (K)
Industrial waste water containing ...			
- Paint suspensions	Gray cast iron	K	Solvent-free, observe the operator's instructions.
- Lacquer/paint/varnish suspensions	Gray cast iron	F, E	Solvent-free, contact KSB to handle silicone-free fluids
- Fibers/pulp	Gray cast iron	F, D	-
- Chips/swarf	Gray cast iron	K, F	Material variants G2 or GH, special mechanical seal
- Abrasive substances[4]	Gray cast iron	K, F	Material variants G2 or GH, special mechanical seal
Mildly acidic industrial waste water	Gray cast iron	K, F	pH value ≥ 6.5 material variant G1 and FPM (Viton) O-rings
Neutral non-corrosive waste water			
- Ammonium hydroxide	Gray cast iron	K	-
- Ammonium hydroxide 5 % NH_4OH	Gray cast iron	K	-
- Urea 25 % $(NH_2)_2$-CO	Gray cast iron	K	-
- Potassium hydroxide 10 % KOH	Gray cast iron	K	-
- Calcium hydroxide 5 % $Ca(OH)_2$	Gray cast iron	K	-
- Sodium hydroxide 5 % NaOH	Gray cast iron	K	-
- Sodium carbonate 30 % Na_2CO_3	Gray cast iron	K	-
Neutral, non-corrosive waste water containing ...			
- Aliphatic hydrocarbons, e.g. oils, petrol, butane, methane	Gray cast iron	K	-
- Aromatic hydrocarbons, e.g. benzene, styrene	Gray cast iron	K	FPM (Viton) O-rings[5]

1) For any fluids which are not listed in this table contact KSB.
2) The first impeller type listed should be given preference.
3) Contact KSB.
4) Severe hydroabrasive wear occurs if solids contents of 0.5 g/l or higher are combined with circumferential speeds exceeding 66 ft/s [20 m/s] or low-flow conditions to the left of the operating point.
5) The hydrocarbons mentioned may occur in very high concentrations due to the difference in specific weight and their low solubility. If this is the case, contact KSB.

Fluid handled[1]	Recommended material	Recommended impeller type[2]	Comments, further recommendations
- Chlorinated hydrocarbons, e.g. tetrachloroethylene, ethylene chloride, chloroform, methylene chloride	Gray cast iron	K	FPM (Viton) O-rings[5]
Highly abrasive industrial waste water causing wear (chemically neutral)[6]			
- Water containing iron ore sinter	Wear-resistant white cast iron	K	Sinter content < 4 g/l, GH variant, special mechanical seal
- Lime milk containing quartz and pigment suspensions	Wear-resistant white cast iron	K	Lime milk of up to 15 %, GH variant, special mechanical seal
- Wash water containing solids	Wear-resistant white cast iron	K, F	Material selection based on fluid analysis, material variant GH, special mechanical seal
- Waste water containing dust or ash	Wear-resistant white cast iron	K	Material selection based on fluid analysis, material variant GH, special mechanical seal
Water/sand mixture	Wear-resistant white cast iron	K, F	Solids content of up to 5 g/l, material variant GH, special mechanical seal
Waste water and landfill seepage water	Duplex stainless steel	K, F	Material variant GC (not for seawater and brackish water)

Shaft seal

Available shaft seal types per bearing bracket

Bearing bracket		Standard design		Standard variant[7]	
Sewatec	Sewabloc	Mechanical seal with elastomer bellows (NBR, optional Viton)[8]	Stationary mechanical seal whose spring is outside the fluid handled (Cartex S10 cartridge seal)	Product-side mechanical seal with covered spring[9]	Gland packing
		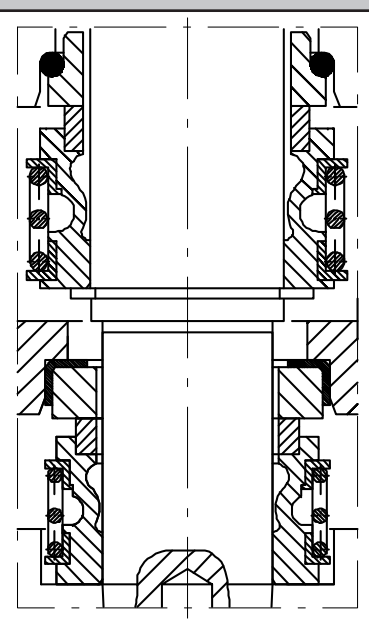	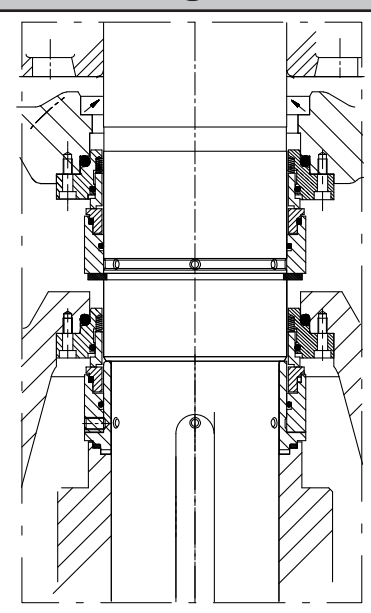	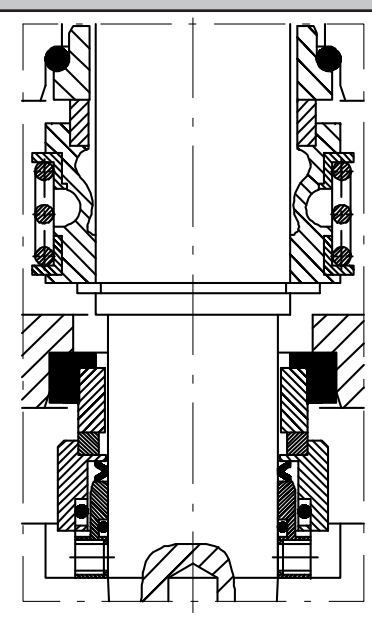	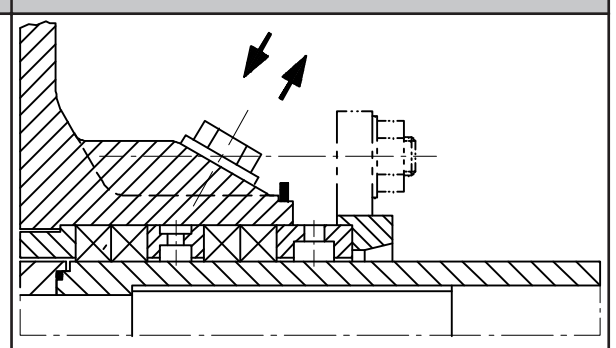
S01	–	✗	-	✗	-
–	B01	✗	-	-	-
S02	–	✗	-	✗	-
–	B02	✗	-	-	-
S03	–	✗	-	✗	-
–	B03	✗	-	-	-
S04	–	✗	-	✗	-
S05	–	✗	-	✗	✗
S06	–	✗	-	-	✗
S07	–	✗	-	-	✗
S08	–	-	✗	-	✗

1) For any fluids which are not listed in this table contact KSB.
2) The first impeller type listed should be given preference.
6) The required material variants highly depend on the operating hours, speed and flow velocity.
7) A surcharge and longer delivery times apply to standard variants.
8) For all types of waste water
9) For very abrasive fluids or fluids containing metallic particles (e.g. shavings from drilling)

Impellers per material variant, 60 Hz

Impeller types per material variant, 60 Hz

Size	Bearing bracket		Material variant																				
			G[10]				G1[11]				G2[12]				GH[13]				GC[14]			
	Sewatec	Sewabloc	Impeller				Impeller				Impeller				Impeller				Impeller			
			K	D	F	E	K	D	F	E	K	D	F	E	K	D	F	E	K	D	F	E
050-215	-	B01	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
050-216	-	B01	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
050-250	S01	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
050-250	-	B01	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
050-251	S02	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-
050-251	-	B02	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-
065-215	-	B01	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
065-250	S01	-	✗	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
065-250	-	B01	✗	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
080-216	-	B01	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
080-250	S01	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
080-250	-	B01	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
080-315	S03	-	✗	✗	✗	-	✗	✗	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
080-315	S05	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
080-315	-	B03	✗	✗	✗	-	✗	✗	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
080-316	S03	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
080-316	-	B03	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-215	-	B01	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
100-250	S01	-	-	-	✗	✗	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
100-250	-	B01	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-
100-251	S02	-	✗	✗	✗	✗	✗	✗	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
100-251	-	B02	✗	✗	✗	-	✗	✗	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
100-252	S01	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-252	-	B01	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-253	S01	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-253	-	B01	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-315	S05	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-316	S03	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-316	-	B03	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-400	S04	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-400	S05	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-401	S04	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	-	-	-	-	-	-	-	-
100-401	S05	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	-	-	-	-	-	-	-	-
125-315	S03	-	✗	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
125-315	-	B03	✗	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
125-317	S03	-	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-251	S02	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-251	-	B02	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-315	S03	-	✗	✗	✗	✗	✗	✗	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
150-315	-	B03	✗	✗	✗	-	✗	✗	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-
150-400	S04	-	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
150-400	S05	-	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
150-401	S04	-	✗	-	✗	-	✗	-	✗	-	✗	-	✗	-	-	-	-	-	-	-	-	-
150-401	S05	-	✗	✗	✗	-	✗	✗	✗	-	✗	-	✗	-	-	-	-	-	-	-	-	-
150-401	S06	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-500	S05	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-500	S06	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-315	S03	-	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-
200-315	-	B03	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-
200-316	S03	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-
200-316	-	B03	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	✗	-	-	-

10) G = standard variant; wetted components made of gray cast iron
11) G1 = like G with impeller made of duplex stainless steel
12) G2 = like G with impeller made of white cast iron
13) GH = like G with impeller and intermediate casing made of white cast iron
14) GC = like G with impeller and discharge cover made of duplex stainless steel and shaft made of 1.4462

Size	Bearing bracket		Material variant																			
			G[10)				G1[11)				G2[12)				GH[13)				GC[14)			
	Sewatec	Sewabloc	Impeller				Impeller				Impeller				Impeller				Impeller			
			K	D	F	E	K	D	F	E	K	D	F	E	K	D	F	E	K	D	F	E
200-330	S04	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
200-330	S05	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
200-400	S04	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
200-400	S05	-	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
200-400	S06	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-402	S04	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-402	S05	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-500	S05	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-500	S06	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-500	S07	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-500Ex	S05	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-501	S06	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-631	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
200-631	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250-400	S04	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
250-400	S05	-	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
250-400	S06	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250-401	S04	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
250-401	S05	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
250-500	S06	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250-500	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250-630	S07	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250-630	S08	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250-900	S09	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300-400	S04	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
300-400	S05	-	✗	✗	-	-	✗	✗	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
300-400	S06	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300-401	S04	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
300-401	S05	-	✗	-	-	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-
300-500	S06	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300-630	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300-630	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300-500	S07	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-500	S06	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-500	S07	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-501	S06	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-501	S07	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-630	S07	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-630	S08	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-710	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350-710	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-500	S06	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-500	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-630	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-710	S09	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-820	S09	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-630	S07	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-630	S08	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-632	S08	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-710	S09	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-900	S09	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-900	S10	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
600-520	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
600-710	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

10) G = standard variant; wetted components made of gray cast iron
11) G1 = like G with impeller made of duplex stainless steel
12) G2 = like G with impeller made of white cast iron
13) GH = like G with impeller and intermediate casing made of white cast iron
14) GC = like G with impeller and discharge cover made of duplex stainless steel and shaft made of 1.4462

Size	Bearing bracket		Material variant																			
			G[10]				G1[11]				G2[12]				GH[13]				GC[14]			
	Sewatec	Sewabloc	Impeller				Impeller				Impeller				Impeller				Impeller			
			K	D	F	E	K	D	F	E	K	D	F	E	K	D	F	E	K	D	F	E
600-900	S10	-	✗	-	-	-	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
700-900	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

Maximum diameter of K and D impellers per bearing bracket and speed

Density 1.0 kg/dm³

Max. impeller diameter ["][15]

Size	Bearing bracket		K impeller					D impeller			
			Speed [rpm]					Speed [rpm]			
	Sewatec	Sewabloc	1750	1160	875	700	585	1750	1160	875	700
050-250	S01	-	-	10 1/4	10 1/4	-	-	-	-	-	-
050-250	-	B01	-	10 1/4	10 1/4	-	-	-	-	-	-
050-251	S02	-	10 7/16	-	-	-	-	-	-	-	-
050-251	-	B02	10 7/16	-	-	-	-	-	-	-	-
065-250	S01	-	-	9 1/16	9 1/16	-	-	-	-	-	-
065-250	-	B01	-	9 1/16	9 1/16	-	-	-	-	-	-
080-250	S01	-	-	9 1/4	-	-	-	-	-	-	-
080-250	-	B01	-	9 1/4	-	-	-	-	-	-	-
080-315	S03	-	8 11/15	-	-	-	-	-	10 1/4	-	-
080-315	S05	-	-	-	-	-	-	10 1/4	-	-	-
080-315	-	B03	8 11/15	-	-	-	-	-	10 1/4	-	-
080-316	S03	-	-	-	-	-	-	-	12	-	-
080-316	-	B03	-	-	-	-	-	-	12	-	-
100-250	S01	-	-	-	-	-	-	-	-	-	-
100-250	-	B01	-	-	-	-	-	-	-	-	-
100-251	S02	-	10 1/16	10 1/16	-	-	-	-	10 3/8	-	-
100-251	-	B02	10 1/16	10 1/16	-	-	-	-	10 3/8	-	-
100-315	S05	-	-	-	-	-	-	8 11/16	-	-	-
100-316	S03	-	-	-	-	-	-	-	12	-	-
100-316	-	B03	-	-	-	-	-	-	12	-	-
100-400	S04	-	-	16 1/16	16 1/16	-	-	-	-	-	-
100-400	S05	-	-	16 1/16	16 1/16	-	-	-	-	-	-
100-401	S04	-	-	15 13/16	15 13/16	-	-	-	-	-	-
100-401	S05	-	-	15 13/16	15 13/16	-	-	-	-	-	-
125-315	S03	-	12 5/16	12 5/16	12 5/16	-	-	-	-	-	-
125-315	-	B03	12 5/16	12 5/16	12 5/16	-	-	-	-	-	-
125-317	S03	-	-	-	-	-	-	-	-	-	-
125-317	-	B03	-	-	-	-	-	-	-	-	-
150-251	S02	-	-	-	-	-	-	-	10	10	-
150-251	-	B02	-	-	-	-	-	-	10	10	-
150-315	S03	-	12 3/16	12 3/16	12 3/16	-	-	-	12 7/16	12 7/16	-
150-315	-	B03	12 3/16	12 3/16	12 3/16	-	-	-	12 7/16	12 7/16	-
150-400	S04	-	-	16 1/16	16 1/16	-	-	-	-	-	-
150-400	S05	-	-	16 1/16	16 1/16	-	-	-	14 1/4	-	-
150-401	S04	-	-	15 13/16	15 13/16	-	-	-	-	-	-
150-401	S05	-	15 13/16	15 13/16	15 13/16	-	-	-	-	-	-
150-401	S06	-	-	-	-	-	-	-	16 3/16	-	-

10) G = standard variant; wetted components made of gray cast iron
11) G1 = like G with impeller made of duplex stainless steel
12) G2 = like G with impeller made of white cast iron
13) GH = like G with impeller and intermediate casing made of white cast iron
14) GC = like G with impeller and discharge cover made of duplex stainless steel and shaft made of 1.4462
15) Selection for a fluid density of 1.0 kg/dm³; higher densities on request only

Size	Bearing bracket		K impeller					D impeller			
			Speed [rpm]					Speed [rpm]			
	Sewatec	Sewabloc	1750	1160	875	700	585	1750	1160	875	700
150-500	S05	-	-	$19\frac{3}{4}$	$19\frac{3}{4}$	-	-	-	-	-	-
150-500	S06	-	-	$19\frac{3}{4}$	$19\frac{3}{4}$	-	-	-	-	-	-
200-315	S03	-	-	$11\frac{5}{8}$	$11\frac{5}{8}$	-	-	-	$12\frac{3}{8}$	$12\frac{3}{8}$	-
200-315	-	B03	-	$11\frac{5}{8}$	$11\frac{5}{8}$	-	-	-	$12\frac{3}{8}$	$12\frac{3}{8}$	-
200-316	S03	-	-	12	12	-	-	-	-	-	-
200-316	-	B03	-	12	12	-	-	-	-	-	-
200-330	S04	-	-	$12\frac{3}{4}$	$12\frac{3}{4}$	-	-	-	-	-	-
200-330	S05	-	-	$12\frac{3}{4}$	$12\frac{3}{4}$	-	-	-	-	-	-
200-400	S04	-	-	$15\frac{13}{16}$	$15\frac{13}{16}$	-	-	-	-	-	-
200-400	S05	-	-	$15\frac{13}{16}$	$15\frac{13}{16}$	-	-	-	-	-	-
200-400	S06	-	-	-	-	-	-	-	$15\frac{13}{16}$	-	-
200-500	S05	-	-	-	-	-	-	-	-	-	-
200-500	S06	-	-	-	$19\frac{5}{8}$	-	-	-	-	-	-
200-500	S07	-	-	$19\frac{3}{4}$	$19\frac{3}{4}$	-	-	-	-	-	-
200-500Ex	S05	-	-	-	-	-	-	-	-	-	-
200-501	S06	-	-	-	-	-	-	-	-	-	-
200-631	S07	-	-	-	-	-	-	-	-	-	-
200-631	S08	-	-	-	-	-	-	-	-	-	-
250-400	S04	-	-	$14\frac{9}{16}$	$14\frac{9}{16}$	-	-	-	-	-	-
250-400	S05	-	-	$14\frac{9}{16}$	$14\frac{9}{16}$	-	-	-	-	$14\frac{3}{4}$	-
250-400	S06	-	-	-	-	-	-	-	$14\frac{3}{4}$	-	-
250-401	S04	-	-	$15\frac{13}{16}$	$15\frac{13}{16}$	-	-	-	-	-	-
250-401	S05	-	-	$15\frac{13}{16}$	$15\frac{13}{16}$	-	-	-	-	-	-
250-500	S06	-	-	-	-	-	-	-	-	-	-
250-500	S07	-	-	-	-	-	-	-	-	-	-
250-630	S07	-	-	-	$20\frac{13}{16}$	-	-	-	-	-	-
250-630	S08	-	-	$20\frac{13}{16}$	$20\frac{13}{16}$	-	-	-	-	-	-
250-900	S09	-	-	-	$33\frac{1}{4}$	-	-	-	-	-	-
300-400	S04	-	-	-	$14\frac{3}{4}$	$14\frac{3}{4}$	-	-	-	-	-
300-400	S05	-	-	$14\frac{3}{4}$	$14\frac{3}{4}$	$14\frac{3}{4}$	-	-	-	$16\frac{1}{16}$	-
300-400	S06	-	-	-	-	-	-	-	$16\frac{1}{16}$	-	-
300-401	S04	-	-	-	$15\frac{9}{16}$	$15\frac{9}{16}$	-	-	-	-	-
300-401	S05	-	-	$15\frac{9}{16}$	$15\frac{9}{16}$	$15\frac{9}{16}$	-	-	-	-	-
300-500	S06	-	-	-	-	$19\frac{3}{4}$	-	-	-	-	-
300-500	S07	-	-	-	$19\frac{3}{4}$	$19\frac{3}{4}$	-	-	-	-	-
300-630	S07	-	-	-	-	-	-	-	-	-	-
300-630	S08	-	-	-	-	-	-	-	-	-	-
350-500	S06	-	-	-	-	20	-	-	-	-	-
350-500	S07	-	-	-	20	20	-	-	-	-	-
350-501	S06	-	-	-	-	$20\frac{1}{16}$	-	-	-	-	-
350-501	S07	-	-	-	$20\frac{1}{16}$	$20\frac{1}{16}$	-	-	-	-	-
350-630	S07	-	-	-	-	$24\frac{3}{4}$	-	-	-	-	-
350-630	S08	-	-	-	$24\frac{3}{4}$	$24\frac{3}{4}$	-	-	-	-	-
350-710	S07	-	-	-	-	-	-	-	-	-	-
350-710	S08	-	-	-	-	-	-	-	-	-	-
400-500	S06	-	-	-	-	20	-	-	-	-	-
400-500	S07	-	-	-	-	20	-	-	-	-	-
400-630	S08	-	-	-	-	-	-	-	-	-	-
400-710	S09	-	-	-	$29\frac{1}{16}$	-	-	-	-	-	-
400-820	S09	-	-	-	$35\frac{3}{4}$	-	-	-	-	-	-
500-630	S07	-	-	-	-	$22\frac{15}{16}$	-	-	-	-	-
500-630	S08	-	-	-	$22\frac{15}{16}$	$22\frac{15}{16}$	$22\frac{15}{16}$	-	-	-	-
500-632	S08	-	-	-	$25\frac{3}{16}$	$25\frac{3}{16}$	$25\frac{3}{16}$	-	-	-	-
500-900	S09	-	-	-	-	-	-	-	-	-	-
500-900	S10	-	-	-	-	$35\frac{3}{4}$	$35\frac{3}{4}$	-	-	-	-
600-520	S07	-	-	-	-	-	-	-	-	-	-
600-710	S08	-	-	-	-	-	-	-	-	-	-
600-900	S10	-	-	-	-	$35\frac{3}{4}$	$35\frac{3}{4}$	-	-	-	-
700-900	S08	-	-	-	-	-	-	-	-	-	-

Maximum diameter of F and E impellers per bearing bracket and speed

Density 1.0 kg/dm³

Selection table [inch][16)]

Size	Bearing bracket		F impeller				E impeller			
			Speed [rpm]				Speed [rpm]			
	Sewatec	Sewabloc	3500	1750	1160	875	1160	875	700	585
050-215	-	B01	8 1/4	8 1/4	-	-	-	-	-	-
050-216	-	B01	7 7/16	8 1/4	-	-	-	-	-	-
050-250	S01	-	-	7 13/16	7 13/16	7 13/16	-	-	-	-
050-250	-	B01	-	7 13/16	7 13/16	7 13/16	-	-	-	-
050-251	S02	-	-	-	-	-	-	-	-	-
050-251	-	B02	-	-	-	-	-	-	-	-
065-215	-	B01	8 1/4	8 1/4	-	-	-	-	-	-
065-250	S01	-	-	-	8 1/4	8 1/4	-	-	-	-
065-250	-	B01	-	-	8 1/4	8 1/4	-	-	-	-
080-216	-	B01	8 1/4	8 1/4	-	-				
080-250	S01	-	-	-	8 1/4	-	-	-	-	-
080-250	-	B01	-	-	9 3/4	-	-	-	-	-
080-315	S03	-	-	9 3/4	9 3/4	-	-	-	-	-
080-315	S05	-	-	-	-	-	-	-	-	-
080-315	-	B03	-	9 3/4	9 3/4	-	-	-	-	-
080-316	S03	-	-	-	-	-	-	-	-	-
080-316	-	B03	-	-	-	-	-	-	-	-
100-215	-	B01	-	8 1/4	-	-	-	-	-	-
100-250	S01	-	-	-	8 1/4	-	9 5/8	9 5/8	9 5/8	-
100-250	-	B01	-	-	10 7/16	-	-	-	-	-
100-251	S02	-	-	10 7/16	-	-	10 7/16	10 7/16	10 7/16	-
100-251	-	B02	-	10 7/16	-	-	-	-	-	-
100-252	S01	-	-	-	9 3/4	-	-	-	-	-
100-252	-	B01	-	-	9 3/4	-	-	-	-	-
100-253	S02	-	-	10 7/16	-	-	-	-	-	-
100-253	-	B02	-	10 7/16	-	-	-	-	-	-
100-315	S05	-	-	-	-	-	-	-	-	-
100-316	S03	-	-	-	-	-	-	-	-	-
100-316	-	B03	-	-	-	-	-	-	-	-
100-401	S04	-	-	-	15 3/8	15 3/8	-	-	-	-
100-401	S05	-	-	-	15 3/8	15 3/8	-	-	-	-
125-315	S03	-	-	11 15/16	11 15/16	-	-	-	-	-
125-315	-	B03	-	11 15/16	11 15/16	-	-	-	-	-
125-317	S03	-	-	-	-	-	12 5/8	12 5/8	12 5/8	-
125-317	-	B03	-	-	-	-	-	-	-	-
150-251	S02	-	-	-	-	-	-	-	-	-
150-251	-	B02	-	-	-	-	-	-	-	-
150-315	S03	-	-	-	11 7/16	11 7/16	12 5/8	12 5/8	12 5/8	-
150-315	-	B03	-	-	11 7/16	11 7/16	-	-	-	-
150-400	S05	-	-	-	-	-	-	-	-	-
150-401	S04	-	-	-	15 3/8	15 3/8	-	-	-	-
150-401	S05	-	-	-	15 3/8	15 3/8	-	-	-	-
150-401	S06	-	-	-	-	-	-	-	-	-
151-401	S05	-	-	-	-	-	-	-	-	-
150-500	S05	-	-	-	-	-	-	-	-	-
150-500	S06	-	-	-	-	-	-	-	-	-
200-315	S03	-	-	-	-	-	-	-	-	-
200-315	-	B03	-	-	-	-	-	-	-	-
200-316	S03	-	-	-	-	-	-	-	-	-
200-316	-	B03	-	-	-	-	-	-	-	-
200-330	S04	-	-	-	-	-	-	-	-	-

16) Selection for a fluid density of 1.0 kg/dm³; higher densities on request only

Size	Bearing bracket		F impeller				E impeller			
			Speed [rpm]				Speed [rpm]			
	Sewatec	Sewabloc	3500	1750	1160	875	1160	875	700	585
200-330	S05	-	-	-	-	-	-	-	-	-
200-400	S04	-	-	-	-	-	-	-	-	-
200-400	S05	-	-	-	-	-	-	-	-	-
200-400	S06	-	-	-	-	-	-	-	-	-
200-500	S05	-	-	-	-	-	-	-	-	-
200-500	S06	-	-	-	-	-	-	-	-	-
200-500	S07	-	-	-	-	-	-	-	-	-
200-500Ex	S05	-	-	-	-	-	-	-	-	-
200-501	S06	-	-	-	-	-	-	-	-	-
200-631	S07	-	-	-	-	-	-	-	-	-
200-631	S08	-	-	-	-	-	-	-	-	-
250-400	S04	-	-	-	-	-	-	-	-	-
250-400	S05	-	-	-	-	-	-	-	-	-
250-400	S06	-	-	-	-	-	-	-	-	-
250-401	S04	-	-	-	-	-	-	-	-	-
250-401	S05	-	-	-	-	-	-	-	-	-
250-500	S06	-	-	-	-	-	-	-	-	-
250-500	S07	-	-	-	-	-	-	-	-	-
250-630	S07	-	-	-	-	-	-	-	-	-
250-630	S08	-	-	-	-	-	-	-	-	-
300-400	S04	-	-	-	-	-	-	-	-	-
300-400	S05	-	-	-	-	-	-	-	-	-
300-400	S06	-	-	-	-	-	-	-	-	-
300-401	S04	-	-	-	-	-	-	-	-	-
300-401	S05	-	-	-	-	-	-	-	-	-
300-500	S06	-	-	-	-	-	-	-	-	-
300-500	S07	-	-	-	-	-	-	-	-	-
300-630	S07	-	-	-	-	-	-	-	-	-
300-630	S08	-	-	-	-	-	-	-	-	-
350-500	S06	-	-	-	-	-	-	-	-	-
350-500	S07	-	-	-	-	-	-	-	-	-
350-501	S06	-	-	-	-	-	-	-	-	-
350-501	S07	-	-	-	-	-	-	-	-	-
350-630	S07	-	-	-	-	-	-	-	-	-
350-630	S08	-	-	-	-	-	-	-	-	-
350-710	S07	-	-	-	-	-	-	-	-	-
350-710	S08	-	-	-	-	-	-	-	-	-
400-500	S06	-	-	-	-	-	-	-	-	-
400-500	S07	-	-	-	-	-	-	-	-	-
400-630	S08	-	-	-	-	-	-	-	-	-
500-630	S07	-	-	-	-	-	-	-	-	-
500-630	S08	-	-	-	-	-	-	-	-	-
500-632	S08	-	-	-	-	-	-	-	-	-
600-520	S07	-	-	-	-	-	-	-	-	-
600-710	S08	-	-	-	-	-	-	-	-	-
700-900	S08	-	-	-	-	-	-	-	-	-

Motor frames per pump

The following installation types require the motors to be fitted with a C flange (e.g. 404TC): BLOC, BLOC-VF, V, VU, VGW.

Overview of motor sizes per pump

Size	Bearing bracket		Impeller type	Motor frame (NEMA)																					
	Sewatec	Sewabloc		182T	184T	213T	215T	254T	256T	284T	286T	324T	326T	364T	365T	404T	405T	444T	445T	447T	449T	504T	505T	586T	587T
50-215	-	B01	F	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
50-216	-	B01	F	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
50-250	S01	-	K, F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
50-250	-	B01	K, F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
50-251	S02	-	K	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
50-251	-	B02	K	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
65-215	-	B01	F	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
65-250	S01	-	K, F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
65-250	-	B01	K, F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
80-216	-	B01	F	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
80-250	S01	-	K, F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
80-250	-	B01	K, F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
80-315	S03	-	K, F, D	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
80-315	-	B03	K, F, D	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
80-315	S05	-	D	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
80-316	S03	-	D	-	-	-	-	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-215	-	B01	F	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-250	S01	-	F, E	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-250	-	B01	F	-	-	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-251	S02	-	K, F, E	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-251	S02	-	D	-	-	-	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-251	-	B02	K, D, F	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-252	S01	-	F	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-252	-	B01	F	-	-	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-253	S02	-	F	-	-	-	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-253	-	B02	F	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-315	S05	-	D	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100-316	S03	-	D	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
100-400	S04	-	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
100-400	S05	-	K	-	-	-	-	✗[17]	✗[17]	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-
100-401	S04	-	K, F	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
100-401	S05	-	K, F	-	-	-	-	✗[17]	✗[17]	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-
125-315	S03	-	K, F	-	-	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
125-315	-	B03	K, F	-	-	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
125-317	S03	-	E	-	-	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
150-251	S02	-	D	-	-	-	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-251	-	B02	D	-	-	-	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-315	S03	-	K, F, E	-	-	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
150-315	-	B03	K, F, E	-	-	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
150-315	S03	-	D	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-315	-	B03	D	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-	-
150-400	S04	-	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
150-400	S05	-	D	-	-	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-
150-400	S05	-	K	-	-	-	-	✗[17]	✗[17]	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-
150-401	S04	-	K, F	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
150-401	S05	-	K, F	-	-	-	-	✗[17]	✗[17]	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-
150-401	S06	-	D	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-
150-500	S06	-	K	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-
200-315	S03	-	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
200-315	-	B03	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
200-315	S03	-	D	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-
200-315	-	B03	D	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-	-
200-316	S03	-	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-

17) Not for installation type Sewatec-vertical (VU)

Size	Bearing bracket		Impeller type	Motor frame (NEMA)																					
	Sewatec	Sewabloc		182T	184T	213T	215T	254T	256T	284T	286T	324T	326T	364T	365T	404T	405T	444T	445T	447T	449T	504T	505T	586T	587T
200-316	-	B03	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
200-330	S04	-	K	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
200-330	S05	-	K	-	-	-	-	✗[17]	✗[17]	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-
200-400	S04	-	K	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
200-400	S05	-	K	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-
200-400	S06	-	D	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-
200-402	S04	-	K	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
200-402	S05	-	K	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-
200-500	S07	-	K	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-
250-400	S04	-	K	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
250-400	S05	-	K	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-
250-400	S05	-	D	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
250-400	S06	-	D	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-
250-401	S04	-	K	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
250-401	S05	-	K	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-
250-630	S08	-	K	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗
250-900[18]	S09	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300-400	S04	-	K	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
300-400	S05	-	K	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-
300-400	S05	-	D	-	-	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-
300-400	S06	-	D	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-	-	-
300-401	S04	-	K	-	-	-	-	-	-	✗	✗	✗	✗	-	-	-	-	-	-	-	-	-	-	-	-
300-401	S05	-	K	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗	✗	✗	-	-	-	-	-	-
300-500	S07	-	K	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-	-
350-500	S07	-	K	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	-	-	-	-
350-501	S07	-	K	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	-	-	-	-	-
350-630	S08	-	K	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗
350-710[18]	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-500[18]	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-630[18]	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-710[18]	S09	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
400-820[18]	S09	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-630	S08	-	K	-	-	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗	✗	✗
500-632	S08	-	K	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	✗	✗	✗	✗	✗	✗
500-710[18]	S09	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
500-900[18]	S09	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
600-520[18]	S07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
600-710[18]	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
600-900[18]	S10	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
700-900[18]	S08	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

18) Due to large number of poles and high ratings, motor combination provided on request

Product overview

Overview of features and accessories per installation type

<table>
<tr><th colspan="2" rowspan="2">Options</th><th colspan="3">Sewatec</th><th colspan="2">Sewabloc</th></tr>
<tr><th>Fig.0</th><th>V</th><th>3E</th><th>BLOC</th><th>BLOC-VF</th></tr>
<tr><td colspan="7">Motor</td></tr>
<tr><td colspan="2">Without motor</td><td>●</td><td>●</td><td>●</td><td>●</td><td>●</td></tr>
<tr><td colspan="2">Standard KSB motor</td><td>–</td><td>○[19]</td><td>●</td><td>●</td><td>●</td></tr>
<tr><td colspan="2">Motor make to customer's choice</td><td>–</td><td>○[19]</td><td>○</td><td>○</td><td>○</td></tr>
<tr><td colspan="7">Accessories installation set</td></tr>
<tr><td colspan="2">Baseplate</td><td>–</td><td>●[20]</td><td>●[21]</td><td>●[22]</td><td>–</td></tr>
<tr><td colspan="2">Support frame, drive lantern, soleplate for the motor[23]</td><td>–</td><td>Δ</td><td>–</td><td>–</td><td>–</td></tr>
<tr><td colspan="2">Coupling, coupling guard[23]</td><td>–</td><td>●[24]</td><td>●</td><td>–</td><td>–</td></tr>
<tr><td colspan="2">Suction-side intermediate flanged piece with inspection hole[23]</td><td>○</td><td>○[25]</td><td>○</td><td>○</td><td>●[25]</td></tr>
<tr><td colspan="2">Base suction elbow</td><td>–</td><td>●</td><td>–</td><td>–</td><td>●</td></tr>
<tr><td colspan="2">Fastening elements: anchor bolts (A4)</td><td>–</td><td>●</td><td>●</td><td>●</td><td>●</td></tr>
<tr><td colspan="7">Shaft seal</td></tr>
<tr><td rowspan="3">Mechanical seal</td><td>Standard KSB mechanical seal with elastomer bellows (bearing brackets S01, S02, S03, S04, S05, S06, S07, B01, B02, B03)</td><td colspan="5">●</td></tr>
<tr><td>Standard KSB mechanical seal with covered spring (bearing brackets S01, S02, S03, S04, S05)</td><td colspan="5">○</td></tr>
<tr><td>Stationary mechanical seal with spring outside of fluid (bearing bracket S08)</td><td colspan="5">●</td></tr>
<tr><td colspan="2">Gland packing (bearing brackets S05 and larger only)</td><td colspan="3">○</td><td colspan="2">–</td></tr>
<tr><td colspan="7">Coating</td></tr>
<tr><td colspan="2">Standard KSB coating</td><td colspan="5">●</td></tr>
<tr><td colspan="2">Primed to standard</td><td colspan="5">●</td></tr>
<tr><td colspan="2">Customer specification</td><td colspan="5">Δ</td></tr>
<tr><td colspan="7">Flange</td></tr>
<tr><td colspan="2">To DIN</td><td colspan="5">○</td></tr>
<tr><td colspan="2">To ANSI</td><td colspan="5">●</td></tr>
<tr><td colspan="7">Sealing elements, bolts and screws</td></tr>
<tr><td colspan="2">NBR/A4[26]</td><td colspan="5">●</td></tr>
<tr><td colspan="2">Viton/A4</td><td colspan="5">○</td></tr>
<tr><td colspan="7">Acceptance inspections/tests</td></tr>
<tr><td colspan="2">KSB Standard ZN 56535</td><td colspan="5">●</td></tr>
<tr><td colspan="2">Customer specification[27]</td><td colspan="5">○</td></tr>
<tr><td colspan="7">Sensors</td></tr>
<tr><td colspan="2">Leakage monitoring</td><td colspan="5">○</td></tr>
<tr><td colspan="2">Pt100 resistance thermometer</td><td colspan="5">○</td></tr>
<tr><td colspan="2">Vibration sensor</td><td colspan="5">○</td></tr>
</table>

Key to the symbols

Symbol	Description
●	Standard design
○	Standard variant[28]
Δ	Special design[28]

19) Special version for universal-joint shaft
20) For vertical installation soleplate or feet
21) With height adjustment of the motor
22) Foundation rails for Sewabloc
23) Optional
24) For underfloor installation
25) Suction elbow
26) Screw plugs made of steel
27) HI Level A: K impeller; HI Level B: K impellers only, not for white cast iron; other impellers on request; ISO 9906/(Grade 2): not for F impellers, not for white cast iron; BS 5316/I A: not for F impellers, not for white cast iron; BS 5316/I B: for K impellers only, not for white cast iron
28) A surcharge and longer delivery times apply to standard variants and special designs.

Material variants

Overview of available materials

<table>
<tr><th rowspan="2">Part No.</th><th rowspan="2">Description</th><th colspan="5">Material variant</th></tr>
<tr><th>G</th><th>G1</th><th>G2</th><th>GH</th><th>GC</th></tr>
<tr><td>101</td><td>Pump casing</td><td colspan="5">EN-GJL-250</td></tr>
<tr><td>135</td><td>Wear plate[29]</td><td colspan="2">EN-GJL-250[30]</td><td colspan="3">-</td></tr>
<tr><td>163</td><td>Discharge cover</td><td colspan="3">EN-GJL-250</td><td>EN-GJN-HB555</td><td>1.4517</td></tr>
<tr><td>183</td><td>Support foot</td><td colspan="5">Steel[31]</td></tr>
<tr><td>210</td><td>Shaft</td><td colspan="4">1.4021</td><td>1.4462</td></tr>
<tr><td>230</td><td>Impeller</td><td>EN-GJL-250</td><td>1.4517</td><td colspan="2">EN-GJN-HB555</td><td>1.4517</td></tr>
<tr><td>330</td><td>Bearing bracket</td><td colspan="5">EN-GJL-250</td></tr>
<tr><td>433</td><td>Mechanical seal</td><td colspan="5">SiC/SiC (Q1Q1 PGG)</td></tr>
<tr><td>502.01</td><td>Casing wear ring</td><td>EN-GJL-250[32]</td><td colspan="4">EN-GJL-250 (F impeller only)
VG 434</td></tr>
<tr><td>503</td><td>Impeller wear ring</td><td colspan="5">VG 434</td></tr>
<tr><td>452.01</td><td>Gland follower[33]</td><td colspan="5">EN-GJS-400-15</td></tr>
<tr><td>454.01</td><td>Stuffing box ring[33]</td><td colspan="5">EN-GJL-250</td></tr>
<tr><td>456.01</td><td>Neck bush[33]</td><td colspan="5">EN-GJL-250</td></tr>
<tr><td>458.01</td><td>Lantern ring[33]</td><td colspan="5">PTFE</td></tr>
<tr><td>524.01</td><td>Shaft protecting sleeve[33]</td><td colspan="5">1.4021</td></tr>
<tr><td>914</td><td>Impeller screw</td><td rowspan="2">Stainless steel[34]</td><td colspan="4" rowspan="2">Stainless steel</td></tr>
<tr><td>902/920</td><td>Screws, bolts and nuts</td></tr>
<tr><td></td><td>Screw plugs</td><td colspan="5">Steel</td></tr>
<tr><td></td><td>Sealing elements</td><td colspan="5">NBR</td></tr>
</table>

Comparison of materials

EN	ASTM
EN-GJL-250	A 48 Class 35 B
EN-GJS-400-15	A 536 Class 60-40-18
EN-GJN-HB555	A 532 Class II Type B (15 % Cr-Mo)
1.4517	A 890 CD4MCuN
1.4021	A 276 Type 420
1.4462	A 182 F51
VG 434	-
C 35 E	A 29 Gr. 1035

Description of materials

Gray cast iron EN-GJL-250 (lamellar graphite cast iron):
Lamellar graphite cast iron to EN 1561 is the most widely used cast material for handling municipal sewage, waste water and sludges as well as stormwater and surface water. It is suitable for neutral fluids which are only slightly aggressive and cause little wear. The pH value should be ≥ 6.5, the sand content ≤ 0.5 g/l.

Duplex stainless steel (1.4517 or technically equivalent material)

Cast steel is resistant to cavitation, has excellent strength values and is used for high circumferential speeds. An excellent resistance to pitting corrosion makes ferritic-austenitic stainless steel a popular choice for pumping acidic waste water containing large amounts of chlorine, as well as seawater and brackish water. Thanks to its good chemical resistance, e.g. also against waste water containing phosphorous and sulphuric acid, this material is used in a wide range of applications in the chemical industry and process engineering. Pumps made of duplex stainless steel have a very long service life, even when handling brines, chemical waste water (pH value 1 - 12), gray water and landfill leachate.

Wear-resistant white cast iron ((EN-GJN-HB555 (XCR14) or technically equivalent material)

This is a wear-resistant white cast iron for highly abrasive fluids containing sand, ash or iron ore sinter. It has a Rockwell hardness of 61.5 to 68, which is higher than that of hardened chrome steel. The chromium-molybdenum alloy cast iron features a notably higher wear resistance than EN-GJL-250 gray cast iron and other cast materials.

29) For E200-500, E250-500, E250-630, E300-630, E350-710 only
30) For D impeller optional: EN-GJN-HB555
31) Bearing brackets S05 and larger: EN-GJL-250
32) For E100-250, E100-251, E100-401, E150-315, E150-401, E200-315, E200-400: EN-GJN-HB555
33) For pump sets with gland packing only
34) Bearing brackets S05 and larger: CK 35N

Technical data

K impeller

Overview

Size	Bearing bracket				Pump data							No. of impeller channels	K impeller			
						Shaft seal		Pressure limits		Inspection hole diameter						
	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece		Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			[mm]		[Nm/ impeller]			[bar]		[mm]			[mm]			[kgm²]
050-250	S01	-	65	50	13000	-	✗	10	15	-	80	2	15	260	150	0,05
050-250	-	B01	65	50	13000	-	✗	10	15	-	80	2	15	260	150	0,05
050-251	S02	-	65	50	50000	-	✗	10	15	-	80	2	15	260	150	0,05
050-251	-	B02	65	50	50000	-	✗	10	15	-	80	2	15	260	150	0,05
065-250	S01	-	80	65	13000	-	✗	6	9	-	80	2	50	230	170	0,08
065-250	-	B01	80	65	13000	-	✗	6	9	-	80	2	50	230	170	0,08
080-250	S01	-	100	80	13000	-	✗	6	9	-	120	2	76	235	205	0,08
080-250	-	B01	100	80	13000	-	✗	6	9	-	120	2	76	235	205	0,08
080-315	S03	-	100	80	80000	-	✗	10	15	-	120	2	33	220	140	0,07
080-315	-	B03	100	80	80000	-	✗	10	15	-	120	2	33	220	140	0,07
100-251	S02	-	100	100	50000	-	✗	6	9	118	120	2	76	256	235	0,07
100-251	-	B02	100	100	50000	-	✗	6	9	118	120	2	76	256	235	0,07
100-400	S04	-	150	100	190000	-	✗	10	15	100	150	2	76	408	355	1,1
100-400	S05	-	150	100	220000	■	✗	10	15	100	150	2	76	408	355	1,1
100-401	S04	-	100	100	190000	-	✗	10	15	118	120	2	50	404	310	0,31
100-401	S05	-	100	100	220000	■	✗	10	15	118	120	2	50	404	310	0,31
125-315	S03	-	125	125	80000	-	✗	6	9	118	120	2	76	312	235	0,09
125-315	-	B03	125	125	80000	-	✗	6	9	118	120	2	76	312	235	0,09
150-315	S03	-	150	150	80000	-	✗	6	9	118	150	2	76	310	235	0,09
150-315	-	B03	150	150	80000	-	✗	6	9	118	150	2	76	310	235	0,09
150-400	S04	-	200	150	190000	-	✗	10	15	100	200	3	76	404	300	0,83
150-400	S05	-	200	150	220000	■	✗	10	15	100	200	3	76	404	300	0,83
150-401	S04	-	150	150	190000	-	✗	10	15	118	200	2	76	404	330	0,92
150-401	S05	-	150	150	220000	■	✗	10	15	118	200	2	76	404	330	0,92
150-500	S06	-	150	150	370000	-	✗	11	16,5	118	150	3	60	504	350	0,71
200-315	S03	-	200	200	80000	-	✗	6	9	118	200	3	70	295	211	0,22
200-315	-	B03	200	200	80000	-	✗	6	9	118	200	3	70	295	211	0,22
200-316	S03	-	200	200	80000	-	✗	6	9	118	200	2	100	305	230	0,22
200-316	-	B03	200	200	80000	-	✗	6	9	118	200	2	100	305	230	0,22
200-330	S04	-	200	200	190000	-	✗	10	15	118	200	3	70	326	242	0,22
200-330	S05	-	200	200	220000	■	✗	10	15	118	200	3	70	326	242	0,22
200-400	S04	-	200	200	190000	-	✗	10	15	200	200	3	80	404	330	0,46
200-400	S05	-	200	200	220000	■	✗	10	15	200	200	3	80	404	330	0,46
200-500	S07	-	200	200	1020000	-	✗	10	15	118	200	3	75	504	400	0,83
250-400	S04	-	250	250	190000	-	✗	10	15	143	200	3	83	370	312	0,50
250-400	S05	-	250	250	220000	■	✗	10	15	143	200	3	83	370	312	0,50
250-401	S04	-	250	250	190000	-	✗	10	15	143	200	2	105	404	310	0,56
250-401	S05	-	250	250	220000	■	✗	10	15	143	200	2	105	404	310	0,56
250-630	S08	-	250	250	1400000	■	✗	10	15	143	143	4	90	530	500	2,76
250-900	S09	-	350	250	2500000	■	✗	13	19,5	100	-	3	110	840	717	19,03
300-400	S04	-	300	300	190000	-	✗	10	15	143	200	3	100	377	320	0,75
300-400	S05	-	300	300	220000	■	✗	10	15	143	200	3	100	377	320	0,75
300-401	S04	-	300	300	190000	-	✗	10	15	143	200	2	135	395	331	0,75
300-401	S05	-	300	300	220000	■	✗	10	15	143	200	2	135	395	331	0,75
300-500	S07	-	300	300	1020000	■	✗	6	9	143	200	3	100	504	430	1,48

Size	Bearing bracket				Pump data								K impeller			
						Shaft seal		Pressure limits		Inspection hole diameter						
	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece	No. of impeller channels	Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			[mm]		[Nm/ impeller]			[bar]		[mm]			[mm]			[kgm²]
350-500	S07	-	350	350	1020000	■	✗	6	9	143	200	3	110	508	393	3,12
350-501	S07	-	350	350	1020000	■	✗	6	9	143	200	2	170	509	490	3,00
350-630	S08	-	350	350	1400000	■	✗	10	15	143	200	3	135	630	500	5,22
350-710	S08	-	350	350	1400000	■	✗	10	15	143	200	3	110	730	580	10,6
400-500	S06	-	400	400	370000	■	✗	6	9	200	200	3	130	508	355	3,37
400-500	S07	-	400	400	1020000	■	✗	6	9	200	200	3	130	508	355	3,37
400-630	S08	-	500	400	1400000	■	✗	6	9	200	200	3	132	620	400	8,21
400-710	S09	-	500	400	2500000	■	✗	10	15	150	-	3	165	739	587	16,0
400-820	S09	-	500	400	2500000	■	✗	13	19,5	143	-	3	130	830	659	17,79
500-630	S08	-	500	500	1400000	■	✗	6	9	200	200	3	133	582	490	3.46
500-632	S08	-	500	500	1400000	■	✗	6	9	200	200	3	135	639	560	6.0
500-710	S09	-	500	500	2500000	■	✗	8/6,9	6,9/9,0	200	-	3	150	700	586	16,0
500-900	S09	-	600	500	2500000	■	✗	9	13,5	200	-	3	202	908	721	45,0
500-900	S10	-	600	500	5000000	■	✗	9	13,5	200	-	3	202	908	721	45,0
600-520	S07	-	500	600	1020000	■	✗	4	6	200	200	3	145	532	457	7,01
600-710	S08	-	600	600	1400000	■	✗	4	6	200	200	3	165	736	664	16,96
600-900	S10	-	700	600	5000000	■	✗	9	13,5	200	-	3	180	908	760	50,0
700-900	S08	-	700	700	1400000	■	✗	3	4,5	200	200	3	190	850	638	40,0

Overview

Size	Bearing bracket				Pump data								K impeller			
						Shaft seal		Pressure limits		Inspection hole diameter						
	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece	No. of impeller channels	Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			["]		[Nm/ impeller]			[psi]		["]			["]			[lb ft²]
050-250	S01	-	$2\frac{1}{2}$	2	13000	-	✗	145	218	-	$3\frac{1}{8}$	2	$\frac{9}{16}$	$10\frac{1}{4}$	$5\frac{13}{16}$	1,187
050-250	-	B01	$2\frac{1}{2}$	2	13000	-	✗	145	218	-	$3\frac{1}{8}$	2	$\frac{9}{16}$	$10\frac{1}{4}$	$5\frac{13}{16}$	1,187
050-251	S02	-	$2\frac{1}{2}$	2	50000	-	✗	145	218	-	$3\frac{1}{8}$	2	$\frac{9}{16}$	$10\frac{1}{4}$	$5\frac{13}{16}$	1,187
050-251	-	B02	$2\frac{1}{2}$	2	50000	-	✗	145	218	-	$3\frac{1}{8}$	2	$\frac{9}{16}$	$10\frac{1}{4}$	$5\frac{13}{16}$	1,187
065-250	S01	-	3	$2\frac{1}{2}$	13000	-	✗	87	131	-	$3\frac{1}{8}$	2	$1\frac{15}{16}$	$9\frac{1}{16}$	$6\frac{11}{16}$	1,898
065-250	-	B01	3	$2\frac{1}{2}$	13000	-	✗	87	131	-	$3\frac{1}{8}$	2	$1\frac{15}{16}$	$9\frac{1}{16}$	$6\frac{11}{16}$	1,898
080-250	S01	-	4	3	13000	-	✗	87	131	-	$4\frac{3}{4}$	2	3	$9\frac{1}{4}$	$8\frac{1}{16}$	1,898
080-250	-	B01	4	3	13000	-	✗	87	131	-	$4\frac{3}{4}$	2	3	$9\frac{1}{4}$	$8\frac{1}{16}$	1,898
080-315	S03	-	4	3	80000	-	✗	145	218	-	$4\frac{3}{4}$	2	$1\frac{5}{16}$	$8\frac{11}{16}$	$5\frac{1}{2}$	1,661
080-315	-	B03	4	3	80000	-	✗	145	218	-	$4\frac{3}{4}$	2	$1\frac{5}{16}$	$8\frac{11}{16}$	$5\frac{1}{2}$	1,661
100-251	S02	-	4	4	50000	-	✗	87	131	$4\frac{5}{8}$	$4\frac{3}{4}$	2	3	$10\frac{1}{16}$	$9\frac{1}{4}$	1,661
100-251	-	B02	4	4	50000	-	✗	87	131	$4\frac{5}{8}$	$4\frac{3}{4}$	2	3	$10\frac{1}{16}$	$9\frac{1}{4}$	1,661
100-400	S04	-	6	4	190000	-	✗	145	218	$3\frac{15}{16}$	$5\frac{13}{16}$	2	3	$16\frac{1}{16}$	14	26,103

Size	Bearing bracket		Suction nozzle	Discharge nozzle	Pump data							No. of impeller channels	K impeller			
						Shaft seal		Pressure limits		Inspection hole diameter						
	Sewatec	Sewabloc			Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece		Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			["]		[Nm/ impeller]			[psi]		["]			["]			[lb ft²]
100-400	S05	-	6	4	220000	■	✗	145	218	3 15/16	5 13/16	2	3	16 1/16	14	26,103
100-401	S04	-	4	4	190000	-	✗	145	218	4 5/8	4 3/4	2	1 5/16	15 13/16	12 3/16	7,356
100-401	S05	-	4	4	220000	■	✗	145	218	4 5/8	4 3/4	2	1 5/16	15 13/16	12 3/16	7,356
125-315	S03	-	5	5	80000	-	✗	87	131	4 5/8	4 3/4	2	3	12 5/16	9 1/4	2,136
125-315	-	B03	5	5	80000	-	✗	87	131	4 5/8	4 3/4	2	3	12 5/16	9 1/4	2,136
150-315	S03	-	6	6	80000	-	✗	87	131	4 5/8	5 13/16	2	3	12 3/16	9 1/4	2,136
150-315	-	B03	6	6	80000	-	✗	87	131	4 5/8	5 13/16	2	3	12 3/16	9 1/4	2,136
150-400	S04	-	8	6	190000	-	✗	145	218	3 15/16	7 13/16	3	3	15 13/16	11 13/16	19,696
150-400	S05	-	8	6	220000	■	✗	145	218	3 15/16	7 13/16	3	3	15 13/16	11 13/16	19,696
150-401	S04	-	6	6	190000	-	✗	145	218	4 5/8	7 13/16	2	3	15 13/16	13	21,831
150-401	S05	-	6	6	220000	■	✗	145	218	4 5/8	7 13/16	2	3	15 13/16	13	21,831
150-500	S06	-	6	6	370000	-	✗	160	239	4 5/8	5 13/16	3	2 3/8	19 3/4	13 3/4	16,849
200-315	S03	-	6	6	80000	-	✗	87	131	4 5/8	7 13/16	3	2 3/4	11 5/8	8 5/16	5,221
200-315	-	B03	6	6	80000	-	✗	87	131	4 5/8	7 13/16	3	2 3/4	11 5/8	8 5/16	5,221
200-316	S03	-	8	8	80000	-	✗	87	131	4 5/8	7 13/16	2	3 15/16	12	9 1/16	5,221
200-316	-	B03	8	8	80000	-	✗	87	131	4 5/8	7 13/16	2	3 15/16	12	9 1/16	5,221
200-330	S04	-	8	8	190000	-	✗	145	218	4 5/8	7 13/16	3	2 3/4	12 3/4	9 1/2	5,221
200-330	S05	-	8	8	220000	■	✗	145	218	4 5/8	7 13/16	3	2 3/4	12 3/4	9 1/2	5,221
200-400	S04	-	8	8	190000	-	✗	145	218	7 13/16	7 13/16	3	3 1/8	15 13/16	13	10,916
200-400	S05	-	8	8	220000	■	✗	145	218	7 13/16	7 13/16	3	3 1/8	15 13/16	13	10,916
200-500	S07	-	8	8	1020000	-	✗	145	218	4 5/8	7 13/16	3	2 15/16	19 3/4	15 3/4	19,696
250-400	S04	-	10	10	190000	-	✗	145	218	5 5/8	7 13/16	3	3 1/4	14 9/16	12 5/16	11,685
250-400	S05	-	10	10	220000	■	✗	145	218	5 5/8	7 13/16	3	3 1/4	14 9/16	12 5/16	11,685
250-401	S04	-	10	10	190000	-	✗	145	218	5 5/8	7 13/16	2	4 1/8	15 13/16	12 3/16	13,289
250-401	S05	-	10	10	220000	■	✗	145	218	5 5/8	7 13/16	2	4 1/8	15 13/16	12 3/16	13,289
250-630	S08	-	10	10	1400000	-	✗	145	218	5 5/8	5 5/8	4	3 9/16	20 13/16	19 11/16	65,496
250-900	S09	-	14	10	2500000	■	✗	189	283	3 15/16	-	3	4 5/16	33 1/16	28 1/4	451,589
300-400	S04	-	12	12	190000	-	✗	145	218	5 5/8	7 13/16	3	3 15/16	14 3/4	12 5/8	17,789
300-400	S05	-	12	12	220000	■	✗	145	218	5 5/8	7 13/16	3	3 15/16	14 3/4	12 5/8	17,789
300-401	S04	-	12	12	190000	-	✗	145	218	5 5/8	7 13/16	2	5 5/16	15 9/16	13 1/16	17,789
300-401	S05	-	12	12	220000	■	✗	145	218	5 5/8	7 13/16	2	5 5/16	15 9/16	13 1/16	17,789
300-500	S07	-	12	12	1020000	■	✗	87	131	5 5/8	7 13/16	3	3 15/16	19 3/4	16 15/16	35,121
350-500	S07	-	14	14	1020000	■	✗	87	131	5 5/8	7 13/16	3	4 5/16	20	15 1/2	74,039
350-501	S07	-	14	14	1020000	■	✗	87	131	5 5/8	7 13/16	2	6 5/8	20 1/16	18 1/8	71,191
350-630	S08	-	14	14	1400000	■	✗	145	218	5 5/8	7 13/16	3	5 5/16	24 3/4	19 11/16	142,382
350-710	S08	-	14	14	1400000	■	✗	145	218	5 5/8	7 13/16	3	4 5/16	28 3/4	22 13/16	251,541
400-500	S06	-	16	16	370000	■	✗	87	131	7 13/16	7 13/16	3	5 1/8	20	14	79,971
400-500	S07	-	16	16	1020000	■	✗	87	131	7 13/16	7 13/16	3	5 1/8	20	14	79,971
400-630	S08	-	20	16	1400000	■	✗	87	131	7 13/16	7 13/16	3	5 3/16	24 7/16	15 3/4	194,826
400-710	S09	-	20	16	2500000	■	✗	145	218	5 7/8	-	3	6 1/2	29 1/16	23 1/8	379,685
400-820	S09	-	20	16	2500000	■	✗	189	283	5 5/8	-	3	5 1/8	32 11/16	25 15/16	422,163
500-630	S08	-	20	20	1400000	■	✗	87	131	7 13/16	7 13/16	3	5 1/4	22 15/16	19 5/16	82,107
500-632	S08	-	20	20	1400000	■	✗	87	131	7 13/16	7 13/16	3	5 5/16	25 3/16	22 1/16	142,382
500-710	S09	-	20	20	2500000	■	✗	116/100	100/131	7 13/16	-	3	5 7/8	27 9/16	23 1/16	379,685
500-900	S09	-	24	20	2500000	■	✗	131	196	7 13/16	-	3	7 15/16	35 3/4	28 3/8	1067,866
500-900	S10	-	24	20	5000000	■	✗	131	196	7 13/16	-	3	7 15/16	35 3/4	35 3/4	1067,866

Size	Bearing bracket				Pump data								K impeller			
						Shaft seal		Pressure limits		Inspection hole diameter						
	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece	No. of impeller channels	Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			["]		[Nm/impeller]			[psi]		["]			["]			[lb ft²]
600-520	S07	-	20	24	1020000	■	✗	58	87	7 $^{13}/_{16}$	7 $^{13}/_{16}$	3	5 $^{11}/_{16}$	20 $^{15}/_{16}$	18	166,350
600-710	S08	-	24	24	1400000	■	✗	58	87	7 $^{13}/_{16}$	7 $^{13}/_{16}$	3	6 $^{1}/_{2}$	29	26 $^{1}/_{8}$	402,467
600-900	S10	-	28	24	5000000	■	✗	131	196	7 $^{13}/_{16}$	-	3	7 $^{1}/_{16}$	35 $^{3}/_{4}$	29 $^{15}/_{16}$	1186,518
700-900	S08	-	28	28	1400000	■	✗	44	65	7 $^{13}/_{16}$	7 $^{13}/_{16}$	3	7 $^{1}/_{2}$	33 $^{7}/_{16}$	25 $^{1}/_{8}$	949,214

Key to the symbols

Symbol	Description
■	Optional
✗	Standard

D impeller

Overview

Size	Bearing bracket				Pump data							D impeller			
						Shaft seal		Pressure limits		Inspection hole diameter					
	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece	Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			[mm]		[Nm/impeller]			[bar]		[mm]		[mm]			[kgm²]
080-315	S05	-	100	80	220000	-	✗	10	15	-	120	70	260	242	0,124
080-316	S03	-	125	80	80000	-	✗	10	15	-	120	70	306	280	0,222
100-251	S02	-	100	100	50000	-	✗	6	9	118	120	76	265	234	0,115
100-251	-	B02	100	100	50000	-	✗	6	9	118	120	76	265	234	0,115
100-315	S05	-	125	100	220000	-	✗	10	15	100	120	75	222	196	0,065
100-316	S03	-	150	100	80000	-	✗	10	15	100	150	85	306	270	0,223
150-251	S02	-	150	150	50000	-	✗	6	9	120	150	100	254	225	0,150
150-251	-	B02	150	150	50000	-	✗	6	9	120	150	100	254	225	0,150
150-315	S03	-	150	150	80000	-	✗	6	9	118	150	100	317	280	0,289
150-315	-	B03	150	150	80000	-	✗	6	9	118	150	100	317	280	0,289
150-400	S05	-	200	150	220000	■	✗	10	15	100	200	100	363	326	0,573
150-401	S06	-	250	150	370000	■	✗	10	15	120	200	110	412	370	0,999
200-315	S03	-	200	200	80000	-	✗	6	9	118	200	100	315	280	0,261
200-315	-	B03	200	200	80000	-	✗	6	9	118	200	100	315	280	0,261
200-400	S06	-	250	200	370000	■	✗	10	15	125	200	100	402	355	0,825
250-400	S05	-	250	250	220000	■	✗	10	15	143	200	120	375	320	0,653
250-400	S06	-	250	250	370000	■	✗	10	15	143	200	120	375	320	0,653
300-400	S05	-	300	300	220000	■	✗	10	15	143	200	150	408	375	0,925
300-400	S06	-	300	300	370000	■	✗	10	15	143	200	150	408	375	0,925

Overview

	Bearing bracket				Pump data							D impeller			
						Shaft seal		Pressure limits		Inspection hole diameter					
Size	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece	Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			["]		[Nm/ impeller]			[psi]		["]		["]			[lb ft²]
080-315	S05	-	4	3	220000	-	✗	145	218	-	4 3/4	2 3/4	10 1/4	9 9/16	2,943
080-316	S03	-	5	3	80000	-	✗	145	218	-	4 3/4	2 3/4	12	11 1/16	5,268
100-251	S02	-	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3	10 3/8	9 1/4	2,729
100-251	-	B02	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3	10 3/8	9 1/4	2,729
100-315	S05	-	5	4	220000	-	✗	145	218	3 15/16	4 3/4	3	8 11/16	7 3/4	1,542
100-316	S03	-	6	4	80000	-	✗	145	218	3 15/16	5 13/16	3 3/8	12	10 11/16	5,292
150-251	S02	-	6	6	50000	-	✗	87	131	4 3/4	5 13/16	3 15/16	10	8 7/8	3,559
150-251	-	B02	6	6	50000	-	✗	87	131	4 3/4	5 13/16	3 15/16	10	8 7/8	3,559
150-315	S03	-	6	6	80000	-	✗	87	131	4 5/8	5 13/16	3 15/16	12 7/16	11 1/16	6,858
150-315	-	B03	6	6	80000	-	✗	87	131	4 5/8	5 13/16	3 15/16	12 7/16	11 1/16	6,858
150-400	S05	-	8	6	220000	■	✗	145	218	3 15/16	7 13/16	3 15/16	14 1/4	12 7/8	13,597
150-401	S06	-	8	6	370000	■	✗	145	218	4 3/4	7 13/16	4 1/4	16 3/16	14 5/8	23,706
200-315	S03	-	6	6	80000	-	✗	87	131	4 5/8	7 13/16	3 15/16	12 3/8	11 1/16	6,193
200-315	-	B03	6	6	80000	-	✗	87	131	4 5/8	7 13/16	3 15/16	12 3/8	11 1/16	6,193
200-400	S06	-	8	8	370000	■	✗	145	218	4 15/16	7 13/16	3 15/16	15 13/16	14	19,577
250-400	S05	-	10	10	220000	■	✗	145	218	5 5/8	7 13/16	4 3/4	14 3/4	12 5/8	15,496
250-400	S06	-	10	10	370000	■	✗	145	218	5 5/8	7 13/16	4 3/4	14 3/4	12 5/8	15,496
300-400	S05	-	12	12	220000	■	✗	145	218	5 5/8	7 13/16	5 13/16	16 1/16	14 3/4	21,950
300-400	S06	-	12	12	370000	■	✗	145	218	5 5/8	7 13/16	5 13/16	16 1/16	14 3/4	21,950

Key to the symbols

Symbol	Description
■	Optional
✗	Standard

F impeller

Overview

Size	Bearing bracket: Sewatec	Bearing bracket: Sewabloc	Suction nozzle [mm]	Discharge nozzle [mm]	Pump data: Torsional spring constant [Nm/impeller]	Shaft seal: Gland packing	Shaft seal: Mechanical seal	Pressure limits: Max. operating pressure [bar]	Pressure limits: Max. test pressure [bar]	Inspection hole diameter: Casing [mm]	Inspection hole diameter: Intermediate flanged piece [mm]	F impeller: Max. free passage [mm]	F impeller: Max. impeller diameter [mm]	F impeller: Min. impeller diameter [mm]	F impeller: Mass moment of inertia J based on water [kgm²]
050-215	-	B01	65	50	13000	-	✗	10	15	-	80	42	210	130	0,019
050-216	-	B01	65	50	13000	-	✗	10	15	-	80	25	210	120	0,025
050-250	S01	-	65	50	13000	-	✗	10	15	-	80	25	200	150	0,027
050-250	-	B01	65	50	13000	-	✗	10	15	-	80	25	200	150	0,027
065-215	-	B01	80	65	13000	-	✗	6	9	-	80	65	210	120	0,025
065-250	S01	-	80	65	13000	-	✗	6	9	-	80	66	210	170	0,027
065-250	-	B01	80	65	13000	-	✗	6	9	-	80	66	210	170	0,027
080-216	-	B01	100	80	13000	-	✗	6	9	-	120	76	210	120	0,025
080-250	S01	-	100	80	13000	-	✗	6	9	-	120	76	210	180	0,095
080-250	-	B01	100	80	13000	-	✗	6	9	-	120	76	210	180	0,095
080-315	S03	-	100	80	80000	-	✗	10	15	-	120	76	250	211	0,119
080-315	-	B03	100	80	80000	-	✗	10	15	-	120	76	250	211	0,119
100-215	-	B01	100	100	13000	-	✗	6	9	100	120	100	210	120	0,025
100-250	S01	-	100	100	13000	-	✗	6	9	118	120	100	265	200	0,119
100-250	-	B01	100	100	13000	-	✗	6	9	118	120	100	265	200	0,119
100-251	S02	-	100	100	50000	-	✗	6	9	118	120	100	265	249	0,119
100-251	-	B02	100	100	50000	-	✗	6	9	118	120	100	265	249	0,119
100-252	S01	-	100	100	50000	-	✗	6	9	118	120	100	210/265	170	0,119
100-252	-	B01	100	100	50000	-	✗	6	9	118	120	100	210/265	170	0,119
100-253	S02	-	100	100	50000	-	✗	6	9	118	120	100	265	249	0,119
100-253	-	B02	100	100	50000	-	✗	6	9	118	120	100	265	249	0,119
100-401	S04	-	100	100	190000	-	✗	10	15	118	120	100	390	325	0,475
100-401	S05	-	100	100	220000	■	✗	10	15	118	120	100	390	325	0,475
125-315	S03	-	125	125	80000	-	✗	6	9	118	120	120	304	240	0,214
125-315	-	B03	125	125	80000	-	✗	6	9	120	120	120	304	240	0,214
150-315	S03	-	150	150	80000	-	✗	6	9	120	150	120	290	250	0,214
150-315	-	B03	150	150	80000	-	✗	6	9	118	150	120	290	250	0,214
150-401	S04	-	150	150	190000	-	✗	10	15	118	200	135	390	270	0,476
150-401	S05	-	150	150	220000	■	✗	10	15	118	200	135	390	270	0,476

Overview

Size	Bearing bracket				Pump data							F impeller			
						Shaft seal		Pressure limits		Inspection hole diameter					
	Sewatec	Sewabloc	Suction nozzle	Discharge nozzle	Torsional spring constant	Gland packing	Mechanical seal	Max. operating pressure	Max. test pressure	Casing	Intermediate flanged piece	Max. free passage	Max. impeller diameter	Min. impeller diameter	Mass moment of inertia J based on water
			["]		[Nm/impeller]			[psi]		["]			["]	["]	[lb ft²]
050-215	-	B01	2 1/2	2	13000	-	✗	145	218	-	3 1/8	1 5/8	8 1/4	5 1/8	0,451
050-216	-	B01	2 1/2	2	13000	-	✗	145	218	-	3 1/8	1	8 1/4	4 3/4	0,593
050-250	S01	-	2 1/2	2	13000	-	✗	145	218	-	3 1/8	1	7 13/16	5 13/16	0,641
050-250	-	B01	2 1/2	2	13000	-	✗	145	218	-	3 1/8	1	7 13/16	5 13/16	0,641
065-215	-	B01	3	2 1/2	13000	-	✗	87	131	-	3 1/8	2 5/8	8 1/4	4 3/4	0,593
065-250	S01	-	3	2 1/2	13000	-	✗	87	131	-	3 1/8	2 5/8	8 1/4	6 11/16	0,641
065-250	-	B01	3	2 1/2	13000	-	✗	87	131	-	3 1/8	2 5/8	8 1/4	6 11/16	0,641
080-216	-	B01	4	3	13000	-	✗	87	131	-	4 3/4	3	8 1/4	4 3/4	0,593
080-250	S01	-	4	3	13000	-	✗	87	131	-	4 3/4	3	8 1/4	7 1/16	2,254
080-250	-	B01	4	3	13000	-	✗	87	131	-	4 3/4	3	8 1/4	7 1/16	2,254
080-315	S03	-	4	3	80000	-	✗	145	218	-	4 3/4	3	9 3/4	8 5/16	2,824
080-315	-	B03	4	3	80000	-	✗	145	218	-	4 3/4	3	9 3/4	8 5/16	2,824
100-215	-	B01	4	4	13000	-	✗	87	131	3 15/16	4 3/4	3 15/16	8 1/4	4 3/4	0,593
100-250	S01	-	4	4	13000	-	✗	87	131	4 5/8	4 3/4	3 15/16	10 7/16	7 13/16	2,824
100-250	-	B01	4	4	13000	-	✗	87	131	4 5/8	4 3/4	3 15/16	10 7/16	7 13/16	2,824
100-251	S02	-	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3 15/16	10 7/16	9 13/16	2,824
100-251	-	B02	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3 15/16	10 7/16	9 13/16	2,824
100-252	S01	-	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3 15/16	8 1/4/10 7/16	6 11/16	2,824
100-252	-	B01	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3 15/16	8 1/4/10 7/16	6 11/16	2,824
100-253	S02	-	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3 15/16	10 7/16	9 13/16	2,824
100-253	-	B02	4	4	50000	-	✗	87	131	4 5/8	4 3/4	3 15/16	10 7/16	9 13/16	2,824
100-401	S04	-	4	4	190000	-	✗	145	218	4 5/8	4 3/4	3 15/16	15 3/8	12 3/4	11,272
100-401	S05	-	4	4	220000	■	✗	145	218	4 5/8	4 3/4	3 15/16	15 3/8	12 3/4	11,272
125-315	S03	-	5	5	80000	-	✗	87	131	4 5/8	4 3/4	4 3/4	11 15/16	9 7/16	5,078
125-315	-	B03	5	5	80000	-	✗	87	131	4 5/8	4 3/4	4 3/4	11 15/16	9 7/16	5,078
150-315	S03	-	6	6	80000	-	✗	87	131	4 3/4	5 13/16	4 3/4	11 7/16	9 3/4	5,078
150-315	-	B03	6	6	80000	-	✗	87	131	4 3/4	5 13/16	4 3/4	11 7/16	9 3/4	5,078
150-401	S04	-	6	6	190000	-	✗	10	15	4 5/8	7 13/16	5 5/16	15 3/8	10 5/8	11,272
150-401	S05	-	6	6	220000	■	✗	145	218	4 5/8	7 13/16	5 5/16	15 3/8	10 5/8	11,272

Key to the symbols

Symbol	Description
■	Optional
✗	Standard

E impeller

Overview

Size	Bearing bracket: Sewatec	Bearing bracket: Sewabloc	Suction nozzle [mm]	Discharge nozzle [mm]	Pump data: Torsional spring constant [Nm/impeller]	Shaft seal: Gland packing	Shaft seal: Mechanical seal	Pressure limits: Max. operating pressure [bar]	Pressure limits: Max. test pressure [bar]	Inspection hole diameter: Casing [mm]	Inspection hole diameter: Intermediate flanged piece [mm]	E impeller: Max. free passage [mm]	E impeller: Max. impeller diameter [mm]	E impeller: Min. impeller diameter [mm]	E impeller: Mass moment of inertia J based on water [kgm²]
100-250	S01	-	100	100	13000	-	✗	6	9	118	120	95	245	-	0,16
100-251	S02	-	100	100	50000	-	✗	6	9	118	120	95	265	-	0,16
125-317	S03	-	125	125	80000	-	✗	6	9	118	120	100	330	-	0,25
150-315	S03	-	200	150	80000	-	✗	6	9	120	150	120	320	-	0,25

Overview

Size	Bearing bracket: Sewatec	Bearing bracket: Sewabloc	Suction nozzle ["]	Discharge nozzle ["]	Pump data: Torsional spring constant [Nm/impeller]	Shaft seal: Gland packing	Shaft seal: Mechanical seal	Pressure limits: Max. operating pressure [psi]	Pressure limits: Max. test pressure [psi]	Inspection hole diameter: Casing ["]	Inspection hole diameter: Intermediate flanged piece ["]	E impeller: Max. free passage ["]	E impeller: Max. impeller diameter ["]	E impeller: Min. impeller diameter ["]	E impeller: Mass moment of inertia J based on water [lb ft²]
100-250	S01	-	4	4	13000	-	✗	87	131	4 $^{5}/_{8}$	4 $^{3}/_{4}$	3 $^{3}/_{4}$	9 $^{5}/_{8}$	-	3,797
100-251	S02	-	4	4	50000	-	✗	87	131	4 $^{5}/_{8}$	4 $^{3}/_{4}$	3 $^{3}/_{4}$	10 $^{7}/_{16}$	-	3,797
125-317	S03	-	5	5	80000	-	✗	87	131	4 $^{5}/_{8}$	4 $^{3}/_{4}$	3 $^{15}/_{16}$	12 $^{5}/_{8}$	-	5,933
150-315	S03	-	6	6	80000	-	✗	87	131	4 $^{3}/_{4}$	5 $^{13}/_{16}$	4 $^{3}/_{4}$	12 $^{5}/_{8}$	-	8,543

Key to the symbols

Symbol	Description
■	Optional
✗	Standard

Selection charts

Sewatec/Sewabloc, n = 1750/1160/875 rpm, K impeller, nominal diameter of the discharge nozzle DN 50, 65, 80, 100, 125 (diameter selection chart)

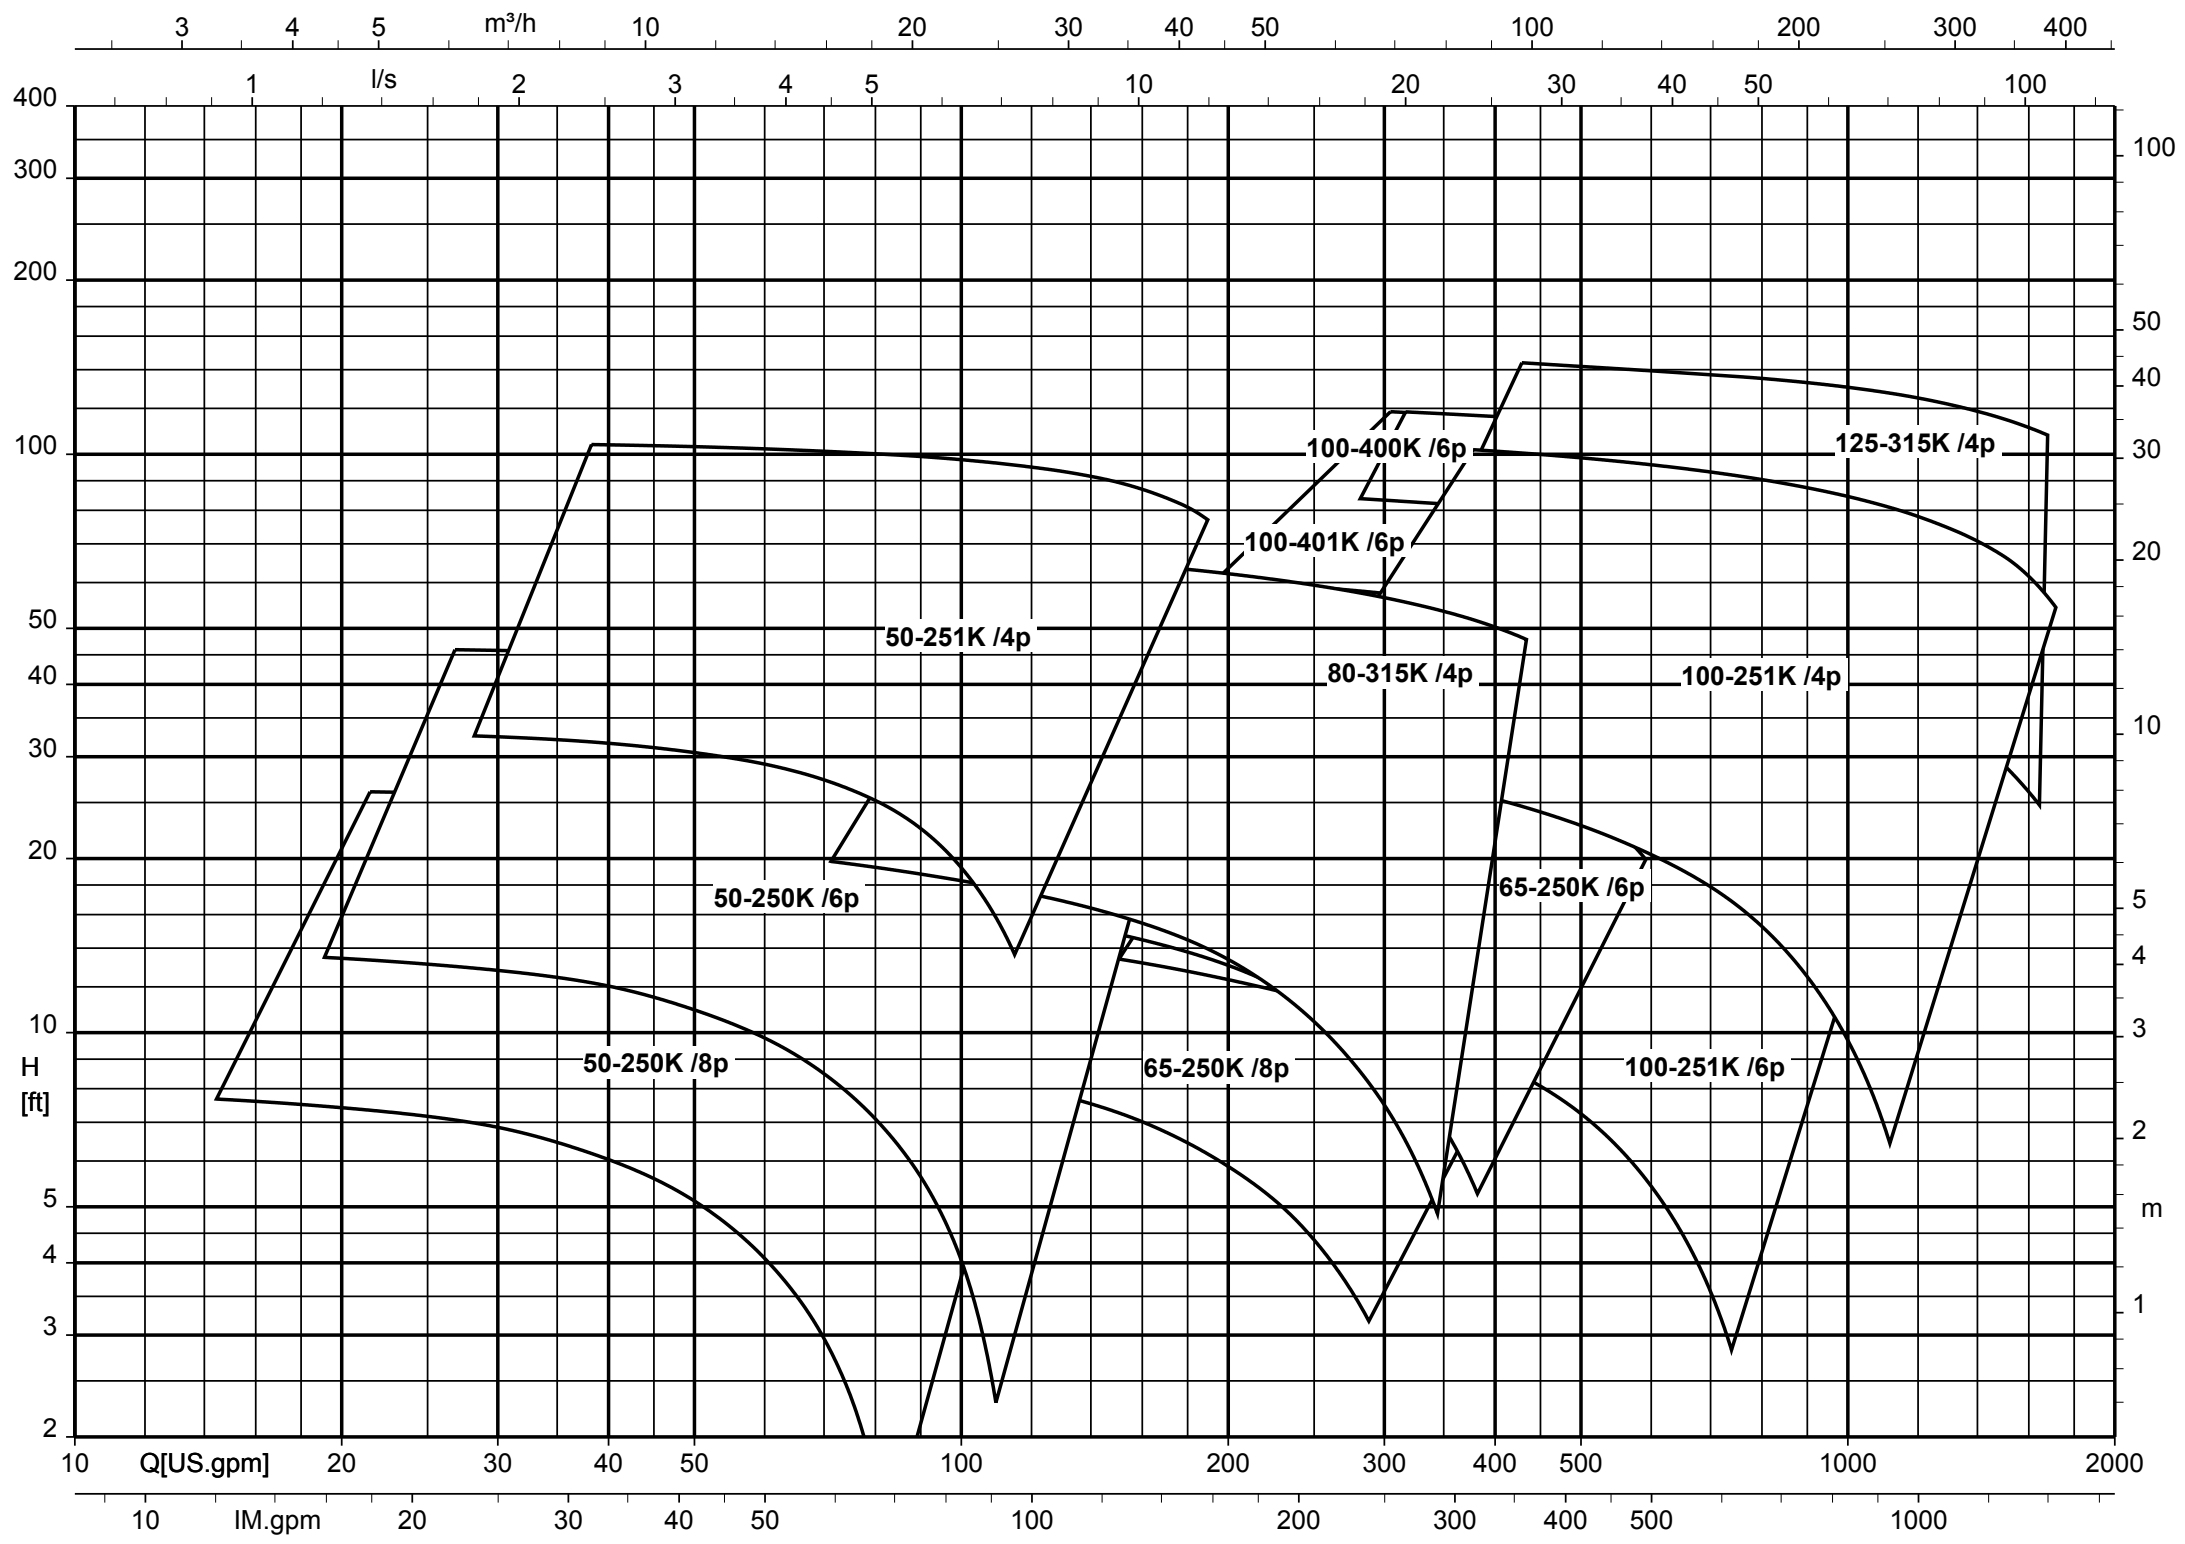

Sewatec/Sewabloc, n = 1750/1160/875 rpm, K impeller, nominal diameter of the discharge nozzle DN 150, 200 (diameter selection chart)

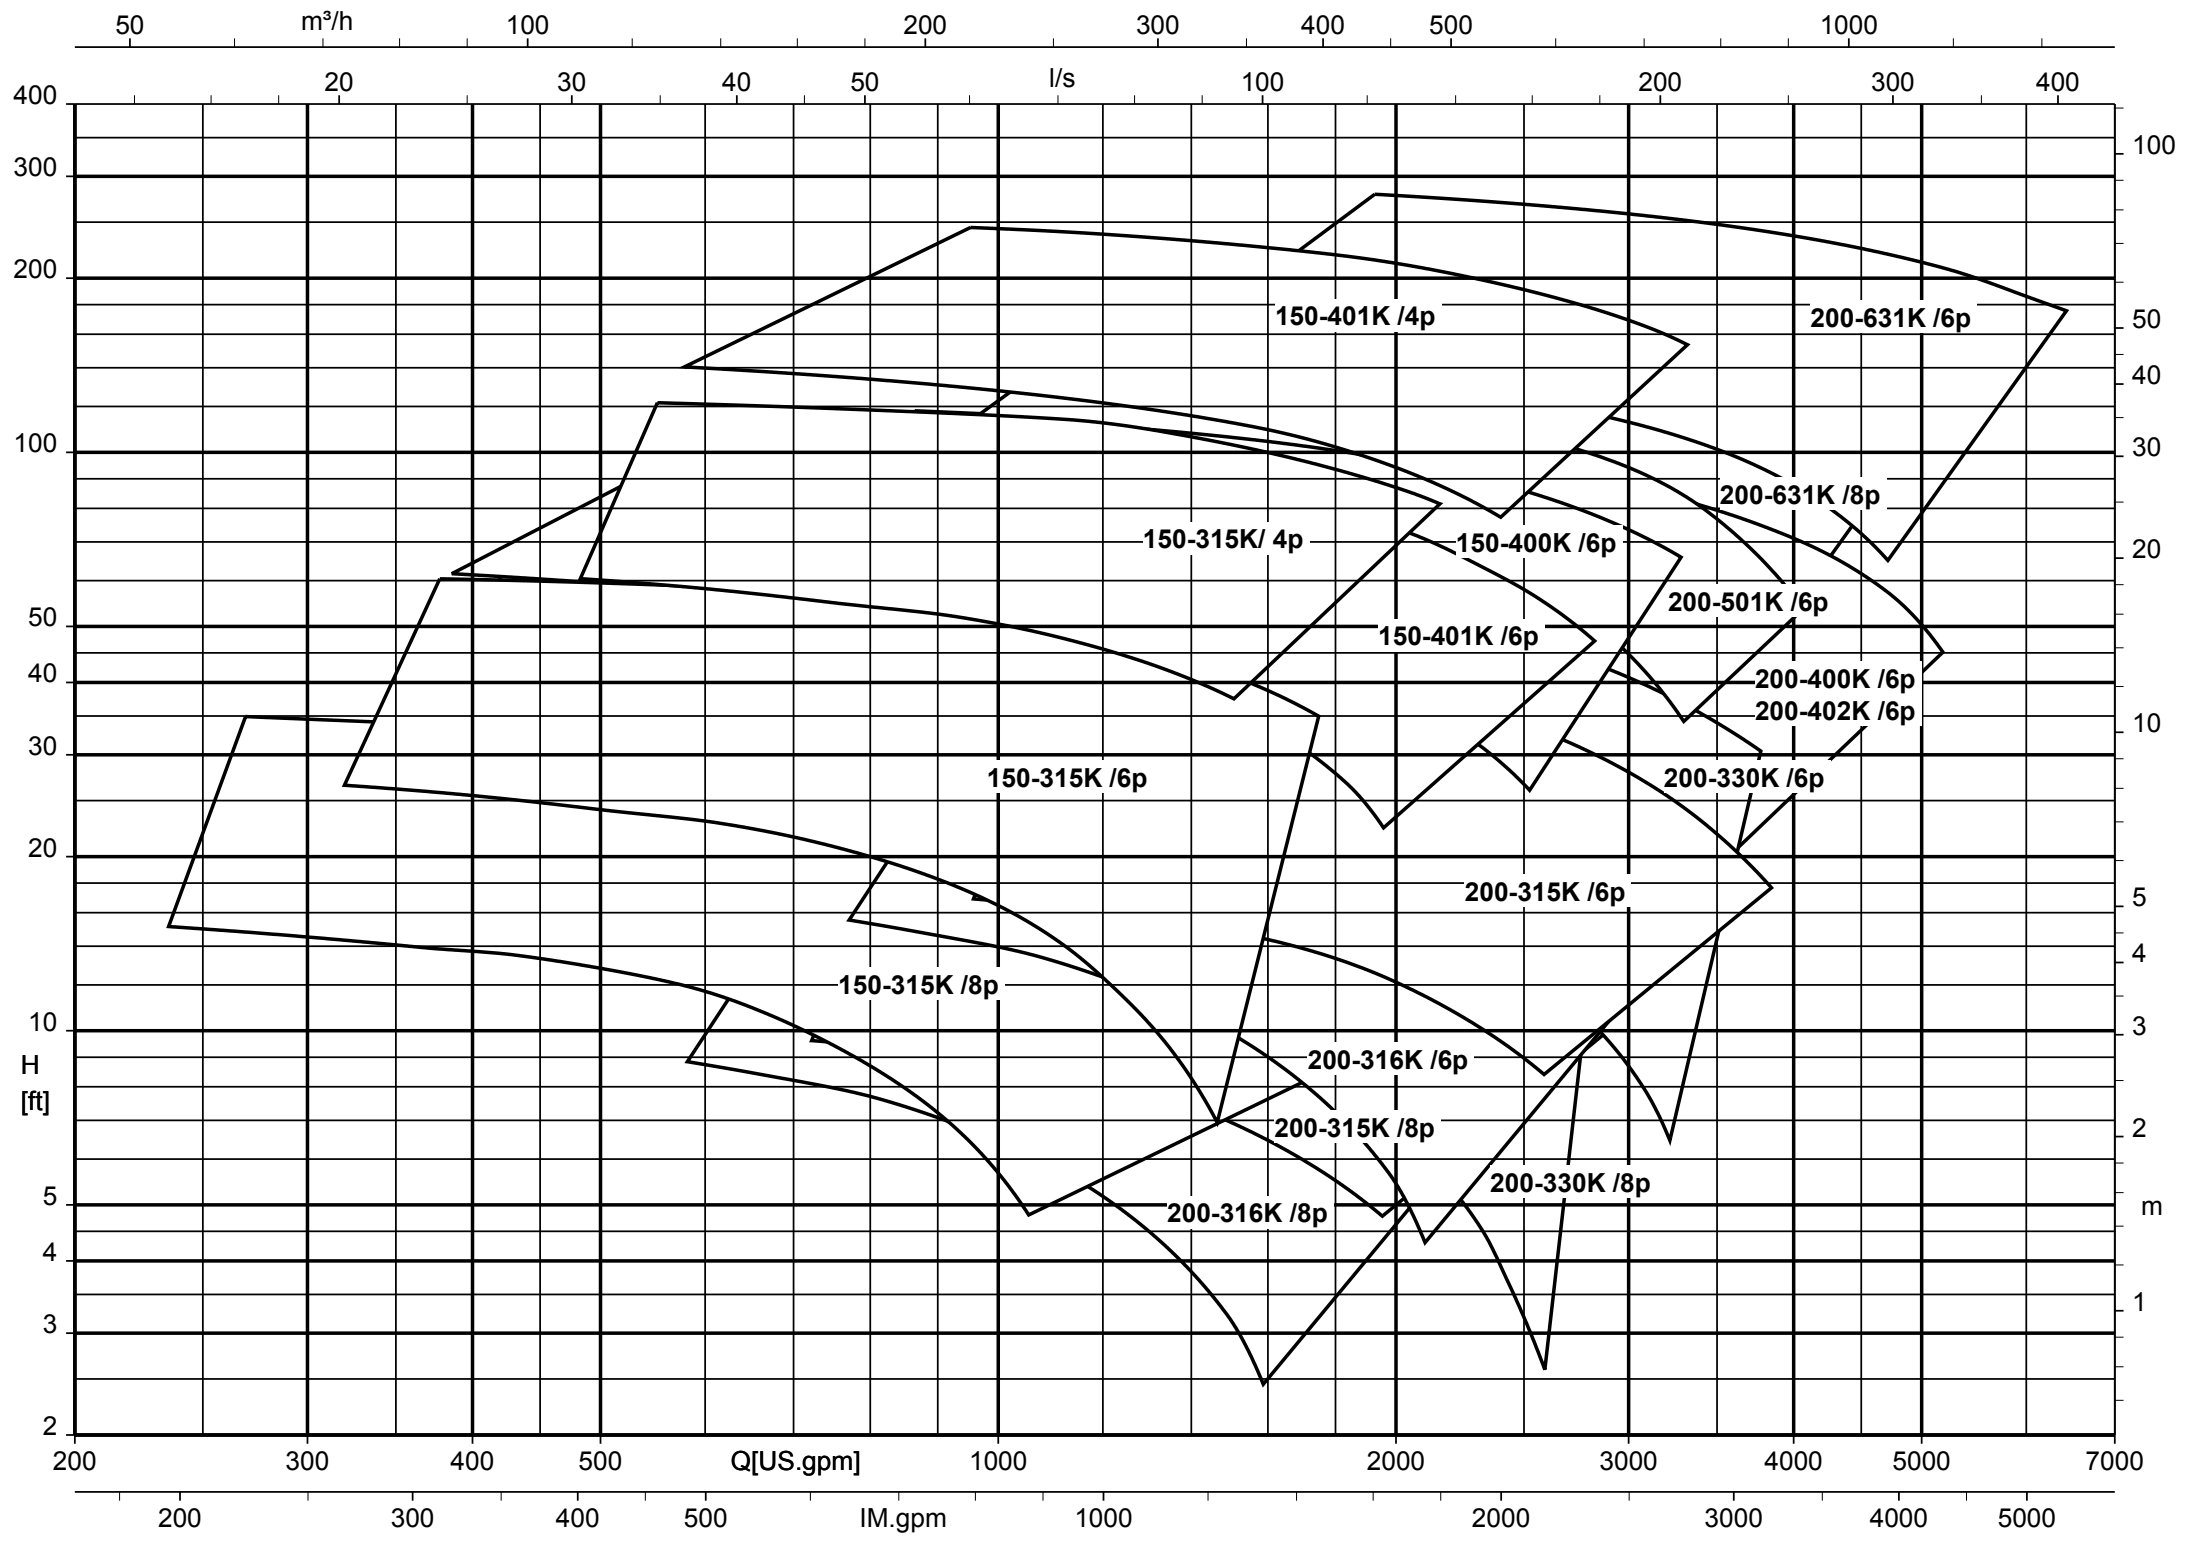

Sewatec/Sewabloc, n = 1160/875/700 rpm, K impeller, nominal diameter of the discharge nozzle DN 250, 300 (diameter selection chart)

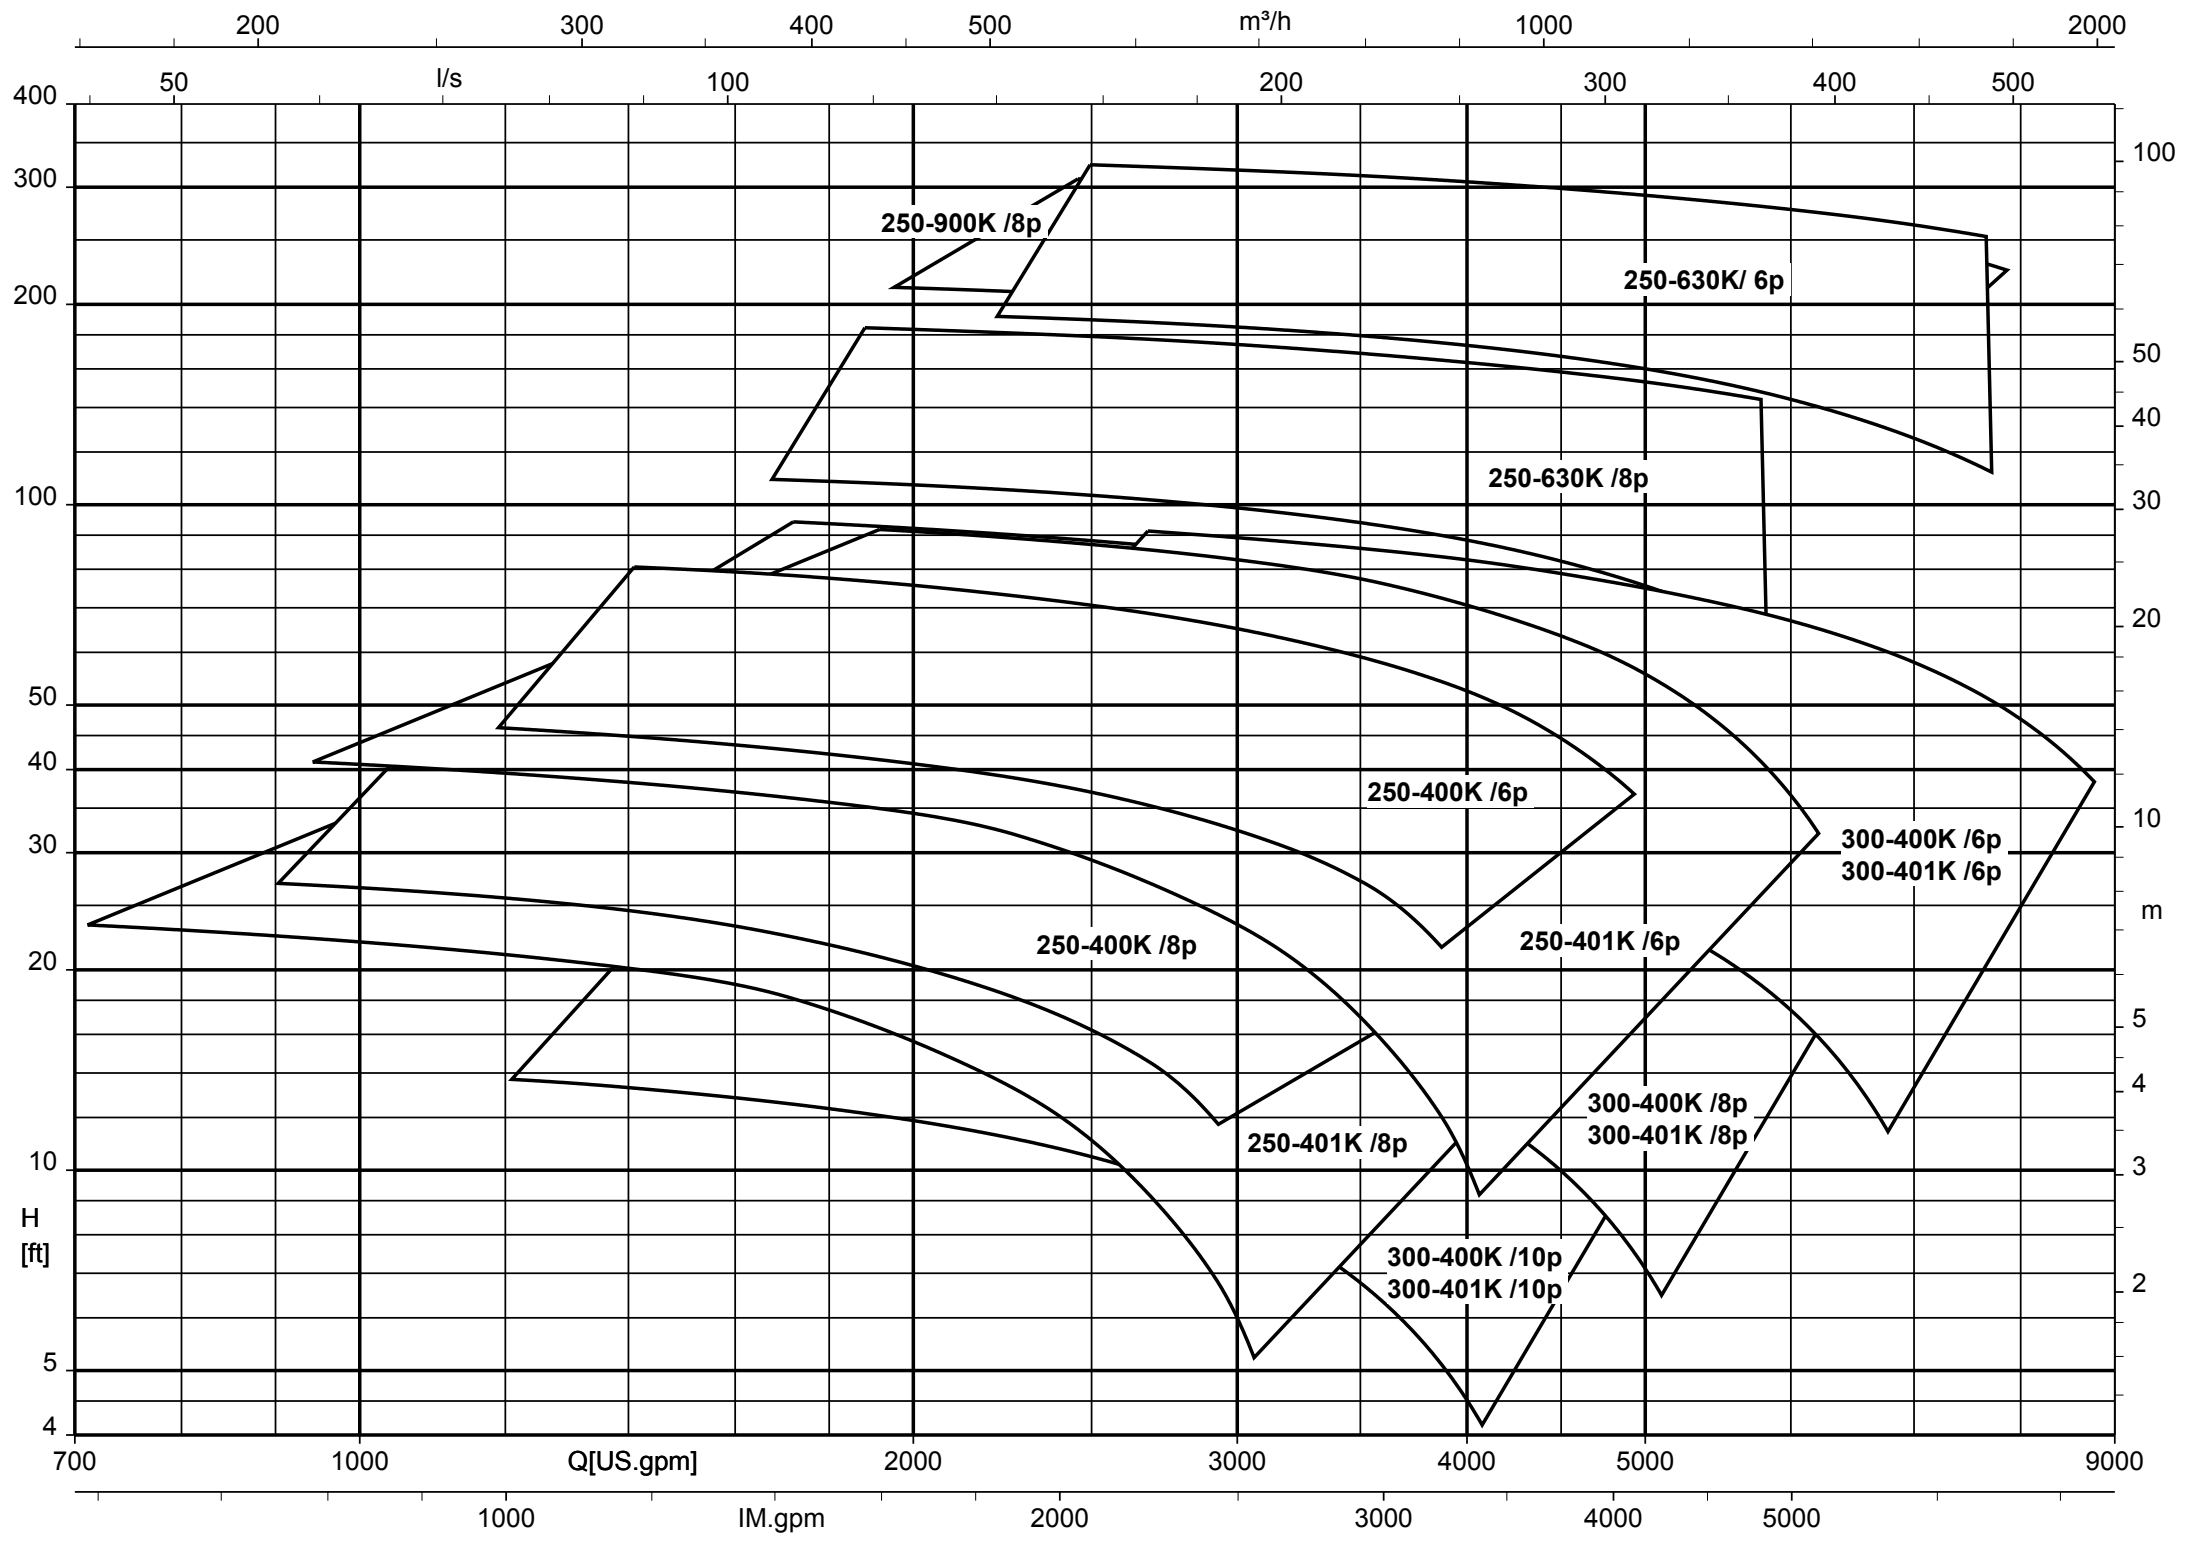

Sewatec/Sewabloc, n = 875/700/585/500 rpm, K impeller, nominal diameter of the discharge nozzle DN 350, 400, 500, 600, 700 (diameter selection chart)

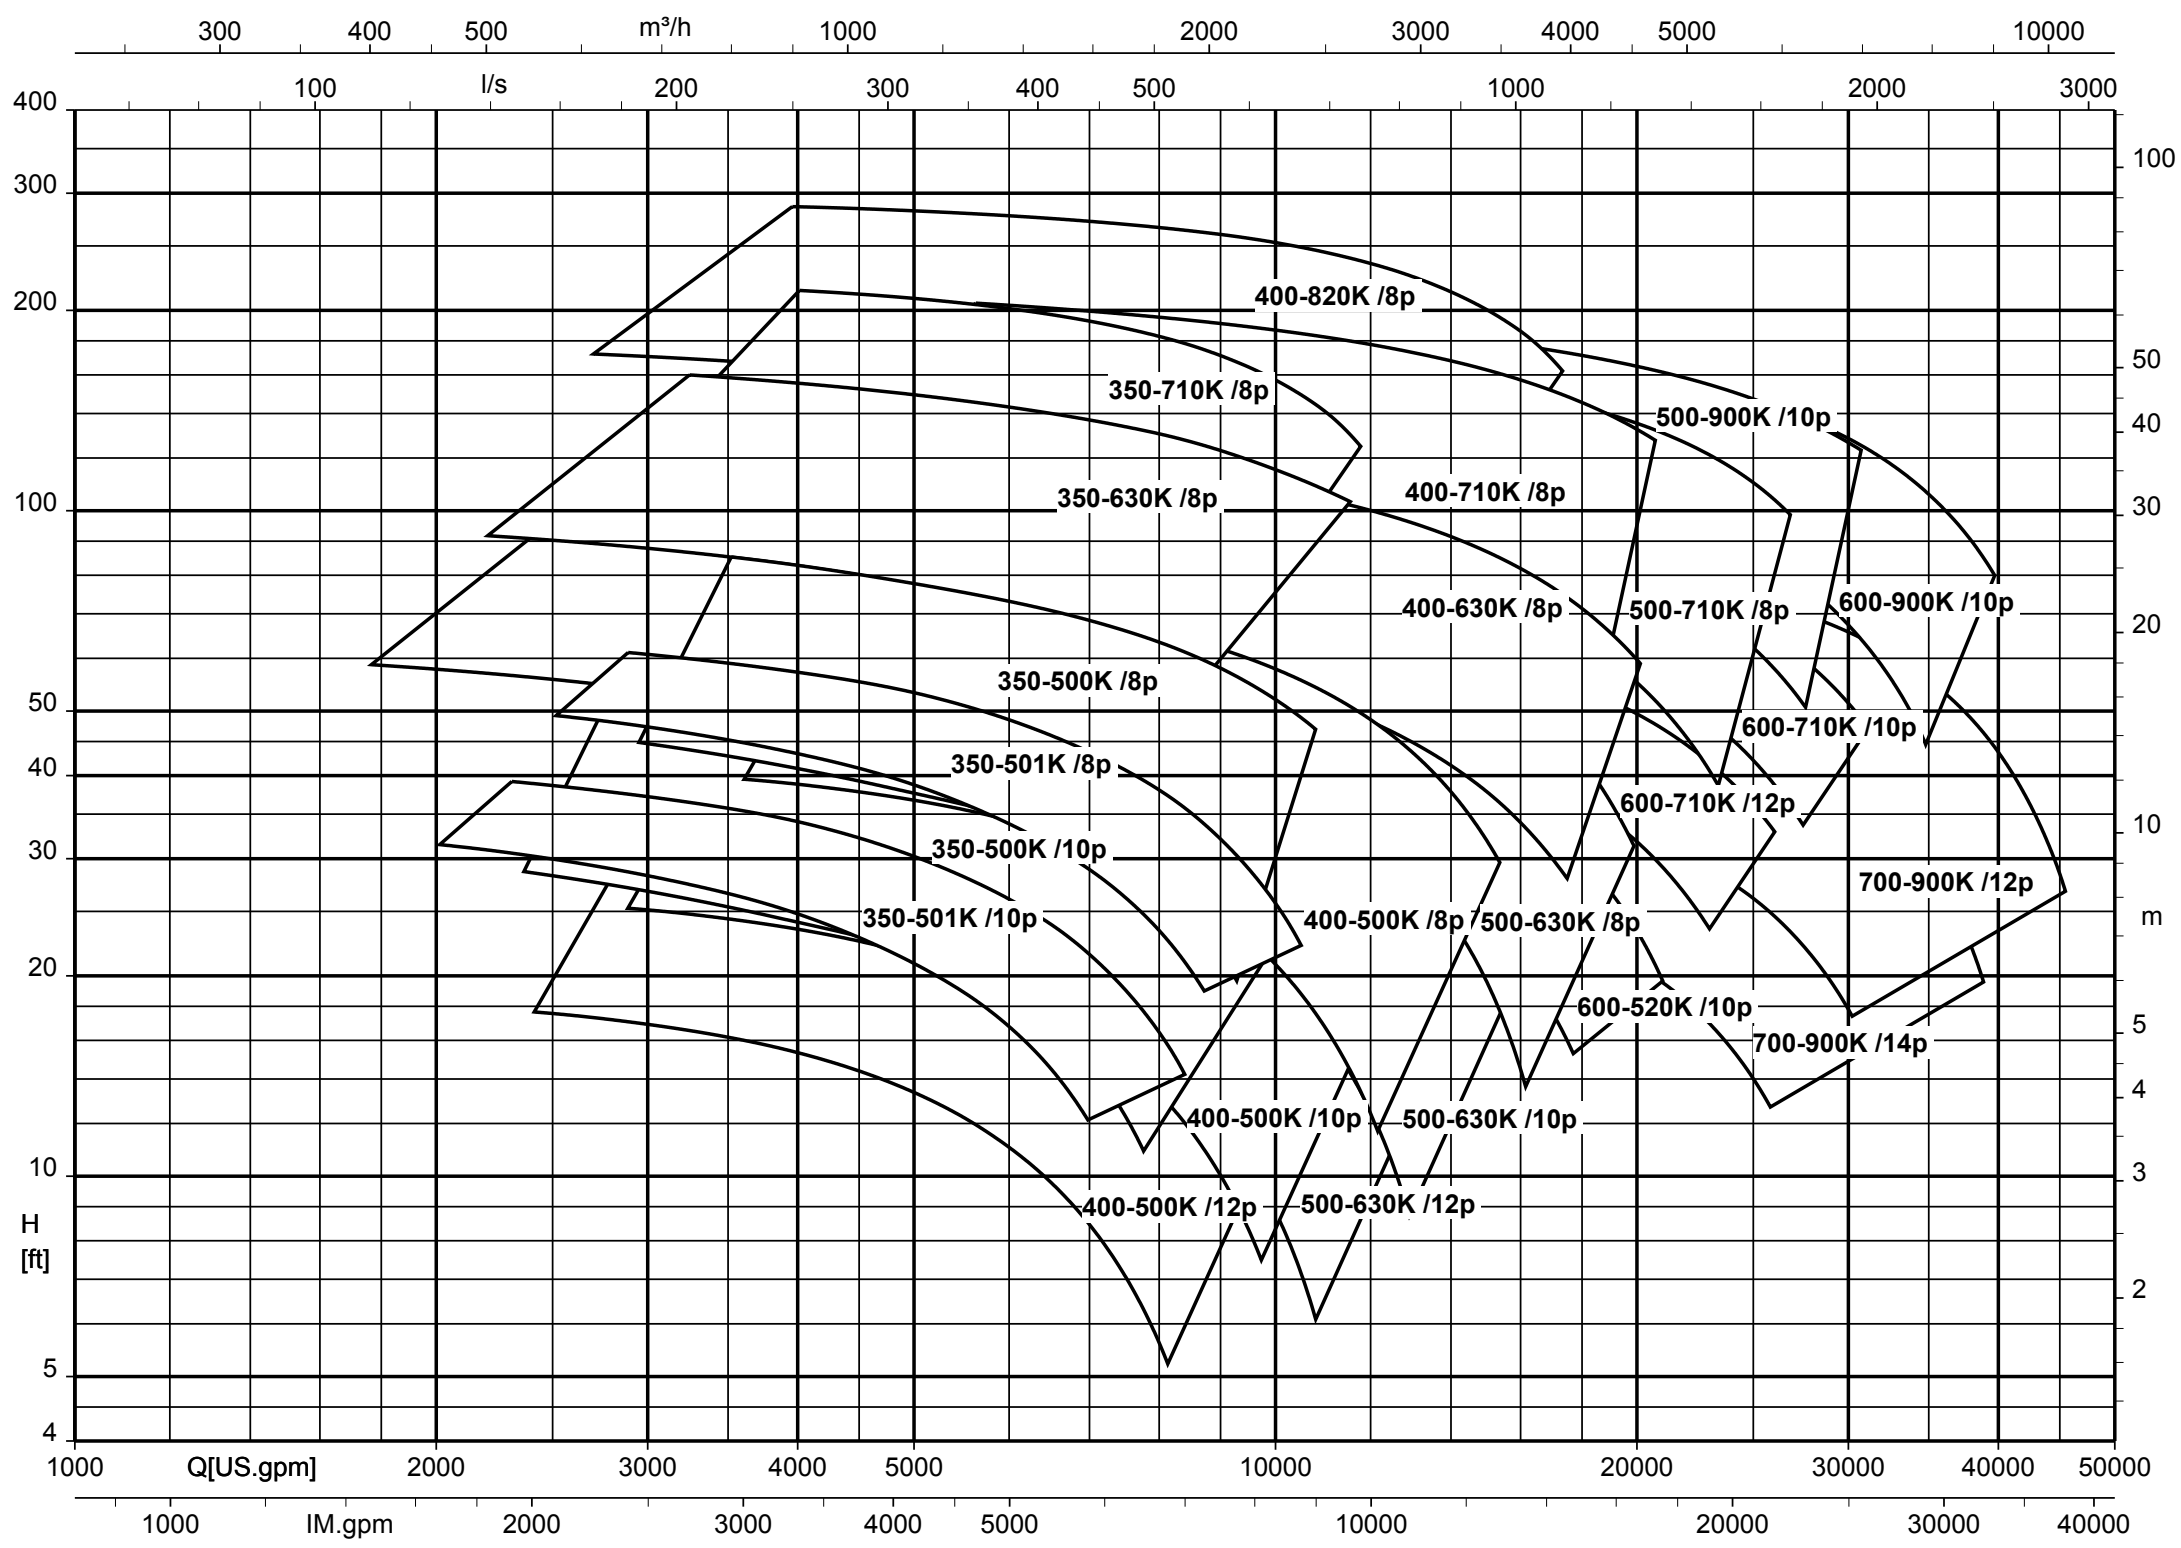

Sewatec/Sewabloc, n = 1750/1160/875 rpm, D impeller (diameter selection chart)

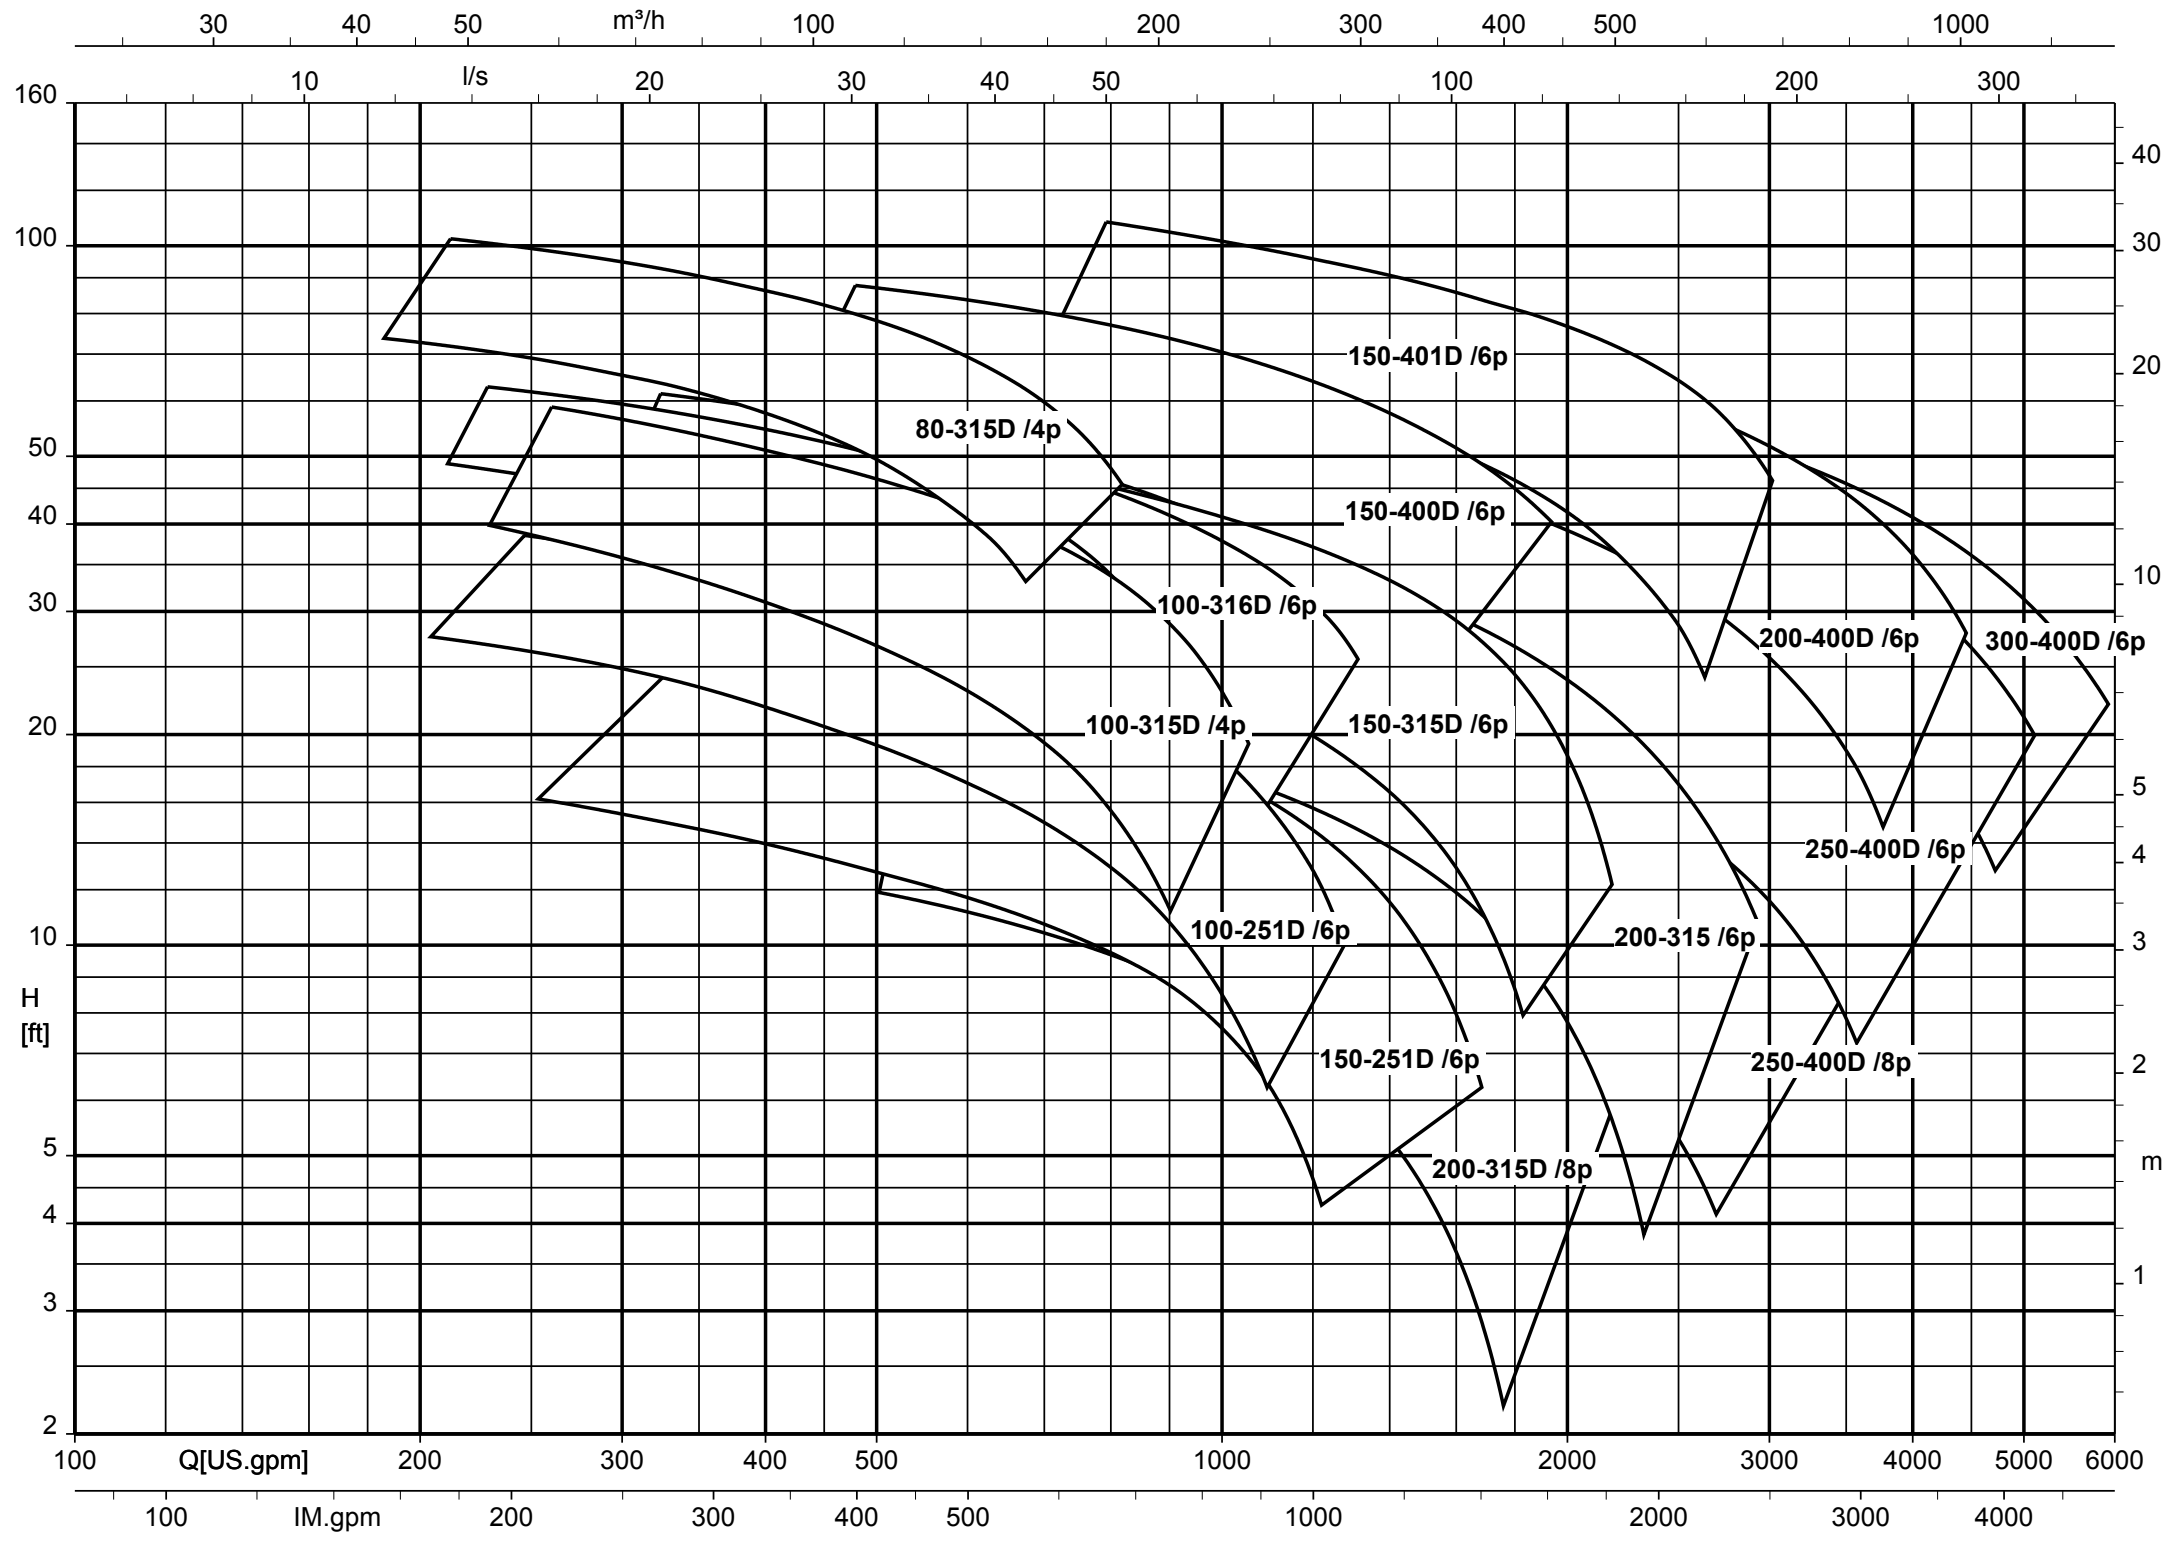

Sewatec/Sewabloc, n = 1750 rpm, F-max impeller (speed selection chart)

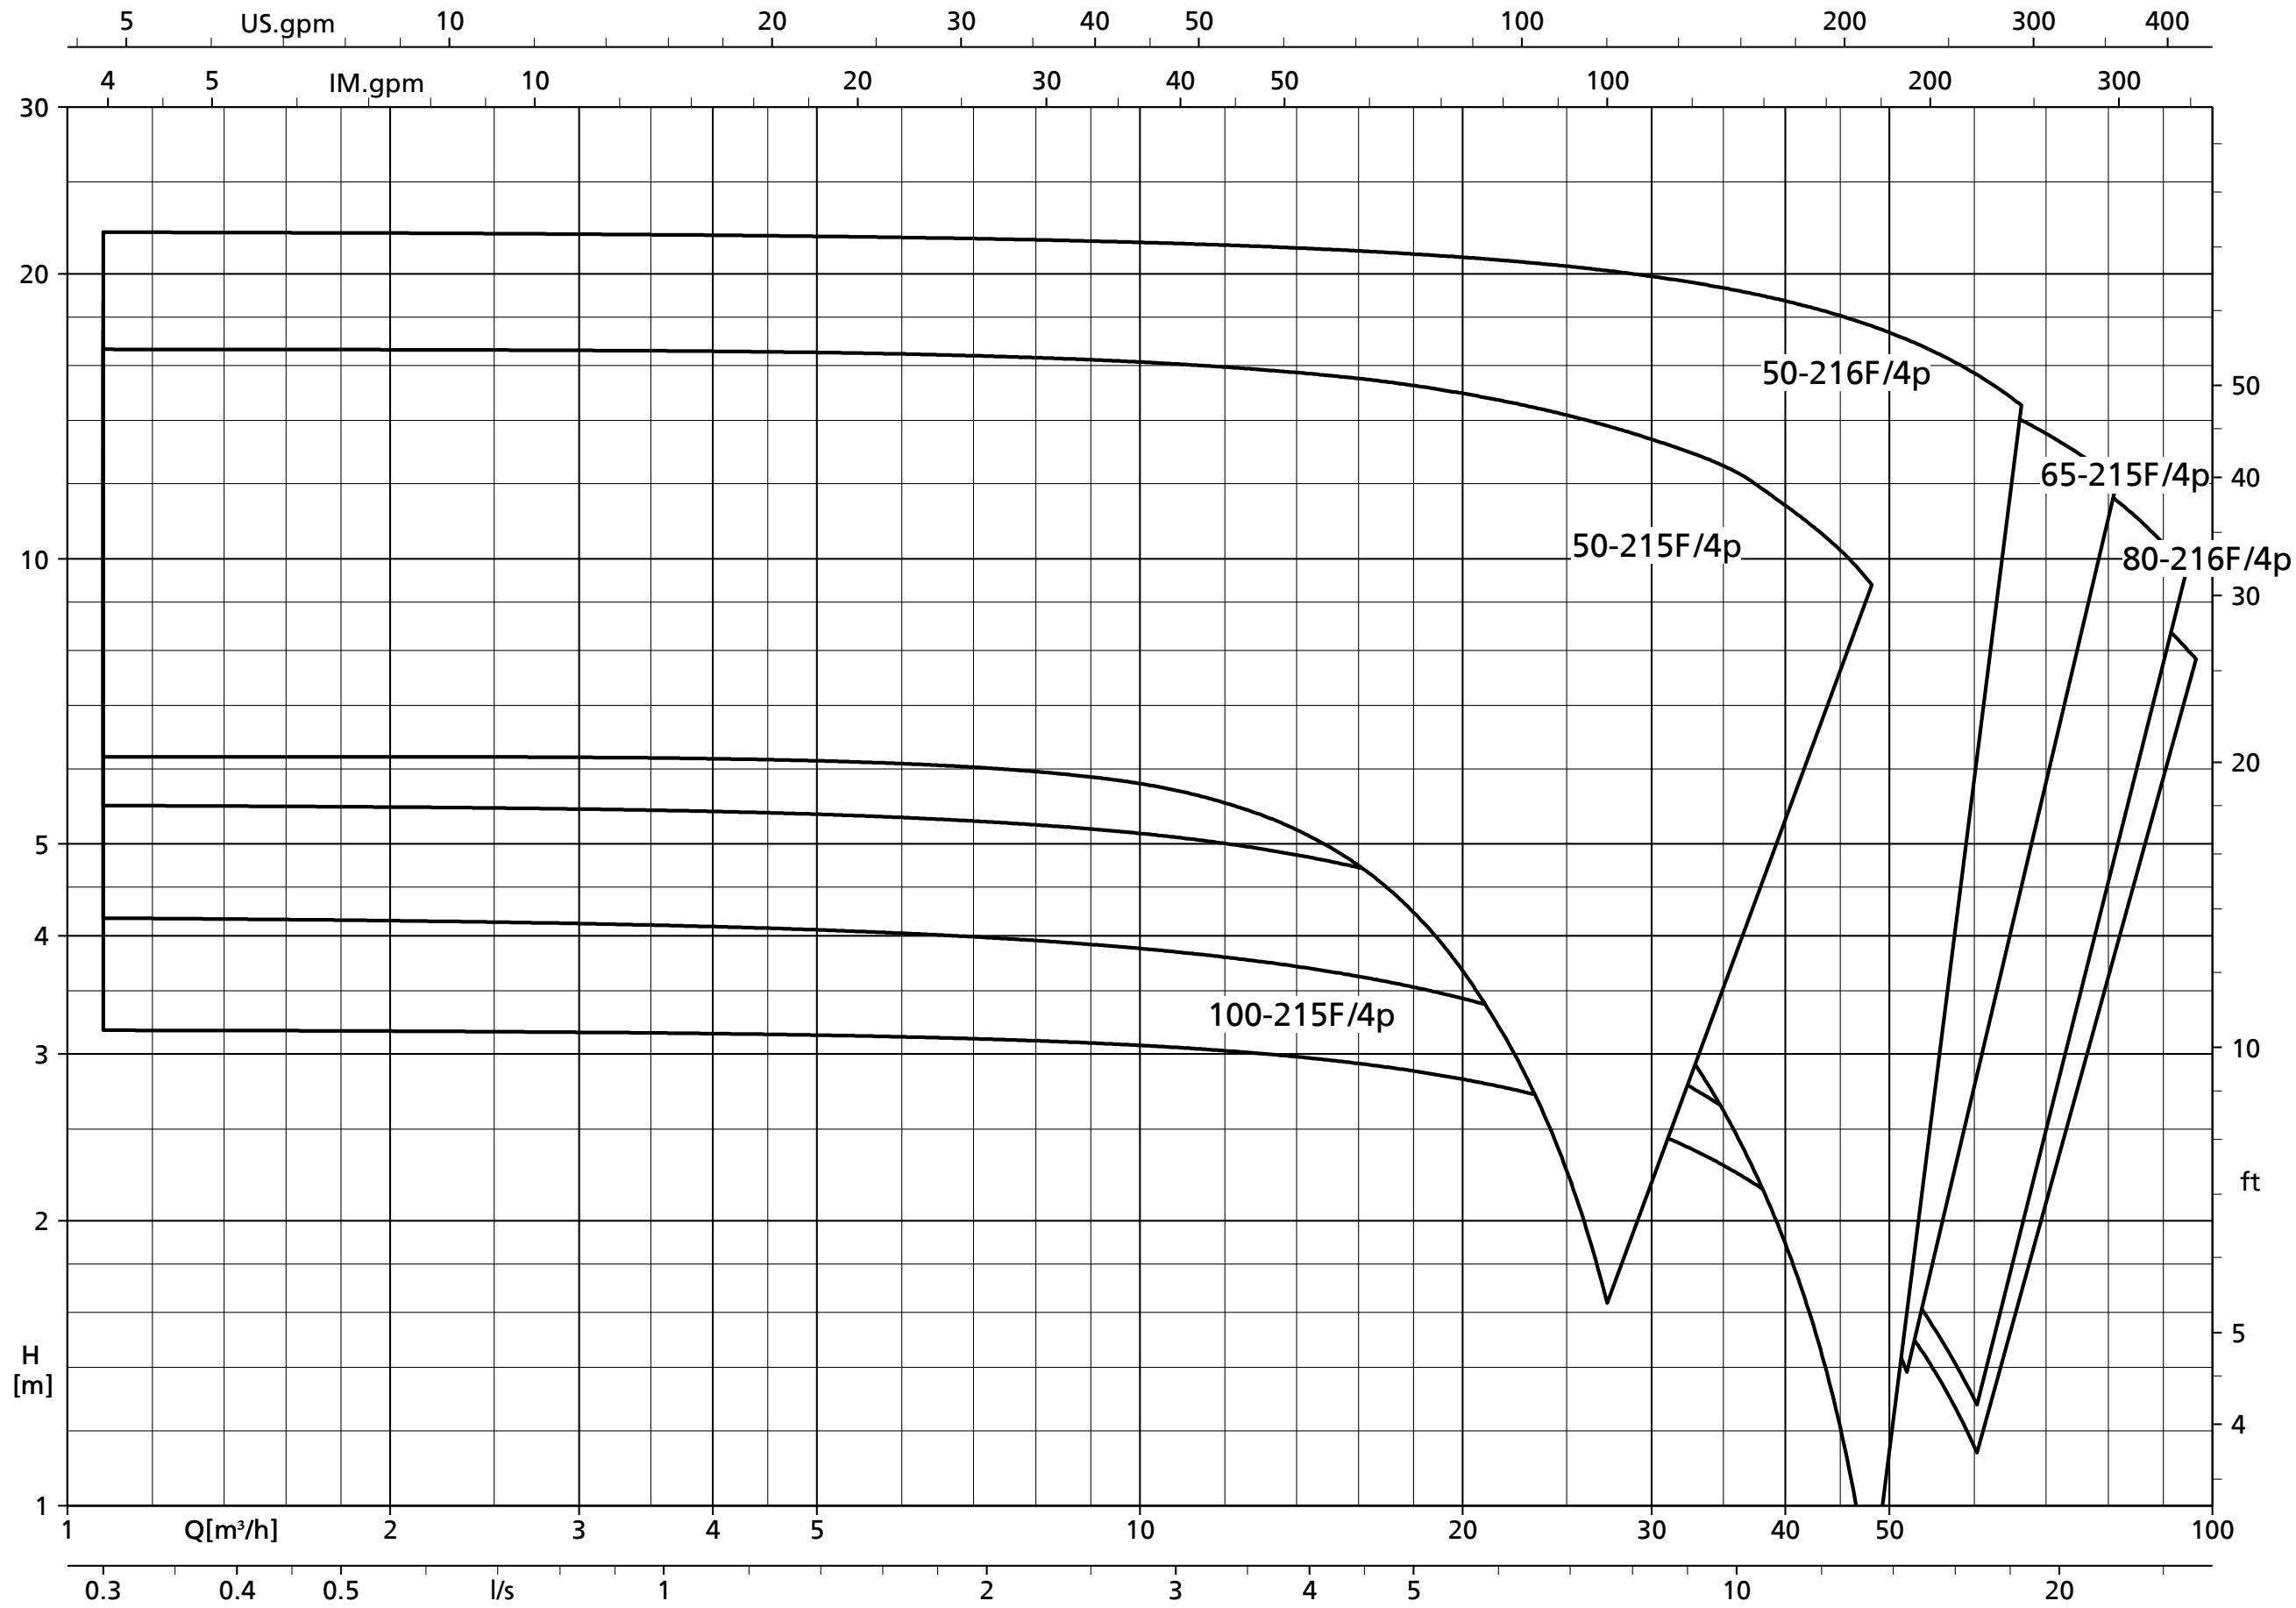

Sewatec/Sewabloc, n = 1750/1160/875 rpm, F impeller (diameter selection chart)

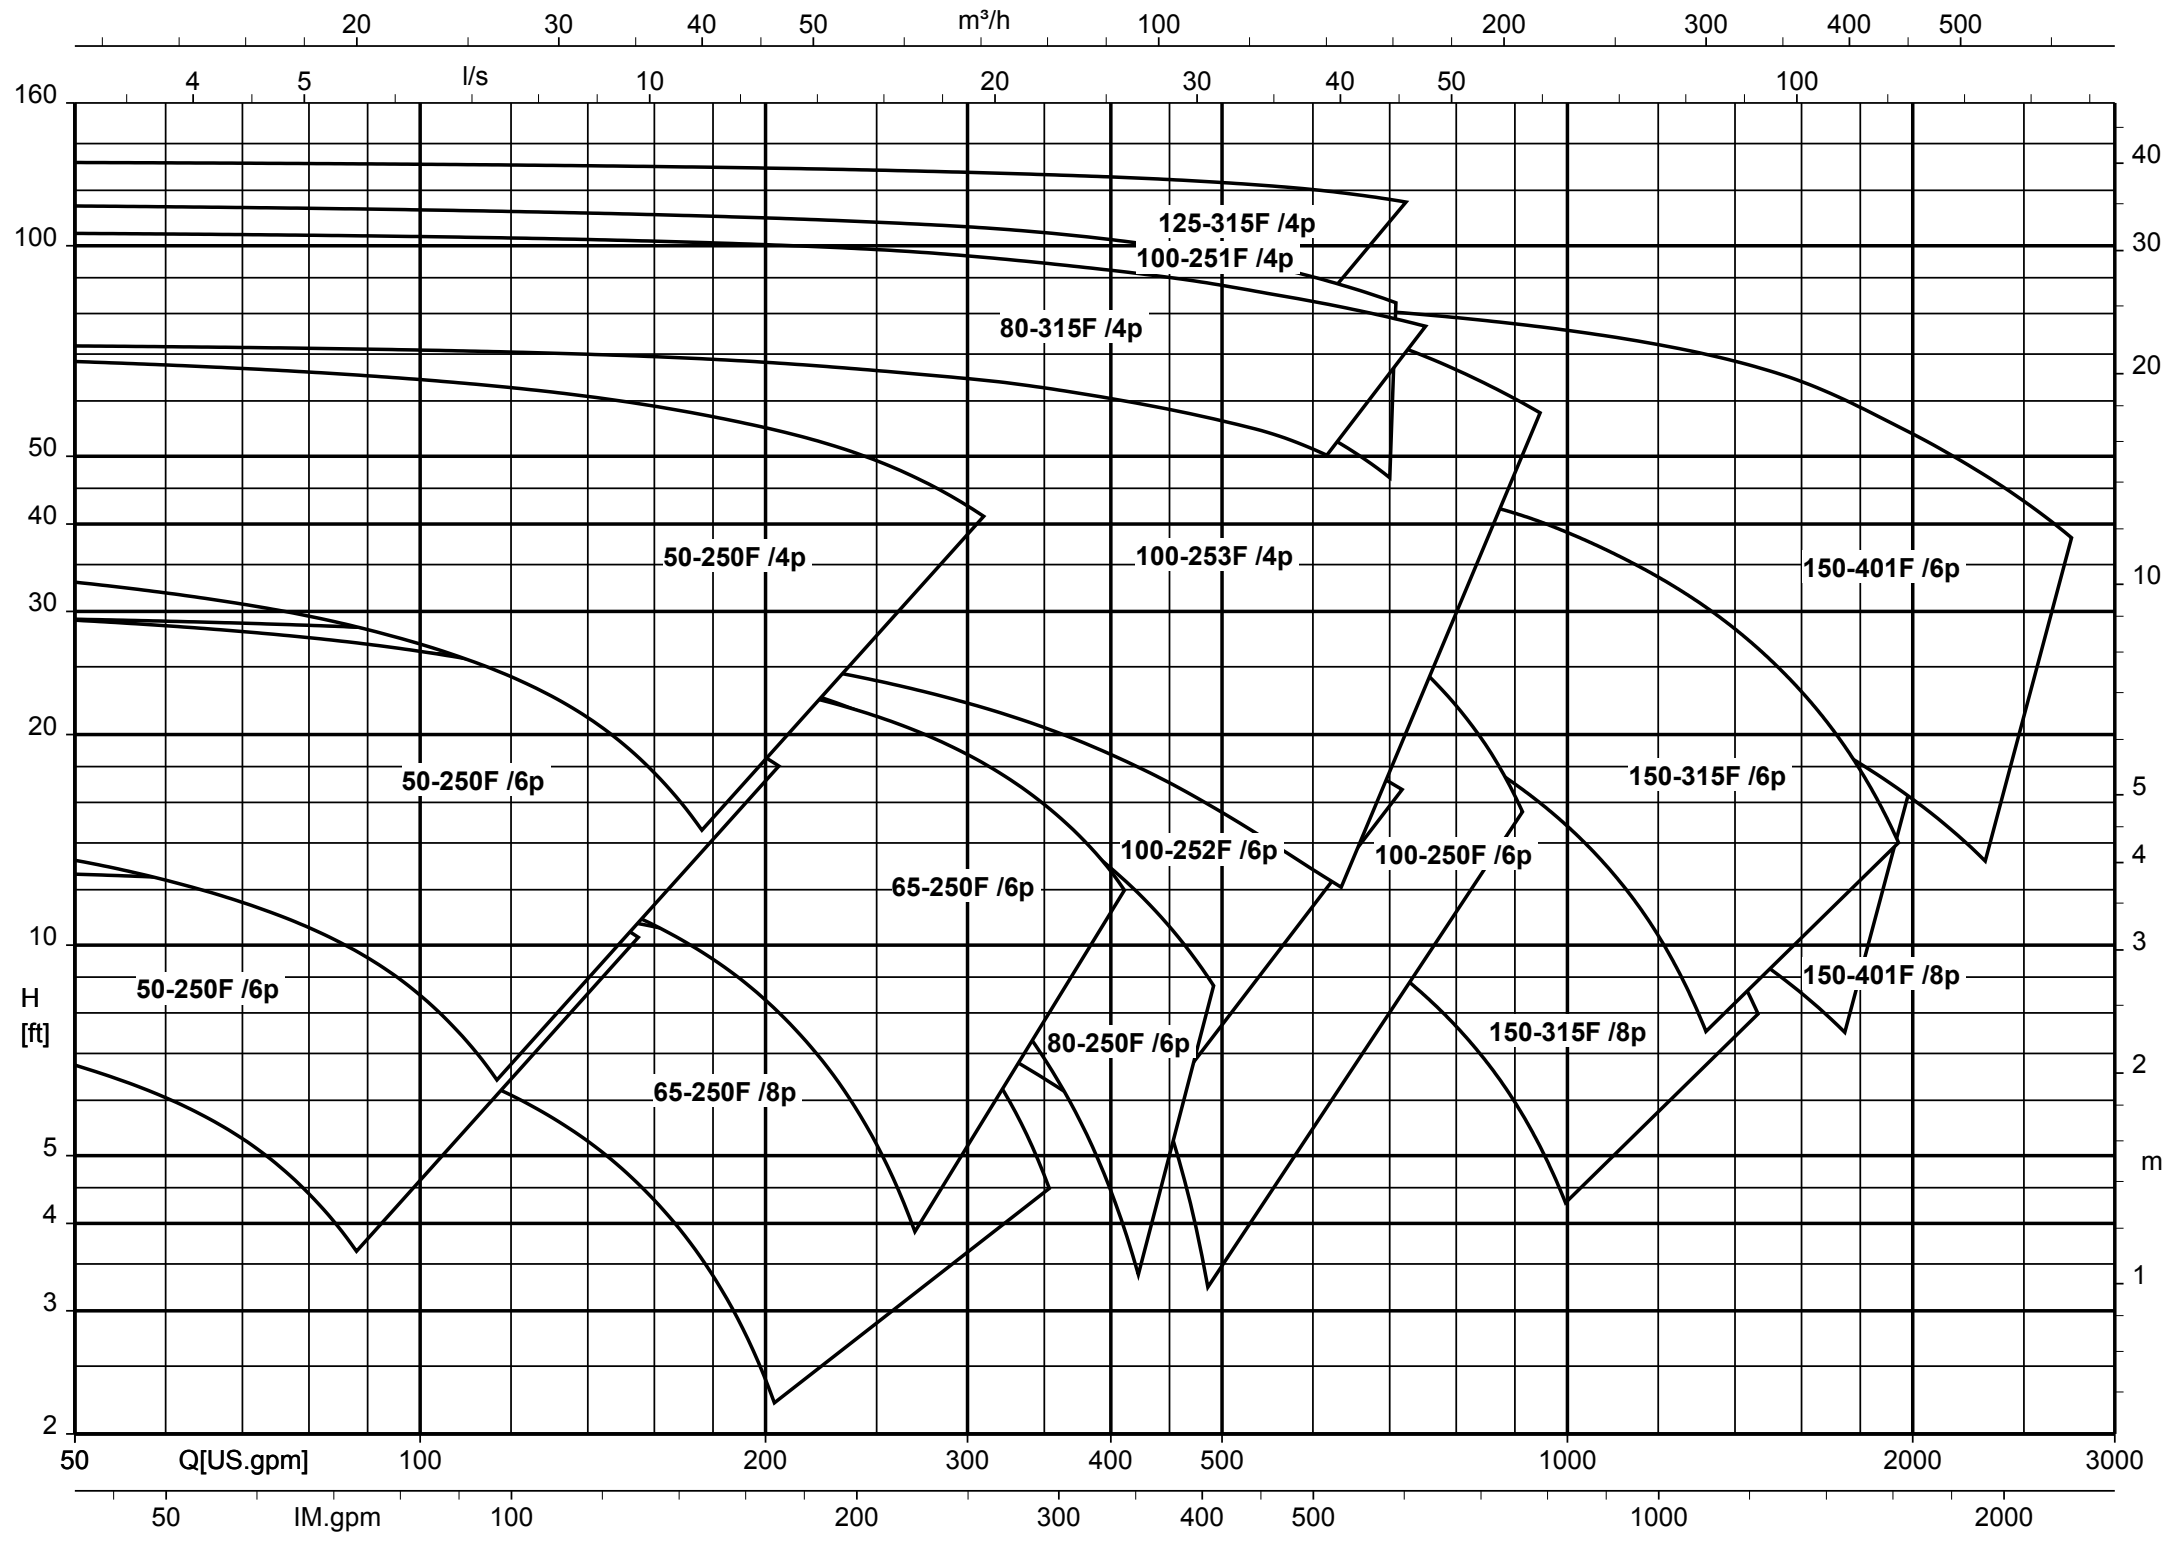

Sewatec/Sewabloc, n = 1160/875/700/585 rpm, E impeller (diameter selection chart)

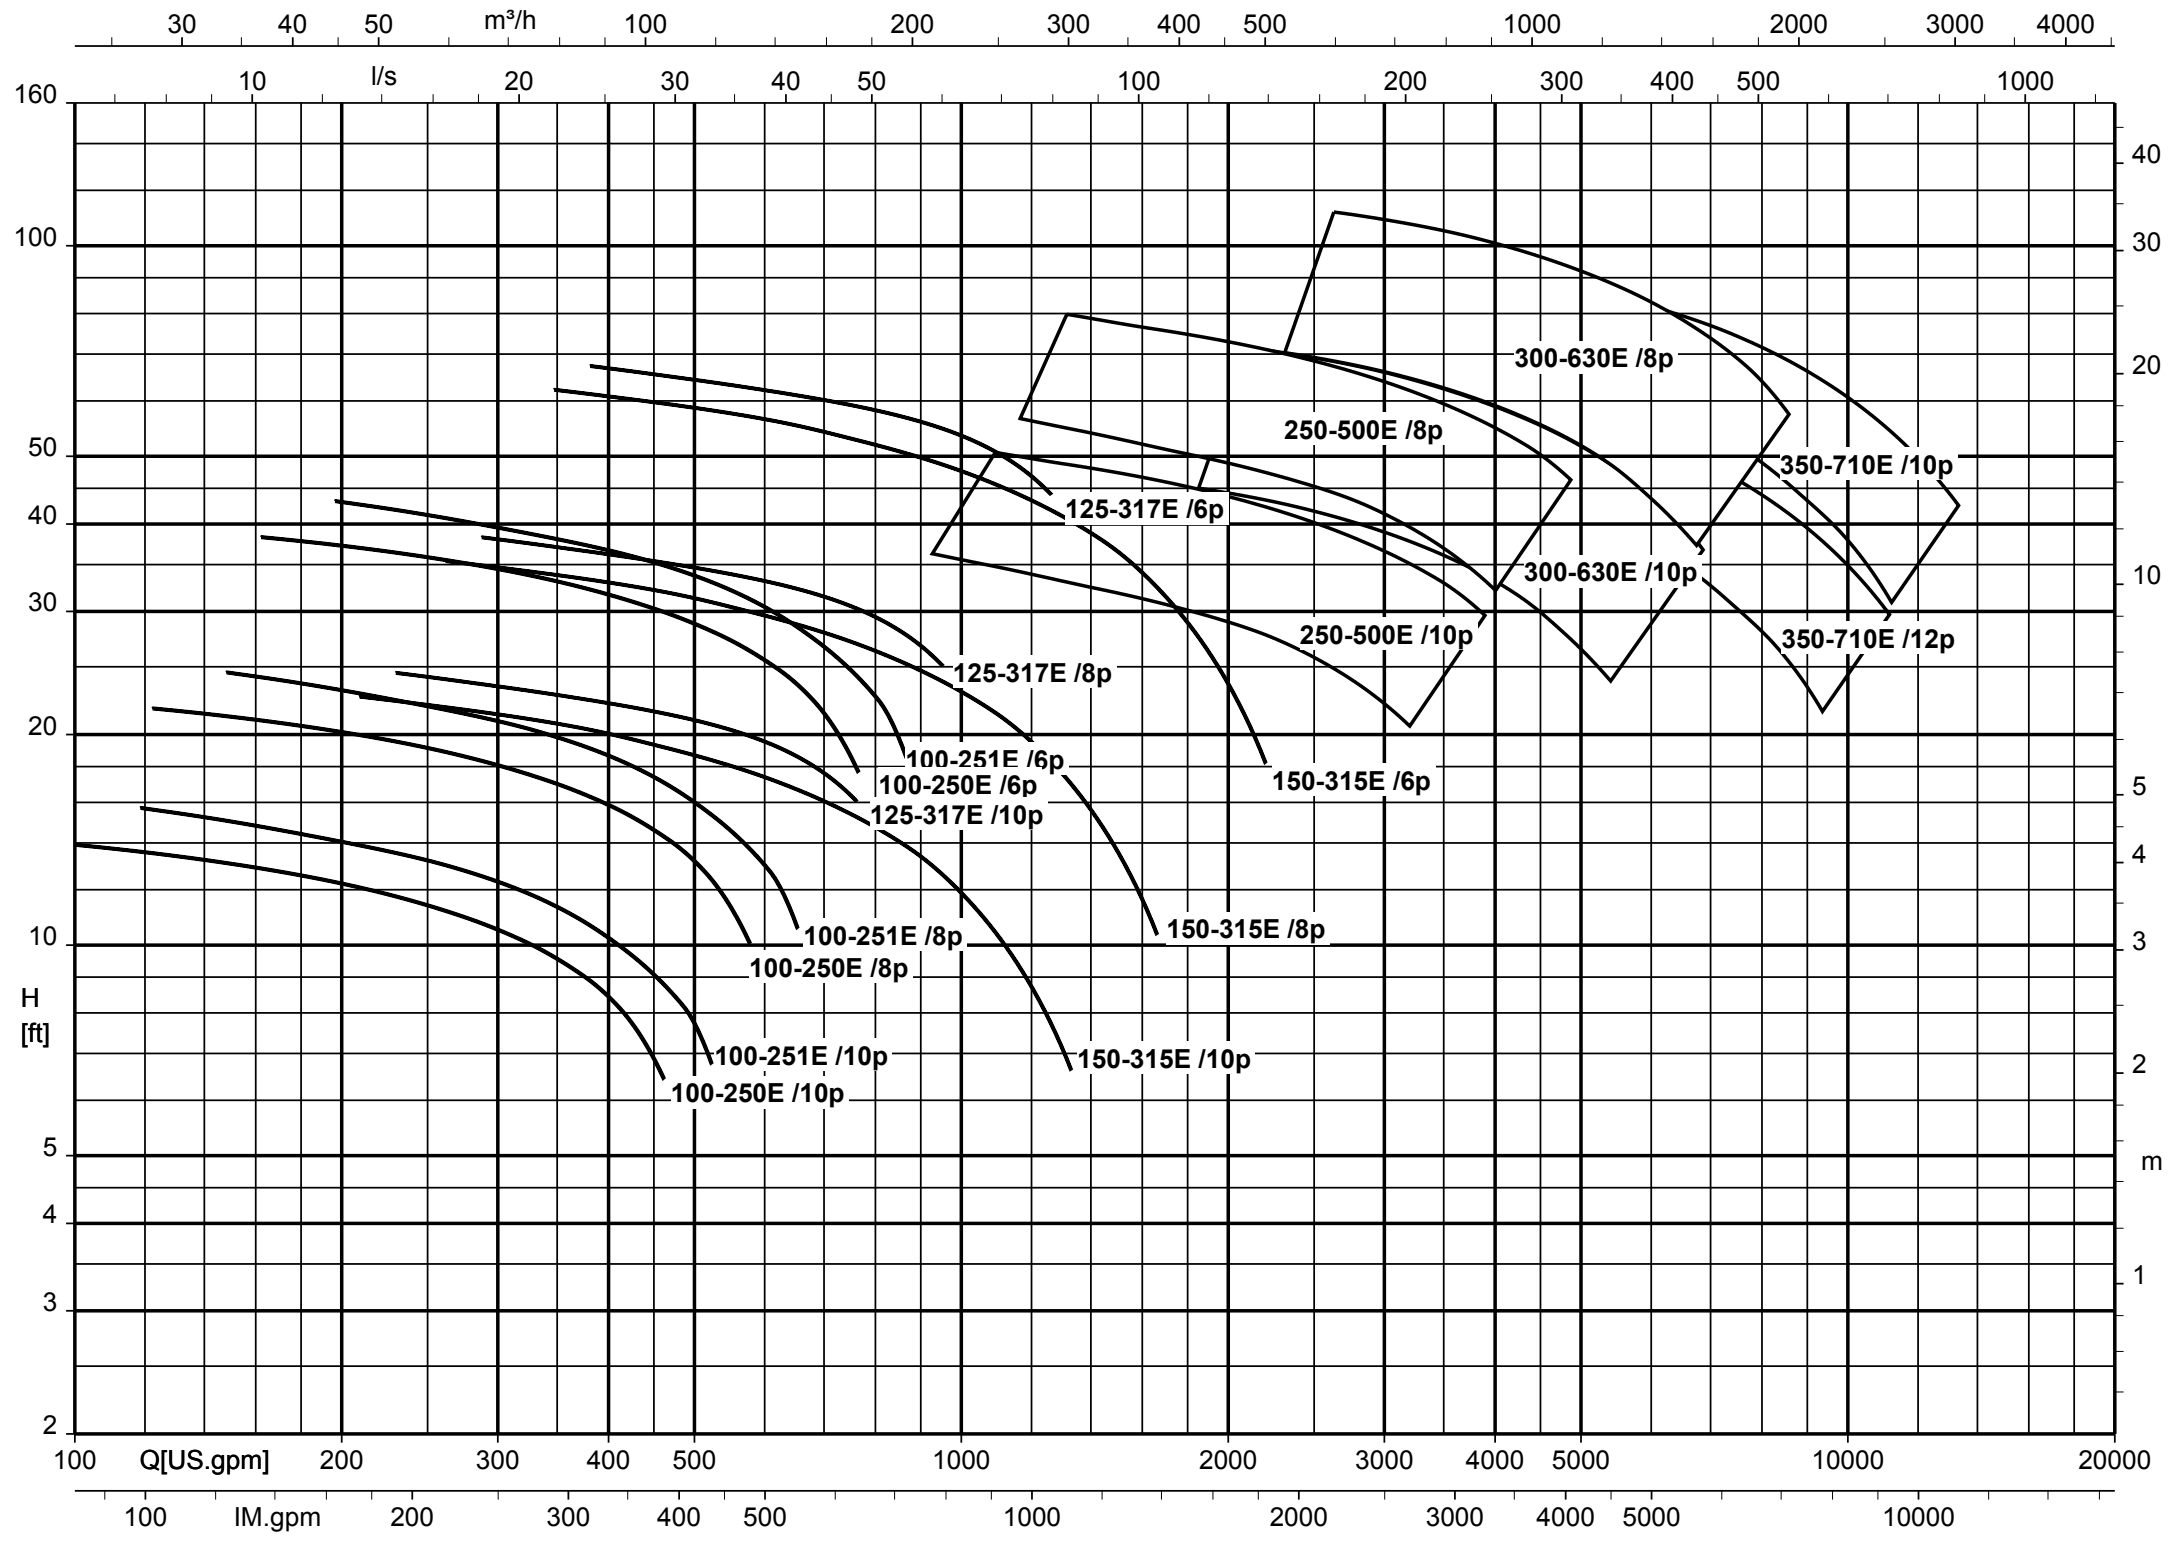

Installation types

Horizontal installation

Sewatec – Fig. 0



Bare shaft pump

Sewabloc



Pump set with directly flanged motor, C-face configuration, horizontal installation

Sewatec - 3E (3EN/3ENH)

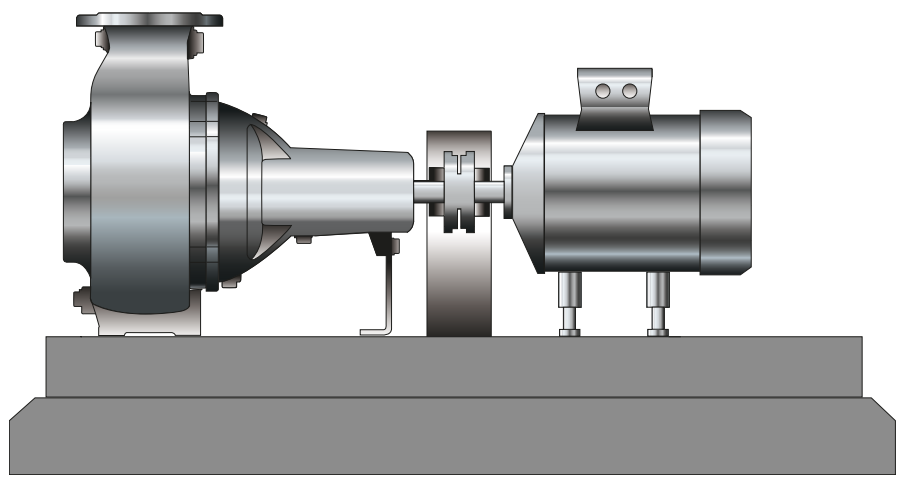

Pump set with directly coupled motor, baseplate, coupling (also with coupling spacer), coupling guard and height adjustment of the motor

Vertical installation

Sewatec - vertical (VU)

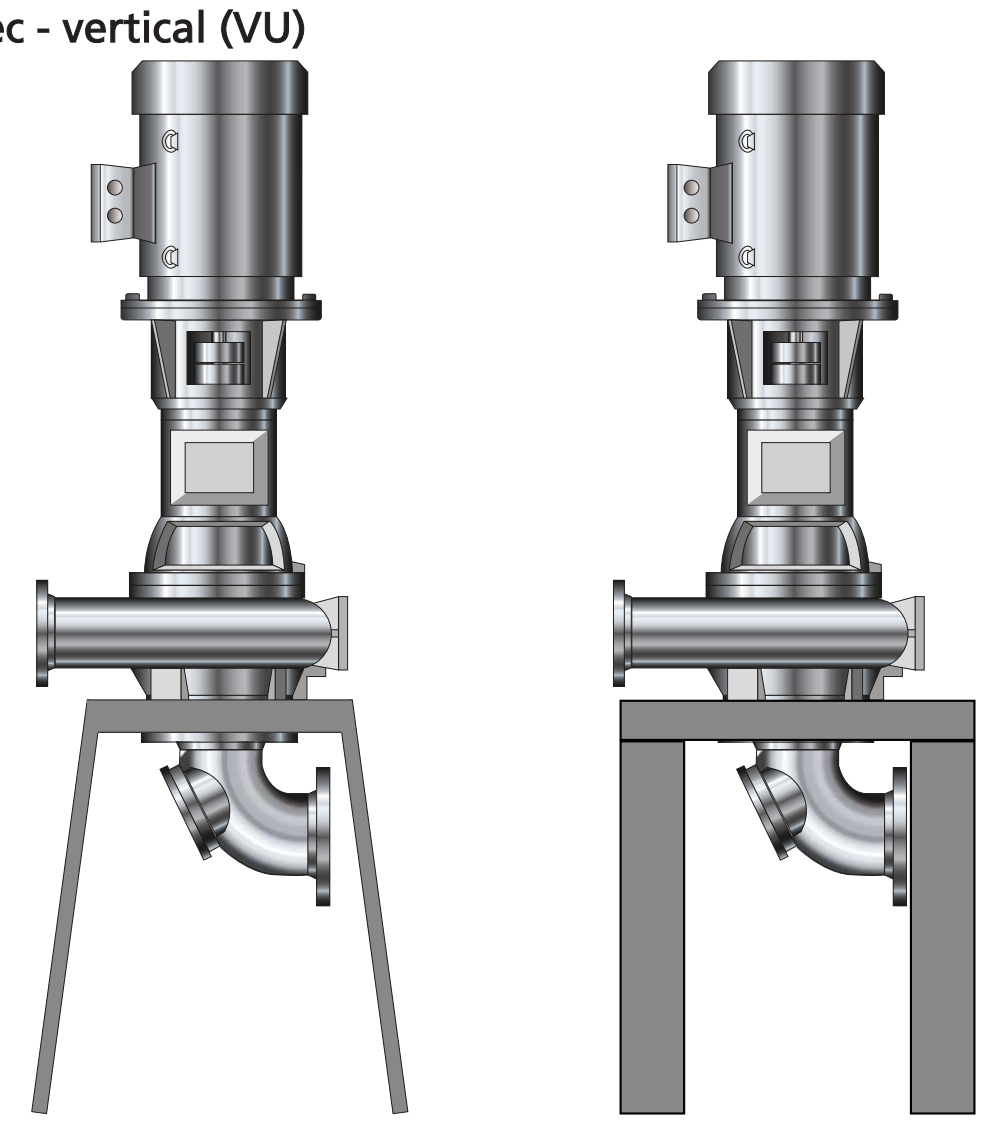

Pump set, C-face configuration, with motor pedestal, motor stool, coupling, coupling guard and suction elbow

Sewatec - vertical (VGW)

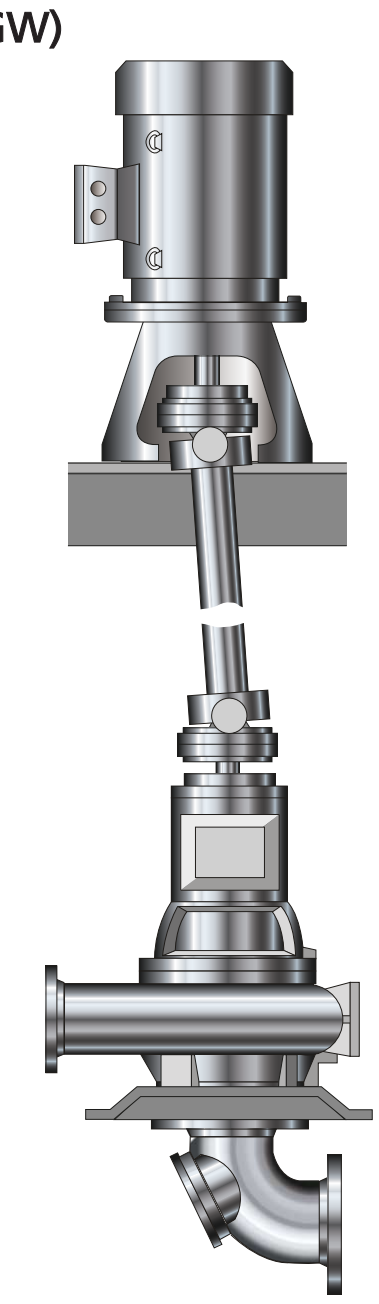

Pump set with sole plate for pump and motor, supporting frame, motor stool, suction elbow and universal-joint shaft

Sewatec - vertical (V)

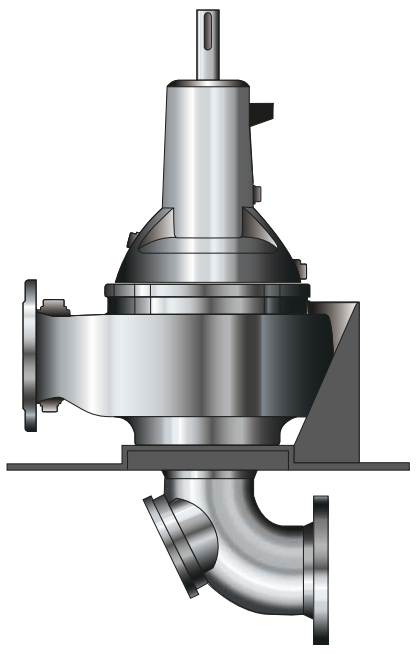

Bare shaft pump, sole plate and suction elbow

Sewabloc - vertical (VF)

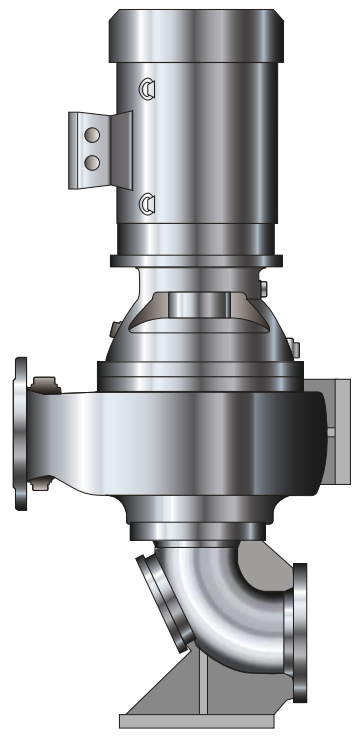

Pump set with directly flanged motor, C-face configuration, with base suction elbow

Installation types per bearing bracket and impeller type

Installation types per bearing bracket and impeller type

Size	Bearing bracket	Impeller type	Installation types							
			Sewabloc	Sewabloc-vertical	Sewatec			Sewatec-vertical		
										
			BLOC	BLOC-VF	Fig.0	3E-N	3E-NH	V	VU	VGW[35]
50-215	B01	F	✗	✗	-	-	-	-	-	-
50-216	B01	F	✗	✗	-	-	-	-	-	-
50-250	B01	F	✗	✗	-	-	-	-	-	-
50-250	B01	K	✗	✗	-	-	-	-	-	-
50-250	S01	F	-	-	✗	✗	✗	✗	-	✗
50-250	S01	K	-	-	✗	✗	✗	✗	-	✗
50-251	B02	F	-	-	-	-	-	-	-	-
50-251	B02	K	✗	✗	-	-	-	-	-	-
50-251	S02	F	-	-	-	-	-	-	-	-
50-251	S02	K	-	-	✗	✗	✗	✗	-	✗
65-215	B01	F	✗	✗	-	-	-	-	-	-
65-250	B01	F	✗	✗	-	-	-	-	-	-
65-250	B01	K	✗	✗	-	-	-	-	-	-
65-250	S01	F	-	-	✗	✗	✗	✗	-	-
65-250	S01	K	-	-	✗	✗	✗	✗	-	-
80-216	B01	F	✗	✗	-	-	-	-	-	-
80-250	B01	F	✗	✗	-	-	-	-	-	-
80-250	B01	K	✗	✗	-	-	-	-	-	-
80-250	S01	F	-	-	✗	✗	✗	✗	-	✗
80-250	S01	K	-	-	✗	✗	✗	✗	-	✗
80-315	B03	D	✗	✗	-	-	-	-	-	-
80-315	B03	F	✗	✗	-	-	-	-	-	-
80-315	B03	K	✗	✗	-	-	-	-	-	-
80-315	S03	D	-	-	✗	✗	✗	✗	-	✗
80-315	S03	F	-	-	✗	✗	✗	✗	-	✗
80-315	S03	K	-	-	✗	✗	✗	✗	-	✗
80-315	S05	D	-	-	✗	✗	✗	-	-	-
80-316	B03	D	-	-	-	-	-	-	-	-
80-316	S03	D	-	-	✗	✗	✗	✗	-	✗
100-215	B01	F	✗	✗	-	-	-	-	-	-
100-250	B01	E	-	-	-	-	-	-	-	-
100-250	B01	F	✗	✗	-	-	-	-	-	-
100-250	B01	K	-	-	-	-	-	-	-	-
100-250	S01	E	-	-	✗	✗	✗	✗	-	✗
100-250	S01	F	-	-	✗	✗	✗	✗	-	✗
100-250	S01	K	-	-	-	-	-	-	-	-
100-251	B02	D	✗	✗	-	-	-	-	-	-
100-251	B02	E	-	-	-	-	-	-	-	-
100-251	B02	F	✗	✗	-	-	-	-	-	-
100-251	B02	K	✗	✗	-	-	-	-	-	-
100-251	S02	D	-	-	✗	✗	✗	✗	-	✗
100-251	S02	E	-	-	✗	✗	✗	✗	-	✗
100-251	S02	F	-	-	✗	✗	✗	✗	-	✗
100-251	S02	K	-	-	✗	✗	✗	✗	-	✗
100-252	B01	F	✗	✗	-	-	-	-	-	-

35) Installation with universal-joint shaft subject to quotation approval

Size	Bearing bracket	Impeller type	Installation types							
			Sewabloc	Sewabloc-vertical	Sewatec			Sewatec-vertical		
										
			BLOC	BLOC-VF	Fig.0	3E-N	3E-NH	V	VU	VGW[35]
100-252	S01	F	-	-	✗	✗	✗	✗	-	✗
100-253	B02	F	✗	✗	-	-	-	-	-	-
100-253	S02	F	-	-	✗	✗	✗	✗	-	✗
100-315	B03	D	-	-	-	-	-	-	-	-
100-315	S03	D	-	-	-	-	-	✗	-	-
100-315	S05	D	-	-	✗	✗	✗	-	-	-
100-316	B03	D	-	-	-	-	-	-	-	-
100-316	S03	D	-	-	✗	✗	✗	✗	-	✗
100-400	S04	K	-	-	✗	✗	✗	✗	-	-
100-400	S05	K	-	-	✗	✗	✗	✗	✗	✗
100-401	S05	E	-	-	-	-	-	-	-	-
100-401	S04	F	-	-	✗	✗	✗	-	-	-
100-401	S04	K	-	-	✗	✗	✗	-	-	-
100-401	S05	E	-	-	-	-	-	-	-	-
100-401	S05	F	-	-	✗	✗	✗	✗	✗	✗
100-401	S05	K	-	-	✗	✗	✗	✗	✗	✗
125-315	B03	F	✗	✗	-	-	-	-	-	-
125-315	B03	K	✗	✗	-	-	-	-	-	-
125-315	S03	F	-	-	✗	✗	✗	✗	-	✗
125-315	S03	K	-	-	✗	✗	✗	✗	-	✗
125-317	B03	E	-	-	-	-	-	-	-	-
125-317	S03	E	-	-	✗	✗	✗	✗	-	-
150-251	B02	D	✗	✗	-	-	-	-	-	-
150-251	S02	D	-	-	✗	✗	✗	✗	-	✗
150-315	B03	D	✗	✗	-	-	-	-	-	-
150-315	B03	E	-	-	-	-	-	-	-	-
150-315	B03	F	✗	✗	-	-	-	-	-	-
150-315	B03	K	✗	✗	-	-	-	-	-	-
150-315	S03	D	-	-	✗	✗	✗	✗	-	✗
150-315	S03	E	-	-	✗	✗	✗	✗	-	✗
150-315	S03	F	-	-	✗	✗	✗	✗	-	✗
150-315	S03	K	-	-	✗	✗	✗	✗	-	✗
150-400	S05	D	-	-	✗	✗	✗	-	✗	✗
150-400	S04	K	-	-	✗	✗	✗	-	-	-
150-400	S05	K	-	-	✗	✗	✗	-	✗	✗
150-401	S04	E	-	-	-	-	-	-	-	-
150-401	S04	F	-	-	✗	✗	✗	-	-	-
150-401	S04	K	-	-	✗	✗	✗	-	-	-
150-401	S05	D	-	-	✗	✗	✗	-	✗	✗
150-401	S05	E	-	-	-	-	-	-	-	-
150-401	S05	F	-	-	✗	✗	✗	-	✗	✗
150-401	S05	K	-	-	✗	✗	✗	-	✗	✗
150-401	S06	D	-	-	✗	✗	✗	-	-	✗
150-401	S06	E	-	-	-	-	-	-	-	-
150-500	S05	K	-	-	✗	✗	✗	-	✗	✗
150-500	S06	K	-	-	✗	✗	✗	-	✗	✗
200-315	B03	D	✗	✗	-	-	-	-	-	-

35) Installation with universal-joint shaft subject to quotation approval

Size	Bearing bracket	Impeller type	Installation types							
			Sewabloc	Sewabloc-vertical	Sewatec			Sewatec-vertical		
										
			BLOC	BLOC-VF	Fig.0	3E-N	3E-NH	V	VU	VGW[35]
200-315	B03	K	✗	✗	-	-	-	-	-	-
200-315	S03	D	-	-	✗	✗	✗	✗	-	✗
200-315	S03	K	-	-	✗	✗	✗	✗	-	✗
200-316	B03	K	✗	✗	-	-	-	-	-	-
200-316	S03	K	-	-	✗	✗	✗	✗	-	✗
200-330	S04	K	-	-	✗	✗	✗	-	-	-
200-330	S05	K	-	-	✗	✗	✗	✗	✗	✗
200-400	S04	E	-	-	-	-	-	-	-	-
200-400	S04	K	-	-	✗	✗	✗	-	-	-
200-400	S05	D	-	-	✗	✗	✗	✗	✗	✗
200-400	S05	E	-	-	-	-	-	-	-	-
200-400	S05	K	-	-	✗	✗	✗	✗	✗	✗
200-400	S06	D	-	-	✗	✗	✗	✗	✗	✗
200-400	S06	E	-	-	-	-	-	-	-	-
200-402	S04	K	-	-	✗	✗	✗	-	-	-
200-402	S05	K	-	-	✗	✗	✗	✗	✗	✗
200-500	S05	E	-	-	-	-	-	-	-	-
200-500	S06	K	-	-	✗	✗	✗	-	-	-
200-500	S07	K	-	-	✗	✗	✗	✗	✗	✗
200-501	S06	K	-	-	-	-	-	-	-	-
200-631	S08	K	-	-	-	-	-	-	-	-
250-400	S04	K	-	-	✗	✗	✗	-	-	-
250-400	S05	D	-	-	✗	✗	✗	✗	✗	✗
250-400	S05	K	-	-	✗	✗	✗	✗	✗	✗
250-400	S06	D	-	-	✗	✗	✗	✗	✗	✗
250-401	S04	K	-	-	✗	✗	✗	-	-	-
250-401	S05	K	-	-	✗	✗	✗	✗	✗	✗
250-500	S06	E	-	-	-	-	-	-	-	-
250-500	S07	E	-	-	-	-	-	-	-	-
250-630	S07	E	-	-	-	-	-	-	-	-
250-630	S07	K	-	-	✗	✗	✗	-	-	-
250-630	S08	E	-	-	-	-	-	-	-	-
250-630	S08	K	-	-	✗	-	-	✗	✗	✗
250-900	S09	K	-	-	-	-	-	✗	-	-
300-400	S04	K	-	-	✗	✗	✗	-	-	-
300-400	S05	D	-	-	✗	✗	✗	✗	✗	✗
300-400	S05	K	-	-	✗	✗	✗	✗	✗	✗
300-400	S06	D	-	-	✗	✗	✗	✗	✗	✗
300-401	S04	K	-	-	✗	✗	✗	-	-	-
300-401	S05	K	-	-	✗	✗	✗	✗	✗	✗
300-500	S06	K	-	-	✗	✗	✗	-	-	-
300-500	S07	K	-	-	✗	✗	✗	✗	✗	✗
300-630	S07	E	-	-	-	-	-	-	-	-
300-630	S08	E	-	-	-	-	-	-	-	-
350-500	S06	K	-	-	✗	✗	✗	-	-	-
350-500	S07	K	-	-	✗	✗	✗	✗	✗	✗
350-501	S06	K	-	-	✗	✗	✗	-	-	-

35) Installation with universal-joint shaft subject to quotation approval

Size			Installation types							
			Sewabloc	Sewabloc-vertical	Sewatec			Sewatec-vertical		
										
	Bearing bracket	Impeller type	BLOC	BLOC-VF	Fig.0	3E-N	3E-NH	V	VU	VGW[35]
350-501	S07	K	-	-	✗	✗	✗	✗	✗	✗
350-630	S07	K	-	-	✗	✗	✗	-	-	-
350-630	S08	K	-	-	✗	✗	✗	✗	✗	✗
350-710	S07	E	-	-	-	-	-	-	-	-
350-710	S08	E	-	-	-	-	-	-	-	-
350-710	S08	K	-	-	✗	-	-	✗	-	✗
400-500	S07	K	-	-	✗	-	-	✗	-	✗
400-630	S08	K	-	-	✗	-	-	✗	-	✗
400-710	S09	K	-	-	-	-	-	✗	-	-
400-820	S09	K	-	-	-	-	-	✗	-	-
500-630	S07	K	-	-	✗	✗	✗	-	-	-
500-630	S08	K	-	-	✗	✗	✗	-	-	-
500-632	S08	K	-	-	✗	✗	✗	✗	✗	✗
500-900	S09	K	-	-	-	-	-	✗	-	-
500-900	S10	K	-	-	-	-	-	✗	-	-
600-520	S07	K	-	-	✗	-	-	✗	-	✗
600-710	S08	K	-	-	✗	-	-	✗	-	✗
600-900	S10	K	-	-	-	-	-	✗	-	-
700-900	S08	K	-	-	✗	-	-	✗	-	✗

35) Installation with universal-joint shaft subject to quotation approval

Recommended spare parts stock for 2 years' operation to DIN 24296

Quantity of spare parts for recommended spare parts stock

Part No.	Description	Number of pumps (including stand-by pumps)								Spare part	Replacement part	Wear part
		1	2	3	4	5	6	8	10 and more			
163	Discharge cover	1	2	2	2	3	3	4	50 %	✗	-	-
210	Shaft	1	1	1	2	2	2	3	30 %	✗	-	-
230	Impeller	1	1	1	2	2	2	3	30 %	-	✗	-
321.01/02	Rolling element bearing (set)	1	1	1	2	2	3	4	50 %	-	-	✗
330	Bearing bracket, complete	-	-	-	-	-	-	1	2 pcs.	✗	-	-
433.01/02	Mechanical seal, complete (set)	1	2	3	4	4	4	6	90 %	-	-	✗
	Assembly for gland packing consisting of: ▪ Neck bush ▪ Shaft protecting sleeve ▪ Lantern ring	1	1	1	2	2	2	3	40 %	-	✗	-
	Packing cord (4 rings)	4	4	6	8	8	9	12	100 %	-	-	✗
502.01	Casing wear ring	1	2	2	2	3	3	4	50 %	-	-	✗
503	Impeller wear ring	1	2	2	2	3	3	4	50 %	-	-	✗
135	Wear plate	1	2	2	2	3	3	4	50 %	-	-	✗
	Sealing elements (set)	2	4	6	8	8	9	12	150 %	-	-	✗

It is recommended to keep a stock of wear and replacement parts also during the warranty period.

Scope of supply

Sewabloc

Depending on the model, the following items are included in the scope of supply:

- Pump without motor or with directly flanged standardized motor
- Foundation rails[36]
- Suction-side intermediate flanged piece or suction elbow with inspection hole
- Baseplate or soleplate
- Base suction elbow[37]

Sewatec

Depending on the model, the following items are included in the scope of supply:

- Pump
- Drive
- Baseplate or soleplate
- Coupling and coupling guard
- Suction-side intermediate flanged piece or suction elbow with inspection hole
- Universal-joint shaft

36) For horizontal installation
37) For vertical installation

General assembly drawings with list of components

General assembly drawing: Sewatec with bearing brackets S01, S02, S03, S04

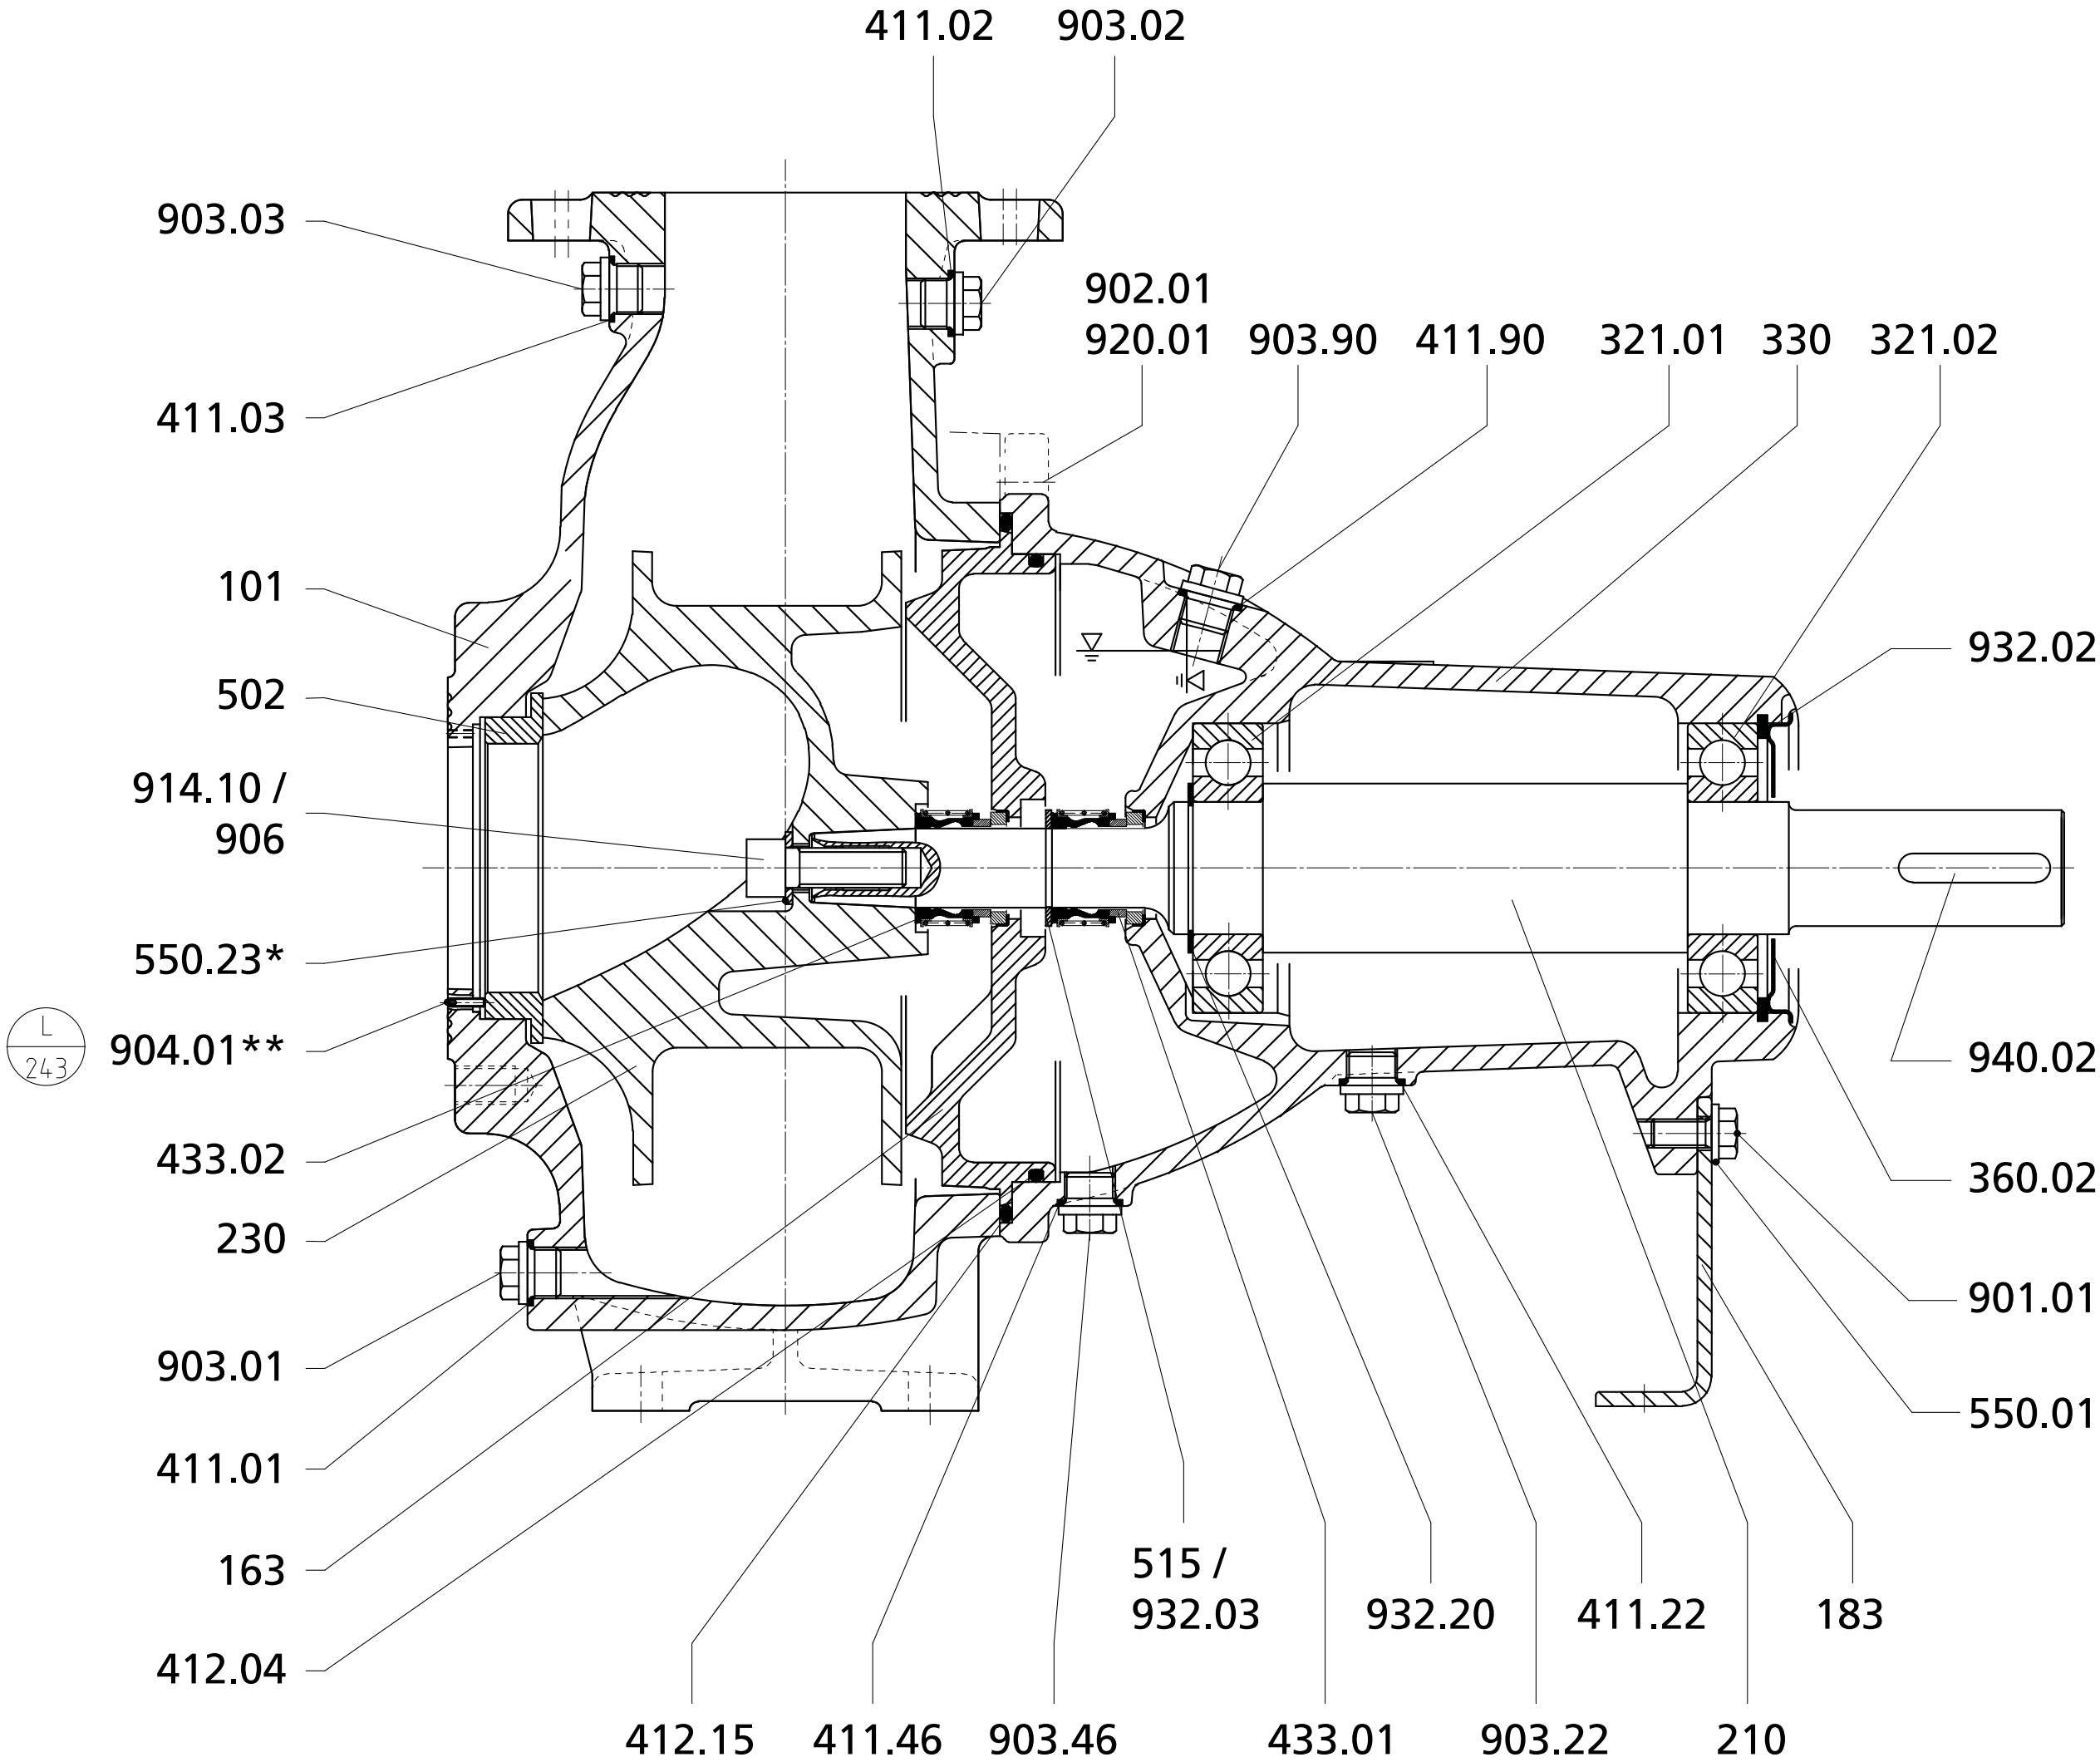

Sewatec with E impeller

Impeller types



F impeller



K impeller

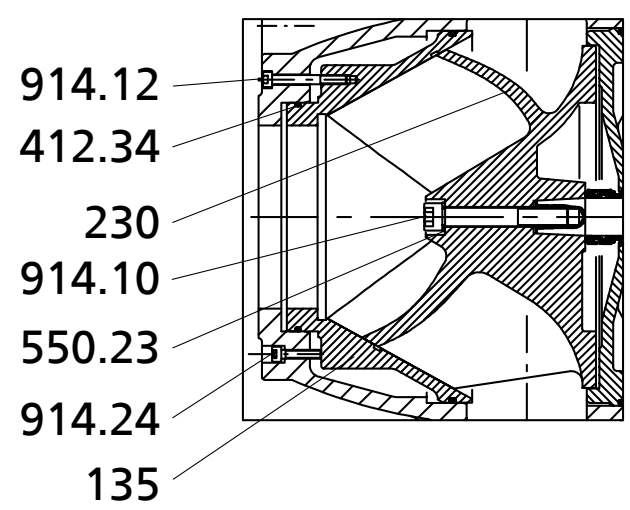

D impeller



Inspection hole

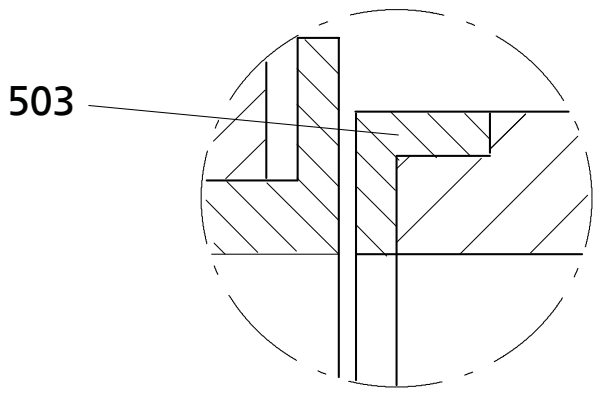

Option: impeller wear ring (K impeller)

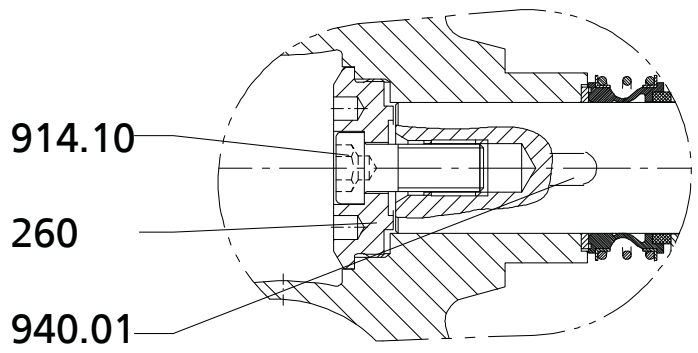

Impeller fastening for bearing bracket S04

List of components

Part No.	Description	Part No.	Description
101	Pump casing	502	Casing wear ring
135	Wear plate	503	Impeller wear ring[38)]
163	Discharge cover	504	Spacer ring
164	Inspection cover	515	Taper lock ring
183	Support foot	550	Disc
210	Shaft	900	Bolt/screw
230	Impeller	901	Hexagon head bolt
260	Impeller hub cap	902	Stud
321	Deep groove ball bearing	903	Screw plug
330	Bearing bracket	906	Impeller screw
360	Bearing cover	914	Hexagon socket head cap screw
411	Joint ring	920	Nut
412	O-ring	932	Circlip
433	Mechanical seal	940	Key

38) For K impeller only

General assembly drawing: Sewatec with bearing brackets S05, S06, S07, S08

Sewatec with bearing brackets S05 to S08

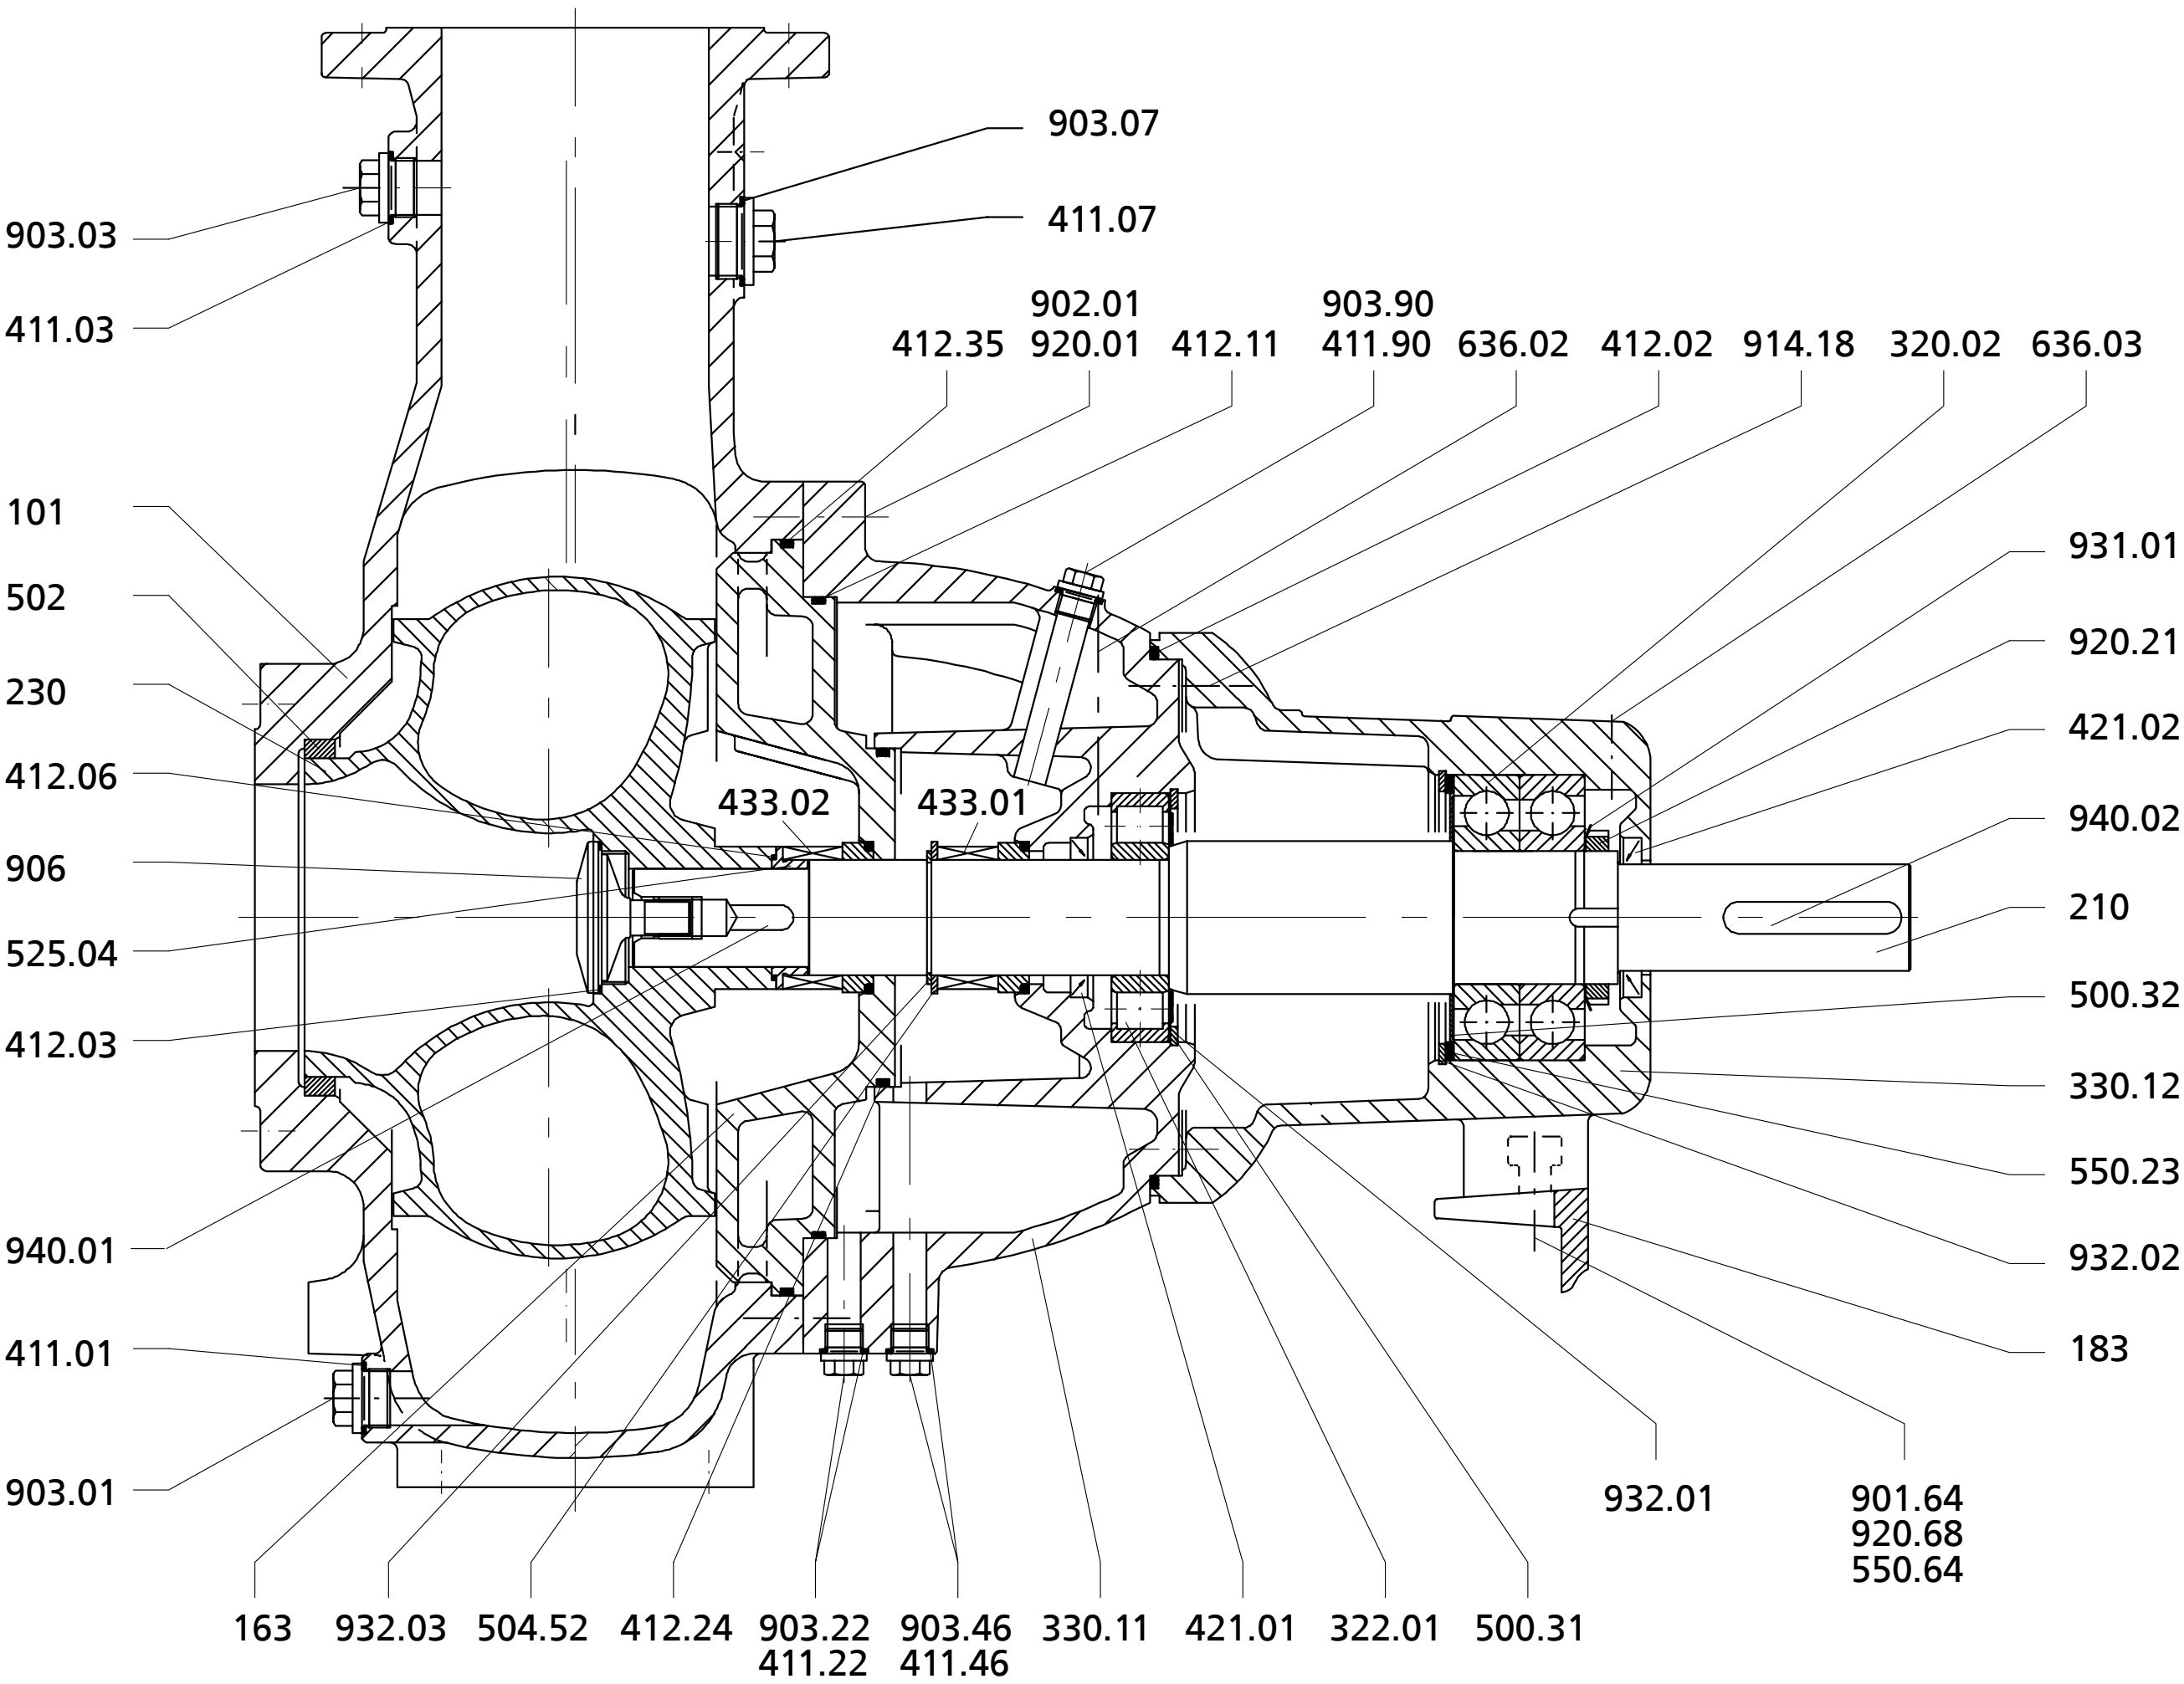

Sewatec with bearing brackets S05 to S08

Impeller types

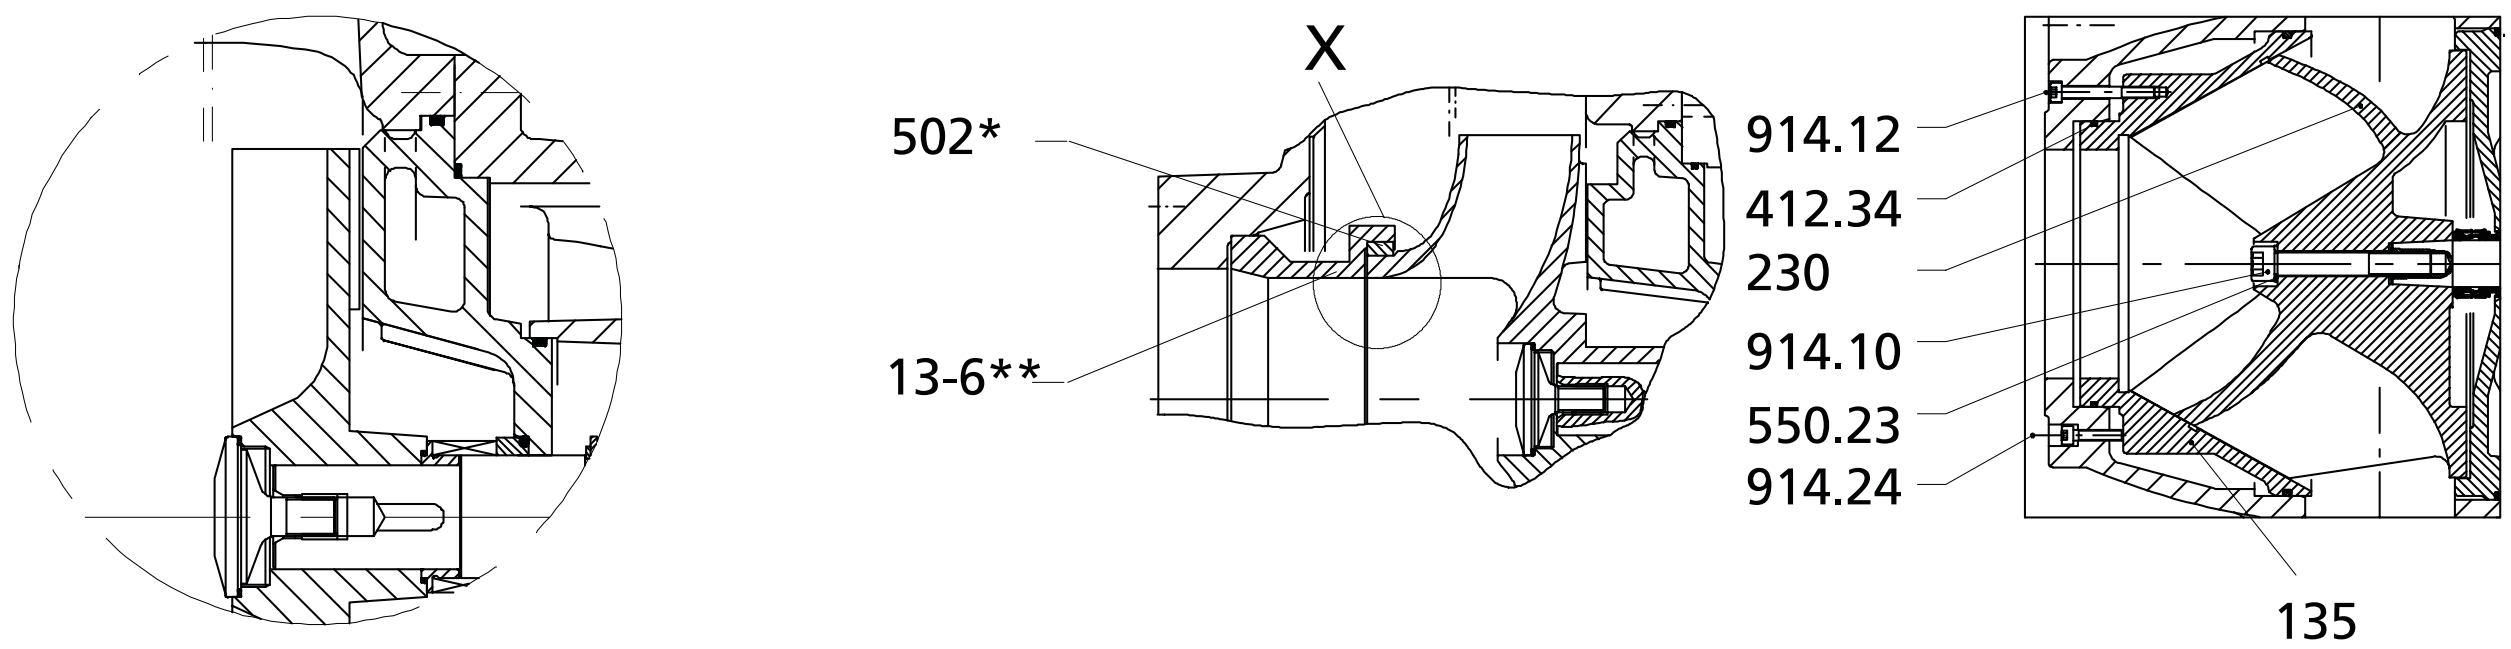

F impeller

K impeller
(* Not for 100-401.
** For 100-401, 200-400 only)

D impeller



Inspection hole



Option: impeller wear ring (K impeller)



Impeller fastening for bearing brackets S06 and larger,
except pump size 500-632

List of components

Part No.	Description	Part No.	Description
13-6	Casing insert	500.31/.32	Ring
101	Pump casing	502	Casing wear ring
135	Wear plate	503	Impeller wear ring[39)]
163	Discharge cover	504.52	Spacer ring
164.02	Inspection cover	525.04	Spacer sleeve
183	Support foot	550.04/.23/.64/.87	Disc
210	Shaft	636.02/.03	Lubricating nipple
230	Impeller	900.02	Bolt/screw
260.01	Impeller hub cap	901.64/.87	Hexagon head bolt
320.02	Rolling element bearing	902.01	Stud
322.01	Radial roller bearing	903.01/.03/.07/.22/.46/.90	Screw plug
330.11/.12	Bearing bracket	906	Impeller screw
411.01/.03/.07/.22/.46/.90	Joint ring	914.10/.12/.18/.24	Hexagon socket head cap screw
412.02/.03/.04/.06/.11/.24/.34/.35	O-ring	920.01/.17/.21/.68	Nut
421.01/.02	Lip seal	931.01/.02	Lock washer
432	Auxiliary seal	932.01/.02/.03	Circlip
433	Mechanical seal	940.01/.02	Key

39) For K impeller only

Sewatec for underfloor installation

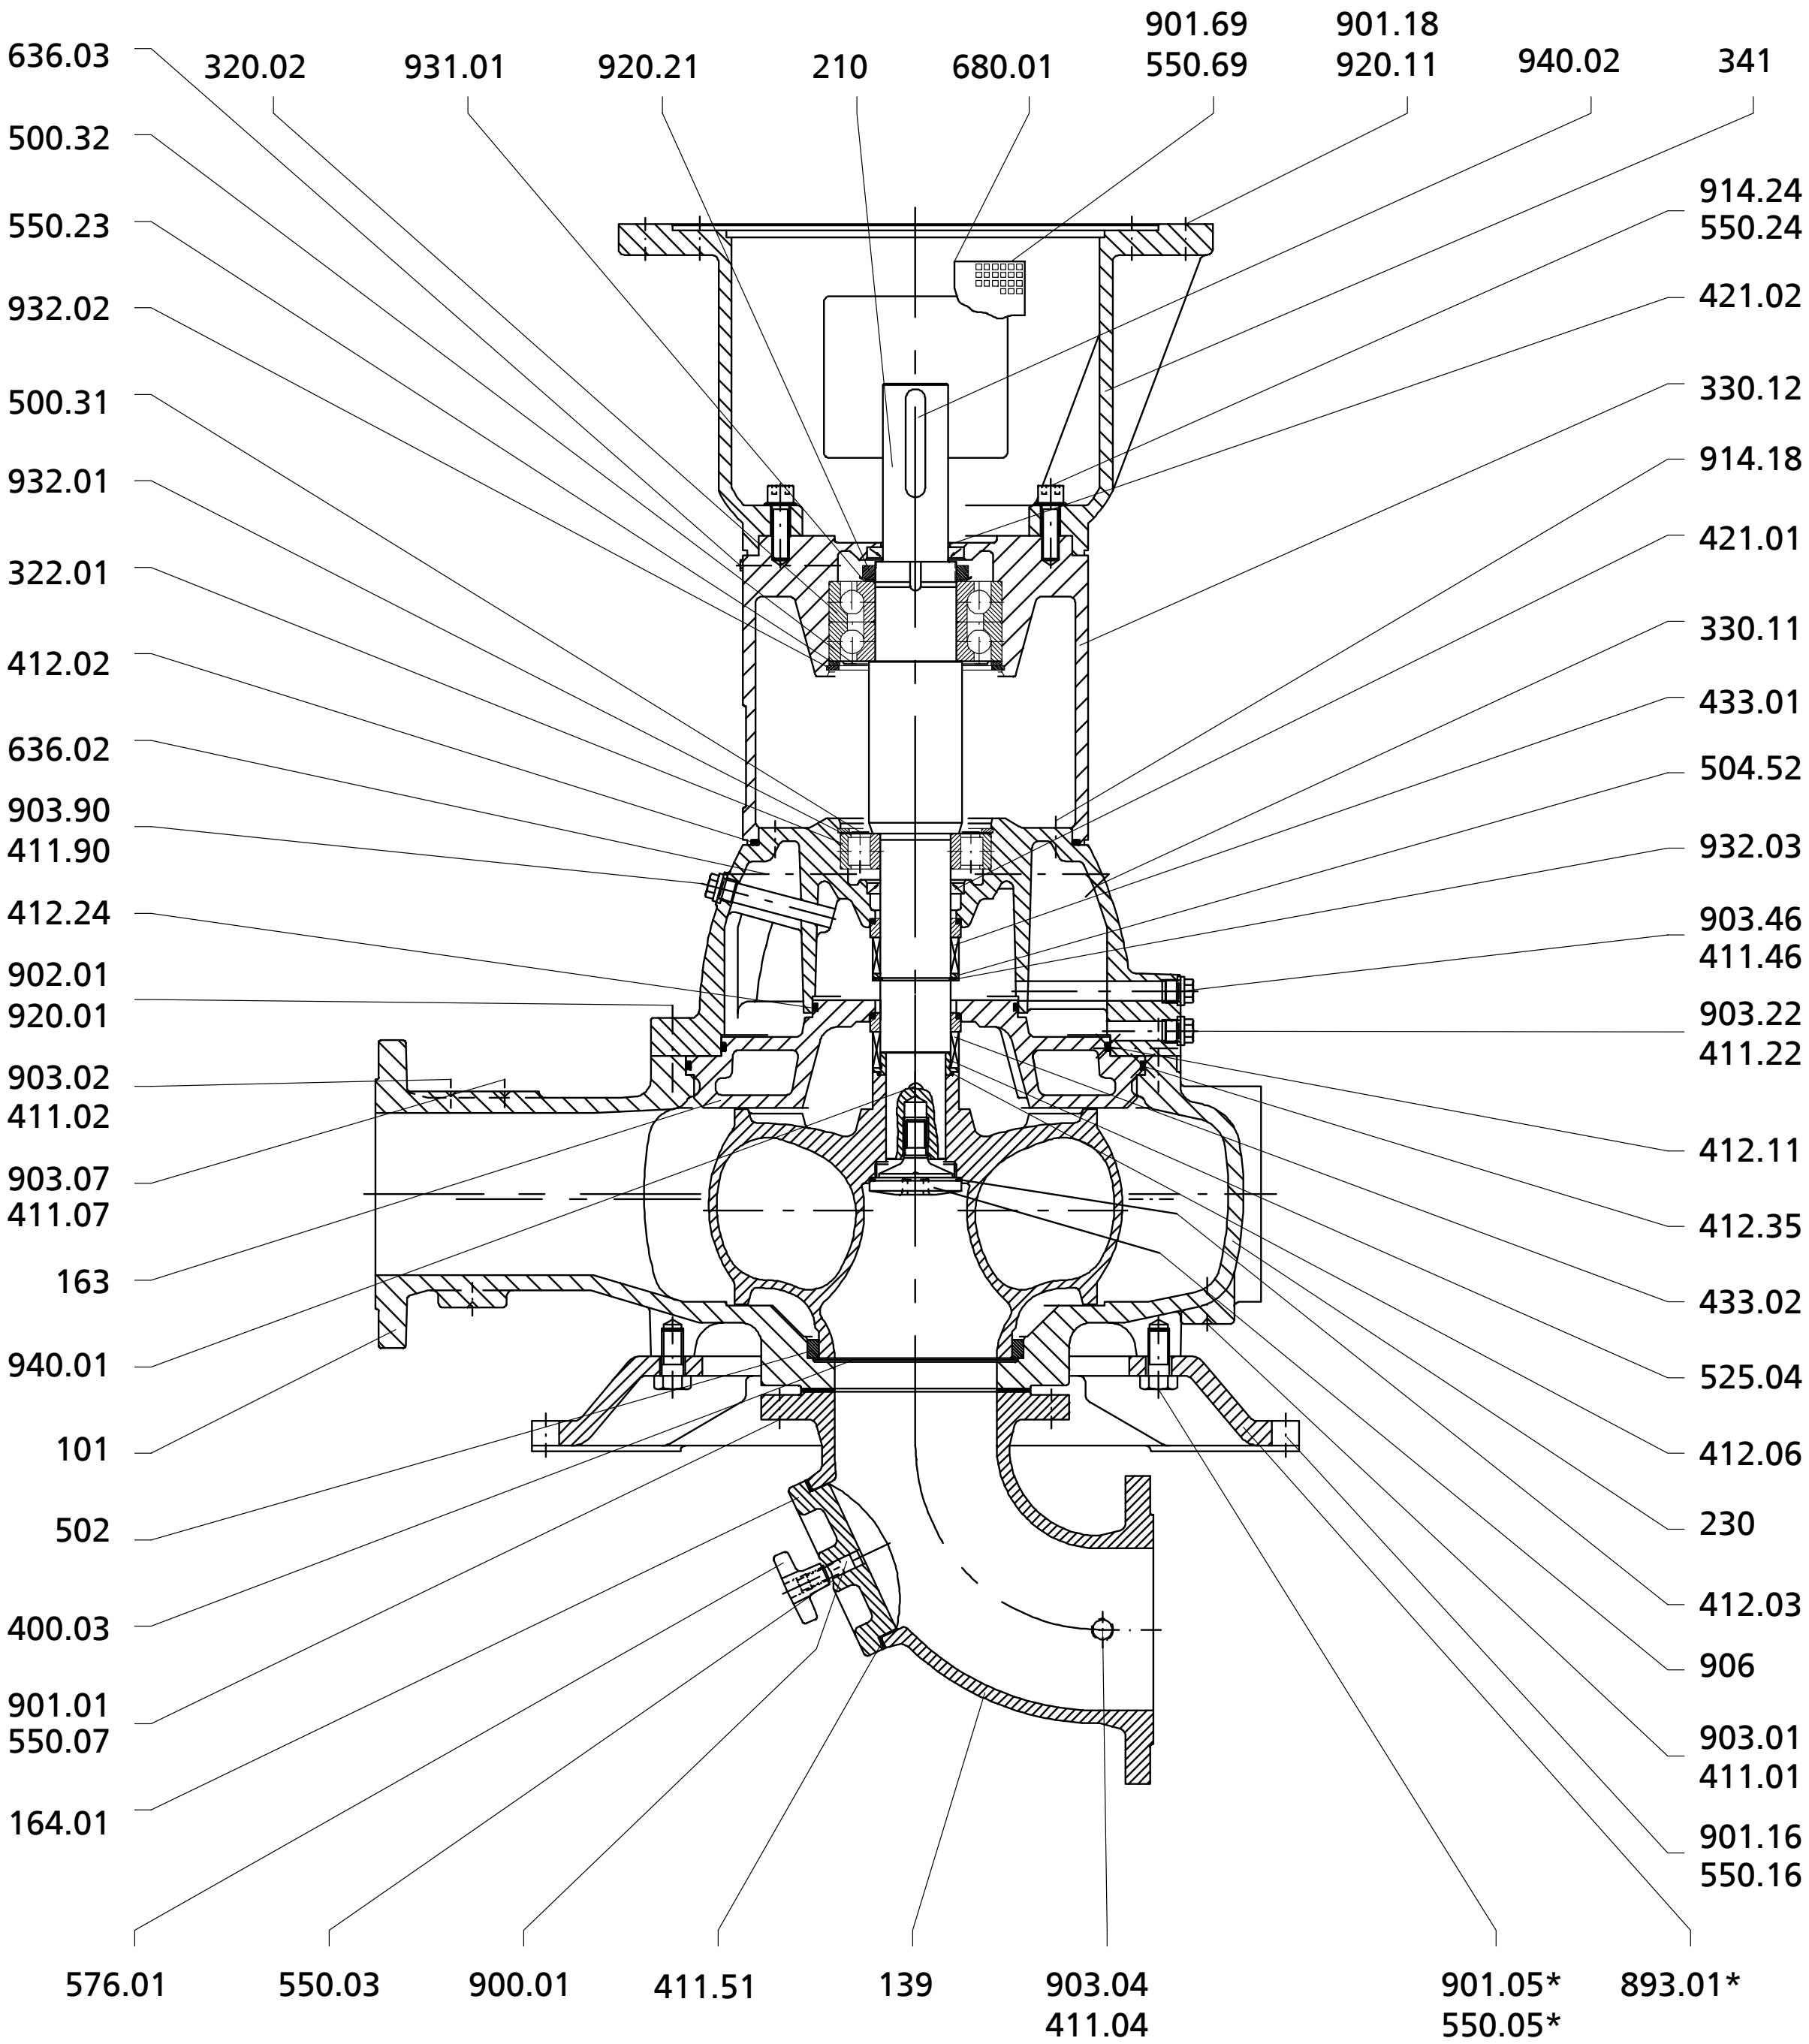

Sewatec with E impeller – pump for underfloor installation, shaft sealed by mechanical seal

Impeller types

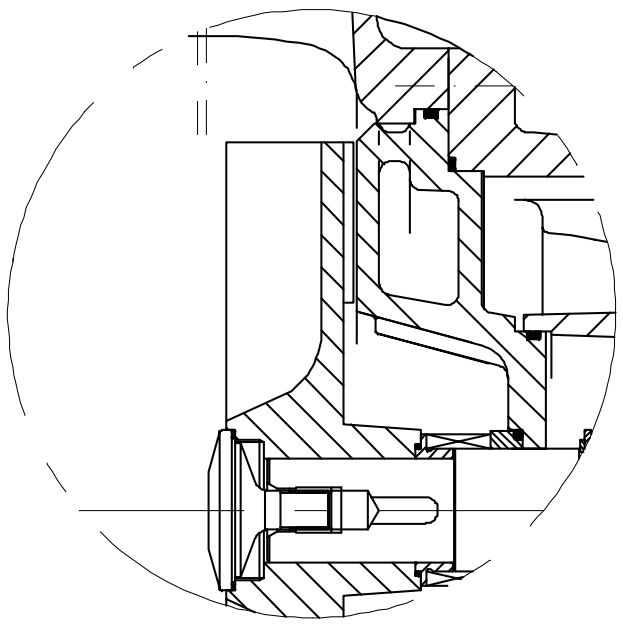

F impeller

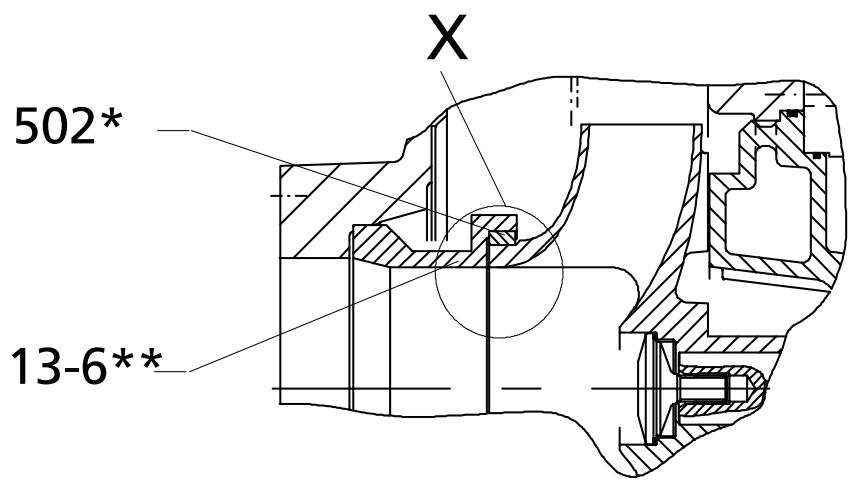

K impeller
(* Not for 100-401.
** For 100-401, 200-400 only)

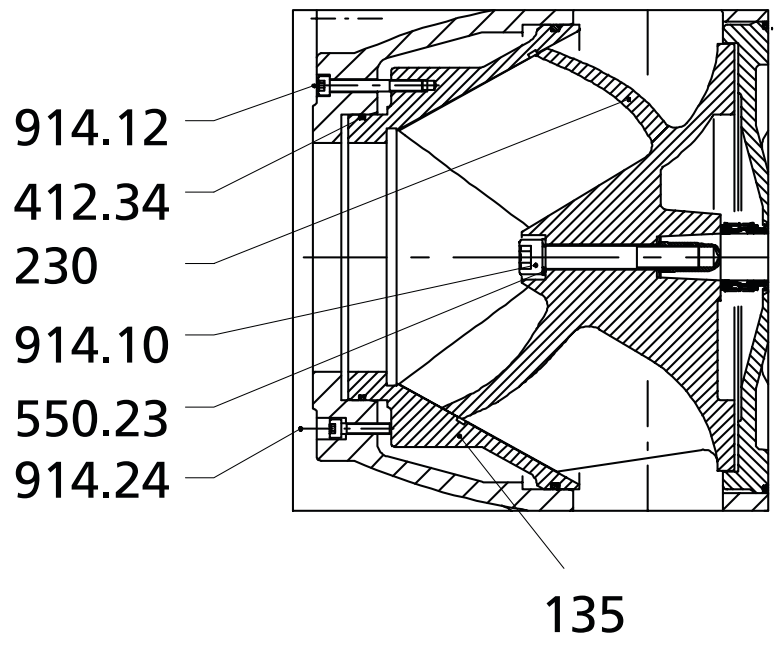

D impeller



Inspection hole



Option: impeller wear ring (K impeller)



Impeller fastening for bearing brackets S06 and larger,
except pump size 500-632

List of components

Part No.	Description	Part No.	Description
13-6	Casing insert	502	Casing wear ring
101	Pump casing	503	Impeller wear ring[40)]
135	Wear plate	504.52	Spacer ring
139	Suction elbow	525.04	Spacer sleeve
163	Discharge cover	550.03/.04/.05/.07/.16/.23/.24/.69/.87	Disc
164.01/.02	Inspection cover	576.01	Handle
210	Shaft	636.02/.03	Lubricating nipple
230	Impeller	680.01	Guard
260.01	Impeller hub cap	893.01	Soleplate
320.02	Rolling element bearing	900.01/.02	Bolt/screw
322.01	Radial roller bearing	901.01/.05/.16/.18/.69/.87	Hexagon head bolt
330.11/.12	Bearing bracket	902.01	Stud
341	Drive lantern	903.01/.02/.04/.07/.22/.46/.90	Screw plug
400.03	Gasket	906	Impeller screw
411.01/.02/.04/.07/.22/.46/.51/.90	Joint ring	914.10/.12/.18/.24	Hexagon socket head cap screw
412.02/.03/.04/.06/.11/.24/.34/.35	O-ring	920.01/.11/.17/.21	Nut
421.01/.02	Lip seal	931.01/.02	Lock washer
433.01/.02	Mechanical seal	932.01/.02/.03	Circlip
500.31/.32	Ring	940.01/.02	Key

40) For K impeller only

Sewatec for installation with universal-joint shaft

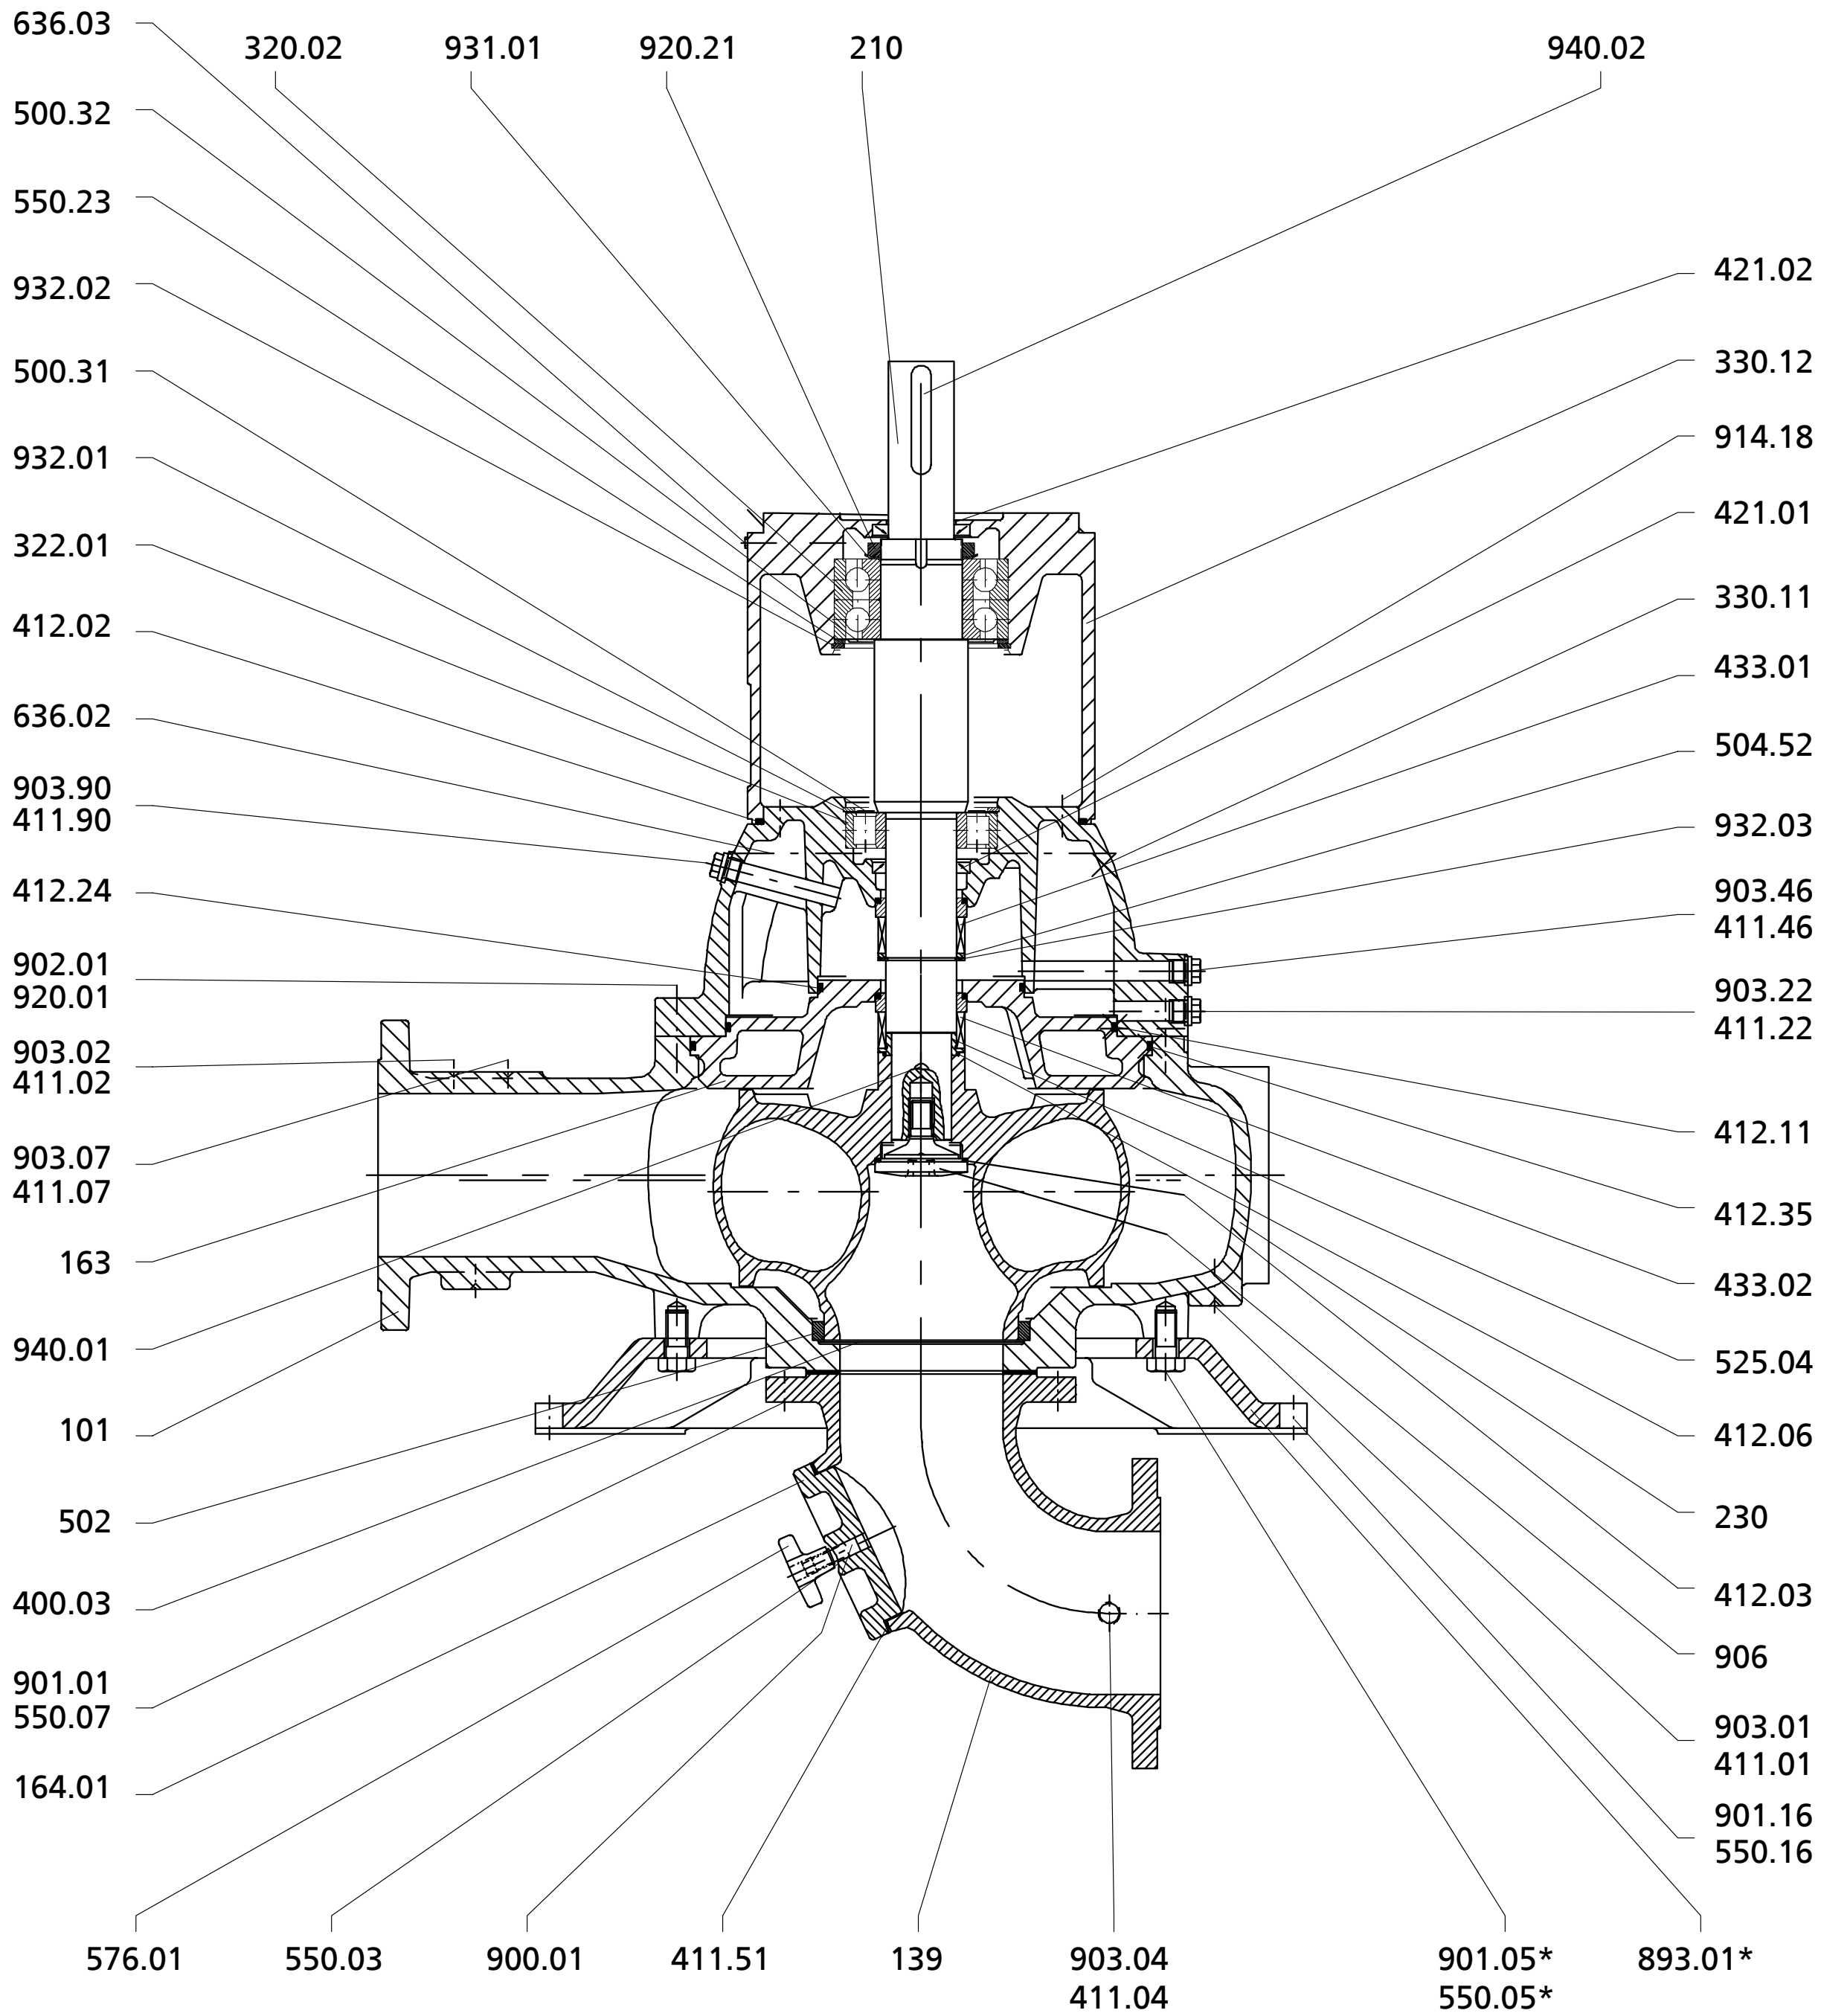

Sewatec with E impeller – pump with universal-joint shaft, shaft sealed by mechanical seal

Impeller types

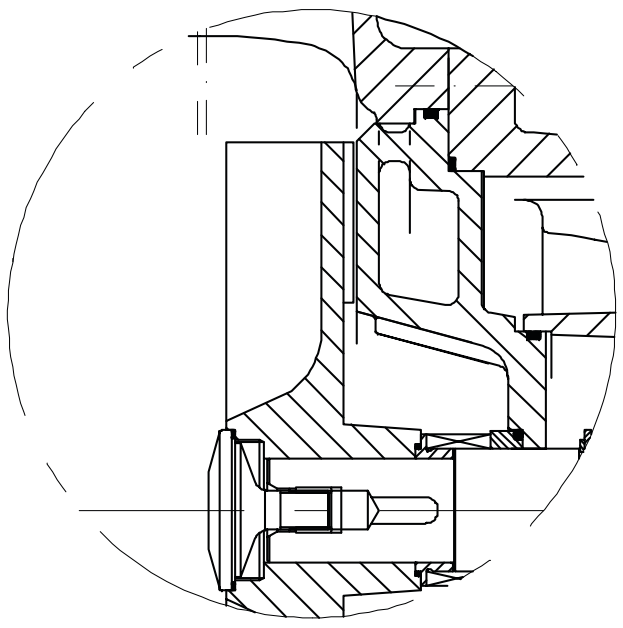

F impeller

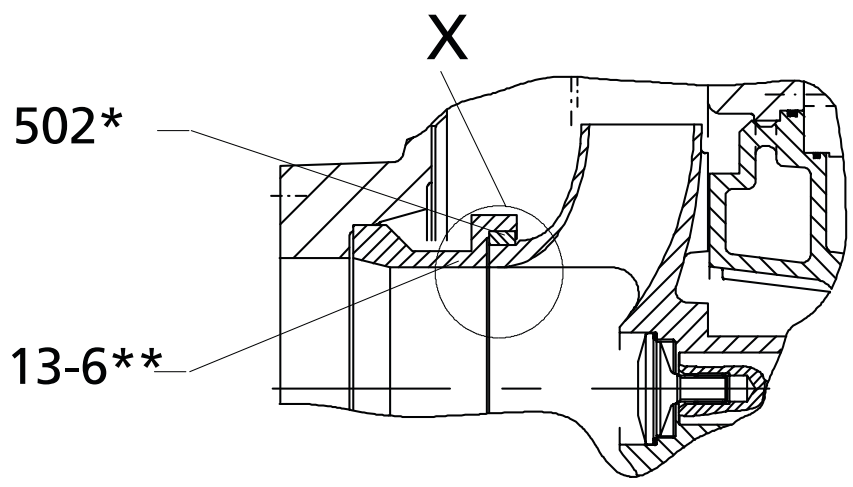

K impeller
(* Not for 100-401.
** For 100-401, 200-400 only)

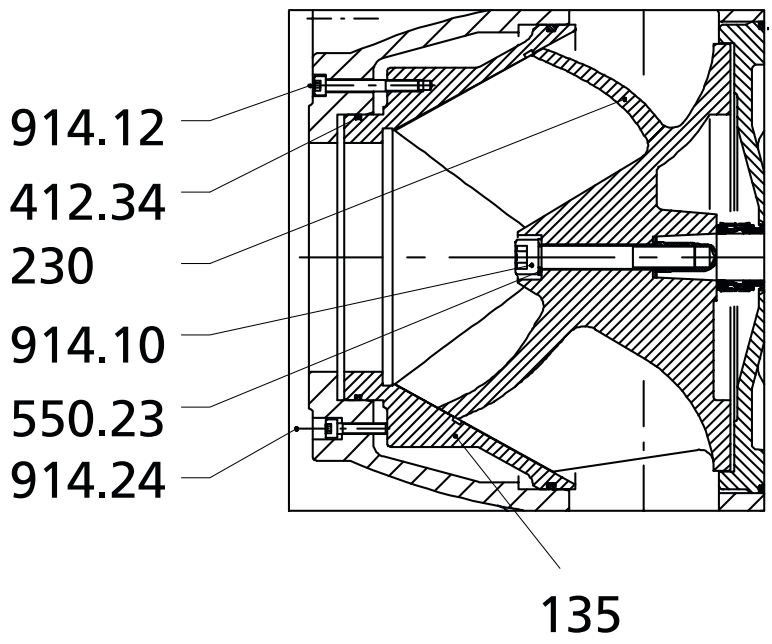

D impeller



Inspection hole



Option: impeller wear ring (K impeller)



Impeller fastening for bearing brackets S06 and larger,
except pump size 500-632

List of components

Part No.	Description	Part No.	Description
13-6	Casing insert	503	Impeller wear ring[41)]
101	Pump casing	504.52	Spacer ring
139	Suction elbow	525.04	Spacer sleeve
163	Discharge cover	550.03/.04/.05/.07/.16/.23/.87	Disc
164.01/.02	Inspection cover	576.01	Handle
210	Shaft	636.02/.03	Lubricating nipple
230	Impeller	680	Guard
260.01	Impeller hub cap	893.01	Soleplate
320.02	Rolling element bearing	900.01.02	Bolt/screw
322.01	Radial roller bearing	901.01/.05/.16/.87	Hexagon head bolt
330.11/.12	Bearing bracket	902.01	Stud
341	Drive lantern	903.01/.02/.04/.07/.22/.46/.90	Screw plug
400.03	Gasket	906	Impeller screw
411.01/.02/.04/.07/.22/.46/.51/.90	Joint ring	914.10/.12/.18/.24	Hexagon socket head cap screw
412.02/.03/.04/.06/.11/.24/.34/.35	O-ring	920.01/.17/.21	Nut
421.01/.02	Lip seal	931.01/.02	Lock washer
433.01/.02	Mechanical seal	932.01/.02/.03	Circlip
500.31/.32	Ring	940.01/.02	Key
502	Casing wear ring		

41) For K impeller only

General assembly drawing: Sewabloc

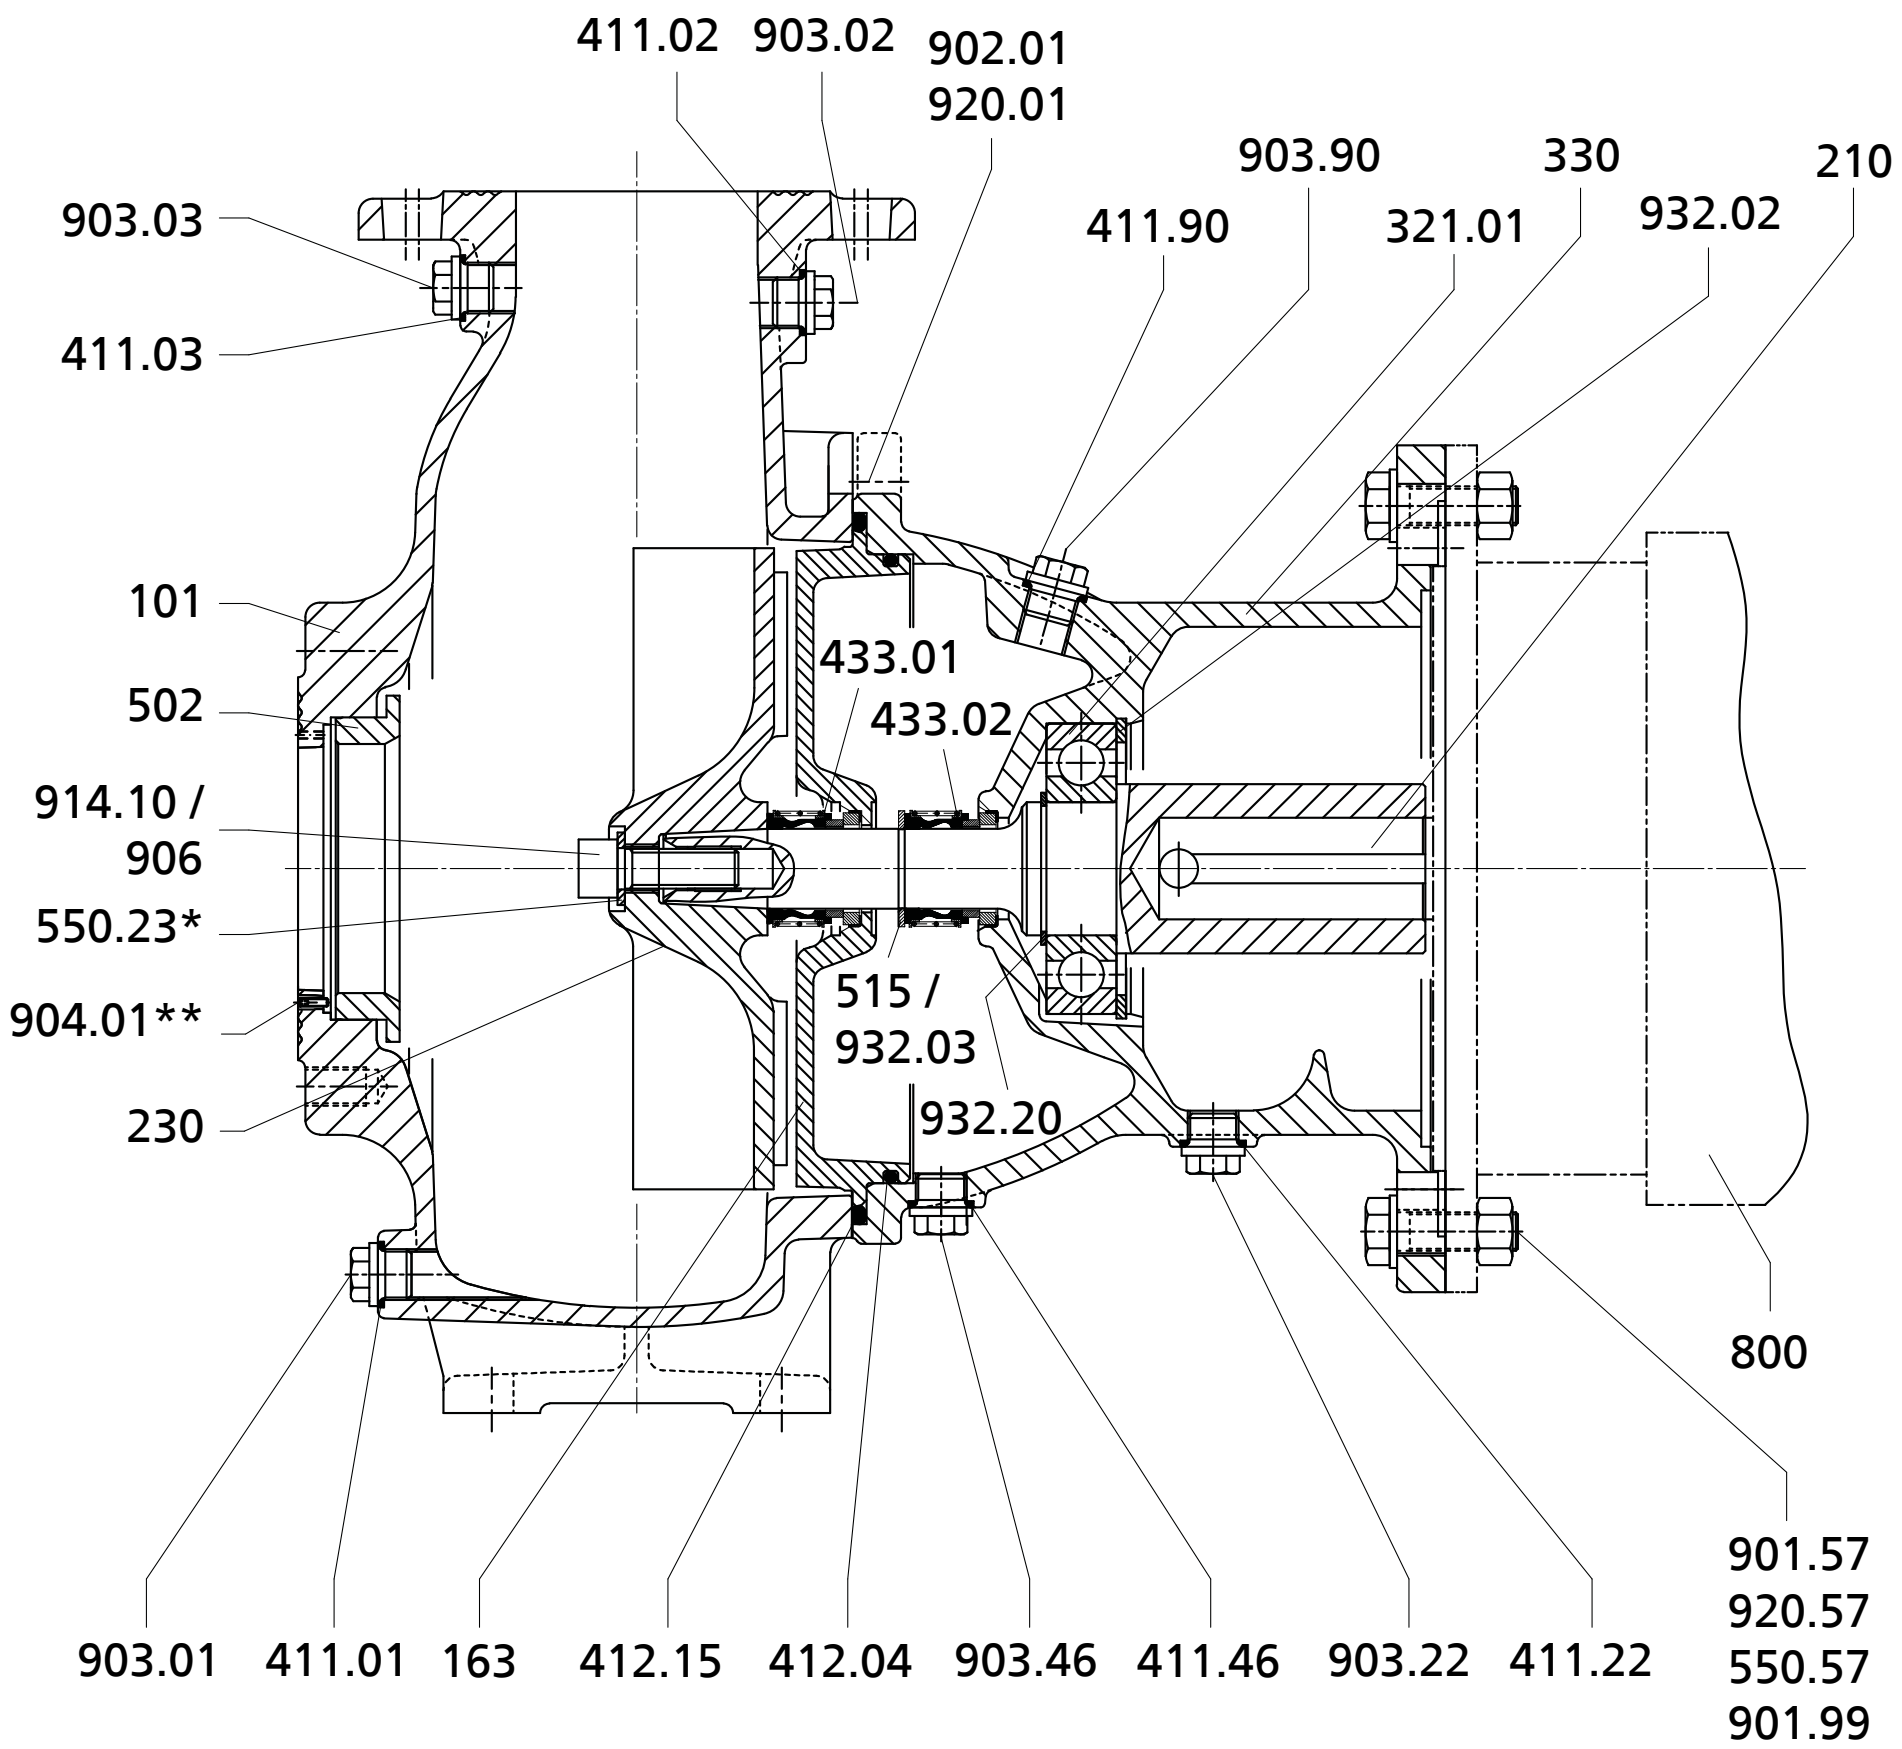

Sewabloc with F impeller

Impeller types



K impeller

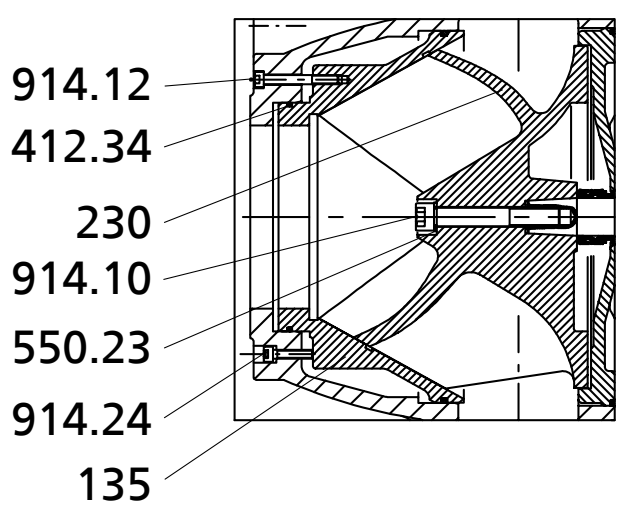

D impeller



Inspection hole

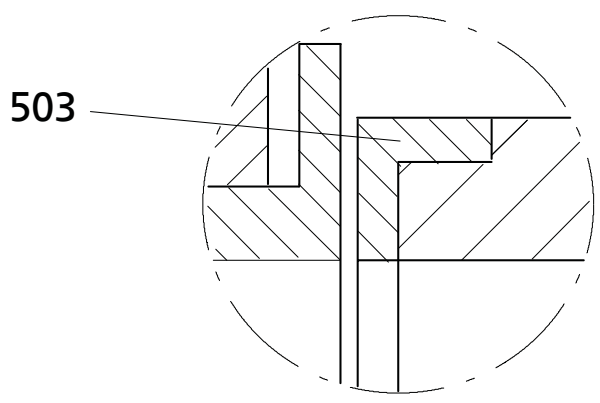

Option: impeller wear ring (K impeller)

List of components

Part No.	Description	Part No.	Description
101	Pump casing	503	Impeller wear ring[42)]
135	Wear plate	515	Taper lock ring
163	Discharge cover	550	Disc
164	Inspection cover	800	Motor

Part No.	Description	Part No.	Description
210	Shaft	900	Bolt/screw
230	Impeller	901	Hexagon head bolt
260	Impeller hub cap	902	Stud
321	Deep groove ball bearing	903	Screw plug
330	Bearing bracket	914	Hexagon socket head cap screw
411	Joint ring	920	Nut
412	O-Ring	932	Circlip
433	Mechanical seal	940	Key
502	Casing wear ring		

42) For K impeller only

KSB, Inc.
4415 Sarellen Road • Richmond, VA 23231
Phone: (804) 222-1818 • Fax: (804) 226-6961 • www.ksbusa.com
KSB PUMPS Inc.
5885 Kennedy Road • Mississauga • Ontario L 4Z 2G3
Phone: (905) 568-9200 • Fax: (905) 568-3740 • www.ksb.ca

16.12.2015
2580.56/06-US