



PUMP SELECTION REPORT

Project Name: imthiyas appartment
Customer Name: imthiyas
Consultant Name: hydrokrat ventures
Project Location: COIMBATORE

Application: Fire Fighting
Duty Point: 180.0 m³/hr @ 75.0 m

Prepared by Hydrokrat AI


Hydrokrat AI Pump Selection Report

Application: Fire Fighting
Flow: 180.0 m³/hr
Head: 75.0 m
Report Date: 03-06-2026 12:59

Fire Pump Selection

Fire Type: Hydrant
Requested Duty Point: 180.0 m³/hr @ 75.0 m
Selected Package: 273 m³/hr @ 88 m
Pump Family: Etanorm
Main Electric Pump: ETN 125-100-250 GC2
Motor: 110 kW
Standby Diesel Pump: ETN 150-125-400 GI4
Diesel Engine: 167 BHP
Jockey Pump: ETB 065-040-160 GI4

Pump Performance Curve

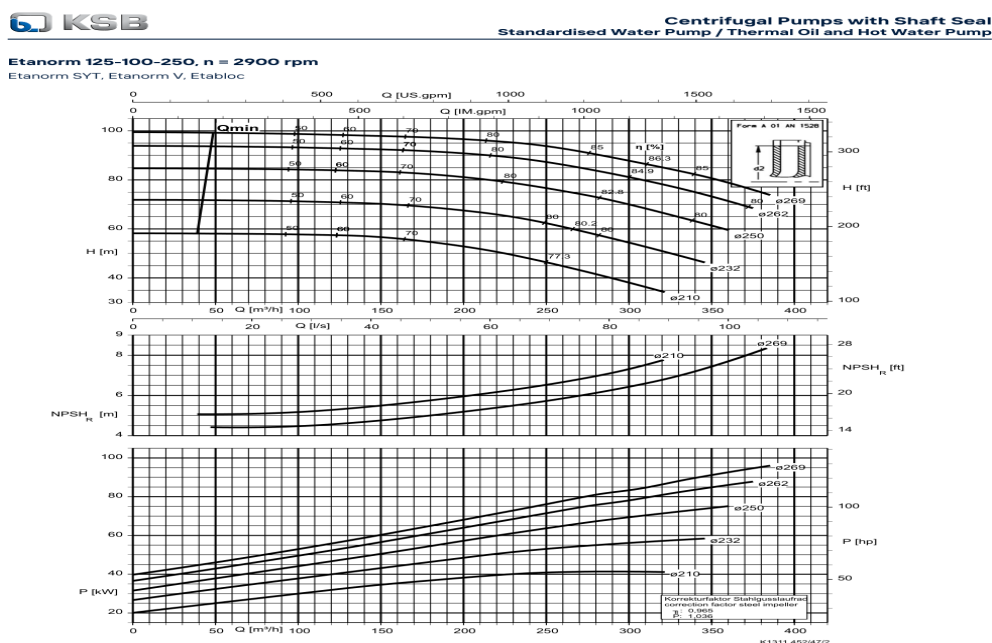

131145/12-EN

www.hydrokratpumps.in

Generated by Hydrokrat AI