


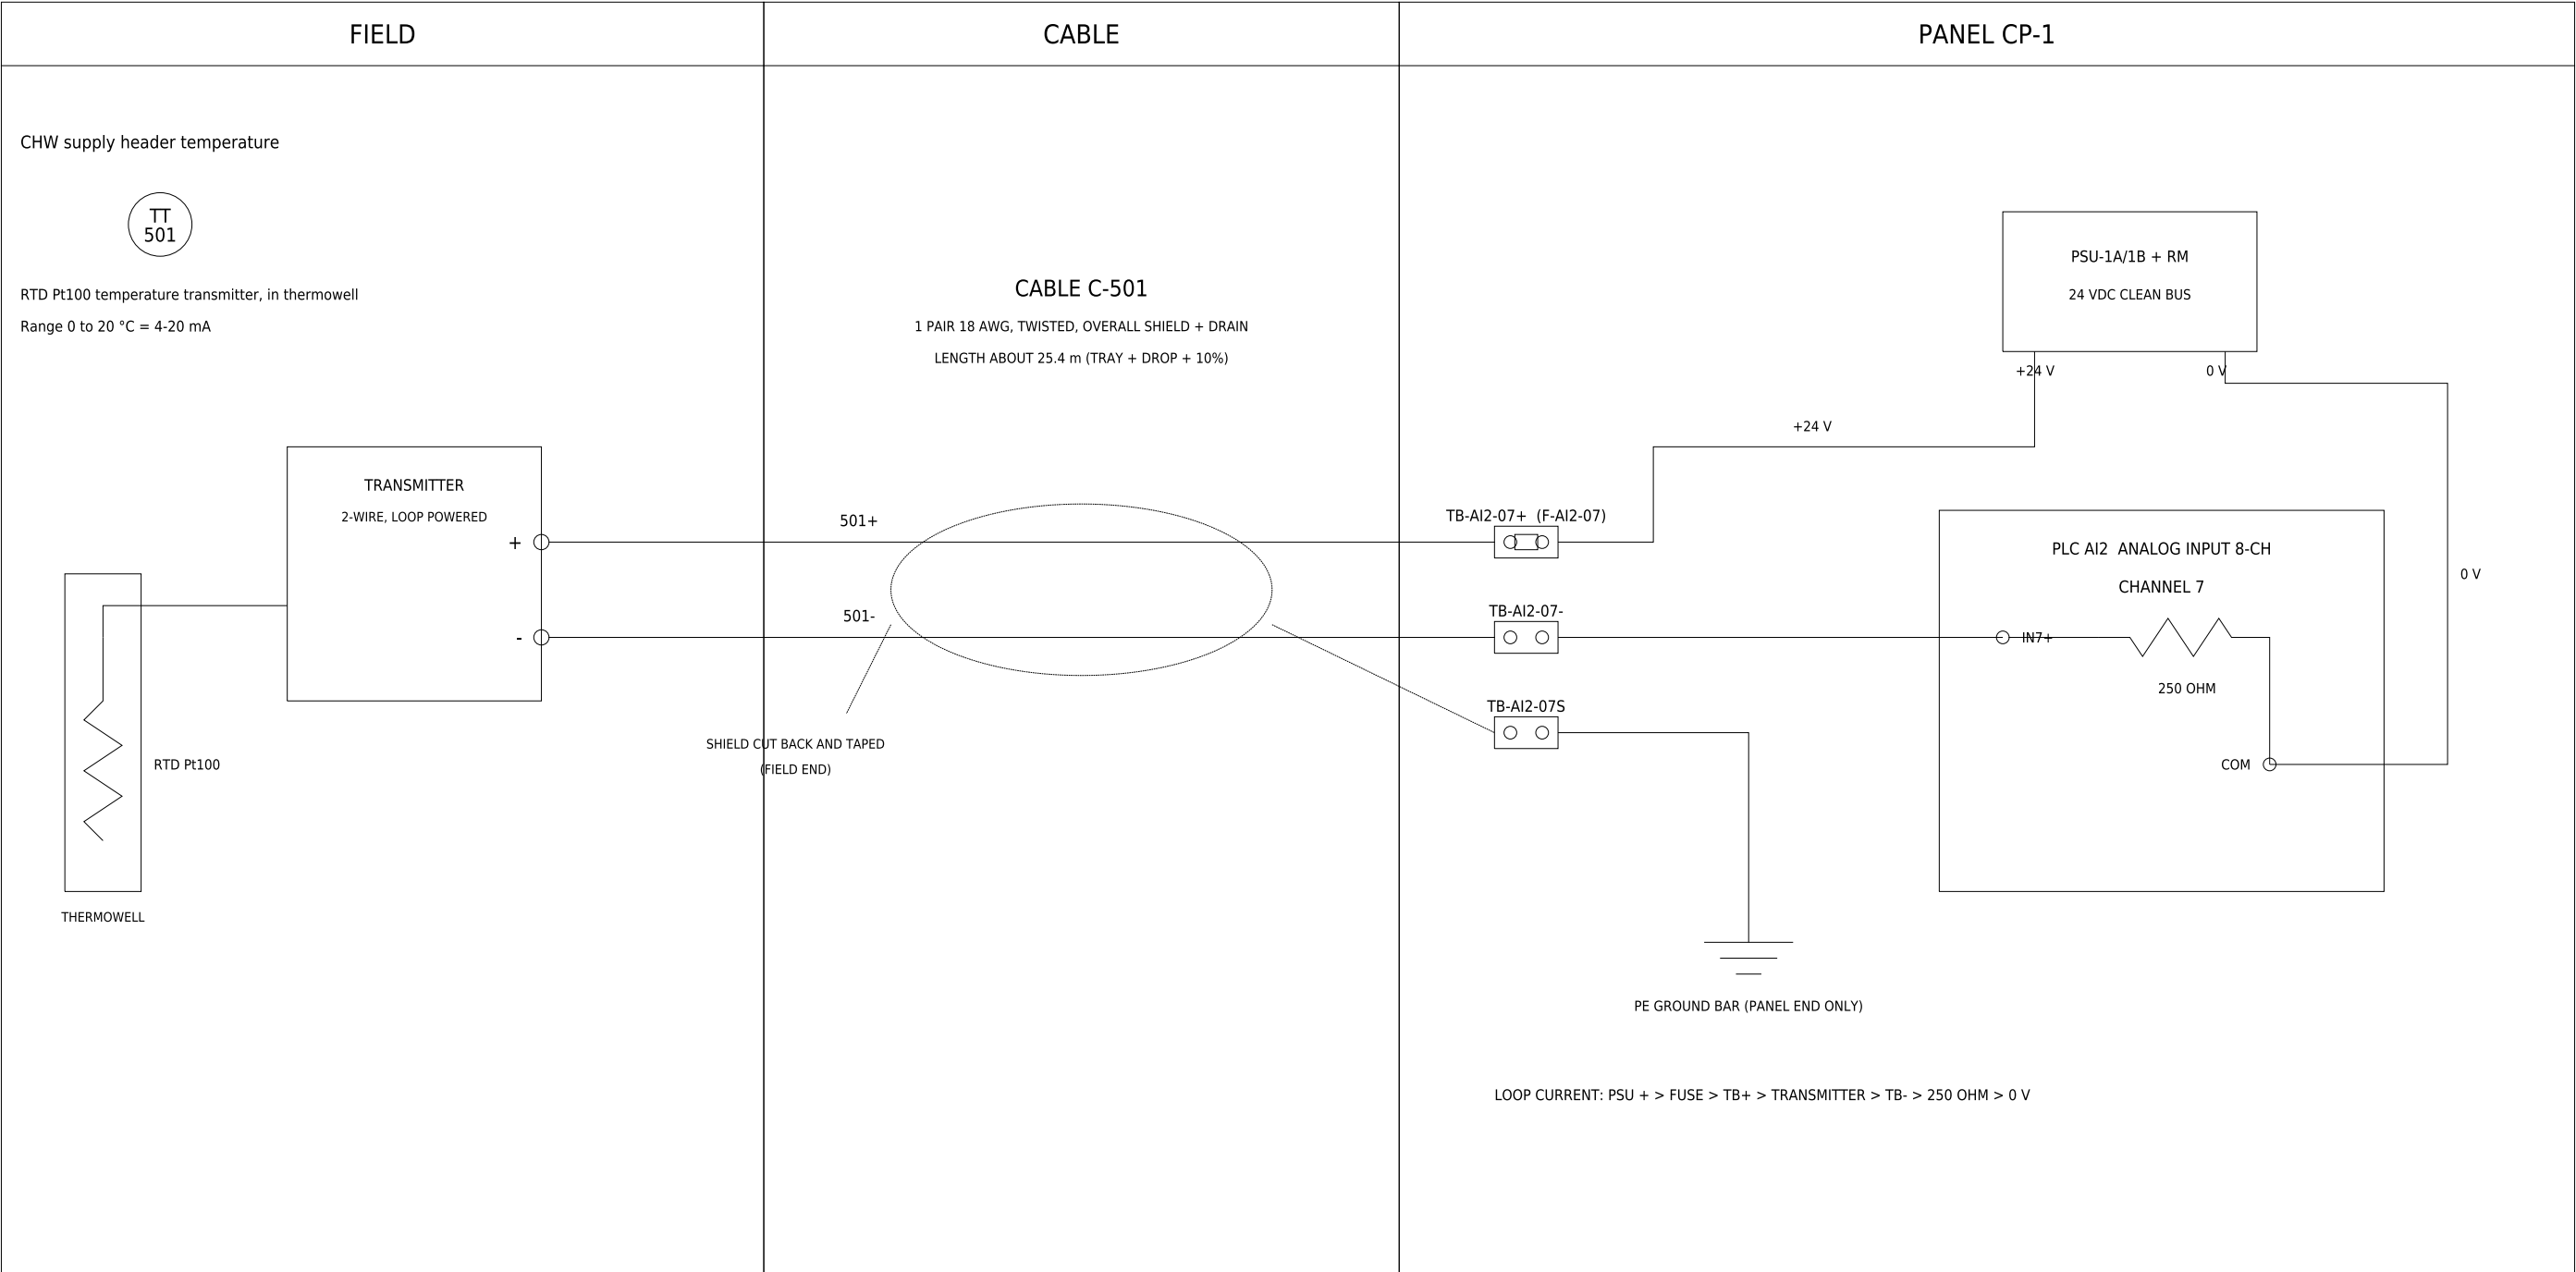

- NOTES
- 1. TT-501: CHW supply header temperature. Index row: 4-20 mA, loop powered Y, AI AI2 ch 7.
 - 2. Shield grounded at the panel end only; cut back and taped at the field end (no ground loop).
 - 3. Cable: about 25.4 m, 1-pair 18 AWG shielded.
 - 4. Wire numbers per loop number; terminals and fuse per the I/O list (data/io_list.xlsx). Home run, no junction box.

NOT FOR CONSTRUCTION - PORTFOLIO PROJECT

REV	DATE	DESCRIPTION
A	2026-10-08	ISSUED FOR REVIEW

Data Center Chilled Water Plant - I&C Package	
LOOP DIAGRAM TT-501 (ANALOG INPUT, 2-WIRE)	
DWG DC-E-201	REV A
DATE 2026-10-08 SCALE NTS DRAWN S. Anandkumar	SHEET ANSI B