


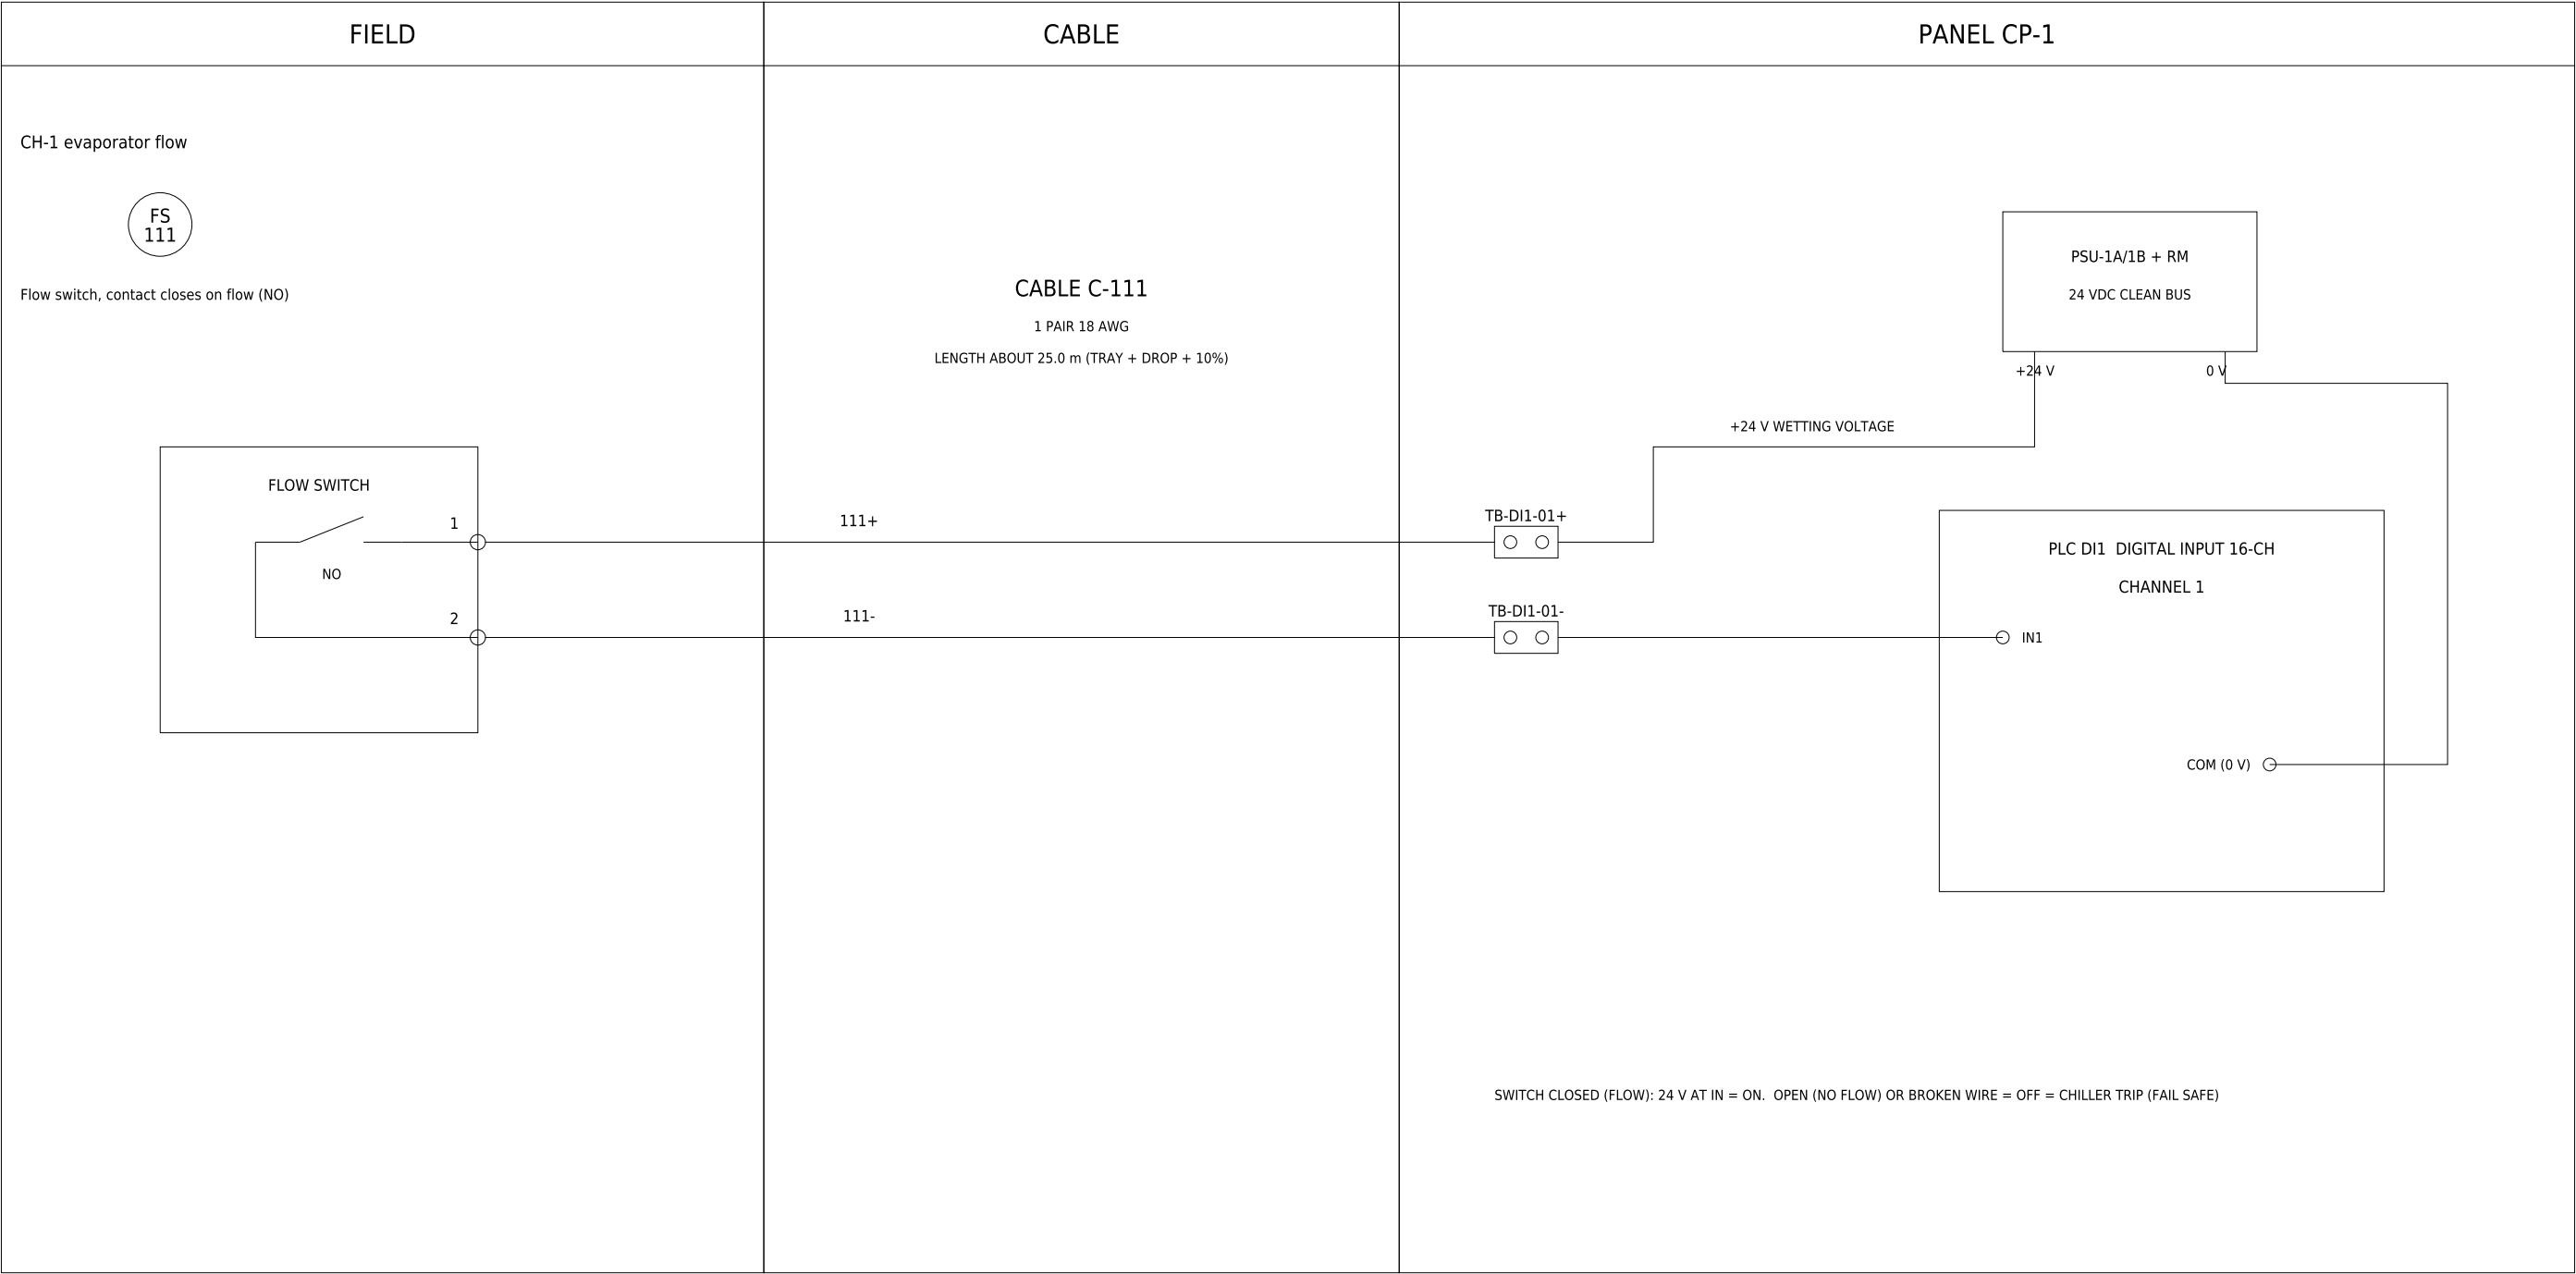

- NOTES
- 1. FS-111: CH-1 evaporator flow. Dry contact, DI DI1 ch 1. Interlock: no flow, no chiller start (freeze protection).
 - 2. The panel supplies the 24 V wetting voltage; the switch only opens or closes the circuit.
 - 3. Used in the chiller start permissive and flow-loss trip (docs/01-system-basis.md, Interlocks).
 - 4. Wire numbers per loop number; terminals per the I/O list (data/io_list.xlsx). Home run, no junction box.

NOT FOR CONSTRUCTION - PORTFOLIO PROJECT

REV	DATE	DESCRIPTION
A	2026-10-08	ISSUED FOR REVIEW

Data Center Chilled Water Plant - I&C Package	
LOOP DIAGRAM FS-111 (DIGITAL INPUT, DRY CONTACT)	
DWG DC-E-202	REV A
DATE 2026-10-08 SCALE NTS DRAWN S. Anandkumar	SHEET ANSI B